


Post Insulator Construction
13/23 KV Target Pole

E-1 Fig-1

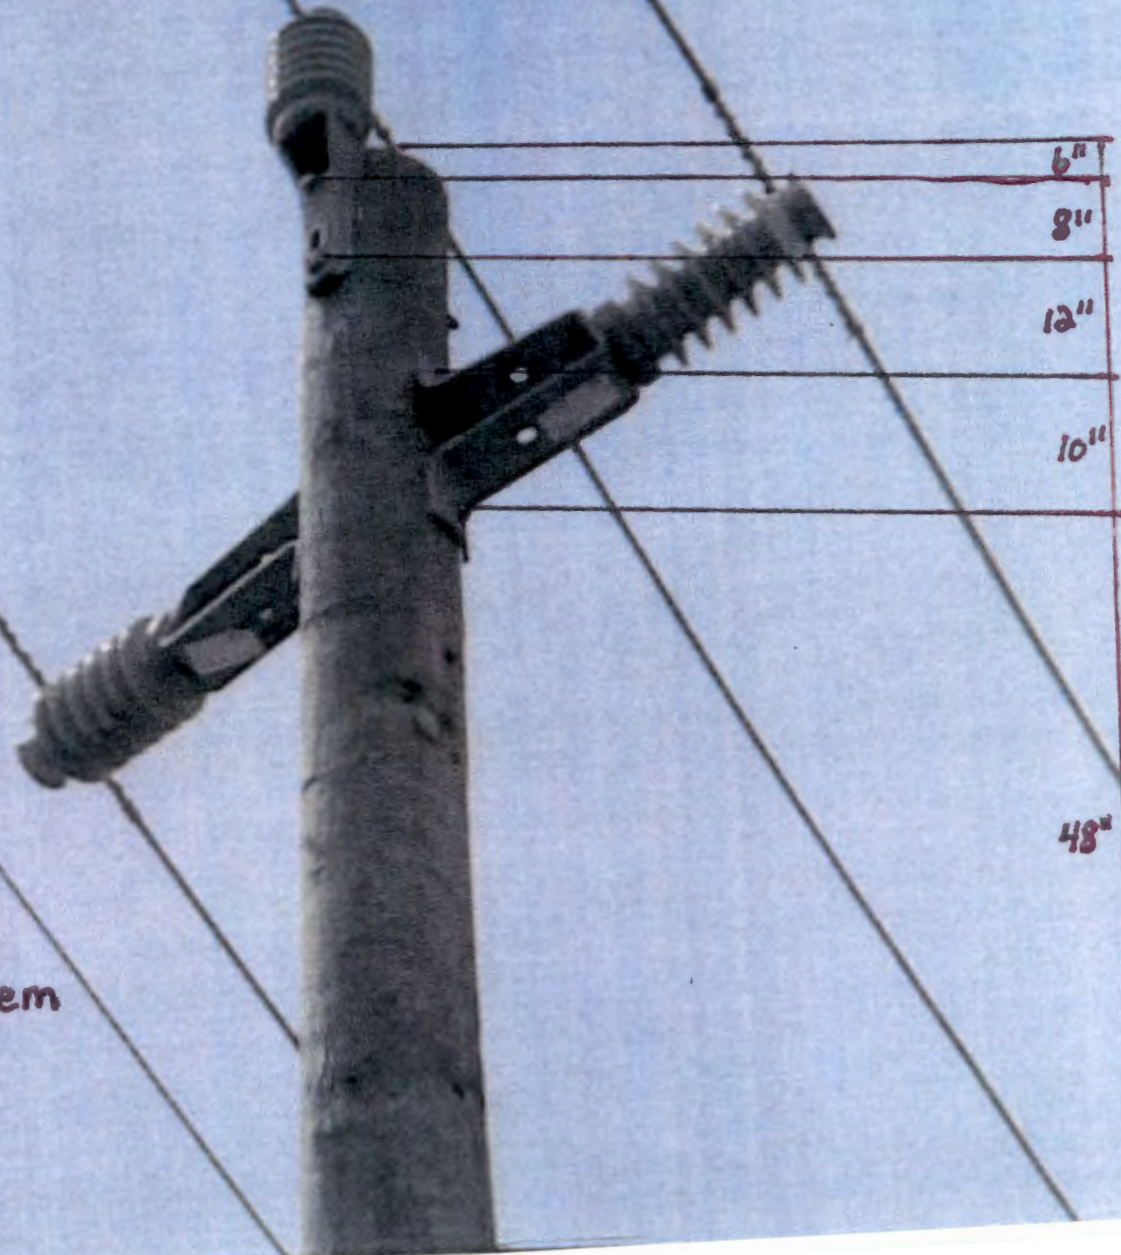


CBTS
H & UG Distribution System
Standards

E-1 Fig-1

Post Insulator Construction
13/23 KV Target Pole

E-1 Fig2

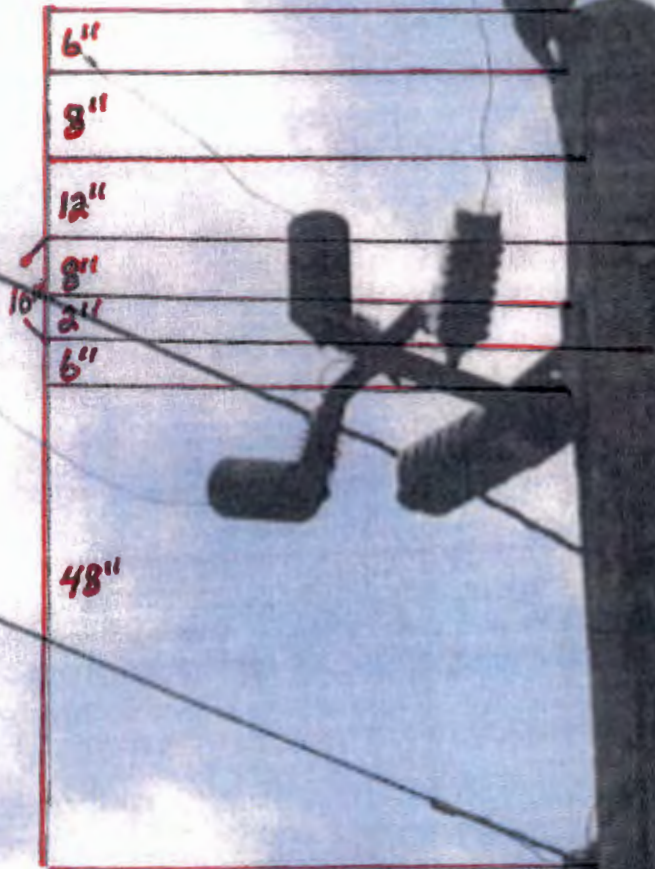

CBTS
OH & UG Distribution System
Standards

E-1 Fig-2

Post Insulator Construction
13/23KV Target Pole

E-1 Fig-3




CBTS
OH+UG Distribution System
Standards

E-1 Fig-3

Post Insulator Construction 13/23 KV Vertical Pole

E-2 Fig-1

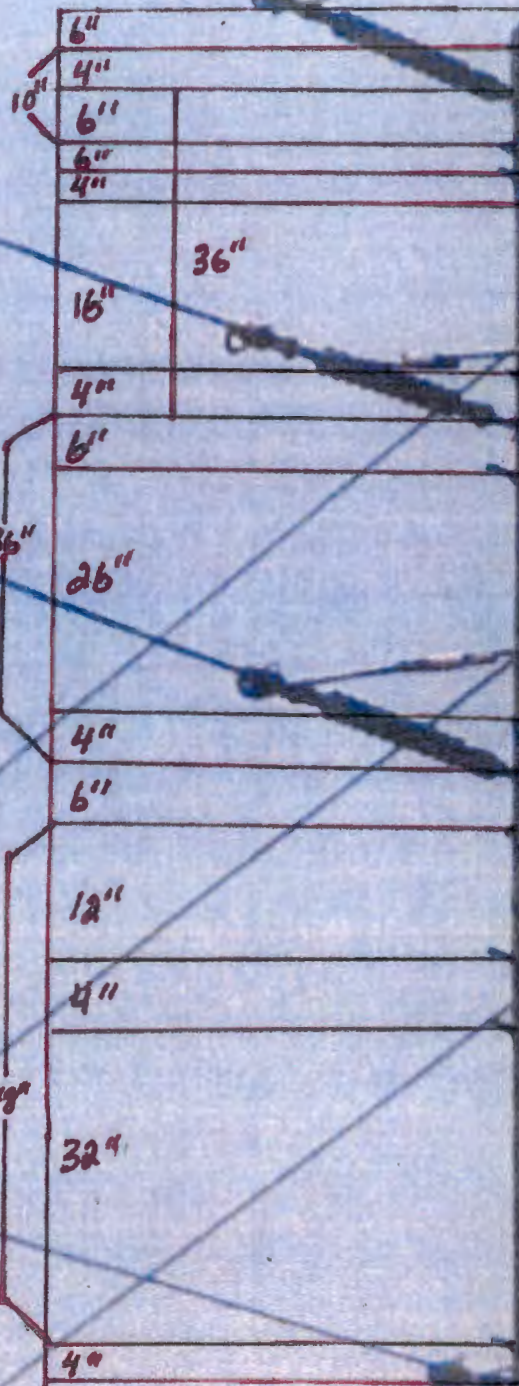


C.B.T.S.
OH & UG Distribution System
Standards

E-2 Fig-1

Post Insulator Construction
13/23 KV Dead end with
jumper pins

E-2 Fig 2

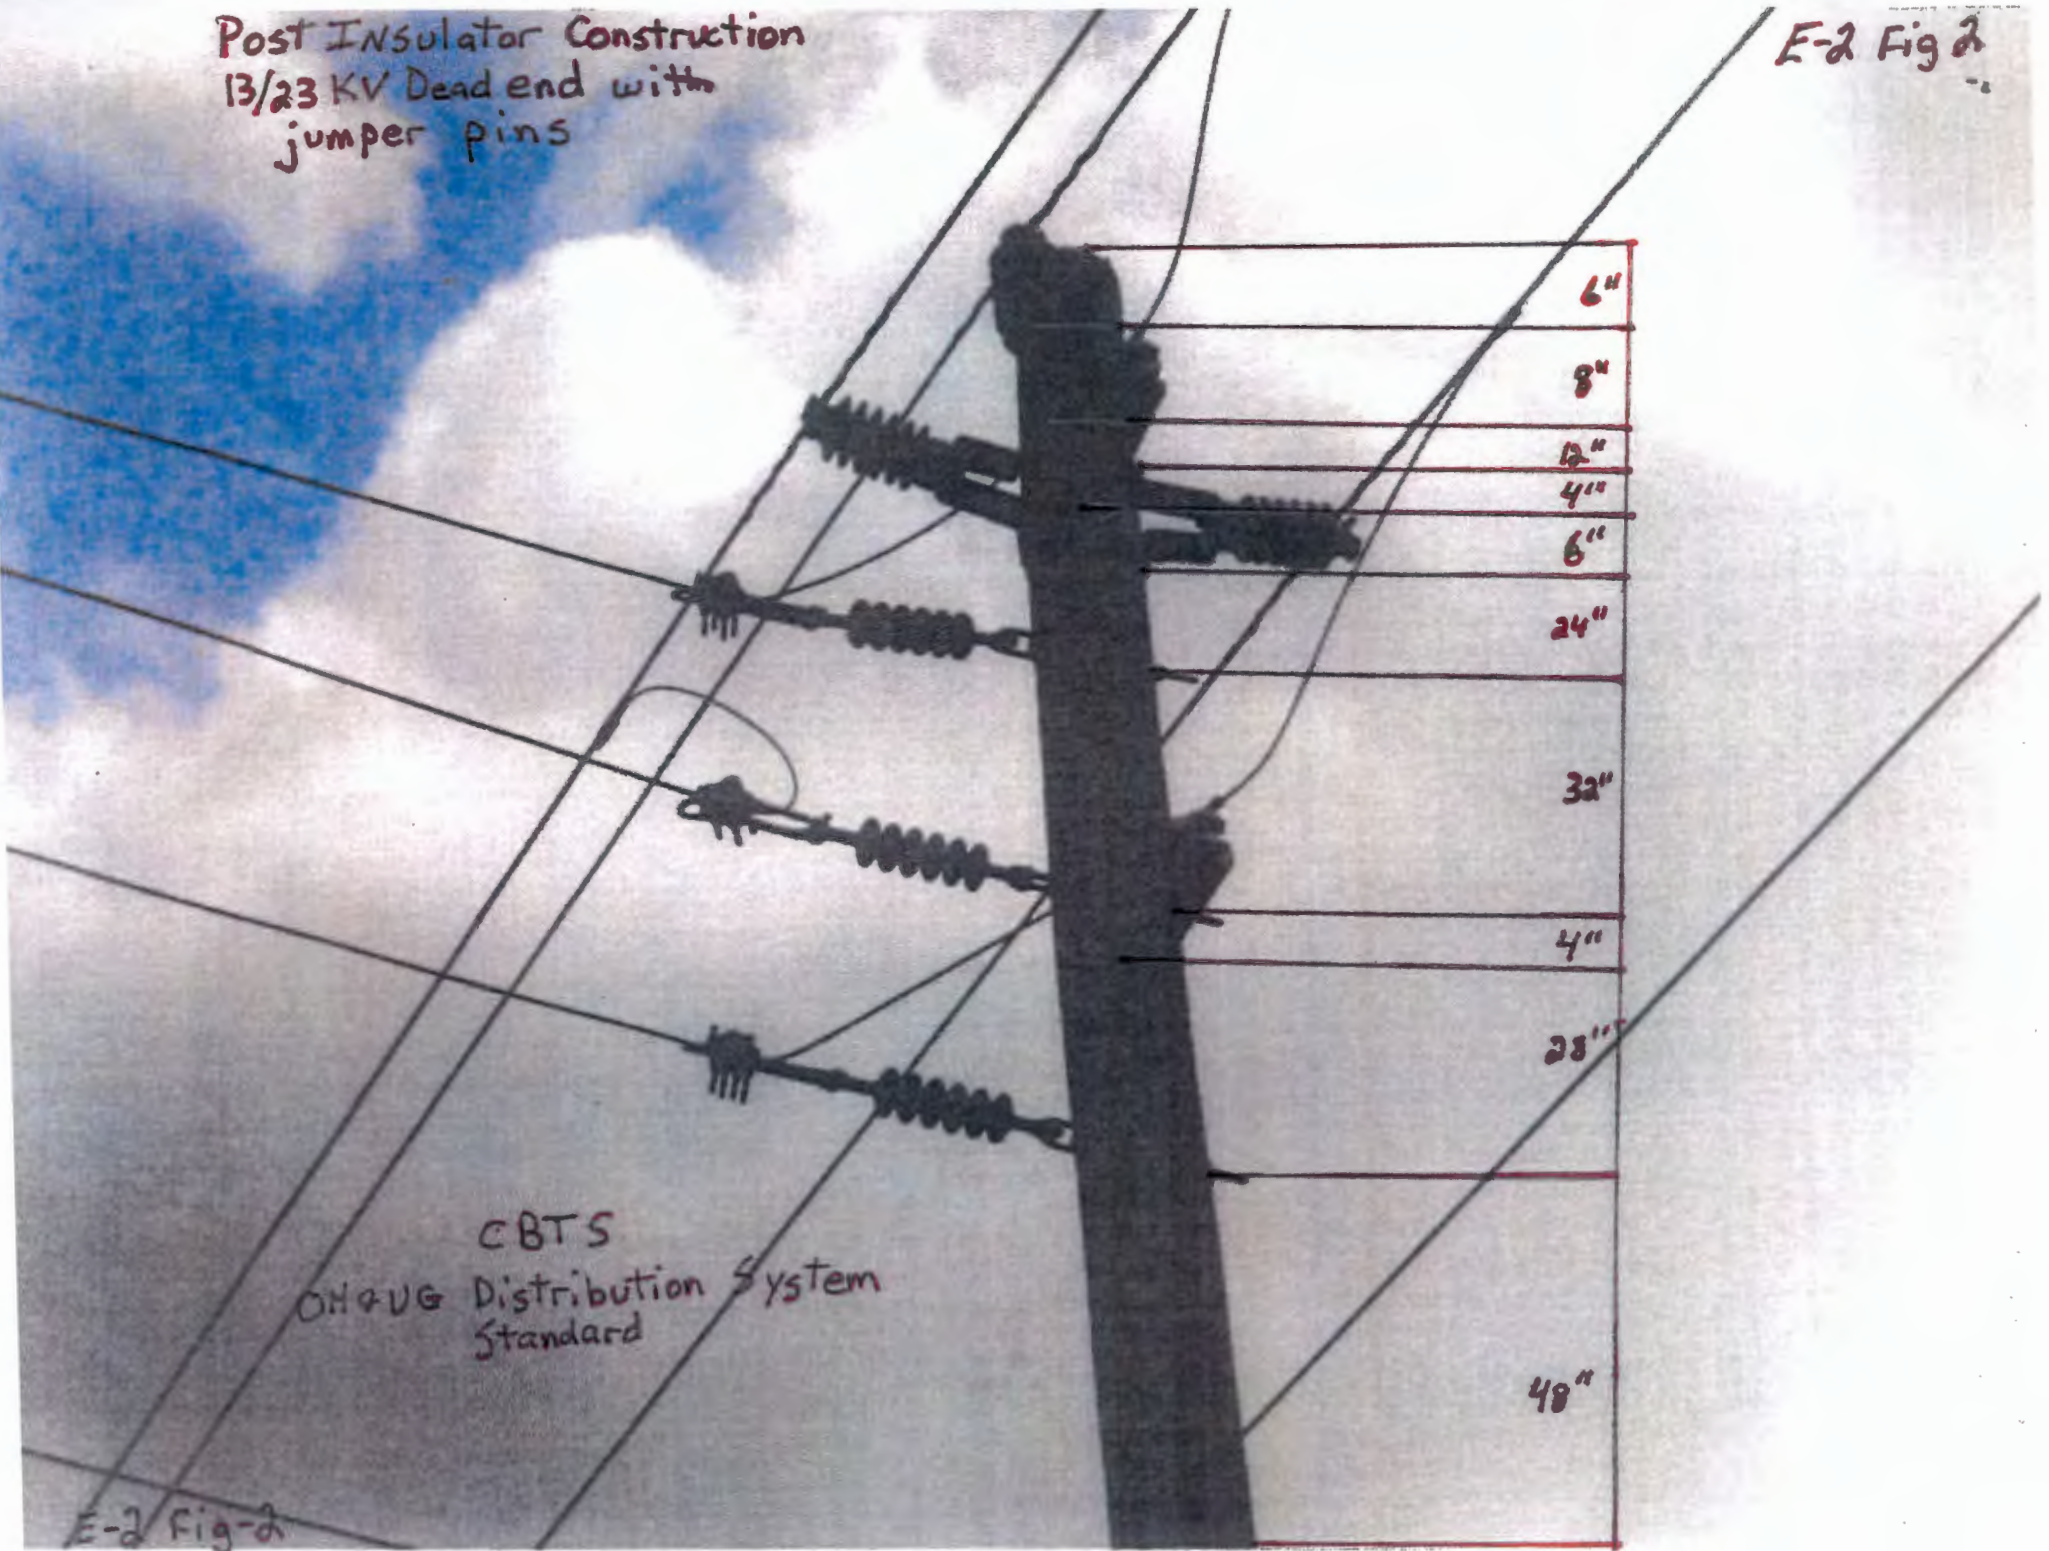


CBTS
OH & UG Distribution System
Standard

E-2 Fig-2

Post Insulator Construction
13/23 KV Dead END


E-2 Fig-21

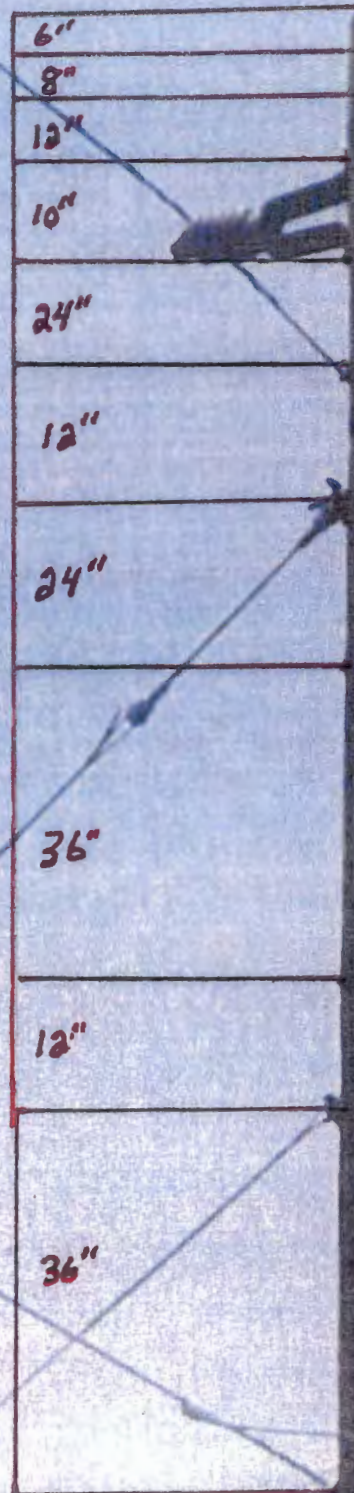

CBT 5
OH & UG Distribution System
Standard

Post Insulator Construction
13/23 KV Dead end with Switch

E-2 Fig 3

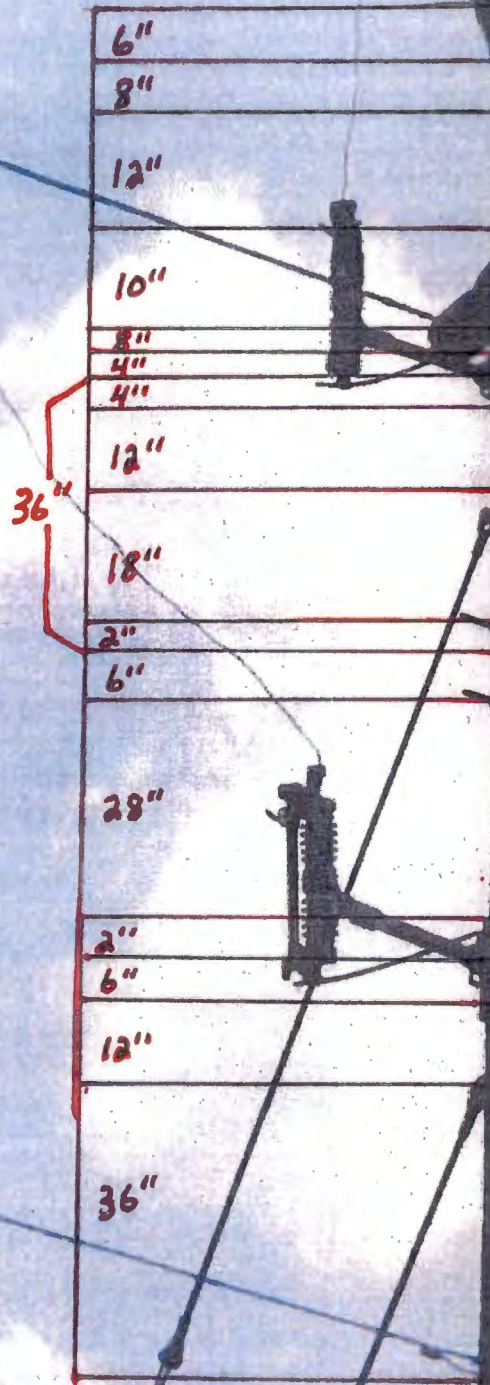

CBTS
OH & UG Distribution System
Standard

E-2 Fig 3


Post Insulator Construction
13/23 KV Dead End with switch

E-2 Fig 3

6"
8"
12"
10"
4"
4"
12"
36"
18"
6"
6"
28"
2"
6"
12"
36"


CBTS
OH & UG Distribution System
Standard

E-2 Fig 3

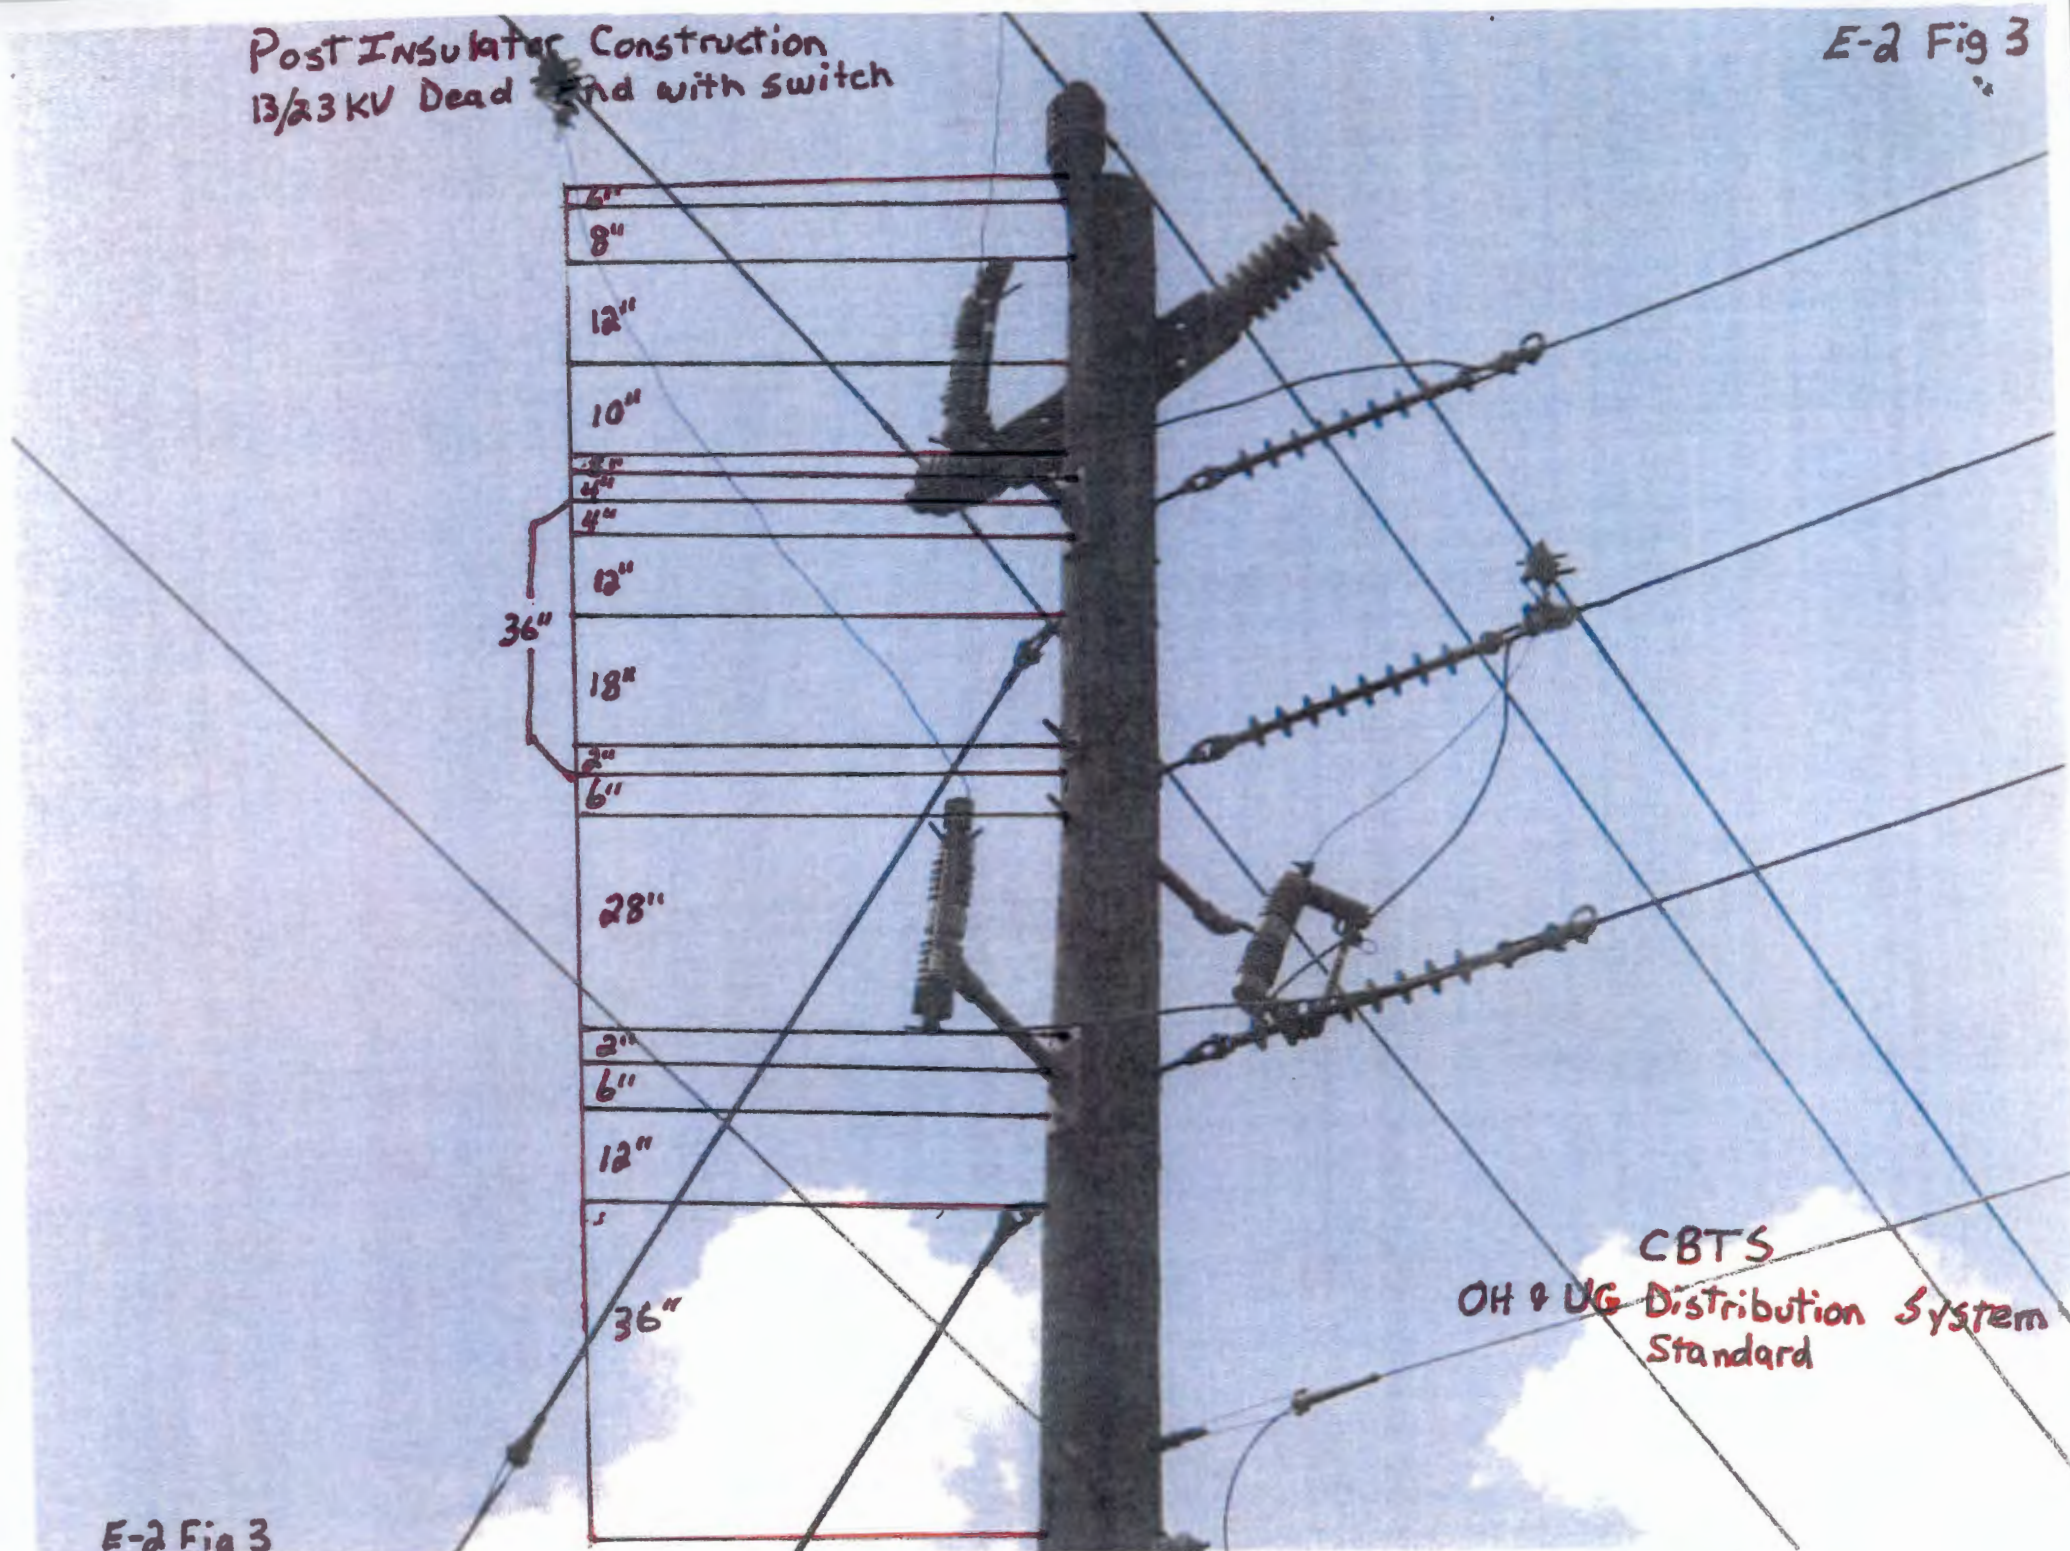

Post Insulator Construction
13/23 KV 1 ϕ Dead end with Switch

E-2 Fig 4

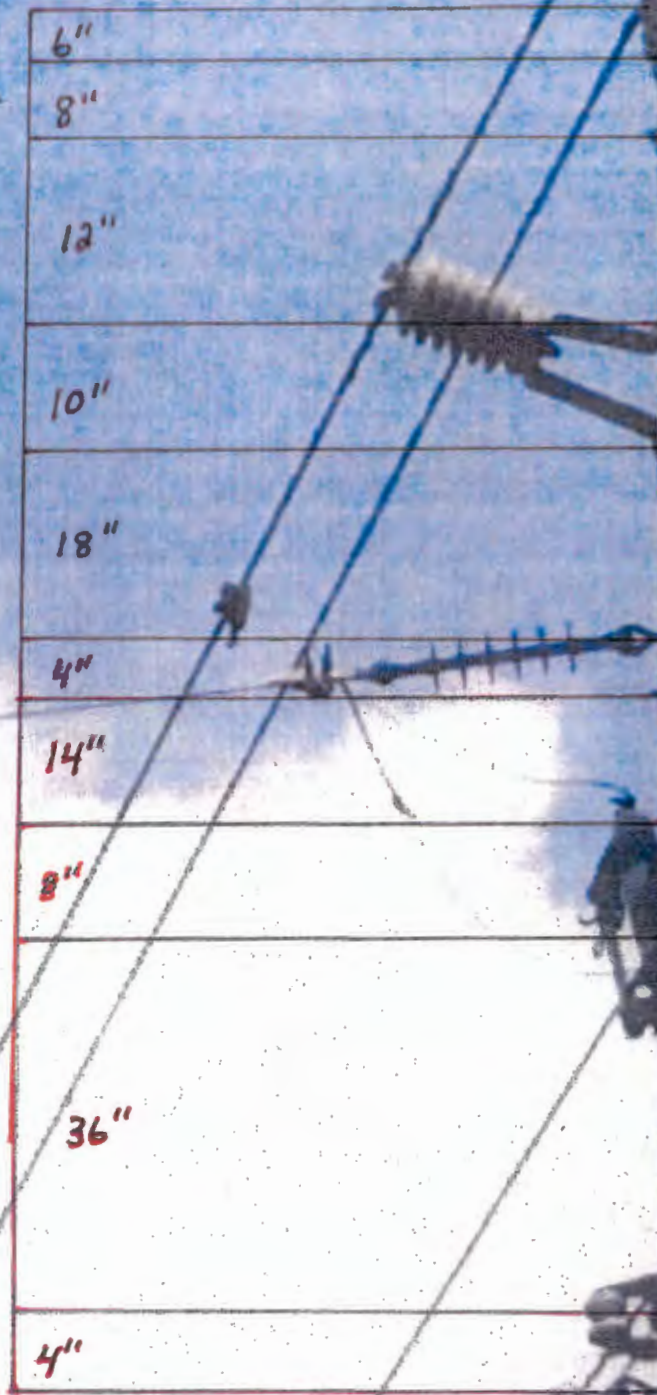

CBTS
OH & UG Distribution System
Standard

E-2 Fig 4

Post Insulator Construction
13/23 KV Xarm Dead end with switch

E-3 Fig-1

E-1 Fig-1 →

36"

24"

8"

4"


36"

CBTS
OH & UG Distribution System
Standard

E-3 Fig-1

Post Insulator Construction
13/23 KV Xarm Dead end

E3 Fig 2

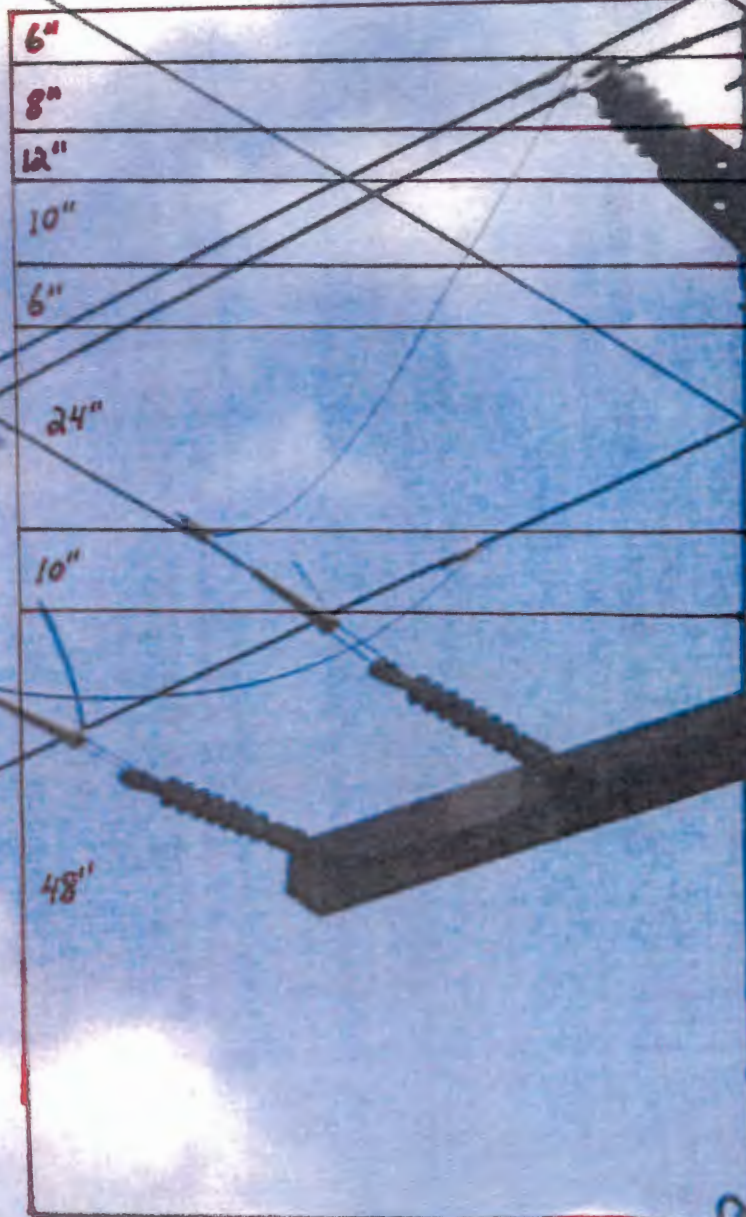


CBTS
OH & UG Distribution System
Standard

E-3 Fig-2

Vertical Construction
3 ϕ double Dead end
13/23 KV

ED-1 Fig-1

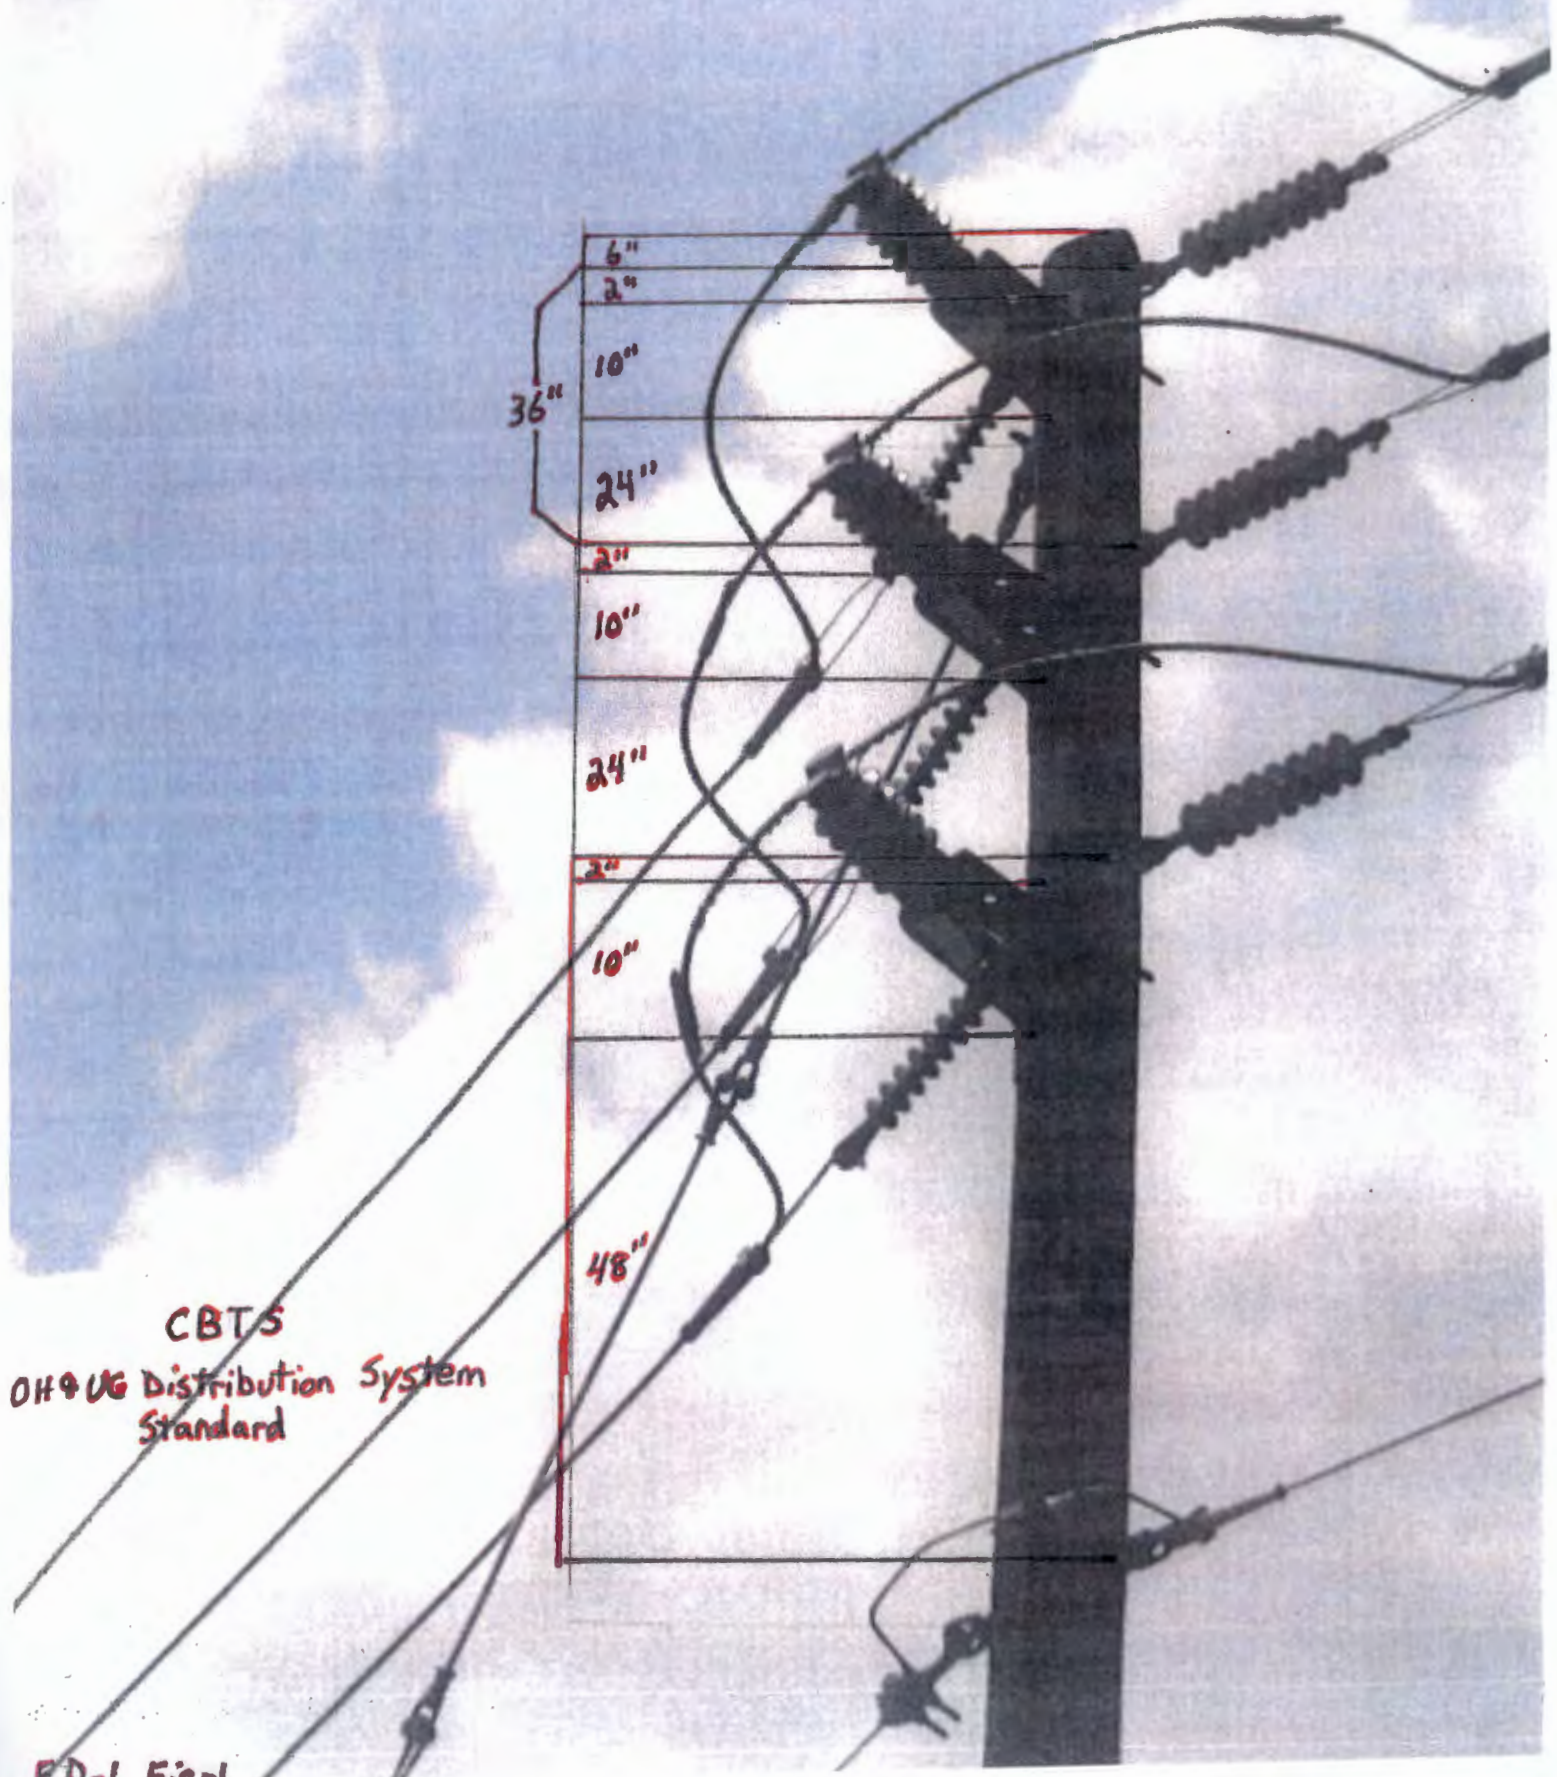

Vertical Construction
3 ϕ double Dead end
13/23 KV

ED-I Fig-2

6"
3"
10"
24"
3"
10"
24"
3"
10"
1/2"

CBTS
OH & UG Distribution System
Standard

ED-I Fig-2

Vertical Construction
angle double Dead END
13/23 KV

ED-1 Fig-3




CBTS

H9UG Distribution System
Standard

ED-1 Fig-3

Vertical Construction
3 way Dead End
13/23 KV

ED-2 Fig 1

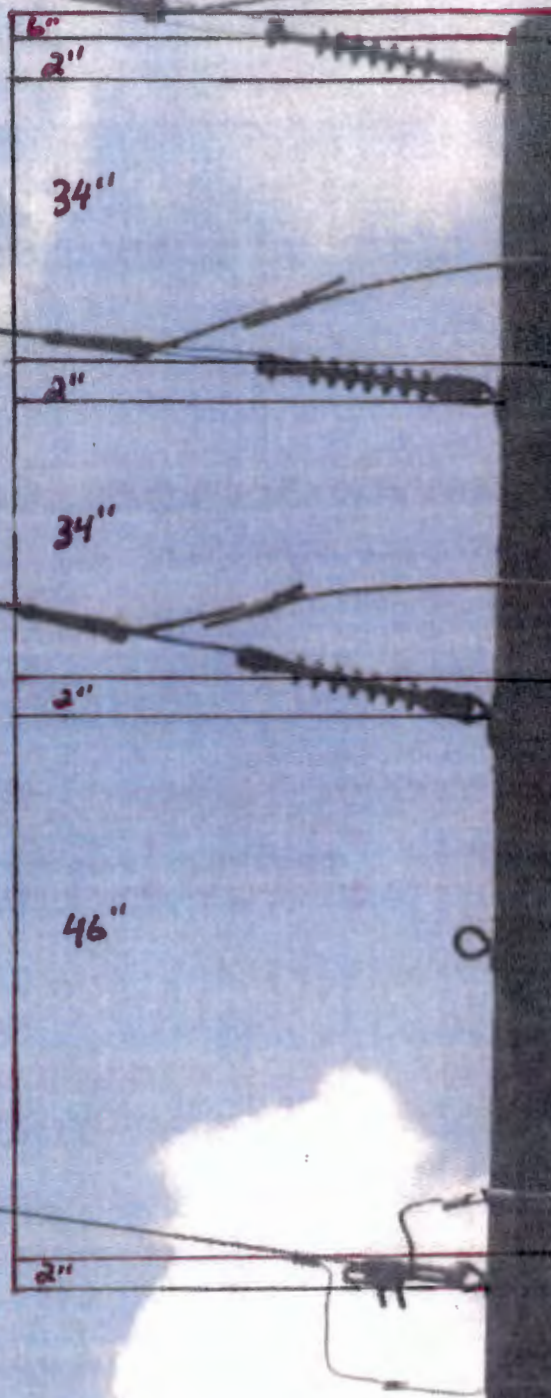


CBTS
OH & UG Distribution System
Standard

ED-2 Fig-1

Vertical Construction
3 way Dead END
13/23 KV

ED-2 Fig-2

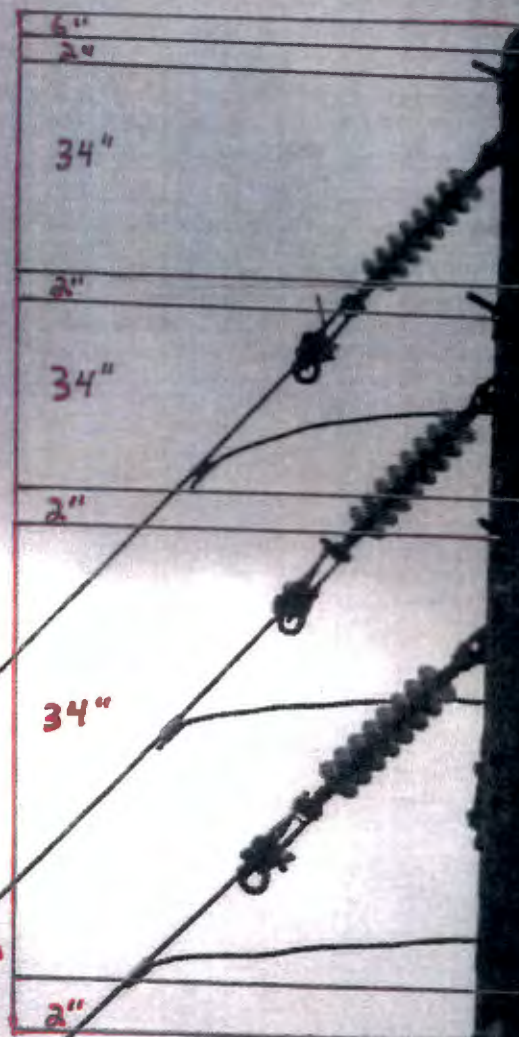


CBTS

OH & UG Distribution System
Standard

ED-2 Fig-2

Vertical Construction
Rec 13/23KV


ER 1 Fig 1

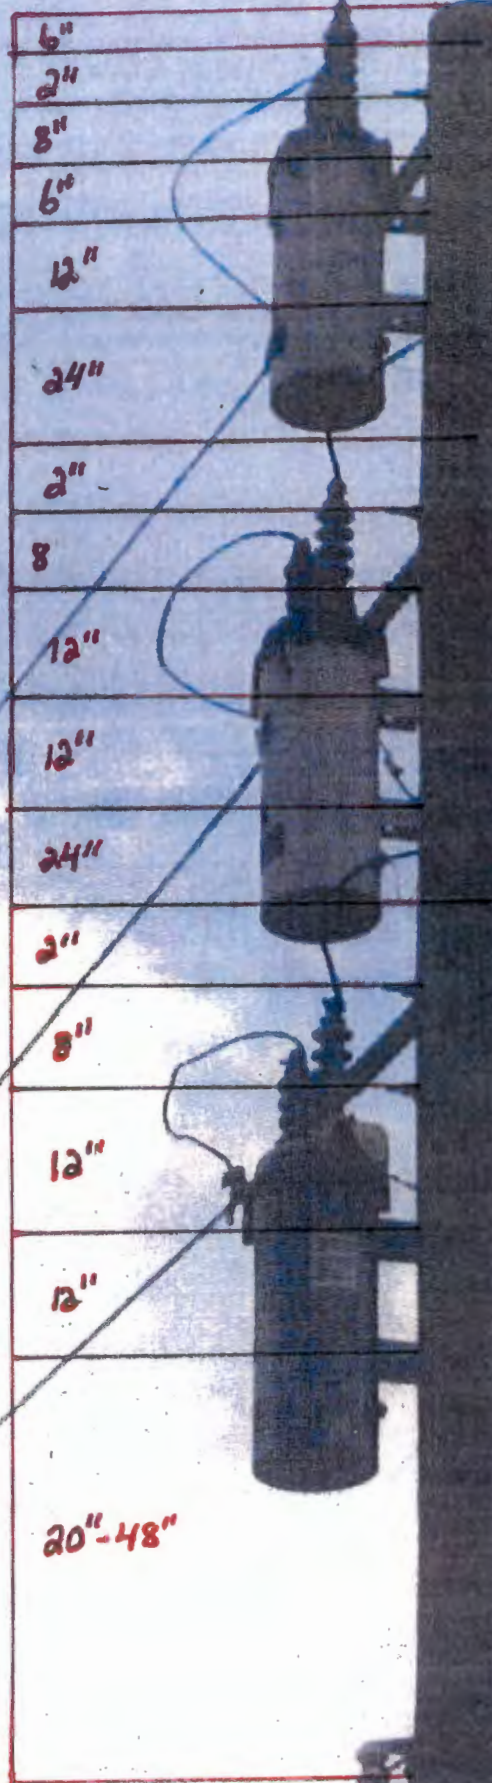

CBTS
OH+UG Distribution System
Standard

ER1 Fig 2

Xarm Construction
13/23 KV Rec

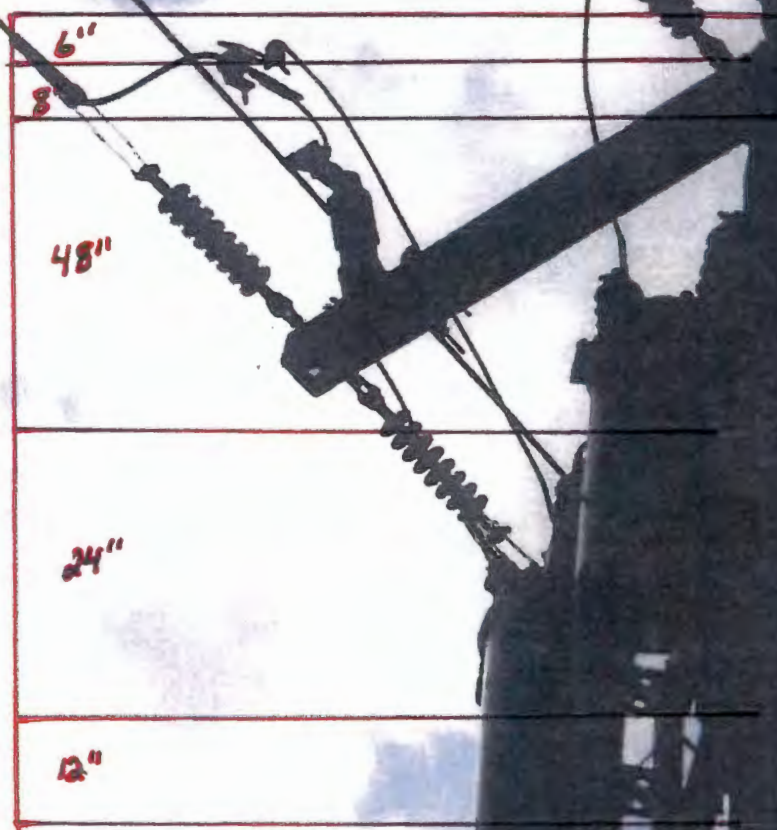

CBTS
2H9 UG Distribution System
Standard

ER1 Fig 2

Post INSULATOR Construction
13/23 KV 1Ø Transformer:


ET 1 Fig 1

6"
8"
12"
10"
4"
8"
40"
12"
18"

CBTS
OH & UG Distribution System
Standard

Post Insulator Construction
13/23 KV 3 ϕ Transformer

ET 2 Fig 1

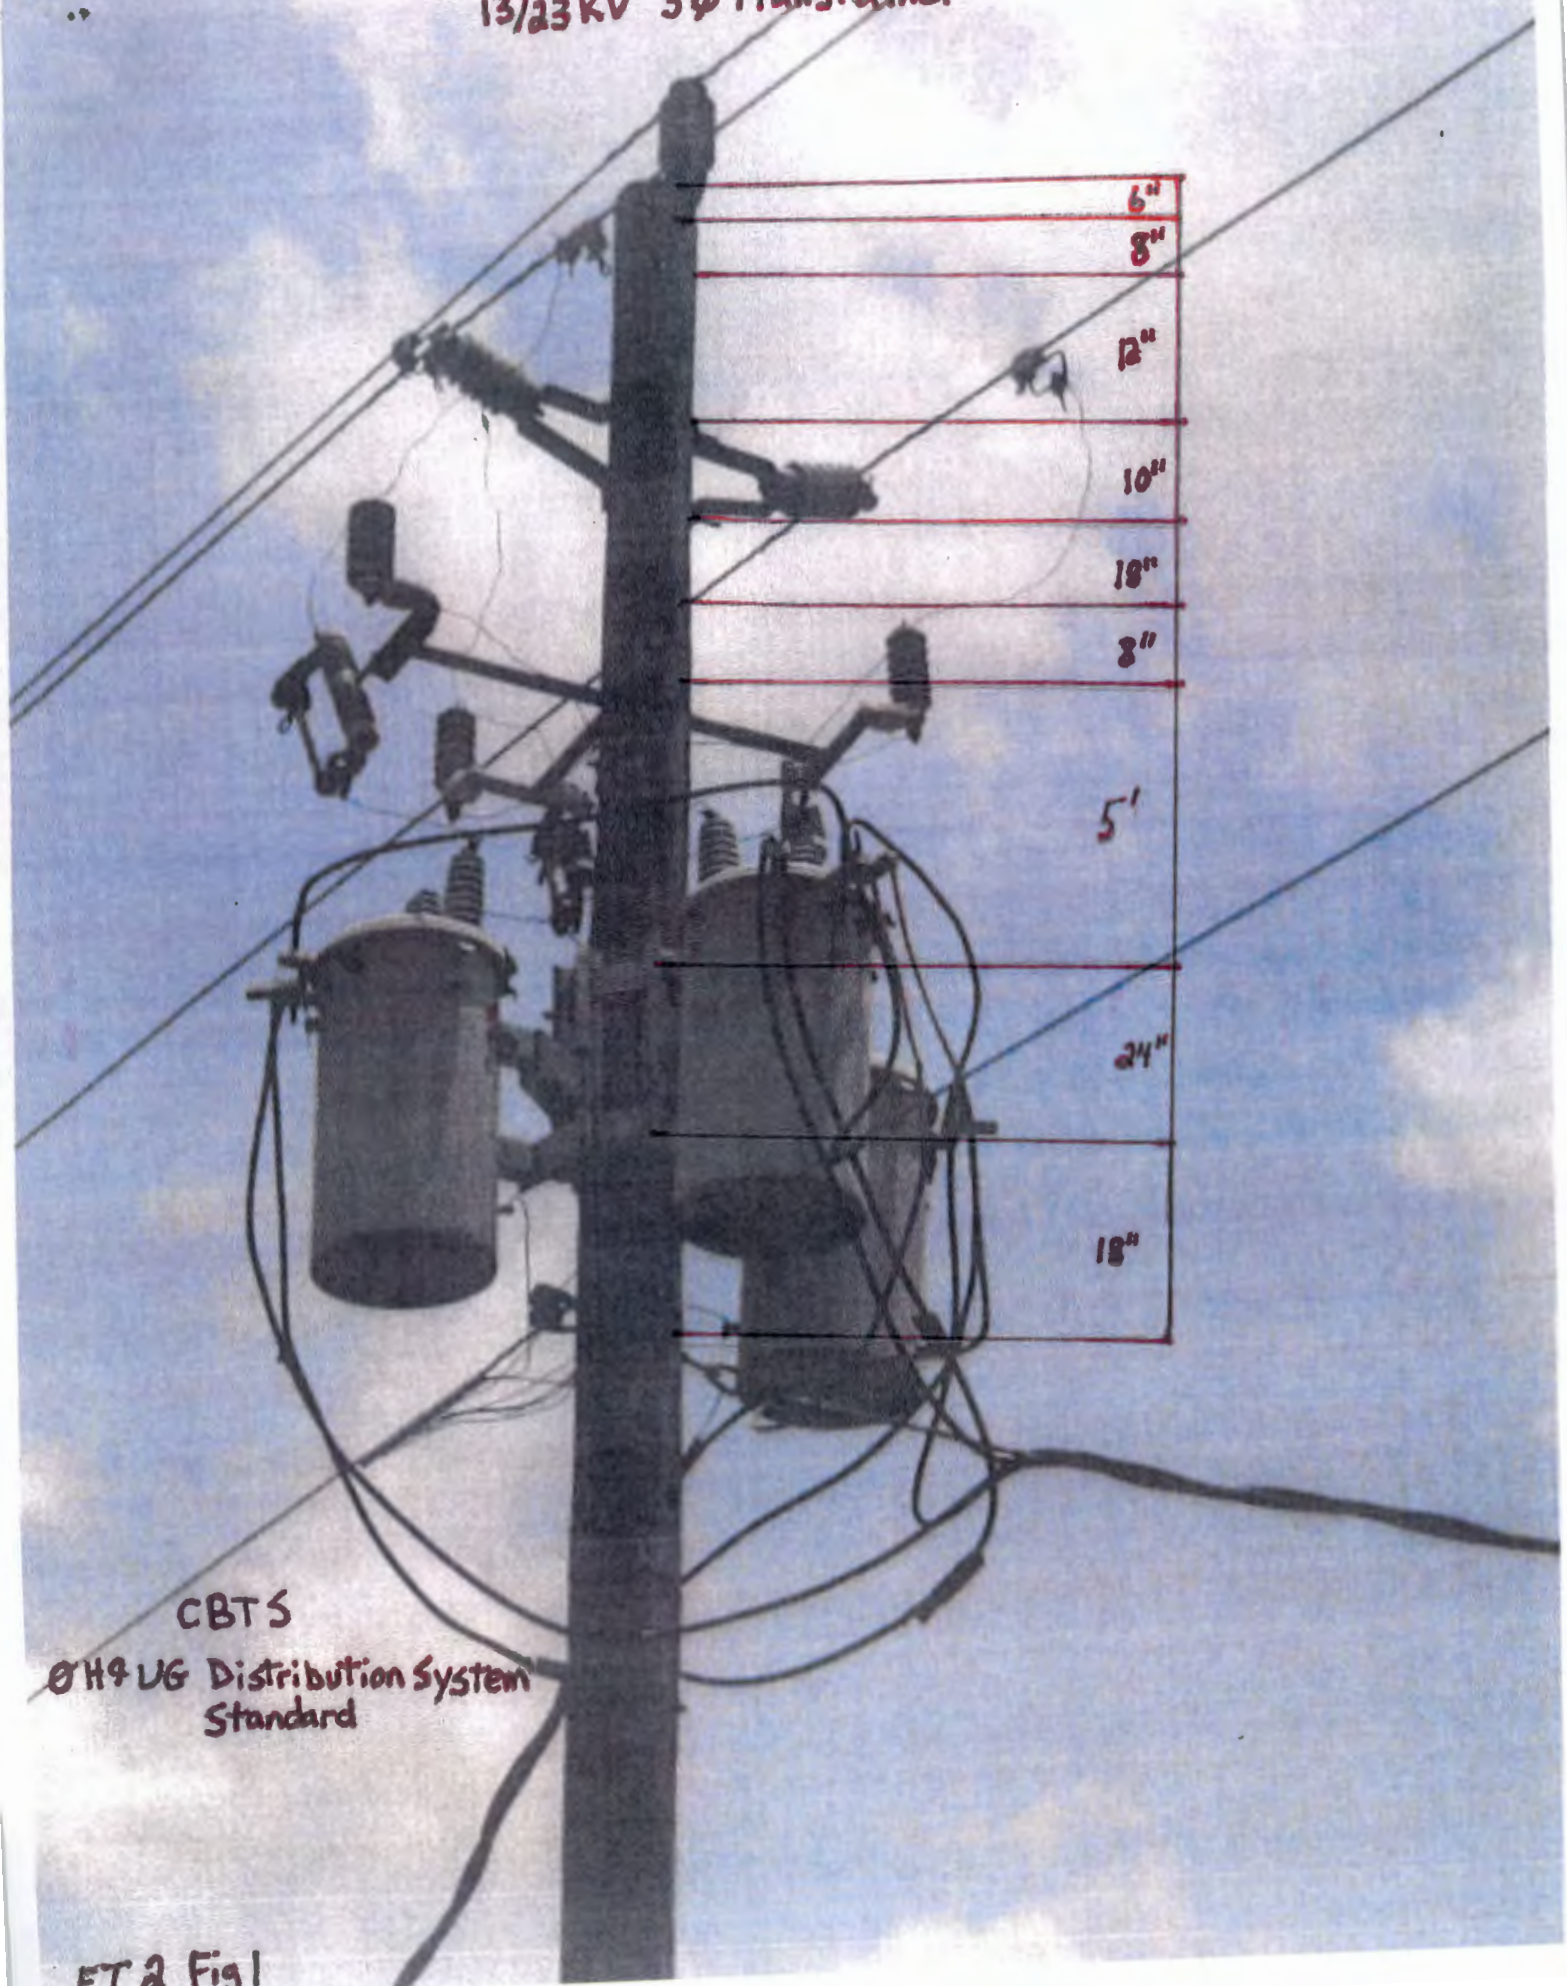


CBTS
ØH 9 UG Distribution System
Standard

ET 2 Fig 1

Vertical Construction
13/23 KV 3 ϕ Transformer

ET2 Fig2

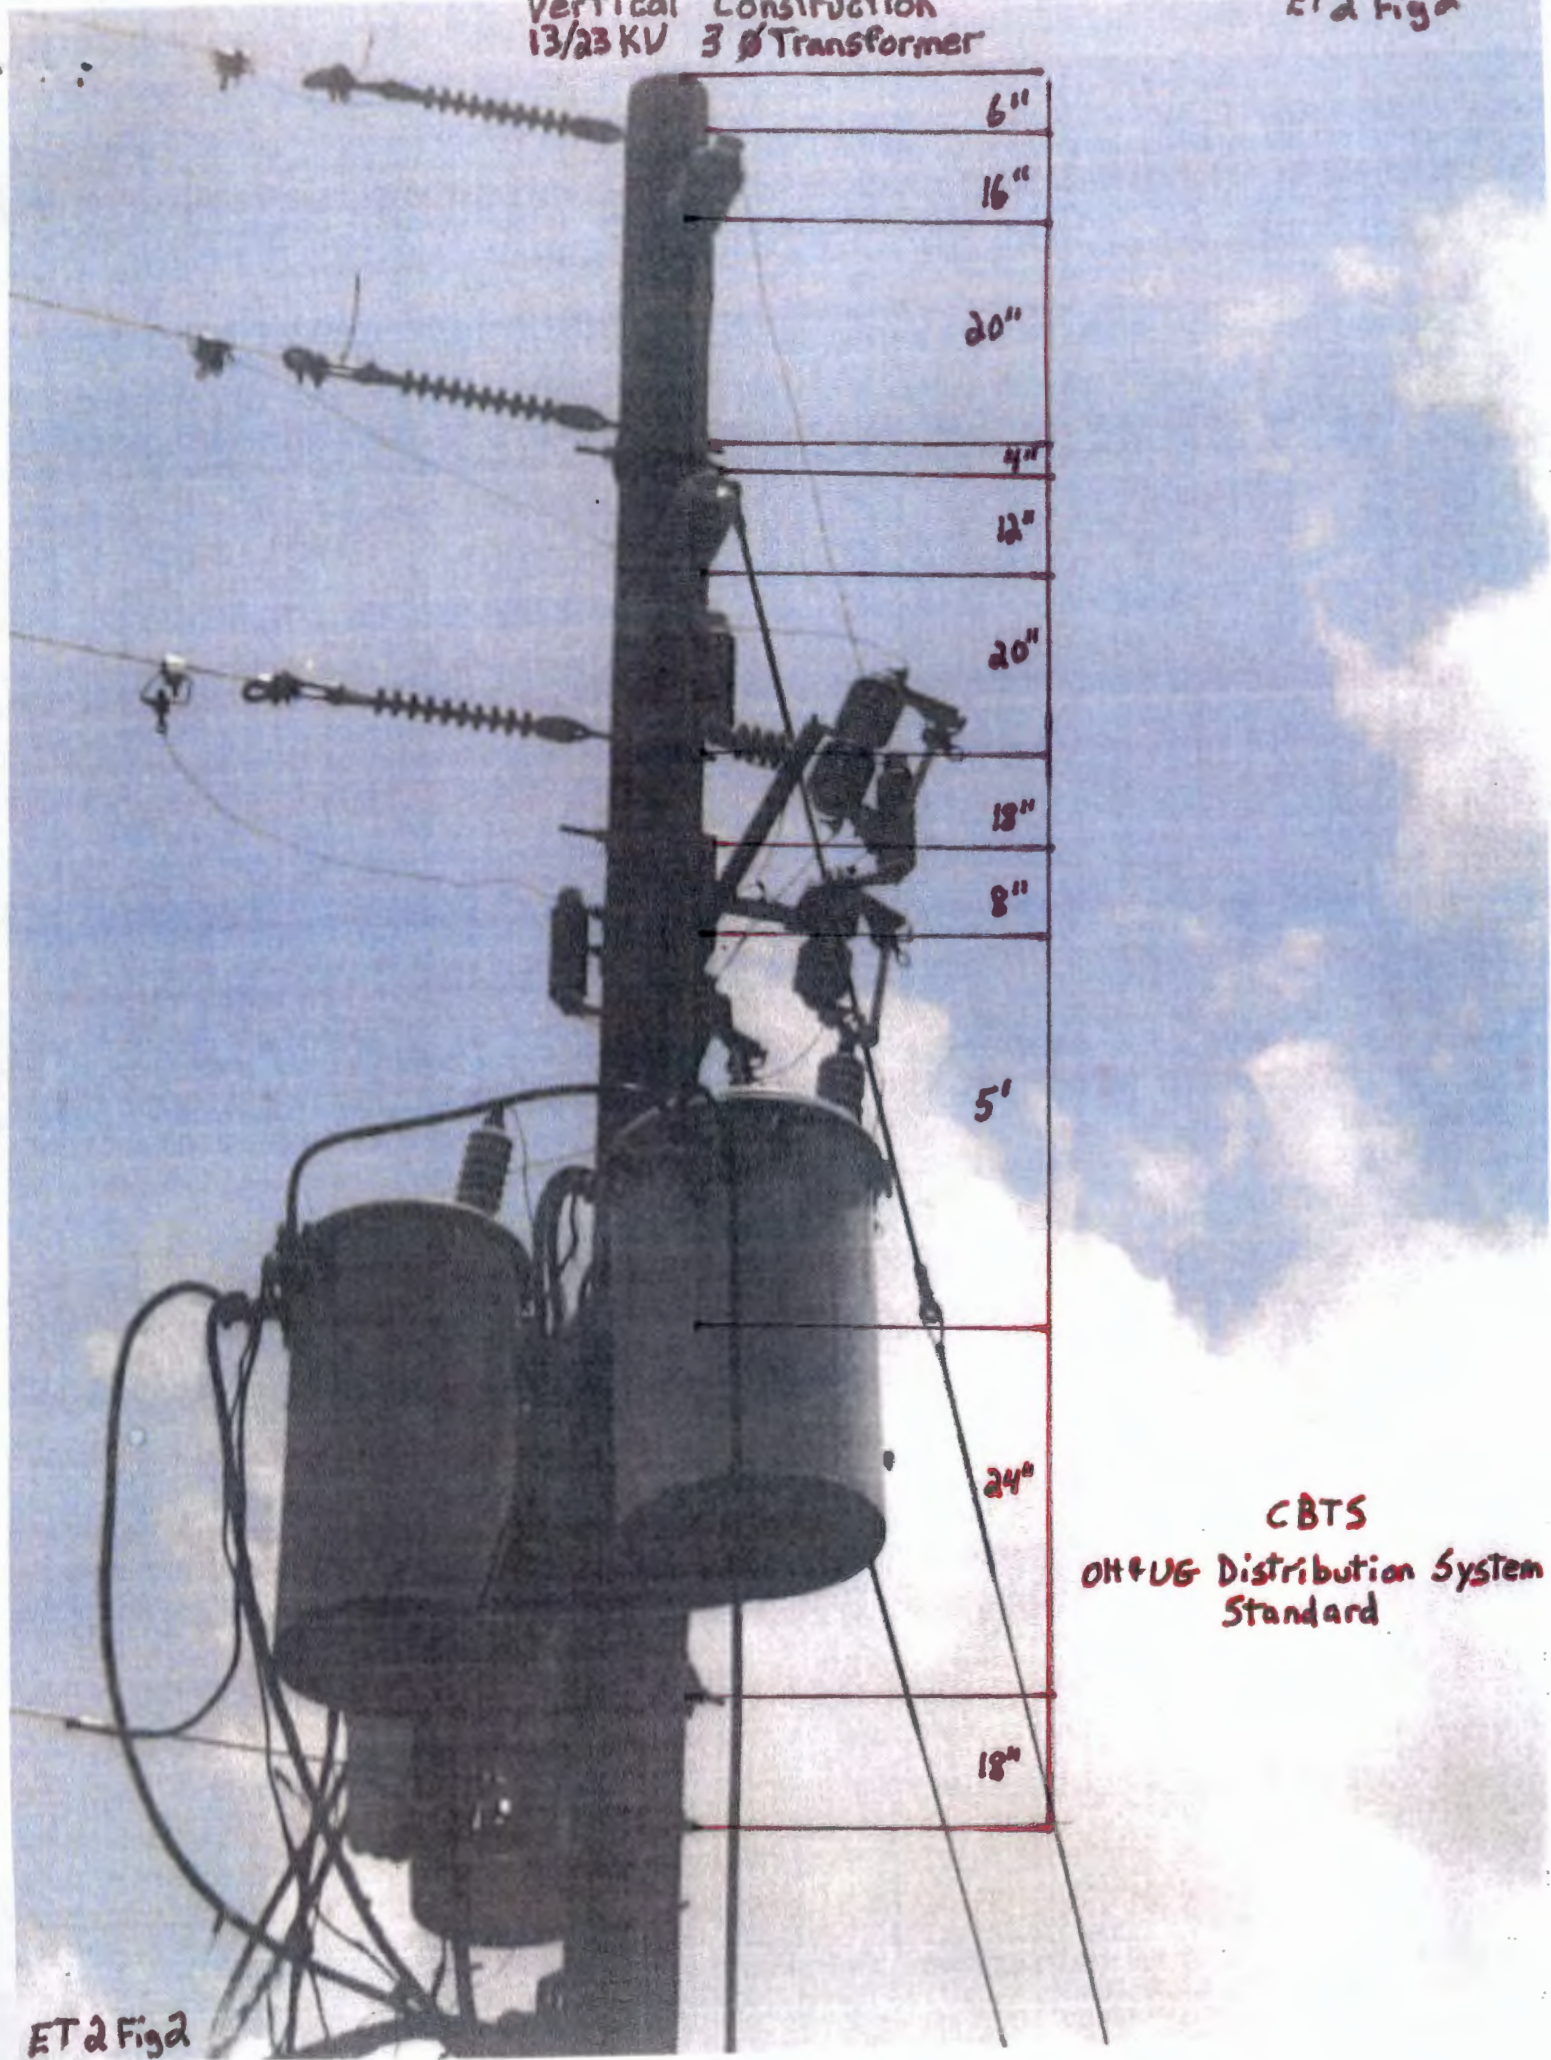

6"

16"

20"

4"

12"

20"

18"

8"

5'

24"


18"

CBTS
OH+UG Distribution System
Standard

ET2 Fig2

Vertical Construction
13/23 X Arm 3Ø Transformer

ET2 Fig 3

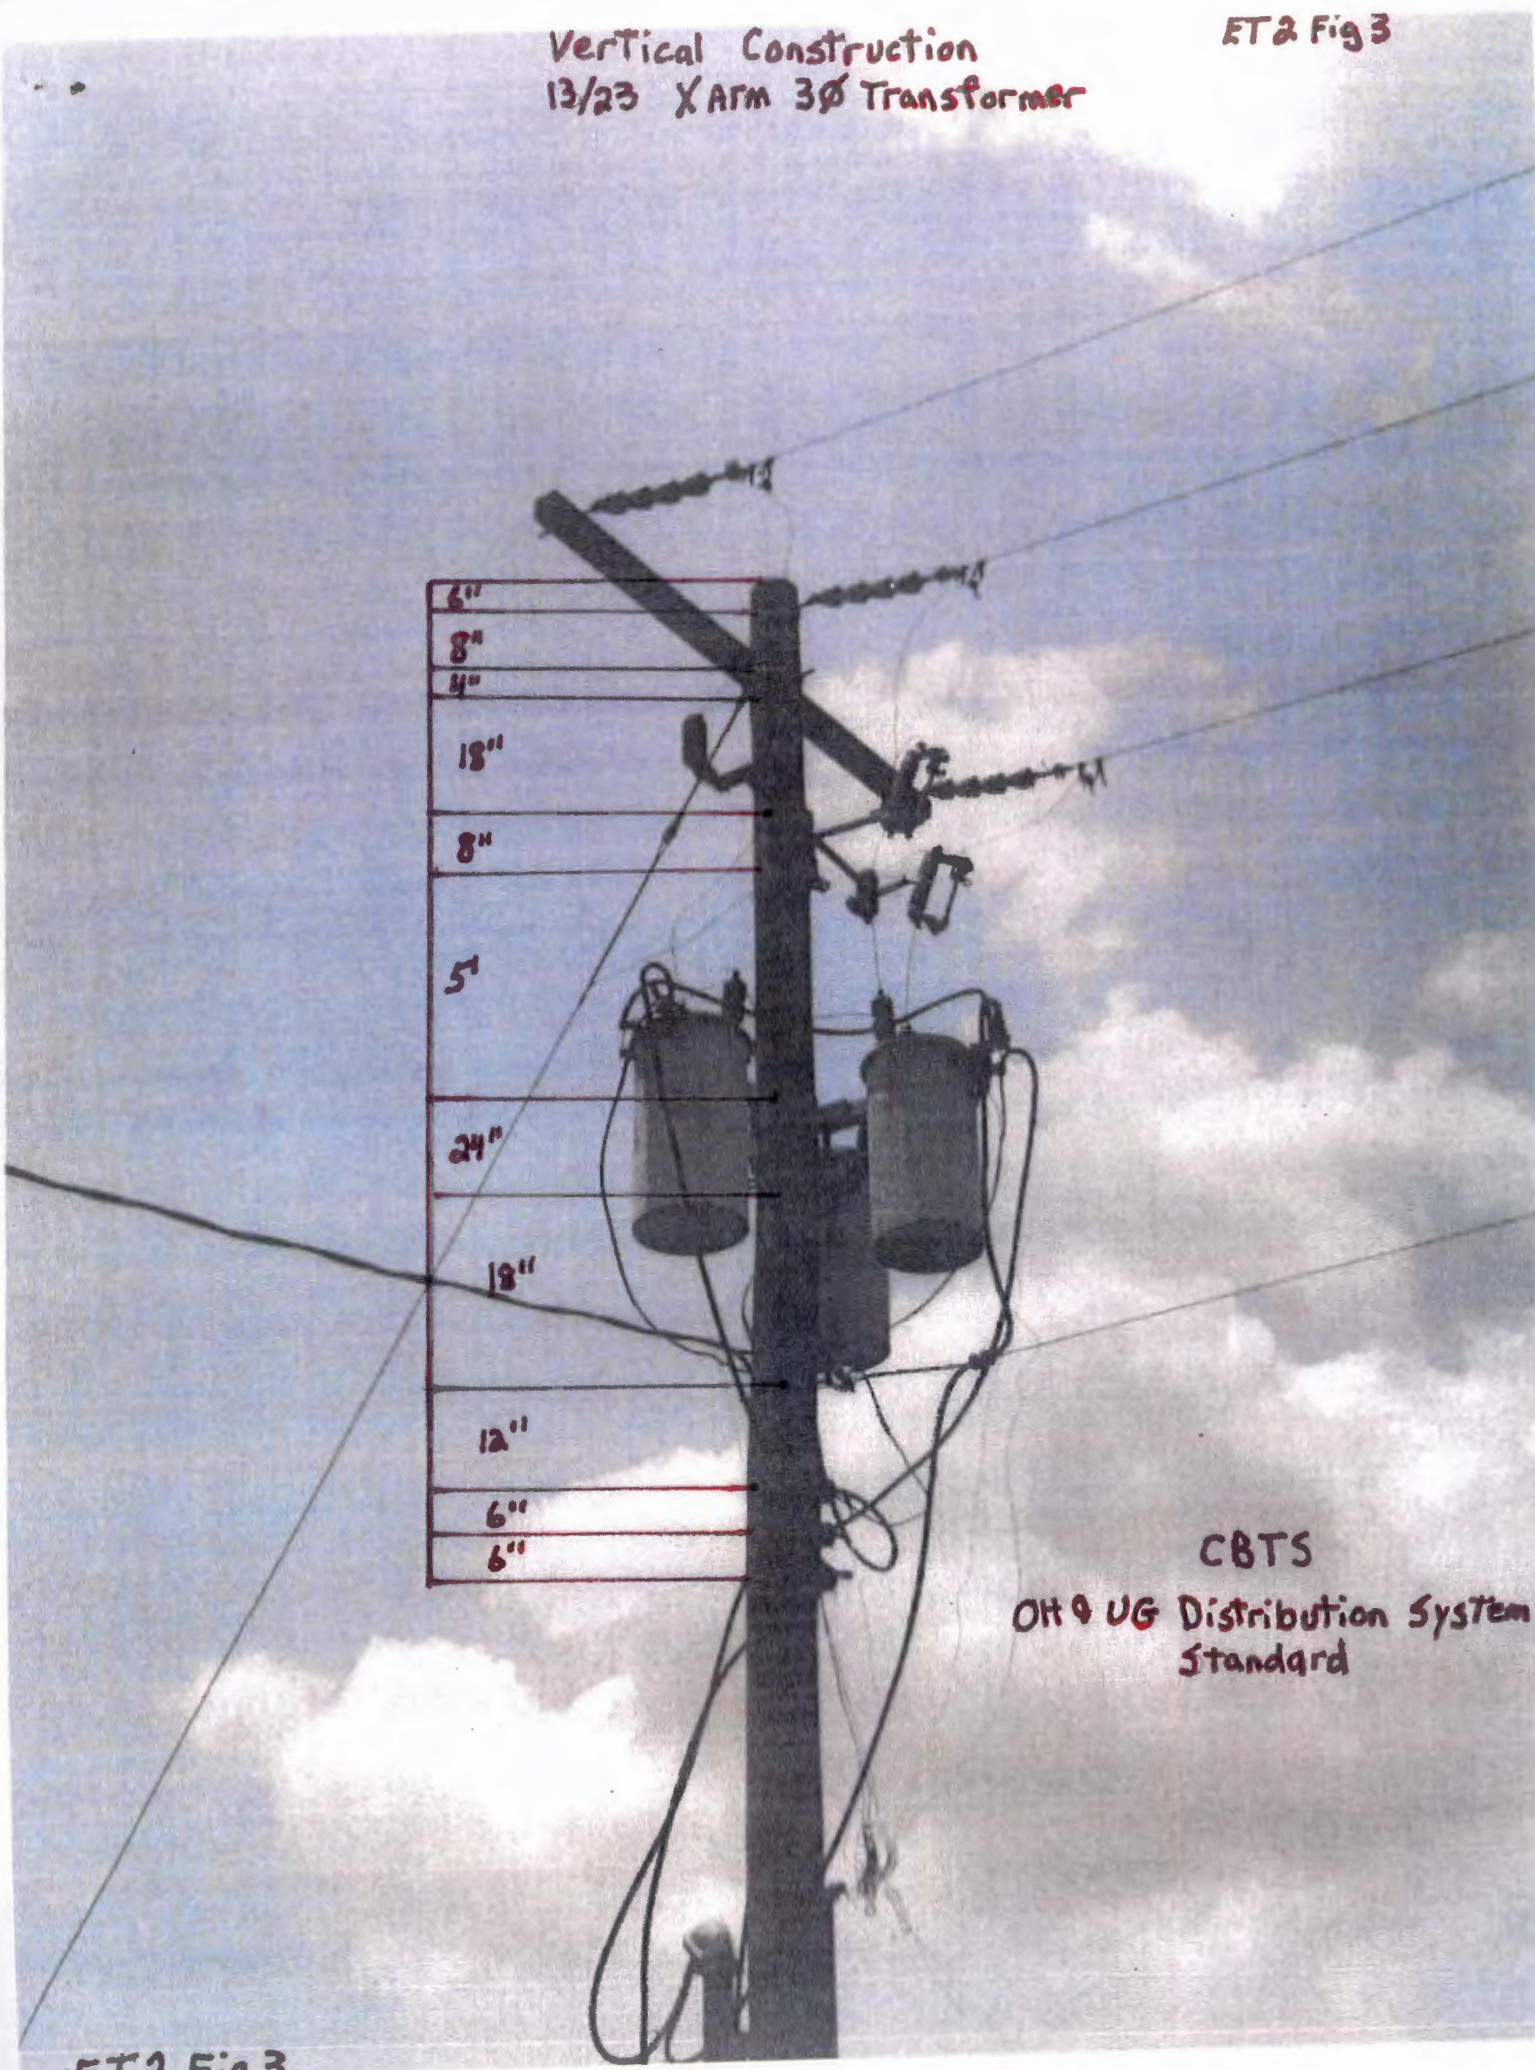

6"
8"
4"
18"
8"
5'
24"
18"
12"
6"
6"

CBTS
OK & UG Distribution System
Standard

Post Insulator Construction
13/23 KV Underground Primary

UH-1 Fig 1



CBTS
OH & UG Distribution System
Standard

UH-1 Fig 1

Post Vertical Construction
Gang Switch

VDI Fig 1


VDI Fig 1

CBTS

OH & UG Distribution System
Standard

Vertical Disconnect Switch
13/23 KV Blades

VD-1 Fig 2

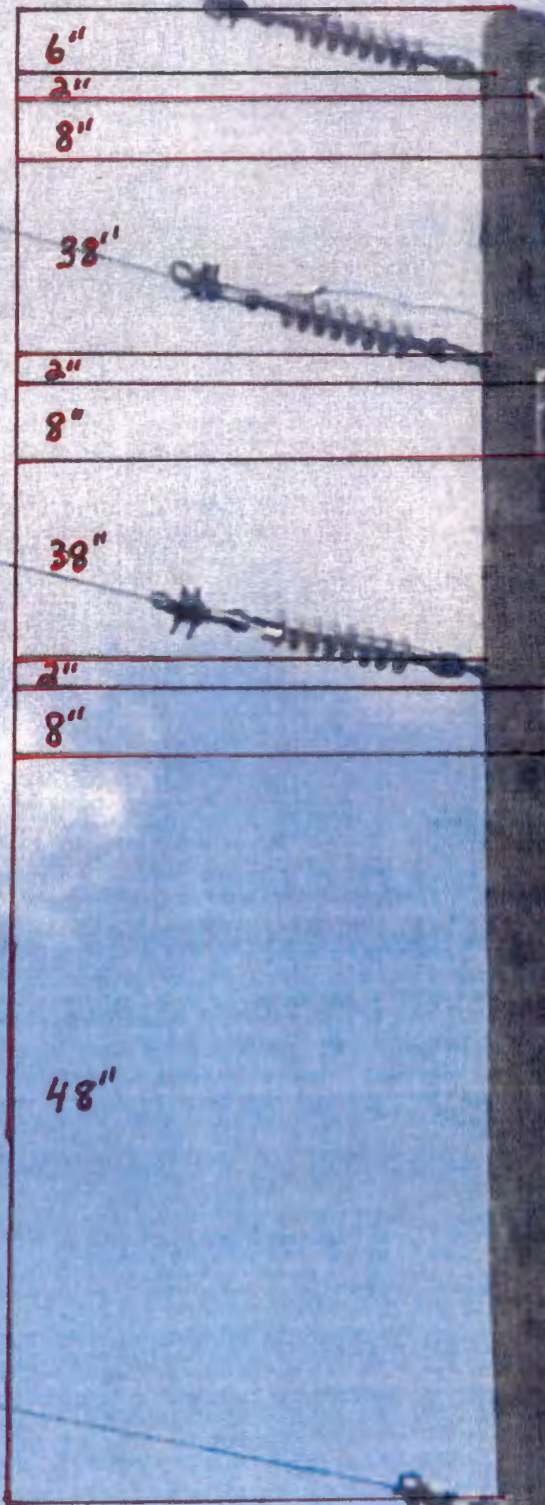

CBTS
OH & UG Distribution System
Standard

Verical Construction
Switch & Arrester

VD-1 Fig 3




CBTS
OH & VG Distribution System
Standard

VD-1 Fig 3

Vertical Construction
13/23 KV 3way Pole

VD-2 Fig1

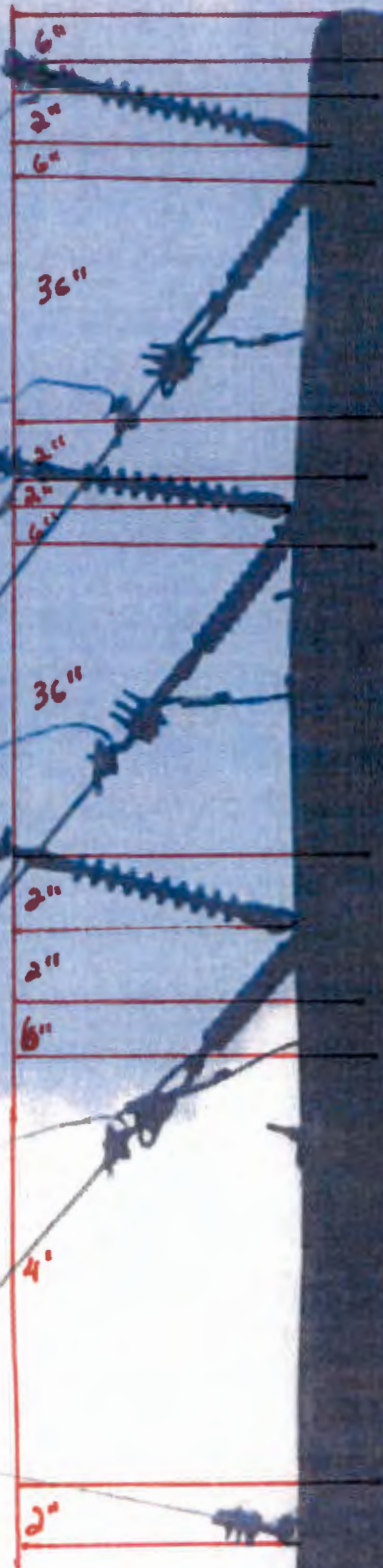


CBTS
OH & UG Distribution System
Standard

VD-2 Fig1

X ARM Construction
13/23KV

X-1 Fig 1

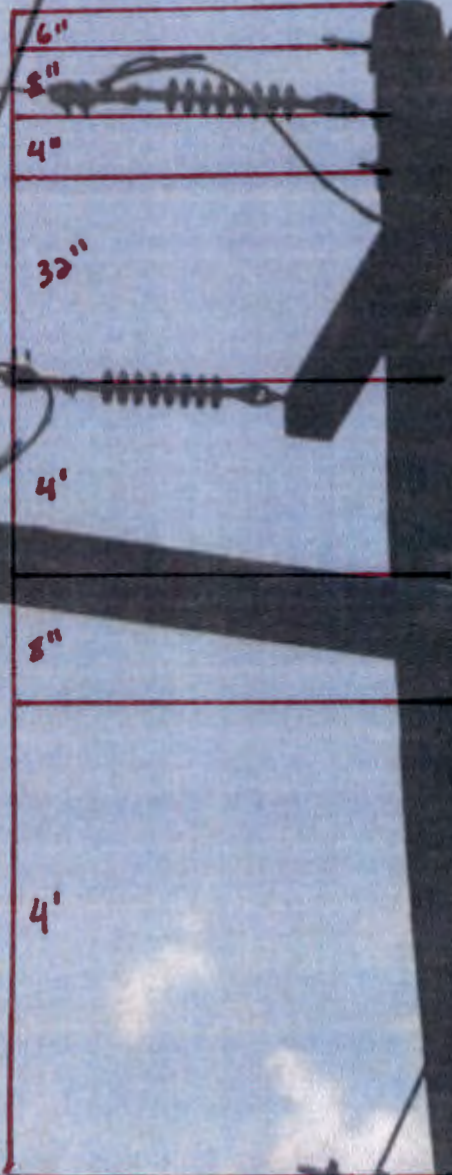


CBTS
OH & OG Distribution System
Standard

X-1 Fig 1

Xarm Construction
Disconnect Switch
13/23 KV

XD-1 Fig-1

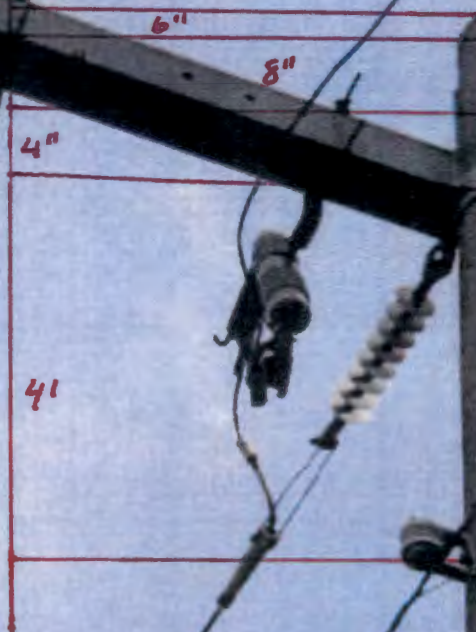


CBTS
OH & UG Distribution System
Standard

XD-1 Fig 1

X Arm Construction
Double Dead End Switch Pole

XD-1 Fig 2

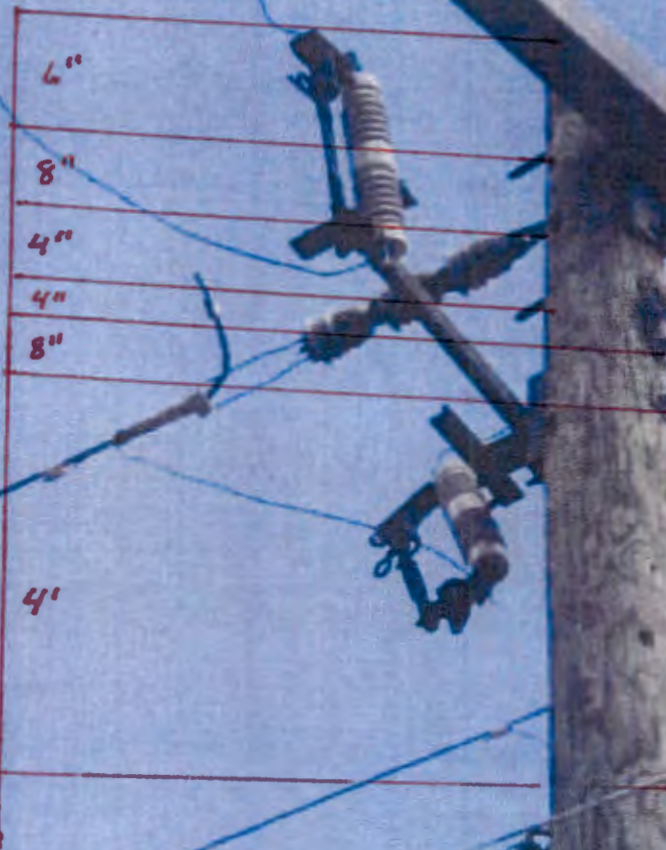

CBTS
OH & UG Distribution System
Standard

XD-1 Fig 2



Cocoa St

ABI #5

#16

#15

Camp Blanding Conference Center and...

Camp Blanding

ABI #4

Defuniak Springs St.

AVE A

#14

Lake City St

Florida Youth Challenge Academy

Bartow Ave

#11

#12

Sarasota Ave

#13

Quincy Ave

#s 6, 7

Plant City Ave

#8

Avon Park St

Bohifay St

#9

#10

PCS MATES

#s 3, 4 & 5

ABI #3

AVE D

Hillsborough Ave

ASP

ABI #1

Duval Rd

ABI #2

Yerkes Rd

#1

Yerkes Rd

ARF 3

Stevens Lake Rd

#2 (Stevens Lake Rd to OP Dickson)
(OP Dickson off page)

Image Landsat / Copernicus

1985

29°57'32.50" N 82°



ABI #6

Leesburg Street

Finnegan Lodge

ABI #5

Cocoa Street

CBJTC RTT DFAC

Fitness Center

Camp Blanding Conference Center and...

Camp