
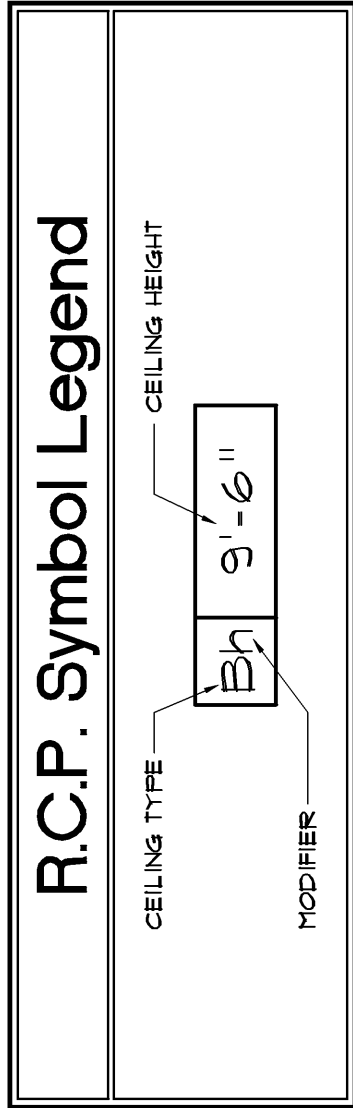


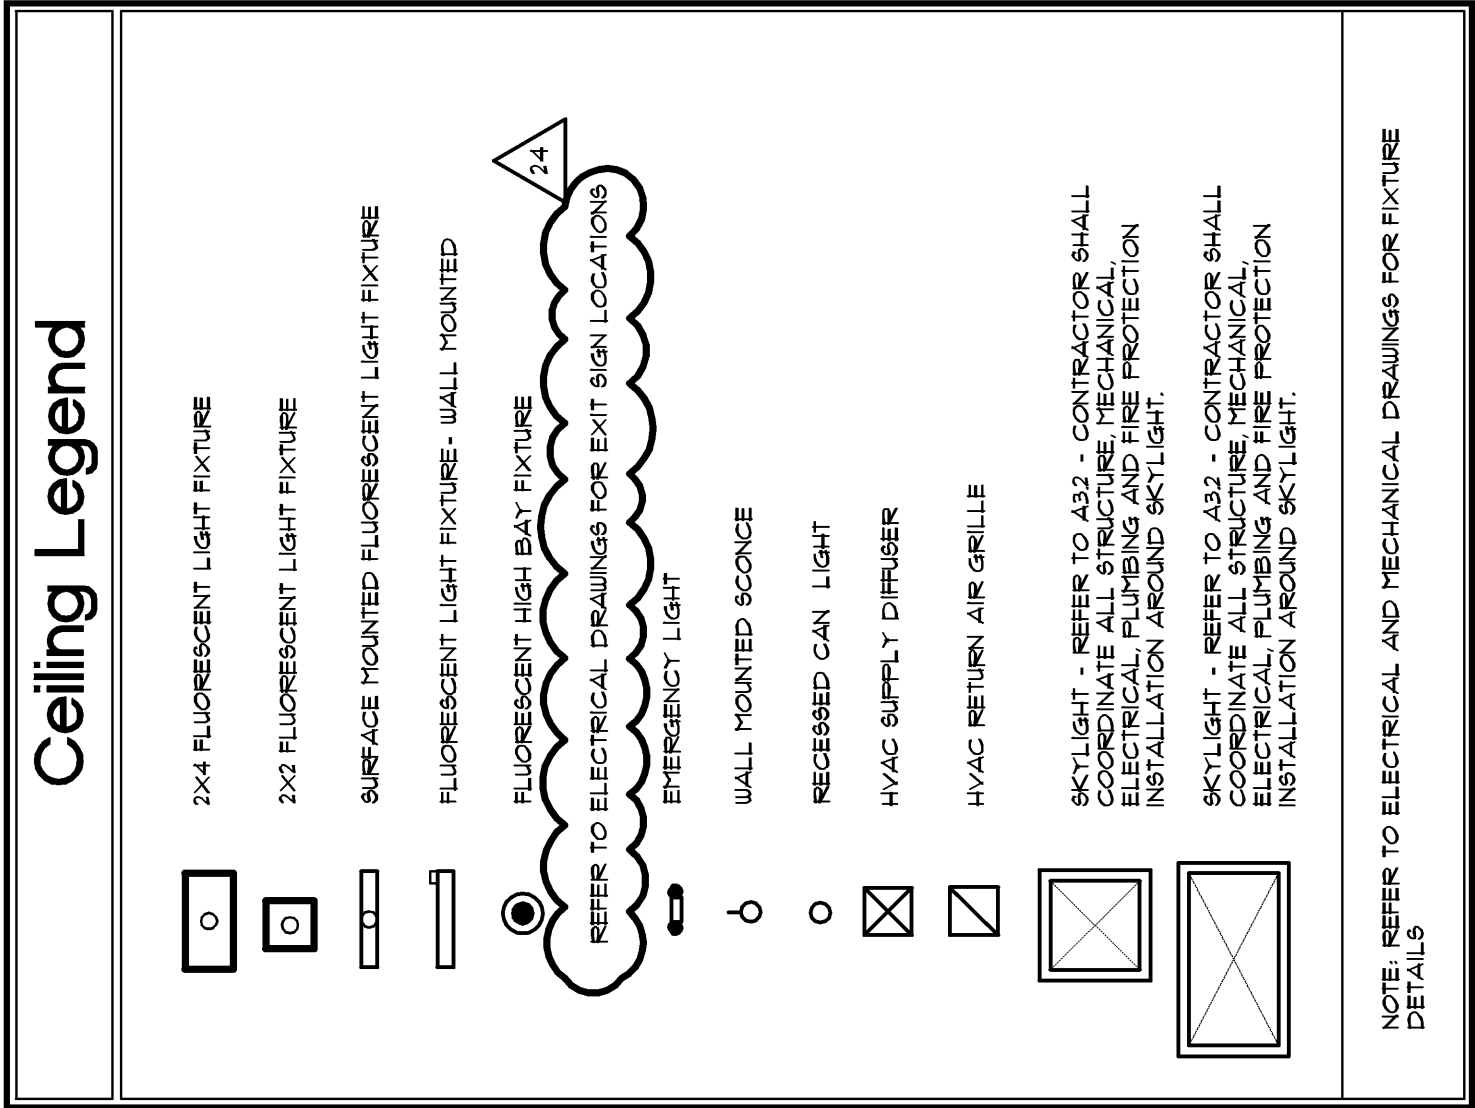

Ceiling Type Schedule	
A	X-X-X APC-1. RADAR 2'X2'X9". REFER TO SPECIFICATIONS.
B	X-X-X APC-3. HALCYON CLIMATEPLUS 2'X2'X1" WITH NMC OF 30". REFER TO SPECIFICATIONS.
C	X-X-X PREFABT PLANK. PAINT. REFER TO STRUCTURAL.
D	X-X-X NOT USED
E	X-X-X APC-4. CLEAN ROOM CLIMATEPLUS 2'X2'X9". REFER TO SPECIFICATIONS.
F	X-X-X OPEN TO STRUCTURE - NOT PAINTED. REFER TO STRUCTURAL.
G	X-X-X LAYERS OF 5/8" FIBER REINFORCED BOARD ON LIGHT GAUGE METAL DECKING. 1/2" GYPSUM BOARD. PAINT. PROVIDE FIRE PROOF ASSEMBLY.
H	X-X-X APC-2. RADAR CLIMATEPLUS 2'X2'X9". REFER TO SPECIFICATIONS.
I	X-X-X 5/8" FIBERGLASS AQUA-TUFF GYPSUM BOARD CEILING ON LIGHT GAUGE METAL FRAMING - PAINT.
K	X-X-X 5/8" FIBER-REINFORCED HIGH IMPACT GYPSUM BOARD CEILING ON LIGHT GAUGE METAL FRAMING - PAINT.
L	X-X-X APC-5. TECTA LAY-1 IN CEILING PLANEL 2'X2'X1". REFER TO SPECIFICATIONS.
M	X-X-X OPEN TO STRUCTURE - PAINT. REFER TO STRUCTURAL.
N	X-X-X 5/8" GYPSUM PANEL. SUSPENDED ON LIGHT GAUGE METAL FRAMING - PAINT.
CEILING TYPE MODIFIERS	
X	X-X-X INSTALL HOLLOW CLIPS.
1. CENTER GYPSUM JOINTS IN BOTH DIRECTIONS. WALL CORNERS AND ALL EXPOSED EDGES IN CEILING SHALL BE FINISHED TO MATCH MINIMUM 6' FROM WALLS IN BOTH DIRECTIONS. 2. CENTER ALL INTERIOR DOWNGLIGHTS IN CEILING TILES. IN ROOMS WITHOUT CEILING TILES, CENTER DOWNLIGHTS IN BOTH DIRECTIONS TO RELATIVE WALLS. 3. CENTER ALL SECURITY AND NON-SECURITY WALL MOUNTED VANITY FIXTURES OVER THIRDS BELOW. 4. CENTER 2'X4' 1/4" AND 2'X2' SURFACE MOUNTED FIXTURES IN BOTH DIRECTIONS. 5. SEE SPECIFICATIONS OF EACH FIXTURE TYPE REFER TO ELECTRICAL DRAWINGS. 6. CENTER ALL SPRINKLER HEADS IN CEILING TILES WHERE APPLICABLE. 7. PRODUCT TYPES INDICATED ARE BASIS OF DESIGN - REFER TO SPECIFICATIONS. 8. COORDINATE CEILING LIGHT FIXTURES WITH HVAC GRILLER, CONTACT ARCHITECT IF CONFLICT OCCURS. 9. CEILING HEIGHTS IN AREAS WITH DEPRESSURED SLAB SHALL BE MEASURED TO FINISH OF CEILING. CEILING HEIGHTS IN AREAS NOT INCLUDING DEPRESSURED AREAS SHALL BE MEASURED TO FINISH OF SLAB. 10. PROVIDE ADEQUATE ACCESS TO EQUIPMENT, FITTINGS, VALVES, ETC. THAT ARE NOT TO BE PROTECTED AS APPROPRIATE FOR THE FIRST RESISTANCE RATING OF THE BARRIER PER NFPA 601 LIFE SAFETY CODE. 11. PROVIDE GYPSUM BOARD EXPANSION JOINTS AT 10'-0" OR AS INDICATED. 12. CONTRACTOR TO COORDINATE ALL BOSS OPENINGS WITH STRUCTURE, MECHANICAL, ELECTRICAL, PLUMBING AND FIRE PROTECTION INSTALLATION. 13. ALL GYPSUM BOARD IN SECURE AREAS SHALL BE VERY HIGH IMPACT RESISTANT GYPSUM BOARD.	