Code Review

BUILDING CHARACTERISTICS AND OCCUPANCIES - Life Safety Code

ADDRESS

NFPA 101	BUILDING OCCUPANCY	NEW DETENTION AND CORRECTIONAL OCCUPANCY, USE CONDITION IV - IMPEDED EGRESS
NFPA 101		NEW BUSINESS OCCUPANCY
IBC		INSTITUTIONAL - GROUP I-3 - CONDITION 4

Applicable Codes

INTERNATIONAL BUILDING CODE	2006 EDITION WITH 2007 GEORGIA AMENDMENTS
INTERNATIONAL MECHANICAL CODE	2006 EDITION WITH 2007 AND 2008 GEORGIA AMENDMENTS
INTERNATIONAL FUEL GAS CODE	2006 EDITION WITH 2007 AND 2008 GEORGIA AMENDMENTS
INTERNATIONAL PLUMBING CODE	2006 EDITION WITH 2007 AND 2008 GEORGIA AMENDMENTS
NATIONAL ELECTRIC CODE	2005 EDITION WITH 2006 GEORGIA AMENDMENTS
INTERNATIONAL ENERGY CONSERVATION CODE	2006 EDITION WITH 2008 GEORGIA SUPPLEMENTS AND AMENDMENTS

Construction Type and Allowable Heights and Areas - IBC

SEPARATED OCCUPANCIES

JAIL AND ADMINISTRATIVE BUILDING

BUSINESS OCCUPANCY- AREA "A"- REFER TO KEY PLAN

IBC-503	CONSTRUCTION TYPE	IIB UNPROTECTED	
	SPRINKLERED	YES	
	ALLOWABLE HEIGHT	1 STORY	
IBC TBL 503	ALLOWABLE AREA	23,000 SF/FLOOR	
	NO OF STORIES	1	
	AREA INCREASE	YES	
	SPRINKLERED	Ia+300%	+69,000SF
	FRONTAGE	If+(F/P-0.25)W/30+ 53PERCENT	+12,182SF
		F= 429.3FT	
		P= 550.7FT	
		W= 30FT	
	ALLOWABLE SPRINKLERED INCREASE	69,000SF	
	ALLOWABLE FRONTAGE INCREASE	12,182SF	
	TOTAL ALLOWABLE AREA	104,182SF	
	ACTUAL AREA	16,347SF	
	ALLOWABLE AREA	104,182SF	

BUSINESS OCCUPANCY- AREA "B"- REFER TO KEY PLAN

IBC-503	CONSTRUCTION TYPE	IIB UNPROTECTED	
	SPRINKLERED	YES	
	ALLOWABLE HEIGHT	1 STORY	
IBC TBL 503	ALLOWABLE AREA	23,000 SF/FLOOR	
	NO OF STORIES	1	
	AREA INCREASE	YES	
	SPRINKLERED	Ia+300%	+69,000SF
	FRONTAGE	If+(F/P-0.25)W/30+ 53PERCENT	+12,182SF
		F= 429.3FT	
		P= 550.7FT	
		W= 30FT	
	ALLOWABLE SPRINKLERED INCREASE	69,000SF	
	ALLOWABLE FRONTAGE INCREASE	12,182SF	
	TOTAL ALLOWABLE AREA	104,182SF	
	ACTUAL AREA	3,787SF	
	ALLOWABLE AREA	104,182SF	

INSTITUTIONAL (I-3) OCCUPANCY- AREA "C"- REFER TO KEY PLAN

IBC-503	CONSTRUCTION TYPE	IIB UNPROTECTED	
	SPRINKLERED	YES	
	ALLOWABLE HEIGHT	1 STORY	
IBC TBL 503	ALLOWABLE AREA	10,000 SF/FLOOR	
	NO OF STORIES	1	
	AREA INCREASE	YES	
	SPRINKLERED	Ia+300%	+30,000SF
	FRONTAGE	If+(F/P-0.25)W/30+ 75PERCENT	+7,500SF
		F= 875FT	
		P= 875FT	
		W= 30FT	
	ALLOWABLE SPRINKLERED INCREASE	30,000SF	
	ALLOWABLE FRONTAGE INCREASE	7,500SF	
	TOTAL ALLOWABLE AREA	47,500SF	
	ACTUAL AREA	33,852SF	
	ALLOWABLE AREA	47,500SF	

IBC-508.3.3 SEPARATED OCCUPANCIES - LIMITATIONS

IBC-508.3.3.2 ALLOWABLE AREA — IN EACH STORY, THE BUILDING AREA SHALL BE SUCH THAT THE SUM OF THE RATIOS OF THE ACTUAL FLOOR AREA OF EACH OCCUPANCY DIVIDED BY THE ALLOWABLE AREA OF EACH OCCUPANCY SHALL NOT EXCEED ONE.

ACTUAL AREA (B)/20,000 / ALLOWABLE AREA (B)+104,182 + ACTUAL AREA (I-3)+36,078 / ALLOWABLE AREA (I-3)+47,500 = .934 < 1 AND IS THEREFORE ACCEPTABLE

INSTITUTIONAL (I-3) HOUSING PODS- AREA "D" AND "E"- REFER TO KEY PLAN

IBC-503	CONSTRUCTION TYPE	IIA PROTECTED	
	SPRINKLERED	YES	
	ALLOWABLE HEIGHT	1 STORY	
IBC TBL 503	ALLOWABLE AREA	15,000 SF/FLOOR	
	NO STORIES	1	
	AREA INCREASE	YES	
	SPRINKLERED	Ia+300%	+45,000SF
	FRONTAGE	If+(F/P-0.25)W/30+ 63.6PERCENT	+9,540SF
		F= 112.4FT	
		P= 126.6FT	
		W= 30FT	
	ALLOWABLE SPRINKLERED INCREASE	45,000SF	
	ALLOWABLE FRONTAGE INCREASE	9,540SF	
	TOTAL ALLOWABLE AREA	69,540SF	
	ACTUAL AREA	51,938SF	
	ALLOWABLE AREA	69,540SF	

FIRE RESISTIVE RATINGS FOR BUILDING ELEMENTS LSC/IBC

IBC TABLE 601	STRUCTURAL FRAME	0	HOURS	INCLUDING COLUMNS, GIRDERS AND TRUSSES
IBC TABLE 601	FLOORS	0	HOURS	INCLUDING SUPPORTING BEAMS AND JOISTS
IBC TABLE 601	ROOF	0	HOURS	

EXTERIOR WALL RATINGS (BEARING AND NON BEARING)

IBC TABLE 602	SEPARATION DISTANCE	RATING		
	0 - 5 FEET	1 HOUR	EXPOSURE FROM BOTH SIDES	704.5
	5 - 10 FEET	1 HOUR	EXPOSURE FROM INSIDE	704.5
	10 - 30 FEET	0 HOURS		
	30 + FEET	0 HOURS		

OCCUPANCY SEPARATIONS

HOUSING TO SUPPORT	4 HOURS	
NFPA 101 22.1.2.2 B TO I-3	2 HOUR	
IBC 302.3.3 D B TO A-3	1 HOURS	IF > 750 SF
NFPA 101 22.3.2.1. AREAS NOT INCIDENTAL TO HOUSING	2 HOURS	
HOUSING TO SUPPORT	1 HOUR	
BOILER ROOMS	1 HOUR	
LAUNDRY	1 HOUR	
MAINTENANCE SHOPS	SMOKE	
PADDED CELLS	1 HOUR	
SOILED LINEN ROOMS	1 HOUR	
STORAGE > 50SF < 100	SMOKE	
STORAGE > 100SF	1 HOUR	
TRASH ROOMS	1 HOUR	

Code Review

Means of Egress - Life Safety Code

NFPA101 7.3.3.1	EXIT CAPACITIES	02	IN/PERSON
NFPA101 7.4.1.1	NUMBER OF EXITS	2	GENERAL
NFPA101 7.4.1.2		2	50 OR MORE OCCUPANTS
NFPA101 7.4.1.2		3	GREATER THAN 500 BUT LESS THAN 1000 OCCUPANTS
NFPA101 7.4.1.2		4	GREATER THAN 1000 OCCUPANTS
NFPA101 7.3.1.2	OCCUPANT LOADS SF/PERSON	100	BUSINESS (GROSS)
		15	ASSEMBLY LESS CONCENTRATED W/O FIXED SEATING (NET)
		120	DETENTION AND CORRECTIONAL
		300	STORAGE
		100	KITCHENS
		15	LOCKER ROOMS
		20	FREE WEIGHT ROOMS
		20	CLASSROOMS
		* OF SEATS	FIXED SEAT WAITING
NFPA101 22.2.6.1	TRAVEL DISTANCE	150 FT	ANY ROOM DOOR REQUIRED AS EXIT ACCESS AND AN EXIT
		200 FT	ANY POINT IN A ROOM AND AN EXIT
		50 FT	ANY POINT IN A SLEEPING ROOM TO THE DOOR IN THAT ROOM
NFPA101 22.5.3	COMMON PATH OF TRAVEL	100 FT	
NFPA101 22.2.5.2	DEAD END CORRIDORS	50 FT	
	SALLY PORTS	A SALLY PORT SHALL BE PERMITTED IN A MEANS OF EGRESS WHERE THERE ARE PROVISIONS FOR CONTINUOUS AND UNOBSTRUCTED TRAVEL THROUGH THE SALLY PORT DURING AN EMERGENCY CONDITION	
	SEPARATION OF EXITS	EXITS SHALL BE SEPARATED BY 1/2 DIAGONAL DIMENSION OF THE OCCUPIED SPACE MEASURED IN A STRAIGHT LINE BETWEEN EXIT DOORS OR EXIT ACCESS DOORS - IN RATED CORRIDORS THE DISTANCE SHALL BE MEASURED ALONG THE DIRECT LINE OF TRAVEL.	
NFPA 22.2.7	DISCHARGE FROM EXITS	50 FT	DISTANCE FROM BUILDING INTO COURTYARD OR FENCED AREA LESS THAN 2 BUILDING WALLS - PROVIDE 15 SF/PERSON
NFPA101 22.2.10	MARKING	EXIT SIGNS AREA NOT REQUIRED IN HOUSING AREA	

DOORS

NFPA101 7.2.1.2.3	MINIMUM WIDTH	32 INCHES
NFPA101 7.2.1.2.2	CLEAR OPENING	32 INCHES - MEASURED WITH DOOR @ 90° BETWEEN FACE OF DOOR AND STOP
	PROJECTIONS	NONE UP TO 34" AFF 4" BETWEEN 34" AND 80" AFF - HINGE SIDE ONLY
NFPA 101 22.2.11.4	SLIDING DOORS	PERMITTED FOR EGRESS FORCE TO FULLY OPEN <50LBF
NFPA 101 22.2.11.10	EMERGENCY POWER	1-1/2 HR ALL ELECTRICALLY OPERATED SLIDING DOORS AND LOCKS
NFPA101 7.2.1.4.2	DOOR SWING	DOOR SWING IN DIRECTION OF EGRESS TRAVEL IF OCCUPANT LOAD EXCEEDS 50
NFPA101 7.2.1.4	FORCE TO OPEN	LATCH RELEASE - 15LBF SET IN MOTION - 30LBF SWING TO MIN. REQUIRED WIDTH - 15LBF *OPENING FORCES FOR INTERIOR SIDE HINGED OR PIVOTED-SWINGING DOORS W/O CLOSERS SHALL NOT EXCEED 5LBF.

IBC 715.4

FIRE DOOR AND SHUTTER ASSEMBLIES	ASSEMBLY	DOOR RATING
FIRE WALLS >1 HOUR	4	3 HOUR
	2	1.5 HOUR
SHAFT, EXIT AND PASSAGEWAY	1	1 HOUR
OTHER FIRE BARRIERS	1	3/4 HOUR
CORRIDOR WALLS	1	20 MIN
	0.5	20 MIN
SMOKE BARRIERS	1	3/4 HOUR
	1	20 MIN

CORRIDORS REQUIRED FOR EGRESS

NFPA 101 22.2.3.2	WIDTH	MIN. - 48 INCHES
	HEIGHT	80 INCHES CLEAR
	RATINGS	1 HOUR IF GREATER THAN 30 OCCUPANTS

OPENING PROTECTION

IBC 715.1	DOORS	1 HOUR - EXIT ACCESS CORRIDOR ENCLOSURE WALL 1.5 HOUR FOR TWO AND THREE HOUR RATED ASSEMBLIES 3/4 HOUR FOR 1 HOUR RATED ASSEMBLIES
IBC 1004.3.5	CONTINUITY	RATED CORRIDORS SHALL BE CONTINUOUS FROM THE POINT OF ENTRY TO AND EXIT WITH NO INTERVENING ROOMS.
	EXCEPTIONS	FOYERS, LOBBIES OR RECEPTION ROOMS CONSTRUCTED AS REQUIRED FOR CORRIDORS SHALL NOT BE CONSTRUED AS INTERVENING ROOMS.

IBC TABLE 1004.8 MAX AREA OF EXTERIOR WALL OPENINGS

FIRE SEPARATION DIST.	PROTECTED	UNPROTECTED	
0-3 FT	NOT PERMITTED	NOT PERMITTED	SEE SECTION 704.7 FOR UNLIMITED OPENINGS LIMIT OF UNEXPOSED SURFACE TEMPERATURE
3-5 FT	15%	NOT PERMITTED	
5-10 FT	25%	10%	
10-15 FT	45%	15%	
15-20 FT	75%	25%	
20-25 FT	UNLIMITED	45%	
25-30 FT	UNLIMITED	70%	
>30 FT	UNLIMITED	UNLIMITED	

RAMPS

NFPA101 7.2.5		PERMANENT AND FIXED NON COMBUSTIBLE
NFPA101 7.2.5.3.1	FLOOR AND LANDINGS	SOLID - NO PERFORATIONS
NFPA 101 7.2.5.2.A	WIDTH	44" MIN./48" MIN. FOR EGRESS
	SLOPE PROJECTIONS	1:12 MAX 3-1/2" BELOW HANDRAIL HEIGHT
	CROSS SLOPE MAX RISE FOR SINGLE RUN	1:48 MAX 30"
GA ACCESS 120-3-20.15	4) LANDINGS 60" 60" X 60"	LEVEL CLEAR LENGTH IF RAMP CHANGES DIRECTION

FIRE SUPPRESSION

15 FT	PORTABLE FIRE EXTINGUISHERS

DETECTION AND NOTIFICATION

NFPA 22.3.4.1	DETENTION AND CORRECTIONAL OCCUPANCIES SHALL BE PROVIDED WITH A FIRE ALARM SYSTEM IN ACCORDANCE WITH SECTION 9.6, EXCEPT AS MODIFIED BY 22.3.4.1.2 THROUGH 22.3.4.4. ALL FIRE ALARM SYSTEMS AND DETECTION SYSTEMS REQUIRED IN 22.3.4 SHALL BE PROVIDED WITH A SECONDARY POWER SUPPLY, AND THE INSTALLATION SHALL BE IN ACCORDANCE WITH NFPA 72, NATIONAL FIRE ALARM CODE. OCCUPANT NOTIFICATION. OCCUPANT NOTIFICATION SHALL BE ACCOMPLISHED AUTOMATICALLY IN ACCORDANCE WITH 9.6.3. A POSITIVE ALARM SEQUENCE SHALL BE PERMITTED IN ACCORDANCE WITH 9.6.3.4. EXCEPTION:+ ANY SMOKE DETECTORS REQUIRED BY THIS CHAPTER SHALL BE PERMITTED TO BE ARRANGED TO ALARM AT A CONSTANTLY ATTENDED LOCATION ONLY AND SHALL NOT BE REQUIRED TO ACCOMPLISH GENERAL OCCUPANT NOTIFICATION. DETECTION. AN APPROVED AUTOMATIC SMOKE DETECTION SYSTEM SHALL BE IN ACCORDANCE WITH SECTION 9.6, AS MODIFIED BY 22.3.4.4.1 THROUGH 22.3.4.4.3, THROUGHOUT ALL RESIDENT SLEEPING AREAS AND ADJACENT DAY ROOMS, ACTIVITY ROOMS, OR CONTIGUOUS COMMON SPACES. SMOKE DETECTORS SHALL NOT BE REQUIRED IN SLEEPING ROOMS WITH FOUR OR FEWER OCCUPANTS.
EMERGENCY POWER	10 SECOND DELAY MAX.
NFPA101 7.9.2	EMERGENCY ILLUMINATION AND SIGNAGE FOR DURATION OF NOT LESS THAN 1-1/2 HOURS IN THE EVENT OF FAILURE CONNECTED TO AN EMERGENCY ELECTRICAL SYSTEM PROVIDED FROM STORAGE BATTERIES, UNIT EQUIPMENT OR ON-SITE GENERATOR SET.

SMOKE BARRIERS

709.3	FIRE-RESISTANCE RATING A 1-HOUR FIRE-RESISTANCE RATING IS REQUIRED FOR SMOKE BARRIERS. *EXCEPTION - SMOKE BARRIERS CONSSTRUCTED OF MINIMUM 0.10 INCH THICK (2.8mm) STEEL IN GROUP I-3 BUILDINGS.

Life Safety Notes -NFPA 101

CHAPTER 22 NEW DETENTION AND CORRECTIONAL OCCUPANCIES	COMMENT
22.1.2.2 SECTIONS OF DETENTION AND CORRECTIONAL FACILITIES SHALL BE PERMITTED TO BE CLASSIFIED AS OTHER OCCUPANCIES, PROVIDED THAT THEY MEET ALL OF THE FOLLOWING CONDITIONS: (1) THEY ARE NOT INTENDED TO SERVE RESIDENTS FOR SLEEPING PURPOSES. (2) THEY ARE SEPARATED FROM AREAS OF DETENTION OR CORRECTIONAL OCCUPANCIES BY CONSTRUCTION HAVING NOT LESS THAN A 2-HOUR FIRE RESISTANCE RATING.	REFER TO FLOOR PLAN FOR LOCATIONS
22.1.4.1 FOR APPLICATION OF THE LIFE SAFETY REQUIREMENTS OF THIS CHAPTER, THE RESIDENT USER CATEGORY SHALL BE DIVIDED INTO THE FOLLOWING FIVE GROUPS: (2) USE CONDITION IV -IMPEDED EGRESS. FREE MOVEMENT IS RESTRICTED FROM AN OCCUPIED SPACE. REMOTE-CONTROLLED RELEASE IS PROVIDED TO ALLOW MOVEMENT FROM ALL SLEEPING ROOMS, ACTIVITY SPACES, AND OTHER OCCUPIED AREAS WITHIN THE SMOKE COMPARTMENT TO ANOTHER SMOKE COMPARTMENT.	THIS FACILITY USES CONDITION IV
22.3.5.2 NO EXIT OR EXIT ACCESS SHALL CONTAIN A CORRIDOR, HALLWAY, OR AISLE HAVING A POCKET OR DEAD END EXCEEDING 50 FT. (15 M) FOR USE CONDITIONS II, USE CONDITION III, OR USE CONDITION IV AND 20 FT. (6.1 M) FOR USE CONDITION V.	REFER TO FLOOR PLAN FOR LOCATIONS
22.2.1.1 EXITS SHALL BE PERMITTED TO DISCHARGE INTO A FENCED OR WALLED COURTYARD, PROVIDED THAT NOT MORE THAN TWO WALLS OF THE COURTYARD ARE THE BUILDING WALLS FROM WHICH EGRESS IS BEING MADE. ENCLOSED YARDS OR COURTS SHALL BE OF SUFFICIENT SIZE TO ACCOMMODATE ALL OCCUPANTS AT A DISTANCE OF NOT LESS THAN 50 FT. (15 M) FROM THE BUILDING WHILE PROVIDING A NET AREA OF 15 SQ. FT. (1.4 SQ. M) PER PERSON.	REFER TO CIVIL DRAWINGS AND A1.4 FOR EVACUATION YARD
TABLE 22.3.2.1 HAZARDOUS AREA PROTECTION — SEPARATION/PROTECTION BOILER AND FUEL-FIRED HEATER ROOMS — 1-HR AND SPRINKLERS CENTRAL OR BULK LAUNDRIES OVER >100 SQ. FT. — 1-HR AND SPRINKLERS STORAGE ROOMS >100 SQFT. STORING COMBUSTIBLE MATERIALS — 1-HR AND SPRINKLERS	REFER TO FLOOR PLAN FOR RATED WALLS
22.3.4.3.1 OCCUPANT NOTIFICATION. OCCUPANT NOTIFICATION SHALL BE ACCOMPLISHED AUTOMATICALLY IN ACCORDANCE WITH 9.6.3. A POSITIVE ALARM SEQUENCE SHALL BE PERMITTED IN ACCORDANCE WITH 9.6.3.4. EXCEPTION: ANY SMOKE DETECTORS REQUIRED BY THIS CHAPTER SHALL BE PERMITTED TO BE ARRANGED TO ALARM AT A CONSTANTLY ATTENDED LOCATION ONLY AND SHALL NOT BE REQUIRED TO ACCOMPLISH GENERAL OCCUPANT NOTIFICATION.	
22.3.5.2 ALL BUILDINGS CLASSIFIED AS USE CONDITION II, USE CONDITION III, USE CONDITION IV, OR USE CONDITION V SHALL BE PROTECTED THROUGHOUT BY AN APPROVED, SUPERVISED AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE WITH SECTION 9.7.	THE BUILDING IS FULLY SPRINKLERED.
22.3.7.2 WHERE SMOKE BARRIERS ARE REQUIRED BY 22.3.7.1, THEY SHALL BE PROVIDED AS FOLLOWS: (1) THEY SHALL LIMIT THE OCCUPANT LOAD TO NOT MORE THAN 100 RESIDENTS IN ANY SMOKE COMPARTMENT.	THE SMOKE BARRIER IS DELINEATED ON THE FLOOR PLAN.
TABLE 22.3.8 SUBDIVISION OF RESIDENT HOUSING SPACES FEATURE — USE CONDITION IV ROOM TO ROOM SEPARATION — NR ROOM FACE TO CORRIDOR SEPARATION — NR ROOM FACE TO COMMON SPACE SEPARATION — NR ≤50 FT (15 M); SR >50 FT (15 M) COMMON SPACE TO CORRIDOR SEPARATION — NR TOTAL OPENINGS IN SOLID ROOM FACE WHEN ROOM FACE IS REQUIRED TO BE SMOKE RESISTANT OR FIRE RATED — 120 SQ. IN. (0.08 SQ. M)	REFER TO FLOOR PLAN
22.7.5 KEYS. ALL KEYS NECESSARY FOR UNLOCKING DOORS INSTALLED IN MEANS OF EGRESS SHALL BE INDIVIDUALLY IDENTIFIED BY BOTH TOUCH AND SIGHT.	

24

Fire Marshal Review Comments

1. CONTRACTOR SHALL CHECK WITH LOCAL FIRE DEPARTMENT FOR REQUIREMENTS OF THE FIRE APPARATUS ACCESS ROADS, FIRE PROTECTION WATER SUPPLIES AND FIRE HYDRANT SYSTEMS.
2. THE INSTALLATION OR REPAIR OF ANY UNDERGROUND FACILITIES OR PIPING WHICH CONNECTS TO AND FURNISHES WATER FOR THE WATER-BASED FIRE PROTECTION SYSTEM SHALL BE PERFORMED ONLY BY A LICENSED FIRE PROTECTION SPRINKLER CONTRACTOR, OR LICENSED PLUMBER.
3. HAZARD ROOM DOORS SHALL BE SELF CLOSING.
4. NO VEHICLES SHALL BE PARKED WITHIN THE VEHICULAR SALLYPORT FOR LONGER THAN 24-HOURS.
5. IN SECURED PORTIONS OF THE BUILDING MANUAL FIRE ALARM BOXES SHALL BE LOCATED AT A CONSTANTLY ATTENDED LOCATION (CENTRAL CONTROL 1021, CONTROL TOWER 2409 AND CONTROL TOWER 2408) PER NFPA 101 2000 EDITION CHAPTER 22.3.4.2 EXCEPTION NO2.
6. IN SECURED PORTIONS OF THE BUILDING THE INMATE NOTIFICATION SYSTEM SHALL BE ARRANGED TO ALARM AT A CONSTANTLY ATTENDED LOCATION ONLY (CENTRAL CONTROL 1021, CONTROL TOWER 2409 AND CONTROL TOWER 2408) AND SHALL NOT BE REQUIRED TO ACCOMPLISH GENERAL INMATE NOTIFICATION PER NFPA 101 2000 EDITION CHAPTER 22.3.4.3.1 EXCEPTION.

Key Plan

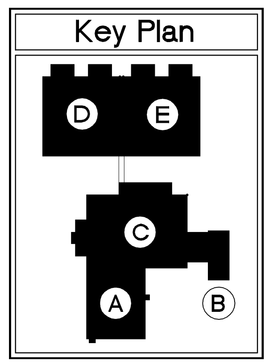

© 2008 PRECISION PLANNING, INC. ALL RIGHTS RESERVED. THESE CONTRACT DOCUMENTS, AND PROMPTED REPRODUCTIONS, AS INSTRUMENTS OF PROFESSIONAL SERVICE, ARE AND SHALL REMAIN THE PROPERTY OF PRECISION PLANNING, INC. UNLESS OTHERWISE AGREED TO, THEY SHALL NOT BE USED BY OTHERS FOR OTHER PROJECTS, OR EXTENSIONS OF THIS PROJECT, EXCEPT BY AGREEMENT IN WRITING AND WITH APPROPRIATE COMPENSATION TO PRECISION PLANNING, INC.

STAMP

Precision Planning, Inc.
planners, engineers, architects & surveyors
P.O. Box 2210
400 Pike Boulevard
Lawrenceville, GA 30046-2210
(770) 338-8000 or (770) 962-8000
(Fax) (770) 822-5990

PROJECT

JACKSON COUNTY JAIL
555 GENERAL JACKSON DRIVE
JEFFERSON, GEORGIA 30549

SHEET TITLE

LIFE SAFETY NOTES

DESIGN	DRAWN	CHECKED
LGD	DMM	LGD

RELEASE

NO	DATE	DESCRIPTION
	12-21-07	MECHANICAL/ ELECTRICAL BID PACKAGE RELEASE
A	1-04-08	MECHANICAL/ ELECTRICAL BID PACKAGE RELEASE
		BALANCE OF REMAINING BID PACKAGES
A	03/28/08	FIRE MARSHAL REVIEW COMMENTS
A	05/16/08	

DATE	PROJ. NUMBER	CAD FILE NAME	FILE NUMBER
03-28-08	A06036	136LS2-0.dwg	

LS2.0

I:\DRAWINGS\06\06136\1540 Construction Documents\136LS2-0.dwg, 4/30/2009 7:56:53 AM, 7526s