

DATE	NO	DESCRIPTION
12/27/07	5	MACHANICAL/ ELECTRICAL BID PACKAGE RELEASE
02/13/08	6	MASONRY/F.P./KITCHEN BID PACKAGE RELEASE
02/28/08	7	BALANCE OF REMAINING BID PACKAGES
04/18/08	11	AS1 #006 FURNISHINGS COORDINATION / OWNER REVISIONS
05/21/08	20	AS1 #015 OWNER REVISIONS AT BOOKING AREA

REFERENCE FLOOR PLAN AREA "C"		
DESIGN	DRAWN	CHECKED
LGD	BKS	LGD
SHEET TITLE		



STATE OF GEORGIA
REGISTERED ARCHITECT
LANCE G. DAVIS
01098

- 1 MOP SINK - REFER TO PLYING DRAWINGS
- 2 PAINTED STEEL COLUMN - REFER TO STRUCTURAL DRAWINGS
- 3 TUBE STEEL COLUMN - REFER TO STRUCTURAL DRAWINGS
- 4 STEEL MEZANINE - REFER TO SHEETS A11 AND A12
- 5 METAL GRATING - REFER TO A11 AND A12
- 6 LOADING DOCK BUFFER, REFER TO SHEET A13
- 7 SAFETY RAIL, REFER TO A13

3. THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY OF ANY DISCREPANCY BETWEEN PARTITIONS SHOWN ON ARCHITECTURAL DRAWINGS AND EXISTING CONDITIONS AND SHALL BE RESPONSIBLE FOR THE CORRECTION AND VERIFICATION PRIOR TO CONSTRUCTION.
4. ALL GYPSUM BOARD IN FINISH AREAS SHALL BE VERY HIGH NIPACT RESISTANT GYPSUM BOARD.
5. 3. SUBSTITUTE 5/8" MOISTURE RESISTANT GYPSUM BOARD AT ALL RESTROOMS AND JANITOR CLOSETS UNLESS NOTED OTHERWISE.
6. CONTRACTOR SHALL PROVIDE COMPLETE SHOP DRAWINGS CLEARLY EXCEEDED 3/16" AND NOT EXCEED 1/8" TO STRUCTURE ABOVE SHOP DRAWING EXCEEDING 1/8" IN THE STATE OF GEORGIA REFER TO STRUCTURAL DRAWINGS AND SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.
7. 5. FOR DOOR REFERENCE AND NOTIFICATION REFER TO A614 THRU A616 AND A614 THRU A617.
8. 6. FOR EXTERIOR AND INTERIOR STORAGE/STOCK UNIFORM REFERENCE (FOR PARTITION) REFER TO A618 THROUGH A620 AND A614 THRU A617.
9. 7. FOR PARTITION OVERLAPPING AND SECURITY, FOLLOW THE REFERENCE NOTIFICATION REFER TO A614 THRU A619.
10. 8. PENETRATION IN FIRE RATED PARTITIONS OR SHIELD WALLS FOR OUTLET BOXES THE EXTINGUISHERS ETC. AND CONNECTIONS OF THE PARTITIONS OR SHIELD WALLS SHALL BE IN ACCORDANCE WITH THE REQUIREMENTS FOR THE FIRE RATED PARTITIONS AND SHIELD WALLS. REFER TO THE SPECIFICATIONS FOR THE FIRE TEST RATINGS.
11. 9. IF PARTITION SYSTEM, WATCHING AND OR MODIFIER ARE IN QUESTION, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT PRIOR TO PROCEEDING. WAITING FOR THE ARCHITECT PRIOR TO PROCEEDING.

	ASSEMBLY: 1 FIRE RATED AND NON-FIRE RATED (ONE) LAYER OF 5/8" GYPSUM BOARD APPLIED AT 10' O.C. TO BOTH VERTICAL EDGES AND 17" O.C. METAL STUDS (8' 0" TO 10' O.C. WITH TYPE 19 SCREWS @ 8" O.C. TO VERTICAL EDGES AND 17" O.C. STUDS, AND BOTTOM RUNNERS AND INTERMEDIATE SPODES.
	ASSEMBLY: 1 FIRE RATED AND NON-FIRE RATED (ONE) LAYER OF 5/8" GYPSUM BOARD APPLIED AT 10' O.C. TO BOTH VERTICAL EDGES AND 17" O.C. METAL STUDS (8' 0" TO 10' O.C. WITH TYPE 19 SCREWS @ 8" O.C. TO VERTICAL EDGES AND 17" O.C. STUDS, AND BOTTOM RUNNERS AND INTERMEDIATE SPODES.
PARTITION MODIFIERS	
	DENOTES METAL STUD ACOUSTICAL PARTITION TYPE. REFER TO 26/A.1.
	DENOTES CMU ACOUSTICAL PARTITION TYPE. REFER TO 21/A.1.
	CMU WALL SHALL BE GROUTED SOLID.
REFERS TO LIFE SAFETY PLAN AND DETAILS FOR FIRE RATED ASSEMBLY LOCATIONS AND TYPE.	

 SYMBOL	 HEIGHT: TO CONCRETE OR TIE PLATE DECK ABOVE	ASSEMBLY: SECURITY WALL OF ROOF DECK. REINFORCE 8" CHL TO UNDERSIDE OF ROOF DECK. REINFORCE 8" CHL BARS AT 8" O.C. PROVIDE 4" DOUELS TO FOOTING OR SLAB AT 4'-6" O.C. REFER TO STRUCTURAL DRAWINGS.
 SYMBOL	 HEIGHT: TO UNDERSIDE OF SECURE CEILING FINISH 8" ABOVE FINISH CEILING HEIGHT	ASSEMBLY: SECURITY WALL TO UNDERSIDE OF SECURE CEILING OR A MINIMUM OF 8" ABOVE FINISHED CONCRETE CEILING. PROVIDE 8" CHL BARS AT 8" O.C. PROVIDE 4" DOUELS TO FOOTING OR SLAB AT 4'-6" O.C. REFER TO STRUCTURAL DRAWINGS.
 SYMBOL	 HEIGHT: 19'-4" ABOVE FINISH FLOOR UNLESS NOTED OTHERWISE	ASSEMBLY: NON-SECURE WALL. NOMINALLY 3/8" THICK WITH HORIZONTAL JOINT PERMANENT AT 16' O.C. REFER TO STRUCTURAL DRAWINGS.
 SYMBOL		ASSEMBLY: NON-SECURE WALL 8" CHL TO UNDERSIDE OF THE ROOF DECK OR TOP OF PARAPET. REFER TO STRUCTURAL.
 SYMBOL		ASSEMBLY: NON-SECURE WALL TO UNDERSIDE OF SECURE CEILING OR A MINIMUM OF 8" ABOVE FINISHED CONCRETE CEILING. REFER TO STRUCTURAL FOR REINFORCEMENT.
 SYMBOL		ASSEMBLY: NON-SECURE WALL 8" CHL REINFORCE WITH 4" BARS AT 8" O.C. PROVIDE 4" DOUELS TO FOOTING OR SLAB AT 4'-6" O.C. REFER TO STRUCTURAL PLAN FOR WALL HEIGHT.
 SYMBOL		ASSEMBLY: SECURITY WALL 8" OR 9" PRECAST CONCRETE WALL PANEL.

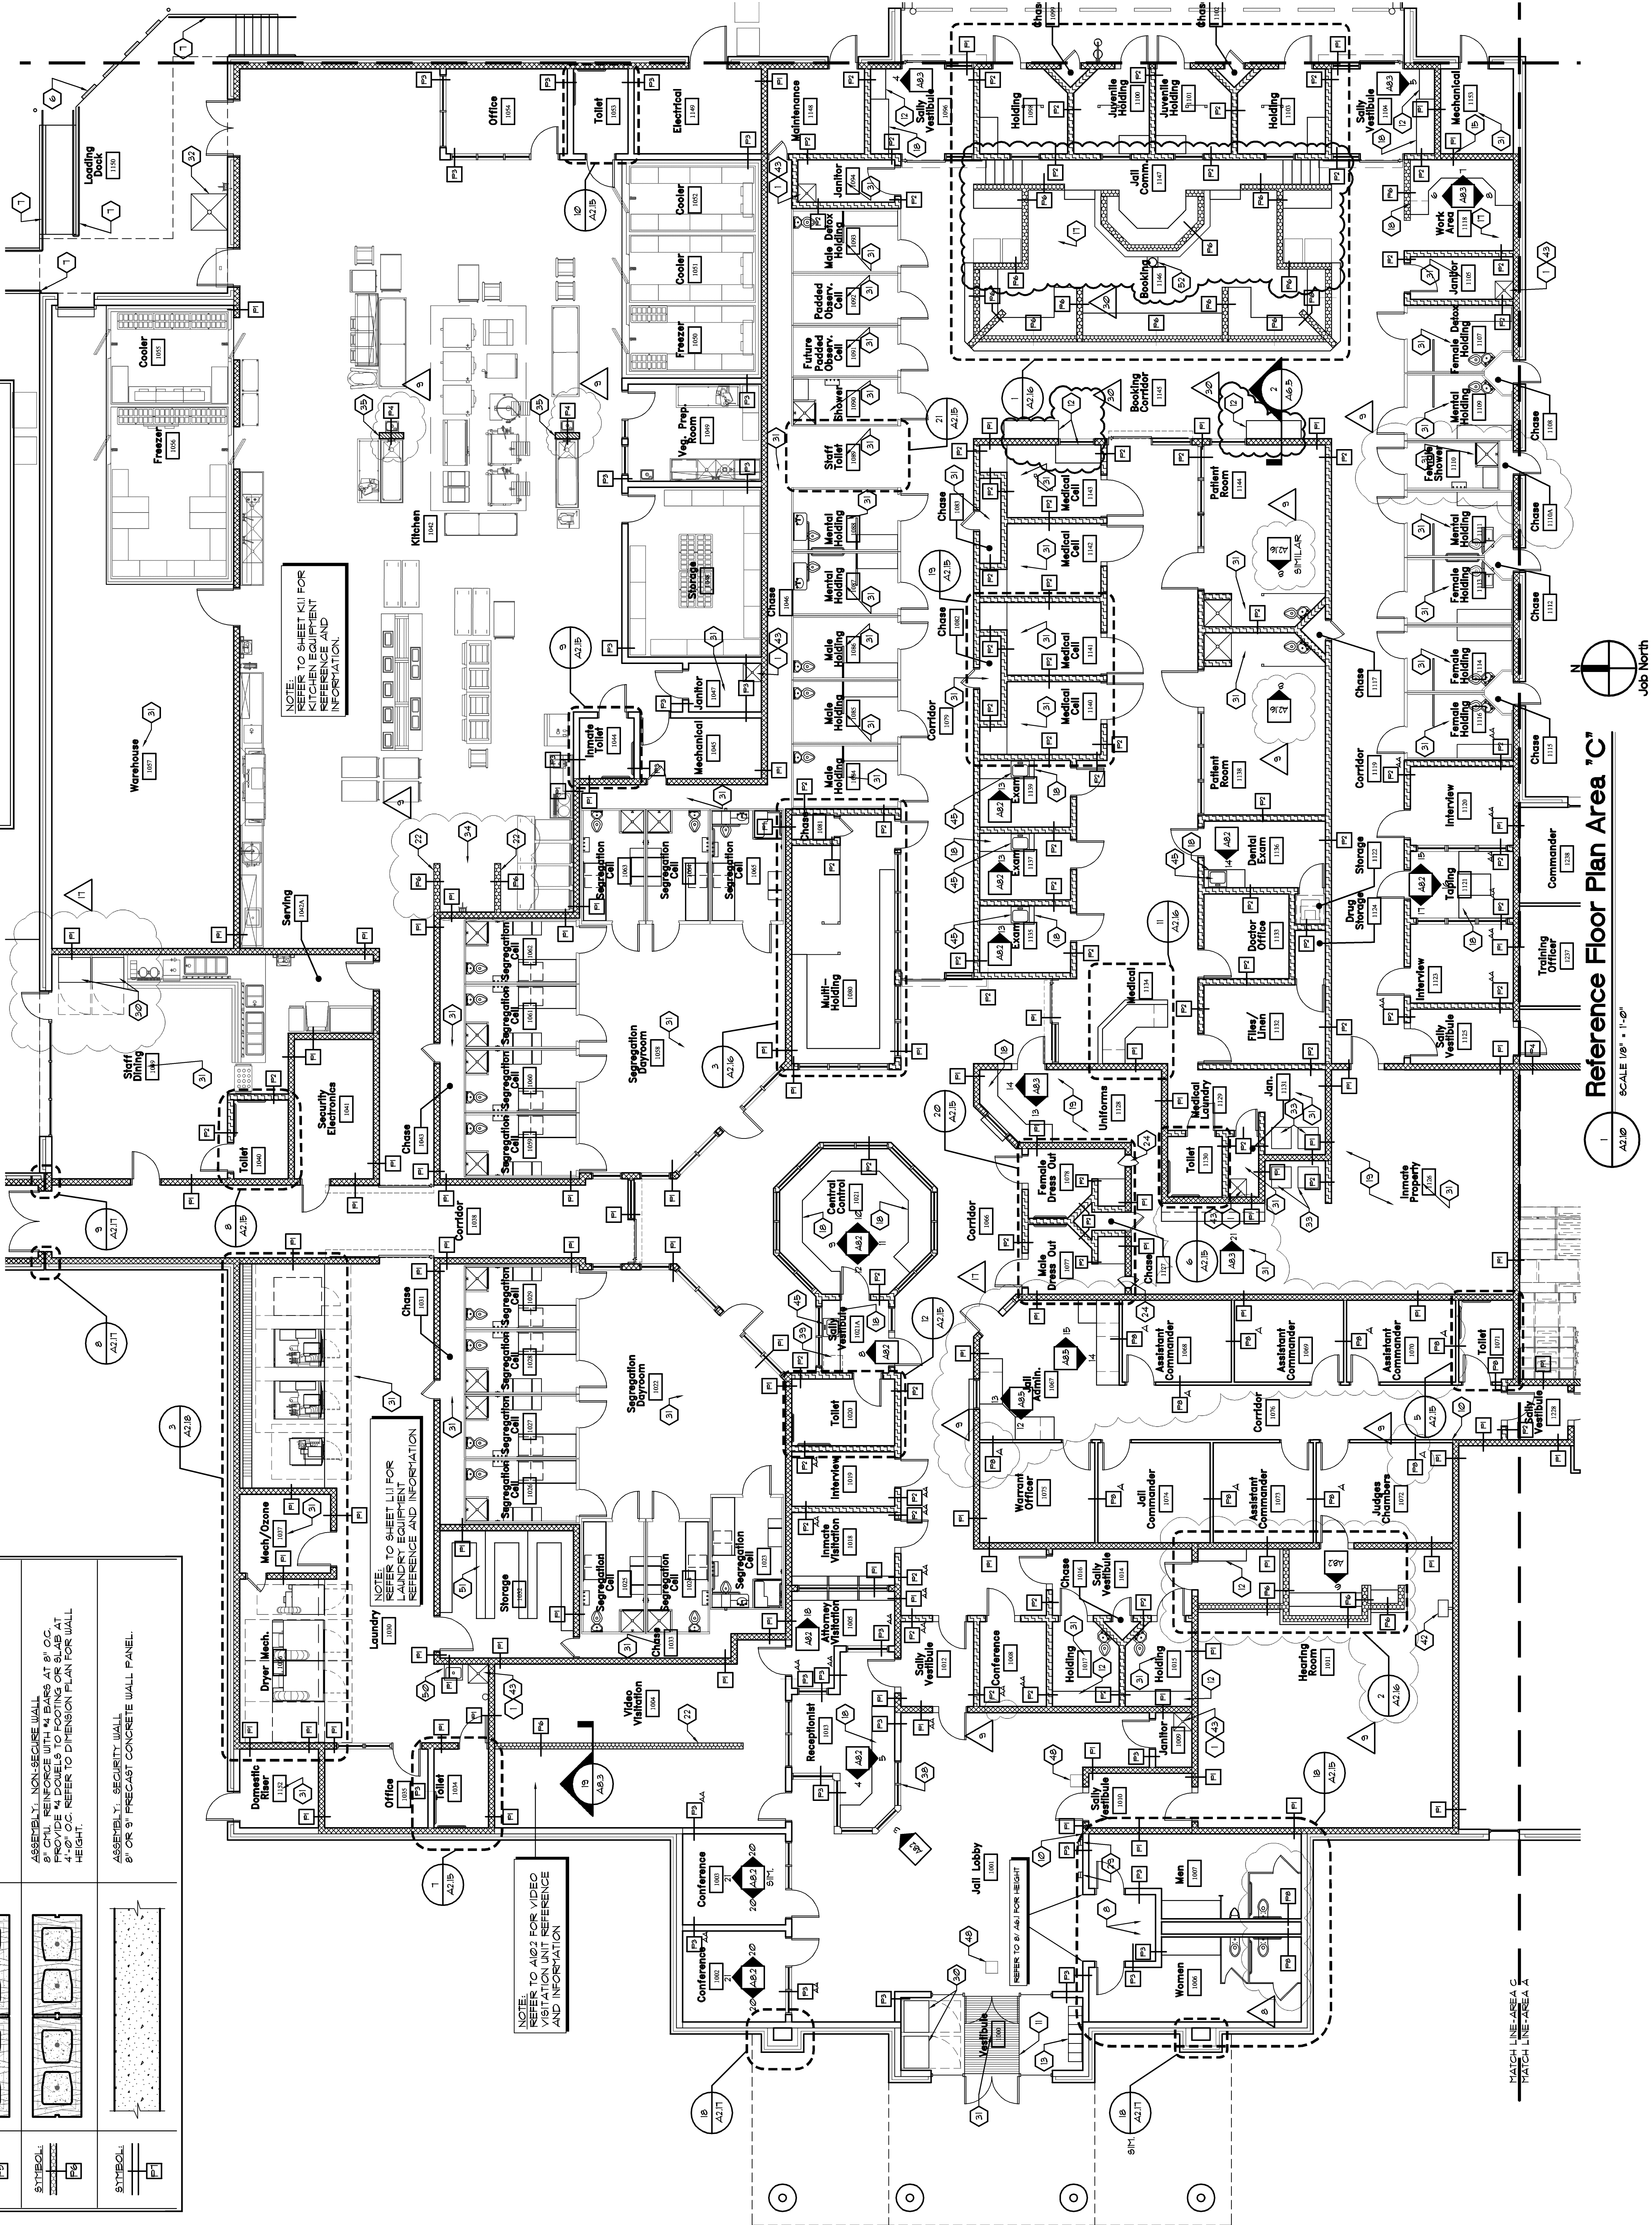


Figure 1. A schematic diagram of the experimental design. The subjects were divided into two groups: the control group and the experimental group. The control group received a standard training program, while the experimental group received a modified training program. The subjects were then tested on a series of tasks, and the results were compared between the two groups.

Job North

Key Plan

