


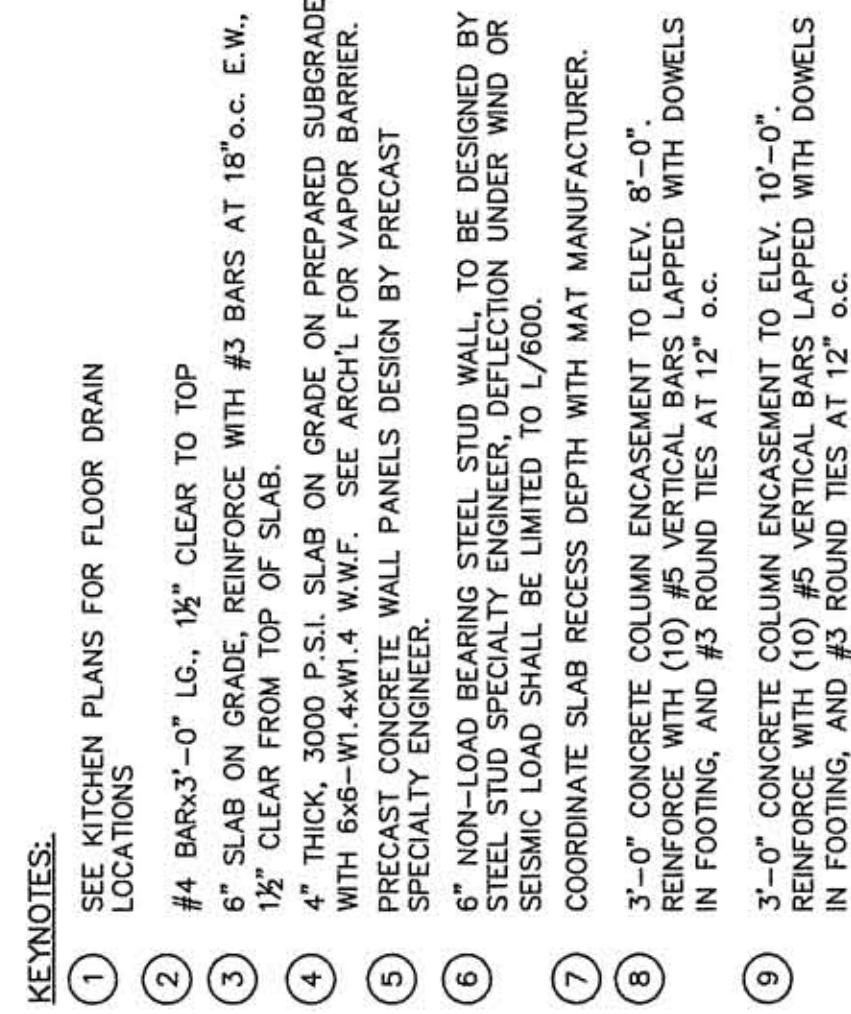

	NON-SECURE WALL	8" CMU TO THE UNDERSIDE OF THE ROOF DECK OR TOP OF PARAPET, REINFORCE WITH #5 BARS AT 32" o.c.
	NON-SECURE WALL	8" CMU TO THE UNDERSIDE OF SECURE CONCRETE CEILING OR ROOF DECK, REINFORCE WITH #5 BARS AT 48" o.c.
	SECURITY WALL	8" CMU TO UNDERSIDE OF ROOF DECK, REINFORCE WITH #5 BARS AT 8" o.c. PROVIDE #4 DOWELS TO FOOTING OR SLAB AT 4'-0" o.c.
	SECURITY WALL	8" CMU TO UNDERSIDE OF SECURE CONCRETE CEILING OR A MINIMUM OF 8" ABOVE FINISH CEILING, REINFORCE WITH #4 BARS AT 8" o.c. PROVIDE #4 DOWELS TO FOOTING OR SLAB AT 4'-0" o.c.
	SECURITY WALL	8" CMU TO 4'-8" ABOVE SLAB, REINFORCE WITH #4 BARS AT 8" o.c. PROVIDE #4 DOWELS TO FOOTING OR SLAB AT 4'-0" o.c.

- NOTES.**
1. SEE SHEET 55.3 FOR COLUMN AND FOOTING SCHEDULES.
 2. ALL WALLS SHOWN ARE 8" CMU U.N.O. REINFORCED WITH #5 AT 48" o.c. IN GROUTED CELLS U.N.O.
 3. ALL DIMENSIONS ARE TO FACE OF CMU U.N.O.
 4. SEE PLUMBING PLANS FOR FLOOR DRAIN LOCATIONS.
 5. SEE ARCHITECTURAL PLANS FOR WALL DIMENSIONS NOT SHOWN.
 6. SEE DETAIL 16/55.1 FOR MASONRY CONTROL JOINT.

- KEYNOTES:
- 1 SEE KITCHEN PLANS FOR FLOOR DRAIN LOCATIONS
- 2 #4 BARS-3" O.C., 1/2" CLEAR TO TOP
- 3 #6 SLAB ON GRADE, REINFORCE WITH #3 BARS AT 18" o.c. E.W.,
- 4 1/2" CLEAR FROM TOP OF SLAB.
- 5 #4 THICK, 3000 P.S.I. SLAB ON PREPARED SUBGRADE WITH 665-W-44M-4 W.W.F. SEE ARCHIT. FOR VAPOR BARRIER.
- 6 SPECIALTY MANUFACTURER WILL PANELS DESIGN BY PRECAST
- 7 SPECIALTY MANUFACTURER
- 8 STEEL-LOAD BEARING STEEL, TO BE DESIGNED BY STEEL STRUCT SPECIALTY ENGINEER, DETECTION UNDER WIND OR SEISMIC LOAD SHALL BE LIMITED TO 1/600.
- 9 COORDINATE SLAB RECESS DEPTH WITH MANUFACTURER.
- 10 3" O" CONCRETE COLUMN ENJOINTMENT TO ELEV. 8'-0"
- 11 REINFORCE WITH (10) #5 VERTICAL BARS LAPPED WITH DOMELS IN FOOTING, AND #3 ROUND TIES AT 12" o.c.
- 12 3" O" CONCRETE COLUMN ENJOINTMENT TO ELEV. 10'-0"
- 13 REINFORCE WITH (10) #5 VERTICAL BARS LAPPED WITH DOMELS IN FOOTING, AND #3 ROUND TIES AT 12" o.c.