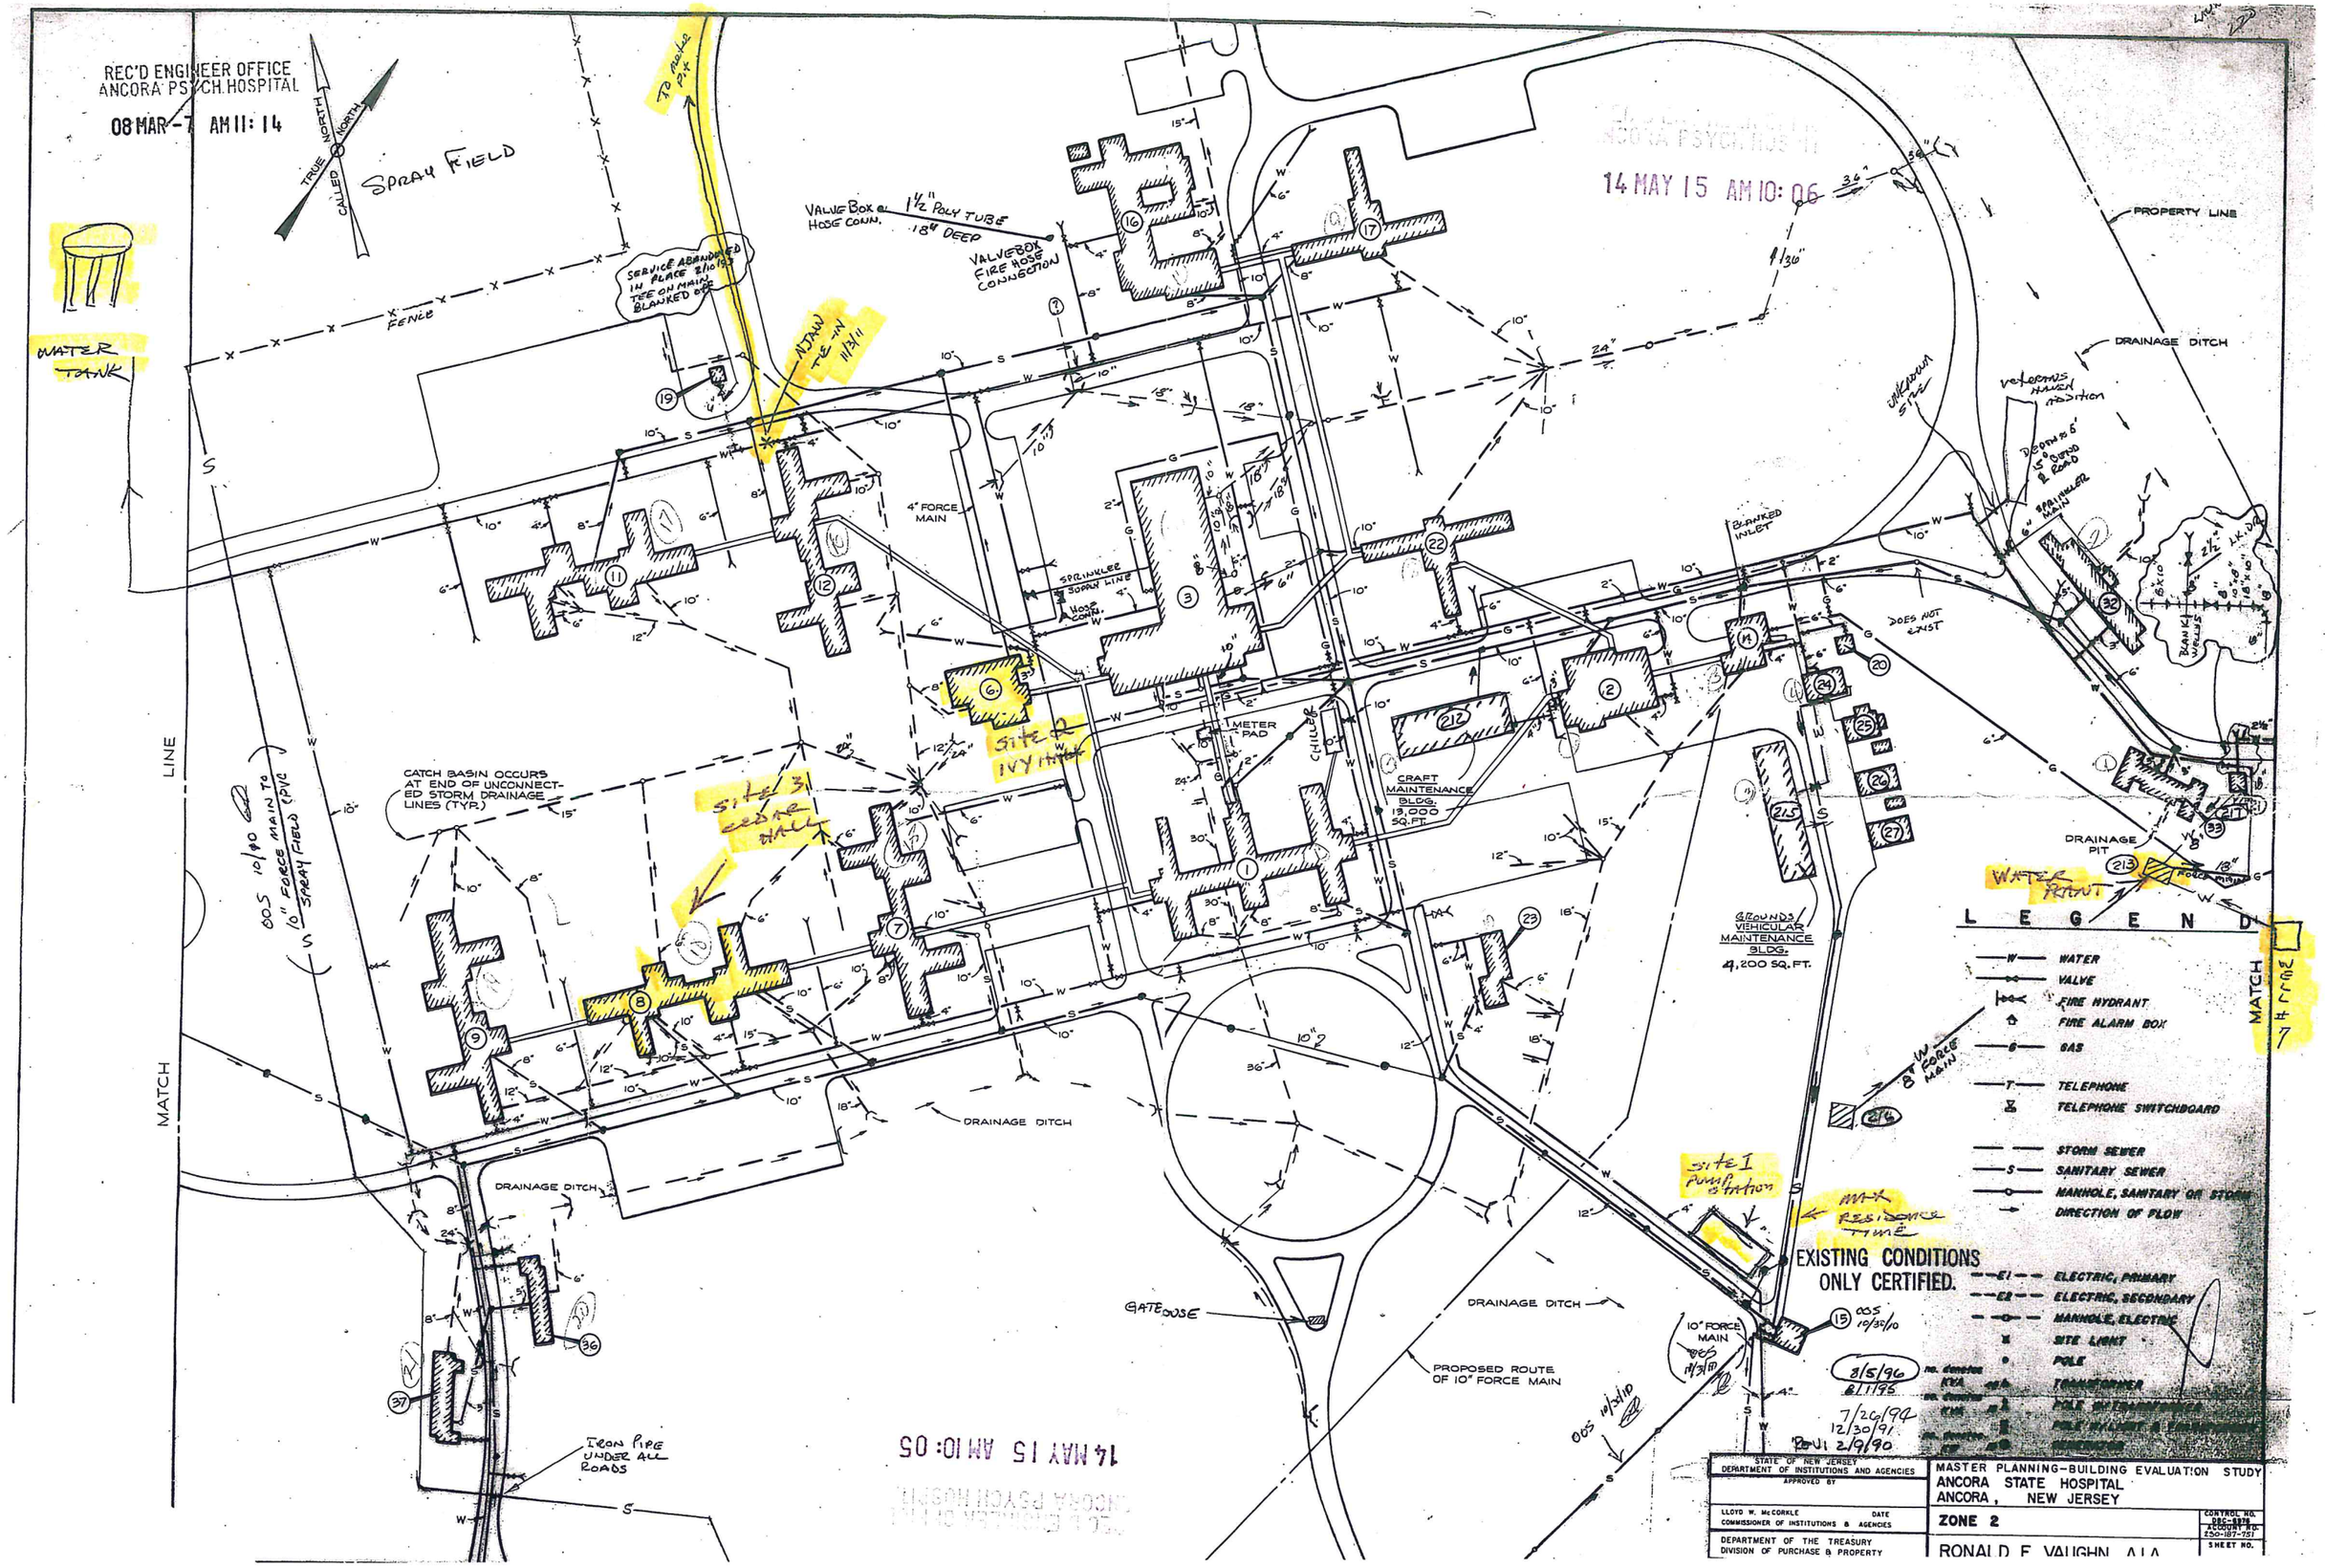
REC'D ENGINEER OFFICE
ANCORA PSYCH. HOSPITAL
08 MAR -7 AM 11: 14
TRUE NORTH
CALLED NORTH
SPRAY FIELD
WATER TANK
FENCE
TO make pit
SERVICE ABANDONED IN PLACE 2/10/93 TEE ON MAIN BLANKED END
MAIN TIE-IN 11/3/11
VALVE BOX @ HOSE CONN.
1½" POLY TUBE 18" DEEP
VALVEBOX FIRE HOSE CONNECTION
4" FORCE MAIN
SPRINKLER & DRAIN LINE
HOSE CONN.
METER PAD
CHILLER
CRAFT MAINTENANCE BLDG. 13,000 SQ.FT.
GROUNDS VEHICULAR MAINTENANCE BLDG. 4,200 SQ.FT.
BLANKED INLET
DOES NOT EXIST
unknown size
veterans HAUN addition
DRAINAGE DITCH
PROPERTY LINE
DRAINAGE PIT
WATER PUMPOUT
CATCH BASIN OCCURS AT END OF UNCONNECTED STORM DRAINAGE LINES (TYP.)
OOS 10/90 10" FORCE MAIN TO SPRAY FIELD (PVC)
site 3 cedar hall
site 2 IVY INLET
site 1 pump station
MAX RESIDENCE TIME
GATEHOUSE
PROPOSED ROUTE OF 10" FORCE MAIN
10" FORCE MAIN
8" W FORCE MAIN
IRON PIPE UNDER ALL ROADS
MATCH LINE
14 MAY 15 AM 10: 06
14 MAY 15 AM 10: 05
LEGEND
WATER
VALVE
FIRE HYDRANT
FIRE ALARM BOX
GAS
TELEPHONE
TELEPHONE SWITCHBOARD
STORM SEWER
SANITARY SEWER
MANHOLE, SANITARY OR STORM
DIRECTION OF FLOW
EXISTING CONDITIONS ONLY CERTIFIED.
ELECTRIC, PRIMARY
ELECTRIC, SECONDARY
MANHOLE, ELECTRIC
SITE LIGHT
POLE
TRANSFORMER
8/5/96
8/1/96
7/26/94
12/30/91
2/9/90
STATE OF NEW JERSEY
DEPARTMENT OF INSTITUTIONS AND AGENCIES
APPROVED BY
LLOYD W. McCORKLE DATE
COMMISSIONER OF INSTITUTIONS & AGENCIES
DEPARTMENT OF THE TREASURY
DIVISION OF PURCHASE & PROPERTY
MASTER PLANNING-BUILDING EVALUATION STUDY
ANCORA STATE HOSPITAL
ANCORA, NEW JERSEY
ZONE 2
RONALD F. VAUGHN A.I.A.
CONTROL NO. DEC-8878
ACCOUNT NO. 230-187-751
SHEET NO.