
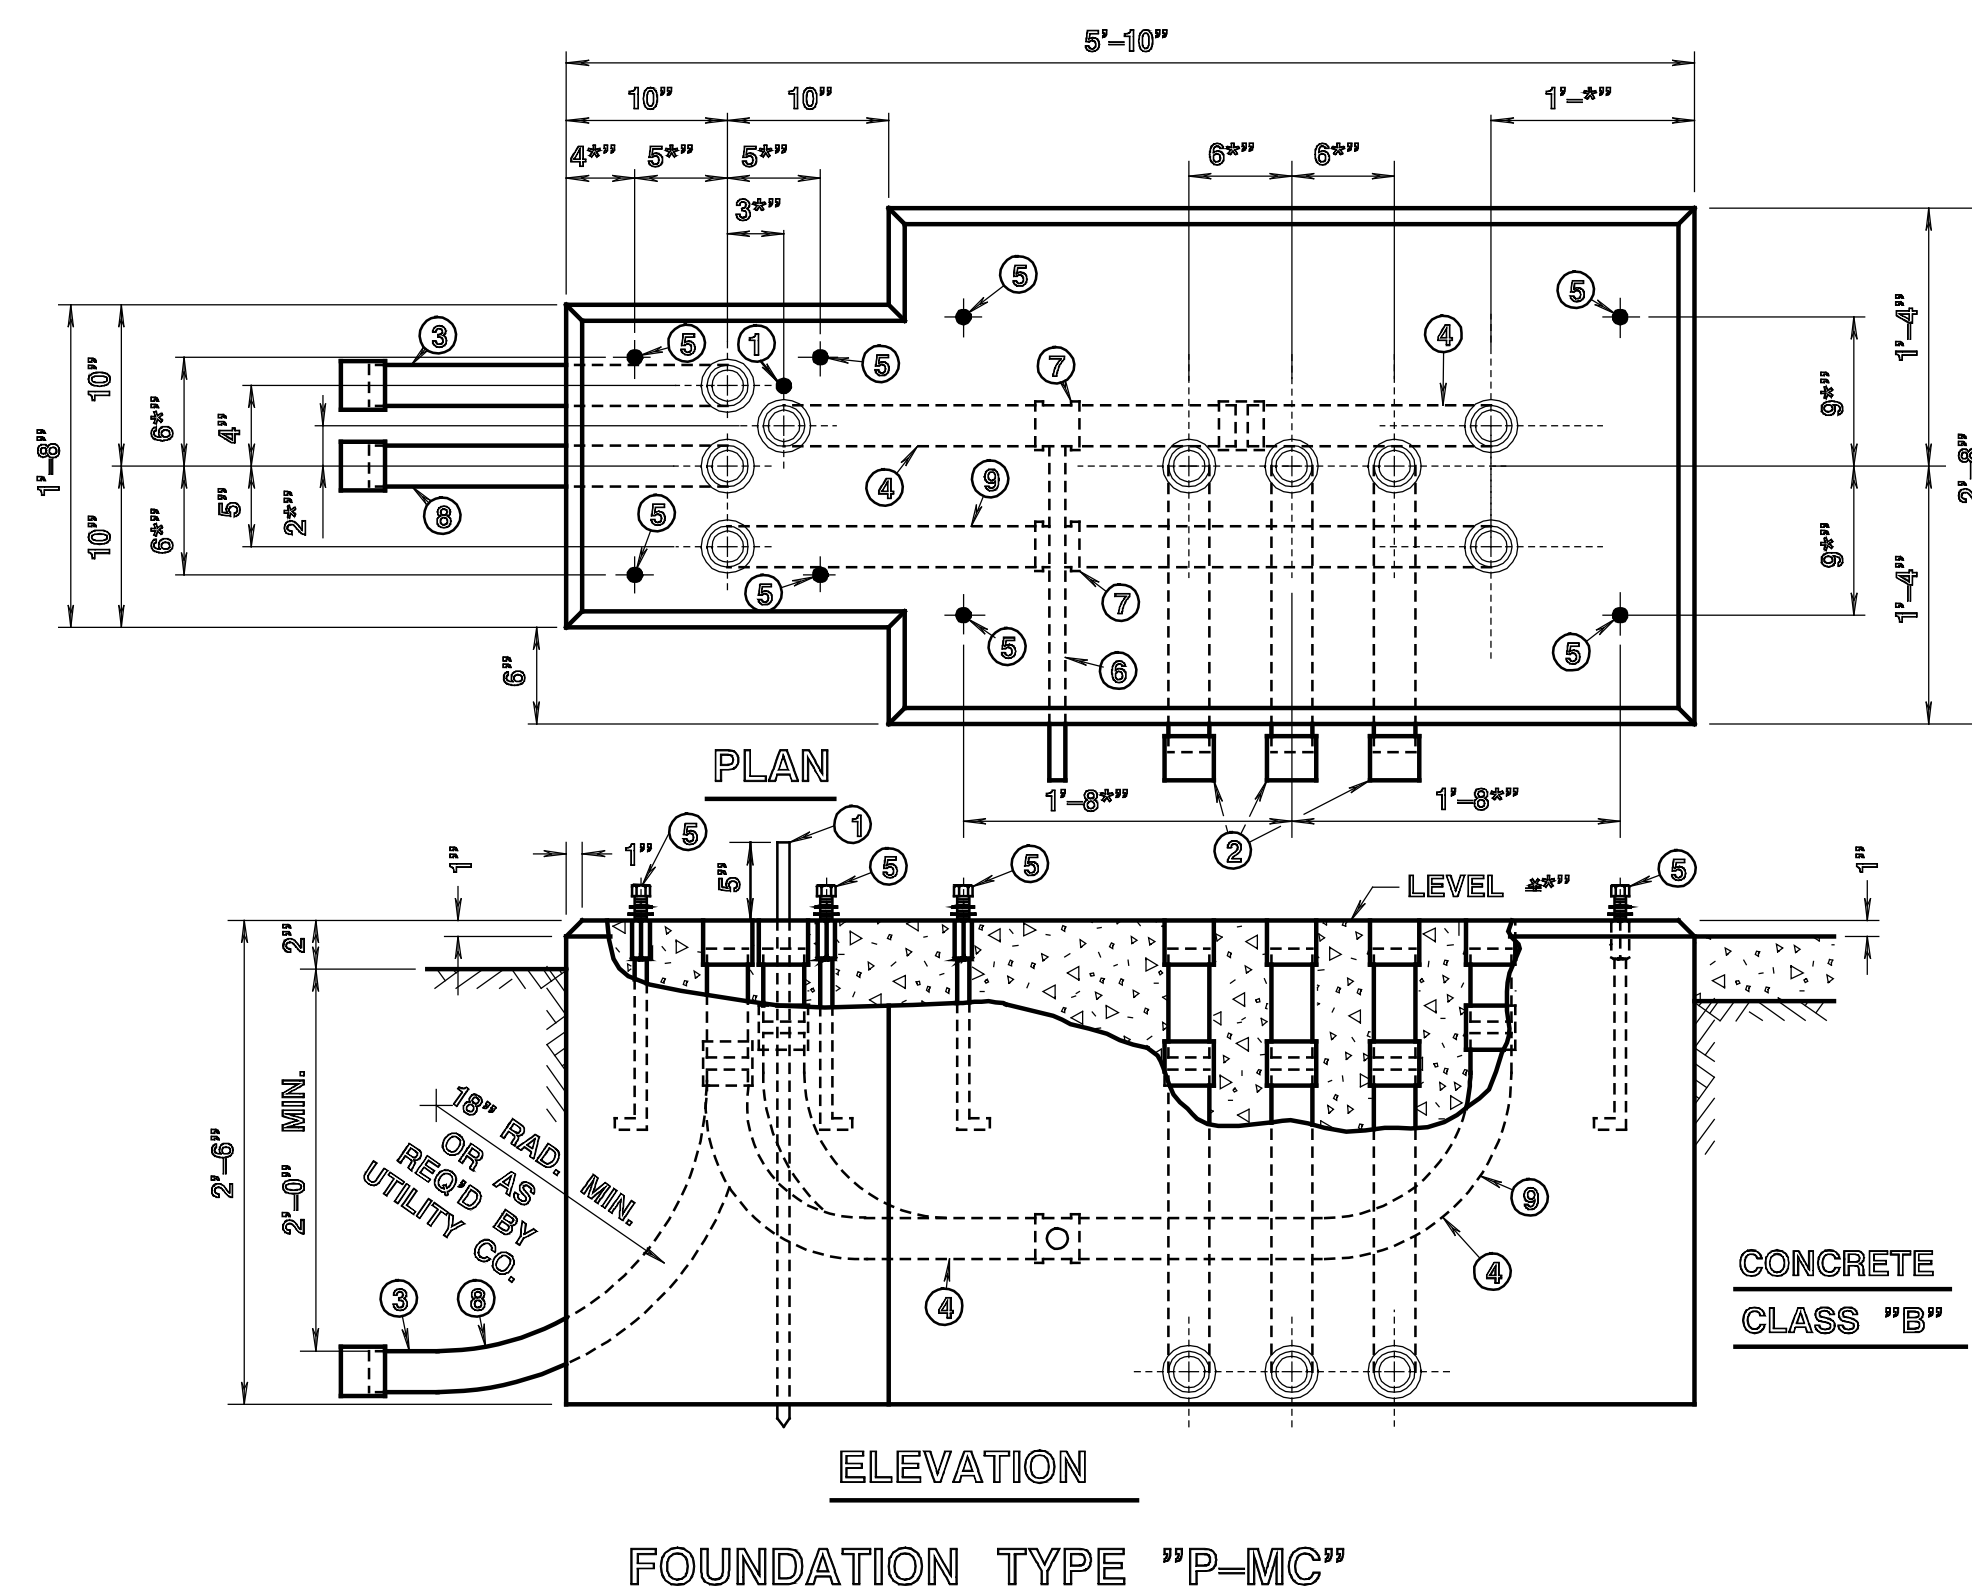


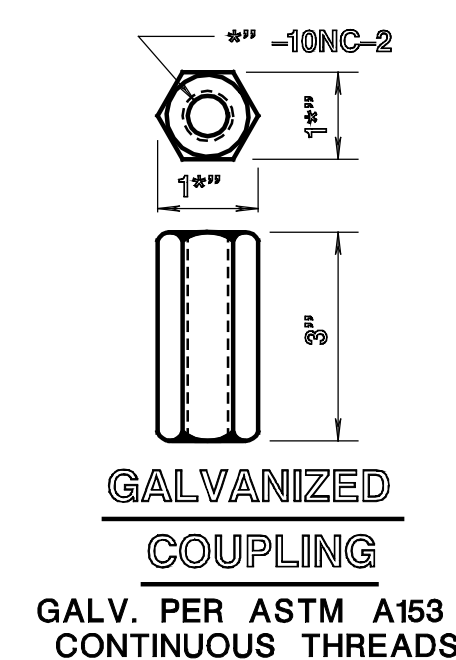

- ITEM
- ① " X 12' L.G. GROUND ROD.
 - ② 3" DIA. RIGID METALLIC CONDUIT. (ALL SHALL EXTEND TO JUNCTION BOX)
 - ③ RIGID METALLIC CONDUIT (SERVICE CONDUIT). SEE GENERAL PLAN FOR DIRECTION AND SIZE
 - ④ 2" DIA. RIGID METALLIC CONDUIT (SERVICE CONDUIT)
 - ⑤ " DIA. ANCHOR BOLTS (SEE "SPF" FOUNDATION FOR DETAILS)
 - ⑥ DRAIN 1" DIA. RIGID METALLIC CONDUIT (PITCH TO JUNCTION BOX).
 - ⑦ 2" X 2" X 1" GALV. TEE FITTING.
 - ⑧ RIGID METALLIC CONDUIT (INTERCONNECT CONDUIT). SEE GENERAL PLAN FOR DIRECTION AND SIZE IF NOT SPECIFIED 2" DIA. RMC SHALL BE INSTALLED.
 - ⑨ 2" DIA. RIGID METALLIC CONDUIT (INTERCONNECT CONDUIT)

- NOTES:**
1. ALL CONDUIT SHALL BE INSTALLED SO THAT COUPLINGS ARE EMBEDDED PLUMB AND FLUSH WITH TOP OF CONCRETE FOUNDATION.
 2. J-BOLT MUST BE INSERTED 1" ** INTO 3" COUPLING
 3. ALL FOUNDATIONS SHALL BE POURED MONOLITHIC