SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	DAY CARE SUITE	6,660 Sq. Ft.	NON SLEEPING PATIENT CARE	2
2	RESEARCH LAB SUITE	5,830 Sq. Ft.	NON SLEEPING PATIENT CARE	1

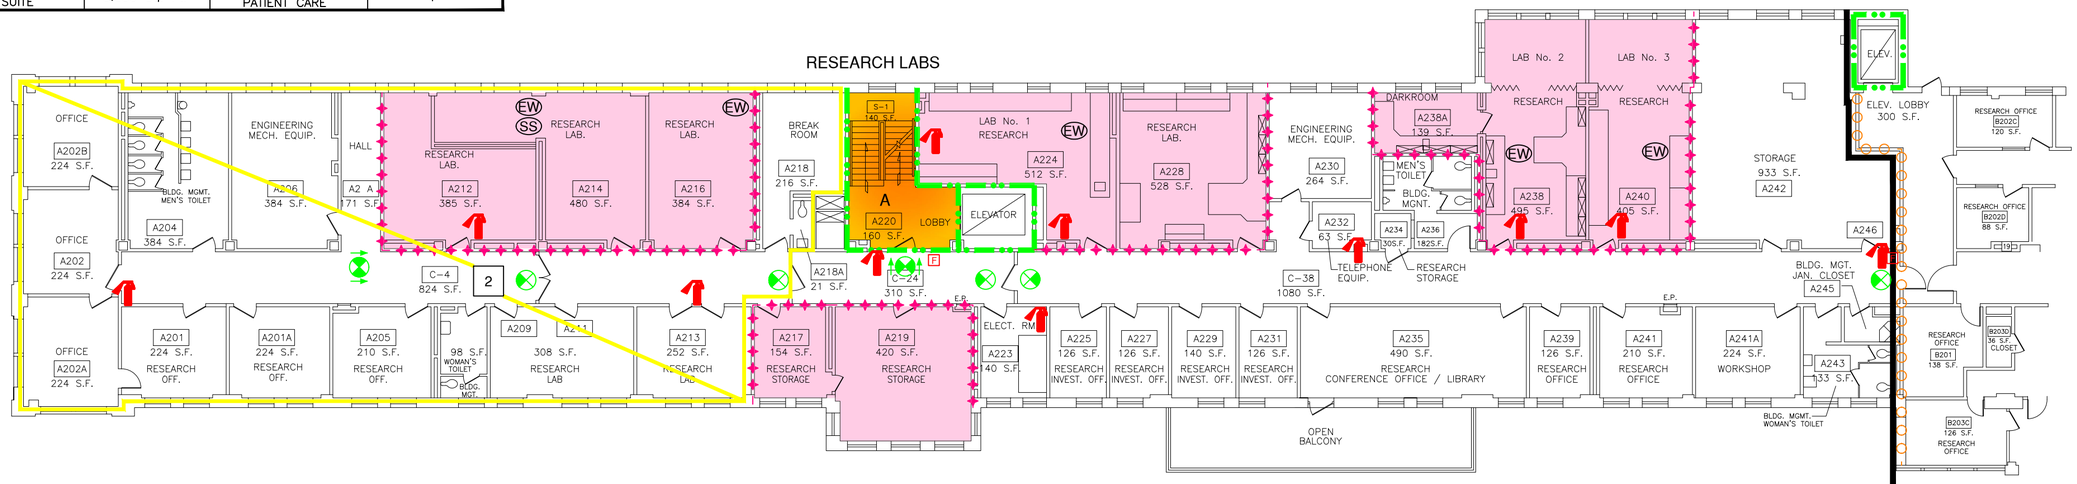

SECOND FLOOR SECTION A

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

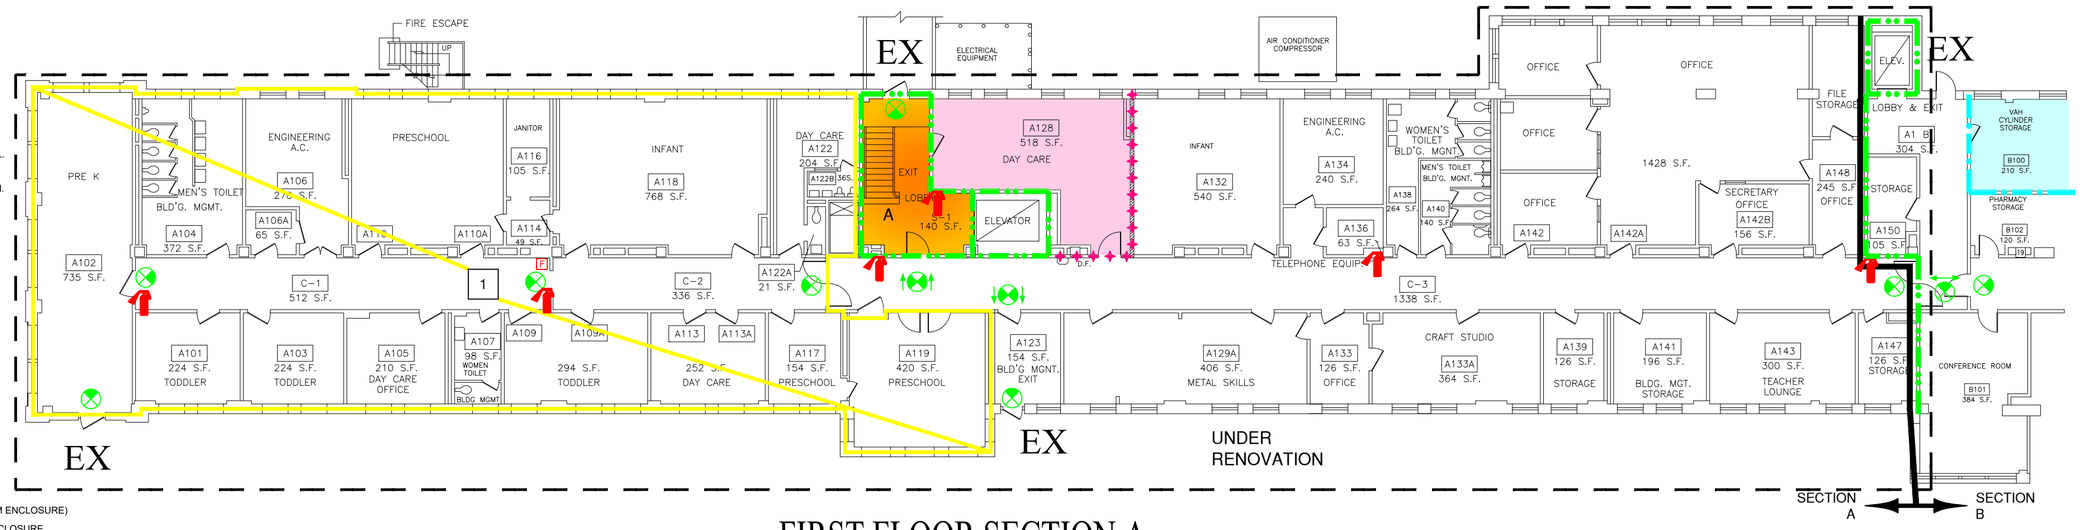

FIRST FLOOR SECTION A

BUILDING 1 SECTION A

NON SPRINKLERED

FIRST FLOOR BUSINESS OCCUPANCY

SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION A FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1A-2A

Dwg. 37 of 64

FOURTH FLOOR SECTION A

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

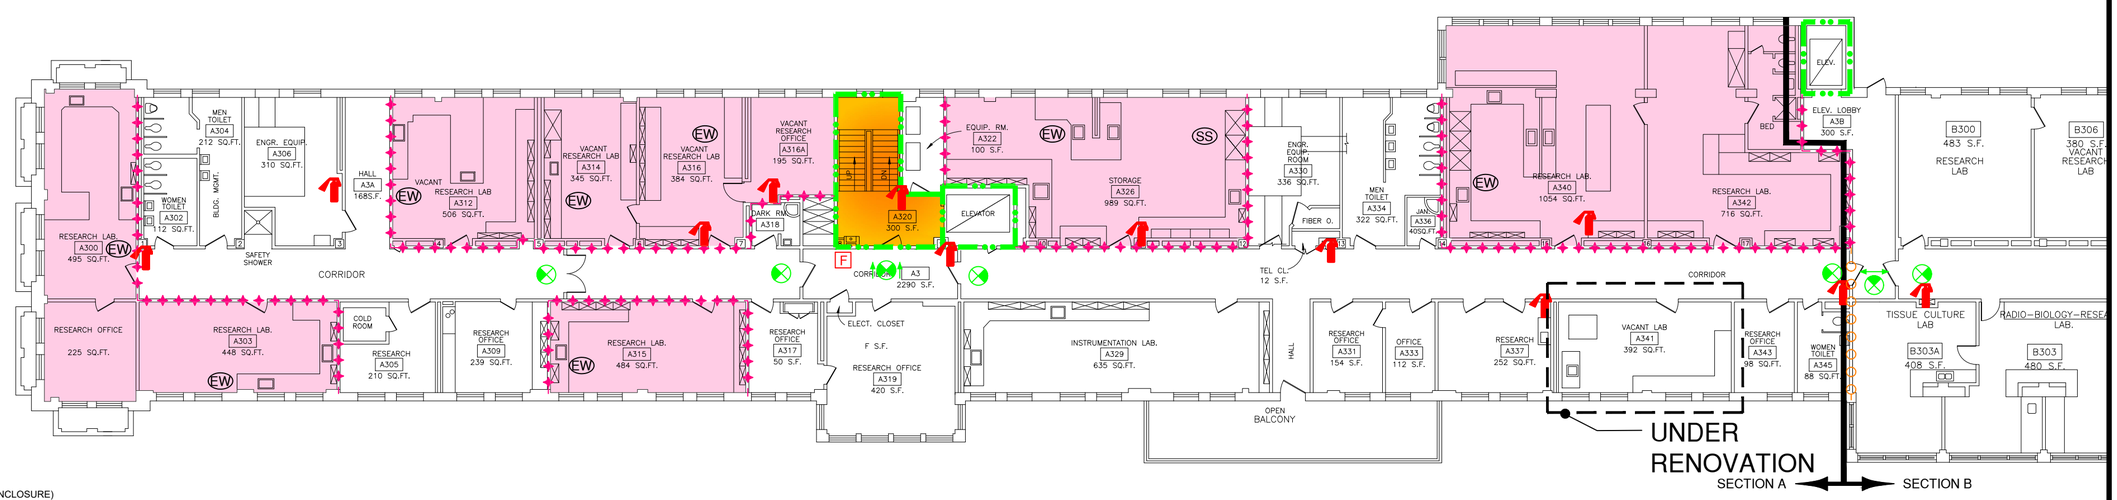

THIRD FLOOR SECTION A

BUILDING 1 SECTION A

NON SPRINKLERED

THIRD FLOOR BUSINESS OCCUPANCY

FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION A THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3A-4A

Dwg. 38 of 64

KEY NOTES:

1. MAXIMUM 49 OCCUPANTS.

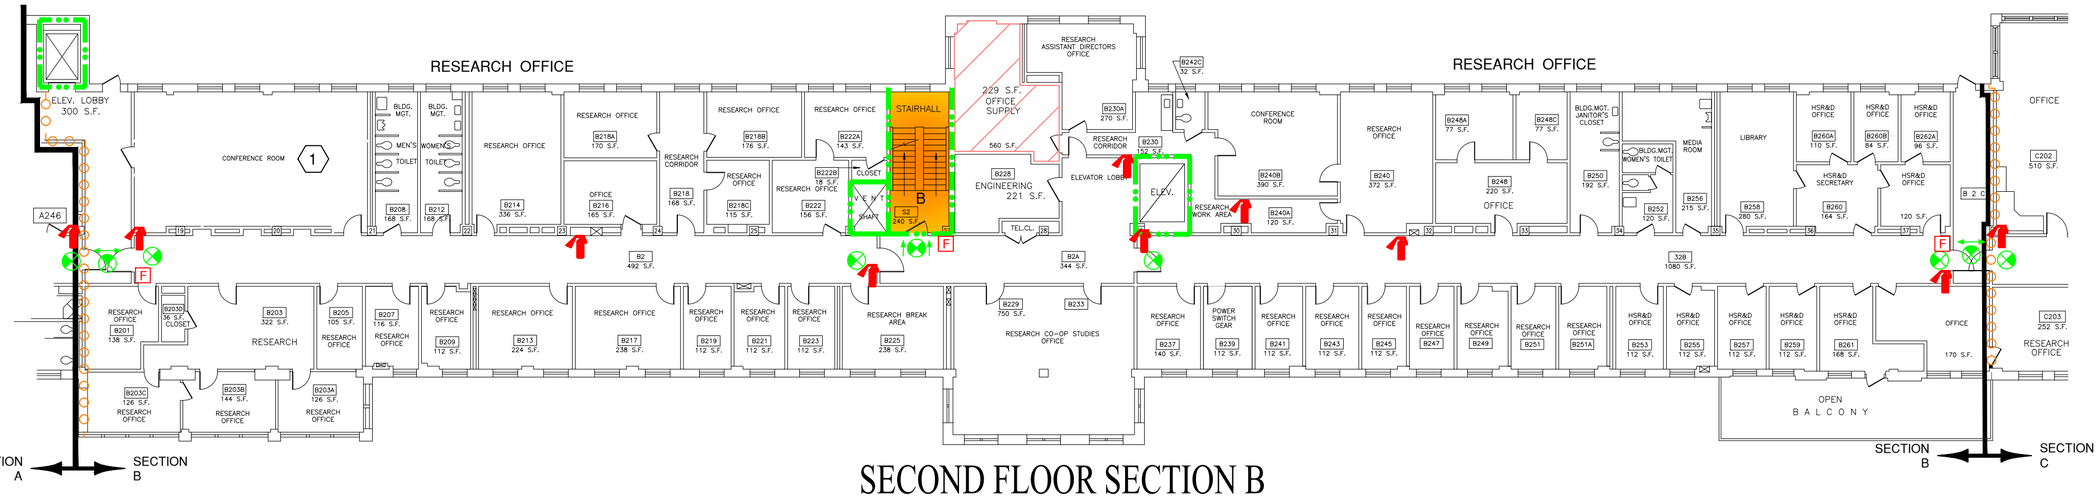

SECOND FLOOR SECTION B
(NON SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

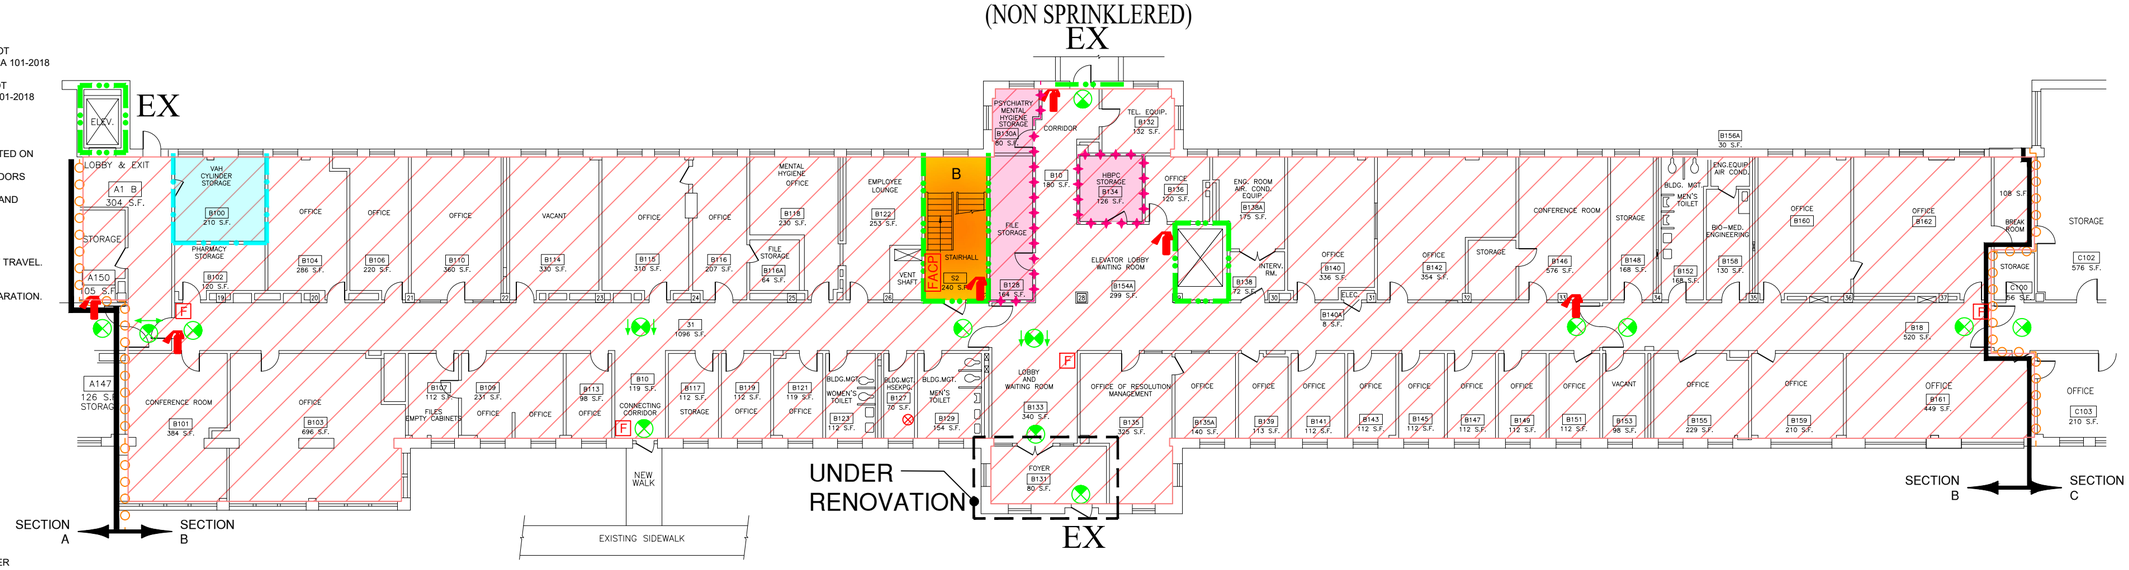

FIRST FLOOR SECTION B
(SPRINKLERED)

BUILDING 1
SECTION B
PARTIALLY SPRINKLERED
FIRST FLOOR BUSINESS OCCUPANCY
SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION B FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1B-2B

Dwg. 39 of 64

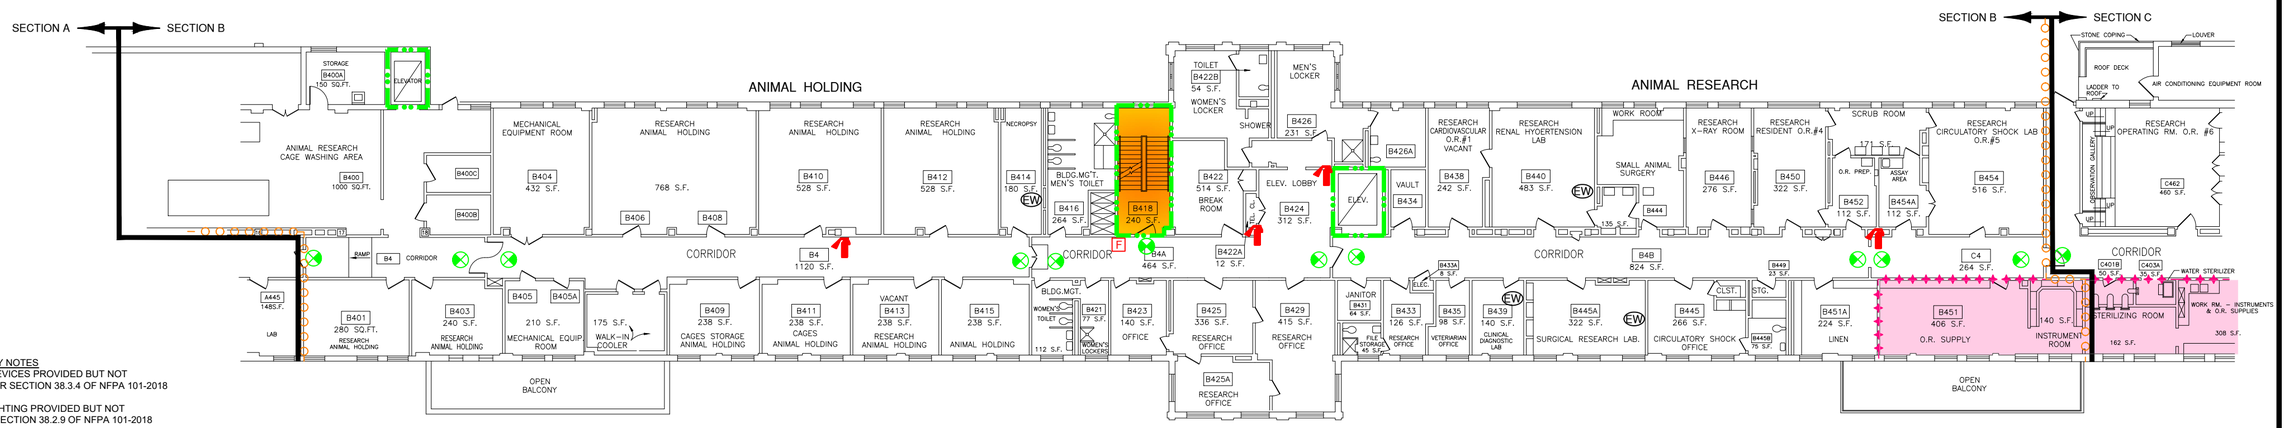

FOURTH FLOOR SECTION B

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

EP	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
EX	EXIT
HE	HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

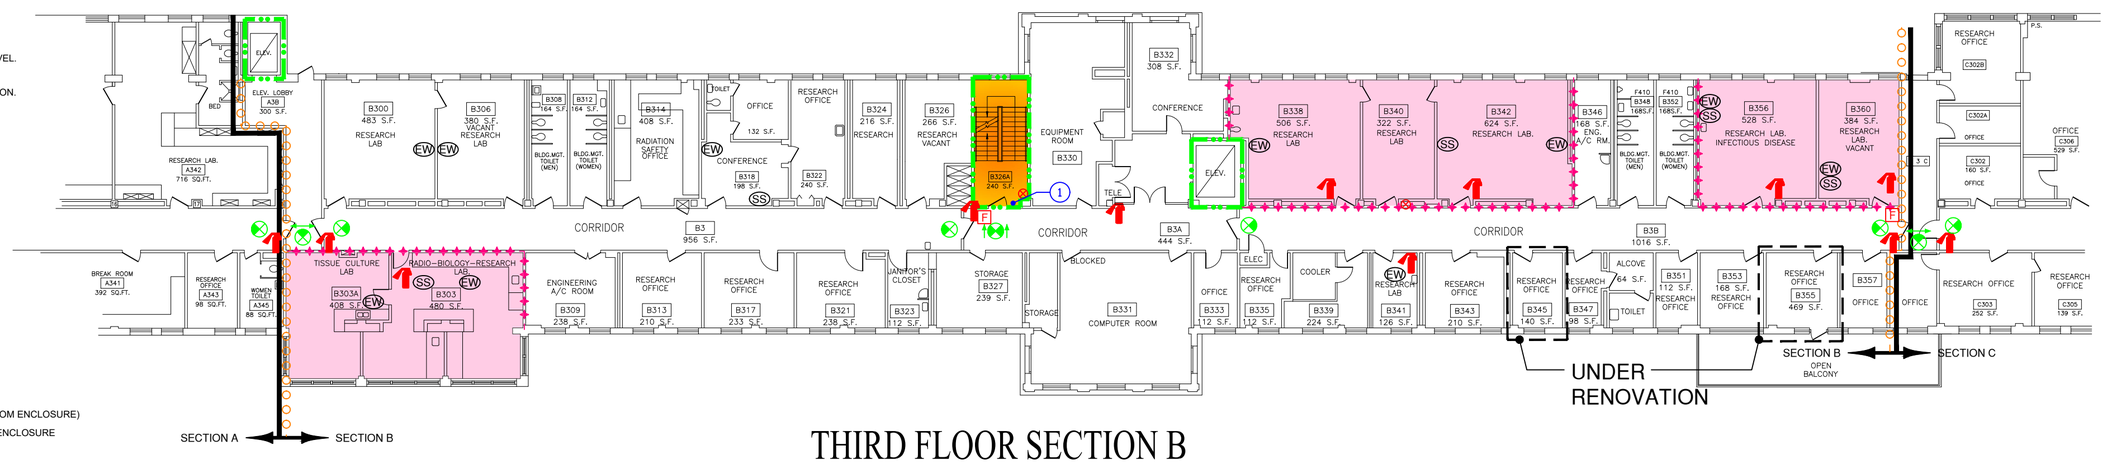

THIRD FLOOR SECTION B

BUILDING 1
SECTION B
NON SPRINKLERED
THIRD FLOOR BUSINESS OCCUPANCY
FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION B THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3B-4B

Dwg. 40 of 64

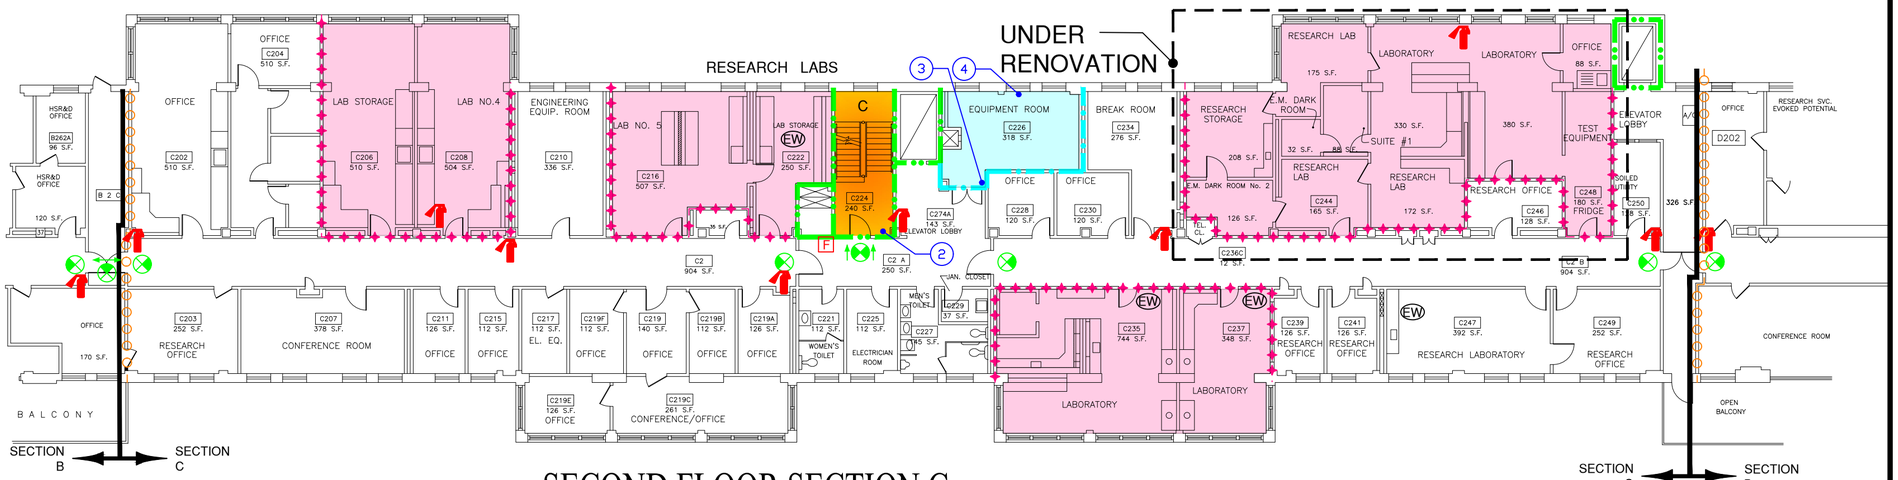

SECOND FLOOR SECTION C
(NON SPRINKLERED)

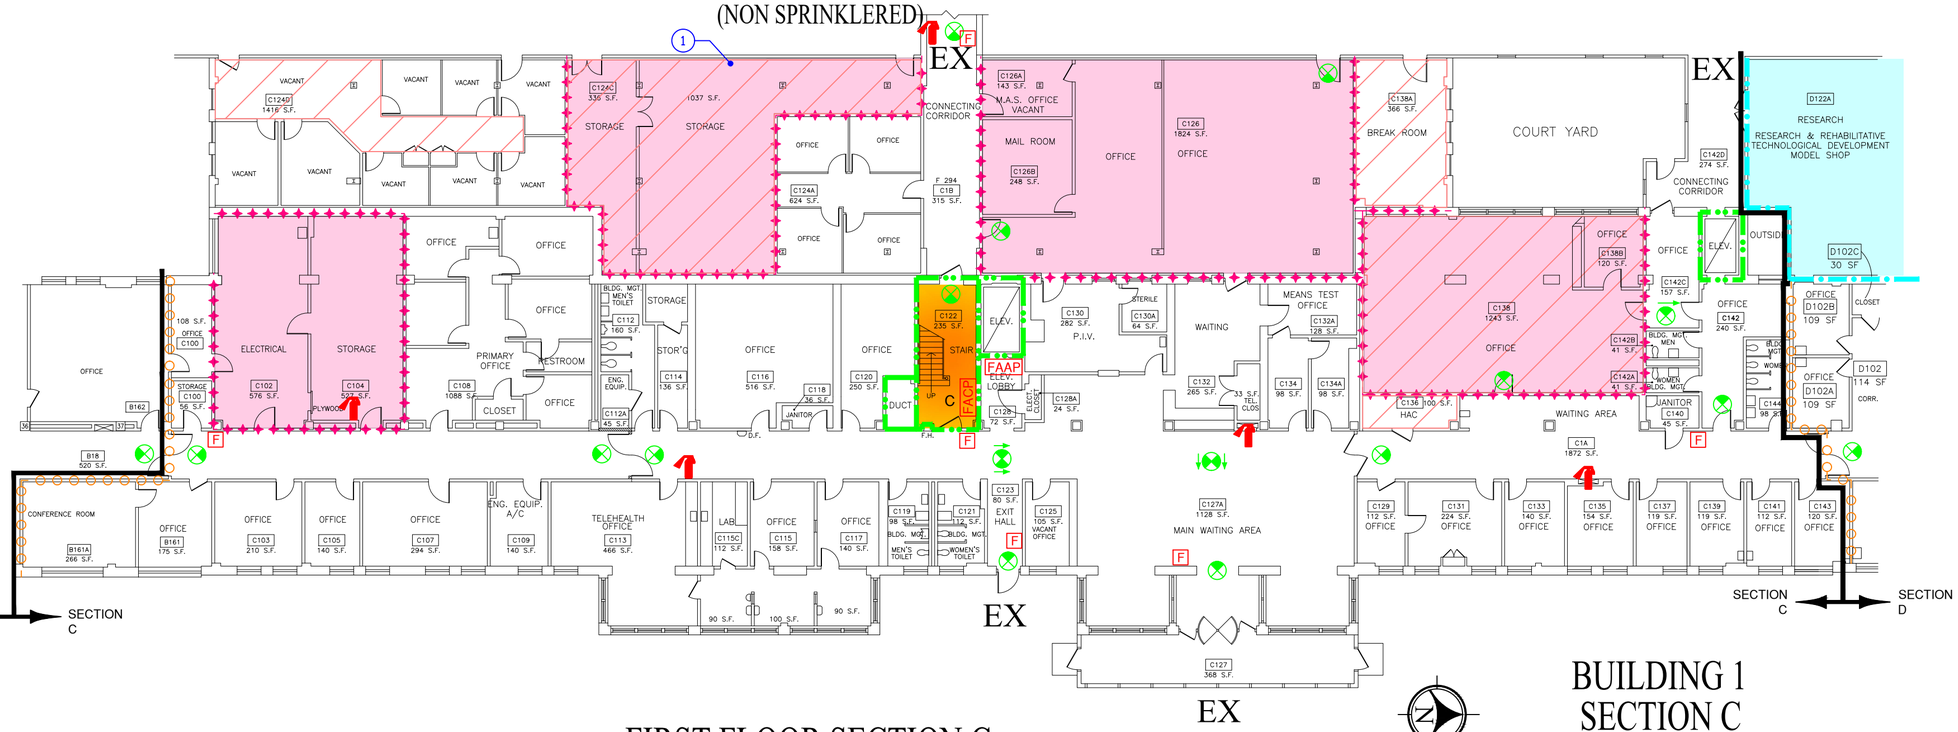

FIRST FLOOR SECTION C
(PARTIALLY SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

BUILDING 1
SECTION C
PARTIALLY SPRINKLERED
FIRST FLOOR BUSINESS OCCUPANCY
SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION C FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1C-2C

Dwg. 41 of 64

KEY NOTES:

1. MAXIMUM 49 OCCUPANTS

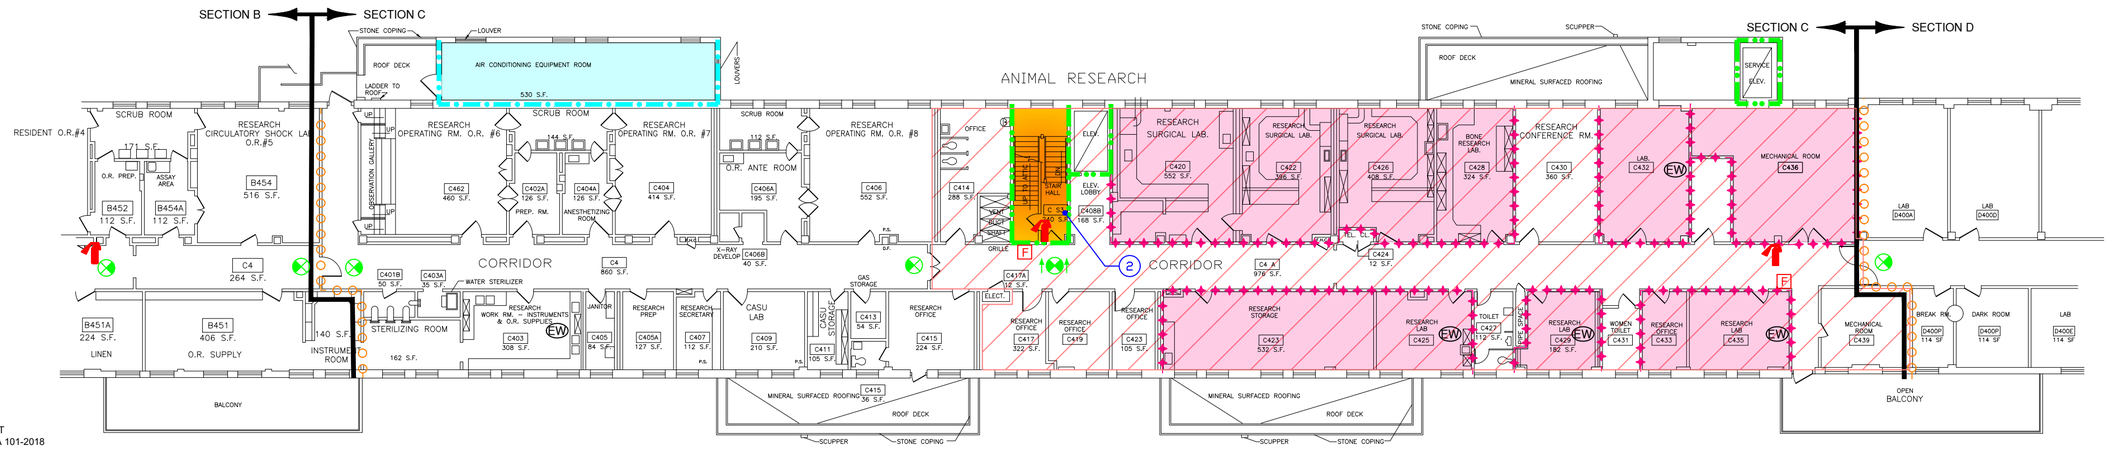

FOURTH FLOOR SECTION C

PARTIALLY SPRINKLERED

BUSINESS OCCUPANCY NOTES

1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES

1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES

BUILDING 200 - MAIN HOSPITAL

1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.

BUILDING 221 - REHABILITATION CENTER

1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

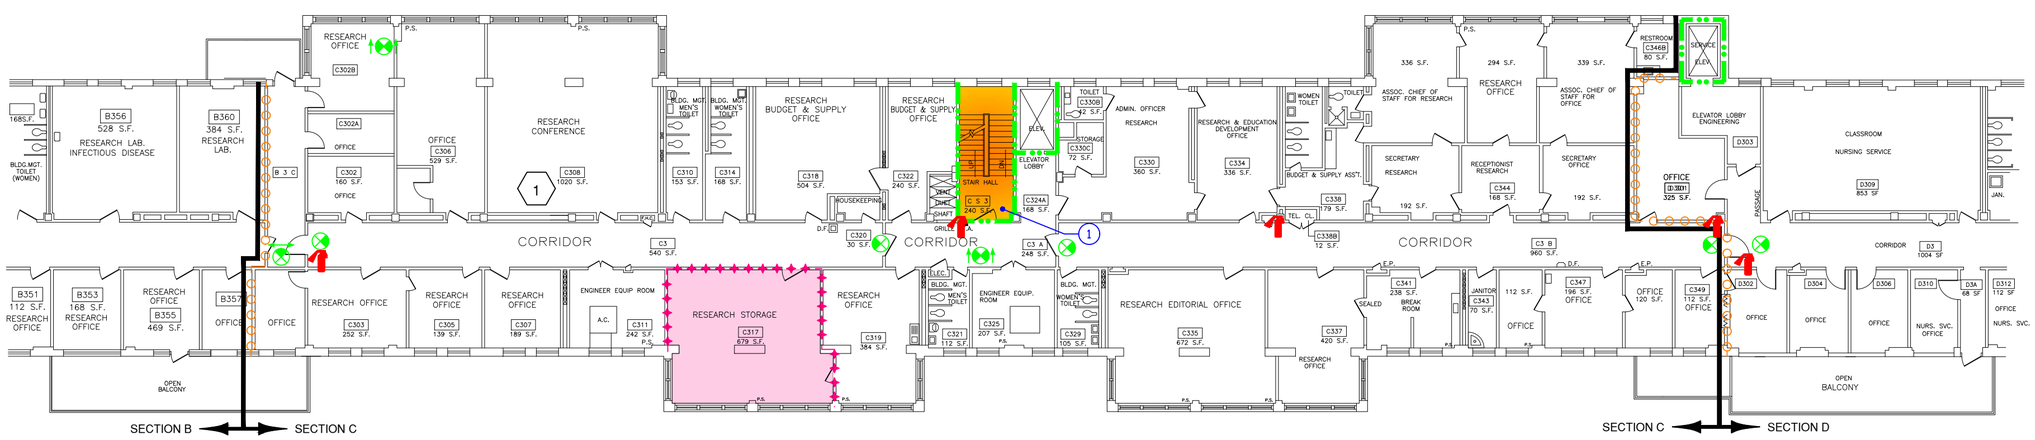

THIRD FLOOR SECTION C

NON SPRINKLERED

BUILDING 1 SECTION C

PARTIALLY SPRINKLERED

THIRD FLOOR BUSINESS OCCUPANCY

FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION C THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3C-4C

Dwg. 42 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	VACANT OFFICE SUITE	1,650 Sq. Ft.	NON PATIENT CARE	2
2	VACANT SUITE	4,403 Sq. Ft.	NON PATIENT CARE	3

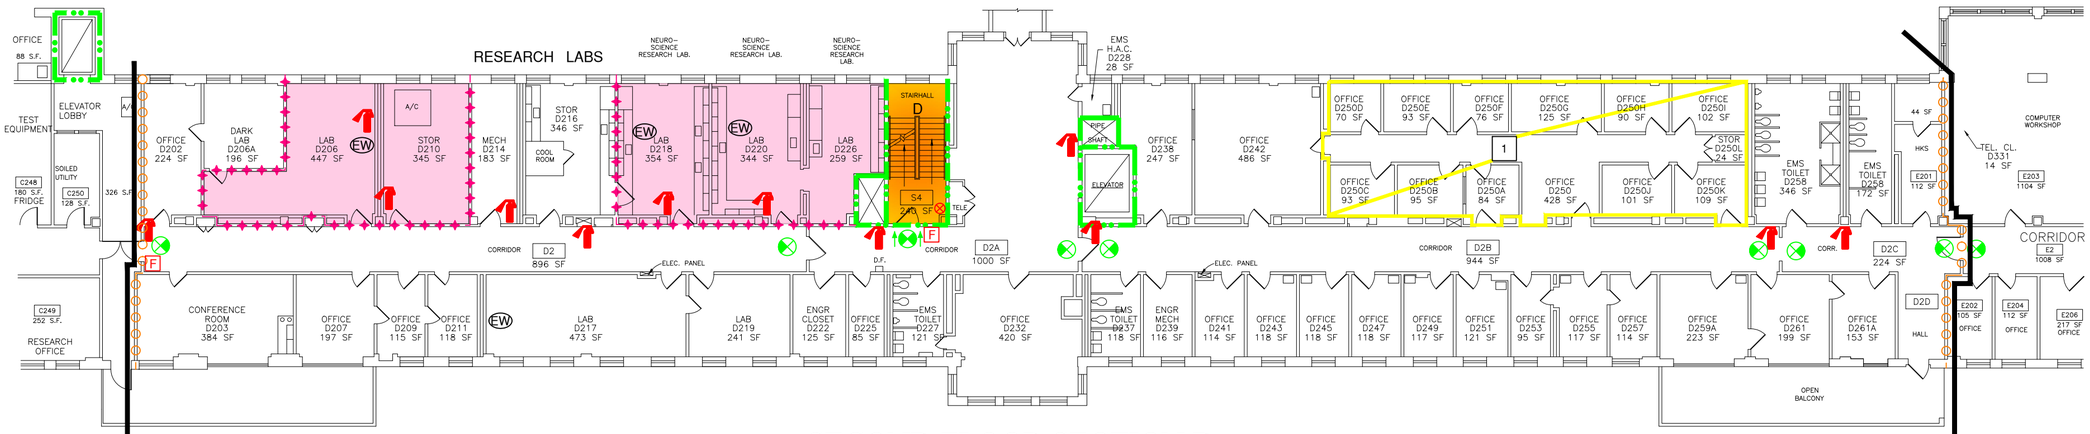

SECOND FLOOR SECTION D
(NON SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

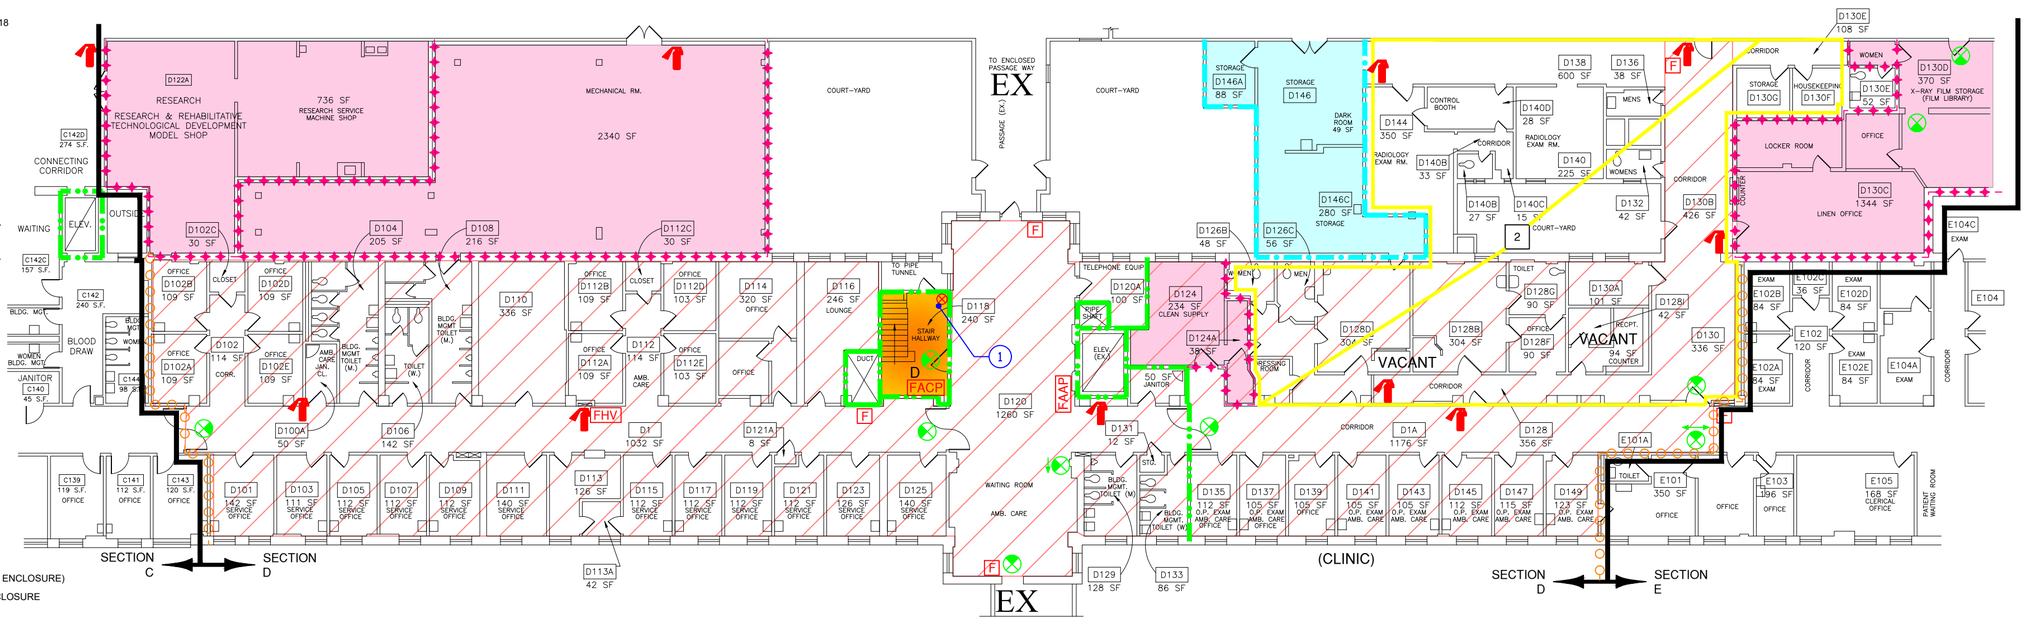

FIRST FLOOR SECTION D
(PARTIALLY SPRINKLERED)

BUILDING 1
SECTION D
PARTIALLY SPRINKLERED
FIRST FLOOR BUSINESS OCCUPANCY
SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION D FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1D-2D

Dwg. 43 of 64

KEY NOTES:

1 MAXIMUM 49 OCCUPANTS

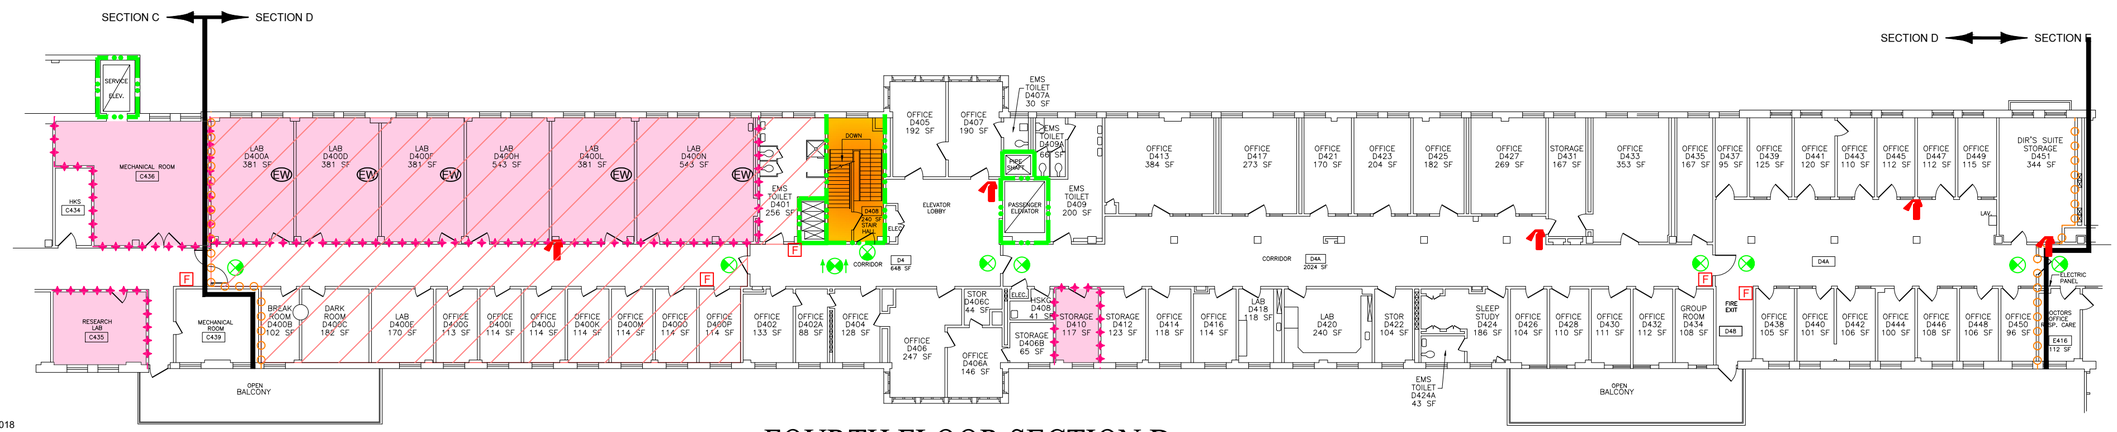

FOURTH FLOOR SECTION D

PARTIALLY SPRINKLERED

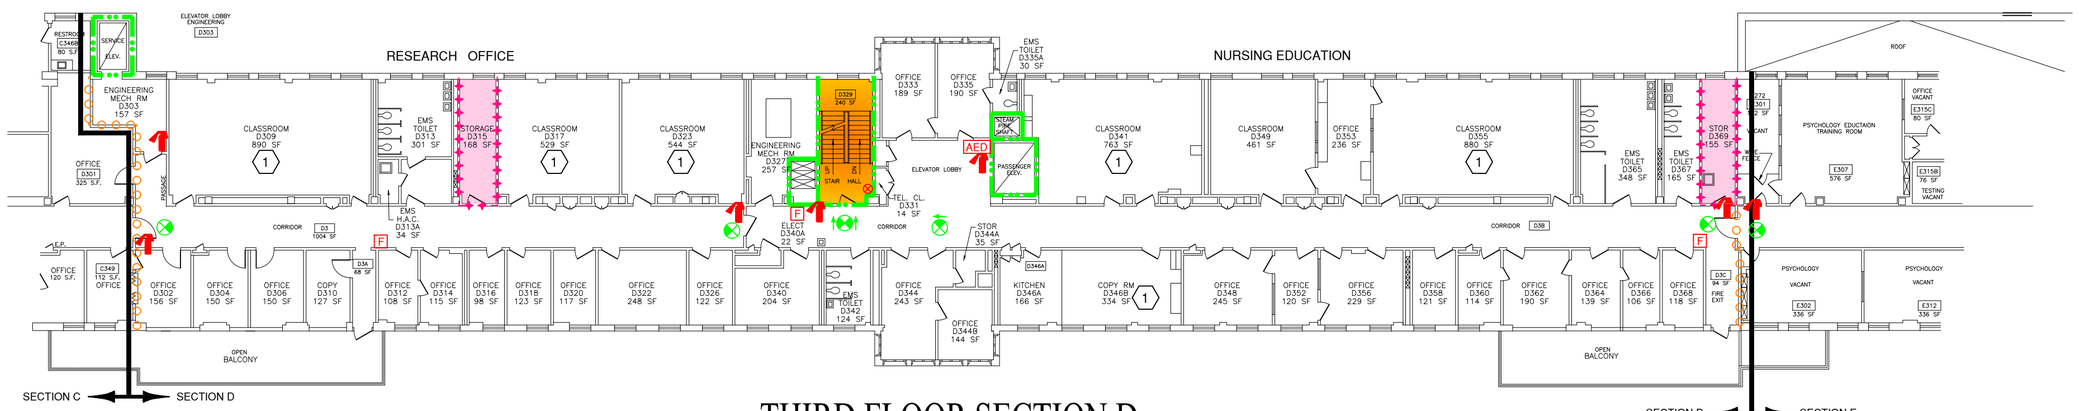

THIRD FLOOR SECTION D

NON SPRINKLERED

BUSINESS OCCUPANCY NOTES

1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES

1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES

BUILDING 200 - MAIN HOSPITAL

1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.

BUILDING 221 - REHABILITATION CENTER

1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 1
SECTION D

PARTIALLY SPRINKLERED

THIRD FLOOR BUSINESS OCCUPANCY
FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION D THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3D-4D

Dwg. 44 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	MEDICARE SERVICE SUITE	2,335 Sq. Ft.	NON PATIENT CARE	2
2	OCCUPATIONAL HEALTH SUITE	2,670 Sq. Ft.	NON PATIENT CARE	2

KEY NOTES:

1. MAXIMUM 49 OCCUPANTS.

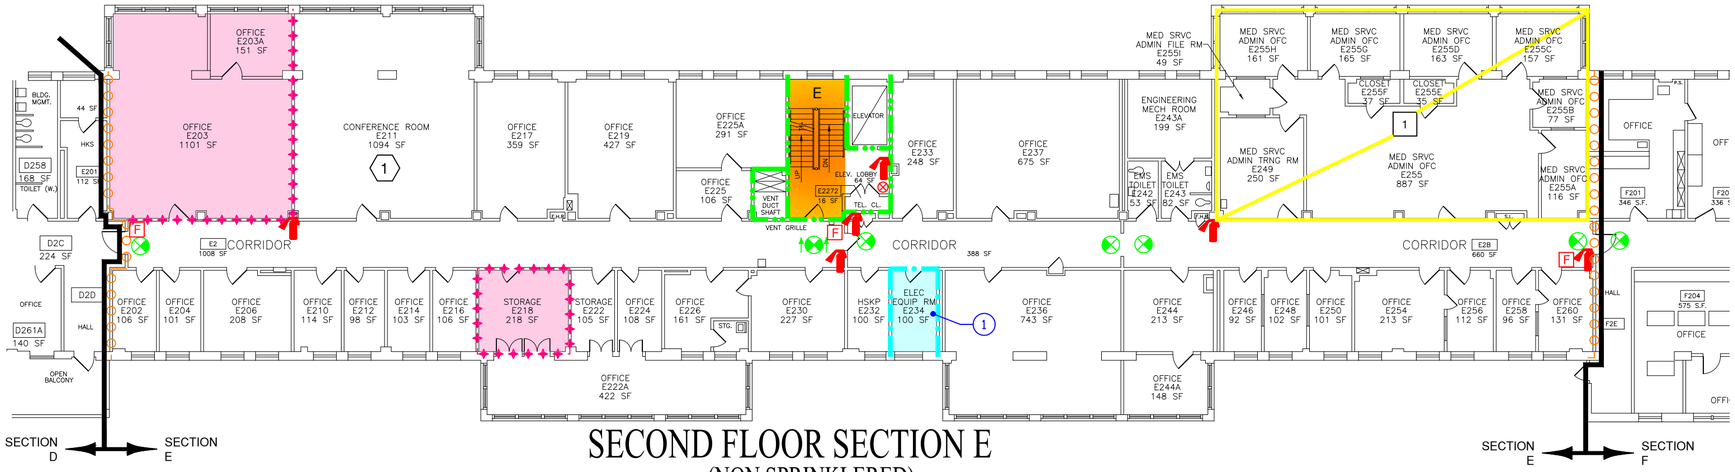

SECOND FLOOR SECTION E
(NON SPRINKLERED)

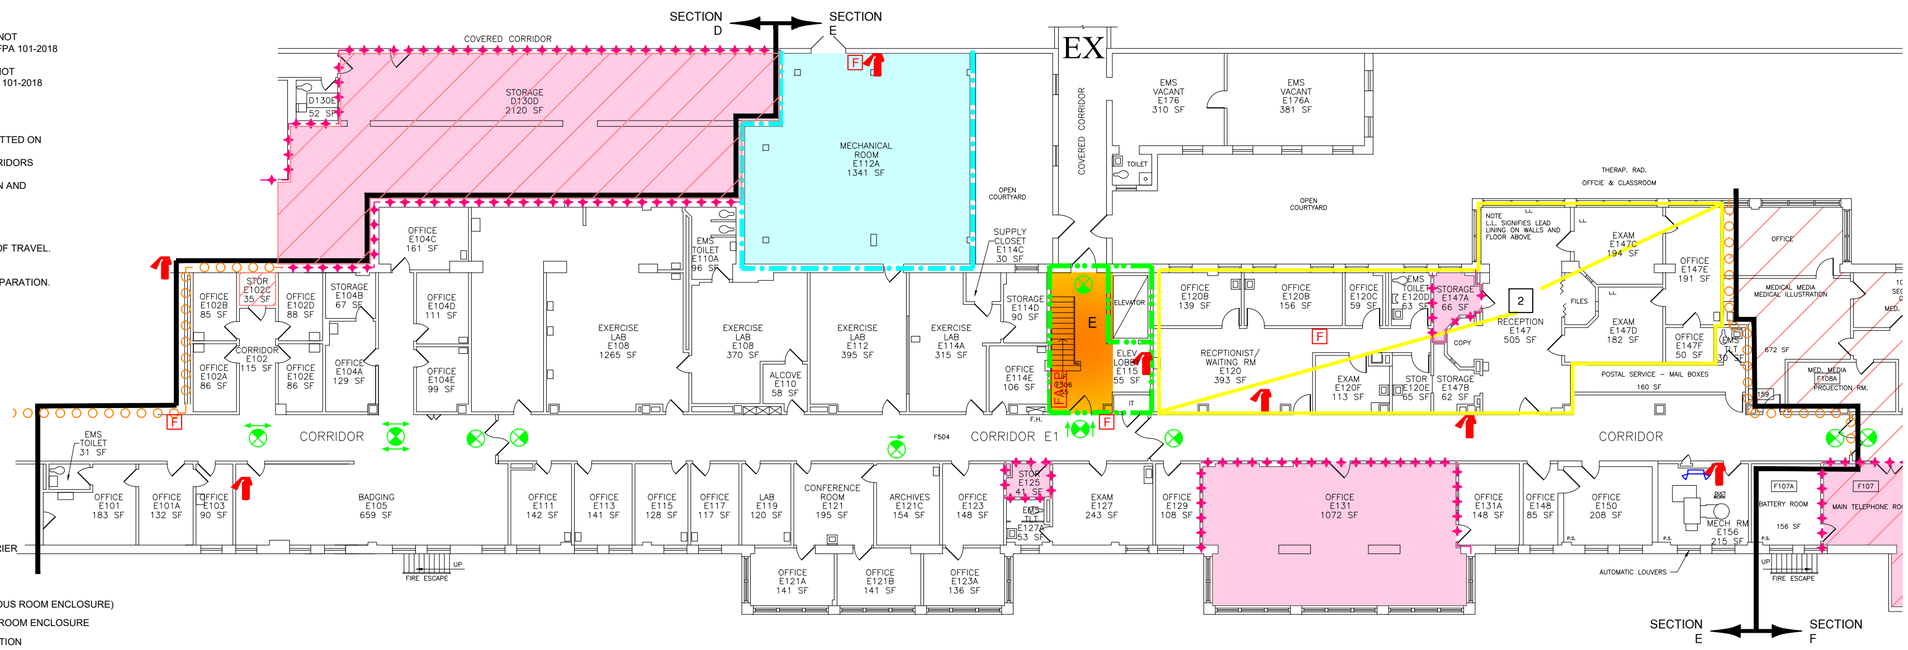

FIRST FLOOR SECTION E
(PARTIALLY SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

BUILDING 1
SECTION E
PARTIALLY SPRINKLERED
FIRST FLOOR BUSINESS OCCUPANCY
SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION E FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1E-2E

Dwg. 45 of 64

KEY NOTES:

1. MAXIMUM 49 OCCUPANTS
2. DOOR ALARM

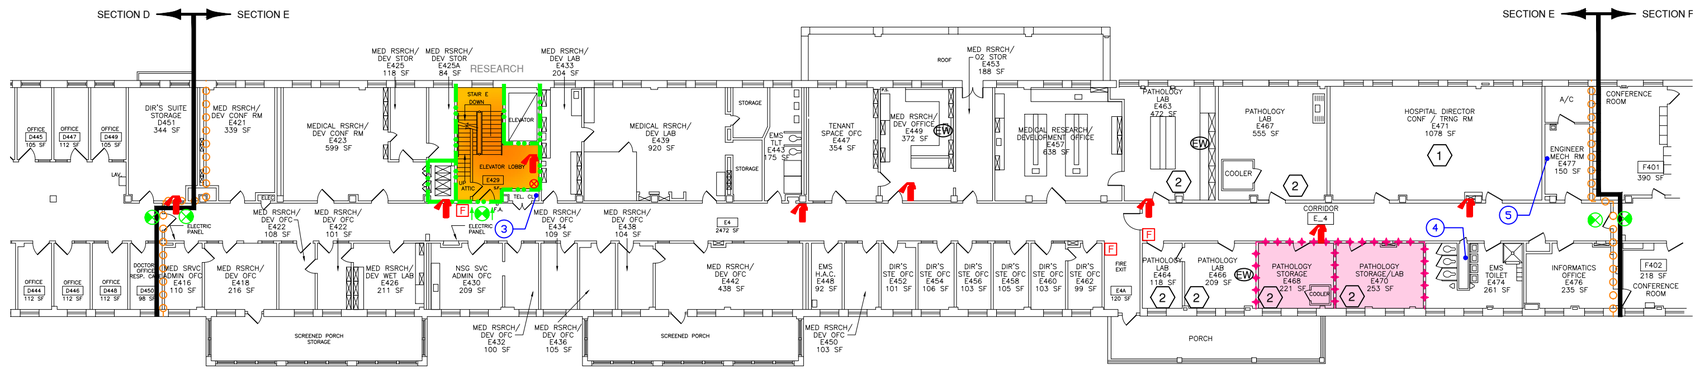

FOURTH FLOOR SECTION E
NON SPRINKLERED

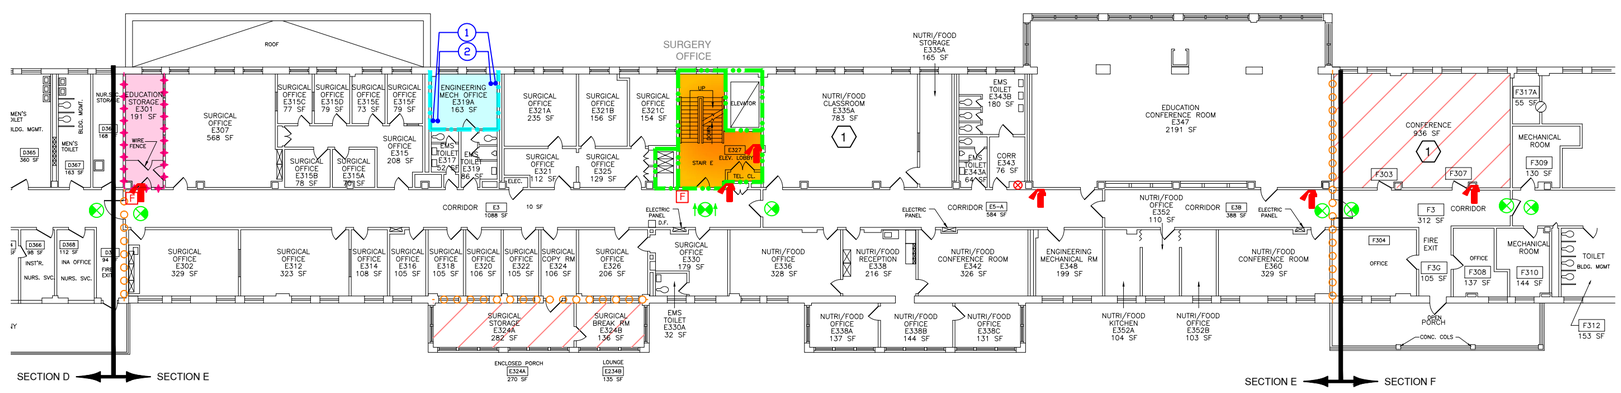

THIRD FLOOR SECTION E
PARTIALLY SPRINKLERED

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.

BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

BUILDING 1
SECTION E
PARTIALLY SPRINKLERED
THIRD FLOOR BUSINESS OCCUPANCY
FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION E THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3E-4E

Dwg. 46 of 64

KEY NOTES:

(1) MAXIMUM 49 OCCUPANTS.

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	TELE HEALTH SUITE	1,075 Sq. Ft.	NON PATIENT CARE	1
2	POLICE DISPATCH SUITE	3,810 Sq. Ft.	NON PATIENT CARE	2
3	POLICE SERVICE SUITE	1,430 Sq. Ft.	NON PATIENT CARE	3

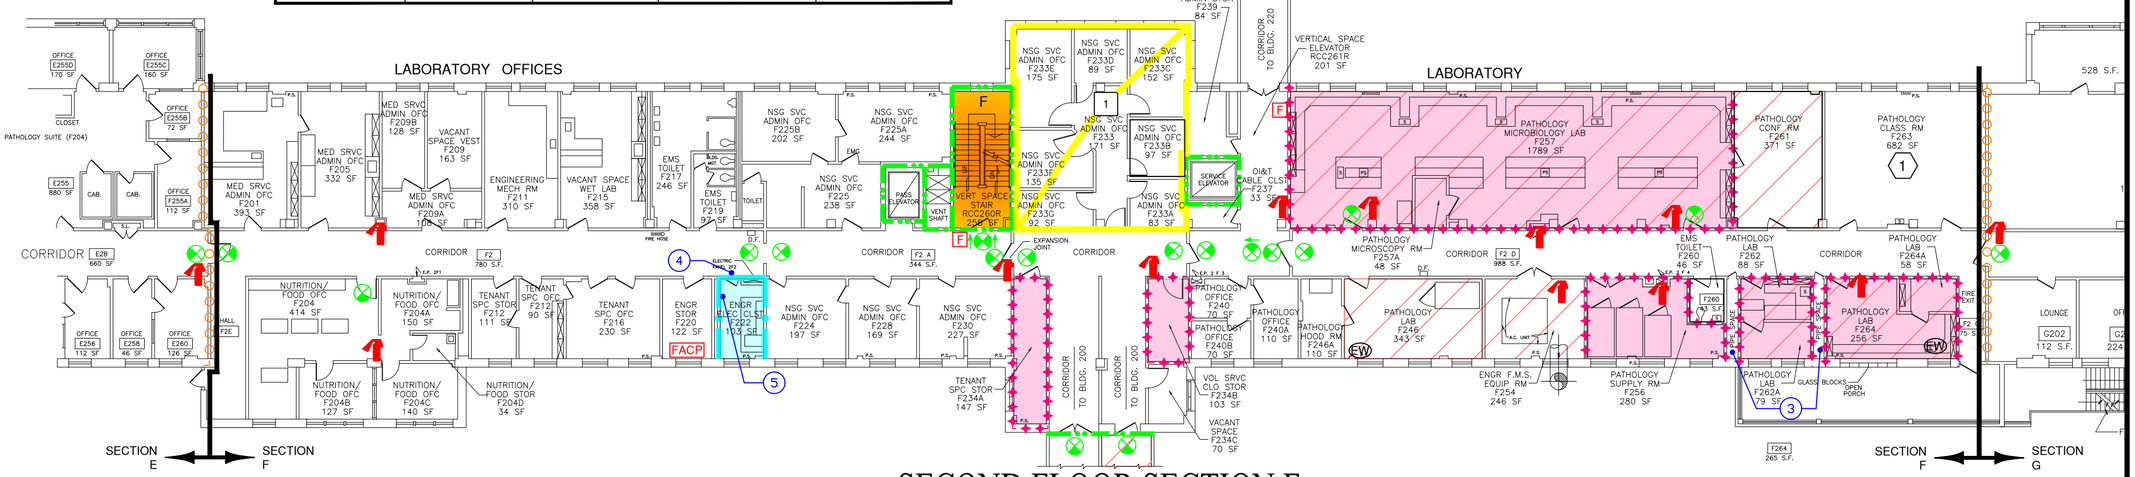

SECOND FLOOR SECTION F
(PARTIALLY SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

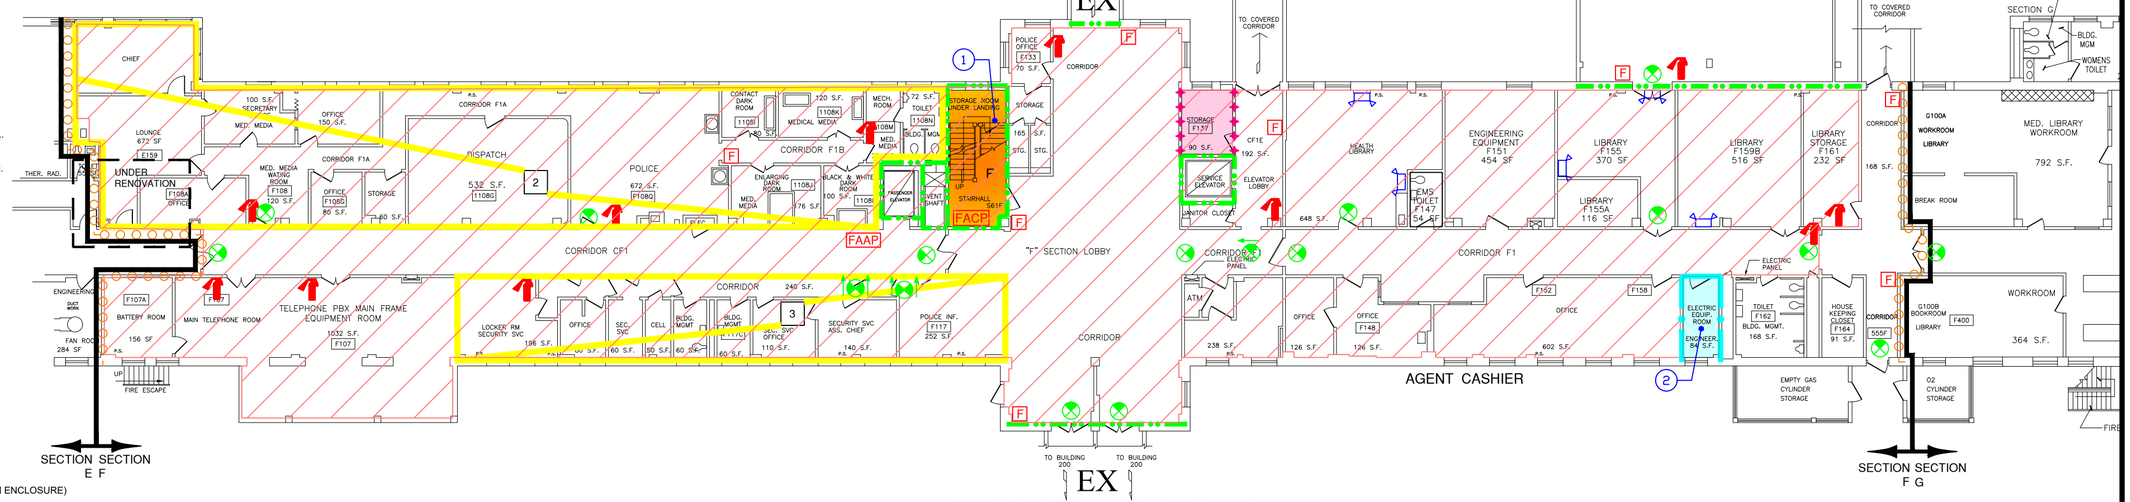

FIRST FLOOR SECTION F
(PARTIALLY SPRINKLERED)

BUILDING 1
SECTION F
PARTIALLY SPRINKLERED
FIRST FLOOR BUSINESS OCCUPANCY
SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION F FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1F-2F

Dwg. 47 of 64

KEY NOTES:

1. MAXIMUM 49 OCCUPANTS
2. DOOR ALARM

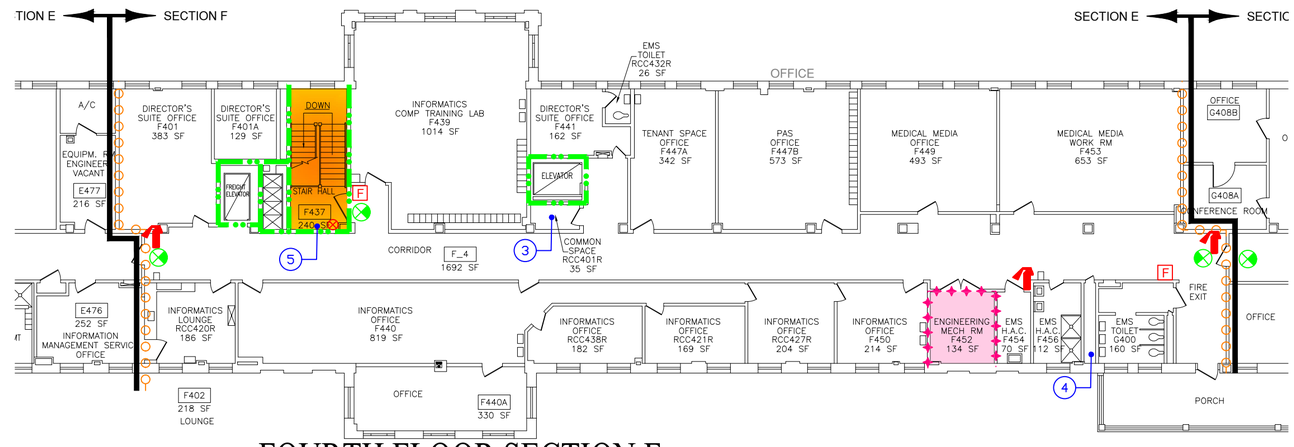

FOURTH FLOOR SECTION F
NON SPRINKLERED

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

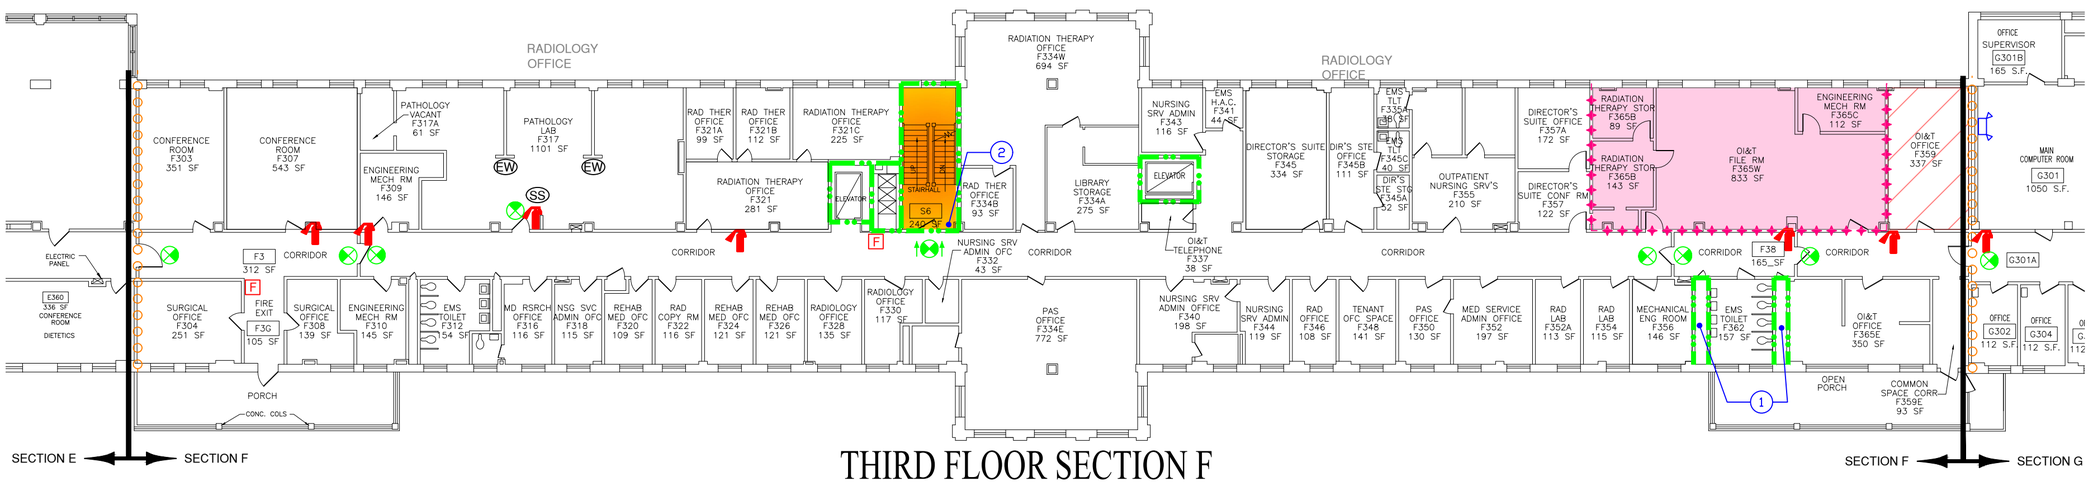

THIRD FLOOR SECTION F
NON SPRINKLERED

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

BUILDING 1
SECTION F
NON SPRINKLERED

THIRD FLOOR BUSINESS OCCUPANCY
FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION F THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3F-4F

Dwg. 48 of 64

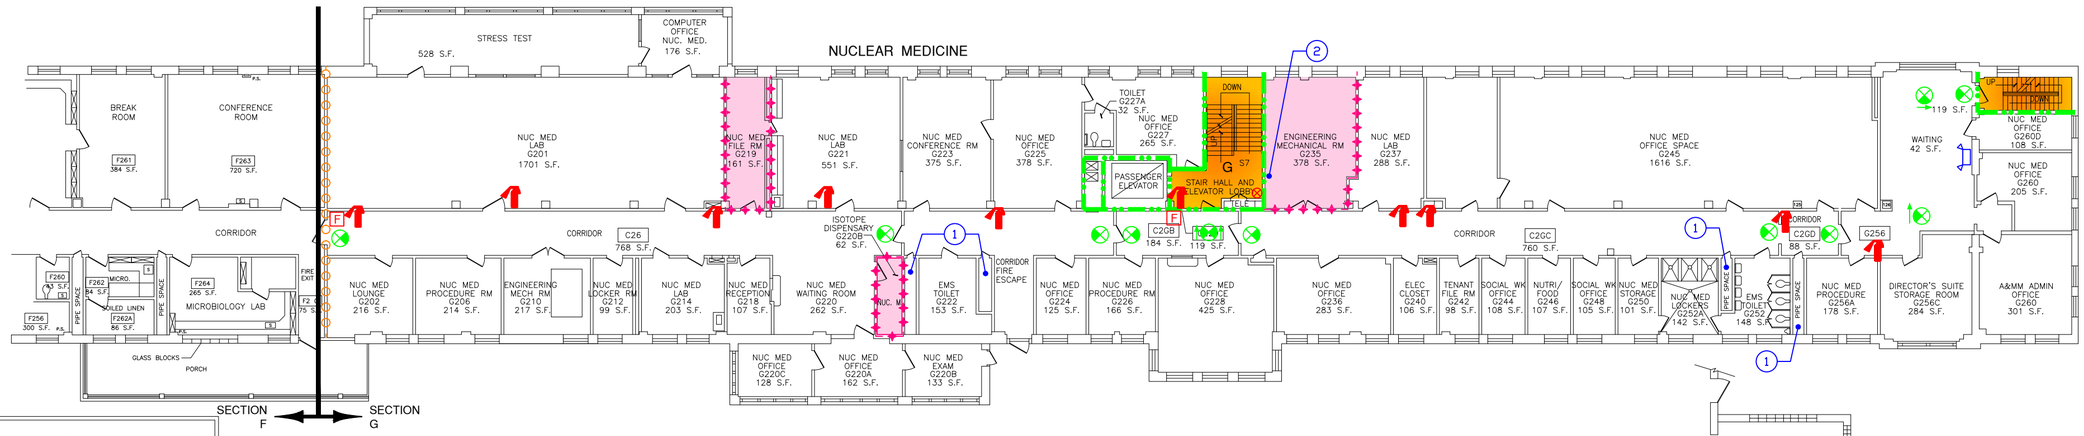

SECOND FLOOR SECTION G
(NON SPRINKLERED)

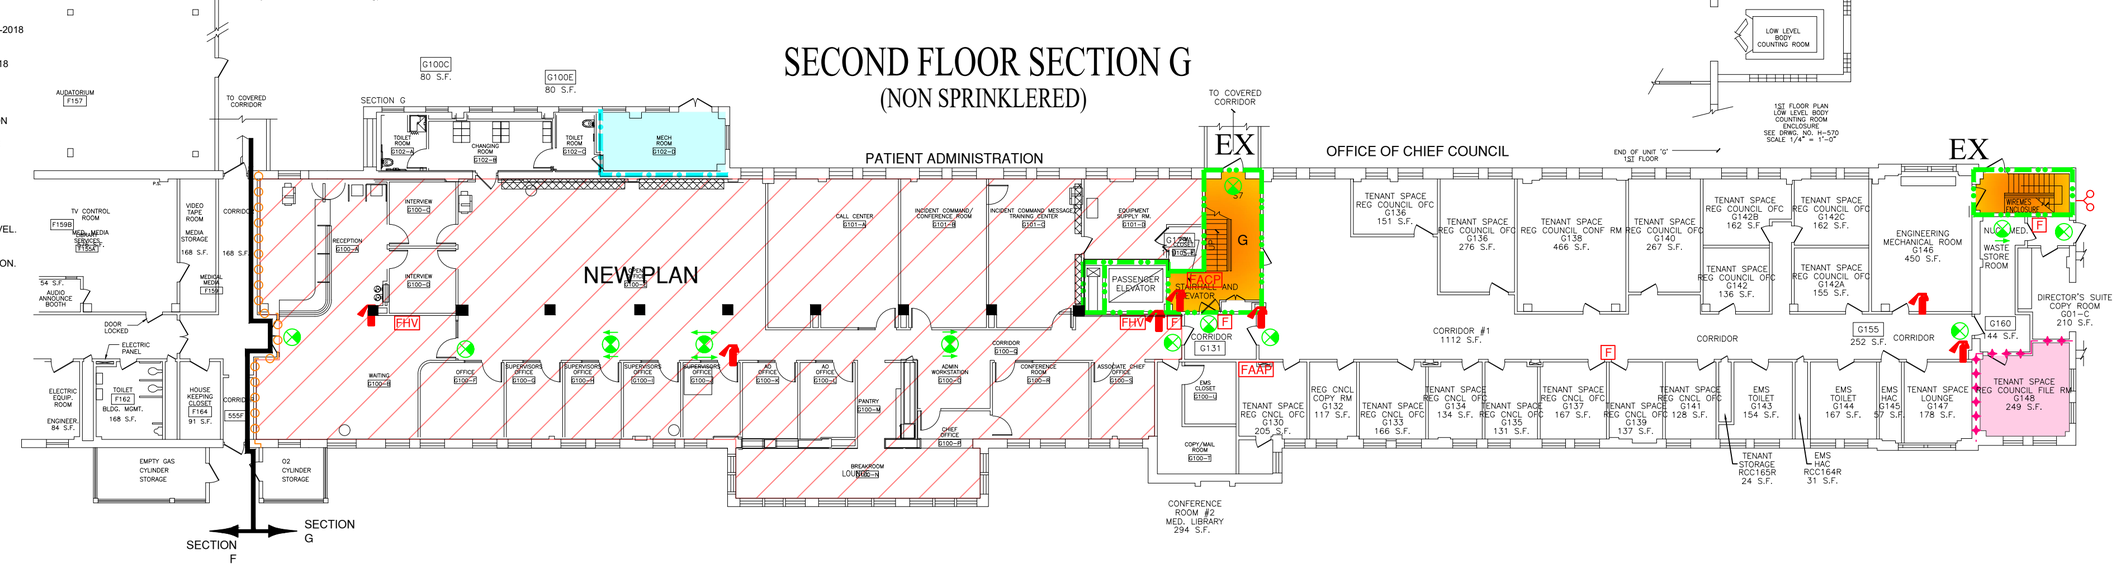

FIRST FLOOR SECTION G
(PARTIALLY SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

BUILDING 1
SECTION G
PARTIALLY SPRINKLERED
FIRST FLOOR BUSINESS OCCUPANCY
SECOND FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION G FIRST & SECOND FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-1G-2G

Dwg. 49 of 64

SUITE DESCRIPTIONS

SUITE NUMBER	SUITE NAME	SUITE SIZE	TYPE OF SUITE	EXIT NUMBER
1	DIRECTOR'S OFFICE	7,020 Sq. Ft.	NON PATIENT CARE	2
2	OFFICE SUITE	7,015 Sq. Ft.	NON PATIENT CARE	2

KEY NOTES:

1. MAXIMUM 49 OCCUPANTS

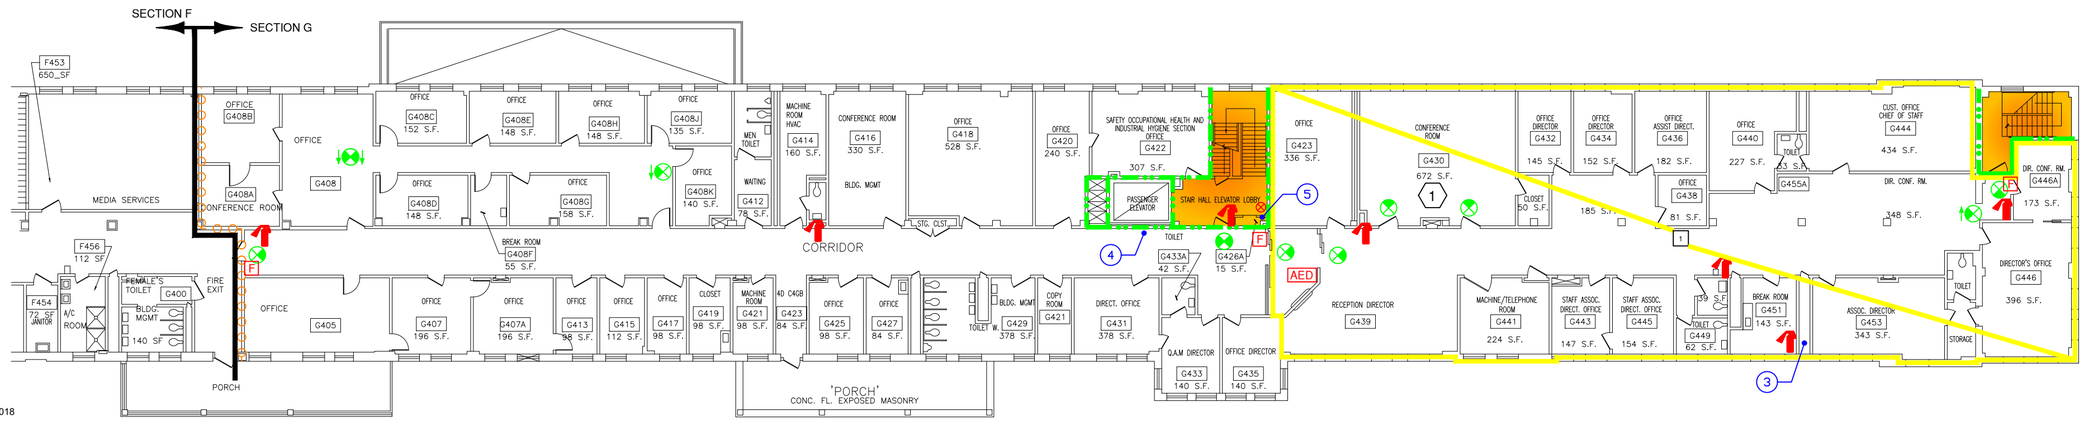

FOURTH FLOOR SECTION G
(NON SPRINKLERED)

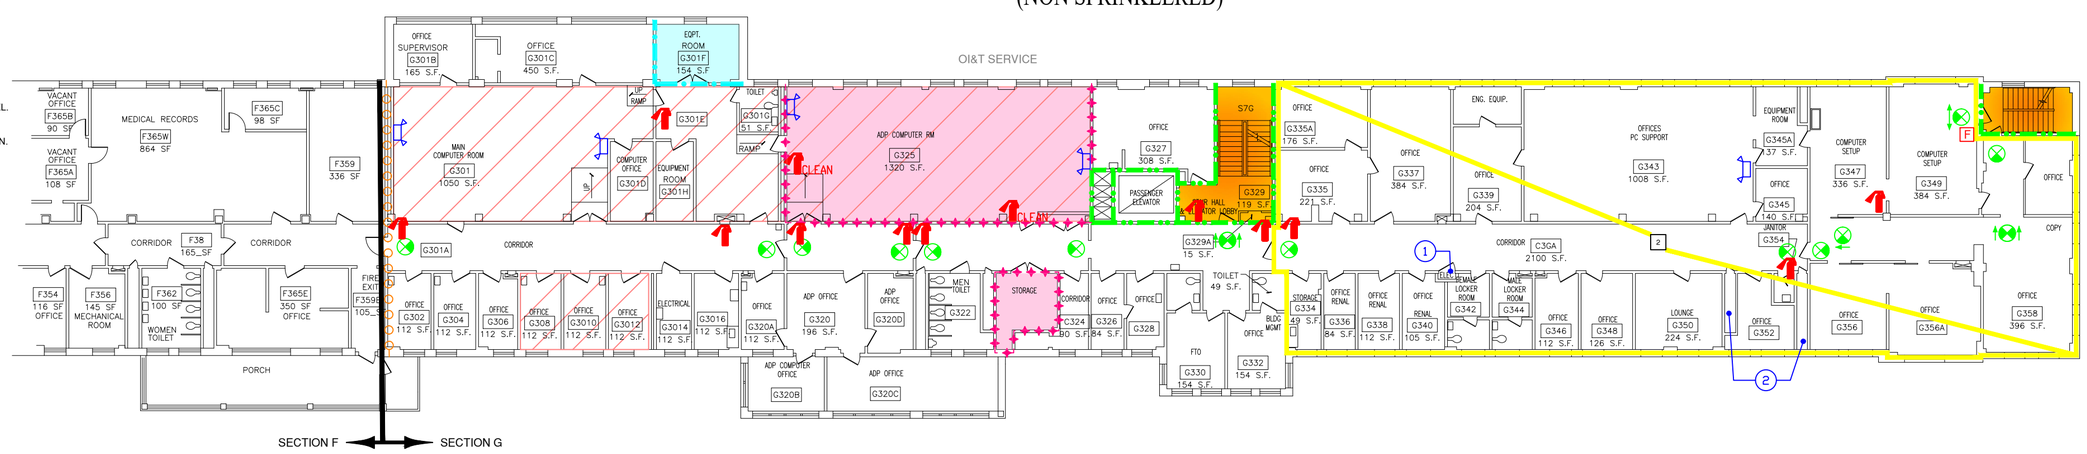

THIRD FLOOR SECTION G
(PARTIALLY SPRINKLERED)

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED
- SPRINKLERED AREA

BUILDING 1
SECTION G
PARTIALLY SPRINKLERED
THIRD FLOOR BUSINESS OCCUPANCY
FOURTH FLOOR BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 SECTION G THIRD & FOURTH FLOORS

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024 | Checked by: JLB | Drawn by: DJB

Project Number: 578-24-002

Building Number: 1

Drawing Number: 1SOC-3G-4G

Dwg. 50 of 64

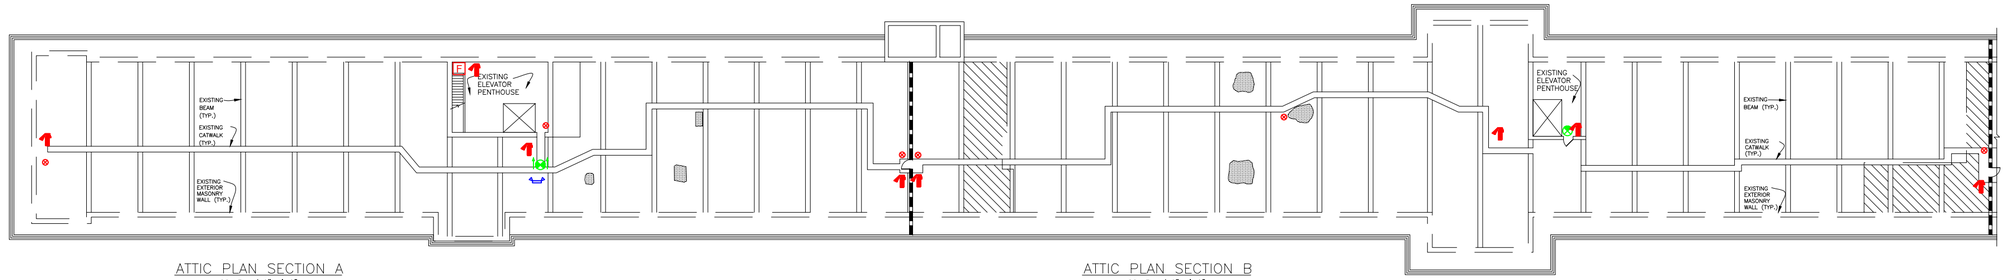

ATTIC PLAN SECTION A
SCALE: 1/16"=1'-0"

ATTIC PLAN SECTION B
SCALE: 1/16"=1'-0"

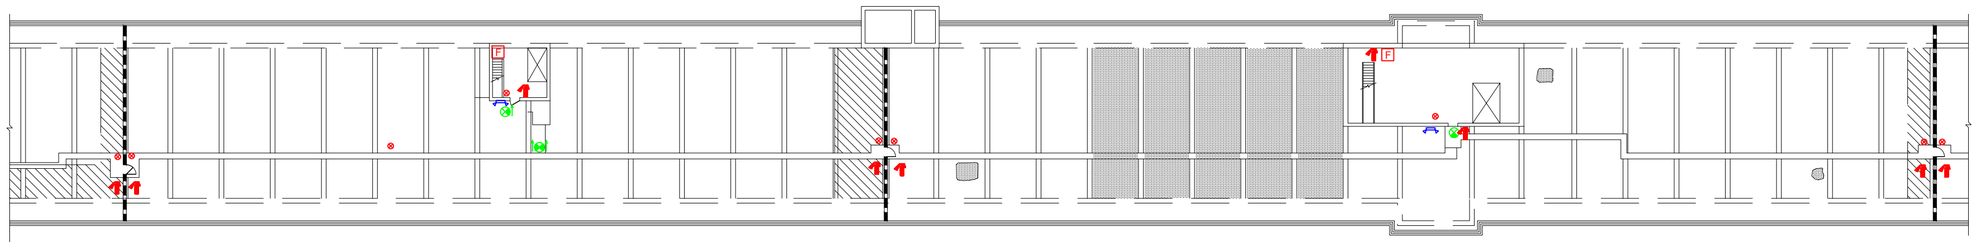

ATTIC PLAN SECTION C
SCALE: 1/16"=1'-0"

ATTIC PLAN SECTION D
SCALE: 1/16"=1'-0"

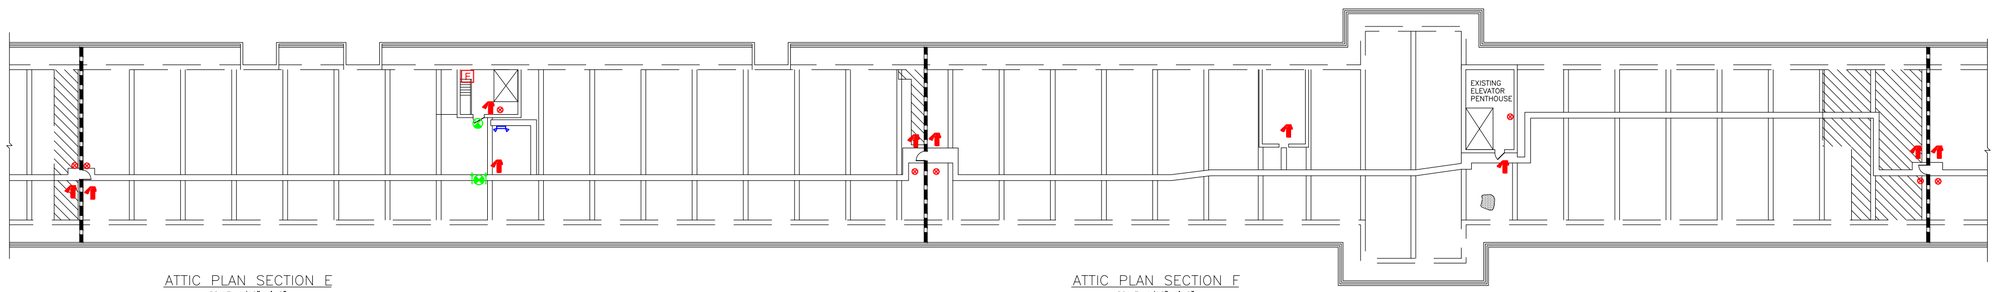

ATTIC PLAN SECTION E
SCALE: 1/16"=1'-0"

ATTIC PLAN SECTION F
SCALE: 1/16"=1'-0"

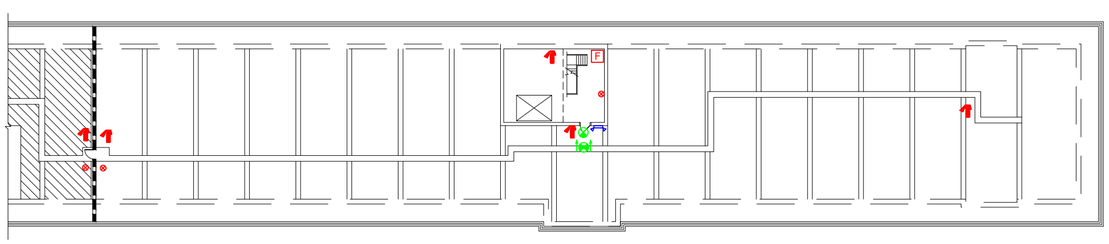

ATTIC PLAN SECTION G
SCALE: 1/16"=1'-0"

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

EP	EXIT PASSAGEWAY
LC	LINEN CHUTE
TC	TRASH CHUTE
EX	EXIT
HE	HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 1 ATTIC FLOOR
NON SPRINKLERED
INDUSTRIAL OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 1 ATTIC

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024
Checked by: JLB
Drawn by: DJB

Project Number: 578-24-002
Building Number: 1
Drawing Number: 1SOC-ATTIC
Dwg. 51 of 64

KEY NOTES:

1. 60 MINUTE FIRE RATED GLASS DOOR AND DOORFRAME.

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.

BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

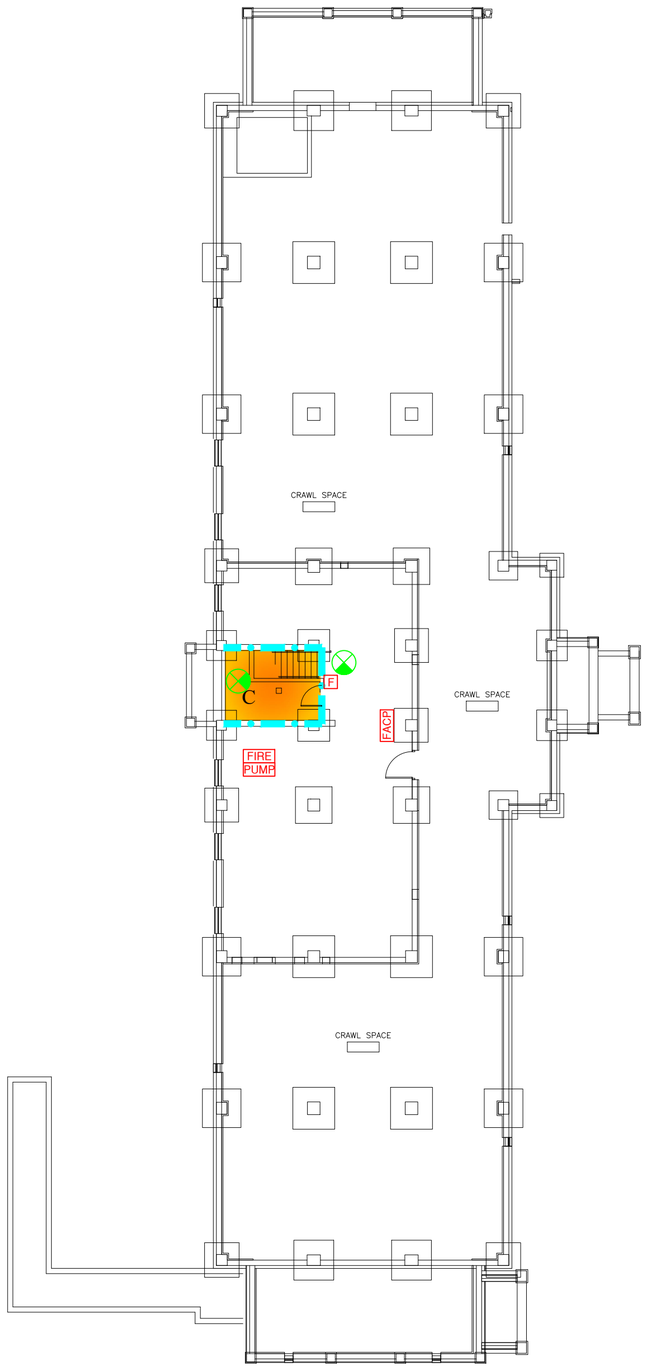

BUILDING 12 BASEMENT

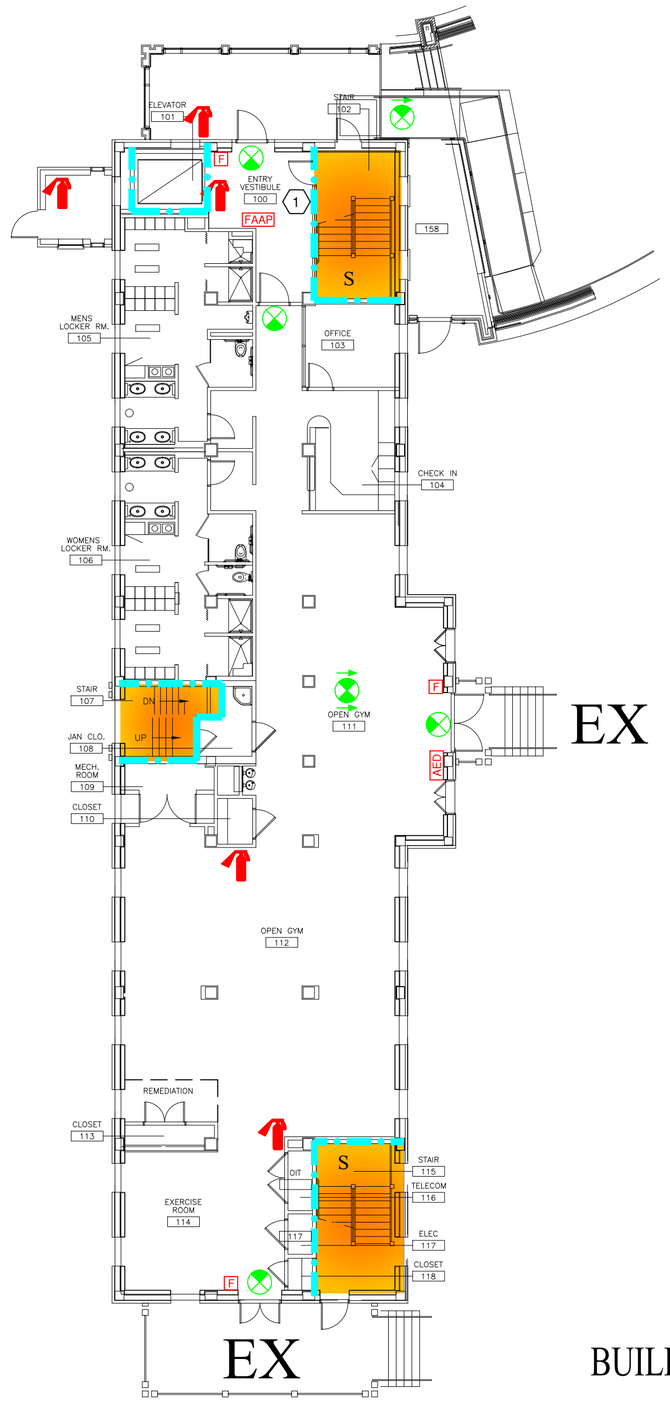

BUILDING 12 FIRST FLOOR

BUILDING 12 BASEMENT & FIRST FLOOR

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 12 BASEMENT & FIRST FLOOR

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 12

Drawing Number: 12SOC-B-1

Dwg. 52 of 64

KEY NOTES:

1 60 MINUTE FIRE RATED GLASS DOOR AND DOORFRAME.

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

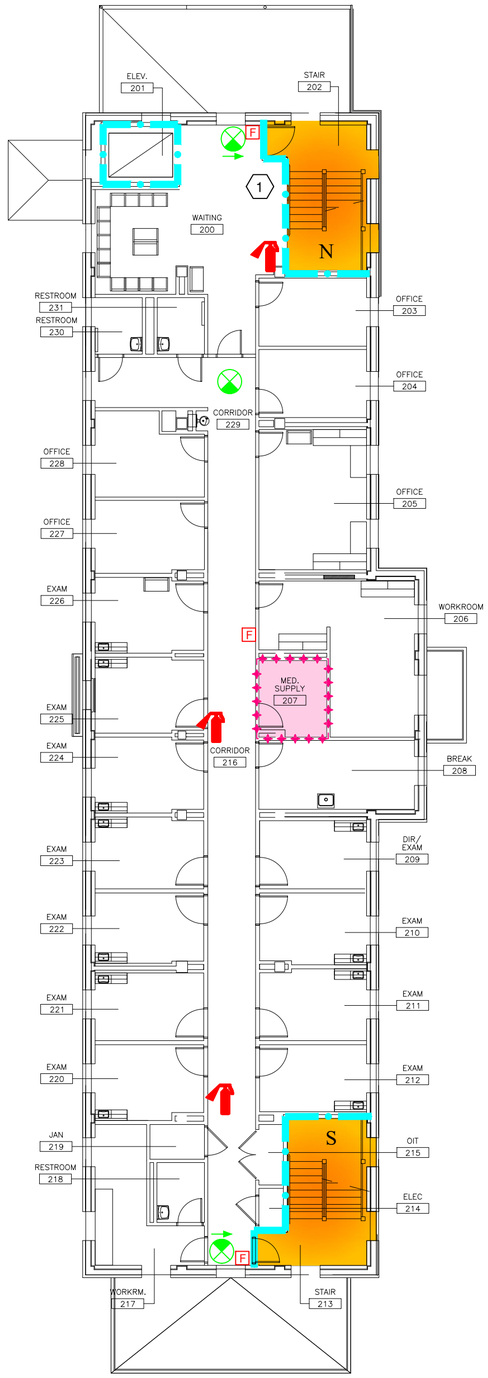

BUILDING 12 SECOND FLOOR

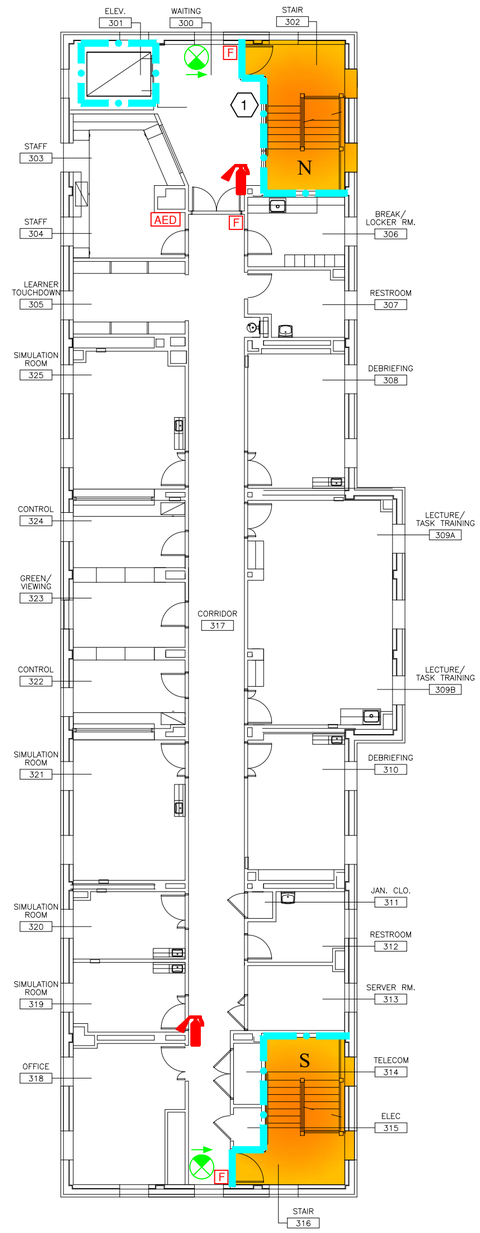

BUILDING 12 THIRD FLOOR

BUILDING 12 SECOND & THIRD FLOORS

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 12 SECOND & THIRD FLOOR

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 12

Drawing Number: 12SOC-2-3

Dwg. 53 of 64

DRAWING KEY NOTES:

1 NON-SPRINKLERED EQUIPMENT ROOM PER SECTION 8.15.11.2 OF NFPA 13-2016 EDITION.

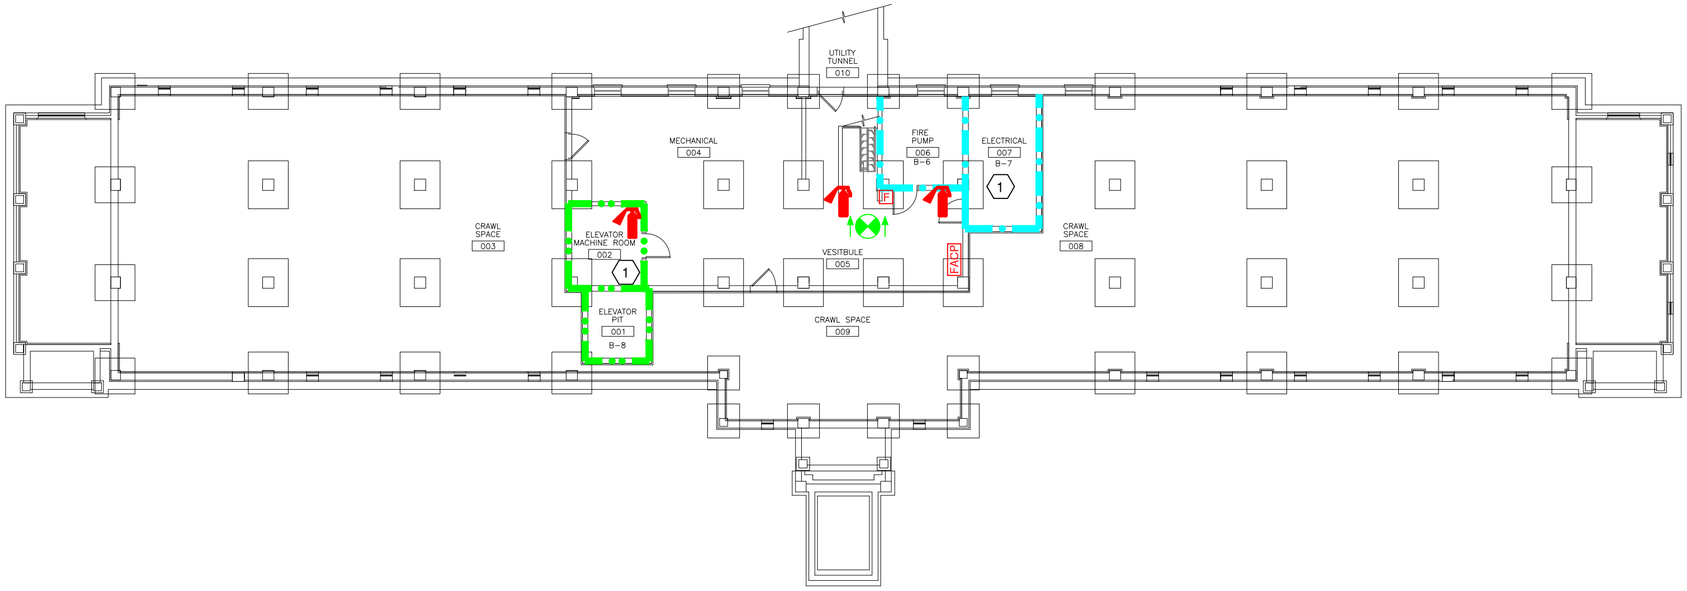

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

EP EXIT PASSAGEWAY
LC LINEN CHUTE
TC TRASH CHUTE
EX EXIT
HE HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 13 BASEMENT

N

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 13 BASEMENT

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 13

Drawing Number: 13SOC-B

Dwg. 54 of 64

DRAWING KEY NOTES:

1. THREE STORY COMMUNICATING SPACE PER SECTION 8.6.6 OF NFPA 101–2015 EDITION.

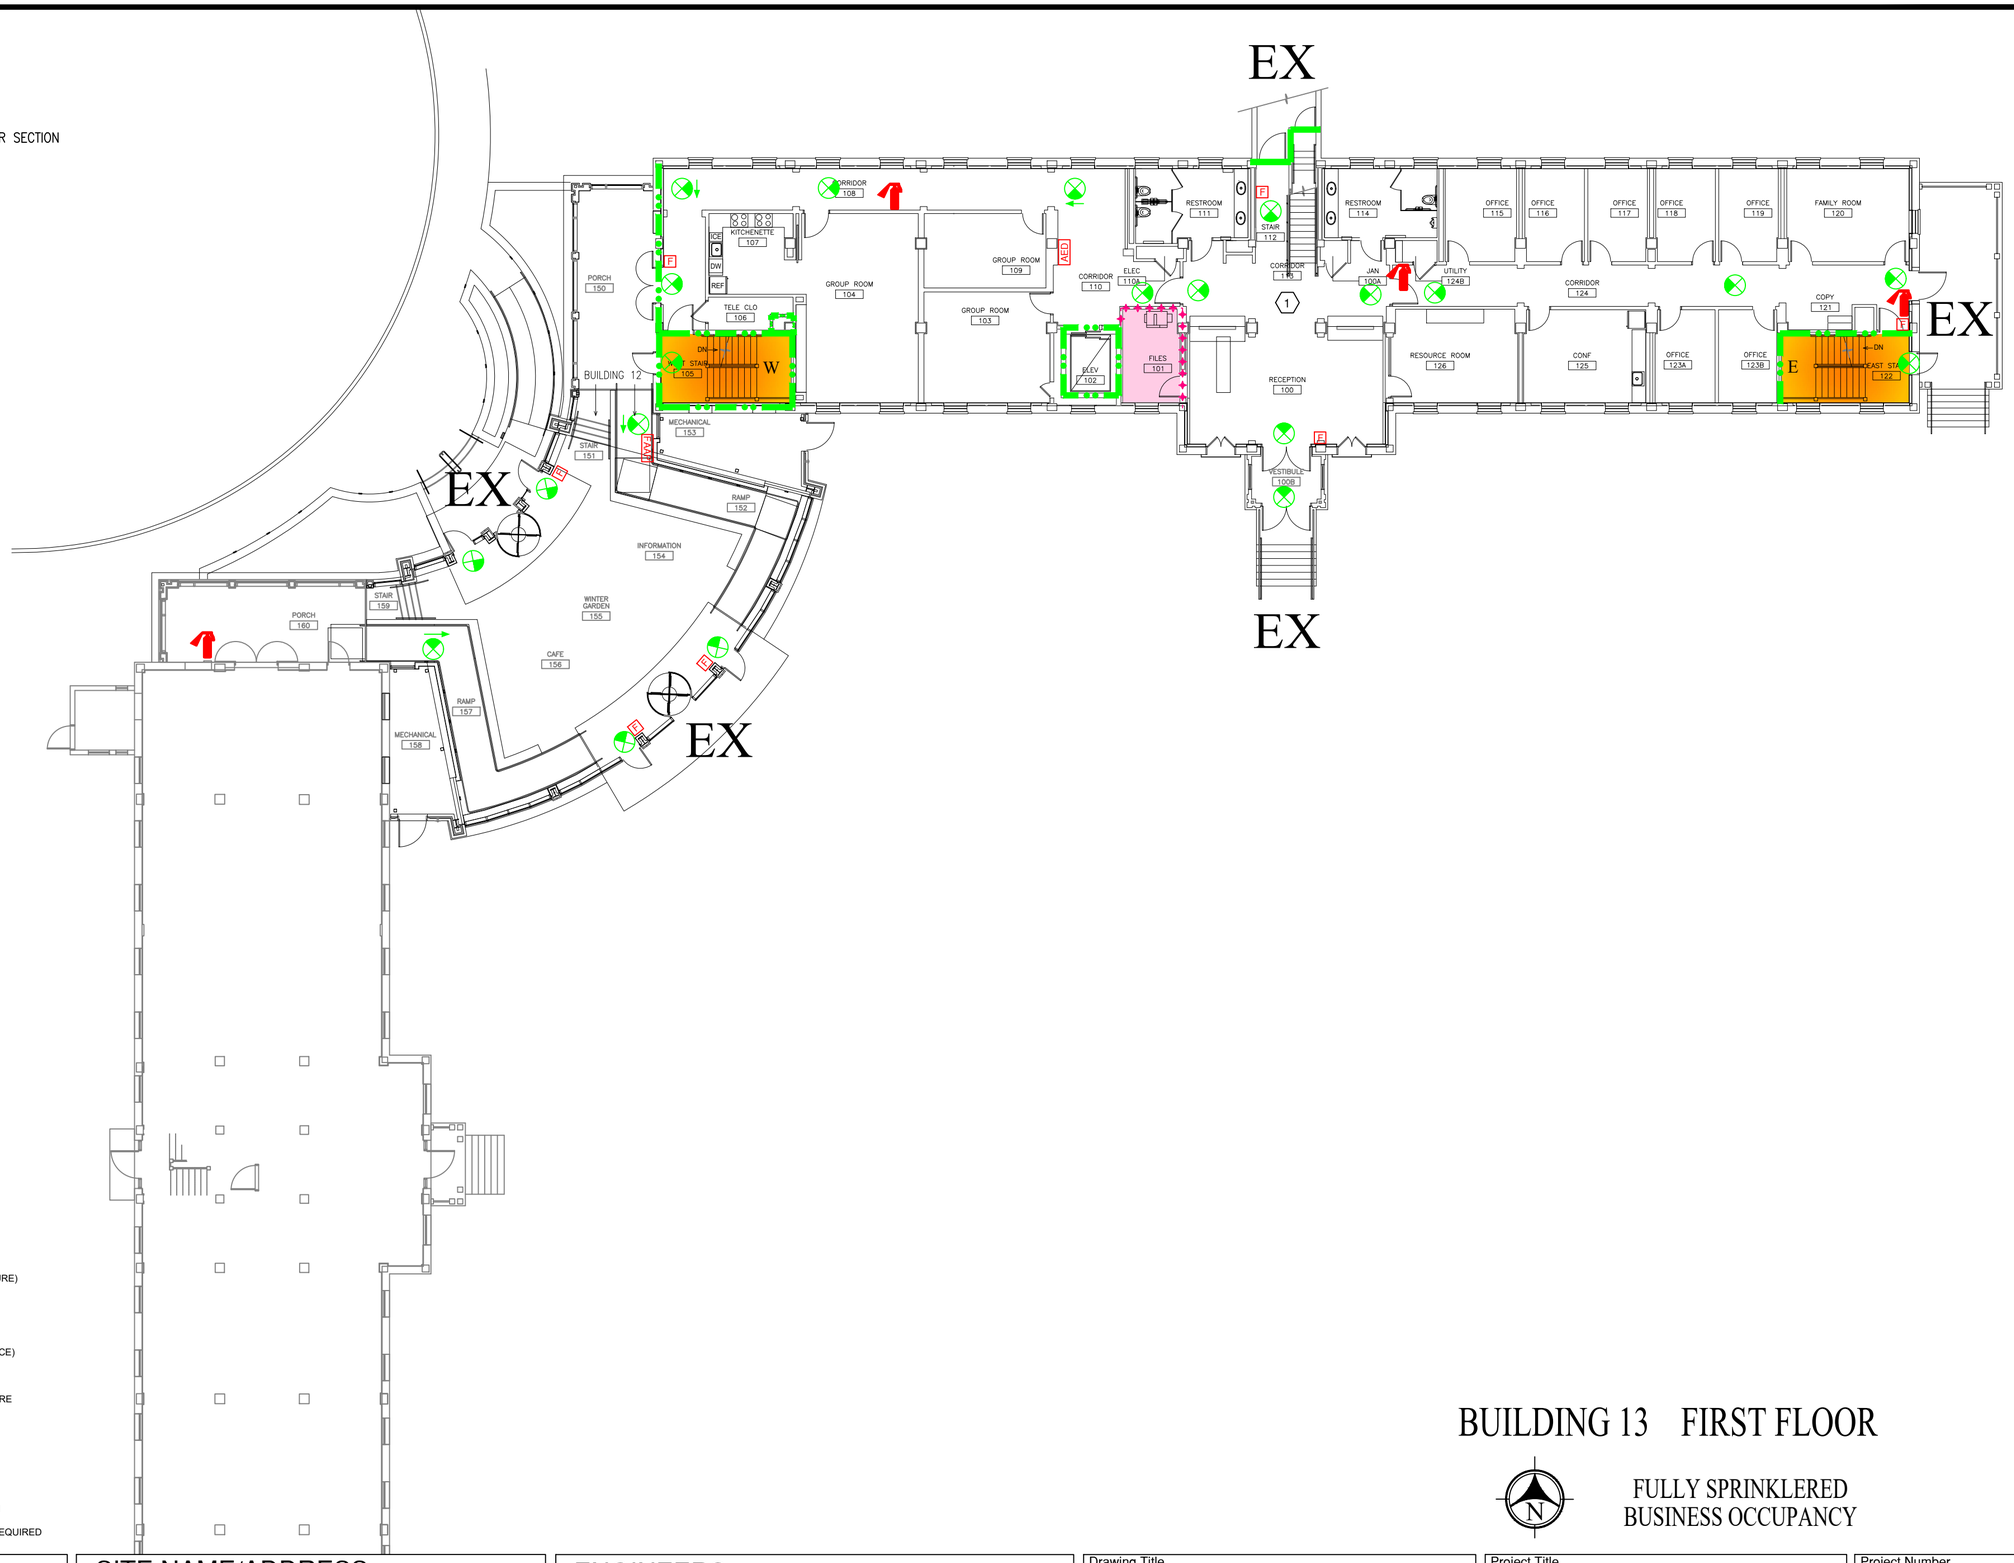

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.

BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 13 FIRST FLOOR

N

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 13 FIRST FLOOR

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 13

Drawing Number: 13SOC-1

Dwg. 55 of 64

KEY NOTES:

1. THREE STORY COMMUNICATING SPACE PER SECTION 8.6.6 OF NFPA 101-2015 EDITION.

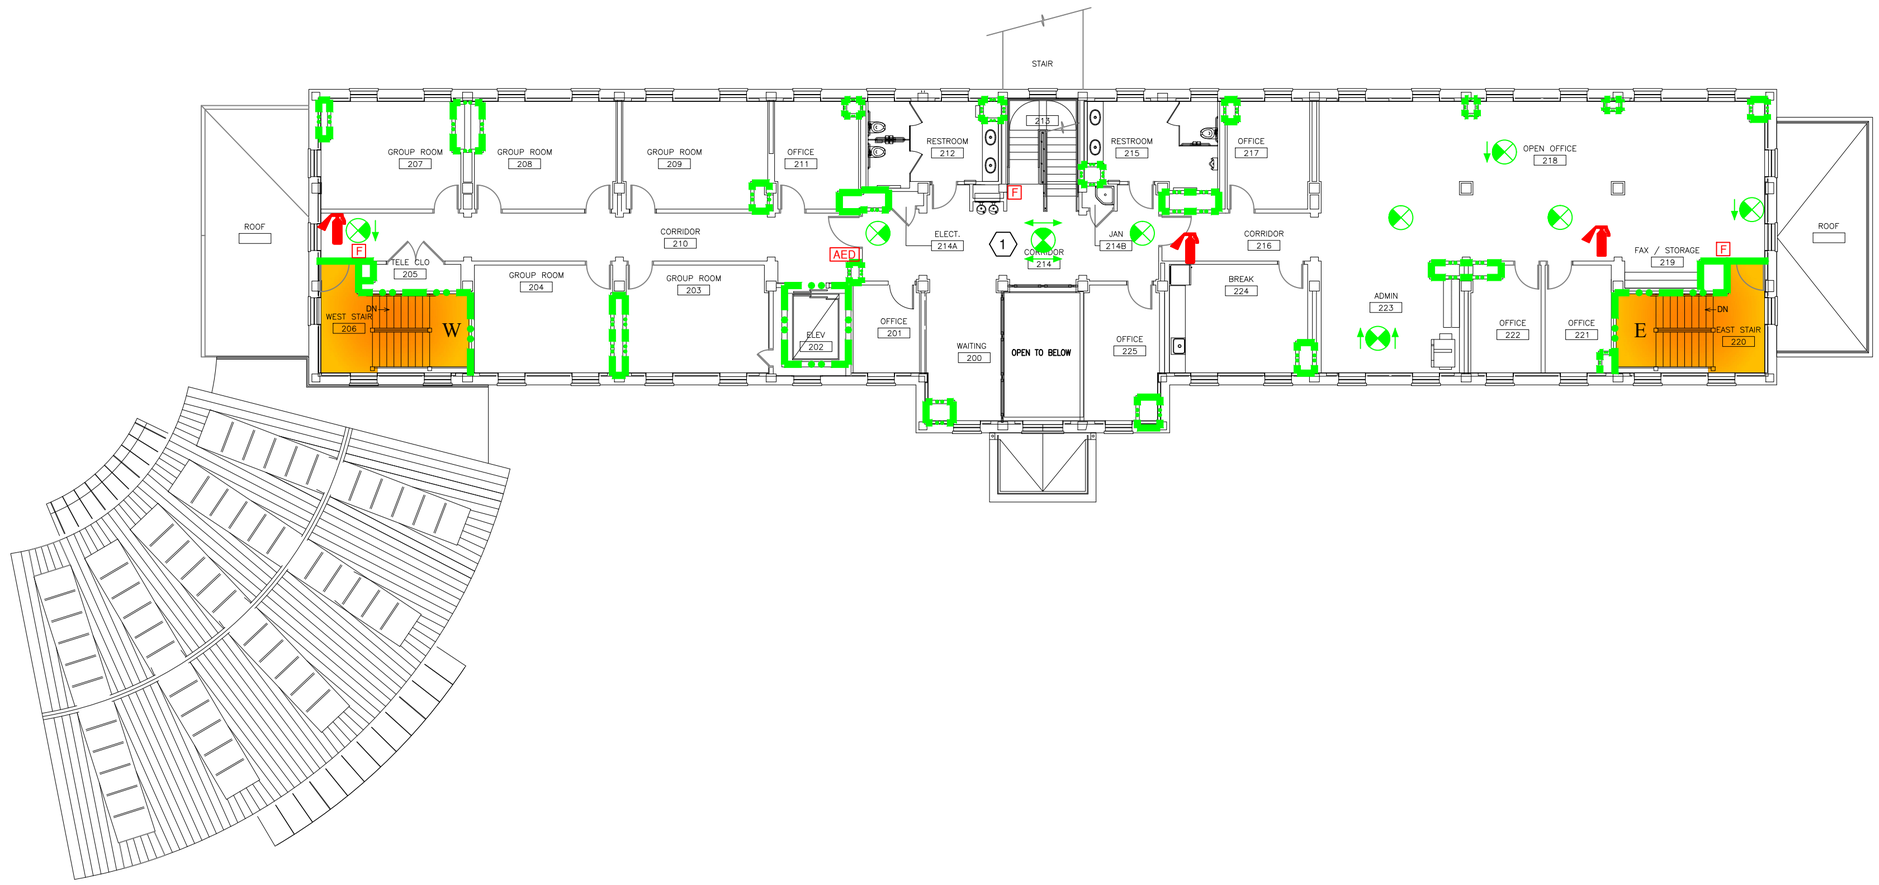

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

BUILDING 13 SECOND FLOOR

N

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 13 SECOND FLOOR

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 13

Drawing Number: 13SOC-2

Dwg. 56 of 64

DRAWING KEY NOTES:

(1) THREE STORY COMMUNICATING SPACE PER SECTION 8.6.6 OF NFPA 101–2015 EDITION.

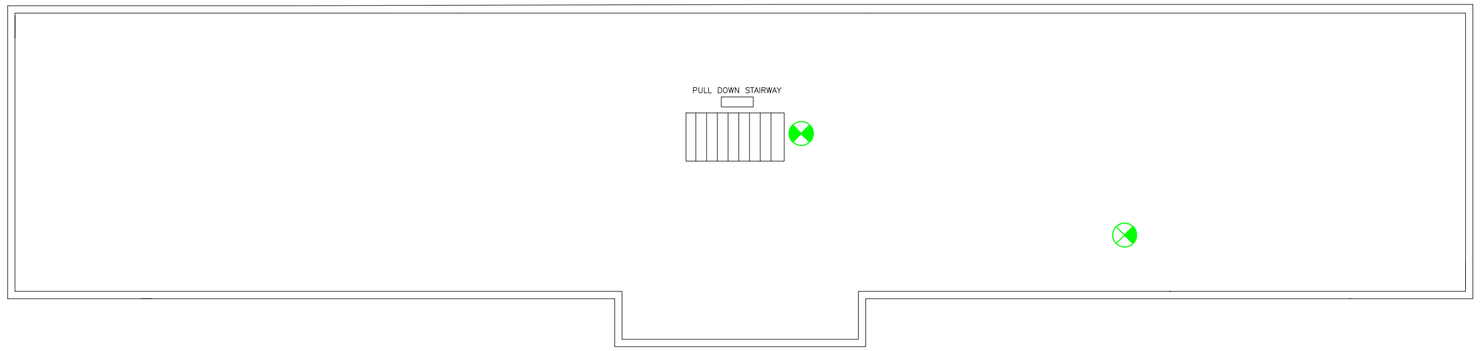

BUILDING 13 ATTIC

N

FULLY SPRINKLERED
INDUSTRIAL OCCUPANCY

BUSINESS OCCUPANCY NOTES
1. NOTIFICATION DEVICES PROVIDED BUT NOT REQUIRED BY PER SECTION 38.3.4 OF NFPA 101-2018 EDITION
2. EMERGENCY LIGHTING PROVIDED BUT NOT REQUIRED PER SECTION 38.2.9 OF NFPA 101-2018 EDITION

APPROVED EQUIVALENCIES
1. OVERSIZED PROTECTIVE PLATES PERMITTED ON FIRE RATED DOORS.
2. BUSINESS OCCUPANCY DEAD END CORRIDORS PERMITTED TO EXCEED 50' FEET.
3. INTERNAL SPRINKLER PIPING CONDITION AND OBSTRUCTION INVESTIGATION.

APPROVED SITE EQUIVALENCIES
BUILDING 200 - MAIN HOSPITAL
1. LINEAR ACCELERATOR COMMON PATH OF TRAVEL.
2. STAIR NO. 1 EXIT PASSAGEWAY.
BUILDING 221 - REHABILITATION CENTER
1. MODULAR BUILDING CONSTRUCTION SEPARATION.

SYMBOLS LIST

- EP — EXIT PASSAGEWAY
- LC — LINEN CHUTE
- TC — TRASH CHUTE
- EX — EXIT
- HE — HORIZONTAL EXIT PASSAGEWAY

PARTITION LEGEND

- 2 HOUR FIRE/SMOKE ZONE BARRIER
- 2 HOUR FIRE BARRIER
- SMOKE ZONE BARRIER
- 1 HOUR FIRE BARRIER (HAZARDOUS ROOM ENCLOSURE)
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- NON-RATED SMOKE ZONE PARTITION
- HEALTH CARE OCCUPANCY CORRIDORS
- NON-RATED SMOKE BARRIER (COMMUNICATING SPACE)
- SPRINKLER AND FIRE ALARM ZONE BOUNDARY
- 1 HOUR FIRE BARRIER HAZARDOUS ROOM ENCLOSURE
- SMOKE RESISTIVE HAZARDOUS ROOM ENCLOSURE
- EXIT STAIRWELL/PASSAGEWAY
- SUITE DESIGNATION
- AREA OPEN TO CORRIDOR WITH SMOKE DETECTION
- AREA OPEN TO CORRIDOR NO SMOKE DETECTION REQUIRED

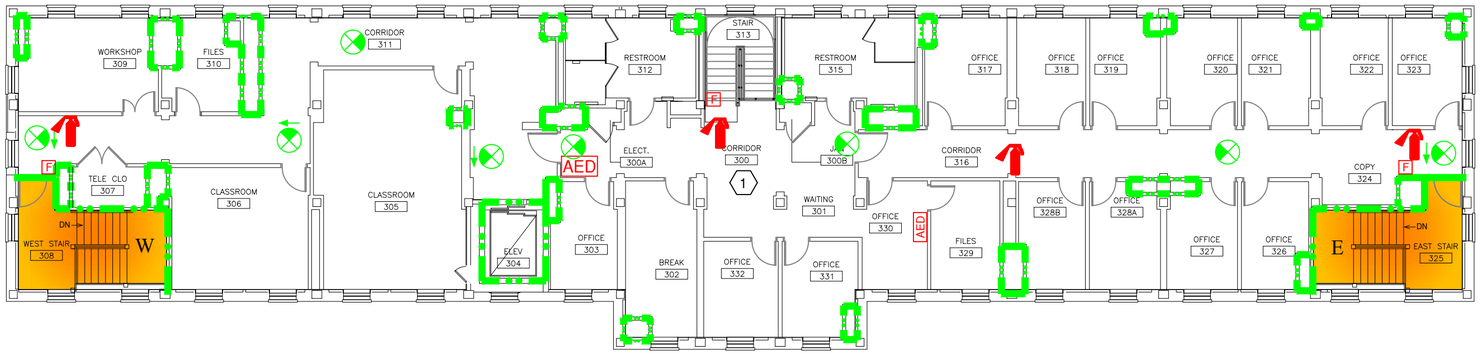

BUILDING 13 THIRD FLOOR

N

FULLY SPRINKLERED
BUSINESS OCCUPANCY

FP&C Project Number	23400	
FINAL SOC		6/19/2024
DRAFT SOC		4/08/2024
REVISIONS:	NUMBER	DATE

SITE NAME/ADDRESS

Edward Hines, Jr.
VA Hospital
5000 5th Ave
Hines, IL 60141

ENGINEERS

FP&C CONSULTANTS

FP&C CONSULTANTS, KC, LLC.
1330 BURLINGTON STREET, SUITE 200
NORTH KANSAS CITY, MO 64116
(816) 931-3377

Drawing Title: BUILDING 13 THIRD FLOOR & ATTIC

Approved: Project Director

Project Title: EDWARD HINES, JR. VA STATEMENT OF CONDITIONS DOCUMENTATION

Location

Issue Date: 06/19/2024

Checked by: JLB

Drawn by: DJB

Project Number: 578-24-002

Building Number: 13

Drawing Number: 13SOC-3-A

Dwg. 57 of 64