



C:\P\WORKING\1707\1707\17AN-A214.DWG

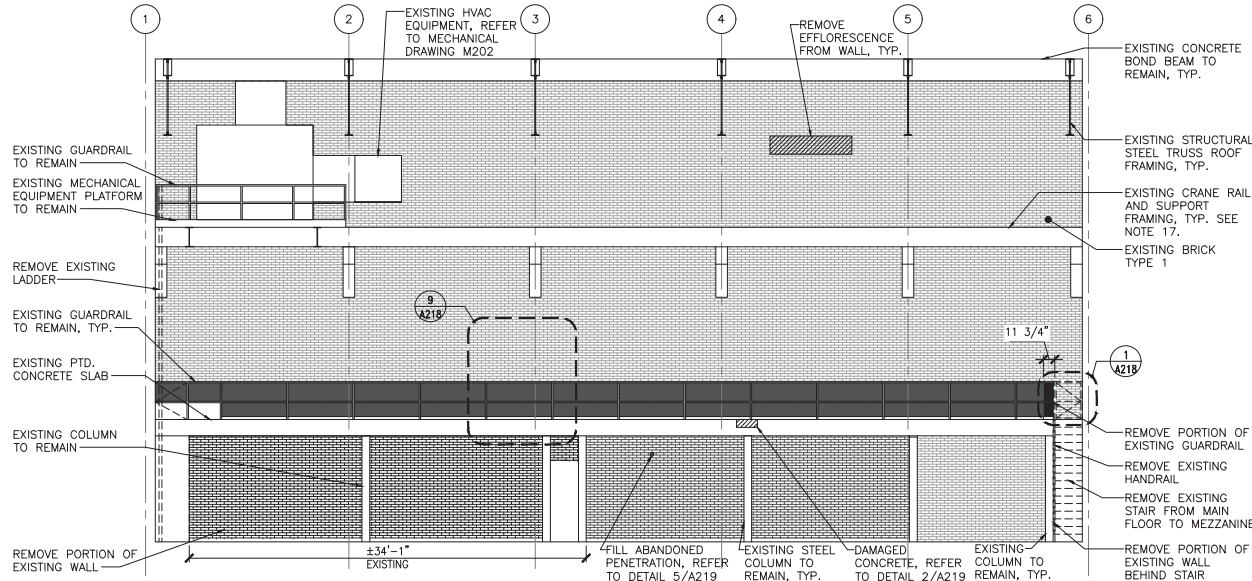


1 EXISTING WEST INTERIOR ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A203, A204



- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. SCRAPE, PREPARE, PRIME AND PAINT ENTIRE SURFACE OF CONCRETE CEILING, ALL ROOMS.
 5. REMOVE ALL PAINT FROM ALL BRICK SURFACES, ALL ROOMS, EACH WALL.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
 8. SCRAPE, PREPARE, PRIME, AND PAINT EXISTING OVERHEAD CRANE, CRANE RAIL, AND ASSOCIATED STEEL SUPPORT FRAMING, TYPICAL.
 9. SCRAPE, PREPARE, PRIME AND PAINT ALL EXPOSED STEEL FRAMING, TYPICAL.
 10. SCRAPE, PREPARE, PRIME, AND PAINT EXISTING MECHANICAL EQUIPMENT PLATFORM AND ASSOCIATED GUARDRAILS.
 11. SCRAP, PREPARE, PRIME AND PAINT ALL EXPOSED CMU.
 12. SEAL ALL ABANDONED PENETRATIONS PER DETAIL 5/A219.
 13. REPAIR ALL ACTIVE PENETRATIONS PER DETAIL 6/A219.
 14. REMOVE ALL EXISTING LIGHT FIXTURES, REFER TO ELECTRICAL DRAWINGS E204 THROUGH E206, TYPICAL.
 15. REMOVE ALL EXISTING TRACTION POWER EQUIPMENT. REFER TO TRACTION POWER DRAWINGS TP211 THROUGH TP219, TYPICAL.
 16. CONTACT CRANE MANUFACTURER TO VERIFY EXISTING WARRANTY.
 17. CRANE TO BE FULLY INSPECTED TO VERIFY REQUIREMENTS TO BRING CRANE SYSTEM BACK INTO OPERATION. FOR BIDDING PURPOSES, ASSUME COSTS FOR THE FOLLOWING:
 - A. INSPECTION
 - B. CRANE TESTING
 - C. HOIST REPLACEMENT
 - D. REFURBISHMENT OF REMAINING SYSTEM INCLUDING CLEANING AND PAINTING

- BRICK LEGEND:**
1. BRICK TYPE 1 = HY-TEX BRICK
 2. BRICK TYPE 2 = ENAMELED BRICK - "GREEN"
 3. BRICK TYPE 3 = ENAMELED BRICK - "GRANITE MARBLE"
 4. BRICK TYPE 4 = FACE BRICK

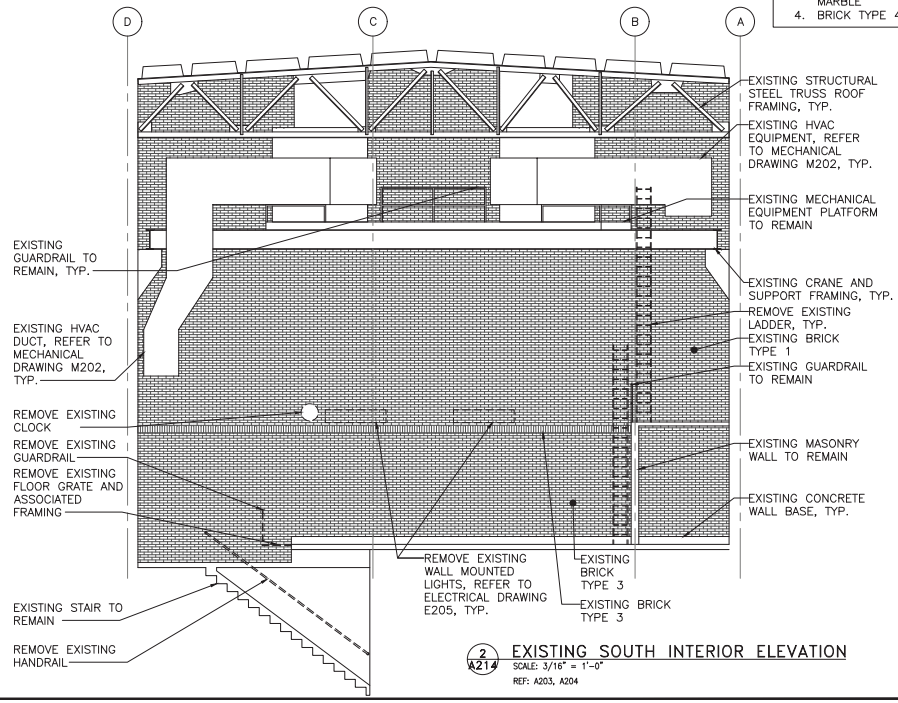

2 EXISTING SOUTH INTERIOR ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A203, A204

REGISTERED PROFESSIONAL ENGINEER
 PENNSYLVANIA REGISTRATION AUTHORITY
DMC 09509
 1200 MARKET ST., 18TH FL.
 PHILADELPHIA, PA 19107

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
ARCHITECTURAL
 EXISTING INTERIOR ELEVATIONS

TITLE	AS SHOWN	SCALE	1:1
DATE	08/22/2025	DRAWN BY	JL
PROJECT NUMBER	276482	CHECKED BY	JL
SHEET NUMBER	A214		
TOTAL SHEETS	15	OF	21
REV NO.	149	OF	448
PROJECT NO.			
COMPUTER FILE NO.	17AN-A214	REV.	

50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025
 STATUS: 50% SUBMISSION


REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 A215 EXISTING ELEVATIONS I


DATE: 08/22/2025	SCALE: 1:1
DRAWN BY: JC	CHECKED BY: JC
SHEET NUMBER: 276482	DATE: 08/22/2025
TOTAL SHEETS: 16 OF 21	DATE: 08/22/2025
CURRENT FILE NO.: 17AN-A215	DATE: 08/22/2025

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
 5. CLEAN ENTIRE FACADE, EACH ELEVATION.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.


- BRICK LEGEND:**
1. BRICK TYPE 1=HY-TEX BRICK
 2. BRICK TYPE 2=ENAMELED BRICK-"GREEN"
 3. BRICK TYPE 3=ENAMELED BRICK-"GRANITE MARBLE"
 4. BRICK TYPE 4=FACE BRICK

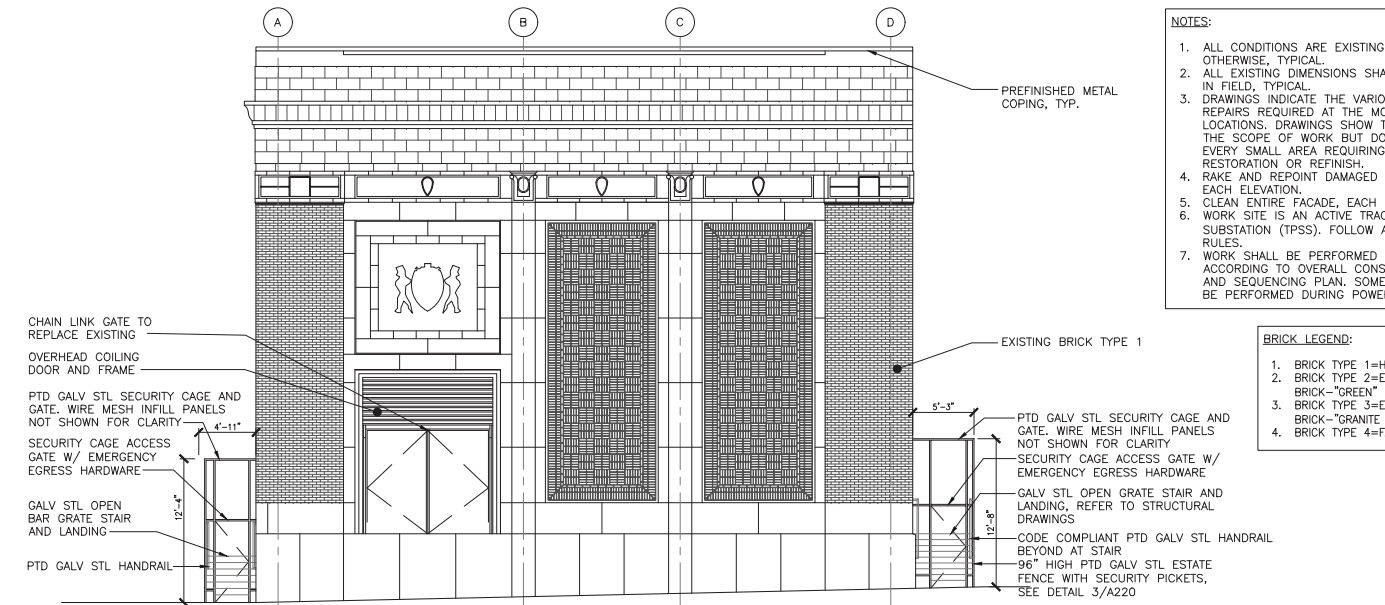

1 NORTH ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A207, A208, A210

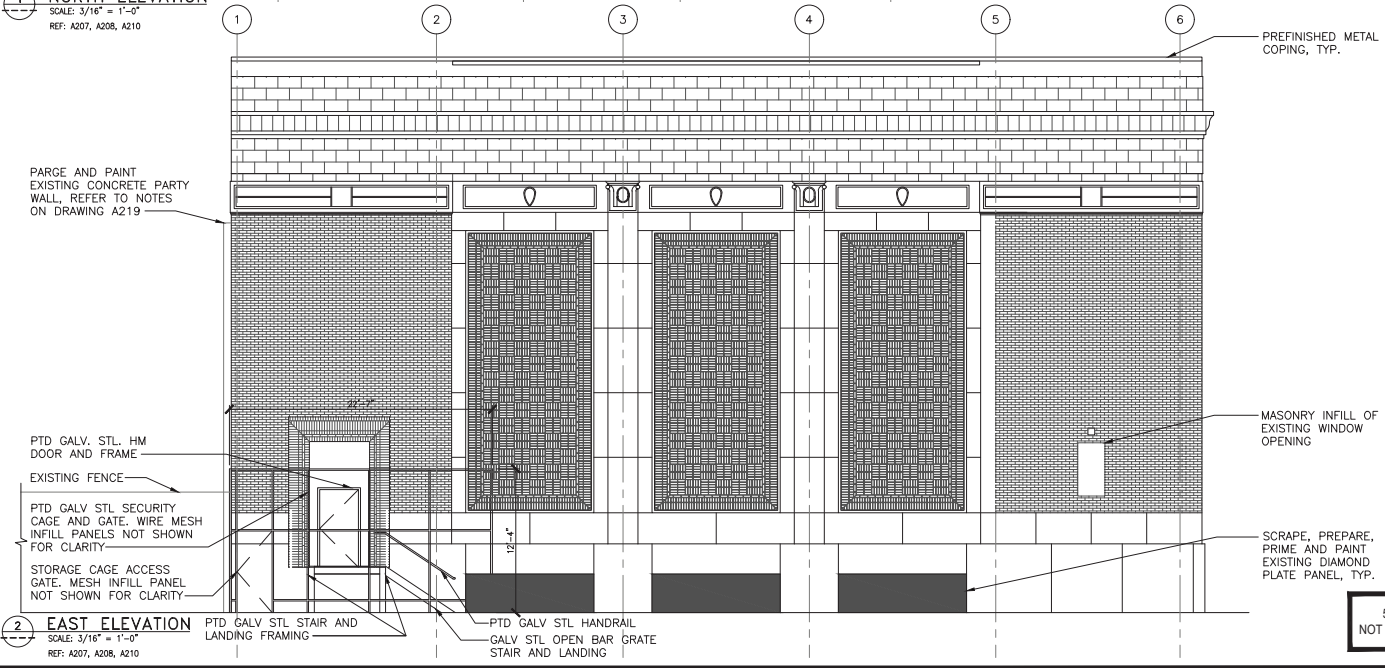

2 EAST ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A207, A208, A210



50% SUBMISSION
NOT FOR CONSTRUCTION

C:\PWORKING\1707\17AN\A215.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

DATE PREPARED:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	
DATE REVISION:	

HDR
HDR Engineering, Inc.
Philadelphia, PA

SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
A216 ELEVATIONS II

DATE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	KL
DATE:		CHECKED BY:	
PROJECT NUMBER:	276482		
SHEET NUMBER	A216		
TOTAL NO. SHEETS:	17	OF:	21
SHEET NO.:	151	OF:	448
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A216	REV. NO.:	


50% SUBMISSION
NOT FOR CONSTRUCTION

- NOTES:
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
 5. CLEAN ENTIRE FACADE, EACH ELEVATION.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
 8. CLOSE INSPECTION OF PORTIONS OF THE FACADE WAS NOT POSSIBLE DUE TO RESTRICTED ACCESS AT PRIVATE PROPERTY. DUE TO THIS, NOT ALL AREAS REQUIRING REPAIR, RESTORATIONS OR REFURBISHING ARE INCLUDED ON DRAWINGS. THE CONTRACTOR SHALL INSPECT ENTIRE BUILDING AND REPAIR ALL DAMAGE.


- BRICK LEGEND:
1. BRICK TYPE 1=HY-TEX BRICK
 2. BRICK TYPE 2=ENAMELED BRICK-"GREEN"
 3. BRICK TYPE 3=ENAMELED BRICK-"GRANITE MARBLE"
 4. BRICK TYPE 4=FACE BRICK

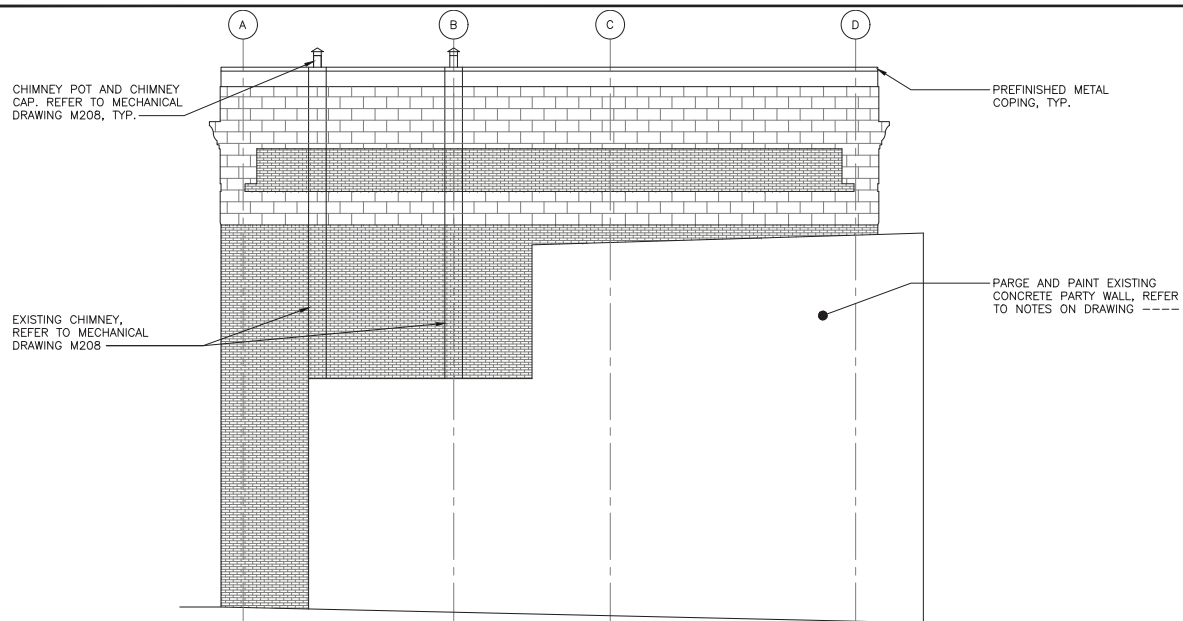

1 SOUTH ELEVATION
SCALE: 3/16" = 1'-0"
REF: ----, ----, ----

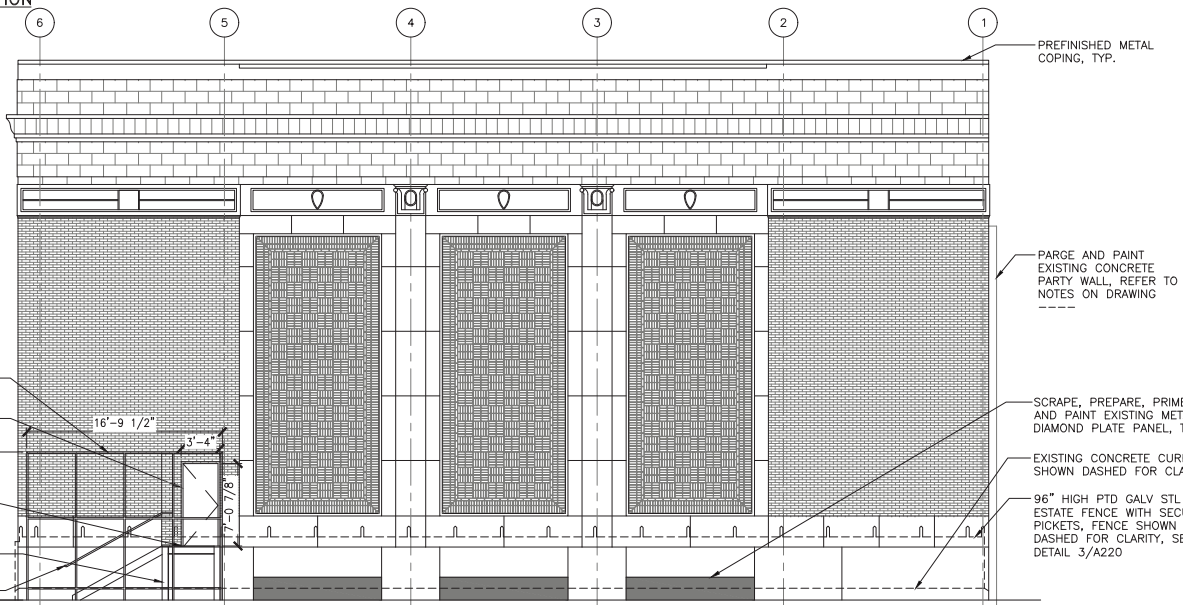

2 WEST ELEVATION
SCALE: 3/16" = 1'-0"
REF: ----, ----, ----



- PTD GALV STL SECURITY CAGE AND GATE. WIRE MESH INFILL PANELS NOT SHOWN FOR CLARITY
- PTD GALV. STL. HM DOOR AND FRAME
- 16'-9 1/2"
- 3'-4 1/8"
- 17'-0 7/8"
- GALV STL OPEN BAR GRATE STAIR AND LANDING
- 12'-8 1/2"
- PTD GALV STL STAIR AND LANDING FRAMING
- PTD GALV STL HANDRAIL

C:\P\WORKING\1707\17AN\A216.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION


SHEET NUMBER: _____
 SHEET TITLE: _____
 PROJECT: _____
 DATE: _____

NO.	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 A217 PHOTO DETAILS I

SHEET NUMBER	276482
DATE	08/22/2025
SCALE	AS SHOWN
SCALE FACTOR	1:1
DRAWN BY	KL
CHECKED BY	JR


SHEET NO.	18	OF	21
REV. NO.	152	OF	448
COMPUTER FILE NO.	17AN-A217	REV. NO.	-

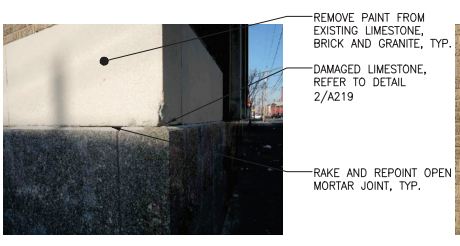

1 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A211

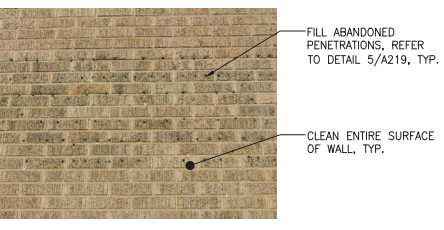


2 ABANDONED PENETRATIONS
 SCALE: NOT TO SCALE
 REF: A211

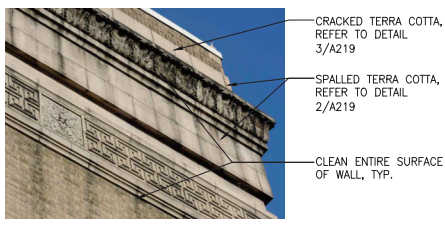


3 CRACKED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A211




4 CRACKED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A211

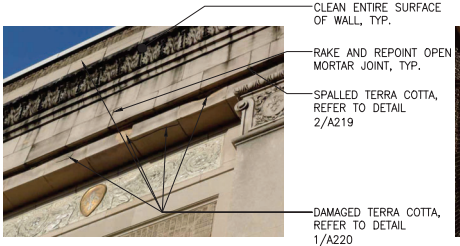


5 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A211

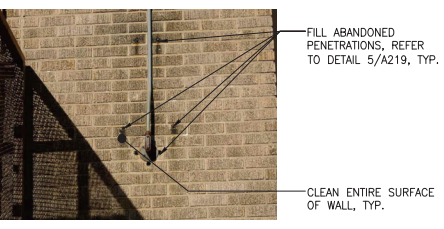


6 ABANDONED PENETRATIONS
 SCALE: NOT TO SCALE
 REF: A211

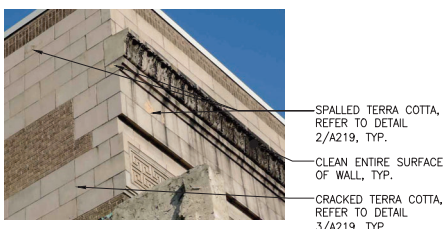


7 CRACKED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A211

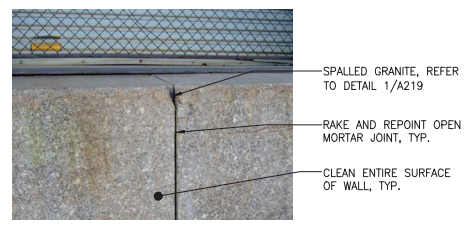


8 DAMAGED GRANITE
 SCALE: NOT TO SCALE
 REF: A211

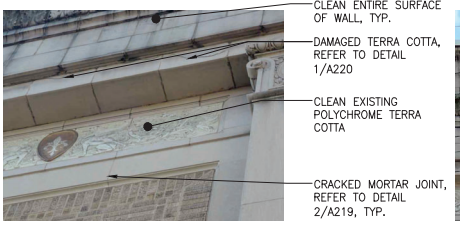


9 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A211

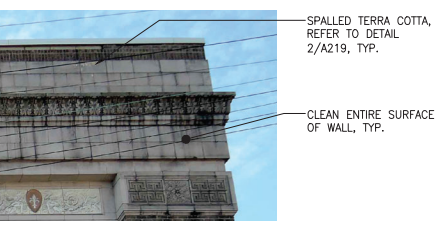


10 SPALLED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A211

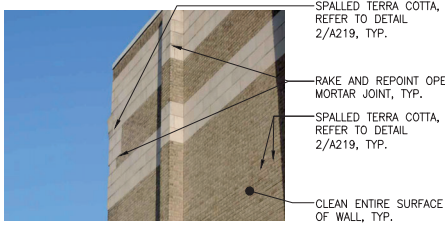


11 SPALLED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A212

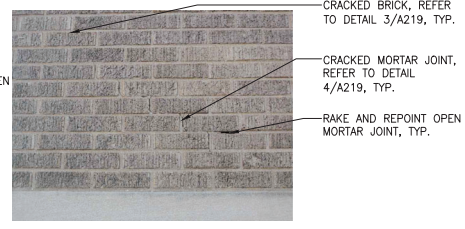

12 CRACKED BRICK
 SCALE: NOT TO SCALE
 REF: A212

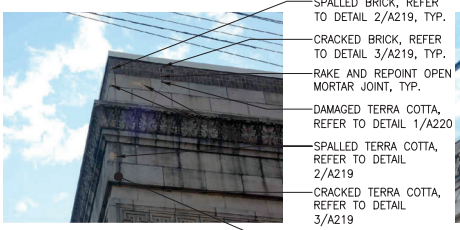


13 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A212

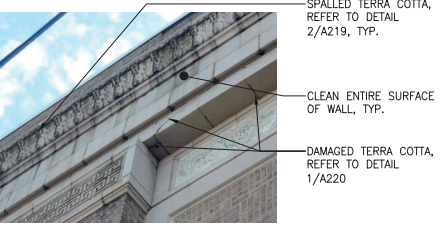

14 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A212



15 ABANDONED PENETRATION
 SCALE: NOT TO SCALE
 REF: A213

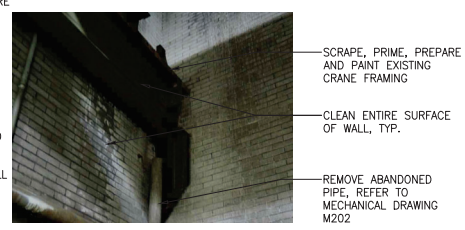

16 ABANDONED PIPE
 SCALE: NOT TO SCALE
 REF: A213

50% SUBMISSION
 NOT FOR CONSTRUCTION



CLEAN ENTIRE SURFACE OF WALL, TYP.
 REMOVE EXISTING HANDRAIL AND GUARDRAIL
 REPAIR DAMAGED BRICK, REFER TO NOTES AND DETAILS ON DRAWING A219
 REMOVE EXISTING GATE

1 LOOSE BRICK
 SCALE: NOT TO SCALE
 REF: A213, A214



REMOVE EXISTING IRON FENCE
 DAMAGED CONCRETE, REFER TO NOTES AND DETAILS ON DRAWING A219

2 DAMAGED CURB
 SCALE: NOT TO SCALE
 REF: A203




CLEAN ENTIRE SURFACE OF WALL, TYP.
 SEAL ABANDONED PENETRATIONS, REFER TO DETAIL 5/A219, TYP.

3 ABANDONED PENETRATIONS
 SCALE: NOT TO SCALE
 REF: A203



SCRAPE, PREPARE, PRIME AND PAINT EXISTING STEEL, TYP.
 SCRAPE, PREPARE, PRIME AND PAINT EXISTING CONCRETE, TYP.
 CLEAN ENTIRE SURFACE OF WALL, TYP.
 SEAL ABANDONED PENETRATIONS, REFER TO DETAIL 5/A219, TYP.

4 ABANDONED PENETRATIONS
 SCALE: NOT TO SCALE
 REF: A203



SCRAPE, PRIME, PREPARE AND PAINT EXISTING IRON FENCE
 DAMAGED CONCRETE, REFER TO NOTES AND DETAILS ON DRAWING A219

5 DAMAGED CURB
 SCALE: NOT TO SCALE
 REF: A203




DAMAGED CONCRETE, REFER TO NOTES AND DETAILS ON DRAWING A219

6 DAMAGED CONCRETE
 SCALE: NOT TO SCALE
 REF: A203



OPEN MORTAR JOINT, REFER TO DETAIL 4/A219, TYP.
 CRACKED MORTAR JOINT, REFER TO DETAIL 4/A219, TYP.
 OPEN MORTAR JOINT, REFER TO DETAIL 4/A219, TYP.

7 CRACKED MORTAR JOINT
 SCALE: NOT TO SCALE
 REF: A212



OPEN MORTAR JOINT, REFER TO DETAIL 4/A219, TYP.

8 OPEN MORTAR JOINTS
 SCALE: NOT TO SCALE
 REF: A212



CLEAN ENTIRE SURFACE OF WALL, TYP.
 SEAL ABANDONED PENETRATIONS, REFER TO DETAIL 5/A219, TYP.
 REMOVE ALL PAINT FROM EXISTING BRICK, TYP.
 SCRAPE, PREPARE, PRIME AND PAINT EXISTING GUARDRAIL, TYP.
 CRACKED CONCRETE, REFER TO DETAIL 3/A219, TYP.

9 ABANDONED PENETRATIONS
 SCALE: NOT TO SCALE
 REF: A214

DATE:	
DESIGNED BY:	
CHECKED BY:	
IN CHARGE:	
PROJECT NUMBER:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI SULLIVAN

NO.	DESCRIPTION	BY	DATE

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 A218 PHOTO DETAILS II

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	JL
PROJECT NUMBER:	276482	CHECKED BY:	JL
SHEET NUMBER:	19	OF	21
	153	OF	448
COMPUTER FILE NO.:	17AN-A218	REV. NO.:	

50% SUBMISSION
 NOT FOR CONSTRUCTION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK SUBWAY/ELEVATED TRAINS
 TRACTION POWER SUBSTATION
 REHABILITATION ARCHITECTURAL
 DETAILS I

- NOTES:**
- ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 - ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 - DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 - PATCHING CEMENT SHALL BE DESIGNED FOR THE REPAIR OF HORIZONTAL, VERTICAL, AND OVERHEAD CONCRETE AND MASONRY SURFACES.
 - MORTAR SHALL BE COMPATIBLE WITH EXISTING MORTAR IN HARDNESS, TEXTURE AND COLOR.

REPAIR NOTES

- BRICK:**
- POWERWASH ALL BRICK SURFACES TO REMOVE DIRT AND GRIME.
 - RAKE AND REPOINT ALL AREAS OF DAMAGED MORTAR JOINTS.
 - REMOVE AND RE-INSTALL BRICKS AT SEVERE CRACK LOCATIONS.
 - GRIND OUT CRACK, PREP PRIME AND PAINT METAL SURFACE OF SHELF ANGLE, REMORTAR.
 - WATERPROOF BRICK WALLS WITH AN APPROVED BREATHABLE, CLEAR SILANE SOLUTION.
 - REPLACE ALL MISSING, CRACKED, BROKEN AND SPALLED BRICK.
 - REPAIR CRACKS IN WALLS.
 - REPAIR ALL CRACKED BRICK, MAXIMUM CRACK WIDTH 1/8". REPLACE BRICK WHERE CRACK EXCEEDS 1/8".
 - REPOINT OPEN MORTAR JOINTS IN EXISTING AREAS AS SHOWN.
 - REMOVE ALL EXISTING PAINT ON BRICK.

- WALL PENETRATIONS:**
- REMOVE ABANDONED PROJECTIONS, FILL OPEN HOLES SOLID WITH NON-SHRINK GROUT.
 - AT SMALL PIPE/CONDUIT WALL PENETRATIONS SEAL VOID BETWEEN PIPE AND WALL WITH BACKER ROD AND SEALANT.
 - SEAL PERIMETER OF CONDUIT AND SLEEVES.
 - REMOVE ABANDONED PIPING, FILL OPEN HOLES SOLID WITH NON-SHRINK GROUT.

- STEEL LINTELS:**
- EXISTING FAILING LINTELS TO BE REMOVED & REPLACED.
 - RAKE AND RE-CAULK METAL/ MASONRY TIE-IN.
 - PREPARE RUSTED LINTEL TO BARE METAL, PRIME (1 COAT) AND PAINT (2 COATS).
 - REMOVE AND REPLACE DAMAGED LINTELS. COORDINATE WITH STRUCTURAL DRAWINGS.

- POWERWASHING, SCRAPING, AND SANDING:**
- TESTING SHALL BE PERFORMED TO DETERMINE PRESENCE OF LEAD. IF LEAD IS PRESENT, ALL INSTANCES SHALL BE REMEDIATED. ALL REMEDIATION WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND LAWS.
 - PAINTED SURFACES BEING POWERWASHED SHALL BE "CONTAINED" AS PER CODE.
 - DRY SCRAPING OR SANDING OF PAINTED SURFACES MAY ONLY BE PERFORMED WITH EQUIPMENT UTILIZING VACUUM ATTACHMENT W/ HEPA FILTER, AS PER CODE.

- ASBESTOS REMOVAL:**
- TESTING SHALL BE PERFORMED TO DETERMINE THE PRESENCE OF ASBESTOS. IF ASBESTOS IS PRESENT, ALL INSTANCES SHALL BE ABATED. ALL ABATEMENT WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND LAWS.
 - REMOVAL OF NON-FRIBLE ASBESTOS CONTAINING MATERIALS SHALL BE PERFORMED IN SUCH A MANNER THAT THE MATERIALS REMAIN NON-FRIBLE DURING THE RENOVATION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT THE MATERIALS ARE REMOVED WITHOUT RENDERING THE MATERIAL FRIBLE. ASBESTOS MATERIALS TO BE PACKAGED AND SEALED AFTER REMOVAL. REFER TO ASBESTOS ABATEMENT SPECIFICATIONS FOR ADDITIONAL INFORMATION ON REMOVAL PROCEDURES.


- GRANITE:**
- REMOVE ALL EXISTING PAINT ON GRANITE.
 - POWERWASH ALL GRANITE SURFACES TO REMOVE DIRT AND GRIME.
 - REPAIR CRACKS IN WALLS.
 - REPOINT ALL OPEN MORTAR JOINTS.
 - WATERPROOF GRANITE WITH APPROVED, CLEAR, BREATHABLE SILANE SOLUTION.

- LIMESTONE:**
- REMOVE ALL EXISTING PAINT ON LIMESTONE.
 - POWERWASH ALL SURFACES TO CLEAN STONES.
 - REPAIR AND RESTORE ALL SPALLED AND BROKEN LIMESTONE.
 - RAKE AND REPOINT ALL OPEN JOINTS.
 - WATERPROOF LIMESTONE WITH APPROVED, CLEAR, BREATHABLE SILANE SOLUTION.


- TERRA COTTA:**
- POWER WASH ALL SURFACES TO REMOVE DIRT AND GRIME.
 - REPAIR AND RESTORE DAMAGED TERRA COTTA.
 - REPLACE TERRA COTTA UNITS WITH SEVERE SPALLING.
 - RAKE AND REPOINT ALL OPEN JOINTS.
 - WATERPROOF TERRA COTTA WITH APPROVED SEALANT PER SPECIFICATION 04212.

- POLYCHROME TERRA COTTA:**
- POWER WASH ALL SURFACES TO REMOVE DIRT AND GRIME.
 - MECHANICALLY ABRASE SURFACES TO REMOVE LOOSE GLAZING.
 - FILL IN CRACKS, REBUILD DAMAGED SECTIONS AND CROSS JOINTS WITH THE ELASTOMERIC COATING SYSTEM'S APPROVED PASTE.
 - REMOVE AND REINSTALL SECTIONS THAT HAVE SEPARATED MORE THAN 3/8" FROM EACH OTHER AT HORIZONTAL JOINTS.
 - PRIME SURFACE.
 - APPLY COLOR CAST.


- CEMENT PARGE:**
- POWER WASH REPAIR AREA AND SURROUNDING AREA.
 - APPLY CEMENT PARGE EVENLY WITH EXISTING.
 - PAINT TO MATCH EXISTING.

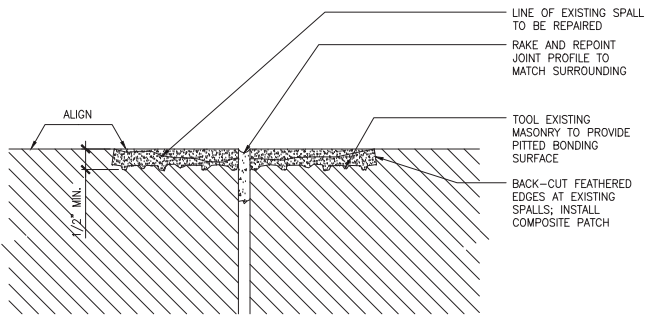


1 MASONRY SPALL REPAIR AT JOINT
 SCALE: 6" = 1'-0"

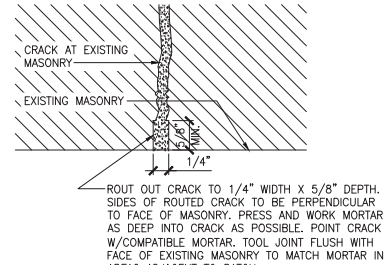


3 MASONRY CRACK REPAIR
 SCALE: 6" = 1'-0"

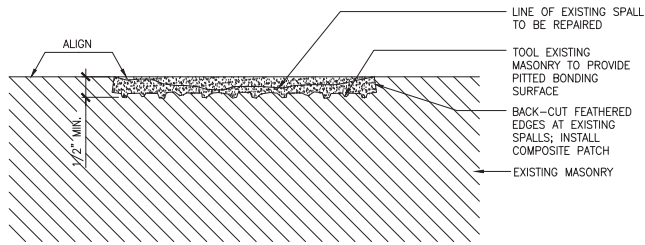

2 MASONRY SPALL REPAIR
 SCALE: 6" = 1'-0"

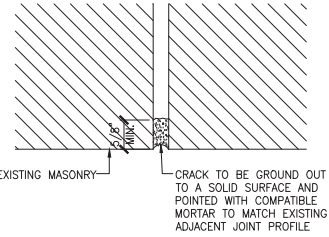


4 MORTAR JOINT REPAIR
 SCALE: 6" = 1'-0"

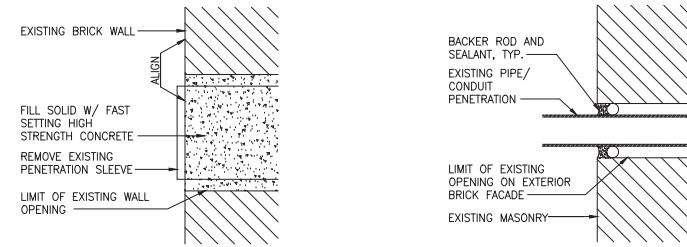


5 ABANDONED PENETRATION REPAIR
 SCALE: 6" = 1'-0"

6 PENETRATION REPAIR
 SCALE: 6" = 1'-0"




C:\P\WORKING\SET\17AN\17AN-A219.DWG


C:\PW\WORKING\170117\17AN-A220.DWG

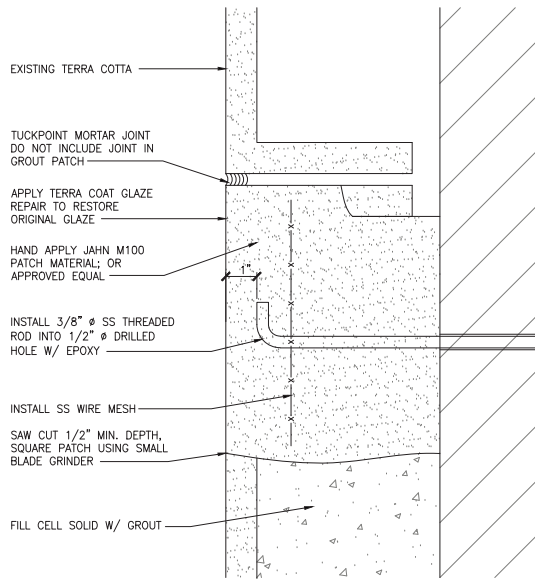

1
A220 GROUT PATCH FOR TERRA COTTA
SCALE: 6" = 1'-0"

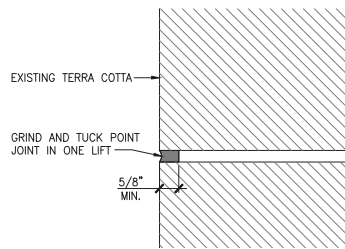

2
A220 POINTING FOR TERRA COTTA
SCALE: 6" = 1'-0"

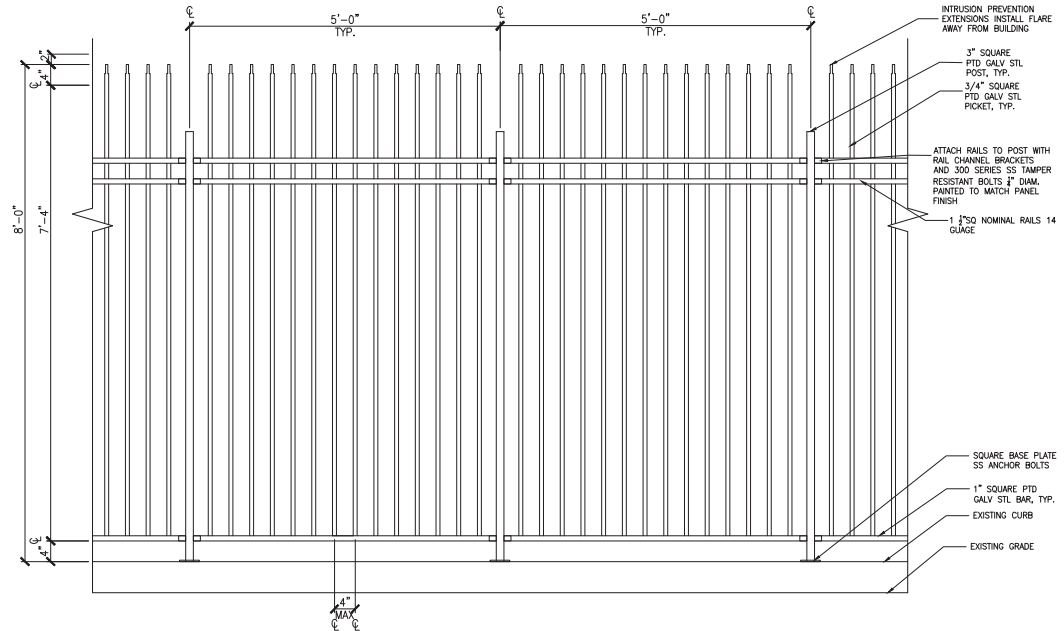

3
A220 TYPICAL FENCE ELEVATION
SCALE: 1" = 1'-0"

NOTES:

1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
4. PATCHING CEMENT SHALL BE DESIGNED FOR THE REPAIR OF HORIZONTAL, VERTICAL AND OVERHEAD CONCRETE AND MASONRY SURFACES.
5. MORTAR SHALL BE COMPATIBLE WITH EXISTING MORTAR IN HARDNESS, TEXTURE AND COLOR.





DATE PREPARED: 08/22/2025
 DATE REVISION: 08/22/2025
 PROJECT: 276482
 SHEET: 21 OF 21
 DRAWN BY: JC
 CHECKED BY: JH



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
 TRACTION POWER SUBSTATION
 REHABILITATION
 ARCHITECTURAL
 MISCELLANEOUS DETAILS - SHEET 2

SCALE: 1:1
 DATE: 08/22/2025
 SHEET NUMBER: 276482
A220
 SHEET NO: 21 OF 21
 SHEET NO: 155 OF 448
 COMPUTER FILE NO: 17AN-A220



50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

GENERAL:

1. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH ALL DRAWINGS AND SPECIFICATIONS CONTAINED HEREIN.
2. ALL WORK RELATED TO THE STAGING, CONSTRUCTION PRACTICES AND SAFETY OF THE PROJECT'S WORKERS AND PROPERTY SHALL BE CONSIDERED MEANS AND METHODS AND SHALL BE COMPLETED BY THE CONTRACTOR IN ACCORDANCE WITH STANDARD INDUSTRY PRACTICE AND ALL CODES AND STANDARDS.
3. ALL DRAWINGS HAVE BEEN PREPARED IN ACCORDANCE WITH THE 2009 INTERNATIONAL BUILDING CODE AS WELL AS ALL REFERENCED STANDARDS CONTAINED THEREIN.
4. EVALUATION AND COMPLIANCE WITH LOADING RESTRICTIONS FOR MEANS AND METHODS OF CONSTRUCTION AS WELL AS STAGING FOR OTHER TRADES ARE THE RESPONSIBILITY OF THE CONTRACTOR.
5. ALL WORK SHALL BE INSPECTED IN ACCORDANCE WITH CHAPTER 17 OF THE REFERENCED BUILDING CODE. SUBMIT ALL REPORTS TO THE SEPTA PROJECT MANAGER FOR REVIEW. AT THE COMPLETION OF THE PROJECT, THE SPECIAL INSPECTION REPORT SHALL BE COMPLETED, SIGNED BY THE SPECIAL INSPECTOR AND SUBMITTED TO THE SEPTA PROJECT MANAGER FOR RECORD PURPOSES.
6. SCALING OF DRAWINGS TO DETERMINE DIMENSIONS OF ELEMENTS IS NOT PERMITTED.
7. ALL HORIZONTAL AND VERTICAL DIMENSIONS CONTAINED ON THE STRUCTURAL DRAWINGS WERE DEVELOPED USING EXISTING SURVEY INFORMATION FOR THE PURPOSE OF THIS PROJECT. ANY DIMENSIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS SHOULD BE COORDINATED WITH THE OTHER DISCIPLINE DRAWINGS.
8. THE STRUCTURAL DOCUMENTS ARE TO BE USED IN COORDINATION WITH THE ELECTRICAL AND CIVIL DRAWINGS AND SPECIFICATIONS AS WELL AS THOSE OF ALL OTHER DISCIPLINES. ANY DISCREPANCIES SHOULD BE BROUGHT TO THE ATTENTION OF THE SEPTA PROJECT MANAGER PRIOR TO THE COMMENCEMENT OF WORK.
9. DESIGN LOADS FOR THE PROJECT ARE LISTED IN THE LOAD SCHEDULE BELOW:
 - a. SNOW LOAD 25 PSF
 - b. DEAD LOAD VARIES, SEE INDIVIDUAL DRAWINGS
 - c. WIND LOAD PER IBC CODE

EXISTING CONSTRUCTION:

1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN, COORDINATION AND INSTALLATION OF SHORING AND STABILIZATION OF EXISTING CONSTRUCTION AS REQUIRED TO PERFORM THE WORK CONTAINED IN THE DRAWINGS AND SPECIFICATIONS.
2. DIMENSIONS SHOWN REFERRING TO EXISTING STRUCTURES ARE FOR REFERENCE ONLY. ALL DIMENSIONS RELATED TO EXISTING FRAMING SHOULD BE VERIFIED BY THE CONTRACTOR PRIOR TO THE COMMENCEMENT OF WORK.
3. THE CONTRACTOR SHALL NOTIFY THE SEPTA PROJECT MANAGER OF ANY INFORMATION RELATING TO EXISTING STRUCTURES THAT HAS BEEN UNCOVERED DUE TO DEMOLITION.

FOUNDATIONS:

1. EXCAVATE THE FOUNDATION AREAS TO THE DEPTH AND EXTENT INDICATED ON THE FOUNDATION DRAWINGS. ALL FOOTING AND SLAB SUBGRADES SHALL BE APPROVED IN WRITING BY THE SEPTA PROJECT MANAGER PRIOR TO BACKFILLING. SUBMIT ALL REPORTS TO THE SEPTA PROJECT MANAGER FOR RECORD.
2. BOTTOM OF FOUNDATIONS SHALL BEAR ON SOIL CAPABLE OF SAFELY SUPPORTING 3000 PSF.
 - a. UNDISTURBED VIRGIN SOIL
 - b. CONTROLLED COMPACTED FILL
 - c. DENSIFIED NATURAL SOIL
 - d. ROCK
 - e. OTHER
3. CAPABLE OF SAFELY SUPPORTING 3000 PSF.
4. BOTTOM OF FOOTING SUBGRADE MUST BE INSPECTED AND APPROVED BY A REGISTERED GEOTECHNICAL ENGINEER BEFORE PLACING ANY CONCRETE FOUNDATIONS. APPROVAL IN WRITING MUST INDICATE THE SOIL IS ADEQUATE TO SAFELY SUSTAIN THE SPECIFIED BEARING PRESSURE. SUBMIT ALL REPORTS TO THE SEPTA PROJECT MANAGER FOR RECORD.
5. BOTTOM OF ALL FOOTINGS SUBJECTED TO FREEZE THAW CONDITIONS SHALL BE A MINIMUM 3 FEET BELOW FINISH GRADE OR TOP OF SLAB ELEVATION WHICHEVER IS LOWER.
6. RETAINING WALLS SHALL BE BACKFILLED AND COMPACTED WITH MATERIAL PRODUCING A MAXIMUM ACTIVE EQUIVALENT FLUID LATERAL EARTH PRESSURE OF 45 PSF.
7. WALLS RETAINING EARTH SHALL NOT BE BACKFILLED UNTIL A MINIMUM OF 70 PERCENT OF SPECIFIED COMPRESSIVE STRENGTH IS ACHIEVED. BASEMENT WALLS SHALL NOT BE BACKFILLED, UNLESS ADEQUATELY BRACED, UNTIL FLOOR SLAB IS IN PLACE AND ATTAINS A MINIMUM OF 70 PERCENT OF SPECIFIED COMPRESSIVE STRENGTH.
8. SITE RETAINING WALLS AND EXPOSED CONCRETE WALLS SHALL HAVE CONTROL JOINTS A MAXIMUM OF 20 FEET ON CENTER UNLESS OTHERWISE NOTED ON THE DRAWINGS. MASONRY OR CONCRETE WALLS WITH INTEGRAL COLUMN PIERS OR PILASTERS SHALL HAVE A FORMED CONTROL JOINT ON ONE SIDE OF EACH PIER ON THE EXPOSED FACE OF THE WALL. JOINTS SHALL BE FILLED WITH SEALANT AS NOTED ON THE ARCHITECTURAL DRAWINGS.
9. UNDERPINNING, SHEETING AND SHORING NOTED ON THE DRAWINGS SHALL BE DESIGNED AND DETAILED BY A REGISTERED PROFESSIONAL ENGINEER WITH A MINIMUM OF 3 YEARS EXPERIENCE IN THE DESIGN OF FOUNDATION SHORING. SUBMIT SIGNED AND SEALED DRAWINGS, CALCULATIONS, AND A STAGING PLAN TO THE SEPTA PROJECT MANAGER FOR REVIEW AND RECORD.

CONCRETE:

1. ALL CONCRETE SHALL BE READY-MIX AND HAVE THE FOLLOWING CHARACTERISTICS:
 - a. SLABS ON GRADE:
 - 1.) A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS.
 - 2.) A MINIMUM OF 520 LBS. OF CEMENT PER CUBIC YARD.
 - 3.) SLUMP (AT POINT OF CONCRETE PLACEMENT) SHALL BE 3 INCH MINIMUM AND 5 INCH MAXIMUM.
 - b. FOOTINGS AND FOUNDATION WALLS:
 - 1.) A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS.
 - 2.) A MINIMUM OF 520 LBS. OF CEMENT PER CUBIC YARD.
 - 3.) SLUMP (AT POINT OF CONCRETE PLACEMENT) SHALL BE 3 INCH MINIMUM AND 5 INCH MAXIMUM.
2. ALL CONCRETE EXPOSED TO EXTERIOR CONDITIONS SHALL HAVE CHARACTERISTICS IN ACCORDANCE WITH ACI BUILDING CODE (ACI 318) AND THE 2012 INTERNATIONAL BUILDING CODE:
 - a. MAXIMUM WATER-CEMENTITIOUS MATERIAL RATIO SHALL BE 0.45.
 - b. MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS.
3. ALL CONCRETE WORK SHALL COMPLY WITH THE REQUIREMENTS OF THE LATEST EDITIONS OF THE FOLLOWING CODES AND STANDARDS:
 - a. ACI BUILDING CODE (ACI 318).
 - b. THE ACI DETAILING MANUAL (SP.66).

4. ALL REINFORCING STEEL SHALL BE GALVANIZED AND SHALL BE MANUFACTURED FROM HIGH STRENGTH BILLET STEEL CONFORMING TO ASTM DESIGNATION A615 GRADE 60. LAP ALL BARS MINIMUM 48 BAR DIAMETERS UNLESS OTHERWISE NOTED OTHERWISE.
5. ALL WWF SHALL BE GALVANIZED AND SHALL BE MANUFACTURED FROM HIGH STRENGTH STEEL CONFORMING TO ASTM A195. LAP ALL WWF A MINIMUM OF 6 INCHES.
6. PLACE TRANSVERSE REINFORCING (SWB) IN BOTTOM LAYER OF CONTINUOUS FOOTINGS. PROVIDE CORNER BARS IN FOOTINGS TO MATCH CONTINUOUS REINFORCEMENT. EXTEND WALL FOOTING REINFORCING INTO COLUMN FOOTINGS A MINIMUM OF 2 FEET.
7. PROVIDE KEYS IN CONCRETE WALLS, PIERS, GRADE BEAMS AND FOOTINGS AT INTERSECTIONS UNLESS NOTED OTHERWISE. PROVIDE CORNER BARS TO MATCH HORIZONTAL REINFORCEMENT AT WALL CORNERS AND TEE INTERSECTIONS.
8. CONCRETE SHALL ACHIEVE A MINIMUM OF 70 PERCENT OF THE DESIGN STRENGTH PRIOR TO STEEL ERECTION. WRITTEN CONFIRMATION OF THIS STRENGTH SHOULD BE SUBMITTED TO THE SEPTA PROJECT MANAGER PRIOR TO THE COMMENCEMENT OF STEEL ERECTION.
9. CONCRETE COVER OVER REINFORCING STEEL SHALL BE IN ACCORDANCE WITH ACI 318.

STEEL:

1. ALL STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE LATEST AISC CODE.
1. ALL STRUCTURAL STEEL WIDE FLANGE (W) SHAPES SHALL BE ASTM A992 GRADE 50 (F50). ALL STRUCTURAL STEEL S, M, AND HP SHAPES SHALL BE ASTM A572 GRADE 50 (F50). ALL OTHER STRUCTURAL STEEL SHALL BE ASTM A36 UNLESS OTHERWISE NOTED.
2. ALL STEEL SHALL BE THOROUGHLY CLEANED IN ACCORDANCE WITH SSPC. SP3 AND BE TREATED AS FOLLOWS:
 - a. HAVE A SHOP COAT OF RUST INHIBITIVE PAINT.
3. ORIENT ALL MILL CAMBER UPWARD DURING FABRICATION AND ERECTION.
4. ALL SHOP AND FIELD WELDING SHALL BE PERFORMED BY WELDERS CERTIFIED, AS DESCRIBED IN THE LATEST EDITION OF THE AMERICAN WELDING SOCIETY'S STANDARD QUALIFICATION PROCEDURE, AWS D1.1, TO PERFORM THE TYPE OF WORK REQUIRED.
5. ALL BOLTS USED FOR THE ANCHORAGE TO CONCRETE AS SPECIFIED ON THE DRAWINGS SHALL CONFORM TO ASTM F1554.
6. ALL STEEL CONNECTIONS SHALL BE BOLTED WITH A MINIMUM OF 3/4" A325N HIGH STRENGTH BOLTS OR WELDED AS DESIGNED BY THE STEEL FABRICATOR.
7. ALL TENSION CONTROLLED BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM F1852 AND ASTM F2280.
8. ALL BRACE CONNECTIONS SHALL BE BOLTED WITH A MINIMUM OF 3/4" DIAMETER A490.SC HIGH STRENGTH BOLTS OR WELDED.
9. ALL ALUMINUM AND STEEL MEMBERS SHALL BE TREATED OR PROPERLY SEPARATED TO PREVENT GALVANIC AND CORROSIIVE EFFECTS.
10. ALL STEEL WELDING RODS SHALL BE AS FOLLOWS:
 - a. E70XX FOR STEEL CONNECTIONS.
 - b. E80XX FOR BRACE CONNECTIONS.
 - c. E60XX FOR STEEL TO METAL STUD CONNECTIONS.
11. SUBMIT ALL STEEL SHOP DRAWINGS FOR REVIEW PRIOR TO ANY FABRICATION. SUBMIT CALCULATIONS FOR ALL BRACE CONNECTIONS TO COLUMNS (CALCULATIONS NEED NOT BE SIGNED AND SEALED).
12. STEEL FABRICATOR IS SOLELY RESPONSIBLE FOR COORDINATING WITH THE CONTRACTOR FOR THE PURPOSE OF SURVEYING AND VERIFICATION OF EXISTING CONDITIONS INCLUDING BUT NOT LIMITED TO THE LOCATION, ELEVATION, AND DIMENSIONS OF WALLS AND FRAMING THAT EXIST AT THE TIME OF THE STEEL ERECTION.
13. ALL LIMBELS AND SHELF ANGLES SHALL BE PAINTED AND GALVANIZED. ANY POINTS OF WELDING SHALL BE TOUCHED UP IN THE FIELD WITH A ZINC-RICH PAINT BY THE STEEL ERECTOR.
14. ALL EXPOSED STEEL (GANTRY COLUMNS AND WALKWAYS, ETC.) SHALL BE HOT DIP GALVANIZED. ANY POINTS OF WELDING SHALL BE TOUCHED UP IN THE FIELD WITH A ZINC-RICH PAINT BY THE STEEL ERECTOR.

MASONRY:

1. MASONRY UNITS SHALL BE:
 - a. NORMAL WEIGHT MASONRY UNITS.
 - b. ASTM C90 SOLID OR ASTM C90 HOLLOW GROUTED SOLID BELOW GRADE.
 - c. ASTM C90 HOLLOW ABOVE GRADE.
2. D WITH MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI (AVERAGE OF 3 UNITS).
3. e. ALL CMU SHALL BE LAID IN A FULL BED OF MORTAR.
4. f. CONSTRUCT COLUMN PIERS INTEGRALLY WITH FOUNDATION AND ABOVE GRADE WALLS AND CONTINUE HORIZONTAL WALL REINFORCEMENT THROUGH THE PIER.
5. g. GROUT COLUMN PIERS AND WALLS MONOLITHICALLY.
2. FOLLOWING ARE THE BLOCK STRENGTHS REQUIRED:
 - a. ASTM C90 SOLID 2000 PSI ON GROSS AREA OF INDIVIDUAL UNITS.
 - b. ASTM C90 SOLID 1500 PSI ON NET AREA OF AVERAGE OF 3 UNITS PER ACI.530.
 - c. ASTM C90 HOLLOW 1700 PSI ON NET AREA OF INDIVIDUAL UNITS.
3. ALL MORTAR SHALL BE ASTM C270 TYPE S WITH A MINIMUM COMPRESSIVE STRENGTH OF 1800 PSI AT 28 DAYS.
4. ALL MORTAR SHALL BE FIELD OBTAINED MORTAR CUBES TESTED IN ACCORDANCE WITH ASTM C270 AND ASTM C780.
5. GROUT SHALL BE A HIGH SLUMP MIX:
 - a. IN ACCORDANCE WITH ASTM C476.
 - b. HAVING A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
 - c. FROM FIELD OBTAINED TEST PRISMS.
6. ALL CONCRETE MASONRY SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE LATEST EDITION OF THE BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES ACI 530/ASCE 5/TMS 402 AND THE SPECIFICATION FOR MASONRY STRUCTURES ACI 530.1/ASCE 6/TMS 602.
7. PROVIDE HOT-DIPPED GALVANIZED TRUSS TYPE HORIZONTAL JOINT REINFORCEMENT, MIN. 9 GA. AT 16" ON CENTER VERTICAL IN ALL MASONRY WALLS. SPACE HORIZONTAL JOINT REINFORCEMENT AT 8 INCHES ON CENTER IN ALL PARAPETS. USE SHOP FABRICATED SPECIAL PIECES AT ALL CORNERS AND TEES.

PAINTING:

1. ALL STEEL SHALL BE CLEANED, PRIMED AND REPAINTED. NOTE EXISTING PAINT MAY BE LEAD BASED. PROPER CONTAINMENT AND DISPOSAL MUST BE PROVIDED.

MINIMUM SIZE OF FILET WELDS	
MATERIAL THICKNESS OF THINNER PART JOINED (IN.)	MINIMUM SIZE OF FILET WELD# (IN.)
TO 1/4 INCLUSIVE	1/8
OVER 1/4 TO 1/2	3/16
OVER 1/2 TO 3/4	1/4
OVER 3/4	5/16

*LEG DIMENSION OF FILET WELDS. SINGLE-PASS WELDS MUST BE USED

ABBREVIATIONS

ACI	AMERICAN CONCRETE INSTITUTE
ASCE	AMERICAN SOCIETY OF CIVIL ENGINEERS
ASTM	AMERICAN SOCIETY OF TESTING AND MATERIALS
AWW	AMERICAN WELDING SOCIETY
B/	BOTTOM OF
B.O.B.	BOTTOM OF BRIDGE
B.O.B.P.L.	BOTTOM OF BASE PLATE
B.O.S.	BOTTOM OF STEEL
CL.	CLEAR
CL.	CENTERLINE
CMU	CONCRETE MASONRY UNIT
CONT.	CONTINUOUS
CU.	COPPER
Ø DIA.	Ø DIAMETER
DWG.	DRAWING
(E), EX	EXISTING
EL.	ELEVATION
E.W. E.F.	EACH WAY EACH FACE
F.	FARENHEIT
F.O.C.	FACE OF COLUMN
FT.	FOOT
G	GRADE
GA.	GAUGE
H	HORIZONTAL
HSS	HOLLOW STRUCTURAL SECTION
HT.	HEIGHT
IBC	INTERNATIONAL BUILDING CODE
I.E.	FOR EXAMPLE
IN.	INCH
LLV	LONG LEG VERTICAL
LBS.	POUNDS
MAX.	MAXIMUM
MIN.	MINIMUM
(MOD)	MODIFIED
NC	NOT IN CONTRACT
NTS	NOT TO SCALE
O.C.	ON CENTER
OSHA	OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION
PL.	PLATE
PROJ	PROJECTION
PSF	POUNDS PER SQUARE FOOT
PSI	POUNDS PER SQUARE INCH
PT	POTENTIAL TRANSFORMER
PVC	POLYVINYL CHLORIDE
QTY	QUANTITY
RECT	RECTIFIER
REF	REFERENCE
R/W	RIGHT OF WAY
(S)	SURVEY ELEVATION
SSPC	SOCIETY OF PROTECTIVE COATINGS
SWB	TRANSVERSE REINFORCEMENT
T/FDN	TOP OF FOUNDATION
TMS	THE MASONRY SOCIETY
TOS	TOP OF STEEL
TYP	TYPICAL
UNC	UNLESS NOTED OTHERWISE
V. VERT	VERTICAL
VC	VERTICAL CURVE
W/	WITH
WESS	WAYSIDE ENERGY STORAGE SYSTEM
WP	WORKING POINT
WFW	WELDED WIRE FABRIC
XFMR	TRANSFORMER

NOTE:

1. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). ALL WORK REFERENCED ON THESE DRAWINGS SHALL BE PERFORMED DURING AN OUTAGE AND UNDER THE DIRECTION OF SEPTA.
2. FOR MORE GENERAL NOTES SEE DRAWING G105.

50% SUBMISSION
NOT FOR CONSTRUCTION



1234 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107

PREPARED BY: [blank]

CHECKED BY: [blank]

DESIGNED BY: [blank]

DATE: [blank]

PROJECT NO.: [blank]

DATE: [blank]

BY: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]


DATE: [blank]

DATE: [blank]

DATE: [blank]

DATE: [blank]

C:\PWORK\PROJECTS\17AN-S200.DWG

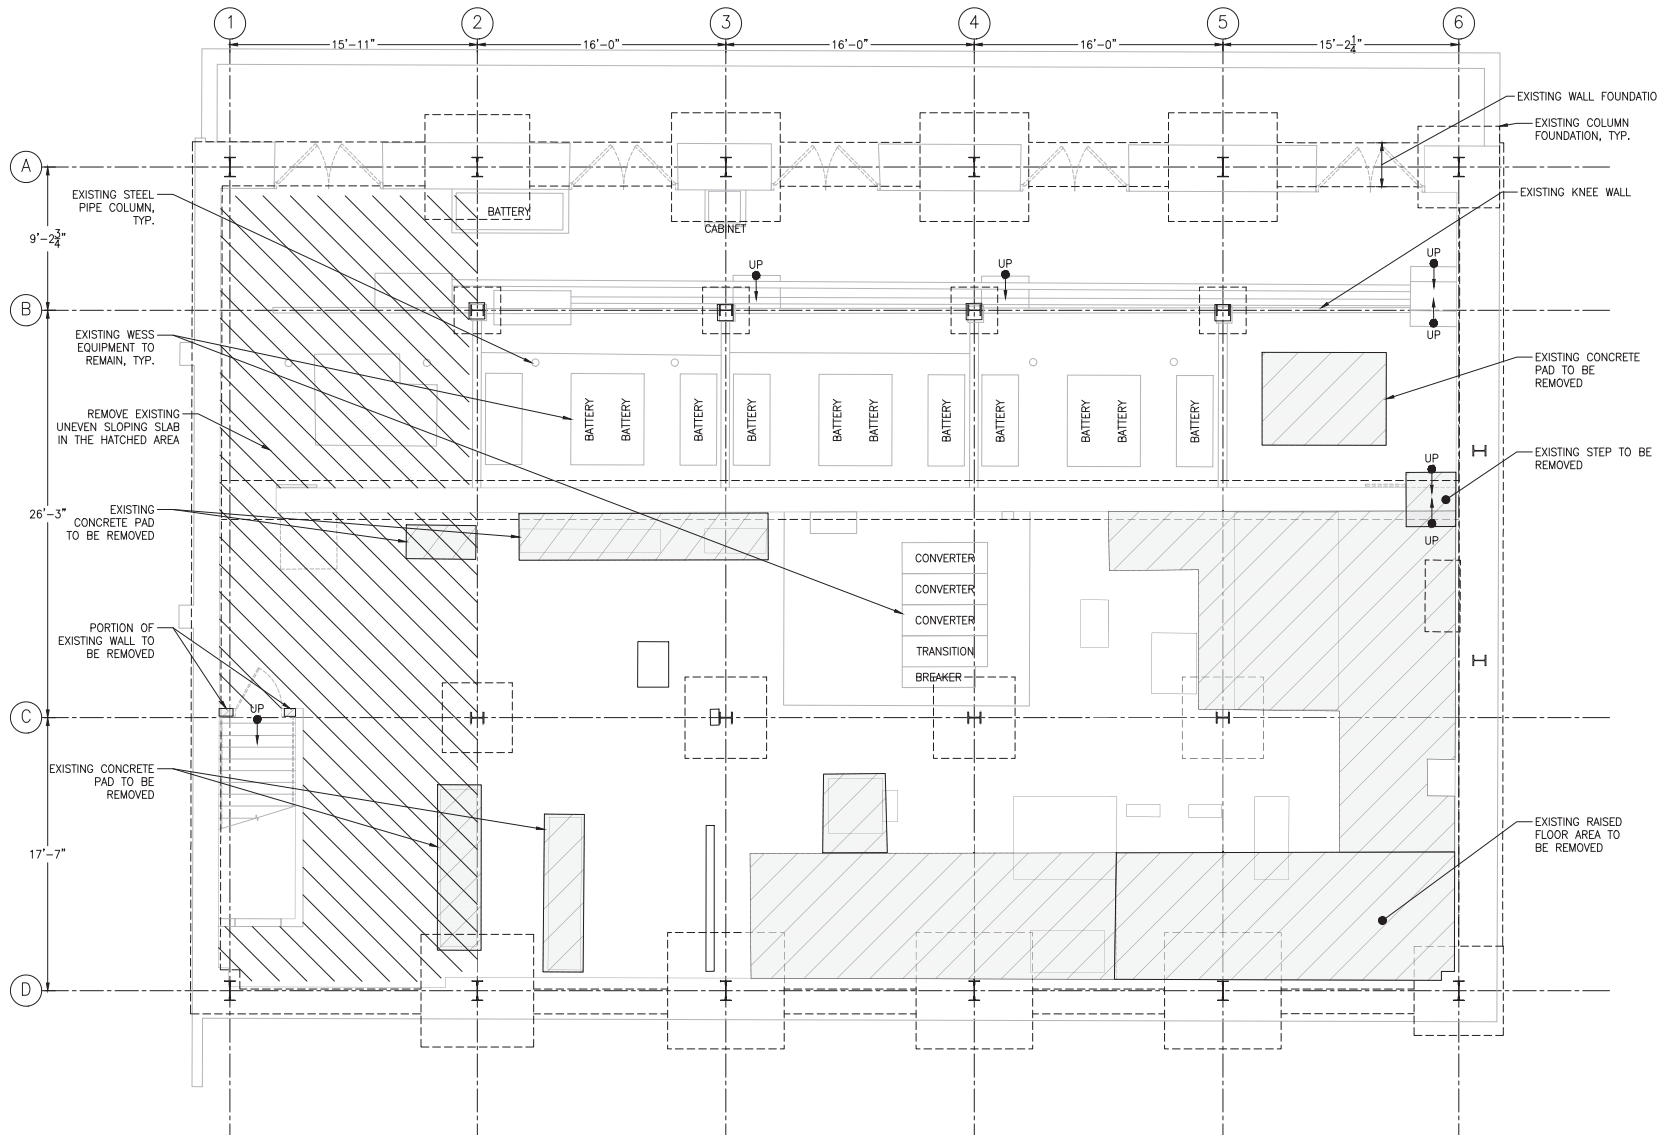


NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- SELECT DEMOLITION OF EXISTING CONCRETE EQUIPMENT PADS.
 - SELECT DEMOLITION OF EXISTING CONCRETE WALL.
 - DEMOLISH STAIRS.

EXISTING CONDITIONS & REMOVAL - BASEMENT

1/4" = 1'-0"



SCALE: 1/4" = 1'-0"

50% SUBMISSION
 NOT FOR CONSTRUCTION



1324 MARKET ST., 15TH FL.
 PHILADELPHIA, PA. 19107

SEPTA ENGINEER: DMC
 SEPTA BOARDING OFFICER: BSA
 SEPTA RAIL TRASH OFFICER:
 SEPTA SAFETY:
 SEPTA DIRECTOR OF ENGINEERING: BSA
 SEPTA GROUP ARCHITECT/ENGINEER:
 SEPTA PROJECT MANAGER:

HDR Engineering, Inc.
 Philadelphia, PA
 MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146-0
 16101 933-0123


NO.	DATE	BY	DESCRIPTION

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 EXISTING CONDITIONS & REMOVAL - BASEMENT

DATE: 08/22/2025
 SCALE FACTOR: 1/4" = 1'-0"
 DRAWN BY: JSA
 CHECKED BY: JSA
 PROJECT NUMBER: 276482
S201
 SHEET NO.: 2 OF 23
 SHEET NO.: 158 OF 452
 SHEET NO.:
 COMPUTER FILE NO.:
 17AN-S201

DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION

C:\PWORKING\PROJECTS\17AN-S202.DWG

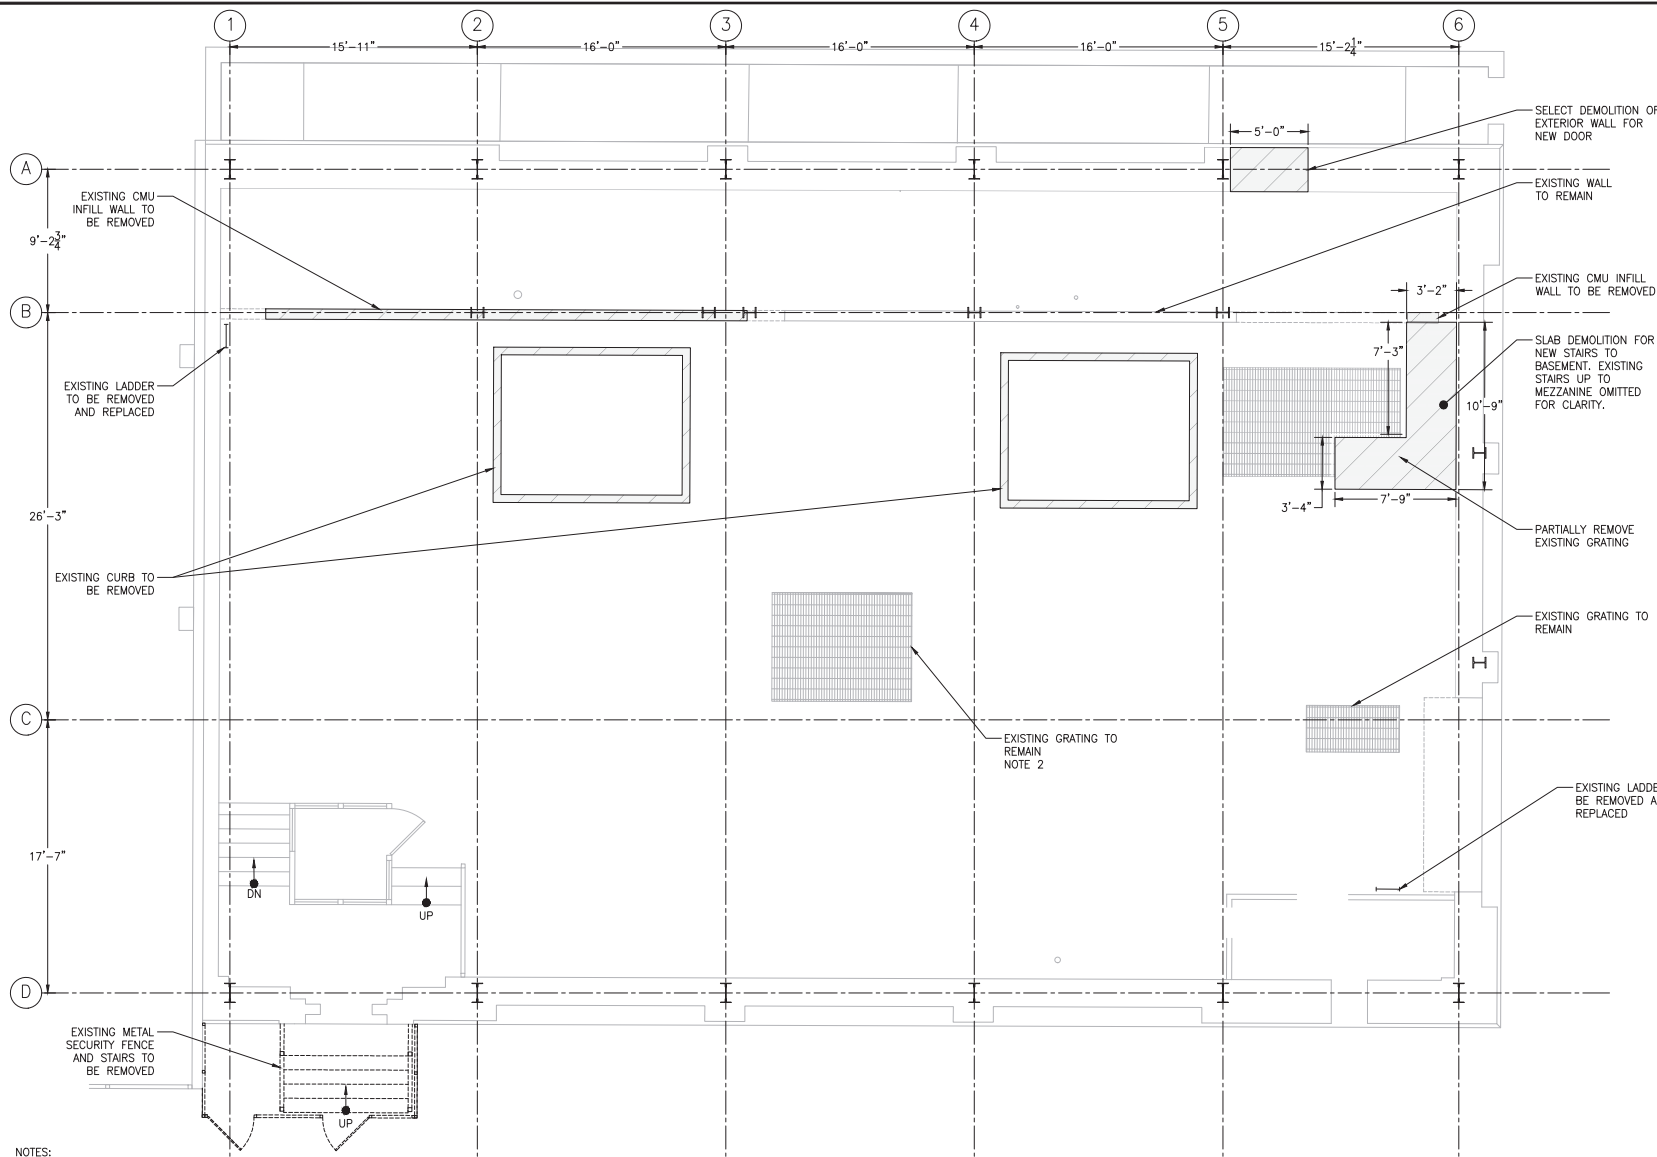

NOTES:


- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
- THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GRATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.

WORK ON THIS DRAWING:

- SELECT DEMOLITION OF EXISTING CONCRETE EQUIPMENT PADS AND CURBS.
- SELECT DEMOLITION OF EXISTING CMU INFILL WALL.
- SELECT DEMOLITION OF EXISTING FLOOR SLAB.
- REMOVE BEAM FOR NEW STAIRS TO BASEMENT.
- DEMOLISH STAIRS.

EXISTING CONDITIONS & REMOVAL - FIRST FLOOR

1/4" = 1'-0"



SCALE: 1/4" = 1'-0"

50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

DRP ENGINEER: DAC
 DRP ENGINEERING OFFICER: SBA
 DRP RAIL TRAFFIC OFFICER:
 DRP SAFETY:
 DIRECTOR OF ENGINEERING: SBA
 DRP/DRP ARCH/ENGINEERING:
 PROJECT NUMBER:

HDR
HDR Engineering, Inc.
Philadelphia, PA

MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146
16101 933-0123


NO.	DATE	BY	DESCRIPTION

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 EXISTING CONDITIONS & REMOVAL - FIRST FLOOR

SCALE: 1/4" = 1'-0"
 DATE: 08/22/2025
 DRAWN BY: SBA
 CHECKED BY: SBA
 PROJECT NUMBER: 276482
S202
 SHEET NO.: 3 OF 23
 DATE: 199 OF 452
 DRAWING FILE NO.: 17AN-S202

DATE PLOTTED: 10/19/2025 STATUS: 50% SUBMISSION


C:\PWORK\DRG\PROJECTS\17AN-S200.DWG

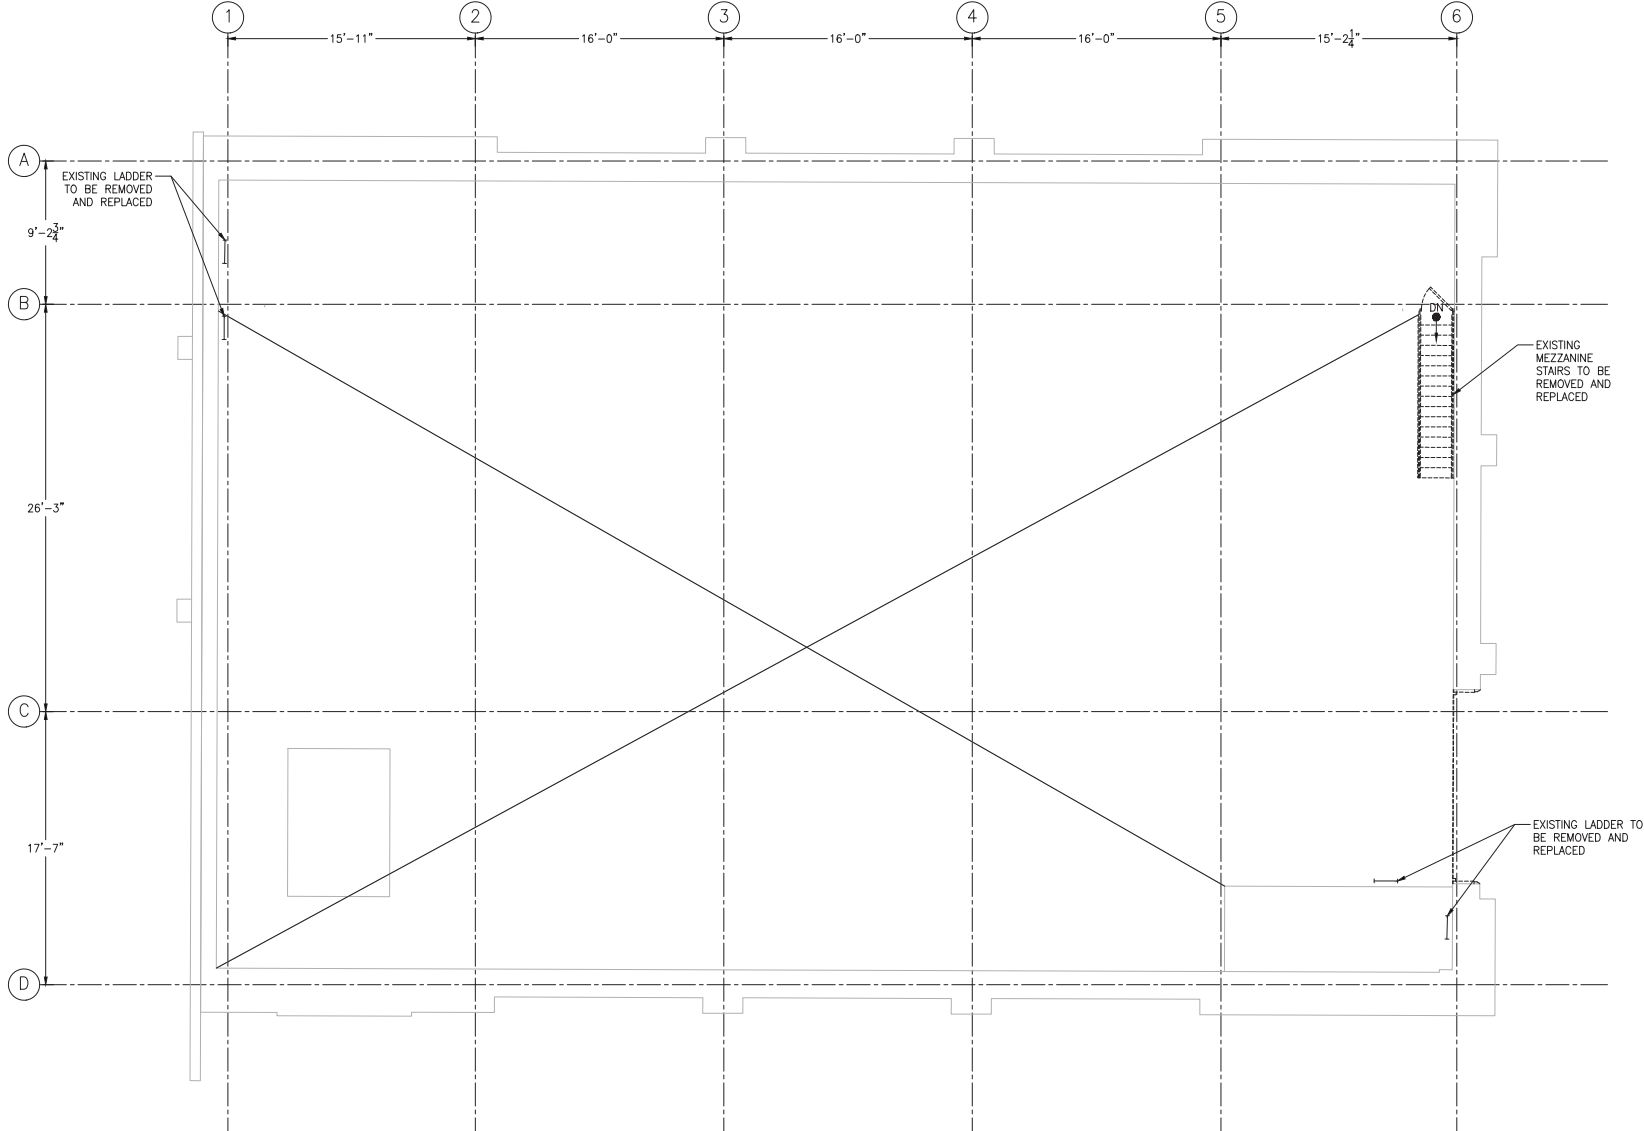

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
 WORK ON THIS DRAWING:
 • LADDER REMOVAL.

EXISTING CONDITIONS & REMOVAL - MEZZANINE

$\frac{1}{4}'' = 1'-0''$



50% SUBMISSION
 NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

SEPTA TRANSPORTATION AUTHORITY
 DMC DIVISION
 1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107


HDR
 HDR Engineering, Inc.
 Philadelphia, PA
 MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA 19146
 1610 933-0123

NO.	REV.	DATE	DESCRIPTION	BY	CHK	APP

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 EXISTING CONDITIONS & REMOVAL - MEZZANINE

DATE: 08/22/2025
 SCALE FACTOR: 1/4" = 1'-0"
 DRAWN BY: JSA
 CHECKED BY: JSA
 PROJECT NUMBER: 276482
S203
 SHEET NO.: 4 OF 23
 SHEET TITLE: 17AN-S203
 COMPUTER FILE NO.:
 REV. NO.:
 STATUS: 50% SUBMISSION

C:\PWORK\DRG\17AN\S204.DWG

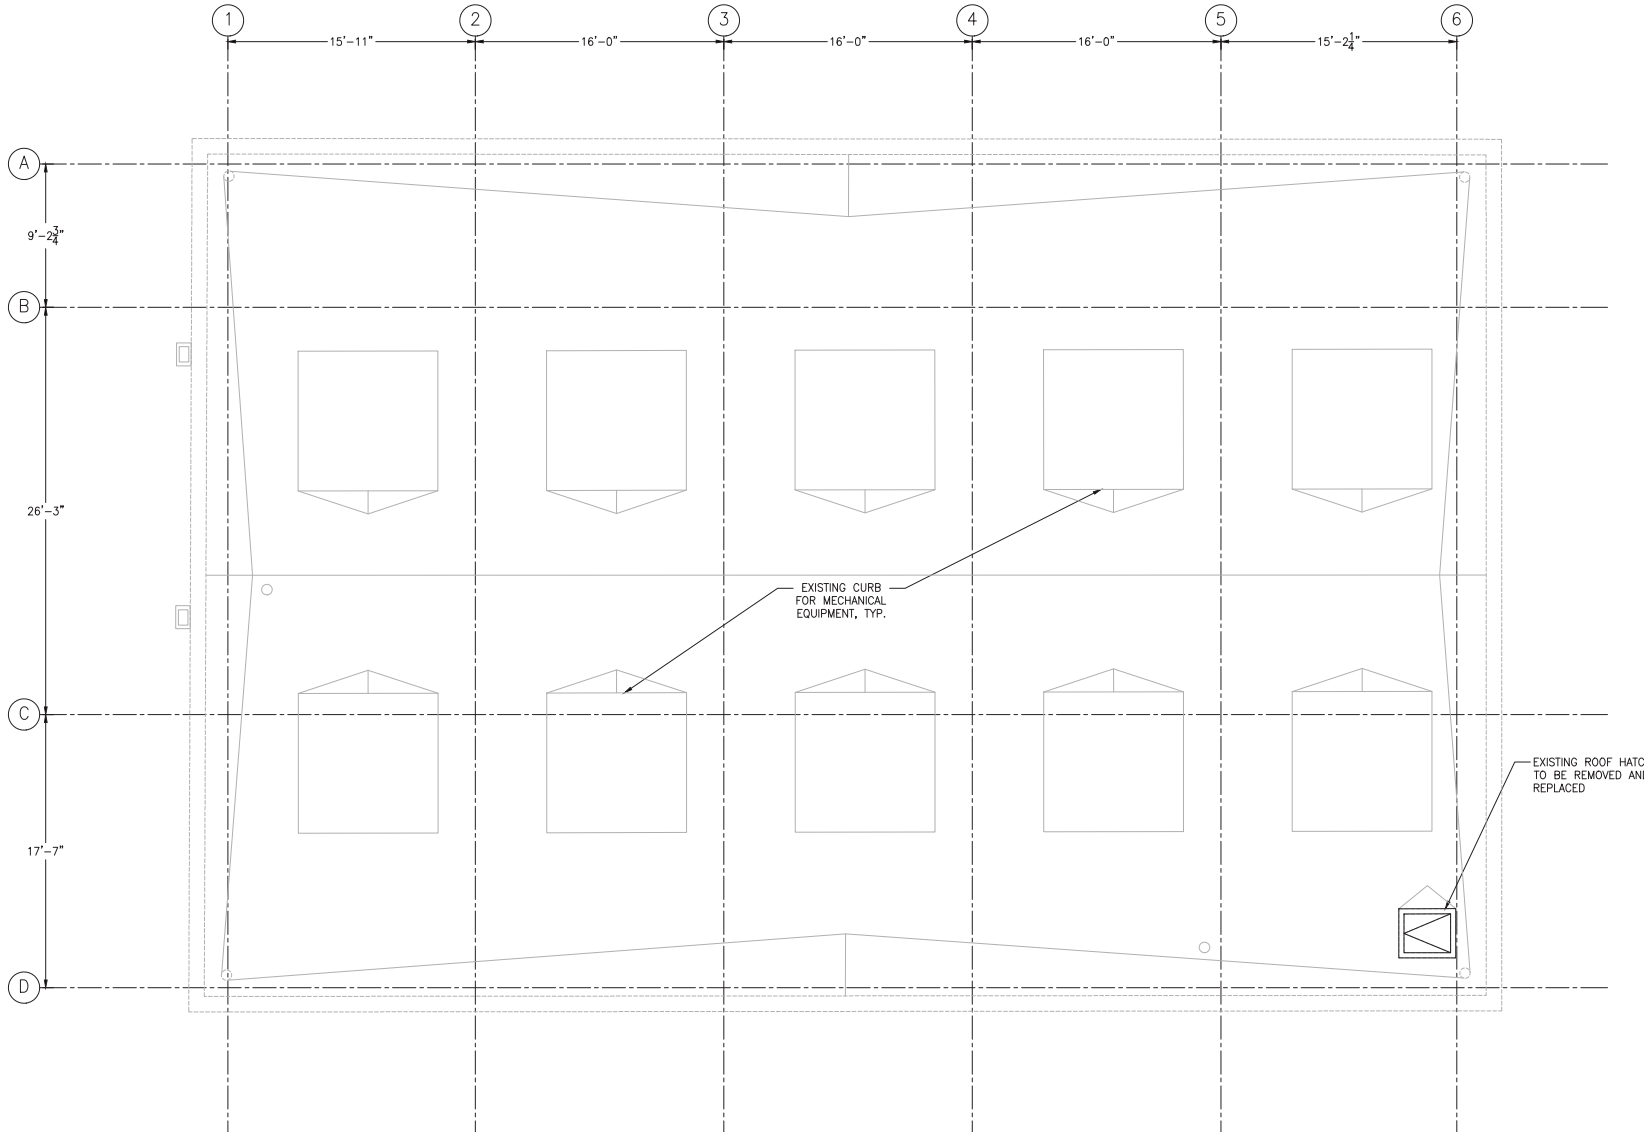


NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

WORK ON THIS DRAWING:
• REMOVE ROOF HATCH.

EXISTING CONDITIONS & REMOVAL - ROOF

1/4" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 19101 PHILADELPHIA, PA. 19107

SEPTA
SOUTHEASTERN
PIEDMONT AREA
TRANSPORTATION
AUTHORITY
DMC DIVISION

HDR Engineering, Inc.
Philadelphia, PA

MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146
1610 933-0123

NO.	REV.	DATE	DESCRIPTION	BY	CHK.	APP.

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
EXISTING CONDITIONS & REMOVAL - ROOF

DATE: 08/22/2025
SCALE FACTOR: 1/4" = 1'-0"


PROJECT NUMBER: 276482

S204

DWG NO. 5 OF 23
SHEET NO. 161 OF 452

COMPUTER FILE NO.: 17AN-S204
REV. NO.: -

DATE PLOTTED: 10/09/2025
STATUS: 50% SUBMISSION

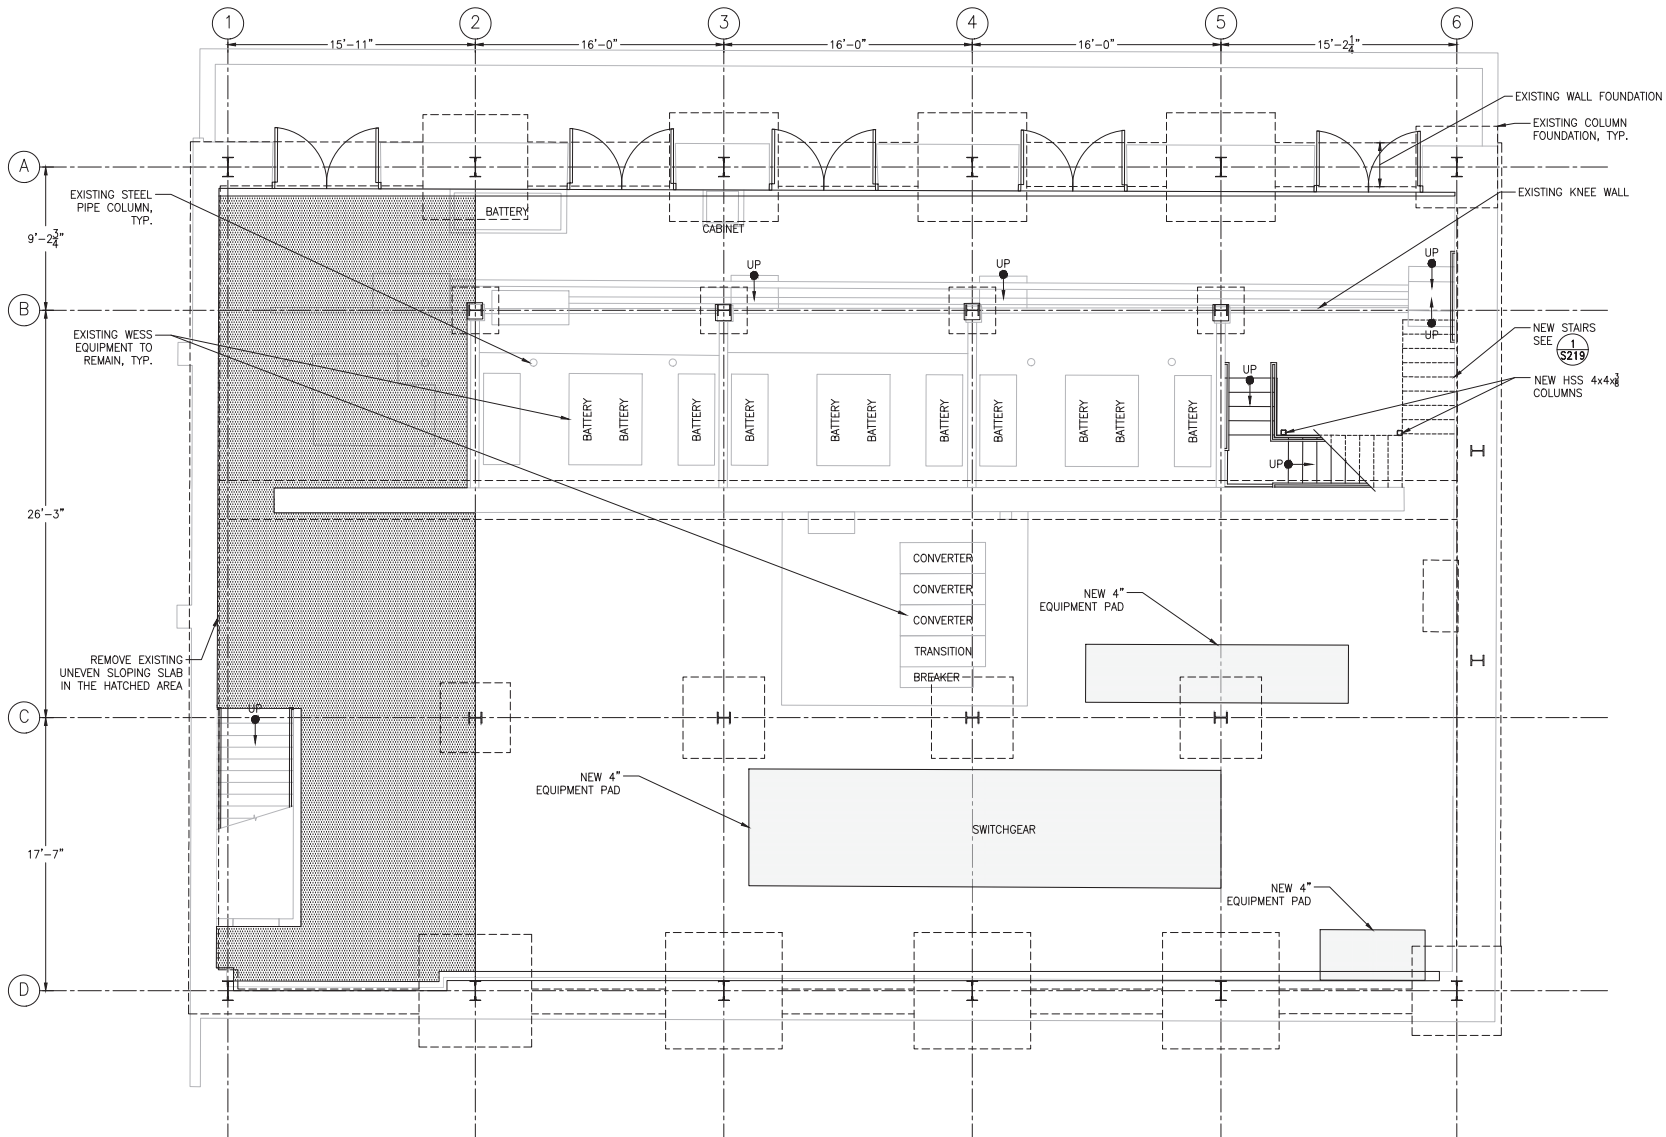

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- NEW CONCRETE EQUIPMENT PADS.
 - NEW HEADER FOR WALL OPENING.

PROPOSED BASEMENT PLAN

1/4" = 1'-0"



SCALE: 1/4" = 1'-0"

50% SUBMISSION
 NOT FOR CONSTRUCTION



1324 MARKET ST., 15TH FL.
 PHILADELPHIA, PA. 19107

DRP ENGINEER: EAC
DRP ENGINEERING OFFICE: SE
DRP RAIL TRACT OFFICER:
DRP STATION:
DRP PROJECT ENGINEER:
DRP PROJECT NUMBER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA


MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146-0
 16101 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 PROPOSED BASEMENT PLAN

DATE:	SCALE FACTOR:
1/4" = 1'-0"	
DATE:	DRAWN BY:
08/22/2025	
PROJECT NUMBER:	CHECKED BY:
276482	
PROJECT NUMBER:	
S205	
DATE:	
6 of 23	
DATE:	
162 of 452	
PROJECT NUMBER:	
17AN-S205	

C:\PWORK\PROJECTS\17AN-S206.DWG

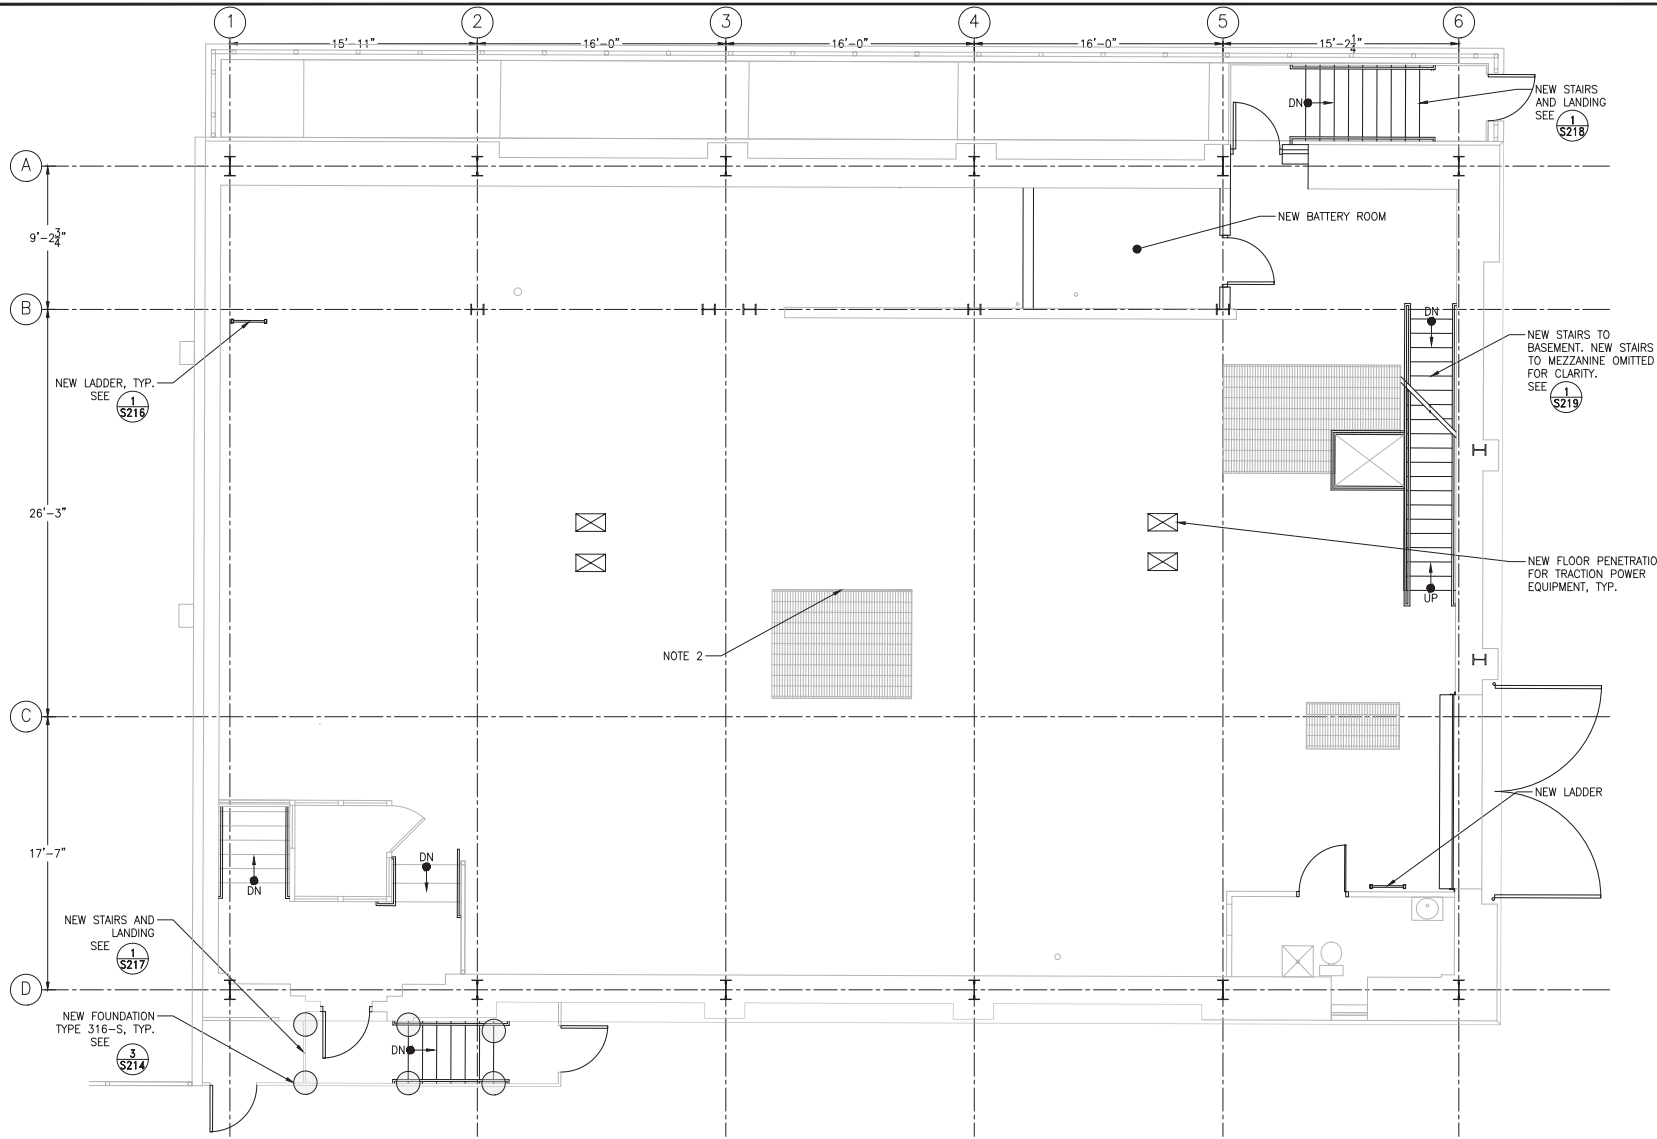

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
 - THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GRATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.

- WORK ON THIS DRAWING:
- NEW EXTERIOR STAIRS.
 - NEW INTERIOR STAIRS TO BASEMENT.
 - NEW STEEL BEAM.
 - NEW FLOOR PENETRATIONS.
 - NEW LADDERS.

FIRST FLOOR PLAN — PROPOSED

1/4" = 1'-0"

4 2 0 4

SCALE: 1/4" = 1'-0"

50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 15TH FL.
PHILADELPHIA, PA. 19107

SEPTA
1324 MARKET ST., 15TH FL.
PHILADELPHIA, PA. 19107

HDR Engineering, Inc.
Philadelphia, PA

MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA. 19146-0
1610 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
PROPOSED FIRST FLOOR PLAN

SCALE: 1/4" = 1'-0"
DATE: 08/22/2025
DRAWN BY: JSA
CHECKED BY: JSA


PROJECT NUMBER: 276482

S206

DWG NO.: 7 of 23
SHEET NO.: 163 of 452
PROJECT NO.: 17AN-S206

DATE PLOTTED: 10/19/2025
STATUS: 50% SUBMISSION

C:\PWORK\PROJECTS\17AN-S207.DWG

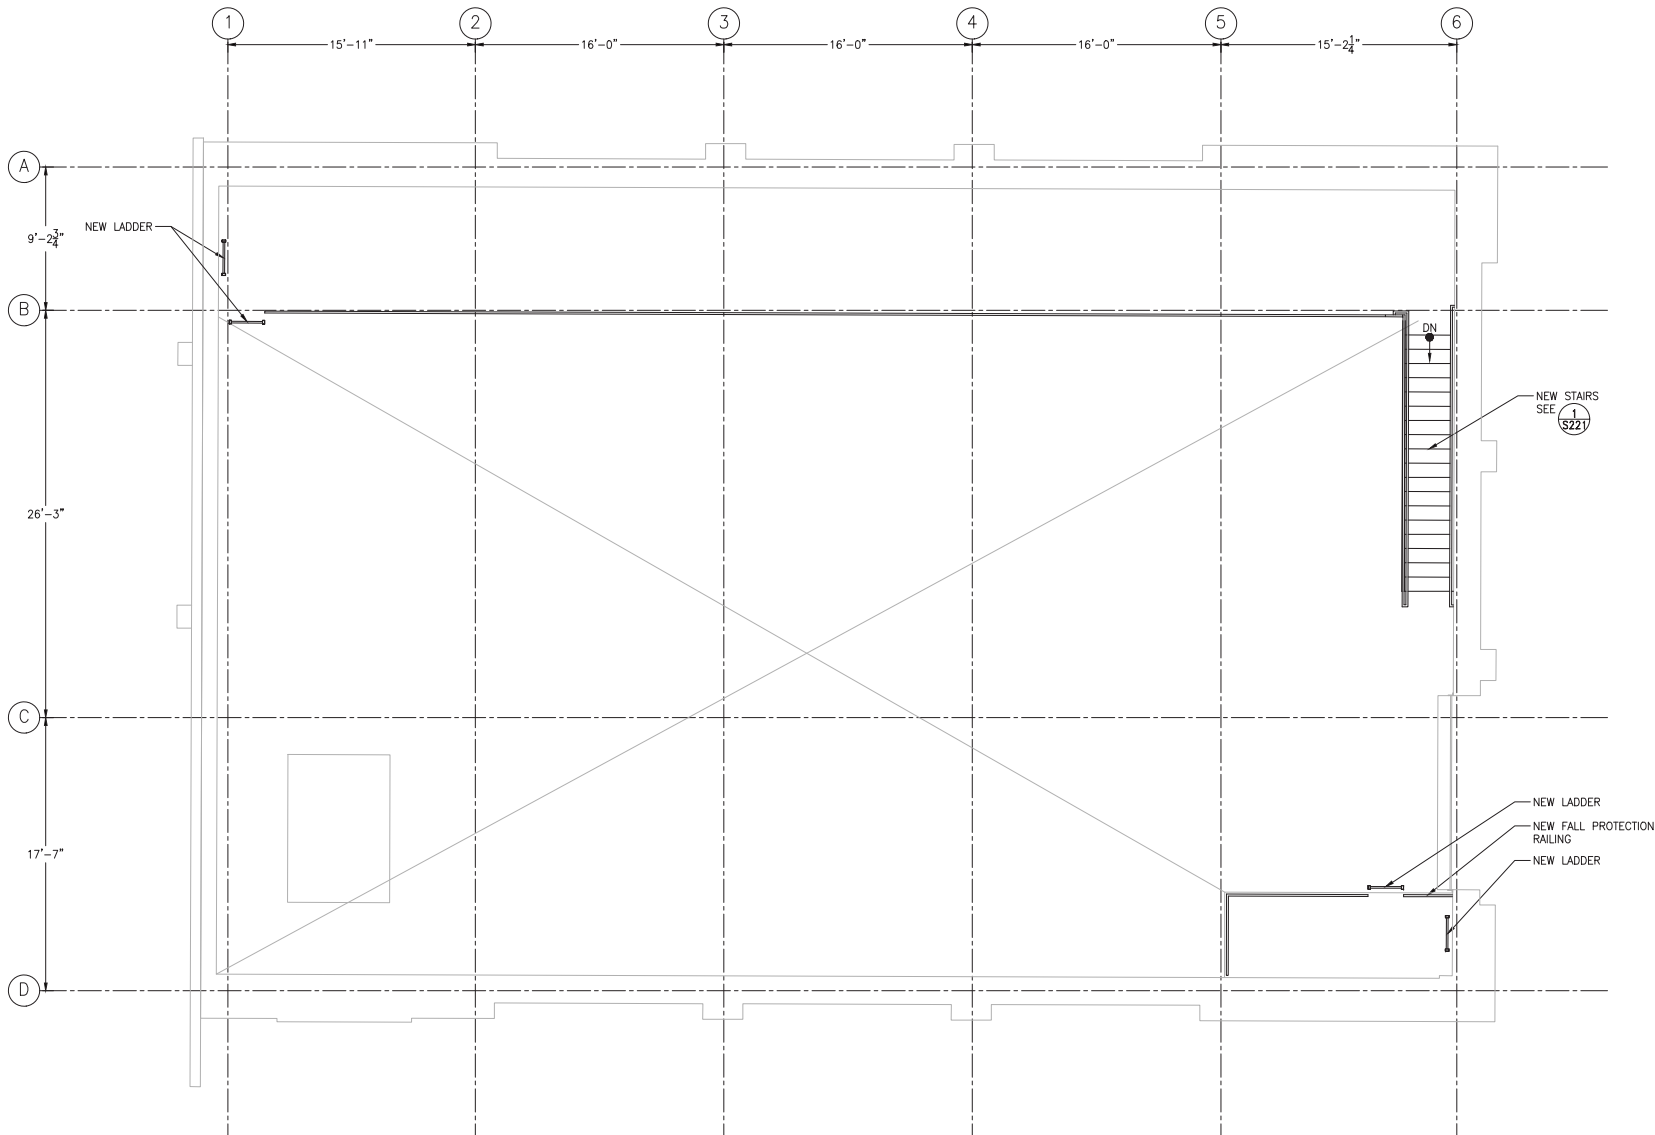

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- NEW LADDERS.
 - NEW STAIRS.

PROPOSED MEZZANINE PLAN

1/4" = 1'-0"



SCALE: 1/4" = 1'-0"

50% SUBMISSION
 NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

SEPTA
 DIRECTOR: DAVID L. BROWN
 DEPUTY DIRECTOR: JAMES J. HANCOCK
 CHIEF FINANCIAL OFFICER: JAMES J. HANCOCK
 CHIEF OPERATING OFFICER: JAMES J. HANCOCK
 CHIEF POLICE OFFICER: JAMES J. HANCOCK
 CHIEF TRAINING OFFICER: JAMES J. HANCOCK
 CHIEF TRANSPORTATION OFFICER: JAMES J. HANCOCK
 CHIEF UTILITIES OFFICER: JAMES J. HANCOCK
 CHIEF VEHICLE OFFICER: JAMES J. HANCOCK
 CHIEF WORKS OFFICER: JAMES J. HANCOCK



MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA 19146-0123
 (610) 933-0123

REV	DATE	DESCRIPTION	BY	APP'D

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 PROPOSED MEZZANINE PLAN

DATE: 08/22/2025
 DRAWN BY: JKH
 CHECKED BY: JKH

PROJECT NUMBER: 276482


S207

DWG NO: 8 of 23
 SHEET NO: 164 of 452
 REV NO: -

COMPUTER FILE NO: 17AN-S207

DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION


C:\P\WORKING\PROJECTS\17AN-S208.DWG

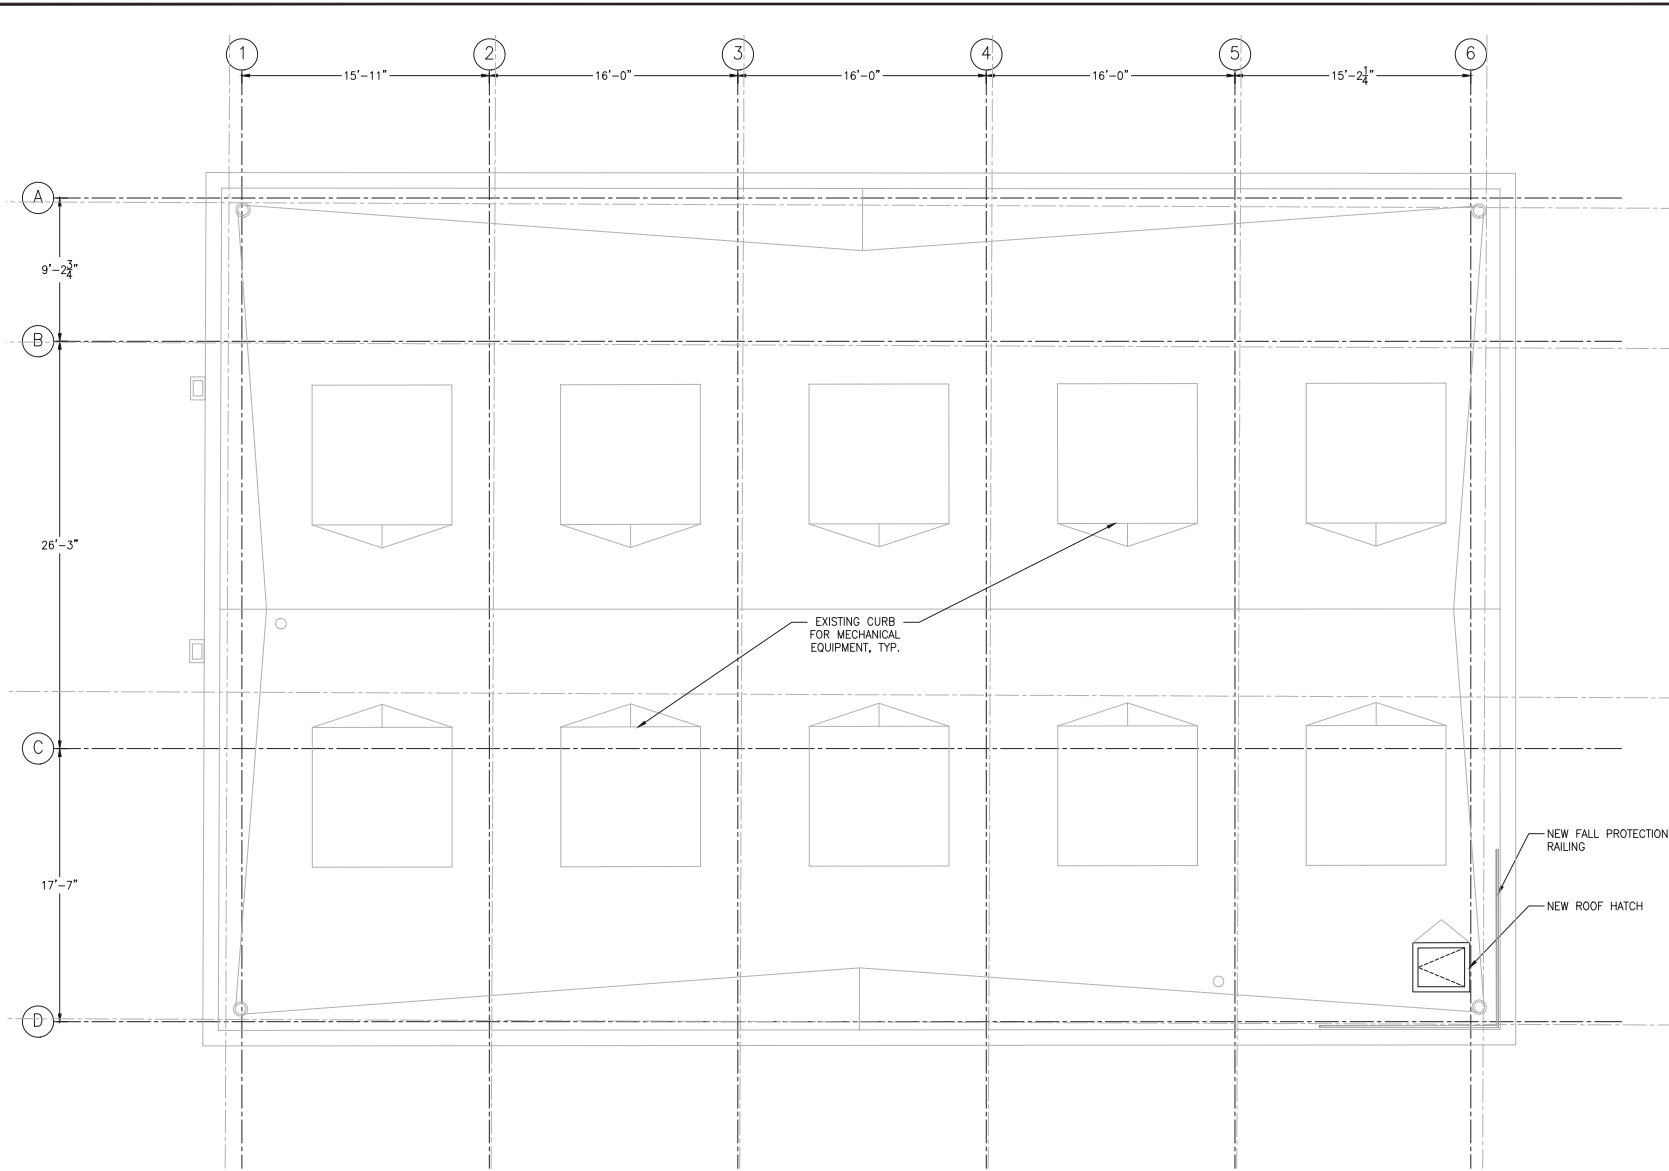

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- NEW FALL PROTECTION AT ROOF HATCH.
 - NEW ROOF HATCH.


PROPOSED ROOF PLAN
 $\frac{1}{4}'' = 1'-0''$



50% SUBMISSION
NOT FOR CONSTRUCTION

SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY DEPC DIVISION 1324 MARKET ST., 15TH FL. PHILADELPHIA, PA. 19107																																																																																					
CHIEF ENGINEER: DEAC CHIEF ENGINEERING OFFICER: SEE CHIEF RAIL TRAFFIC OFFICER FUTURE SPOUT DIRECTOR OF ENGINEERING: SEE MANAGER ARCHITECTURE: SEE PROJECT MANAGER	HDR Engineering, Inc. Philadelphia, PA MELISSA DESIGN 250 MORGAN STREET PHILADELPHIA, PA. 19146-0 (610) 933-0123																																																																																				
<table border="1"> <thead> <tr> <th>NO.</th> <th>REV.</th> <th>DATE</th> <th>DESCRIPTION</th> <th>BY</th> <th>CHK</th> <th>APP</th> </tr> </thead> <tbody> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> <tr><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td><td> </td></tr> </tbody> </table>	NO.	REV.	DATE	DESCRIPTION	BY	CHK	APP																																																																														DATE PLOTTED: 10/9/2025 PARK SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION STRUCTURAL PROPOSED ROOF PLAN
NO.	REV.	DATE	DESCRIPTION	BY	CHK	APP																																																																															
SCALE: $\frac{1}{4}'' = 1'-0''$ DATE: 08/22/2025 DRAWN BY: JSA CHECKED BY: JSA PROJECT NUMBER: 276482	SHEET NUMBER: S208 DRAWING NO: 9 of 23 SHEET NO: 165 of 452 ARCHIVE NO:																																																																																				
COMPUTER FILE NO: 17AN-S208 REV. NO: - STATUS: 50% SUBMISSION																																																																																					

C:\PWORK\ENR\PROJECTS\17AN-S209.DWG

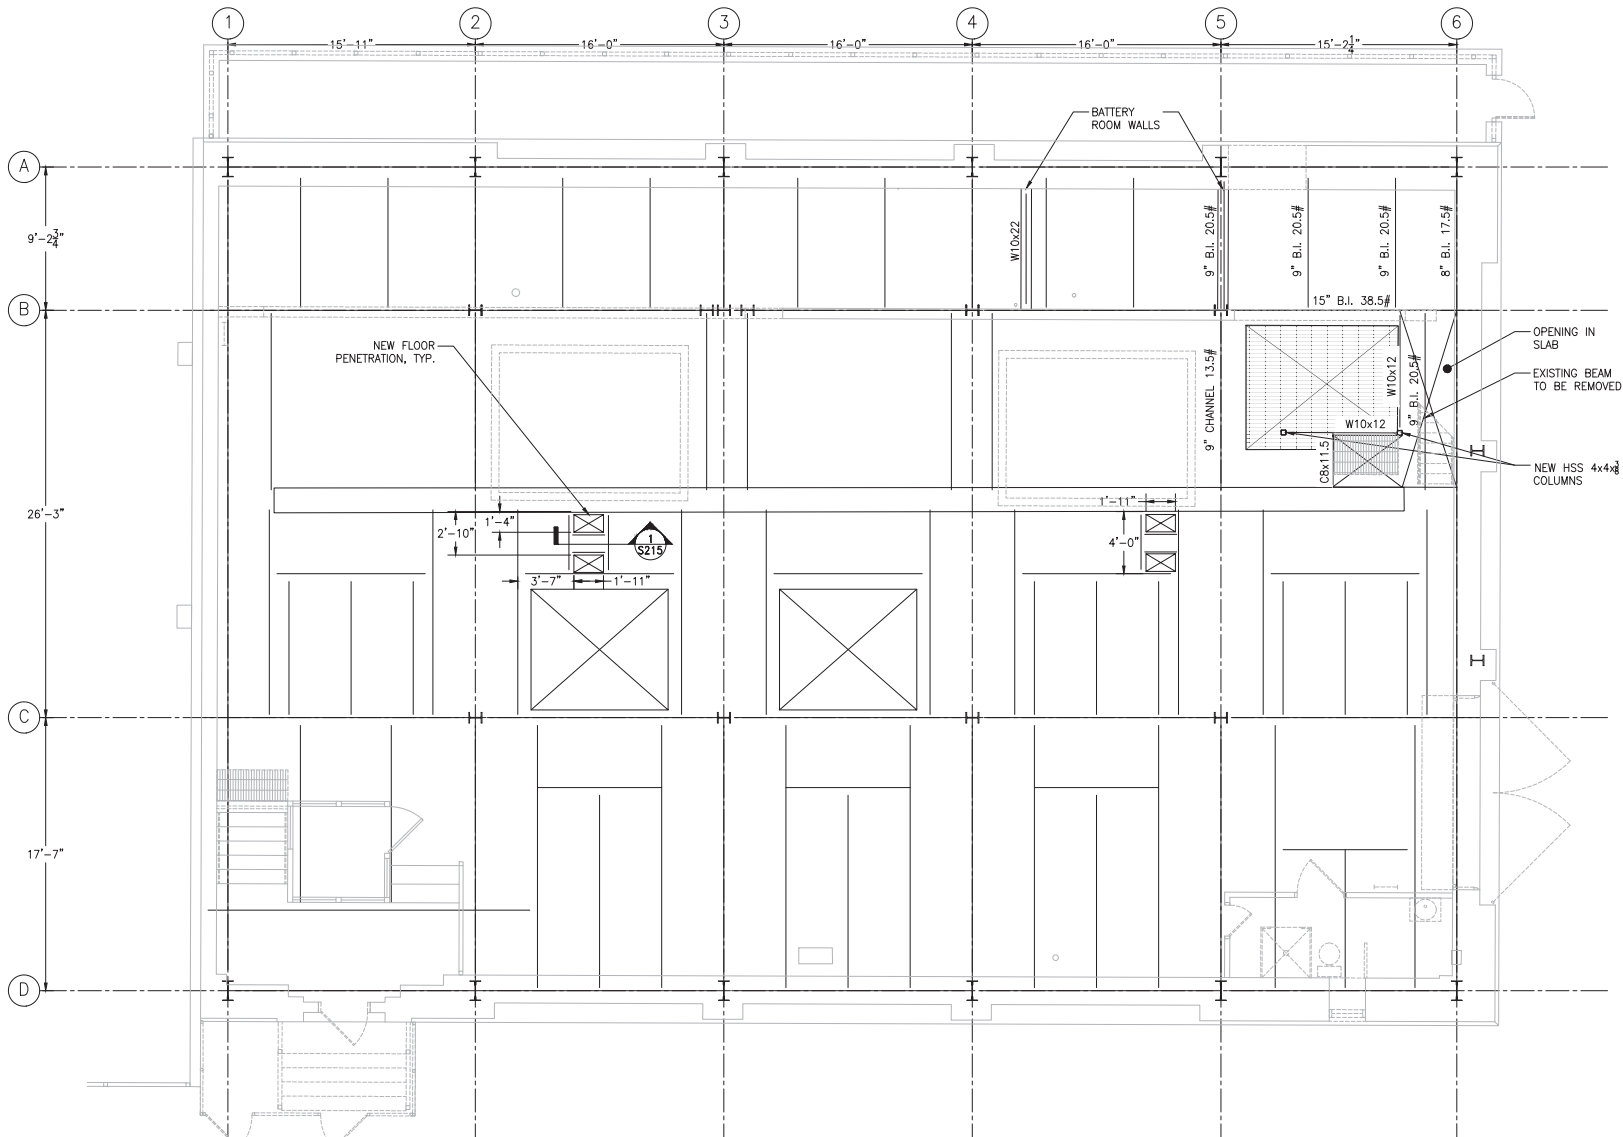

NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- REMOVE EXISTING BEAM.
 - NEW STEEL BEAMS.
 - NEW COLUMNS.

FIRST FLOOR FRAMING PLAN

1/4" = 1'-0"



SCALE: 1/4" = 1'-0"

50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA 19107

SEPTA ENGINEER: ENR
SEPTA ENGINEERING OFFICE: ENR
SEPTA RAIL TRACTOR OFFICE: ENR
SEPTA PROJECT OFFICE: ENR
SEPTA PROJECT OFFICE: ENR
SEPTA PROJECT OFFICE: ENR
SEPTA PROJECT OFFICE: ENR


HDR Engineering, Inc.
Philadelphia, PA
MELIGRA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146-0
1610 933-0123

REV	DATE	DESCRIPTION	BY	APP'D

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
FIRST FLOOR FRAMING PLAN

DATE: 08/22/2025
SCALE FACTOR: 1/4" = 1'-0"
DRAWN BY: ENR
CHECKED BY: ENR
PROJECT NUMBER: 276482
S209
SHEET NO.: 10 OF 23
DATE: 08/22/2025
DRAWN BY: ENR
CHECKED BY: ENR
PROJECT NUMBER: 276482
COMPUTER FILE NO.: 17AN-S209
STATUS: 50% SUBMISSION


C:\PWORK\DRG\PROJECTS\17AN-S210\17AN-S210.DWG

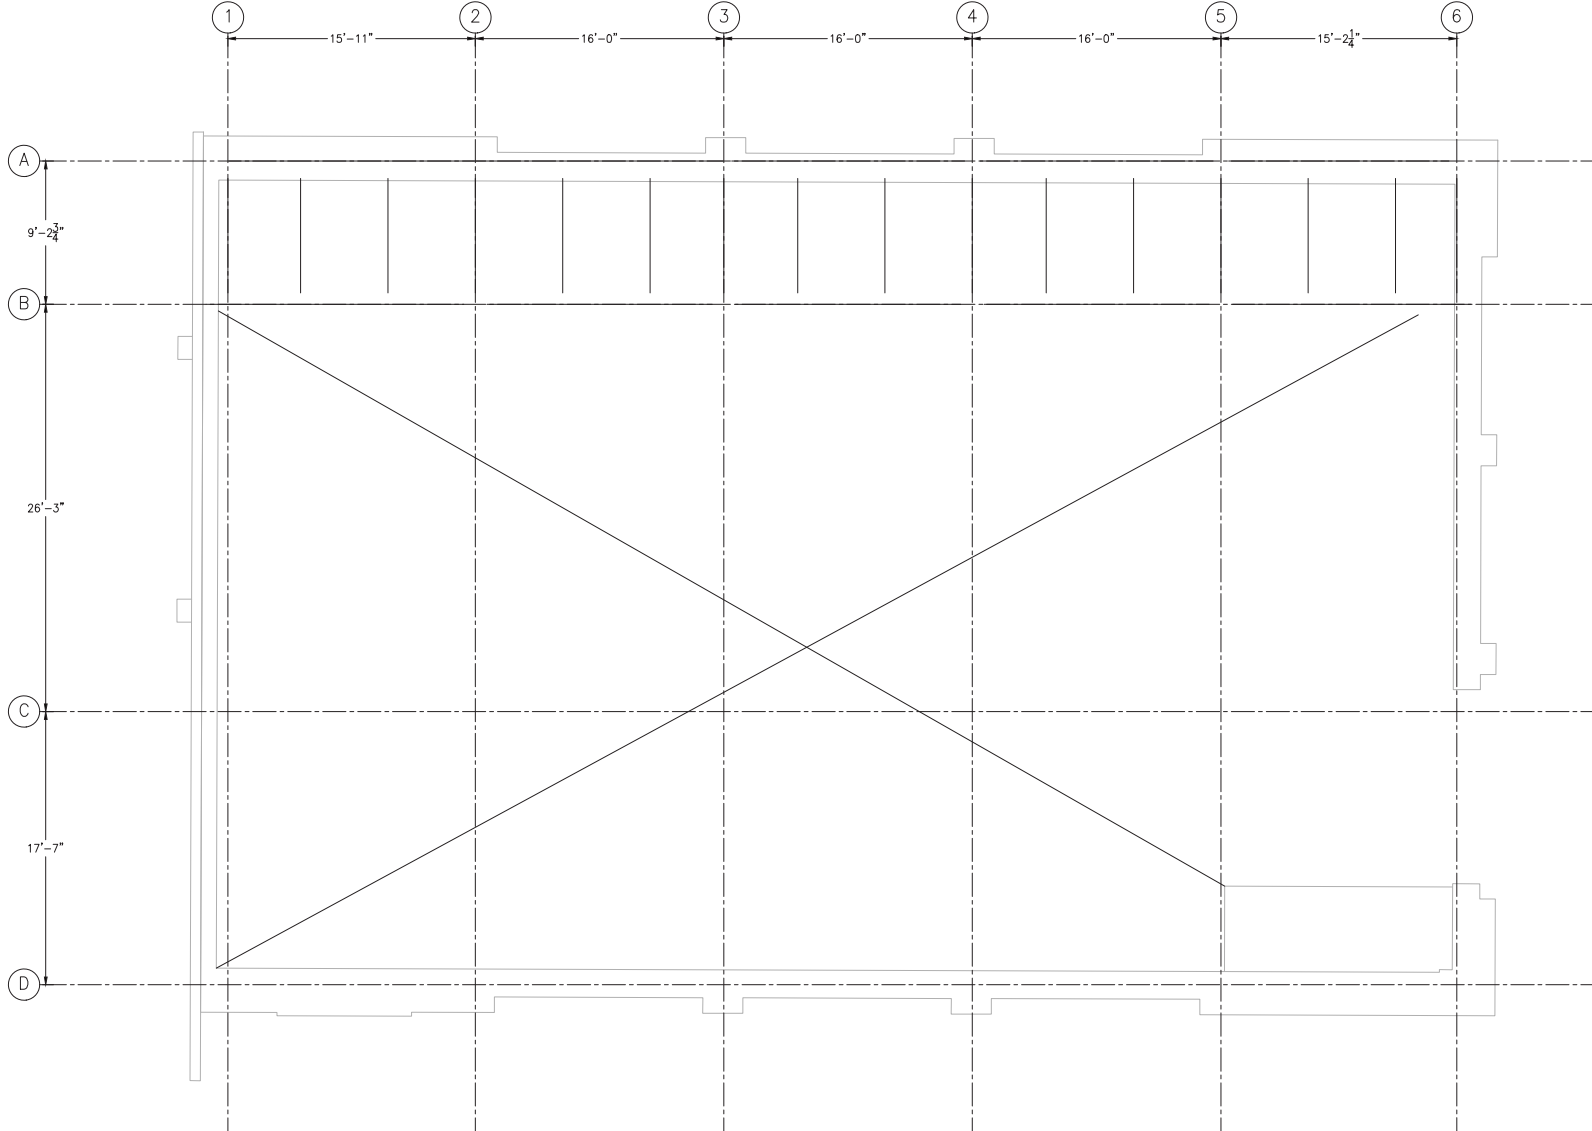

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

WORK ON THIS DRAWING:
 • NONE.

MEZZANINE FRAMING PLAN
 $\frac{1}{4}'' = 1'-0''$



50% SUBMISSION
 NOT FOR CONSTRUCTION



1324 MARKET ST., 19TH FL.
 PHILADELPHIA, PA. 19107

SEPTA
 SOUTHEASTERN PIEDMONT AREA TRANSPORTATION AUTHORITY
 DRAC DIVISION

HDR
 HDR Engineering, Inc.
 Philadelphia, PA
MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146
 1610 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 MEZZANINE FRAMING PLAN

SCALE: 1/4" = 1'-0"
 DATE: 08/22/2025
 DRAWN BY: JSA
 CHECKED BY: JSA
 PROJECT NUMBER: 276482
S210
 SHEET NO.: 11 OF 23
 DATE: 167 OF 452
 DRAWING FILE NO.: 17AN-S210
 SHEET NO.: -

DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION


DRP NUMBER:	DBA:
DRP NUMBERING OFFICER:	DBA:
DRP RAIL TRACT OFFICER:	
DRP PROJECT:	
DIRECTOR OF OPERATIONS:	
INSPECTOR (NOT FOR RECORDING):	
PROJECT NUMBER:	

HDR Engineering, Inc.
 Philadelphia, PA
 MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA 19146-0
 (610) 933-0123


REV	DATE	DESCRIPTION	BY	APP'D

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 CONCRETE REPAIR DETAILS - SHEET 1


DATE:	AS NOTED	SCALE/FACED:	
DATE:	08/22/2025	DRAWN BY:	DBA
DATE:		CHECKED BY:	DBA
PROJECT NUMBER:	276482		
S211			
DATE:	12 of 23		
DATE:	188 of 452		
DATE:			
DATE:			

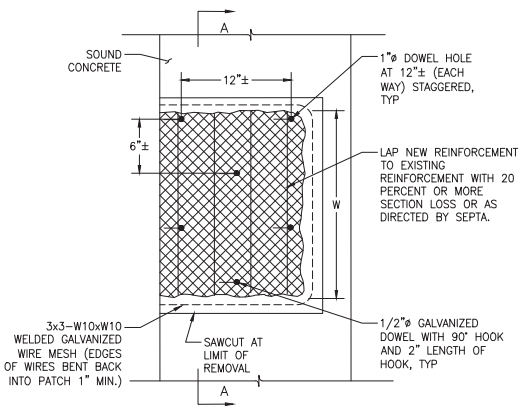


ELEVATION VIEW

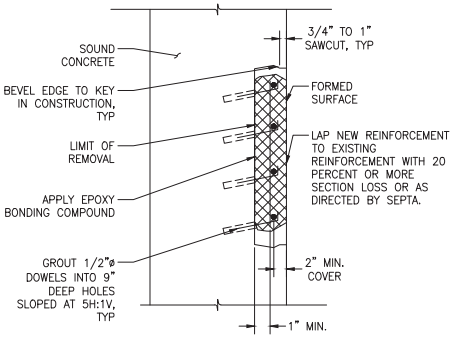

SECTION A-A
 NEW REINFORCEMENT

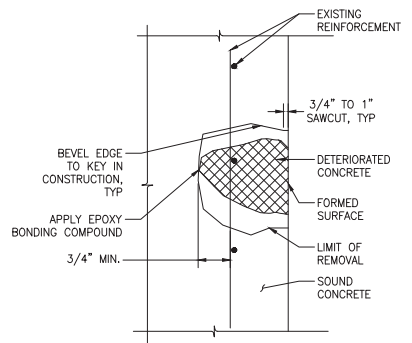

SECTION A-A
 EXISTING REINFORCEMENT

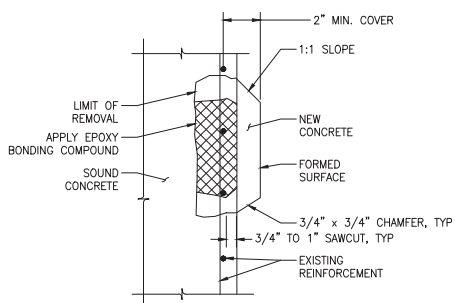

SECTION A-A
 BLISTER DETAIL

1 CONCRETE REPAIR TYPE 2
 SCALE: N.T.S.

NOTE:

REPAIR TYPE 2 IS USED WHEN DEPTH OF DETERIORATED CONCRETE IS GREATER THAN 3/4" AND EXISTING REINFORCEMENT SPACED ≤ 12" ON CENTERS. OTHERWISE USE REPAIR TYPE 2A.

NOTE:

CONCRETE REPAIR TYPE 2 DETAIL FOR AREAS WITH EXISTING REINFORCEMENT HAVING LESS THAN 2" OF COVER.

REINFORCED CONCRETE REPAIR TYPE 2 NOTES:


- SQUARE OFF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MINIMUM TO 1" MAXIMUM BUT NOT TO THE DEPTH OF THE REINFORCEMENT STEEL. BACK BEVEL EDGE BEYOND SAWCUT.
- USE HAND TOOLS TO REMOVE ALL LOOSE AND DELAMINATED CONCRETE THAT PROVIDES A SOUND BOND BETWEEN EXISTING CONCRETE AND NEW CONCRETE. PNEUMATIC HAMMERS WITH IMPACT RATINGS OF 3 FT-LBS OR LESS MAY BE USED IF REQUIRED.
- IF DETERIORATED CONCRETE EXTENDS BEYOND THE PRIMARY REINFORCEMENT, REMOVE THE CONCRETE TO AT LEAST 3/4" BEHIND THE REINFORCEMENT.
- APPLY AN EPOXY BONDING COMPOUND BETWEEN THE EXISTING AND THE NEW CLASS A CEMENT CONCRETE.
- "W" REPRESENTS LEAST DIMENSION OF DETERIORATED CONCRETE.
- USE DOWELS ONLY WHEN "W" DIMENSION OF DETERIORATED CONCRETE IS GREATER THAN 2'-0" AND NEW OR EXISTING REINFORCEMENT CANNOT ADEQUATELY BE DEVELOPED BY LAPPING WITH EXISTING REINFORCEMENT.
- USE A PACHOMETER TO LOCATE EXISTING REINFORCEMENT WHEN DRILLING DOWEL HOLES TO AVOID DRILLING THRU EXISTING BARS.
- AN APPROVED EPOXY ANCHORING SYSTEM IN 90° HOLES MAY REPLACE GROUT IN SLOPED HOLES. USE A 6" MINIMUM EMBEDMENT AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- A #4 DEFORMED REINFORCEMENT BENT "L" BAR MAY REPLACE THE 1/2" DIAMETER DOWEL HOOK.
- ALTERNATE WIRE MESH MAY BE SUBSTITUTED FOR 3x3-W10xW10, PROVIDED WIRE SPACING DOES NOT EXCEED 4" AND AN EQUIVALENT STEEL AREA IS PROVIDED. NEW REINFORCEMENT BARS MAY BE OMITTED IF WIRE MESH STEEL AREA EXCEEDS EXISTING REINFORCEMENT.
- CLEAN EXISTING REINFORCEMENT BY MECHANICAL MEANS.
- LAP EQUIVALENT NEW REINFORCEMENT TO THE EXISTING REINFORCEMENT AS DIRECTED.
- REINFORCEMENT BARS TO BE GALVANIZED.

NOTES:


1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

WORK ON THIS DRAWING:

- CONCRETE REPAIRS.

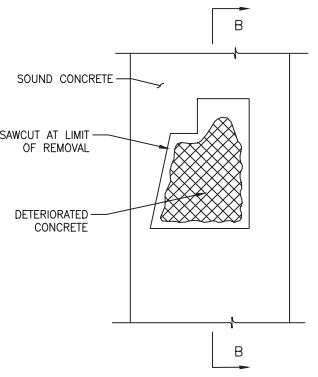

ELEVATION VIEW

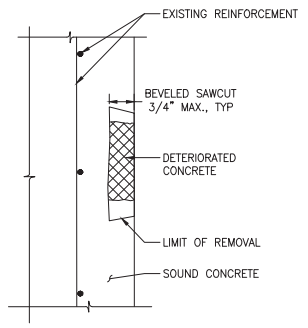

SECTION B-B

2 CONCRETE REPAIR TYPE 1
 SCALE: N.T.S.

NOTE:

REPAIR TYPE 1 IS USED WHEN DEPTH OF DETERIORATED CONCRETE IS LESS THAN EQUAL TO 3/4".

REINFORCED CONCRETE REPAIR TYPE 1 NOTES:

- SQUARE OFF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MAXIMUM.
- REMOVE ALL LOOSE AND DELAMINATED CONCRETE TO PROVIDE A SOUND BOND BETWEEN EXISTING CONCRETE AND PATCHING.
- APPLY A RAPID HARDENING CONCRETE PATCHING MATERIAL FROM AN APPROVED MANUFACTURER AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

LEGEND

REMOVE DETERIORATED CONCRETE

50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PLOTTED: 10/9/2025

STATUS: 50% SUBMISSION

DRP NUMBER: DMC	
DRP DRAWING OFFICE: SRA	
DRP RAIL TRACT OFFICE:	
PROJECT ID#:	
DIRECTOR OF DRAWING: SRA	
DESIGNER/ARCHITECT/ENGINEER:	
PROJECT NUMBER:	




NO.	REV	DATE	DESCRIPTION	BY	APP'D

DATE PLOTTED: 10/9/2025

DATE: AS NOTED	SCALE/FACOR:
DATE: 08/22/2025	DRAWN BY: MJD
WORK ORDER NO.: 276482	CHECKED BY: JJA
SHEET NUMBER	S212
DWG. NO.: 13 OF 23	
DATE: 10/9/2025	
PROJECT NO.: 17AN-S212	

50% SUBMISSION
 NOT FOR CONSTRUCTION

STATUS 50% SUBMISSION

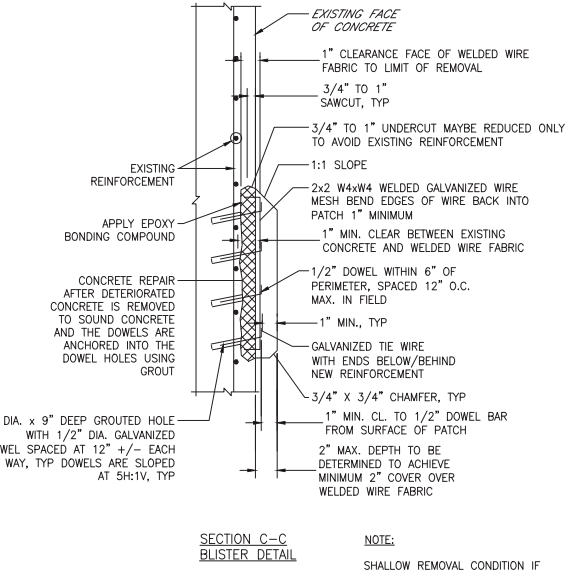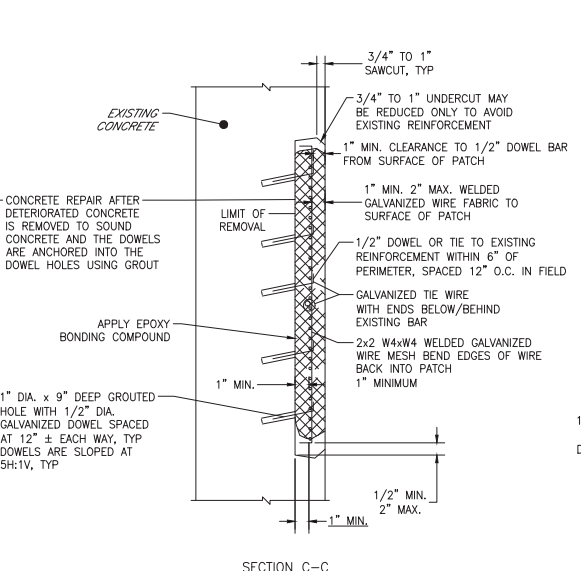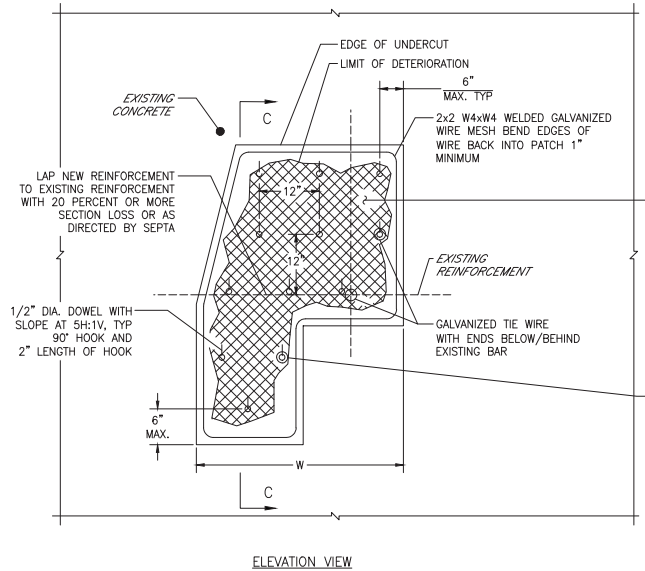


NOTE:
 SHALLOW REMOVAL CONDITION IF PATCH CANNOT ENGAGE EXISTING REINFORCEMENT.

1 CONCRETE REPAIR TYPE 2A
 SCALE: N.T.S.

REINFORCED CONCRETE REPAIR TYPE 2A NOTES:

- REPAIR TYPE 2A IS USED WHEN DEPTH OF DETERIORATION IS GREATER THAN 3/4" AND EXISTING REINFORCEMENT IS SPACED GREATER THAN 12" ON CENTER.
- PROVIDE GALVANIZED WIRE TIE TO CONNECT EXISTING REINFORCEMENT AND GALVANIZED 2x2 W4xW4 WELDED WIRE MESH ALONG THE PERIMETER OF THE REMOVAL AREA AT A MAXIMUM SPACING OF 6" FROM THE EDGE OF THE REMOVAL. PROVIDE TIES AT 12" SPACING IN BOTH HORIZONTAL AND VERTICAL DIRECTIONS ALONG THE PERIMETER AND WITHIN THE AREA OF REMOVAL. IF EXISTING REINFORCEMENT IS SPACED AT GREATER THAN 12" SPACING OR NOT LOCATED TO PROVIDE THE LOCATIONS AS LISTED ABOVE, PROVIDE 1/2" GROUDED DOWELS AS SHOWN ON THE DRAWING TO PROVIDE THE LOCATIONS AT THE SAME SPACINGS.
- USE ONLY AN APPROVED POLYMER MODIFIED AND SPECIAL CEMENTS, MORTARS AND CONCRETES AS LISTED IN THE SPECIFICATIONS.
- SQUARE OF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MINIMUM TO 1" MAXIMUM BUT NOT TO THE DEPTH OF THE REINFORCEMENT STEEL BACK BEVEL EDGE BEYOND SAWCUT.
- USE HAND TOOLS TO REMOVE ALL LOOSE AND DELAMINATED CONCRETE TO PROVIDE A SOUND BOND BETWEEN EXISTING CONCRETE AND NEW CONCRETE. PNEUMATIC HAMMER WITH IMPACT RATINGS OF 3 FT-LBS OR LESS MAY BE USED IF REQUIRED.
- IF DETERIORATED CONCRETE EXTENDS BEYOND THE PRIMARY REINFORCEMENT, REMOVE THE CONCRETE TO AT LEAST 1" BEHIND THE REINFORCEMENT.
- APPLY AN EPOXY BONDING COMPOUND BETWEEN THE EXISTING AND THE NEW 4000 PSI CONCRETE.
- "W" REPRESENTS LEAST DIMENSION OF DETERIORATED CONCRETE.
- USE DOWELS ONLY WHEN "W" DIMENSION OF DETERIORATED CONCRETE IS GREATER THAN 2'-0" AND NEW OR EXISTING REINFORCEMENT CANNOT ADEQUATELY BE DEVELOPED BY LAPPING WITH EXISTING REINFORCEMENT.
- USE A PACHOMETER TO LOCATE EXISTING REINFORCEMENT WHEN DRILLING DOWEL HOLES TO AVOID DRILLING THRU EXISTING BARS.
- AN APPROVED EPOXY ANCHORING SYSTEM IN 90° HOLES MAY REPLACE GROUT IN SLOPED HOLES. USE A 6" MINIMUM EMBEDMENT AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- A #4 DEFORMED GALVANIZED REINFORCEMENT BENT "L" BAR MAY REPLACE THE 1/2" DIAMETER DOWEL HOOK.
- ALTERNATIVE WIRE MESH MAY BE SUBSTITUTED FOR 2x2-W4xW4, PROVIDED WIRE SPACING DOES NOT EXCEED 4", AND AN EQUIVALENT STEEL AREA IS PROVIDED. NEW REINFORCEMENT BARS MAY BE OMITTED IF WIRE MESH STEEL EXCEEDS EXISTING REINFORCEMENT.
- CLEAN EXISTING REINFORCEMENT BY MECHANICAL MEANS AND APPLY EPOXY COATING.
- LAP EQUIVALENT NEW REINFORCEMENT TO THE EXISTING REINFORCEMENT AS DIRECTED.
- EXISTING AND NEW REINFORCEMENT BARS AND WELDED WIRE MESH TO BE GALVANIZED.

LEGEND




- NOTES:**
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
- WORK ON THIS DRAWING:**
- CONCRETE REPAIRS.


C:\PWS\ORIG\PROJECTS\17AN-S212\17AN-S212.DWG

NO.	DATE	BY	APP'D	DESCRIPTION

(FOR VERTICAL SURFACES)



PLAN VIEW

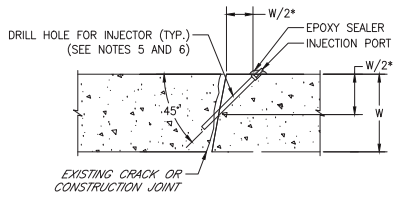


SECTION D-D

1 TYPE 3 CRACK INJECTION REPAIR DETAIL
S213 SCALE:N.T.S.


CRACK INJECTION REPAIR NOTES:

1. IN THE PRESENCE OF THE SEPTA PROJECT MANAGER, INSPECT AND DOCUMENT CONCRETE SURFACES FOR EXTENT, TYPE AND LOCATION OF CONCRETE CRACK REPAIRS.
2. THIS DETAIL APPLIES AT ALL VISIBLE ACTIVE (I.E. SHOWING EVIDENCE OF SEEPAGE OR LEAKAGE) AND INACTIVE CRACKS IN OVERHEAD SLABS AND VERTICAL WALL SURFACES AND AT ALL ACTIVE CONSTRUCTION JOINTS.
3. DIMENSIONS SHOWN WITH AN ASTERISK (*) SHALL BE ADJUSTED AS REQUIRED TO PREVENT DAMAGE TO EXISTING REINFORCING BARS.
4. DRILL HOLE SIZE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
5. INSTALL INJECTION PORTS, SEAL AND PRESSURE INJECT EPOXY RESIN OR HYDROPHILIC POLYURETHANE RESIN AT EACH HOLE LOCATION IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
6. REMOVE INJECTION PORTS, SEAL AND FILL HOLE WITH DRYPACK MORTAR AFTER PRESSURE INJECTION WORK IS COMPLETE.
7. PRIOR TO COMMENCEMENT OF WORK, ENGAGE THE MANUFACTURER'S FACTORY-AUTHORIZED TECHNICAL REPRESENTATIVE FOR CONSULTATION ON-SITE PROJECT INSPECTION, AND TECHNICAL TRAINING ON THE FIRST DAY OF THE WORK AND AT THE REQUEST OF THE SEPTA PROJECT MANAGER.
8. REFER TO SPECIFICATION SECTION 03930 "CONCRETE REPAIR" FOR FURTHER INFORMATION.

(FOR CRACKS UP TO 1/8" WIDE, HORIZONTAL SURFACES)

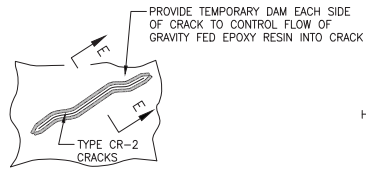


PLAN VIEW

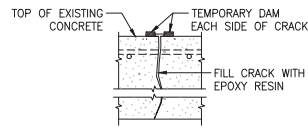


SECTION F-F

2 TYPE 4 GRAVITY CRACK REPAIR DETAIL
S213 SCALE:N.T.S.

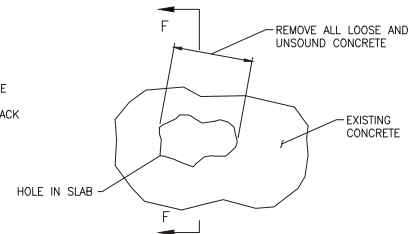

PLAN VIEW




SECTION F-F


3 TYPE 5 CONCRETE HOLE REPAIR DETAIL
S213 SCALE:N.T.S.

NOTE:

IF THE HOLE EXCEEDS 12" IN ANY DIRECTION DOWEL #5 BARS INTO EXISTING SLAB IN THAT DIRECTION

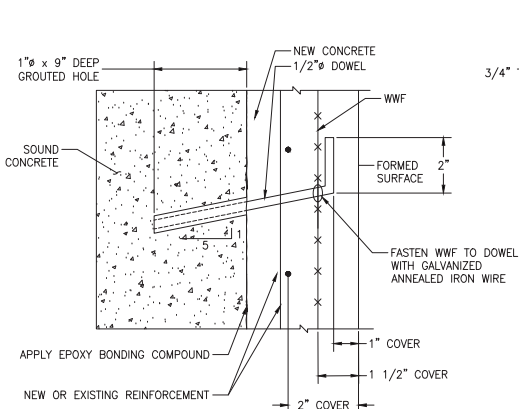

4 TYPICAL DOWEL DETAIL
S213 SCALE:N.T.S.

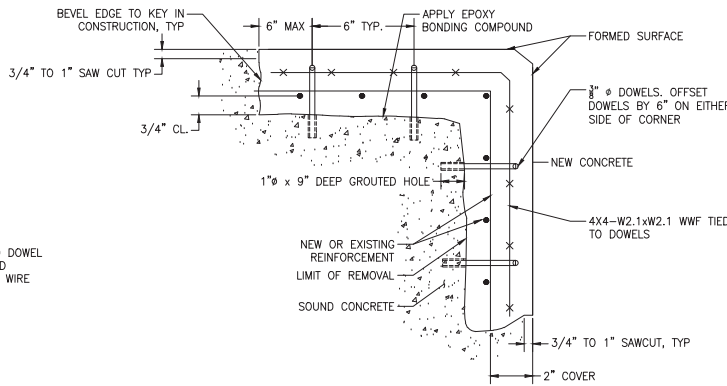

5 TYPICAL CORNER REPAIR DETAIL
S213 SCALE:N.T.S.

NOTES:

1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

WORK ON THIS DRAWING:
• CONCRETE REPAIRS.


50% SUBMISSION
NOT FOR CONSTRUCTION

DRW ENGINEER: DMC
 DRW ENGINEERING OFFICE: SEA
 DRW RAIL TRACT OFFICE:
 PROJECT NO.:
 DIRECTOR OF ENGINEERING: SEA
 MANAGER ARCHITECTURE:
 PROJECT NUMBER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA
MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146
 (610) 933-0123


REV	DATE	DESCRIPTION	BY	CHK	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
STRUCTURAL
 FOUNDATION DETAILS

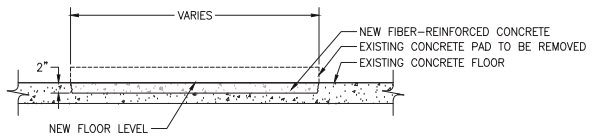


REMOVE EXISTING CONCRETE PAD TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. POUR NEW FIBER REINFORCED CONCRETE TO LEVEL FLOOR.

1 INTERIOR CONCRETE PAD REMOVAL
 S214 SCALE: N.T.S.

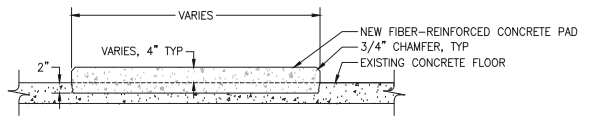


REMOVE EXISTING CONCRETE SLAB TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. SET FORM. POUR NEW FIBER REINFORCED CONCRETE TO NEW PAD LEVEL.

2 NEW INTERIOR CONCRETE PAD
 S214 SCALE: N.T.S.

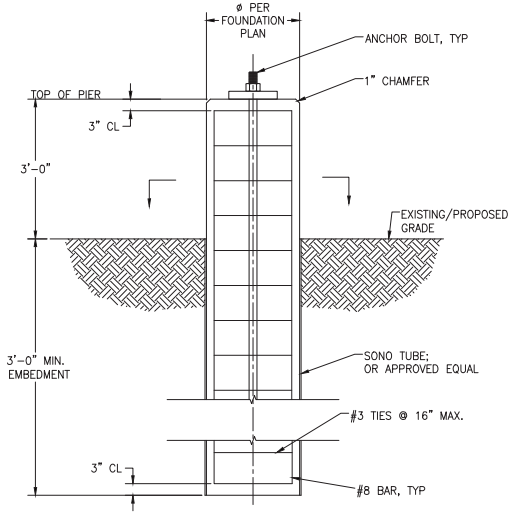


FOUNDATION DETAIL

3 FOUNDATION TYPE 316 MOD-S
 S214 SCALE: 3/4" = 1'-0"

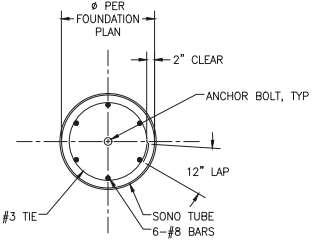


SECTION

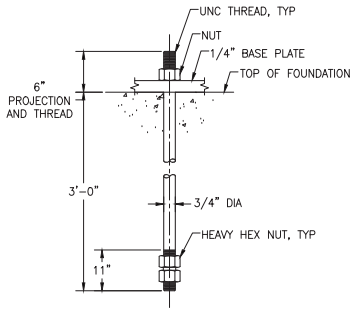

ANCHOR BOLT DETAIL
 (N.T.S.)

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.


- WORK ON THIS DRAWING:
- REMOVAL OF EXISTING CONCRETE EQUIPMENT PADS.
 - NEW CONCRETE EQUIPMENT PADS IN EXISTING SLAB.
 - NEW FOUNDATION FOR EXTERIOR STAIRS.



50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE: AS NOTED SCALE FACTOR:
 DATE: 08/22/2025 DRAWN BY: DJM
 CHECKED BY: DJM
 DRAWING NO.: 276482
S214
 SHEET NO.: 15 OF 23
 SHEET NO.: 171 OF 452
 ARCHIVE NO.:
 COMPUTER FILE NO.: 17AN-S214
 REV NO.: -

DATE PLOTTED: 10/19/2025 STATUS: 50% SUBMISSION

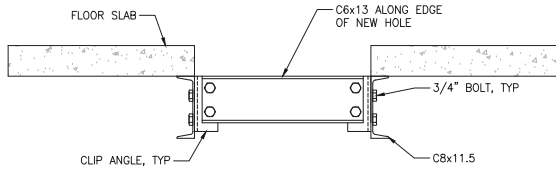

1 FLOOR PENETRATION FRAMING DETAIL
 S215 SCALE: N.T.S.

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- NEW FLOOR PENETRATION FRAMING.

50% SUBMISSION
 NOT FOR CONSTRUCTION

DRP ENGINEER - ENR:
 DRP ENGINEERING OFFICER - ENR:
 DRP RAIL TRAFFIC OFFICER:
 DRP SAFETY:
 DRP DIRECTOR OF ENGINEERING - ENR:
 DRP GROUP ARCHITECTURE:
 DRP PROJECT MANAGER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA
MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146-0
 1610 933-0123


REV	DATE	DESCRIPTION	BY	CHK	APP

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 STEEL DETAILS


SCALE: AS NOTED
 DATE: 08/22/2025
 DRAWN BY: JSA
 CHECKED BY: JSA
 PROJECT NUMBER: 276482
S215
 SHEET NO.: 16 OF 23
 SHEET NO.: 172 OF 452
 COMPUTER FILE NO.: 17AN-S215

DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION


C:\P\WORKING\PROJECTS\17AN-S216.DWG

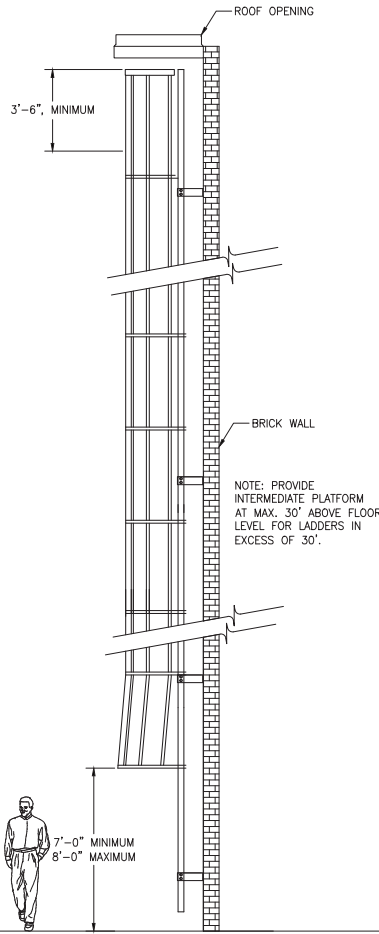


1 LADDER - SIDE ELEVATION
S216 SCALE: 3/8" = 1'-0"

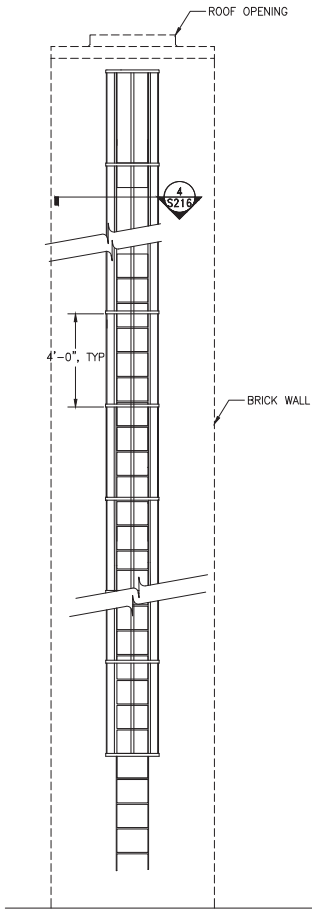


2 LADDER - FRONT ELEVATION
S216 SCALE: 3/8" = 1'-0"

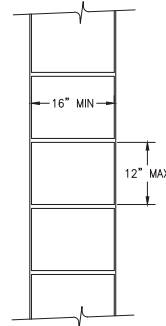

3 TYPICAL LADDER DETAIL
S216 SCALE: 1" = 1'-0"



4 TYPICAL CAGE SECTION
S216 SCALE: 1" = 1'-0"

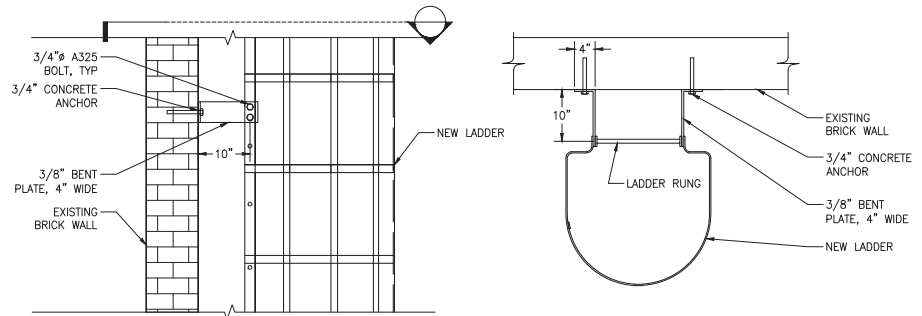

5 LADDER TO WALL CONNECTION
S216 SCALE: 1" = 1'-0"


- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
 - EXISTING ACCESS LADDERS SHALL BE REMOVED AND REPLACED WITH OSHA COMPLIANT LADDERS PER THIS DRAWING.

WORK ON THIS DRAWING:

- NEW LADDER.



SCALE: 3/8" = 1'-0"



1 INCH

50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 15TH FL.
PHILADELPHIA, PA. 19107

SEPTA ENGINEER: DMSC	
SEPTA ENGINEERING OFFICER: SEB	
SEPTA RAIL TRAFFIC OFFICER:	
SEPTA SAFETY:	
DIRECTOR OF ENGINEERING: SEB	
MANAGER ARCHITECTURE:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA
MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA. 19146-0
16101 933-0123

REV	DATE	DESCRIPTION	BY	APP'D

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
FALL PROTECTION DETAILS

DATE:	AS NOTED	SCALE FACTOR:
DATE:	08/22/2025	DRAWN BY: JSA
PROJECT NUMBER:	276482	CHECKED BY: JSA
PROJECT NAME:	S216	
DWG NO.:	17	OF 23
CITY NO.:	173	OF 452
PROJECT NO.:		
COMPUTER FILE NO.:	17AN-S216	REV. NO.:

DATE PLOTTED: 10/09/2025
STATUS: 50% SUBMISSION



1224 MARKET ST., 19106 PHILADELPHIA, PA. 19107

SEPTA
 SOUTHEASTERN
 PIEDMONT AREA
 TRANSPORTATION
 AUTHORITY
 DMSC DIVISION



HDR
 HDR Engineering, Inc.
 Philadelphia, PA
MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA 19146-0160
 1610 933-0123

NO.	REV.	DATE	DESCRIPTION	BY	CHK.

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 BUILDING DETAILS - SHEET 1

DATE:	SCALE FACTOR:
AS NOTED	
DATE:	DRAWN BY:
08/22/2025	
WORK ORDER NO.:	CHECKED BY:
276482	
S217	
DWG. NO.:	OF:
174	452
REV. NO.:	
COMPUTER FILE NO.:	REV. NO.:
17AN-S217	

50% SUBMISSION
NOT FOR CONSTRUCTION

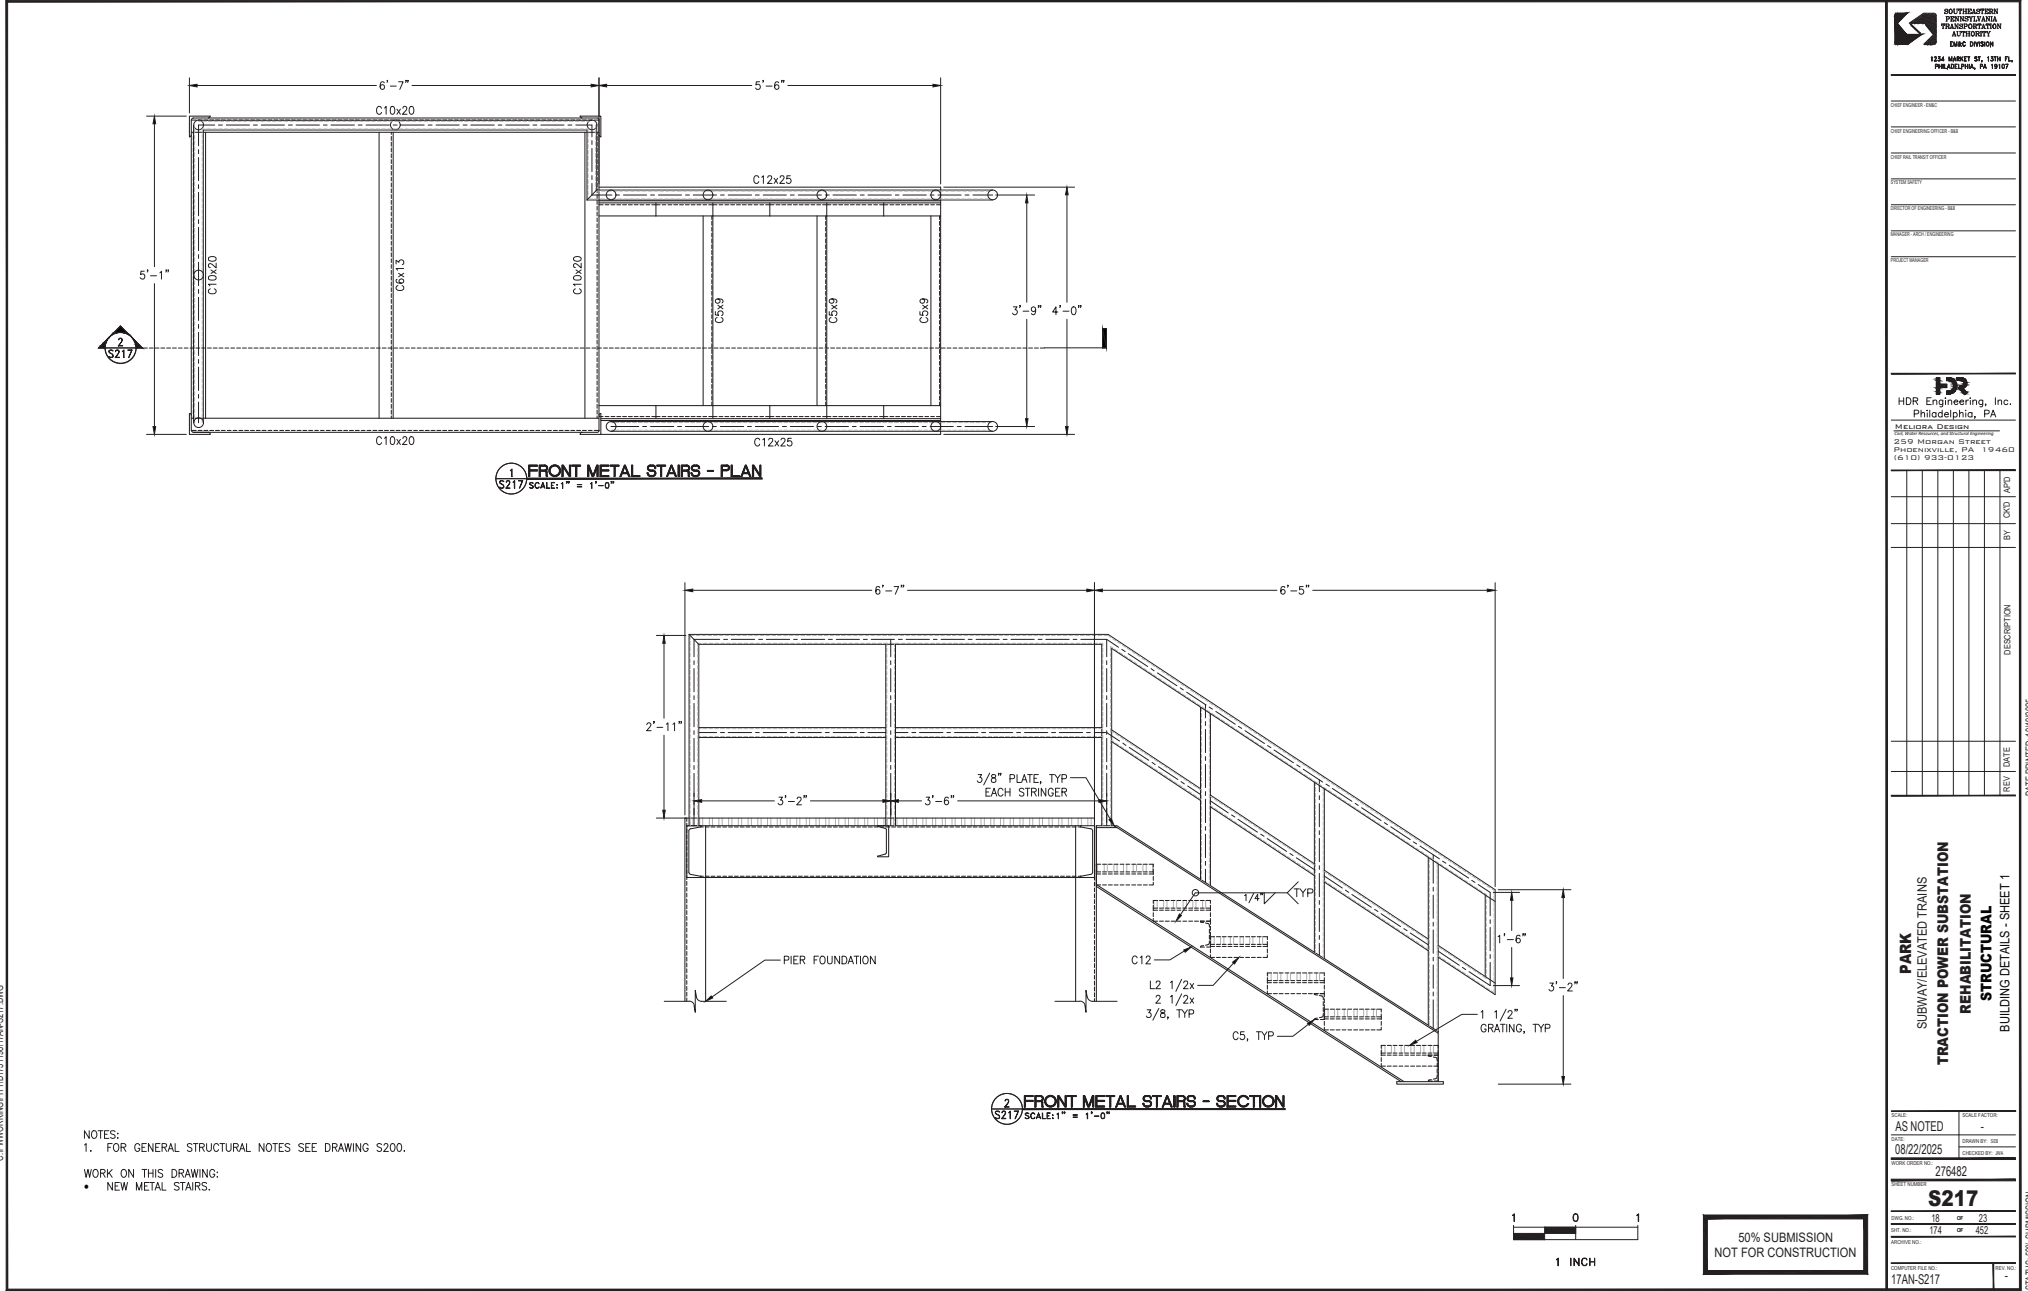

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
 WORK ON THIS DRAWING:
 • NEW METAL STAIRS.

C:\P\WORK\SEPTA\17AN-S217.DWG

STATUS: 50% SUBMISSION



1224 MARKET ST., 19106 PHILADELPHIA, PA. 19107

SEPTA
 SOUTHEASTERN
 PIEDMONT AREA
 TRANSPORTATION
 AUTHORITY
 DMRC DIVISION

HDR
 HDR Engineering, Inc.
 Philadelphia, PA


MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146-0
 1610 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APPD


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
 STRUCTURAL
 BUILDING DETAILS - SHEET 2

DATE: 08/22/2025
 SCALE FACTOR: AS NOTED
 DRAWN BY: MSA
 CHECKED BY: JKA
 SHEET NUMBER: 276482
S218
 SHEET NO: 19 OF 23
 DWT NO: 175 OF 452
 ARCHIVE NO: 17AN-S218

DATE PRINTED: 10/19/2025
 STATUS: 50% SUBMISSION

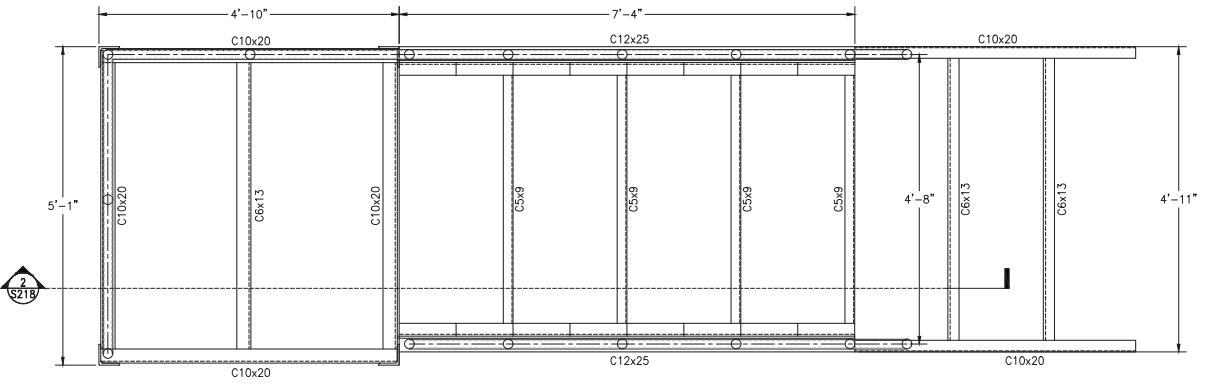


1 REAR METAL STAIRS - PLAN
 SCALE: 1" = 1'-0"

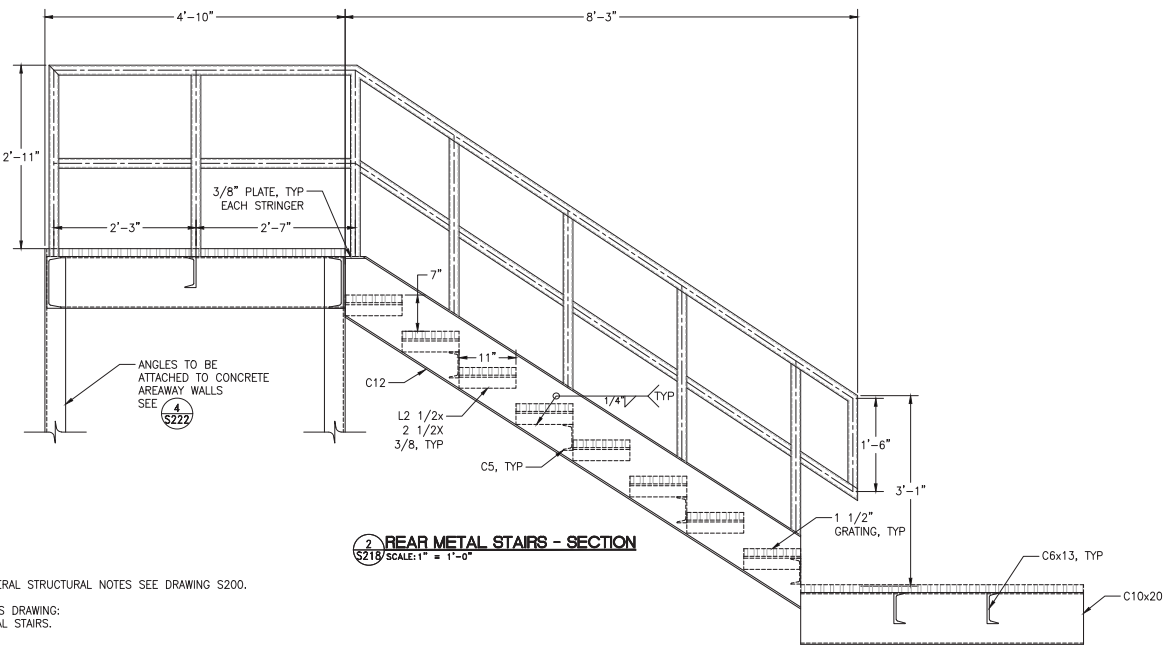

2 REAR METAL STAIRS - SECTION
 SCALE: 1" = 1'-0"


NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.
 WORK ON THIS DRAWING:
 • NEW METAL STAIRS.



50% SUBMISSION
 NOT FOR CONSTRUCTION

C:\POWER\DRG\PROJECTS\17AN-S218.DWG


C:\PWORK\DRG\PROJECTS\17AN-S219.DWG

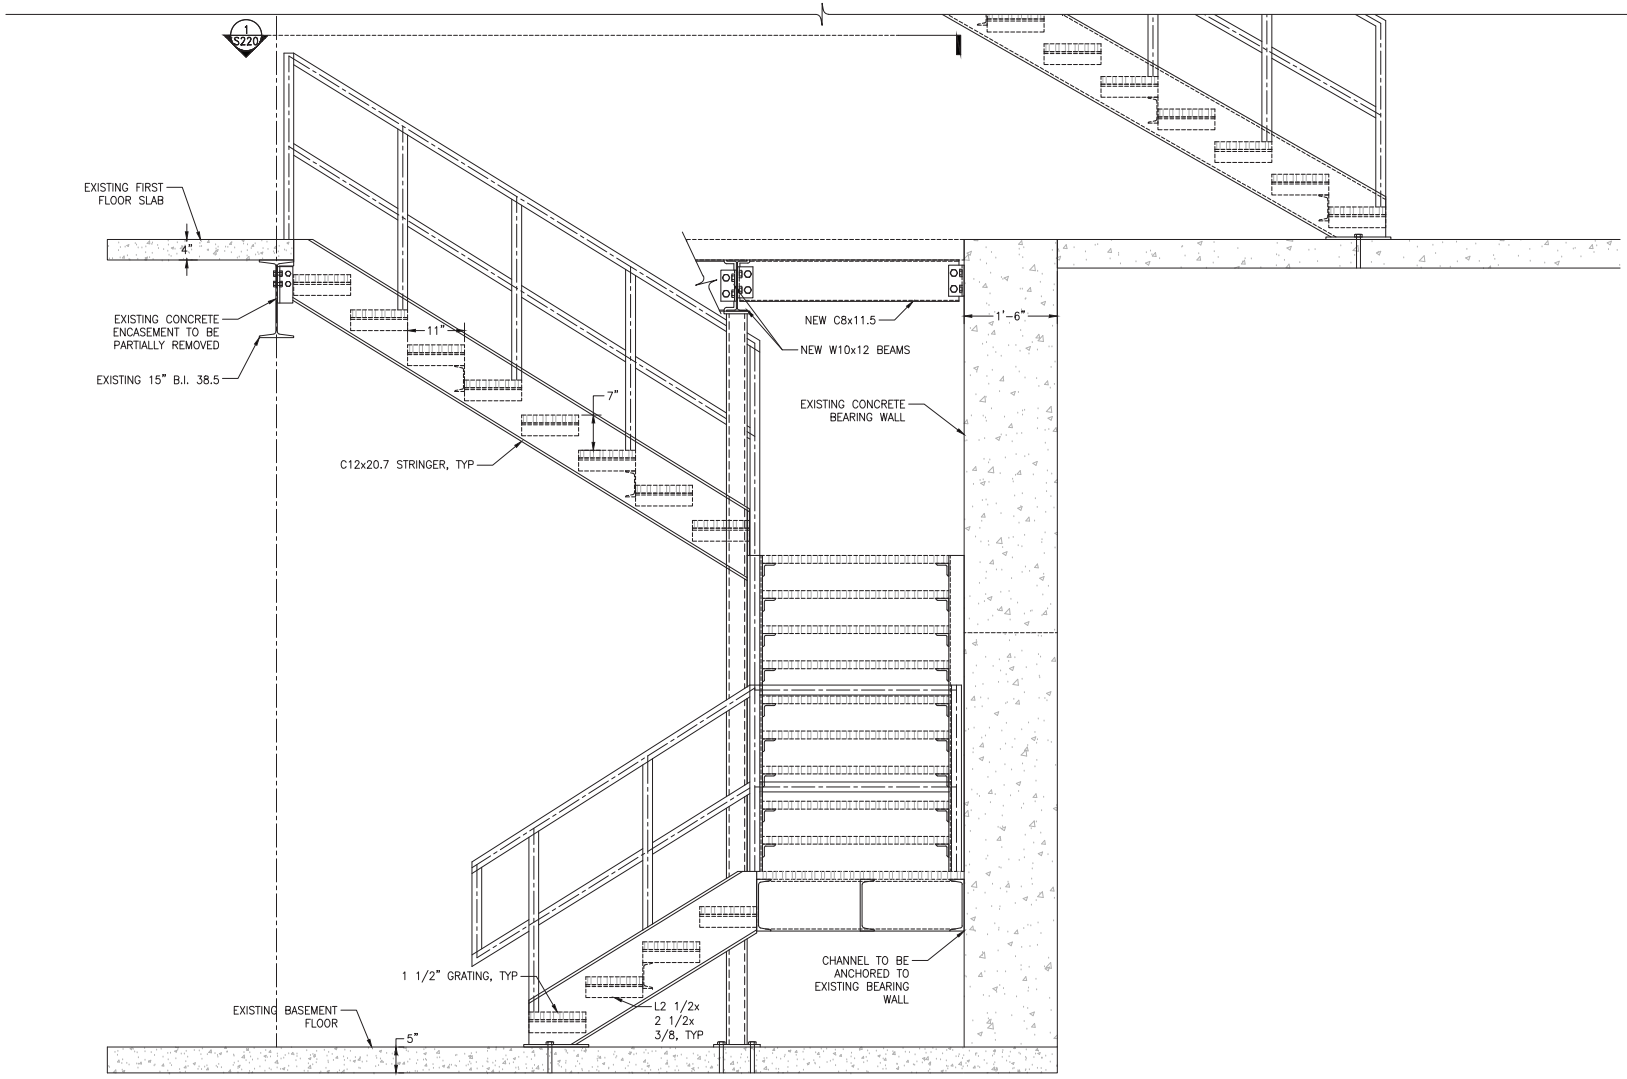

1 INTERIOR STAIRS
 S219 SCALE: 1" = 1'-0"

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- NEW METAL STAIRS.



50% SUBMISSION
 NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

SEPTA
 SOUTHEASTERN
 PIEDMONT AREA
 TRANSPORTATION
 AUTHORITY
 DEPT DIVISION

DRP ENGINEER: EACB
 DRP ENGINEERING OFFICER: SBA
 DRP RAIL TRACT OFFICER
 DRP TRAFFIC
 DIRECTOR OF ENGINEERING: SBA
 MANAGER ARCHITECTURE: SBA
 PROJECT NUMBER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA
 MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146-0
 16101 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 BUILDING DETAILS - SHEET 3

DATE: AS NOTED
 DATE: 08/22/2025
 DRAWN BY: SBA
 CHECKED BY: SBA
 PROJECT NUMBER: 276482

S219
 SHEET NUMBER
 SHEET NO. 20 OF 23
 SHEET NO. 176 OF 452
 DRAWING NO. 17AN-S219

DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION


C:\PWORK\DRG\PROJECTS\17AN-S220.DWG

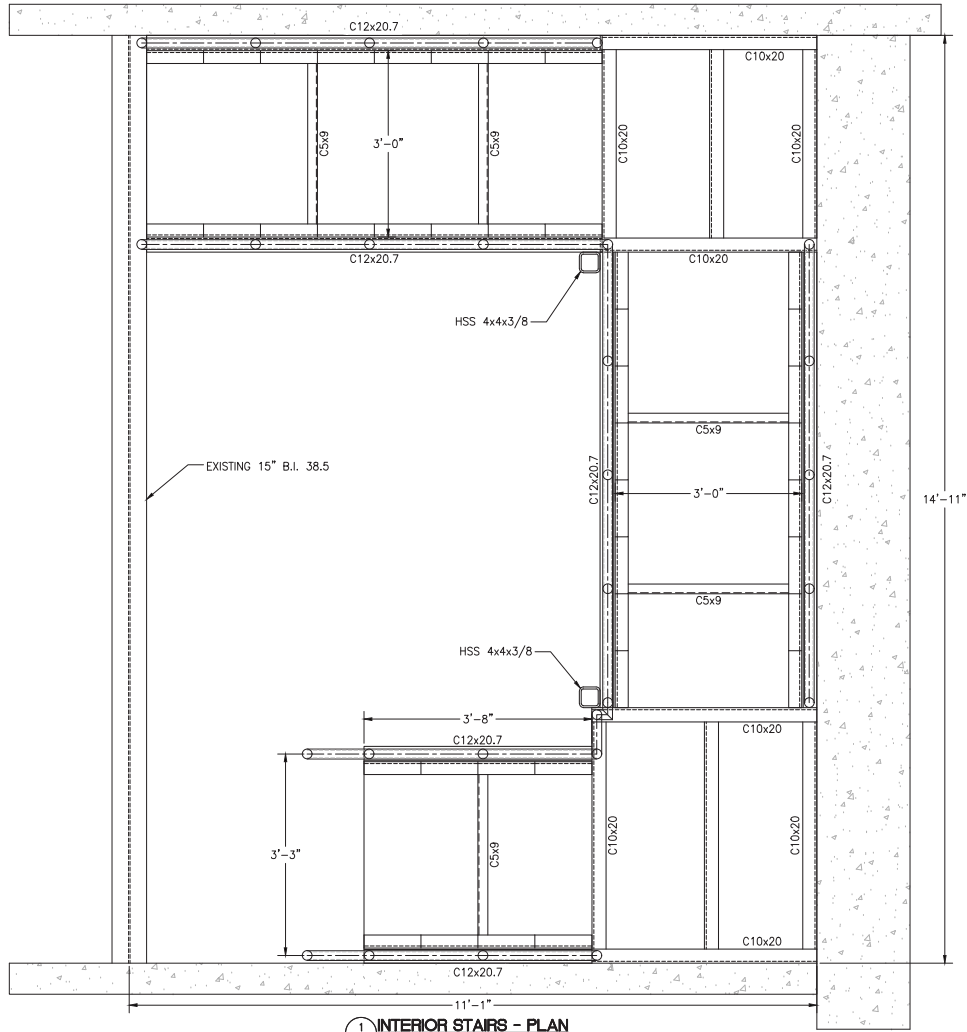

1 INTERIOR STAIRS - PLAN
S220 SCALE: 1" = 1'-0"

NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

WORK ON THIS DRAWING:
• NEW METAL STAIRS.



50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

SEPTA
SEPTA ENGINEER - SEPTA
SEPTA ENGINEERING OFFICER - SEPTA
SEPTA RAIL TRACTOR OFFICER
SEPTA SAFETY
SEPTA DIRECTOR OF ENGINEERING - SEPTA
SEPTA GROUP ARCHITECTURE
SEPTA PROJECT MANAGER

HDR
HDR Engineering, Inc.
Philadelphia, PA
MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146-0
16101 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
BUILDING DETAILS - SHEET 4

DATE: AS NOTED
SCALE FACTOR: AS NOTED
DATE: 08/22/2025
DRAWN BY: JSA
CHECKED BY: JSA
PROJECT NUMBER: 276482
SHEET NUMBER: **S220**
DRAWING NO.: 21 OF 23
SHEET NO.: 177 OF 452
PROJECT NO.:
COMPUTER FILE NO.:
DATE: 17AN-S220

DATE PLOTTED: 10/19/2025
STATUS: 50% SUBMISSION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

CHIEF ENGINEER - SEPTA
 CHIEF ENGINEERING OFFICER - SEPTA
 CHIEF RAIL TRANSIT OFFICER
 TITLE SHEET
 DIRECTOR OF ENGINEERING - SEPTA
 GROUP ARCHITECTURE
 PROJECT NUMBER


 HDR Engineering, Inc.
 Philadelphia, PA


MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146
 (610) 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 BUILDING DETAILS - SHEET 5


SCALE	SCALE FACTOR
AS NOTED	
DATE	DRAWN BY
08/22/2025	
PROJECT NUMBER	CHECKED BY
276482	
S221	
DWG NO.	SHEET NO.
22	23
DTG NO.	OF
178	452
PROJECT NO.	REV. NO.
COMPUTER FILE NO.	
17AN-S221	

DATE PLOTTED: 10/19/2025 STATUS: 50% SUBMISSION

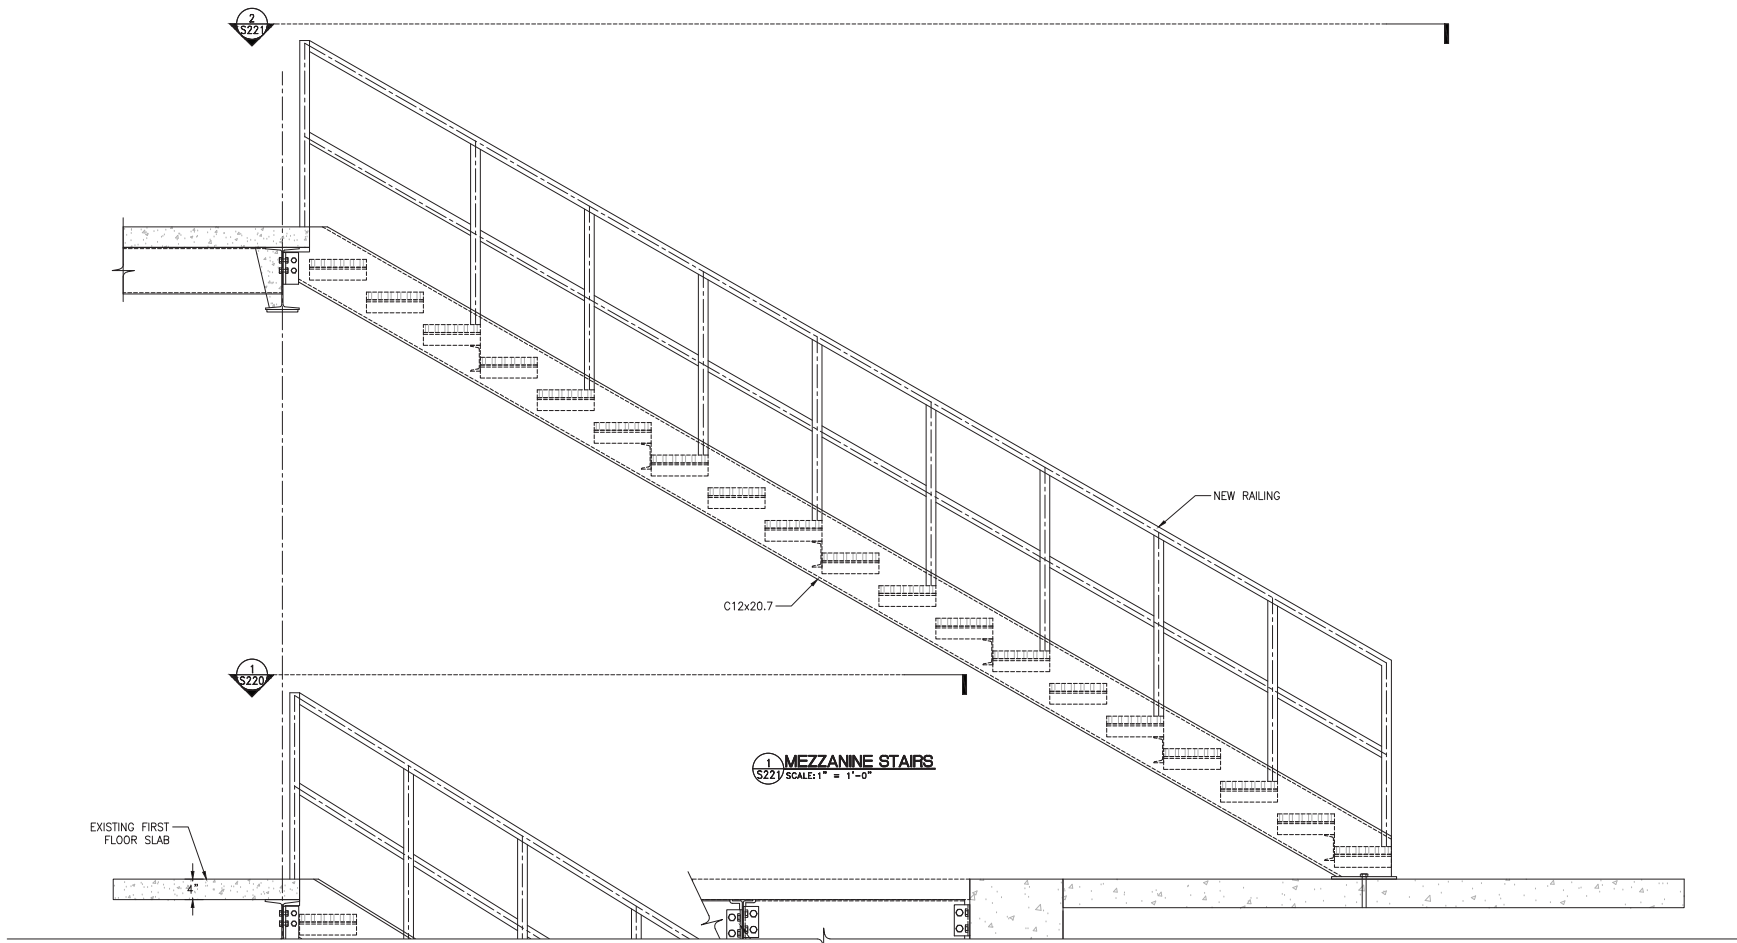


1 MEZZANINE STAIRS
S221 SCALE: 1" = 1'-0"

EXISTING FIRST FLOOR SLAB

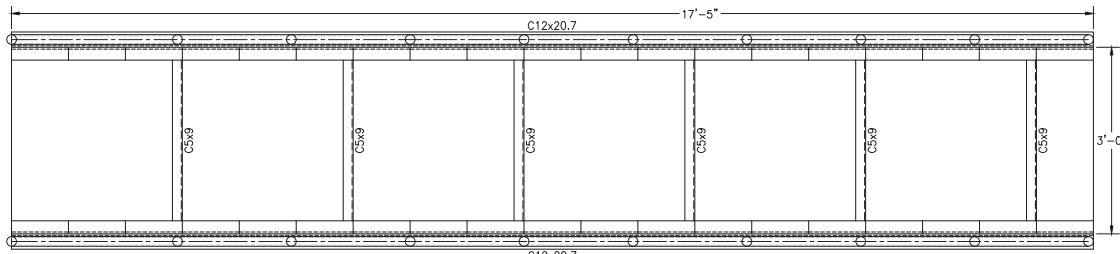

2 MEZZANINE STAIRS - PLAN
S221 SCALE: 1" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION

NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

WORK ON THIS DRAWING:
• NEW METAL STAIRS.


C:\PWORK\PROJECTS\17AN-S221.DWG

DRG NUMBER: DMC
DRG ENGINEERING OFFICE: BSA
DRG RAIL TRACT OFFICE:
PROJECT ID#:
DIRECTOR OF ENGINEERING: BSA
GROUP ARCHITECTING:
PROJECT NUMBER:


REV	DATE	BY	APPD	DESCRIPTION

DATE:	SCALE FACTOR:
AS NOTED	
DATE:	DRAWN BY:
08/22/2025	
PROJECT ORDER NO.:	CHECKED BY:
276482	


SHEET NUMBER:	DWG NO.:	23	OF	23
S222	DATE:	175	OF	452
	PROJECT NO.:			

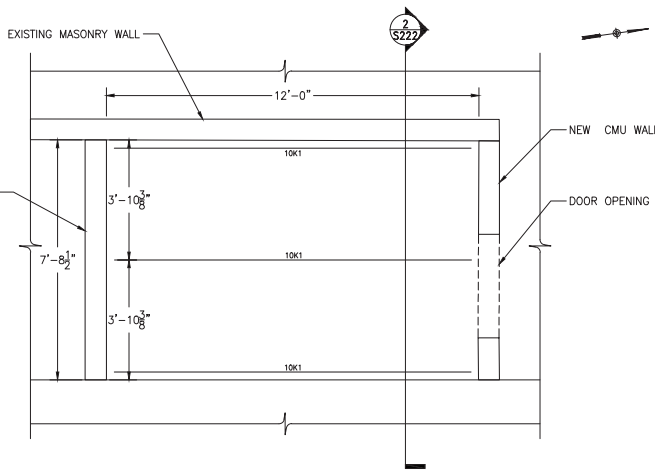


1 BATTERY ROOM FRAMING PLAN
SCALE: 1/2" = 1'-0"

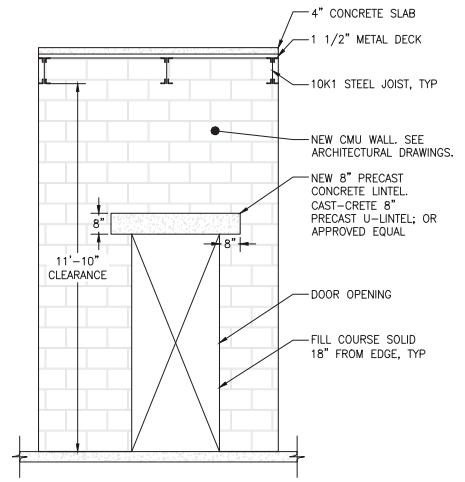

2 BATTERY ROOM - ELEVATION
SCALE: 1/2" = 1'-0"

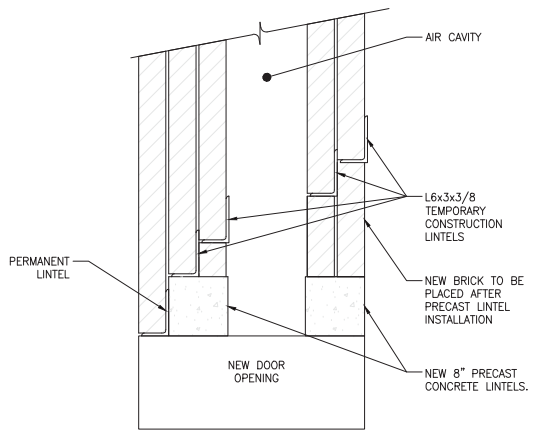


3 SECTION THROUGH LINTEL
SCALE: N.T.S.

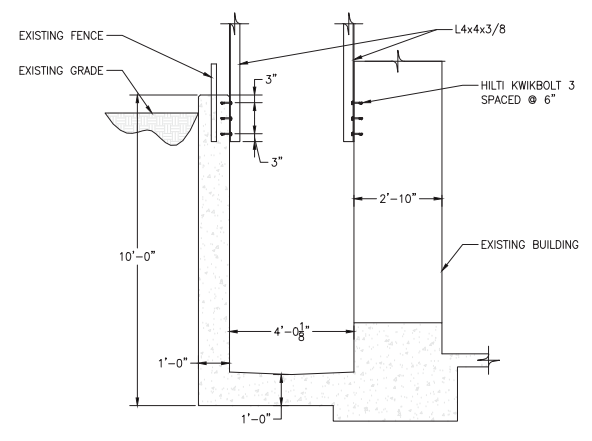

4 SOUTH ARWAYWAY STAIR DETAIL
SCALE: N.T.S.

NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S200.

- WORK ON THIS DRAWING:
- NEW BATTERY ROOM CEILING FRAMING.
 - NEW PRECAST LINTEL.
 - NEW STEEL LINTEL.



50% SUBMISSION
NOT FOR CONSTRUCTION

LEGEND-SYMBOLS:

SYMBOL	DESCRIPTION
	POINT OF DISCONNECTION FROM EXISTING
	POINT OF CONNECTION OF NEW TO EXISTING
	EQUIP TYPE EQUIPMENT TAG
	EQUIP #
	DEMO
	NEW WORK
	EXISTING TO REMAIN (E)
	NEW SANITARY PIPING
	THERMOSTAT
	SUPPLY AIR DIFFUSER
	RETURN AIR REGISTER
	MOTORIZED DAMPER
	AIRFLOW DIRECTION
	BACKDRAFT DAMPER
	FLOOR DRAIN/ROOF DRAIN
	HYDROGEN DETECTOR

ABBREVIATIONS:

@	AT
A	AMPERES
AC	AIR CONDITIONER
AD	ACCESS DOOR
ADA	AMERICANS WITH DISABILITIES ACT
AFF	ABOVE FINISHED FLOOR
AHU	AIR HANDLING UNIT
BOP	BOTTOM OF PIPE
BTU	BRITISH THERMAL UNIT
CD	CONDENSATE DRAIN/CEILING DIFFUSER
CFM	CUBIC FEET PER MINUTE
CO	CLEANOUT
COP	COEFFICIENT OF PERFORMANCE
CU	CONDENSER UNIT
CW	COLD WATER
DB	DRY BULB
DIA, ϕ	DIAMETER
DN	DOWN
DW	DOMESTIC WATER
(E)	EXISTING TO REMAIN
EA	EXHAUST AIR
EAT	EXHAUST AIR TEMPERATURE
EDH	ELECTRIC DUCT HEATER
EF	EXHAUST FAN
EQUIP	EQUIPMENT
(ER)	EXISTING TO BE RELOCATED
EER	ENERGY EFFICIENCY RATIO
ERV	ENERGY RECOVERY VENTILATION UNIT
ET	ET CETERA
ELUH	ELECTRIC UNIT HEATER
EW	EYE WASH
EX	EXHAUST, EXTERNAL
FD	FLOOR DRAIN
FLA	FULL LOAD AMPS
FP	FIRE PROTECTION
FT	FEET
GAL	GALLON
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
H	HEIGHT
HP	HORSEPOWER/HEAT PUMP
HVAC	HEATING, VENTILATION AND AIR CONDITIONING
HW	HOT WATER
HZ	HERTZ (CYCLES PER SECOND)
IN	INCH
IRH	INFRARED RADIANT HEATER
KW	KILOWATT
L	LENGTH
LBS	POUNDS
LAT	LATENT AIR TEMPERATURE
LV	LOUVER
MBH	THOUSANDS OF BTUS PER HOUR
MAX	MAXIMUM
MCA	MINIMUM CIRCUIT AMPACITY
MCP	MAIN CONTROL PANEL
MD	MOTORIZED DAMPER
MFR	MANUFACTURER
MIN	MINIMUM
MOCP	MAXIMUM OVERCURRENT PROTECTION
(N)	NEW
NO., #	NUMBER
OA	OUTSIDE AIR
\emptyset	PHASE
PREP	PREPARE
PSI	POUNDS PER SQUARE INCH
QTY	QUANTITY
(R)	EXISTING TO BE REMOVED
RA	RETURN AIR
RD	ROOF DRAIN
(RE)	RELOCATED EXISTING
RL	RAIN LEADER
RM	ROOM
RPM	REVOLUTIONS PER MINUTE
SAN	SANITARY
SA	SUPPLY AIR
S.F., FT ²	SQUARE FEET
SD	SCUPPER DRAIN
SP	STATIC PRESSURE
SR	SUPPLY REGISTER
T	THERMOSTAT
TYP	TYPICAL
U/G	UNDER GROUND
V	VOLT, VENT
VD	VOLUME DAMPER
W	WIDTH
WB	WET BULB
WC	WATER CLOSET/WATER COLUMN
WESS	WAYSIDE ENERGY STORAGE SYSTEM

GENERAL NOTES:

- SEE ARCHITECTURAL DRAWINGS FOR NEW AND EXISTING GENERAL CONSTRUCTION WORK.
- COMPLY WITH THE PHILADELPHIA PLUMBING CODE AND PHILADELPHIA MECHANICAL CODE IN ADDITION TO THE APPLICABLE MUNICIPAL CODES AND STANDARDS.
- REVIEW ALL PROJECT DOCUMENTS OF ALL TRADES FOR A THOROUGH UNDERSTANDING OF PROJECT AND ANY CROSS REFERENCING OF WORK. REVIEW ALL PROJECT REQUIREMENTS PRIOR TO BIDDING. DISCREPANCIES BETWEEN DOCUMENTS SHALL BE REPORTED TO SEPTA PROJECT MANAGER PRIOR TO BIDDING.
- INSTALL ALL EQUIPMENT WITH ADEQUATE CLEARANCES FOR MAINTENANCE AND SERVICING AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND APPLICABLE CODES.
- OBTAIN AND PAY FOR ALL PERMITS AND PAY FOR ALL COSTS OF MATERIALS. HANDLE, STORE AND PROTECT ALL EQUIPMENT TO PREVENT DAMAGE BEFORE AND DURING INSTALLATION IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. PROTECT THE WORK SITE AND NEW AND EXISTING WORK AGAINST ANY DAMAGE, INCLUDING BUT NOT LIMITED TO WATER, DUST, HEAT, FREEZING ETC. UNTIL FINAL COMPLETION AND ACCEPTANCE BY SEPTA.
- REFER TO SPECIFICATIONS FOR MATERIALS TO BE USED AND METHODS OF INSTALLATION.
- WHERE UTILITIES AND/OR SERVICES REQUIRE SHUTDOWN FOR THE WORK TO BE PERFORMED, NOTIFY THE SEPTA PROJECT MANAGER. IN WRITING, A MINIMUM OF TWO (2) WEEKS PRIOR TO THE REQUESTED SHUTDOWN.
- STORAGE OF MATERIALS AND/OR EQUIPMENT SHALL NOT BE ALLOWED OTHER THAN WITHIN THE LIMITS OF THE STAGING AREA OR CONFINES OF THE PROJECT WORK AREA AND AS APPROVED BY THE SEPTA PROJECT MANAGER.
- PERFORM ALL WORK IN A NEAT AND WORKMANLIKE MANNER TO THE SATISFACTION OF SEPTA STANDARDS.
- RESTORE ALL EXISTING WORK DISTURBED OR DAMAGED BY THE DEMOLITION AND CONSTRUCTION ACTIVITIES TO MATCH EXISTING ORIGINAL CONDITION OR BETTER.
- REMOVE, RECYCLE AND DISPOSE OF ALL CONSTRUCTION WASTE AND DEMOLITION DEBRIS IN ACCORDANCE WITH THE APPROVED CONSTRUCTION WASTE MANAGEMENT PLAN.
- MAINTAIN A COPY OF THE CURRENT SET OF CONTRACT DOCUMENTS WITH THE CONTRACTOR AS-BUILT INFORMATION AT THE JOB SITE AT ALL TIMES.
- VERIFY ALL DIMENSIONS IN THE FIELD AND REPORT DISCREPANCIES, IF ANY, TO THE SEPTA PROJECT MANAGER FOR CLARIFICATION PRIOR TO STARTING ANY AFFECTED WORK.
- PATCH AND REPAIR ALL OPENINGS LEFT IN EXISTING WALL SURFACES OR CEILINGS BY THE REMOVAL OF EXISTING SURFACE AND OR SEMI-RECESSED FITTINGS OR PIPING AND FINISH SUCH AREAS TO MATCH ADJACENT SURFACES.
- PRIOR TO DELIVERY OF ANY MATERIALS TO THE SITE, PROVIDE SAFETY DATA SHEETS FOR ALL REQUIRED ITEMS AND MATERIALS USED IN THE WORK TO THE SEPTA PROJECT MANAGER.
- COMPLY WITH ALL SEPTA SAFETY STANDARDS AND INCLUDE ALL COSTS TO TRAIN AND QUALIFY CONTRACTOR'S PERSONNEL IN SEPTA SAFETY STANDARDS. SEE GENERAL CONDITIONS OF THE SPECIFICATIONS.
- REVIEW POTENTIAL ITEMS FOR SALVAGE AND RETENTION BY SEPTA WITH THE SEPTA PROJECT MANAGER PRIOR TO REMOVAL TO DETERMINE DISPOSITION.
- THESE DRAWINGS SHOW HVAC AND PLUMBING WORK. SEE FPXXX DRAWINGS FOR FIRE SUPPRESSION WORK.

SOUTHEASTERN
PENNSYLVANIA
TRANSPORTATION
AUTHORITY
DMC DIVISION
1200 MARKET ST., 18TH FL.
PHILADELPHIA, PA 19107

JOB NUMBER: 0011
JOB ENGINEER/OWNER: []
JOB FILE NUMBER: []
DESIGN NUMBER: []
PROJECT NUMBER: []
PROJECT MANAGER: []

HDR
HDR Engineering, Inc.
Philadelphia, PA

NO.	DATE	BY (C/C)	APP'D	DESCRIPTION

DATE PRINTED: 10/27/2025

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
GENERAL NOTES, SYMBOLS & ABBREVIATIONS

SCALE: AS SHOWN 1:1
DATE: 08/22/2025 DRAWN BY: DWP CHECKED BY: JRM
JOB NUMBER: 276482
SHEET NUMBER: **M200**
NO. IN SET: 1 of 12
SHEET NO.: 180 of 452
COMPUTER FILE NO.: 17AN-M200

50% SUBMISSION
NOT FOR CONSTRUCTION

C:\P\WORKINGSET\171017\17AN-M201.DWG



DATE PLOTTED:	
DATE EXAMINED/SPECIFY FILE:	
DATE FOR PLOTTING/SCALE:	
DESIGNER:	
DIRECTOR OF ENGINEERING:	
MANAGER - MECH/PLUMBING:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
MECHANICAL
DEMOLITION BASEMENT FLOOR PLAN


TITLE:	AS SHOWN	SCALE/FACED:	1:1
DATE:	08/22/2025	DRAWN BY:	CLP
WORK ORDER NO.:	276482	CHECKED BY:	CLP
SHEET NUMBER:	M201		
DWG. NO.:	2	OF	12
REV. NO.:	181	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-M201	REV. DATE:	

GENERAL NOTES:


- REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
- REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
- REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- REMOVE FLOOR DRAIN GRATE. FLUSH THE ENTIRE UNDERGROUND SANITARY SYSTEM PRIOR TO INSTALLING A NEW DRAIN GRATE.
- THOROUGHLY CLEAN THE SUMP PIT PRIOR TO INSTALLING NEW DUPLEX SUMP PUMP.
- THE CONTRACTOR SHALL LOCATE ALL COMPRESSED AIR PIPING THROUGHOUT THE BUILDING AND REMOVE IT ALONG WITH THE AIR COMPRESSOR AND CONNECTED APPURTENANCES.
- REMOVE SERVICE SINK ALONG WITH ALL CONNECTED APPURTENANCES. REMOVE SANITARY PIPING ABOVE FLOOR. THOROUGHLY CLEAN UNDERGROUND SANITARY PIPING PRIOR TO CONNECTING NEW MOP SINK.
- THE CONTRACTOR SHALL LOCATE ALL ABANDONED SANITARY AND COLD WATER PIPING THROUGHOUT THE BUILDING AND REMOVE IT TO IT'S ENTIRETY.
- THOROUGHLY CLEAN UNDERGROUND SANITARY PIPING PRIOR TO INSTALLING NEW PIPES.
- BEFORE START OF WORK, MEASURE AND RECORD (E) AIRFLOW RATE. REMOVE SUPPLY GRILLE. THOROUGHLY CLEAN ENTIRE DUCTWORK.

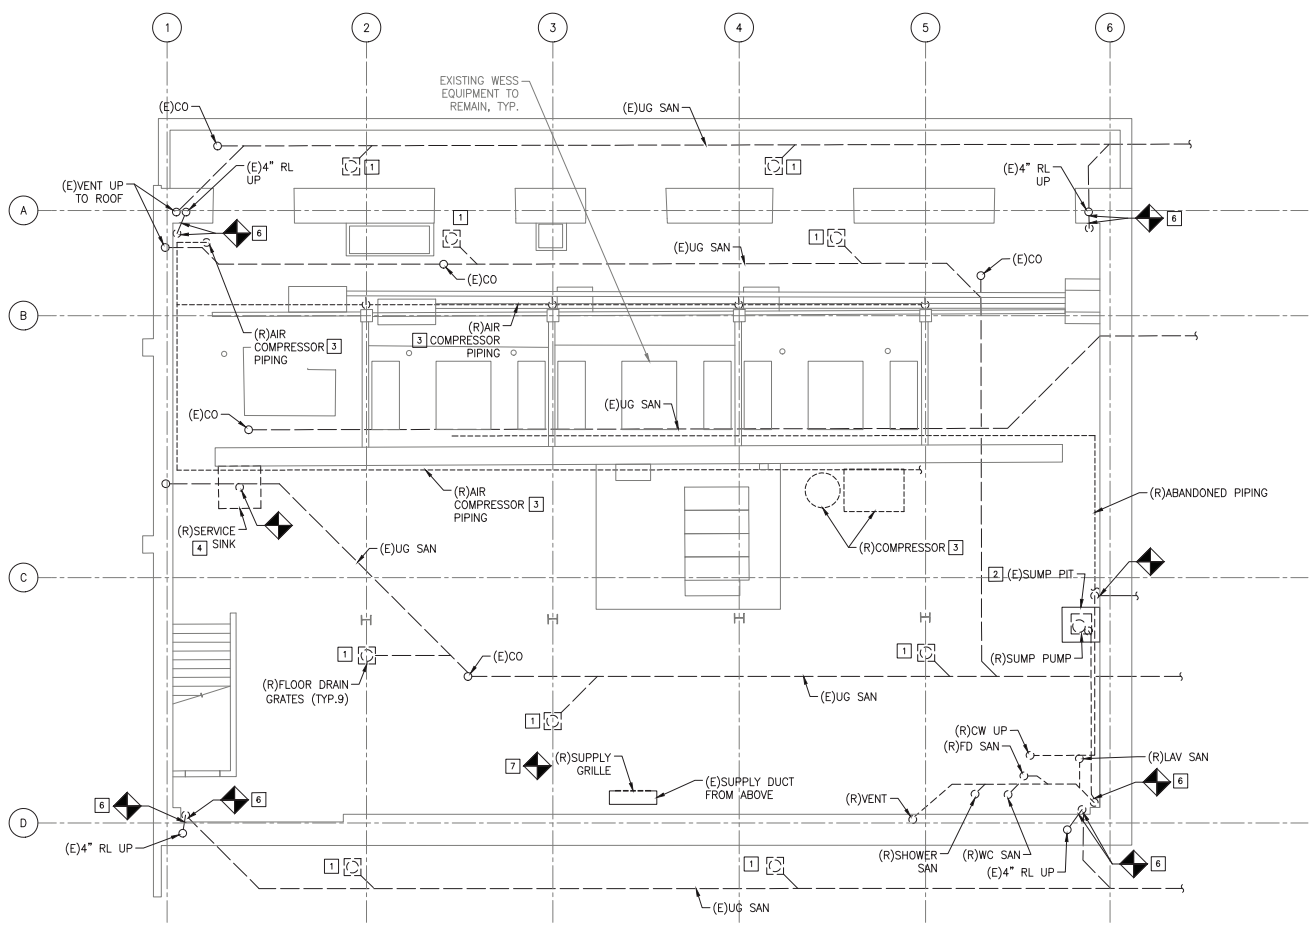


1
M201 DEMOLITION BASEMENT FLOOR PLAN
SCALE: 3/16" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PLOTTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\PW\WORKINGSET\1710117\17AN-M202.DWG

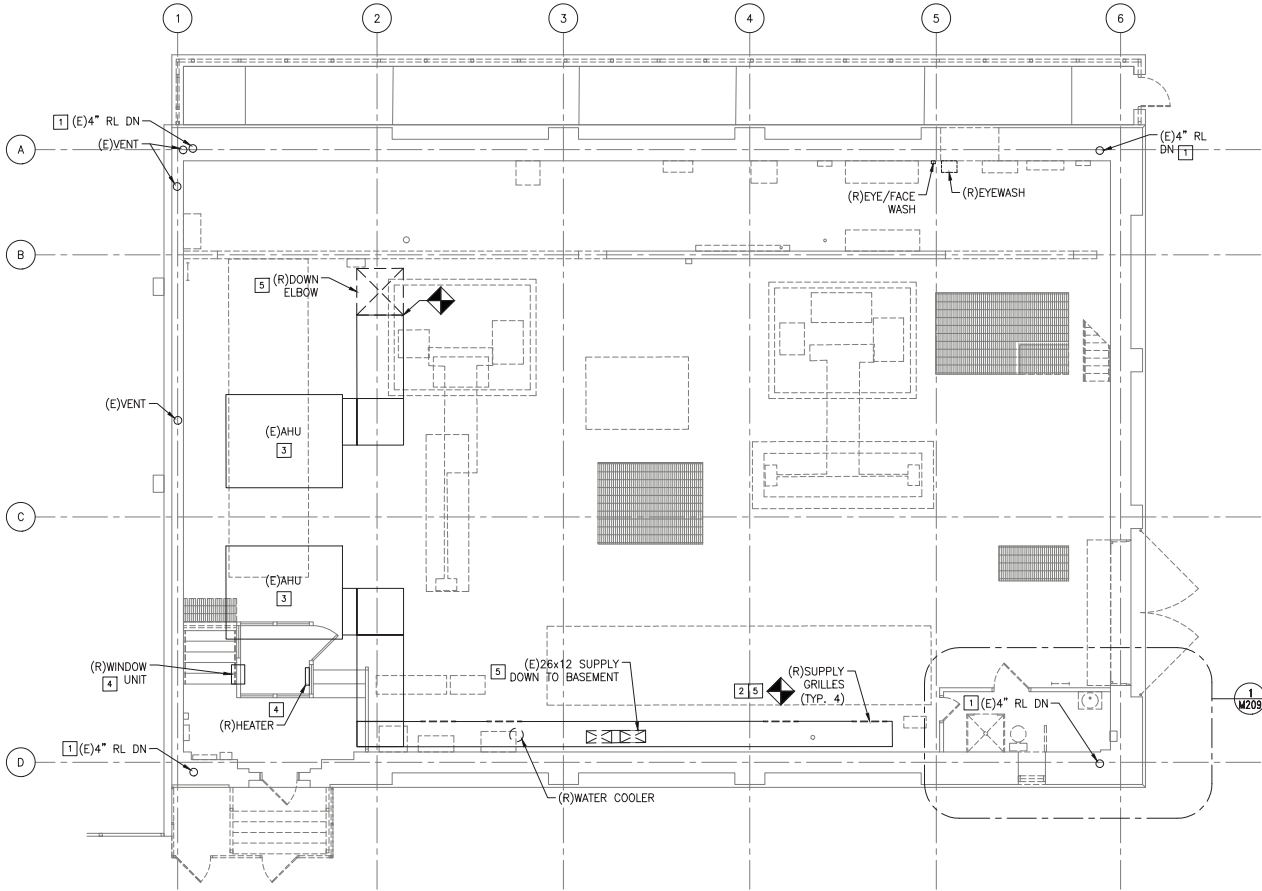


1 DEMOLITION FIRST FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
2. REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
3. REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- 1** REMOVE RAIN LEADER FROM THE ROOF DRAIN DISCHARGE LOCATION TO THE LOCATION WITHIN THE WALL AS SHOWN. CLEAN THE VERTICAL LEADER WITHIN THE WALL PRIOR TO INSTALLING A NEW LEADER.
- 2** REMOVE ALL SUPPLY GRILLES. THOROUGHLY CLEAN THE ENTIRE DUCTWORK.
- 3** REMOVE CURRENT ROLL FILTER ASSEMBLY AND BELT DRIVEN MOTOR. THE CONTRACTOR SHALL THOROUGHLY CLEAN THE ENTIRE AIR HANDLING UNIT INCLUDING BUT NOT LIMITED TO THE FAN AND THE OUTSIDE AIR INTAKE.
- 4** REMOVE HEATER, WINDOW UNIT AND THE CONNECTED APPURTENANCES.
- 5** BEFORE START OF WORK, MEASURE AND RECORD (E) AIRFLOW RATE.



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
PROJECT NAME:	
PROJECT NUMBER:	
DATE:	



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
DEMOLITION FIRST FLOOR PLAN

DATE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	DM
DATE:		CHECKED BY:	DM
PROJECT NUMBER:	276482		
SHEET NUMBER:	M202		
DWG NO:	3	OF	12
REV NO:	182	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-M202		
REV. NO.:	1		

DATE PRINTED: 10/27/2025
STATUS: 50% SUBMISSION

C:\PW\WORKINGSET\171017\17AN-M203.DWG




GENERAL NOTES:


1. REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
2. REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
3. REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- 1 REMOVE RAIN LEADER FROM THE ROOF DRAIN DISCHARGE LOCATION TO THE LOCATION WITHIN WALL AS SHOWN. CLEAN THE VERTICAL LEADER WITHIN THE WALL PRIOR TO INSTALLING A NEW LEADER.

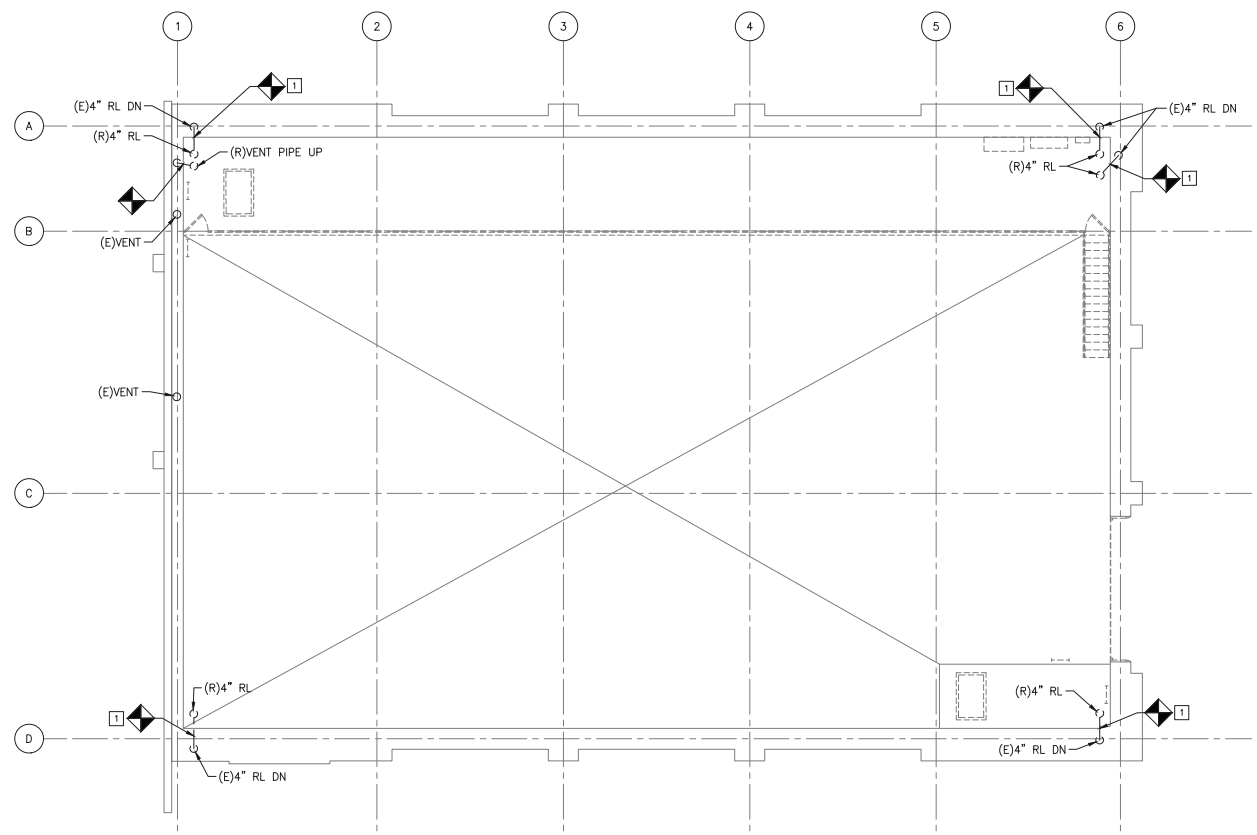

1
M203 DEMOLITION MEZZANINE FLOOR PLAN
 SCALE: 3/16" = 1'-0"



50% SUBMISSION
 NOT FOR CONSTRUCTION


DATE PLOTTED:					
DATE ENGINEERING OFFICE:					
DATE FIELD/PROJECT:					
DESIGNER:					
DIRECTOR OF ENGINEERING:					
GROUP/PROJECT/LOCATION:					
PROJECT NUMBER:					
REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
 MECHANICAL
 DEMOLITION MEZZANINE FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DDP
		CHECKED BY:	SLM
WORK ORDER NO.:	276482		
SHEET NUMBER:	M203		
DWG. NO.:	4	OF:	14
REV. NO.:	183	OF:	452
PROJECT FILE NO.:	17AN-M203		
REV. 01:	1		

DATE PRINTED: 10/27/2025
STATUS: 50% SUBMISSION

C:\P\WORKINGSET\171017\171017\M204.DWG

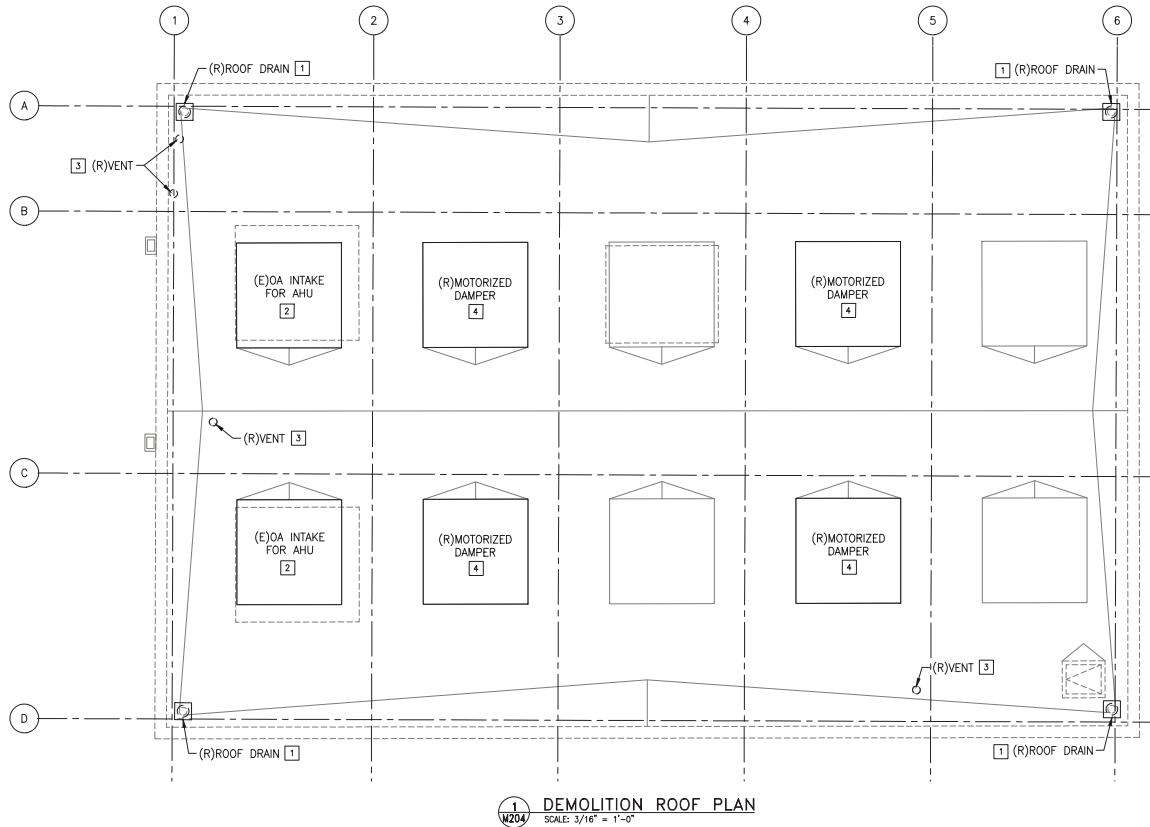

1 DEMOLITION ROOF PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
2. REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
3. REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- 1** REMOVE ROOF DRAIN. CLEAN VERTICAL LEADER WITHIN THE WALL PRIOR TO INSTALLING A NEW ROOF DRAIN.
- 2** THOROUGHLY CLEAN OUTDOOR AIR INTAKE OPENING AND DUCTWORK PRIOR TO INSTALLING NEW ROOF CAP.
- 3** REMOVE ENTIRE LENGTH OF EXPOSED VENT PIPE. THOROUGHLY CLEAN THE ENTIRE LENGTH OF VENT PIPE WITHIN WALL PRIOR TO INSTALLING A NEW PIPE.
- 4** REMOVE EXISTING MOTORIZED DAMPER AND ALL CONNECTED APPURTENANCES.




DATE PLOTTED:	
DATE ENGINEERING OFFICE:	
DATE FIELD/PROJECT:	
DESIGNER:	
DIRECTOR OF ENGINEERING:	
GROUP/PROJECT LEADER:	
PROJECT MANAGER:	



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
DEMOLITION ROOF PLAN


TITLE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DAF
WORK ORDER NO.:	276482	CHECKED BY:	DAF
SHEET NUMBER:	M204		
DWG. NO.:	5	OF	12
PT. NO.:	184	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-M204	REV. NO.:	1




50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PLOTTED: 10/27/2025
STATUS: 50% SUBMISSION

C:\PW\WORKINGSET\1710117AN\M205.DWG

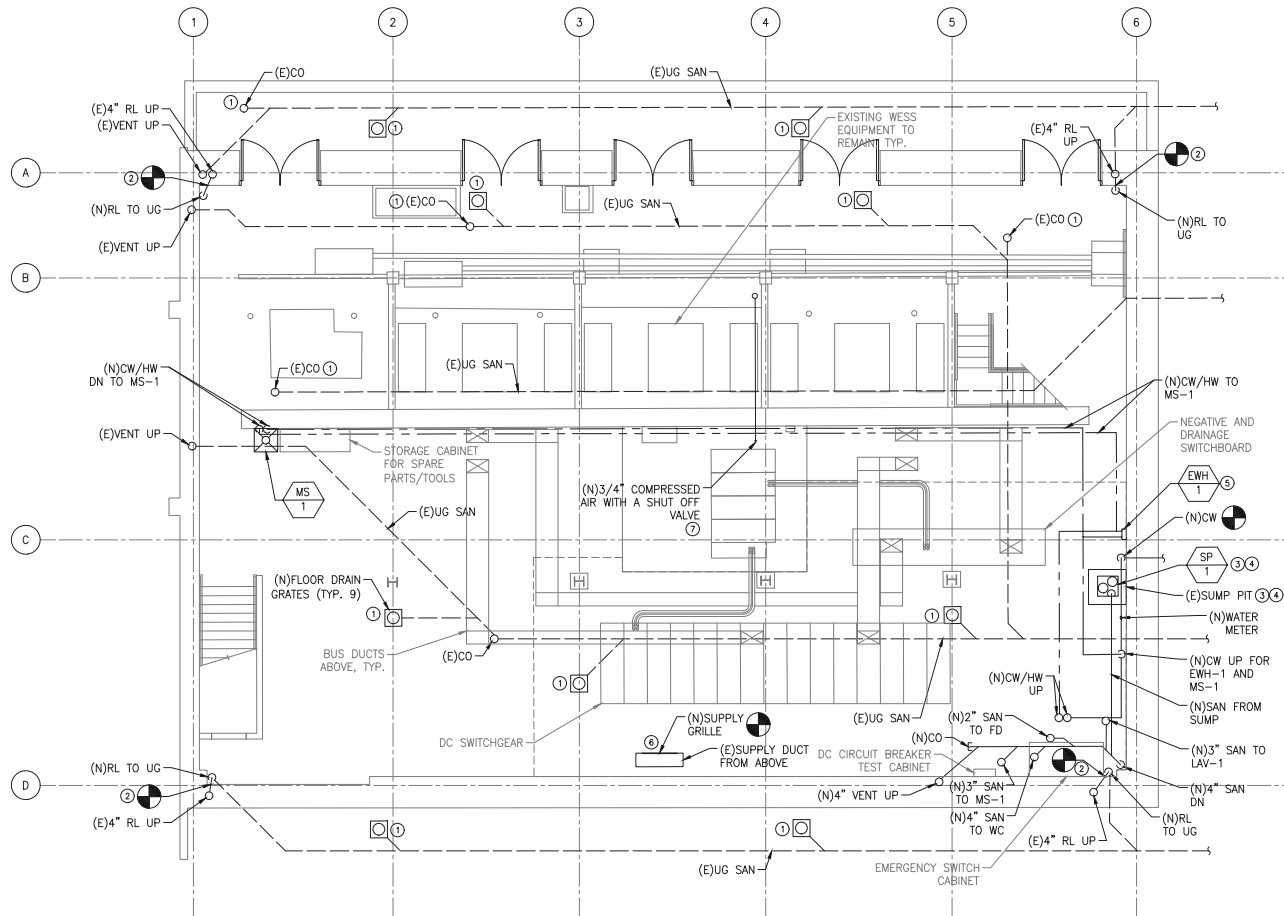

1
M205
PROPOSED BASEMENT FLOOR PLAN
 SCALE: 3/16" = 1'-0"



50% SUBMISSION
 NOT FOR CONSTRUCTION

GENERAL NOTES:

- REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
- REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
- REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- THOROUGHLY CLEAN THE UNDERGROUND SANITARY PIPING FROM THE FLOOR DRAIN OPENINGS AND THE CLEANOUTS PROVIDED PRIOR TO INSTALLING NEW FLOOR DRAIN GRATES.
- THOROUGHLY CLEAN THE RAIN LEADER WITHIN THE WALL PRIOR TO CONNECTING NEW PIPING.
- THOROUGHLY CLEAN THE SUMP PIT AND PIPING WITHIN SUMP PIT PRIOR TO INSTALLING NEW SUMP PUMP.
- PROVIDE DUPLEX SUMP PUMP. BOTH PUMPS SHALL BE SAME MODEL AS DESCRIBED IN THE SCHEDULE.
- MOUNT INSTANT HOT WATER HEATER ON THE WALL TIGHT TO CEILING. PROVIDE NECESSARY CLEARANCE AS REQUIRED BY THE MANUFACTURER.
- REBALANCE TO ORIGINAL AIRFLOW RATE PREVIOUSLY MEASURED.
- AVOID INTERFERENCE WITH THE EXISTING WESS EQUIPMENT.



DATE PLOTTED: 08/22/2025	BY: CXC	APPD:
DATE ENGINEERING OFFICE: 08/22/2025	DESCRIPTION:	
DATE FIELD PLOTTED:	DATE:	
DESIGNER:		
DIRECTOR OF ENGINEERING:		
GROUP/KEY ENGINEER:		
PROJECT MANAGER:		

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
MECHANICAL
 REHABILITATION
 PROPOSED BASEMENT FLOOR PLAN

SCALE: 3/16" = 1'-0"	SCALE FACTOR: 1:1
DATE: 08/22/2025	DRAWN BY: CXP
	CHECKED BY: JLM
WORK ORDER NO: 276482	
M205	
DWG NO: 6 OF 12	
SHT NO: 185 OF 452	
PROJECT NO:	
COMPUTER FILE NO: 17AN-M205	REV: 1

DATE PLOTTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\GPTT\1711917\17AN\M207.DWG




1324 MARKET ST., 19107 PHILADELPHIA, PA. 19107

GENERAL NOTES:

1. REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
2. REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
3. REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- 1 THOROUGHLY CLEAN PIPING WITHIN THE WALL PRIOR TO CONNECTING NEW PIPING.

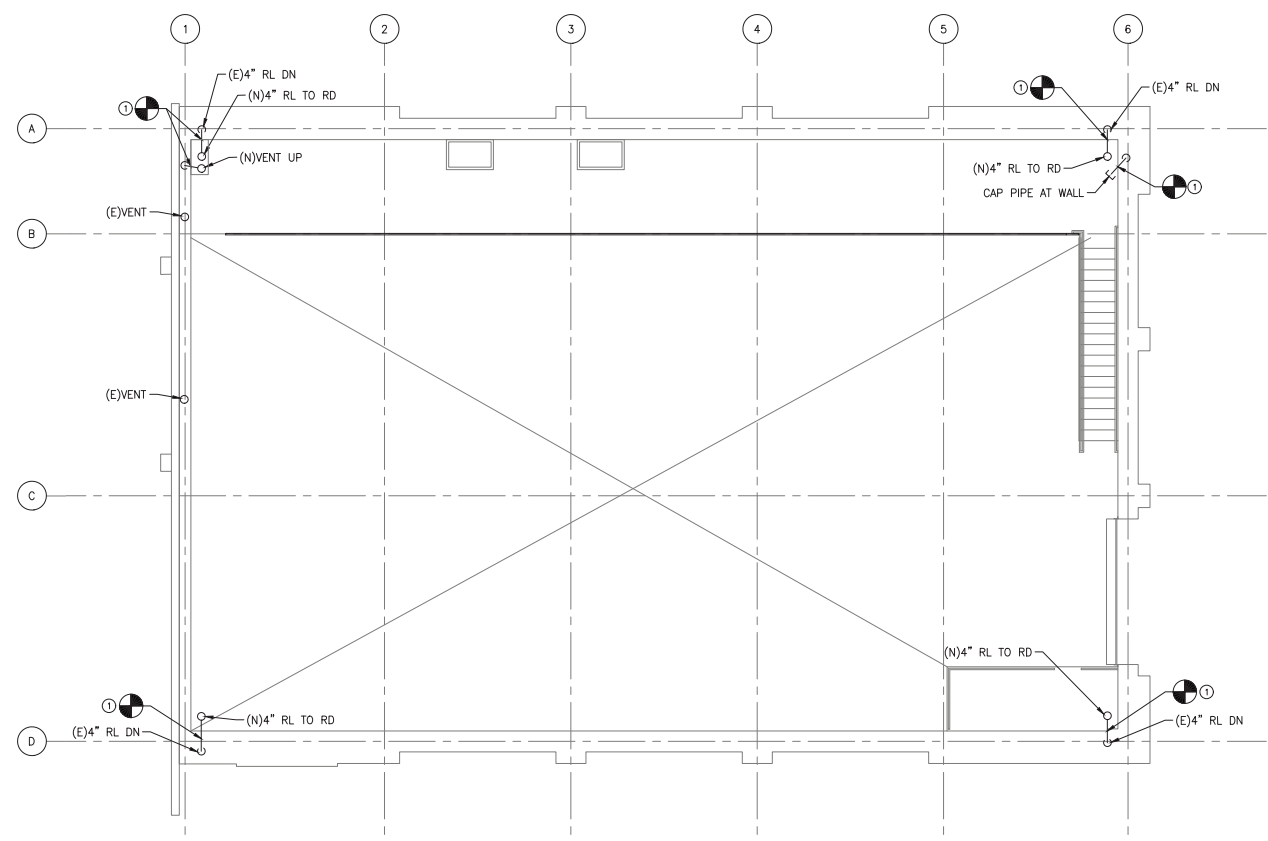

1
M207
PROPOSED MEZZANINE FLOOR PLAN
 SCALE: 3/16" = 1'-0"

SEPTA ENGINEER: EABC
SEPTA ENGINEERING OFFICER: SEE
SEPTA RAIL TRACTOR OFFICER:
SEPTA SAFETY:
DIRECTOR OF ENGINEERING: SEE
SEPTA ARCHITECT/ENGINEER:
PROJECT NUMBER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA




REV	DATE	DESCRIPTION	BY	CHK	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
 PROPOSED MEZZANINE FLOOR PLAN

DATE: AS SHOWN	SCALE FACTOR: 1.1
DATE: 08/22/2025	DRAWN BY: SEE
PROJECT NUMBER: 276482	CHECKED BY: EJM


M207
DWG NO: 8 of 12
DATE: 187 of 452
REV NO: 1
COMPUTER FILE NO: 17AN-M207
REV NO: 1



50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PLOTTED: 10/22/2025
STATUS: 50% SUBMISSION

C:\PW\WORKSP\1710718117AN\M208.DWG

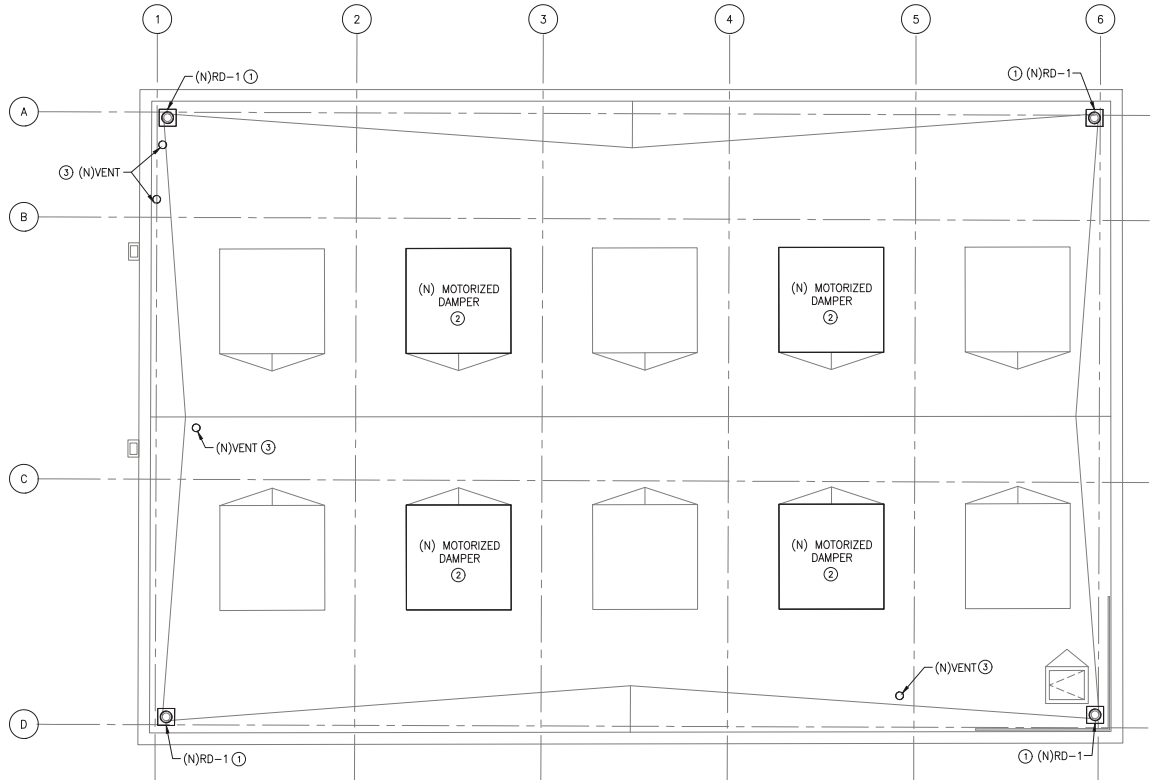

1
M208 PROPOSED ROOF PLAN
SCALE: 3/16" = 1'-0"



GENERAL NOTES:

1. REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
2. REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
3. REFER TO DRAWING M211 FOR DETAILS.

KEYED NOTES:

- ① THOROUGHLY CLEAN RAIN LEADERS WITHIN THE WALL PRIOR TO CONNECTING NEW ROOF DRAIN.
- ② PROVIDE NEW MOTORIZED DAMPERS WITH SAME PROPERTIES AS THE EXISTING DAMPERS. PROVIDE NECESSARY MOUNTING BRACKETS AND APPARATUS TO HAVE FULLY FUNCTIONAL DAMPERS.
- ③ THOROUGHLY CLEAN OUTDOOR AIR INTAKE OPENING AND DUCTWORK PRIOR TO INSTALLING NEW ROOF CAP.



SEPTA PROJECT NO.	
DRPA PROJECT NO.	
SEPTA PROJECT NO.	
DRPA PROJECT NO.	
PROJECT NO.	
PROJECT NAME	

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
PROPOSED ROOF PLAN

SCALE	AS SHOWN	SCALE FACTOR	1:1
DATE	08/22/2025	DRAWN BY	DAF
PROJECT NO.	276482	CHECKED BY	DAF
SHEET NUMBER	M208		
	9	OF	12
	188	OF	452
COMPUTER FILE NO.	17AN-M208		

6 4 2 0 6
SCALE: 3/16"=1'0"

50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PRINTED: 10/21/2025
STATUS: 50% SUBMISSION




REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
ENLARGED PLANS

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DGP
		CHECKED BY:	LJM
WORK ORDER NO.:	276482		
SHEET NUMBER:	M209		
DWG. NO.:	10	OF:	12
	189	OF:	452
PROJECT FILE NO.:	17AN-M209		


- GENERAL NOTES:**
- REFER TO DRAWING M200 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
 - REFER TO DRAWING M210 FOR SCHEDULES AND CONTROLS.
 - REFER TO DRAWING M211 FOR DETAILS.

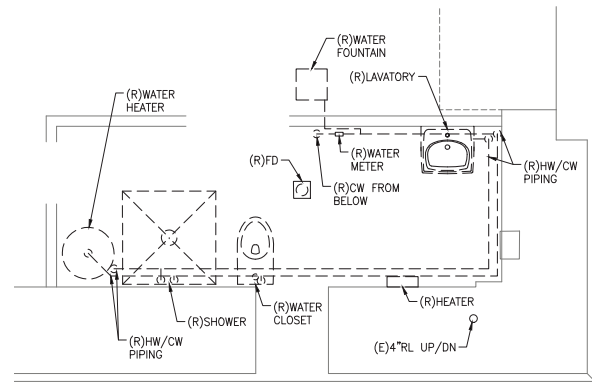

1 RESTROOM REMOVAL PLAN
SCALE: 1/2" = 1'-0"

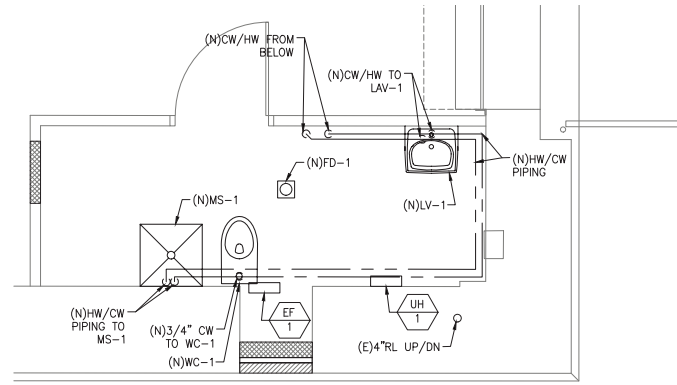

2 RESTROOM PROPOSED PLAN
SCALE: 1/2" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION

ENERGY RECOVERY VENTILATOR																														
TAG	LOCATION	FRESH AIR		EXHAUST		SUPPLY FAN			EXHAUST FAN			WHEEL		ENERGY RECOVERY WHEEL DATA - COOLING					ENERGY RECOVERY WHEEL DATA - HEATING			ELECTRICAL DATA		MAXIMUM DIMENSIONS		MAXIMUM		BASIS OF DESIGN		REMARKS
		CFM	CFM	EXT. SP. (IN WC)	QTY	FAN HP EACH	EXT. SP. (IN WC)	QTY	FAN HP EACH	MOTOR HP	EAT DB (F)	EAT WB (F)	LAT DB (F)	LAT WB (F)	EFFECTIVENESS (%)	EAT DB (F)	LAT DB (F)	EFFECTIVENESS (%)	V/θ/HZ	MCA	MCCP	L x W x H (IN)	WEIGHT (LBS)	MANUFACTURER	MODEL					
ERV-1	BATTERY ROOM	440	440	0.5	1	1/4	0.5	1	1/4	-	93.2	78.3	82.2	69.4	60.7	12.6	47.4	60.7	120/1/60	8.6	15	40.2X28.6X17.9	160	GREENHECK	MINIVENT-450	SEE NOTES				

- NOTES:
 1. PROVIDE SIDE WALL MOUNTING BRACKETS. INTERLOCK THE ENERGY RECOVERY VENTILATOR AND THE SPLIT UNIT TO OPERATE IN UNISON VIA A SINGLE THERMOSTAT.
 2. REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.

GRILLE/REGISTER/DIFFUSER SCHEDULE									
TAG	DESCRIPTION	FRAME TYPE	CFM RANGE	AIR DEVICE SIZE	NECK SIZE	FACE SIZE	FINISH	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS

INFRARED RADIANT HEATER SCHEDULE								
TAG	CAPACITY (KW)	LENGTH	WIDTH	ELEMENT TYPE	ELECTRICAL	AMPS	MANUFACTURER AND MODEL	REMARKS
IRH-1	3	55.4"	5.4"	FROSTED QUARTZ	208/1/60	14.4	FOSTORIA OCH-57-208V	11 LBS. WITH VERTICAL MOUNTING BRACKET

- NOTES:
 1. REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.

SPLIT SYSTEM SCHEDULE										
TAG	AREA SERVED	TOTAL COOLING CAPACITY (MBH)	TOTAL HEATING CAPACITY (MBH)	SEER	REFRIGERANT	ELECTRICAL			MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
						OUTDOOR MCA	BREAKER SIZE (A)	V/θ/HZ		
AC-1/ CU-1	BATTERY ROOM	12	14	22	R410A	25	15	208/1/60	MITSUBISHI MOD# MSZ-GL12NA-U1 FOR INDOOR AND MOD# MUZ-GL12NA-U1 FOR OUTDOOR	1
AC-2/ CU-2	OFFICE	9	10	N/A	R410A	25	15	208/1/60	MITSUBISHI MOD# MSZ-GL09NA-U1 FOR INDOOR AND MOD# MUZ-GL09NA-U1 FOR OUTDOOR	2

- NOTES:
 1. CONTROL SPLIT HEAT PUMP UNIT AND ENERGY RECOVERY VENTILATOR WITH A SINGLE THERMOSTAT USING A PROGRAMMABLE CONTROLLER.
 2. CONTROL SPLIT HEAT PUMP UNIT WITH A UNIT MOUNTED THERMOSTAT.

PLUMBING SCHEDULE						
TAG	DESCRIPTION	FIXTURE CONNECTION SIZE (IN)				MANUFACTURER & MODEL NO. (BASIS OF DESIGN)
		CW	HW	SAN	V	
WC-1	WATER CLOSET	3/4	-	3	2	AMERICAN STANDARD CADET FLOWISE MODEL 2462.100. VITREOUS CHINA, HIGH EFFICIENCY 1.1 GPF ULTRA-LOW CONSUMPTION, ELONGATED BOWL. PROVIDE AMERICAN STANDARD SEAT MODEL 5324.019.
LAV-1	LAVATORY	1/2	1/2	1 1/4	1 1/4	AMERICAN STANDARD LUCERNE WALL-HUNG (ADA) LAVATORY MODEL 0356.421, WALL MOUNTED SINGLE HOLE. 1 1/4" P-TRAP WITH GRID DRAIN 1/2" SUPPLIES WITH STOPS. PROVIDE AMERICAN STANDARD MODEL 1480100 FAUCET WITH A WATTS MODEL LFL1170-M2 MIXING VALVE. PROVIDE S-PRAP ASSEMBLY.
FD-1	FLOOR DRAIN	-	-	3	3	JAY R. SMITH MODEL NUMBER 2005Y ROUND TOP NICKEL BRONZE STRAINER(6"ROUND). PROVIDE P-TRAP FOR EACH DRAIN.
MS-1	MOP SINK	1/2	1/2	3	3	ZURN MODEL Z1996-24. SIZE 24" X 24". PROVIDE SERVICE SINK FAUCET ZURN MODEL Z1996-SF AND WATTS MODEL LFL1170-M2 MIXING VALVE.
RD-1	ROOF DRAIN	-	-	4	-	JAY R. SMITH MODEL NUMBER 1330Y-RDP WITH VANDAL PROOF DOME, UNDERDECK CLAMP-C AND EXTENSION.

ELECTRIC WATER HEATER SCHEDULE				
TAG	AREA SERVED	ELECTRICAL		MANUFACTURER & MODEL NO. (BASIS OF DESIGN)
		KW	V/θ/HZ	
EWH-1	TOILET ROOM AND BASEMENT	16	208/1/60	EEMAX ELECTRIC TANKLESS HOT WATER HEATER MODEL # EX1608TC ML

SUMP PUMP SCHEDULE						
TAG	AREA SERVED	GPM	HEAD (FT)	ELECTRICAL		MANUFACTURER & MODEL NO. (BASIS OF DESIGN)
				HP	V/θ/HZ	
SP-1	BASEMENT SUMP PIT	30	25	1/2	120/1/60	LIBERTY PUMPS MODEL 281-2, CLASS 25 CAST-IRON, VORTEX ENGINEERED IMPELLER, AUTOMATIC RESET, PROVIDE CONTROLS AND DISCONNECT SWITCH.

UNIT HEATER SCHEDULE						
TAG	BTU	CFM	POWER (KW)	V/θ/HZ	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
EUH-1	6138	100	1	120/1/60	QMARK MOD# CWH3180F	SEE NOTES

- NOTES:
 1. REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.

AIR COMPRESSOR SCHEDULE							
TAG	CAPACITY (GAL.)	MAX PSI	CFM@ 90PSI	HP	V/θ/HZ	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
CA-1	80	140	16	5	208/1/60	CAMPBELL HAUSFELD MODEL TQ3104	SEE NOTES

- NOTES:
 1. REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.


EXHAUST FAN SCHEDULE				
TAG	CFM	V/θ/HZ	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
EF-1	180	120/1/60	BROAN WALL FAN MODEL 509	



PROJECT NUMBER: _____
 DATE: _____
 PROJECT LOCATION: _____
 PROJECT OWNER: _____
 PROJECT MANAGER: _____



HDR Engineering, Inc.
 Philadelphia, PA




REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION MECHANICAL SCHEDULES


SHEET NO. AS SHOWN
 DATE: 08/22/2025
 DRAWN BY: DGP
 CHECKED BY: LHM
 SHEET NUMBER: 276482
M210
 SHEET NO. 11 OF 12
 REV. NO. 190 OF 452
 PROJECT NO. _____
 COMPUTER FILE NO. 17AN-M210
 REV. NO. 1

50% SUBMISSION
 NOT FOR CONSTRUCTION


C:\PWORKING\SP1710\171017\17AN-M211.DWG

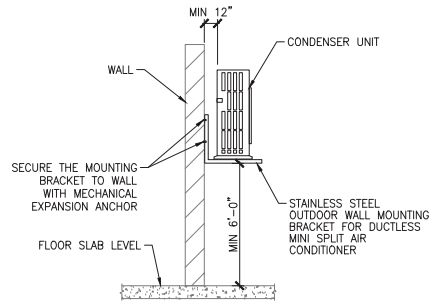


1 CONDENSER WALL MOUNTING DETAIL
SCALE: NO SCALE

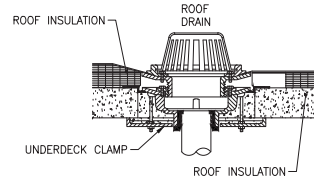


2 ROOF DRAIN DETAIL
SCALE: NO SCALE

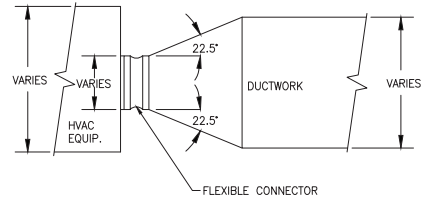

3 TYPICAL SUPPLY DUCT TRANSITION
SCALE: NO SCALE

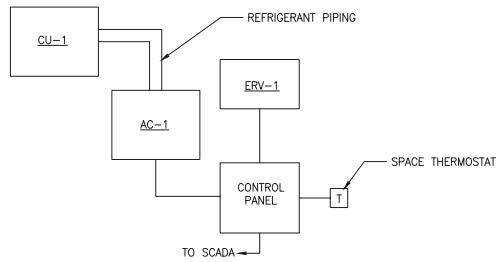

4 BATTERY ROOM CONTROL DIAGRAM
SCALE: NO SCALE

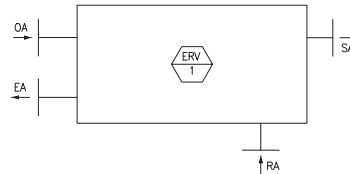

5 ERV DUCT CONNECTION-ELEVATION
SCALE: NO SCALE



HDR Engineering, Inc.
 1328 MARKET ST., 8TH FL.
 PHILADELPHIA, PA 19107



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
MECHANICAL
 MISCELLANEOUS DETAILS

SCALE	AS SHOWN	SCALE FACTOR	1:1
DATE	08/22/2025	DRAWN BY	DGP
WORK ORDER NO.	276482	CHECKED BY	JLM
SHEET NUMBER	M211		
DWG NO.	12	OF	12
REV NO.	191	OF	452
COMPUTER FILE NO.	17AN-M211		

50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

ELECTRICAL / LIGHTING SYMBOLS:

SYMBOL	DESCRIPTION
	PANEL, 208/120V PANEL. REFER TO DRAWINGS E216 AND E217 FOR PANEL SCHEDULES.
	INDUSTRIAL LED LUMINAIRE, ENCLOSED/WET LOCATION. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	INDUSTRIAL LUMINAIRE ENCLOSED/WET LOCATION, CONNECTED TO EMERGENCY CIRCUIT. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	UP/DOWN COLUMN MOUNTED EXTERIOR LUMINAIRE. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	WALL MOUNTED LUMINAIRE, TYPE AS NOTED. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	CEILING MOUNTED LUMINAIRE. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	DOCK LIGHT, 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	EXIT SIGN, SINGLE FACE, WALL MOUNTED. ARROW INDICATES CHEVRON DIRECTION. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	EXIT SIGN, SINGLE FACE, CEILING MOUNTED. ARROW INDICATES CHEVRON DIRECTION. 'XX' REPRESENTS DESIGNATION. REFER TO DRAWING E215 FOR LUMINAIRE SCHEDULE.
	20A, 120/277V AC, SINGLE POLE TOGGLE SWITCH. 'a' DENOTES SWITCH ZONE.
	20A, 120/277V AC, THREE-WAY SWITCH.
	MANUAL MOTOR STARTER (MATCH VOLTAGE, PHASE AND AMPACITY TO EQUIPMENT SERVED).
	DUPLEX RECEPTACLE, NEMA 5-20R, 20A, 125V.
	DUPLEX RECEPTACLE, NEMA 5-20R, 20A, 125V WITH (GFCI) GROUND FAULT CURRENT INTERRUPTER PROTECTION.
	DUPLEX RECEPTACLE, NEMA 5-20R, 20A, 125V WITH (GFCI) GROUND FAULT CURRENT INTERRUPTER PROTECTION IN A WEATHER-PROOF ENCLOSURE.
	QUADRUPLEX RECEPTACLE, TWO (2) NEMA 5-20R, 20A, 125V.
	SPECIAL RECEPTACLE.
	MOTOR.
	NON-FUSIBLE DISCONNECT SWITCH, 30A/3P, 600V UNLESS OTHERWISE NOTED.
	FUSIBLE DISCONNECT SWITCH, SIZE AS NOTED. WP REPRESENTS WEATHER-PROOF NEMA 3R ENCLOSURE.
	BRANCH CIRCUIT HOMERUN INDICATES PANEL AND CIRCUIT BREAKER NUMBER.
	JUNCTION BOX.
	TRANSFORMER, TYPE AS NOTED.
	SUMP PUMP.
	PECO UTILITY METER.
	PECO UTILITY POLE.
	30A CUTOUT FUSE.
	HYDROGEN DETECTOR

DETAIL CALLOUT SYMBOLS:

	EQUIPMENT CALLOUT REFER TO MECHANICAL, FIRE PROTECTION AND PLUMBING FOR ADDITIONAL INFORMATION.
	DETAIL # DRAWING #
	SECTION # DRAWING #


LINETYPE CONVENTIONS:

	ELECTRICAL EQUIPMENT DESIGNATED BY SOLID HEAVY LINE WEIGHT INDICATES NEW WORK TO BE FURNISHED AND INSTALLED.
	ELECTRICAL EQUIPMENT DESIGNATED BY SOLID LIGHT LINE WEIGHT INDICATES EXISTING EQUIPMENT TO REMAIN, UNLESS OTHERWISE INDICATED.
	ELECTRICAL EQUIPMENT DESIGNATED BY DASHED HEAVY LINE WEIGHT REPRESENTS EXISTING EQUIPMENT TO BE REMOVED AND DISPOSED, UNLESS INDICATED TO BE REMOUNTED, RELOCATED OR TURNED OVER TO SEPTA.

SINGLE LINE SYMBOLS:

SYMBOL	DESCRIPTION
	CIRCUIT BREAKER, RATING AS INDICATED
	DISCONNECT SWITCH, RATING AS INDICATED
	FUSED DISCONNECT SWITCH, RATING AS INDICATED
	FUSE, RATING AS INDICATED
	DRAWOUT CIRCUIT BREAKER, RATING AS INDICATED
	TRANSFORMER, RATING AS INDICATED
	SHIELDED ISOLATION TRANSFORMER, RATING AS INDICATED
	15KV-120V POTENTIAL TRANSFORMER UPPER NUMBER: RATIO LOWER NUMBER: QUANTITY OF XFMR
	EXOTHERMIC WELD
	GROUND
	BATTERIES
	GENERATOR, RATINGS AS INDICATED
	AUTOMATIC TRANSFER SWITCH, RATINGS AS INDICATED
	DROPPING RESISTORS, RATINGS AS INDICATED
	NON-UTILITY CURRENT TRANSFORMER AND METER

STANDARD MOUNTING HEIGHTS:

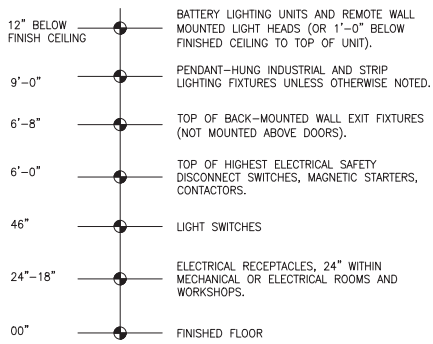


- NOTES:
1. MOUNTING HEIGHTS TO CENTER OF OUTLETS UNLESS OTHERWISE NOTED.
 2. THE ABOVE MOUNTING HEIGHTS SHALL BE ADHERED TO UNLESS NOTED OTHERWISE ON THE DRAWINGS OR SPECIFICATION.

ELECTRICAL ABBREVIATIONS:

(E)	EXISTING WORK -- EQUIPMENT TO REMAIN	MOCPP	MAXIMUM OVERCURRENT PROTECTION
(ER)	EXISTING WORK -- EQUIPMENT TO BE REMOVED AND RELOCATED/REPLACED	MOPD	MAXIMUM OVERCURRENT PROTECTIVE DEVICE
(N)	NEW WORK -- EQUIPMENT	MTR	MOTOR
(R)	EXISTING EQUIPMENT TO BE DISCONNECTED AND REMOVED	#	NUMBER
(RE)	RELOCATED/REPLACED EXISTING WORK	N	NEUTRAL
A, AMPS	AMPERES	NEC	NATIONAL ELECTRICAL CODE
AC	ALTERNATING CURRENT, AIR CONDITIONER	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
AF	AMPERES, FRAME	NIC	NOT IN CONTRACT
AFF	ABOVE FINISHED FLOOR	NVS	NETWORK VIDEO STORAGE
AFG	ABOVE FINISHED GRADE	O	OPEN
AS	AMPERES, SWITCH	OVHD	OVERHEAD
AT	AMPERES, TRIP	P	POLE
ATS	AUTOMATIC TRANSFER SWITCH	PH, Ø	PHASE
AVG	AVERAGE	PT	POTENTIAL TRANSFORMER
AWG	AMERICAN WIRE GAUGE	PWR	POWER
BATT	BATTERY	QTY	QUANTITY
BCW	BARE COPPER WIRE	RMC	RIGID METAL CONDUIT
BKR	BREAKER	RMS	ROOT-MEAN-SQUARE
C	CLOSED	RNC	RIGID NON-METALLIC CONDUIT
C OR CND	CONDUIT	RTU	REMOTE TERMINAL UNIT
CA	COMPRESSOR	S	SECURITY
CALC	CALCULATION	SC	SECURITY CAMERA
CLG	CEILING, EQUIPMENT MOUNTED EITHER ON OR IN CEILING AREA	SCADA	SUPERVISORY CONTROL AND DATA ACQUISITION
CT	CURRENT TRANSFORMER	SCCR	SHORT CIRCUIT CURRENT RATING
CTRL	CONTROL	SLC	SIGNALING LINE CIRCUIT
CU	CONDENSER	SMR	SURFACE METAL RACEWAY
DC	DIRECT CURRENT	SP	SUMP PUMP
ECB	ENCLOSED CIRCUIT BREAKER	STP	SHIELDED TWISTED PAIR
EF	EXHAUST FAN	SWGR	SWITCHGEAR
EMH	ELECTRICAL MANHOLE	SYM.	SYMMETRICAL
EMT	ELECTRICAL METALLIC TUBING	TBD	TO BE DETERMINED
EPO	EMERGENCY POWER OFF	TCOM	TELECOMMUNICATIONS
ERV	ENERGY RECOVERY VENTILATION UNIT	TDDE	TIME-DELAY DUAL ELEMENT (FUSES)
ETC	ET CETERA	TVSS	TRANSIENT VOLTAGE SURGE SUPPRESSION
EWH	ELECTRIC WATER HEATER	TYP	TYPICAL
FA	FIRE ALARM	UE	UNDERGROUND ELECTRIC
FAAP	FIRE ALARM ANNUNCIATOR PANEL	UH	UNIT HEATER
FACP	FIRE ALARM CONTROL PANEL	UON	UNLESS OTHERWISE NOTED
FMC	FLEXIBLE METAL CONDUIT	UPS	UNINTERRUPTIBLE POWER SOURCE
FOIC	FIBER OPTIC INTERFACE CABINET	V	VOLTS
FP	FIRE PROTECTION	VA	VOLT AMPS
G OR GND	GROUND	VF	VERIFY IN FIELD
GFCI OR GFI	GROUND FAULT CIRCUIT INTERRUPTER	VP	VACUUM PUMP
GRS	GALVANIZED RIGID STEEL	VT	VOLTAGE TRANSFORMER
HOA	HAND/OFF/AUTO	W	WIRE
HZ	HERTZ	WC	WATER COOLER CONNECTION
INC	INCANDESCENT LIGHT	WESS	WAYSIDE ENERGY STORAGE SYSTEM
IRH	INFRARED RADIANT HEATER	WP	WEATHERPROOF
IT	INFORMATION TECHNOLOGY	XFMR	TRANSFORMER
IDS	INTRUSION DETECTION SYSTEM		
KA	KILO AMPERES		
KAIC	KILO AMPERES, INTERRUPTING CAPACITY		
KCMIL	KILO CIRCULAR MILS		
KV	KILOVOLTS		
KVA	KILOVOLT AMPERES		
KW	KILOWATTS		
L	LINE		
LCD	LIQUID CRYSTAL DISPLAY		
LED	LIGHT EMITTING DIODE		
LFMC	LIGHTTIGHT FLEXIBLE METAL CONDUIT		
LS	LIGHTING STANDARD		
LSIG	LONG-TIME, SHORT-TIME, INSTANTANEOUS AND GROUND FAULT		
MAX	MAXIMUM		
MCB	MAIN CIRCUIT BREAKER		
MH	METAL HALIDE LIGHT		
MIN	MINIMUM		
MLO	MAIN LUGS ONLY		

50% SUBMISSION
NOT FOR CONSTRUCTION



1228 MARKET ST., 10TH FL. PHILADELPHIA, PA 19107

DATE PLOTTED: 08/22/2025

PROJECT: SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION ELECTRICAL

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

SCALE: 1:1

DATE: 08/22/2025

PROJECT NUMBER: 276482

E200


1 OF 18

SHEET NO: 192 OF 433

COMPUTER FILED: 17AN-E200

DEMOLITION SCOPE OF WORK:

- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING TRANSFORMERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING PANELS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- D. DEMOLITION OF EXISTING DISCONNECT SWITCHES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- E. DEMOLITION OF EXISTING TRANSFER SWITCH AND ASSOCIATED CONDUIT AND CIRCUITRY.
- F. DEMOLITION OF EXISTING BATTERY CHARGERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- G. DEMOLITION OF EXISTING BATTERIES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- H. DEMOLITION OF EXISTING BATTERY RESISTOR AND ASSOCIATED CONDUIT AND CIRCUITRY.
- I. DEMOLITION OF EXISTING BATTERY SELECTOR PANEL AND ASSOCIATED CONDUIT AND CIRCUITRY.
- J. DEMOLITION OF EXISTING CONDUIT AND CIRCUITRY TO MECHANICAL ITEMS.
- K. DEMOLITION OF EXISTING RECEPTACLES AND ASSOCIATED CONDUIT AND CIRCUITRY.

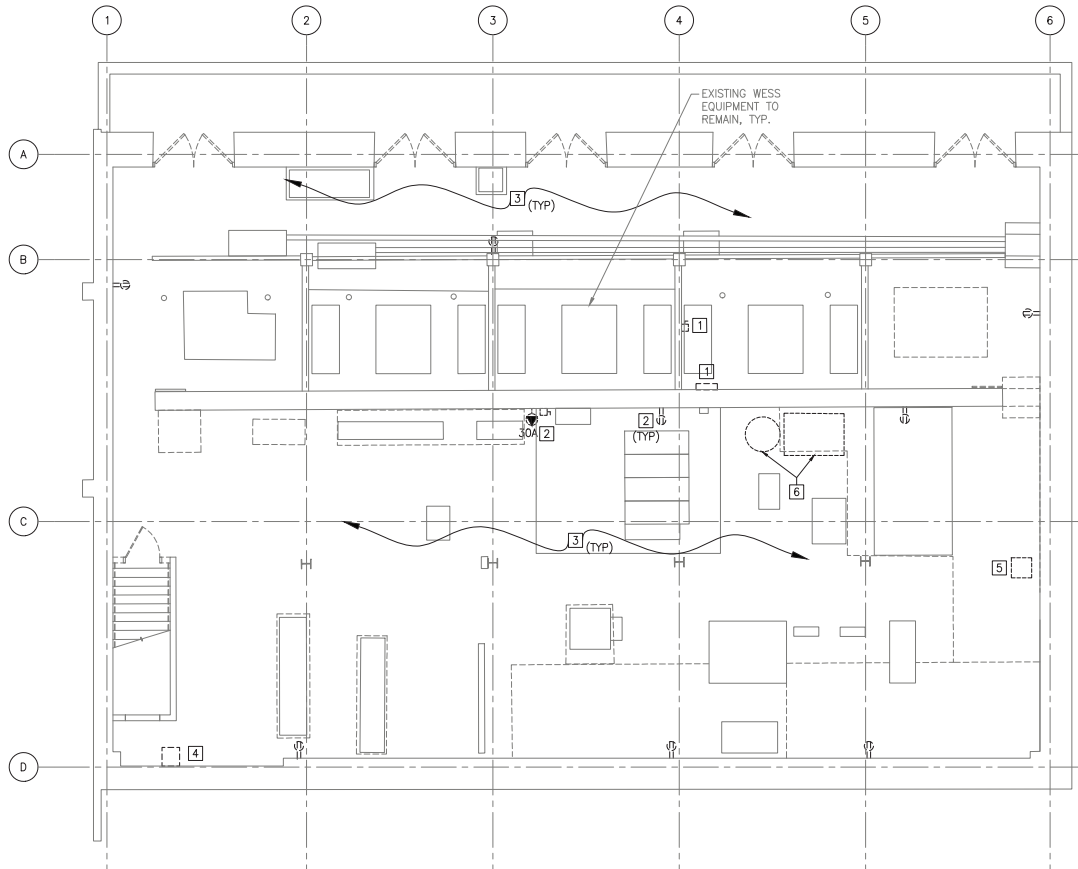


1 BASEMENT REMOVAL FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND BE REMOVED BACK TO SOURCE.

KEYED NOTES:

- 1 DE-ENERGIZE AND REMOVE "BATTERY DIST. PANEL #1" AND 200A BATTERY DISCONNECT SWITCH.
- 2 REMOVE ALL RECEPTACLES AND ASSOCIATED WIRE AND CONDUIT BACK TO SOURCE.
- 3 DE-ENERGIZE AND REMOVE ALL DEVICES, EQUIPMENT, WIRE AND CONDUIT IN THIS AREA.
- 4 REMOVE DOOR CONTACT AND WIRING BACK TO SOURCE.
- 5 DE-ENERGIZE AND REMOVE SUMP PUMP CIRCUIT.
- 6 DE-ENERGIZE AND REMOVE AIR COMPRESSOR CIRCUIT.



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
DEMOLITION POWER BASEMENT FLOOR PLAN

DATE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	MR
PROJECT NUMBER:	276482	CHECKED BY:	JR
SHEET NUMBER:	E201		
TOTAL SHEETS:	2	OF:	18
SHEET NO.:	193	OF:	452
PROJECT FILE NO.:	17AN-E201		

C:\PWORKING\PTD\17AN\17AN-E201.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

DEMOLITION SCOPE OF WORK:


- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING TRANSFORMERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING PANELS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- D. DEMOLITION OF EXISTING DISCONNECT SWITCHES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- E. DEMOLITION OF EXISTING TRANSFER SWITCH AND ASSOCIATED CONDUIT AND CIRCUITRY.
- F. DEMOLITION OF EXISTING BATTERY CHARGERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- G. DEMOLITION OF EXISTING BATTERIES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- H. DEMOLITION OF EXISTING DROPPING RESISTORS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- I. DEMOLITION OF EXISTING BATTERY TRANSFER PANEL AND ASSOCIATED CONDUIT AND CIRCUITRY.
- J. DEMOLITION OF EXISTING CONDUIT AND CIRCUITRY TO MECHANICAL ITEMS.
- K. DEMOLITION OF EXISTING RECEPTACLES AND ASSOCIATED CONDUIT AND CIRCUITRY.

GENERAL NOTES:

- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
- 2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
- 3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
- 4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
- 5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
- 6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
- 7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
- 8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
- 9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
- 10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND BE REMOVED BACK TO SOURCE.
- 11. THE DEMOLITION OF THE EXISTING FIRE ALARM SYSTEM WILL NOT COMMENCE UNTIL THE NEW FIRE ALARM SYSTEM IS FULLY INSTALLED AND ACCEPTED BY THE AUTHORITY HAVING JURISDICTION AND SEPTA.

KEYED NOTES:

- 1 DE-ENERGIZE AND REMOVE "ATS1 SUB PANEL 1", 208/120V 3Ø, 4W 400A MCB.
- 2 DE-ENERGIZE AND REMOVE "ATS1 SUB PANEL 2" 208/120V 100A MCB.
- 3 DE-ENERGIZE AND REMOVE BATTERY CHARGER.
- 4 DE-ENERGIZE AND REMOVE "A/C DIST PANEL", 208/120V 3Ø, 4W 100A MCB.
- 5 DE-ENERGIZE AND REMOVE BATTERIES AND 200A BATTERY DISCONNECT SWITCH.
- 6 DE-ENERGIZE AND REMOVE BATTERY TRANSFER PANEL.
- 7 DE-ENERGIZE AND REMOVE ALL RECEPTACLES AND ASSOCIATED WIRE AND CONDUIT BACK TO SOURCE.
- 8 DE-ENERGIZE AND REMOVE ELECTRICITY METERS.
- 9 DE-ENERGIZE AND REMOVE OVERHEAD DOOR MOTOR AND CONTROL.
- 10 DE-ENERGIZE AND REMOVE ALL DEVICES, EQUIPMENT, WIRE AND CONDUIT IN THIS AREA.
- 11 DE-ENERGIZE AND REMOVE COMPRESSOR CIRCUIT.
- 12 DE-ENERGIZE AND REMOVE HEATER CIRCUIT.
- 13 DE-ENERGIZE AND REMOVE POWER TO FIRE ALARM CONTROL PANEL. REMOVE FIRE ALARM DISCONNECT SWITCH.
- 14 DE-ENERGIZE AND REMOVE BATTERY DISTRIBUTION PANEL.
- 15 DE-ENERGIZE AND REMOVE 400A ATS1.
- 16 DE-ENERGIZE AND REMOVE DOOR INTRUSION ALARM PANEL, ASSOCIATED EQUIPMENT AND WIRING.
- 17 REMOVE DOOR CONTACT AND WIRING BACK TO SOURCE.
- 18 DE-ENERGIZE AND REMOVE WINDOW UNIT CIRCUIT.
- 19 DE-ENERGIZE AND REMOVE WATER COOLER CIRCUIT.
- 20 DE-ENERGIZE AND REMOVE WATER HEATER CIRCUIT.
- 21 DE-ENERGIZE AND REMOVE WATER FOUNTAIN CIRCUIT.
- 22 DE-ENERGIZE AND REMOVE DISCONNECT SWITCH AND CIRCUIT.
- 23 DE-ENERGIZE AND REMOVE DROPPING RESISTORS.

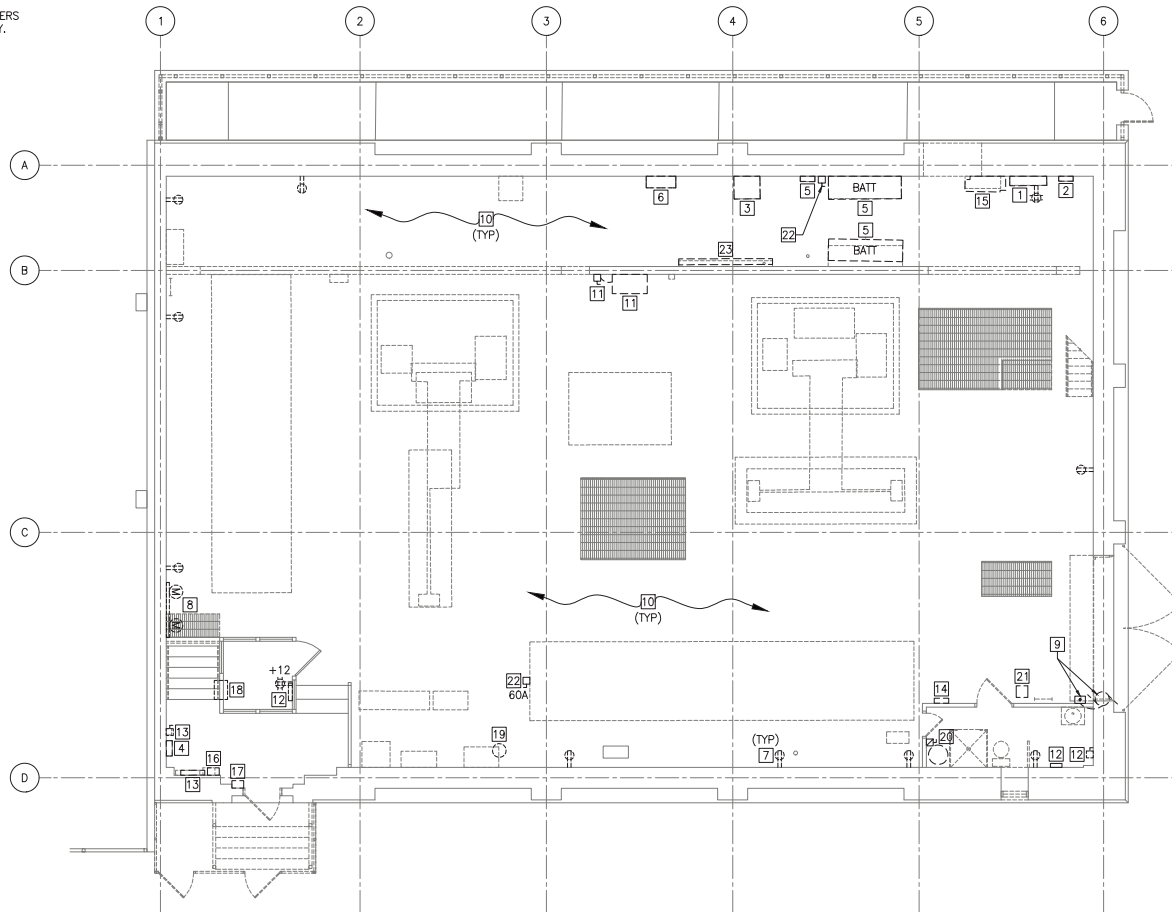

1 MAIN FLOOR REMOVAL PLAN
 SCALE: 3/16" = 1'-0"



50% SUBMISSION
 NOT FOR CONSTRUCTION



DATE PREPARED:	
DATE REVISIONS:	
DATE CHECKED:	
DATE APPROVED:	
DATE SUBMITTED:	
DATE RECEIVED:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA



NO.	DATE	BY	DESCRIPTION

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REBATE ELECTRICAL
 DEMOLITION POWER FIRST FLOOR PLAN


SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	MR
PROJECT NO.:	276482	CHECKED BY:	JR
SHEET NO.:	E202		
TOTAL SHEETS:	3	OF	18
REV. NO.:	194	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E202	REV. DATE:	

C:\PWORKING\PT\2025\17AN-E202.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

DEMOLITION SCOPE OF WORK:

- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING TRANSFORMERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING PANELS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- D. DEMOLITION OF EXISTING DISCONNECT SWITCHES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- E. DEMOLITION OF EXISTING TRANSFER SWITCH AND ASSOCIATED CONDUIT AND CIRCUITRY.
- F. DEMOLITION OF EXISTING BATTERY CHARGERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- G. DEMOLITION OF EXISTING BATTERIES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- H. DEMOLITION OF EXISTING BATTERY RESISTOR AND ASSOCIATED CONDUIT AND CIRCUITRY.
- I. DEMOLITION OF EXISTING BATTERY SELECTOR PANEL AND ASSOCIATED CONDUIT AND CIRCUITRY.
- J. DEMOLITION OF EXISTING CONDUIT AND CIRCUITRY TO MECHANICAL ITEMS.
- K. DEMOLITION OF EXISTING RECEPTACLES AND ASSOCIATED CONDUIT AND CIRCUITRY.

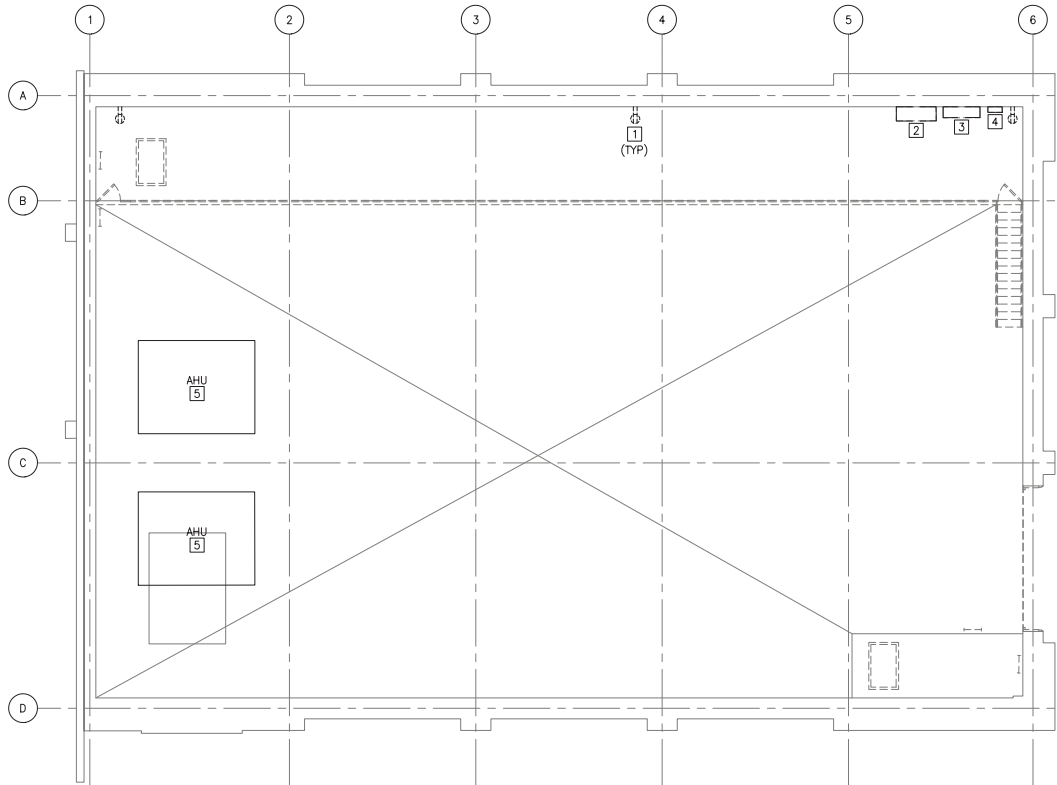

MEZZANINE REMOVAL FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND BE REMOVED BACK TO SOURCE.

KEYED NOTES:

- 1 DE-ENERGIZE AND REMOVE ALL RECEPTACLES AND ASSOCIATED WIRE AND CONDUIT BACK TO SOURCE.
- 2 DE-ENERGIZE AND REMOVE 400A ATSS.
- 3 DE-ENERGIZE AND REMOVE "ATS2 SUB PANEL 1", 208/120V 3Ø, 4W 400A MCB.
- 4 DE-ENERGIZE AND REMOVE "ATS2 SUB PANEL 2", 208/120V 100A MCB.
- 5 DE-ENERGIZE AND REMOVE AIR HANDLING UNIT CIRCUIT.



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
DATE:	
PROJECT MANAGER:	



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
DEMOLITION POWER MEZZANINE FLOOR PLAN


TITLE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	MR
WORK ORDER NO.:	276482	CHECKED BY:	JR
SHEET NUMBER:	E203		
TOTAL NO. SHEETS:	4	OF:	18
SHEET NO.:	195	OF:	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E203		
REV. NO.:			

C:\PW\WORKING\PTT\072118\17AN-E203.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

DEMOLITION SCOPE OF WORK:

- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.

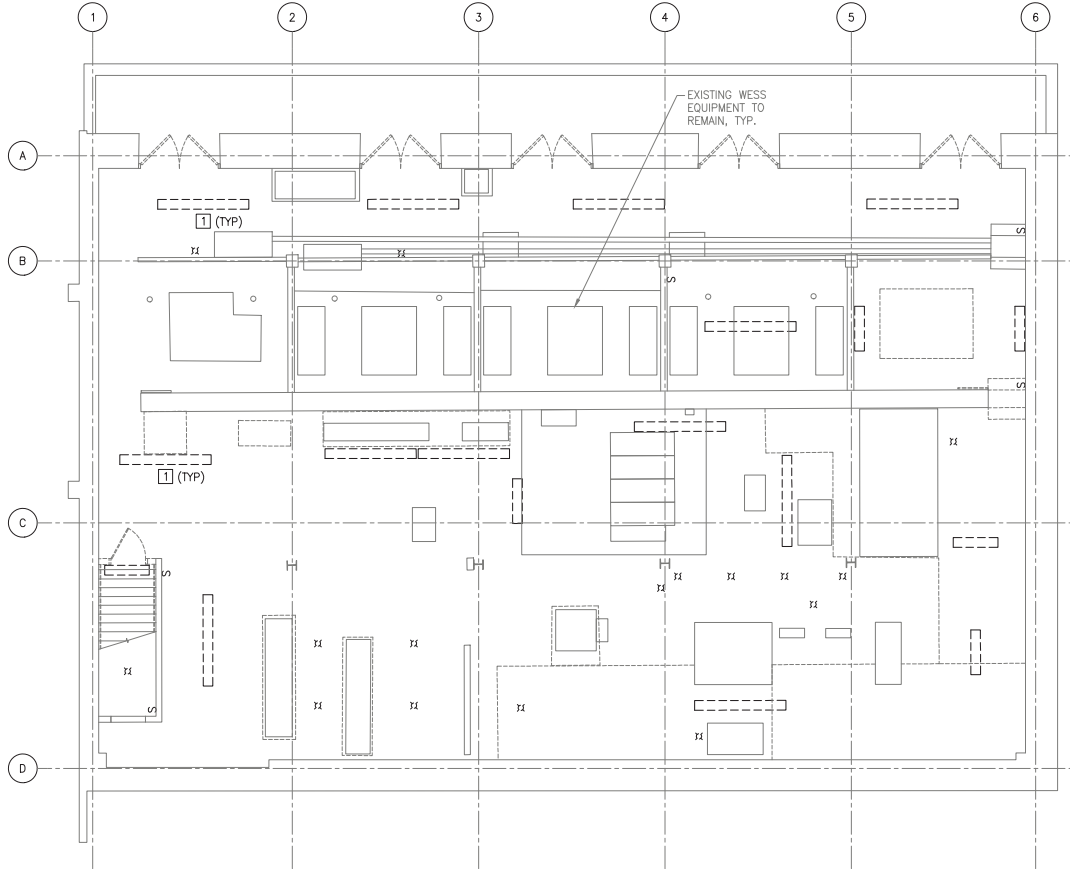

1
E204 BASEMENT LIGHTING REMOVAL FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND BE REMOVED BACK TO SOURCE.

KEYED NOTES:

- 1** DE-ENERGIZE AND REMOVE LIGHTING FIXTURES AND SWITCHES. REMOVE ALL WIRE AND CONDUIT BACK TO SOURCE.



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	DATE:
DRY ENGINEERING OFFICE:	DATE:
DRY FIELD PROJECT OFFICE:	DATE:
UNIVERSITY:	DATE:
DIRECTOR OF ENGINEERING:	DATE:
MANAGER:	DATE:
PROJECT MANAGER:	DATE:

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
DEMOLITION LIGHTING BASEMENT FLOOR PLAN


SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	TR
WORK ORDER NO.:	276482	CHECKED BY:	JR
SHEET NUMBER:	E204		
DWG. NO.:	5	OF	18
REV. NO.:	196	OF	452
PROJECT FILE NO.:	17AN-E204		

C:\P\WORKING\170721\17AN-E204.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

DEMOLITION SCOPE OF WORK:

- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.

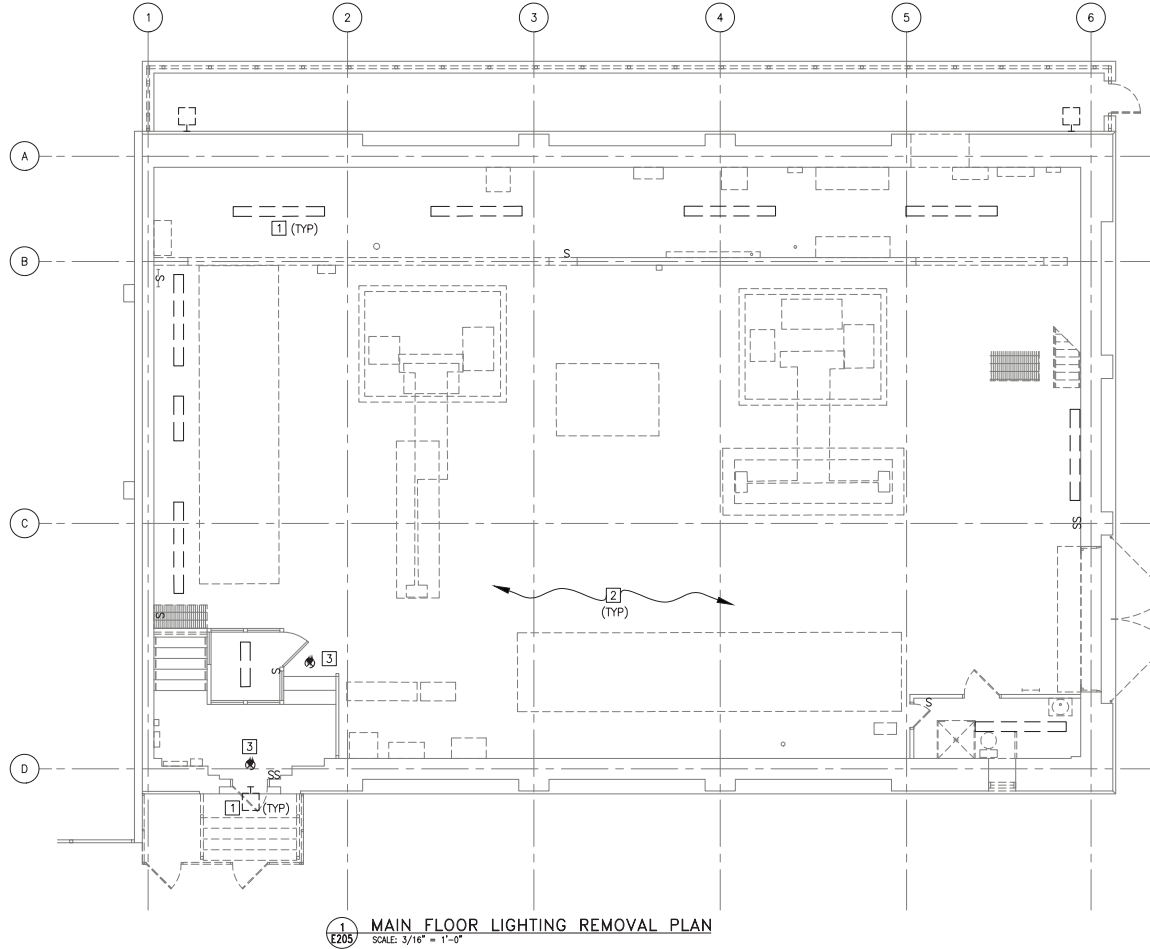

1
E205 MAIN FLOOR LIGHTING REMOVAL PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND BE REMOVED BACK TO SOURCE.

KEYED NOTES:

- 1** DE-ENERGIZE AND REMOVE LIGHTING FIXTURES AND SWITCHES. REMOVE ALL WIRE AND CONDUIT BACK TO SOURCE.
- 2** DE-ENERGIZE AND REMOVE LIGHTS, SWITCHES, WIRE AND CONDUIT IN THIS AREA.
- 3** DE-ENERGIZE AND REMOVE EXIT SIGN. REMOVE ALL WIRE AND CONDUIT BACK TO SOURCE.



50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	
DATE ENGINEERING CHECKED:	
DATE FIELD INSPECTED:	
DESIGNED BY:	
DRAWN BY:	
CHECKED BY:	
PROJECT NUMBER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
DEMOLITION LIGHTING FIRST FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	MR
WORK ORDER NO.:	276482	CHECKED BY:	JR
SHEET NUMBER:	E205		
DWG. NO.:	6	OF	18
PT. NO.:	197	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E205		


C:\PWORKING\PTT\072118\17AN-E205.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

DEMOLITION SCOPE OF WORK:

- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.

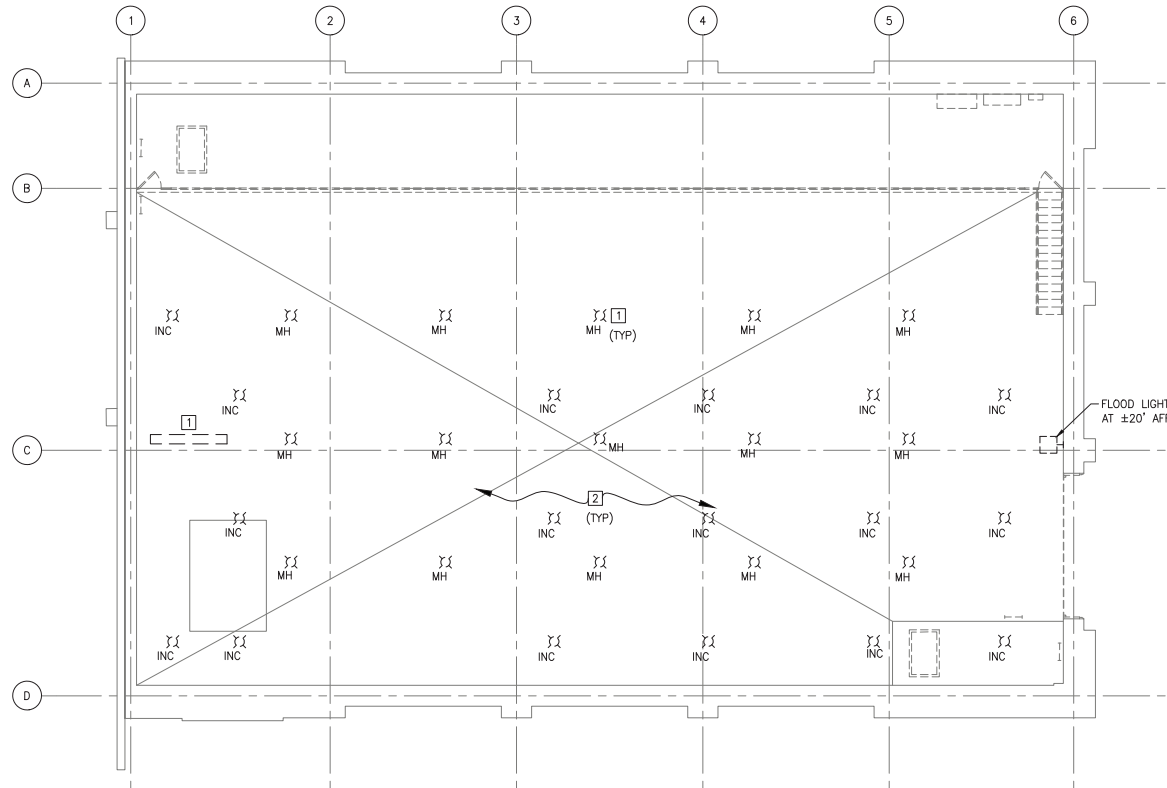

1
E206 MEZZANINE LIGHTING REMOVAL PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND BE REMOVED BACK TO SOURCE.

KEYED NOTES:

- 1 DE-ENERGIZE AND REMOVE LIGHTING FIXTURES AND SWITCHES. REMOVE ALL WIRE AND CONDUIT BACK TO SOURCE.
- 2 DE-ENERGIZE AND REMOVE ALL LIGHTS, SWITCHES, WIRE AND CONDUIT IN THIS AREA.



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA




REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
DEMOLITION LIGHTING MEZZANINE FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	MS
PROJECT NUMBER:	276482	CHECKED BY:	JR
SHEET NUMBER:	E206		
TOTAL SHEETS:	7	OF:	18
REV. NO.:	198	OF:	452
COMPUTER FILE NO.:	17AN-E206	REV. DATE:	

PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW TRANSFORMERS AND ASSOCIATED CIRCUITRY.
- C. NEW PANELS AND ASSOCIATED CIRCUITRY.
- D. NEW DISCONNECT SWITCHES AND ASSOCIATED CIRCUITRY.
- E. NEW TRANSFER SWITCHES AND ASSOCIATED CIRCUITRY.
- F. NEW BATTERY CHARGERS AND ASSOCIATED CIRCUITRY.
- G. NEW BATTERIES AND ASSOCIATED CIRCUITRY.
- H. NEW CIRCUITRY TO MECHANICAL ITEMS.
- I. NEW RECEPTACLES AND ASSOCIATED CIRCUITRY.

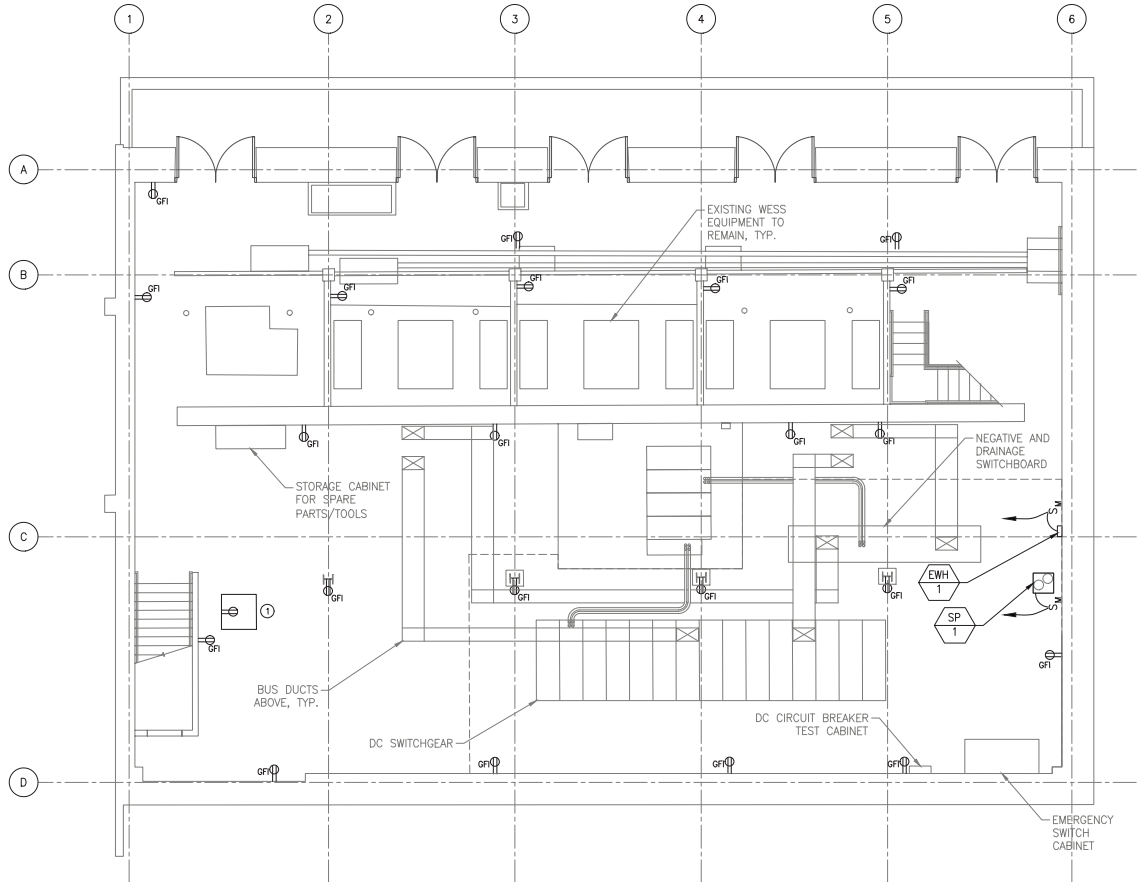

1
E207 BASEMENT PROPOSED FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
4. EXISTING DISTRIBUTION GEAR SHALL REMAIN ENERGIZED UNTIL ALL NEW FEEDERS ARE READY FOR CUT OVER.
5. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217 FOR ADDITIONAL REQUIREMENTS.
6. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES AND ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
7. COORDINATE ALL CONNECTIONS TO MECHANICAL EQUIPMENT WITH TRADE CONTRACTOR PRIOR TO COMMENCING WORK.
8. ALL INTERIOR RECEPTACLES SHALL BE GFCI TYPE AND MOUNTED AT 36" AFF UNLESS OTHERWISE INDICATED.
9. ALL EXTERIOR RECEPTACLES SHALL BE GFCI TYPE MOUNTED IN A WEATHERPROOF GANG BOX, AND MOUNTED AT 48" AFG UNLESS OTHERWISE INDICATED.

KEYED NOTES:

- ① FIBER OPTIC INTERCONNECTION CABINET. REFER TO COMMUNICATIONS WORKSCOPE.



INCORPORATED
PENNSYLVANIA
REGISTRATION
AUTHORITY
ELEC. DIVISION
1228 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107

DATE PREPARED:	
DATE ENGINEERING OFFICE:	
DATE FIELD INSPECTION:	
DATE:	
PROJECT NUMBER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
PROPOSED POWER BASEMENT FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	TR
WORK ORDER NO.:	276482	CHECKED BY:	JR
SHEET NUMBER:	E207		
DWG. NO.:	8	OF	18
SET NO.:	199	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E207		

6 4 2 0 6
SCALE: 3/16"=1'0"

50% SUBMISSION
NOT FOR CONSTRUCTION


C:\PW\WORKING\17072118\17AN-E207.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW TRANSFORMERS AND ASSOCIATED CIRCUITRY.
- C. NEW PANELS AND ASSOCIATED CIRCUITRY.
- D. NEW DISCONNECT SWITCHES AND ASSOCIATED CIRCUITRY.
- E. NEW TRANSFER SWITCHES AND ASSOCIATED CIRCUITRY.
- F. NEW BATTERY CHARGERS AND ASSOCIATED CIRCUITRY.
- G. NEW BATTERIES AND ASSOCIATED CIRCUITRY.
- H. NEW CIRCUITRY TO MECHANICAL ITEMS.
- I. NEW RECEPTACLES AND ASSOCIATED CIRCUITRY.

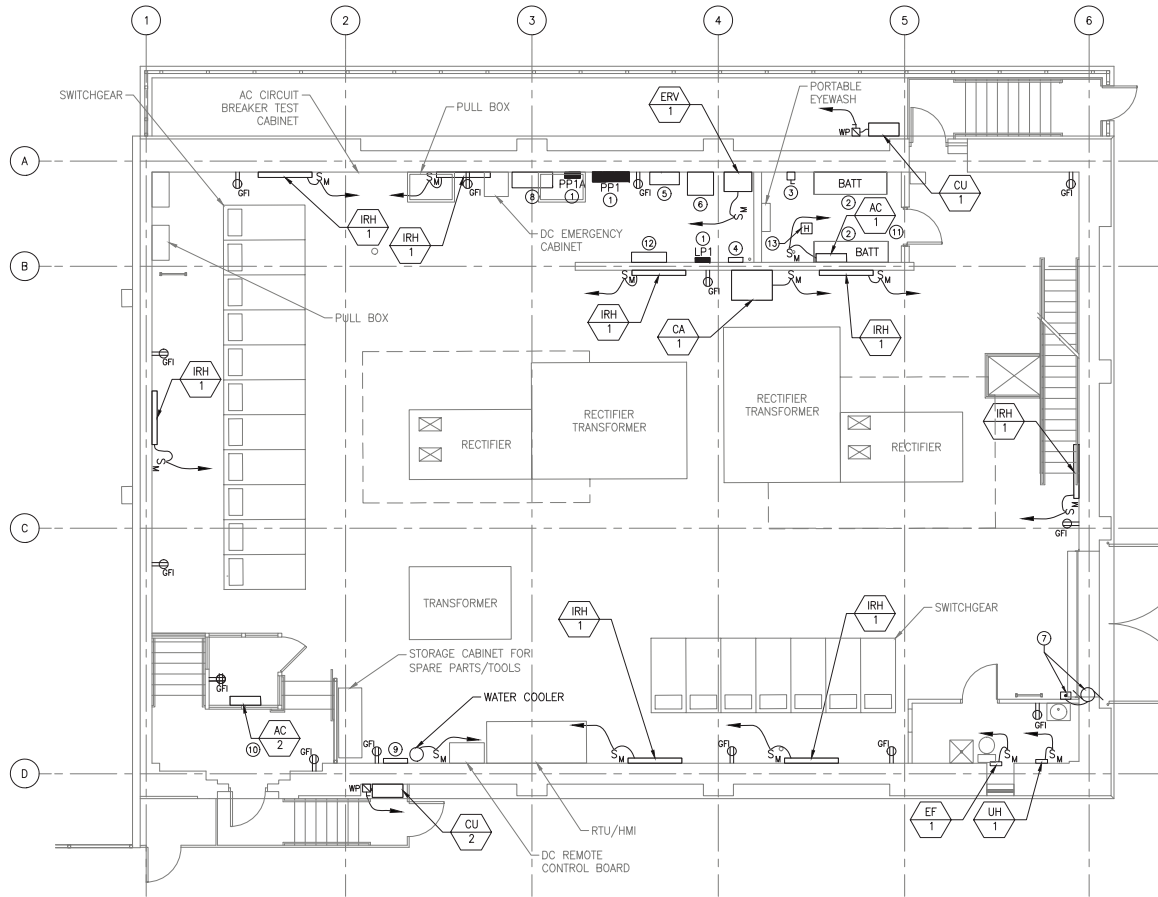

1 E208 MAIN FLOOR PROPOSED PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
4. EXISTING DISTRIBUTION GEAR SHALL REMAIN ENERGIZED UNTIL ALL NEW FEEDERS ARE READY FOR CUT OVER.
5. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217 FOR ADDITIONAL REQUIREMENTS.
6. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES AND ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
7. COORDINATE ALL CONNECTIONS TO MECHANICAL EQUIPMENT WITH TRADE CONTRACTOR PRIOR COMMENCING TO WORK.
8. ALL INTERIOR RECEPTACLES SHALL BE GFCI TYPE AND MOUNTED AT 36" AFF UNLESS OTHERWISE INDICATED.
9. ALL EXTERIOR RECEPTACLES SHALL BE GFCI TYPE MOUNTED IN A WEATHERPROOF GANG BOX, AND MOUNTED AT 48" AFF UNLESS OTHERWISE INDICATED.

KEYED NOTES:

- ① FURNISH AND INSTALL PANELS. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217.
- ② FURNISH AND INSTALL BATTERIES AND BATTERY RACKS.
- ③ FURNISH AND INSTALL BATTERY FUSED DISCONNECT SWITCH.
- ④ FURNISH AND INSTALL 125V DC PANEL.
- ⑤ FURNISH AND INSTALL BATTERY TRANSFER PANEL.
- ⑥ FURNISH AND INSTALL BATTERY CHARGER.
- ⑦ FURNISH AND INSTALL OVERHEAD DOOR AND CONTROLLER.
- ⑧ FURNISH AND INSTALL 400A ATS-1.
- ⑨ FURNISH AND INSTALL 1P/20A 120V CIRCUIT TO FIRE ALARM CONTROL PANEL.
- ⑩ AC-2 IS POWERED FROM CIRCUIT SUPPLYING CU-2.
- ⑪ AC-1 IS POWERED FROM CIRCUIT SUPPLYING CU-1.
- ⑫ FURNISH AND INSTALL DROPPING RESISTORS.
- ⑬ FURNISH AND INSTALL HYDROGEN GAS DETECTION SYSTEM.



50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PLOTTED:	
DATE ENGINEERING OFFICE:	
DATE FIELD PLOTTED:	
DESIGNED BY:	
DIRECTOR OF ENGINEERING:	
BRIDGE/VEHICLE ENGINEER:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA




REV	DATE	BY	CHKD	APPD	DESCRIPTION

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
PROPOSED POWER FIRST FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	MS
		CHECKED BY:	JR
WORK ORDER NO.:	276482		
SHEET NUMBER:	E208		
TOTAL NO. SHEETS:	9	OF:	18
SHEET NO.:	200	OF:	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E208		

PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW TRANSFORMERS AND ASSOCIATED CIRCUITRY.
- C. NEW PANELS AND ASSOCIATED CIRCUITRY.
- D. NEW DISCONNECT SWITCHES AND ASSOCIATED CIRCUITRY.
- E. NEW TRANSFER SWITCHES AND ASSOCIATED CIRCUITRY.
- F. NEW BATTERY CHARGERS AND ASSOCIATED CIRCUITRY.
- G. NEW BATTERIES AND ASSOCIATED CIRCUITRY.
- H. NEW CIRCUITRY TO MECHANICAL ITEMS.
- I. NEW RECEPTACLES AND ASSOCIATED CIRCUITRY.

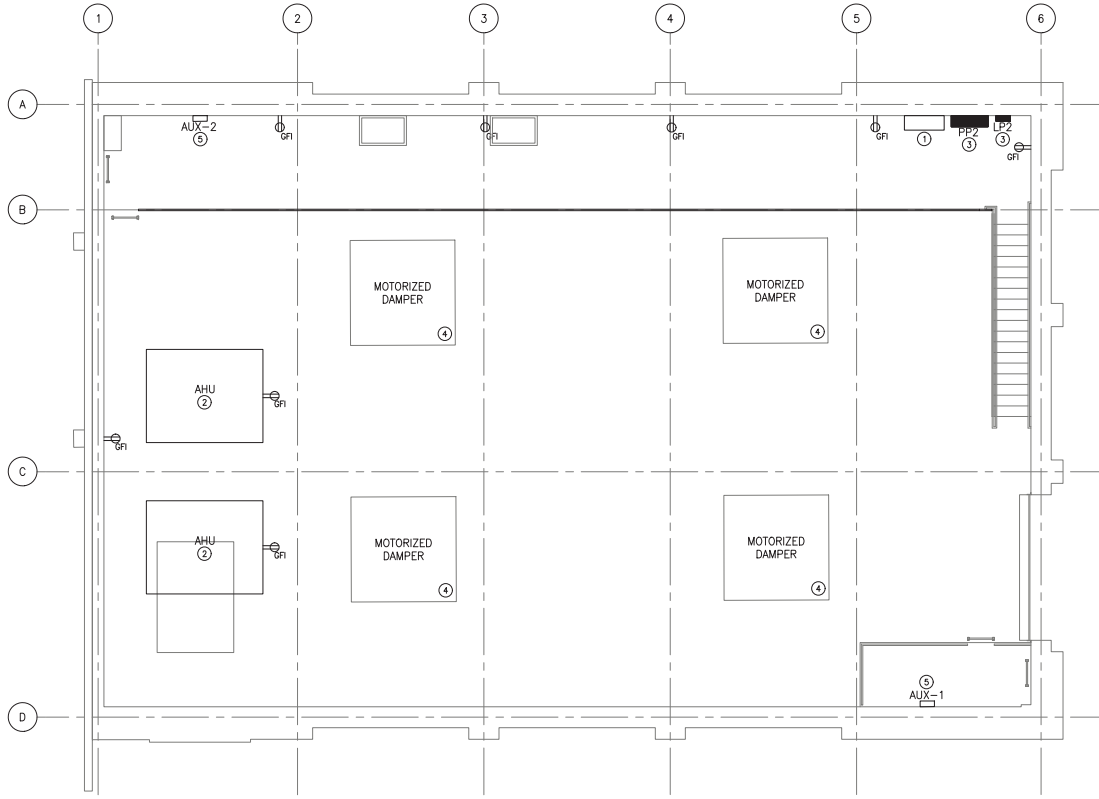

MEZZANINE PROPOSED FLOOR PLAN
 SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
4. EXISTING DISTRIBUTION GEAR SHALL REMAIN ENERGIZED UNTIL ALL NEW FEEDERS ARE READY FOR CUT OVER.
5. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217 FOR ADDITIONAL REQUIREMENTS.
6. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES AND ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
7. COORDINATE ALL INTERCONNECTIONS TO MECHANICAL EQUIPMENT WITH TRADE CONTRACTOR PRIOR TO COMMENCING WORK.
8. ALL INTERIOR RECEPTACLES SHALL BE GFCI TYPE AND MOUNTED AT 36" AFF UNLESS OTHERWISE INDICATED.
9. ALL EXTERIOR RECEPTACLES SHALL BE GFCI TYPE MOUNTED IN A WEATHERPROOF GANG BOX, AND MOUNTED AT 48" AFG UNLESS OTHERWISE INDICATED.

KEYED NOTES:

- ① FURNISH AND INSTALL 400A ATS-2.
- ② FURNISH AND INSTALL CONNECTIONS TO TWO (2) EXISTING AIR HANDLING UNITS SUSPENDED FROM ROOF. FURNISH AND INSTALL 100A/3P DISCONNECT AT EACH. 120V/20A DUPLEX RECEPTACLE AT EACH.
- ③ FURNISH AND INSTALL PANELS. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217.
- ④ FURNISH AND INSTALL POWER TO ROOF DAMPERS.
- ⑤ FURNISH AND INSTALL SECONDARY 400A, 208V, 3Ø ENCLOSED CIRCUIT BREAKER.



DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED FOR:	
PROJECT:	
PROJECT NO.:	
PROJECT NAME:	



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
 ELECTRICAL
 PROPOSED POWER MEZZANINE FLOOR PLAN

TITLE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	
		CHECKED BY:	
WORK ORDER NO.:	276482		
SHEET NUMBER:	E209		
DWG. NO.:	10	OF	18
REV. NO.:	201	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E209		




50% SUBMISSION
 NOT FOR CONSTRUCTION

C:\PWORKING\PTT\07211861\17AN-E209.DWG

DATE PLOTTED: 10/27/2025 STATUS: 50% SUBMISSION

PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.
- C. NEW EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.

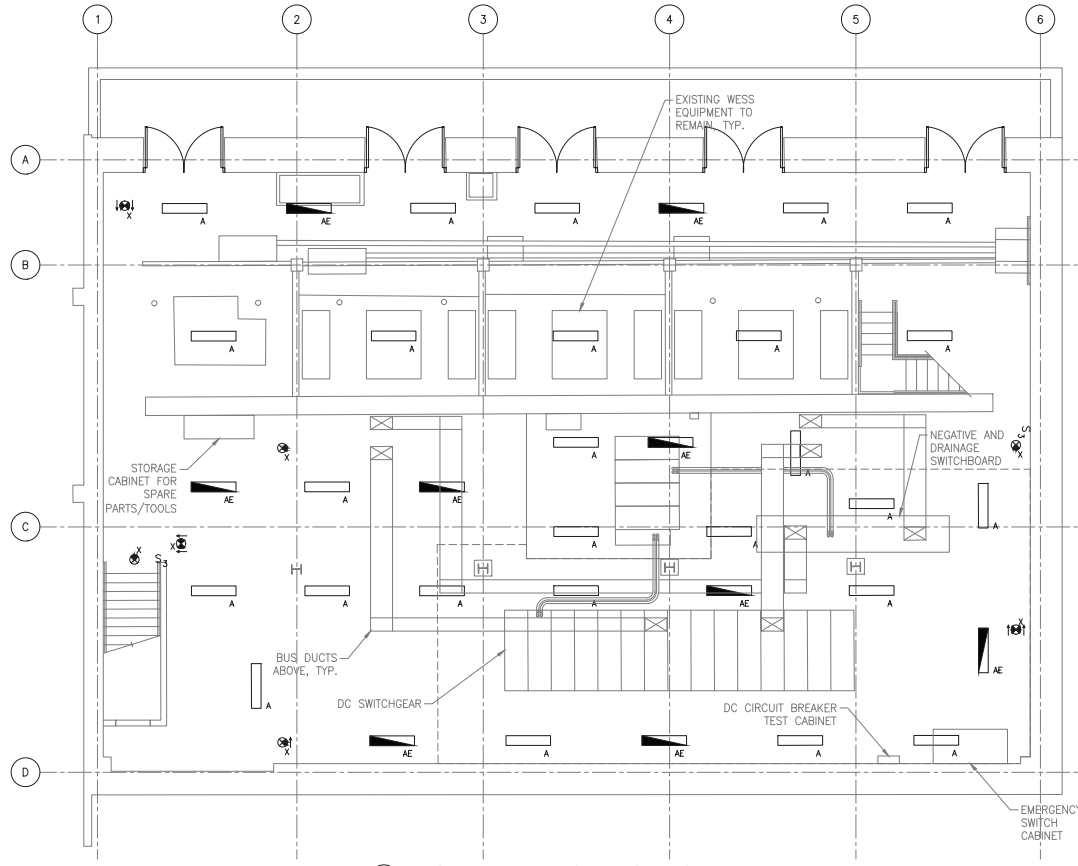

1
E210 BASEMENT PROPOSED LIGHTING PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
4. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217 FOR ADDITIONAL REQUIREMENTS.
5. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES AND ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
6. REFER TO LUMINAIRE SCHEDULE ON DRAWING E215.



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
DATE:	
PROJECT NAME:	


HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
PROPOSED LIGHTING BASEMENT FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	MR
WORK ORDER NO.:	276482	CHECKED BY:	JR
SHEET NUMBER:	E210		
DWG. NO.:	11	OF	18
REV. NO.:	202	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E210		



50% SUBMISSION
NOT FOR CONSTRUCTION


C:\PWORKING\PT\072118\17AN-E210.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.
- C. NEW EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.

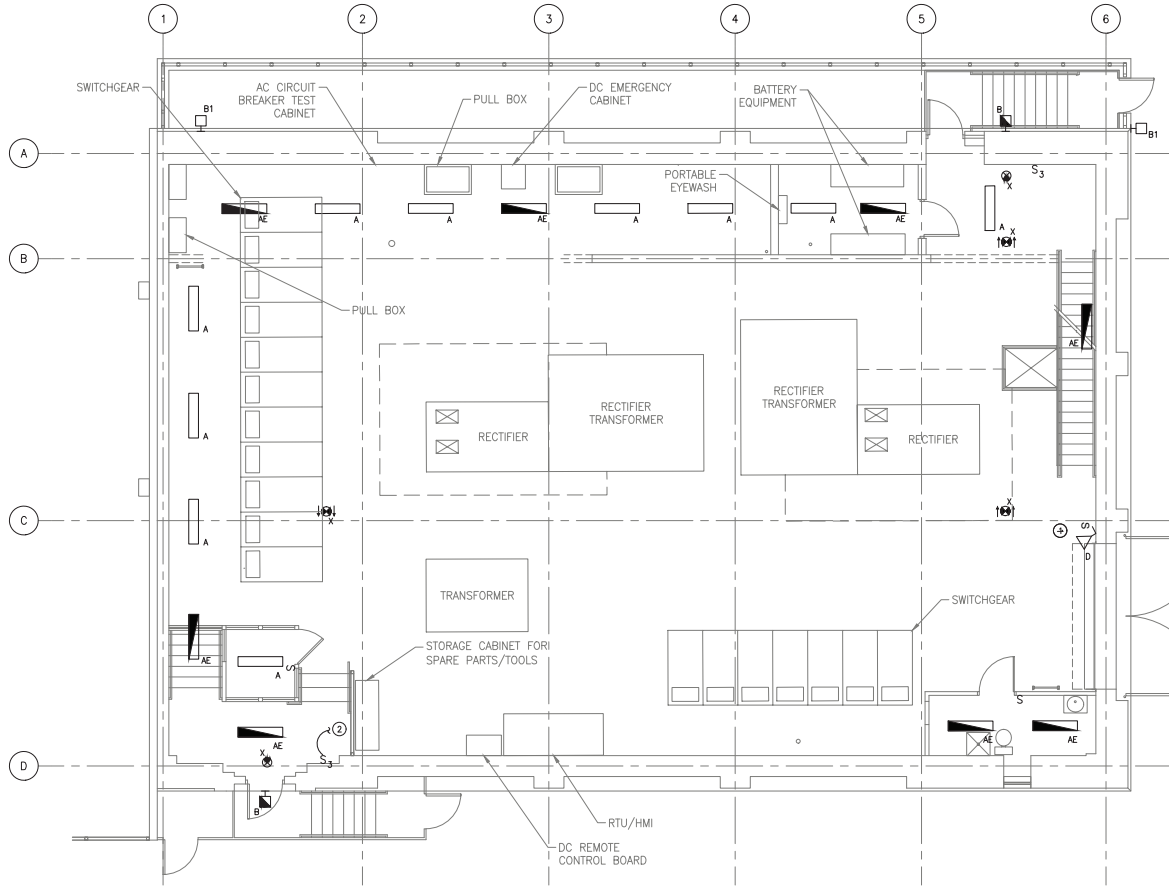


1
E211 MAIN FLOOR PROPOSED LIGHTING PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
4. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217 FOR ADDITIONAL REQUIREMENTS.
5. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES AND ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
6. REFER TO LUMINAIRE SCHEDULE ON DRAWING E215.

KEYED NOTES:

- ① FURNISH AND INSTALL LOADING DOCK LIGHT.
- ② TO LIGHT FIXTURES ON THE MEZZANINE. REFER TO DRAWING E212.



50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	
DATE ENGINEERING OFFICE:	
DATE FIELD/PROJECT:	
DATE OF ENGINEERING:	
DATE OF FIELD/PROJECT:	
DATE OF ENGINEERING:	

HDR
HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
PROPOSED LIGHTING FIRST FLOOR PLAN


SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	MR
		CHECKED BY:	JR
WORK ORDER NO.:	276482		
SHEET NUMBER:	E211		
DWG. NO.:	12	OF	18
PT. NO.:	203	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E211		

C:\PW\WORKING\170721\17AN\E211.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.
- C. NEW EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.

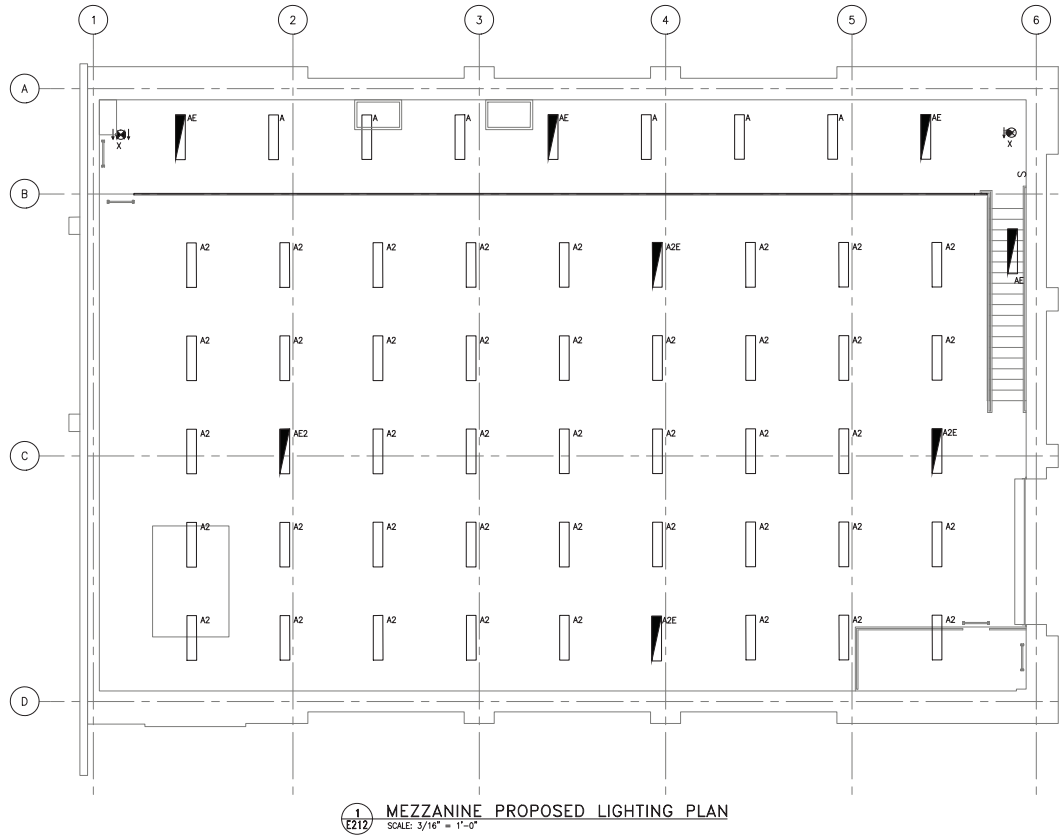

MEZZANINE PROPOSED LIGHTING PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.
2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
4. REFER TO PANEL SCHEDULES ON DRAWINGS E216 AND E217 FOR ADDITIONAL REQUIREMENTS.
5. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES AND ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
6. REFER TO LUMINAIRE SCHEDULE ON DRAWING E215.



PROJECT NUMBER:	
CLIENT:	
DESIGNER:	
DATE:	

HDR
HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
PROPOSED LIGHTING MEZZANINE FLOOR PLAN

DATE:	08/22/2025	SCALE:	1:1
DRAWN BY:		CHECKED BY:	
WORK ORDER NO.:	276482		
SHEET NUMBER	E212		
DWG. NO.:	13	OF	18
SHT. NO.:	204	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-E212		



50% SUBMISSION
NOT FOR CONSTRUCTION


C:\PWORKING\PTT\072118\17AN-E212.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\PWORKING\PT\072118\17AN-E213.DWG

GENERAL NOTES:

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E200.

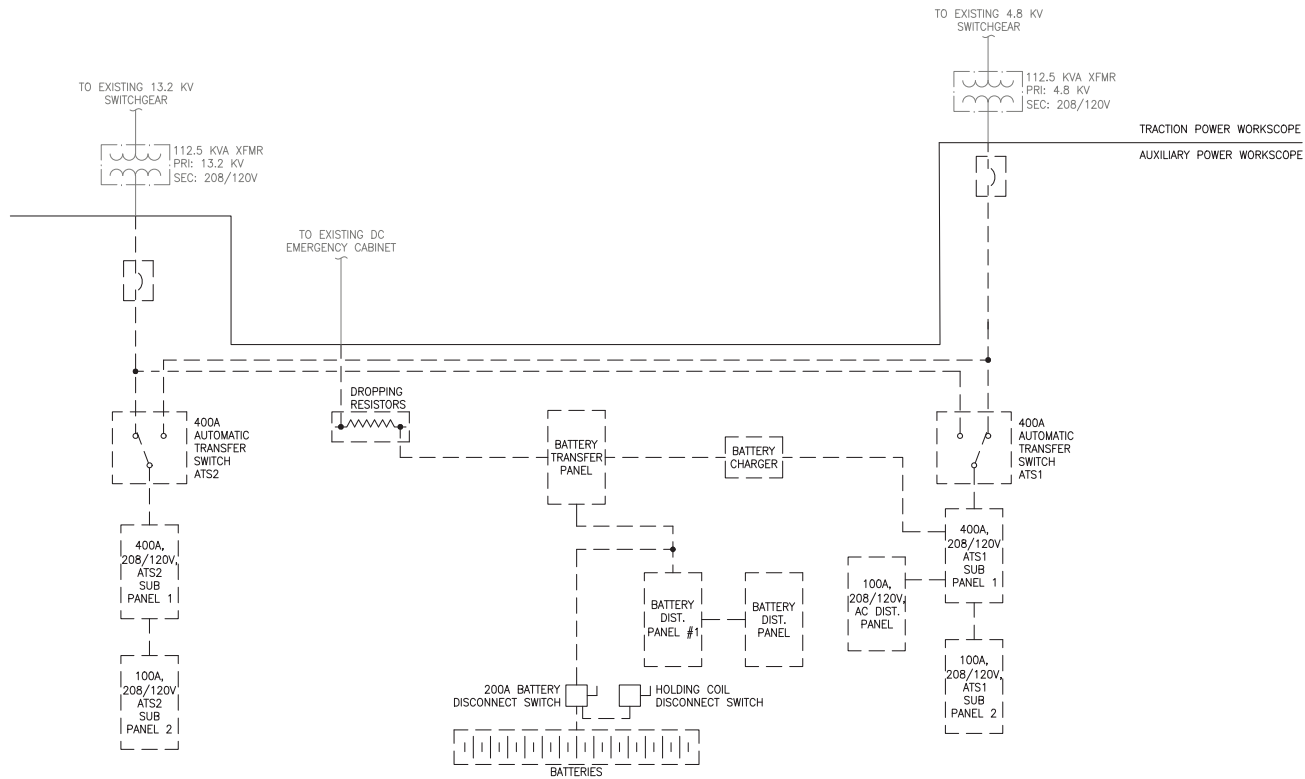

1
E213 ELECTRICAL DEMOLITION SINGLE LINE DIAGRAM
SCALE: NONE

50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	DATE:
DATE ENGINEERING OFFICE:	DATE:
DATE FIELD INSPECTION:	DATE:
DESIGNER:	DATE:
DIRECTOR OF ENGINEERING:	DATE:
SENIOR VICE-PRESIDENT:	DATE:
PROJECT MANAGER:	DATE:



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
DEMOLITION SINGLE LINE DIAGRAM

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	TR
WORK ORDER NO.:	276482	CHECKED BY:	JR
SHEET NUMBER:	E213		
DWG. NO.:	14	OF	18
PT. NO.:	205	OF	452
REVISION:			
COMPUTER FILE NO.:	17AN-E213	REV. NO.:	1

DATE PRINTED: 10/21/2025
STATUS: 50% SUBMISSION


PROPOSED SCOPE OF WORK:

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY OF CIRCUITRY AND ENSURING SEAMLESS OPERATION OF EQUIPMENT.

GENERAL NOTES:

- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATION REFER TO DRAWING E200.
- 2. EXISTING DISTRIBUTION GEAR SHALL REMAIN ENERGIZED UNTIL ALL NEW FEEDERS ARE READY FOR CUT OVER.
- 3. THE CONTRACTOR SHALL PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES FOR ALL NEW PANELS AFTER NEW WORK IS COMPLETED.

FEEDER SCHEDULE						
FEEDER NUMBER	QUANTITY OF SETS	QUANTITY OF CONDUCTORS	600 VOLT COPPER CONDUCTOR SIZE	600 VOLT COPPER GROUND CONDUCTOR SIZE	CONDUIT TRADE SIZE	NOTES
①	-	-	-	-	-	-
②	-	-	-	-	-	-
③	-	-	-	-	-	-
④	-	-	-	-	-	-
⑤	-	-	-	-	-	-
⑥	-	-	-	-	-	-
⑦	-	-	-	-	-	-
⑧	-	-	-	-	-	-
⑨	-	-	-	-	-	-

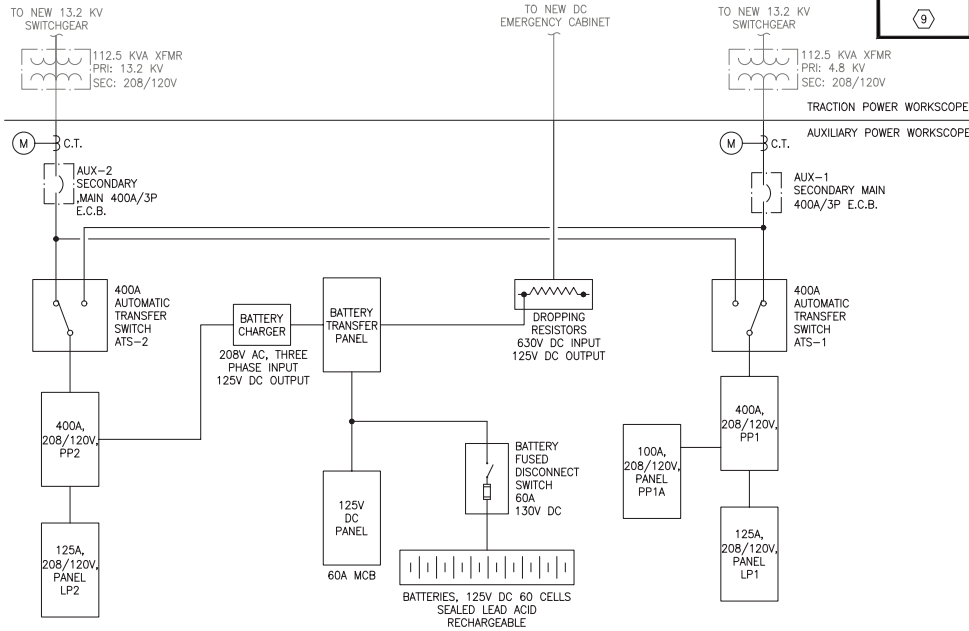

1
E214
ELECTRICAL PROPOSED SINGLE LINE DIAGRAM
SCALE: NONE



DATE PRINTED: 10/27/2025
 PROJECT NUMBER: _____
 PROJECT TITLE: _____
 DESIGNED BY: _____
 CHECKED BY: _____
 APPROVED BY: _____



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
PROPOSED SINGLE LINE DIAGRAM

DATE: 08/22/2025
 SCALE: 1:1
 DRAWN BY: M
 CHECKED BY: J
 SHEET NUMBER: 276482
E214
 SHEET NO: 15 OF 18
 SHEET NO: 206 OF 432
 PROJECT FILE NO.: 17AN-E214

50% SUBMISSION
 NOT FOR CONSTRUCTION



CHIEF ENGINEER: _____
 CHIEF ENGINEERING OFFICER: _____
 CHIEF ELECTRICAL OFFICER: _____
 DEPARTMENT: _____
 DIVISION OF ELECTRICAL: _____
 DIVISION: _____
 PROJECT NUMBER: _____

HDR
 HDR Engineering, Inc.
 Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
 ELECTRICAL SCHEDULES

TITLE	AS SHOWN	SCALE/Factor	1:1
DATE	08/22/2025	DRAWN BY: TM	CHECKED BY: JM
WORK ORDER NO.	276482		
SHEET NUMBER	E215		
DWG. NO.	16	OF	18
SHT. NO.	207	OF	452
PROJECT NO.			
COMPUTER FILE NO.	17AN-E215		
REV. NO.			

50% SUBMISSION
NOT FOR CONSTRUCTION

LUMINAIRE SCHEDULE								
TYPE	DESCRIPTION	MOUNTING	MANUFACTURER	CATALOG NO.	LAMP INFORMATION			
					TYPE	LAMP QTY	WATTS EACH	VOLTS
'A'	CEILING OR WALL MOUNTED ROUGH SERVICE FIXTURE 4000K, 80CRI, CLEAR POLYCARBONATE LENS, WIDE DISTRIBUTION, INJECTION MOLDED, IMPACT RESISTANT POLYCARBONATE HOUSING	CEILING OR WALL	LITHONIA	VAP-4000LM-PCL-WD-120-GZ10-40K-80CRI-OMB	LED	-	42	120
'AE'	CEILING OR WALL MOUNTED ROUGH SERVICE FIXTURE 4000K, 80CRI, CLEAR POLYCARBONATE LENS, WIDE DISTRIBUTION, INJECTION MOLDED, IMPACT RESISTANT POLYCARBONATE HOUSING, EMERGENCY BATTERY LED DRIVER	CEILING OR WALL	LITHONIA	VAP-4000LM-PCL-WD-120-GZ10-40K-80CRI-OMB-BZL722	LED	-	42	120
'A2'	CEILING MOUNTED ROUGH SERVICE FIXTURE 4000K, 80CRI, CLEAR POLYCARBONATE LENS, WIDE DISTRIBUTION, INJECTION MOLDED, IMPACT RESISTANT POLYCARBONATE HOUSING, HIGH LUMEN OUTPUT	CEILING	LITHONIA	VAP-12000LM-PCL-WD-120-GZ10-40K-80CRI-OMB	LED	-	107	120
'A2E'	SAME AS 'A2' WITH EMERGENCY BATTERY LED DRIVER	CEILING	LITHONIA	VAP-12000LM-PCL-WD-120-GZ10-40K-80CRI-OMB-BZL722	LED	-	107	120
'B'	DIE-CAST ALUMINUM LED WALLPACK FIXTURE, 5000K, GLASS LENS WITH WIRE GUARD, TYPE 3 MEDIUM DISTRIBUTION, INTEGRAL PHOTOCELL, BATTERY PACK	WALL	LITHONIA	TWH LED-20C-1000-50K-T3M-120-PE-TP-WG-DOBXD-ELCW	LED	20	72	120
'B1'	SIMILAR TO TYPE 'B' LUMINAIRE EXCEPT NO BATTERY PACK	WALL	LITHONIA	TWH LED-20C-1000-50K-T3M-120-PE-TP-WG-DOBXD	LED	20	72	120
'D'	DOCK LIGHT	WALL	TBD	TBD	-	1	ALL	120
'X'	THERMOPLASTIC EXIT SIGN, EMERGENCY OPERATION, NICKEL-CADMIUM BATTERY, UNIVERSAL MOUNTING KIT, SELF-DIAGNOSTICS, 90-MINUTE CAPACITY FOR EMERGENCY LAMPS	UNIVERSAL	LITHONIA	LQM S W 3 R 120/277 EL N SD	LED	-	.92	120

PANEL SCHEDULE

PANEL: PP1		INTERRUPTING RATING: 22 KAIC		MOUNTING: SURFACE									
VOLTAGE: 208Y/120V		PHASE: 3		WIRE: 4 BUS AMPS: 400A MAIN: 400A MCB									
NEMA 3R		NEUTRAL: 100%		COPPER GROUND BUS LOCATION:									
CIRCUIT	DESCRIPTION	WIRE	POLES	BKR SIZE	VA / PHASE			VA	BKR SIZE	POLES	WIRE	DESCRIPTION	CIRCUIT
					A	B	C						
1				0	0		0						2
3				0	0	0	0						4
5				0		0	0						6
7				0	0		0						8
9				0		0	0						10
11				0	0		0						12
13				0	0		0						14
15				0		0	0						16
17				0	0		0						18
19				0	0		0						20
21				0		0	0						22
23				0	0		0						24
25				0	0		0						26
27				0	0		0						28
29				0		0	0						30
31				0	0		0						32
33				0		0	0						34
35				0	0		0						36
37				0	0		0						38
39				0		0	0						40
41				0			0						42
NOTES:					TOTALS								
					0	0	0						
					0 VA							0.00 AMPS	

PANEL SCHEDULE

PANEL: PP2		INTERRUPTING RATING: 22 KAIC		MOUNTING: SURFACE									
VOLTAGE: 208Y/120V		PHASE: 3		WIRE: 4 BUS AMPS: 400A MAIN: 400A MCB									
NEMA 3R		NEUTRAL: 100%		COPPER GROUND BUS LOCATION:									
CIRCUIT	DESCRIPTION	WIRE	POLES	BKR SIZE	VA / PHASE			VA	BKR SIZE	POLES	WIRE	DESCRIPTION	CIRCUIT
					A	B	C						
1				0	0		0						2
3				0	0	0	0						4
5				0		0	0						6
7				0	0		0						8
9				0		0	0						10
11				0	0		0						12
13				0	0		0						14
15				0		0	0						16
17				0	0		0						18
19				0	0		0						20
21				0		0	0						22
23				0	0		0						24
25				0	0		0						26
27				0	0		0						28
29				0		0	0						30
31				0	0		0						32
33				0		0	0						34
35				0	0		0						36
37				0	0		0						38
39				0		0	0						40
41				0			0						42
NOTES:					TOTALS								
					0	0	0						
					0 VA							0.00 AMPS	

PANEL SCHEDULE

PANEL: LP1		INTERRUPTING RATING: 22 KAIC		MOUNTING: SURFACE									
VOLTAGE: 208Y/120V		PHASE: 3		WIRE: 4 BUS AMPS: 225A MAIN: 125A MCB									
NEMA 3R		NEUTRAL: 100%		COPPER GROUND BUS LOCATION:									
CIRCUIT	DESCRIPTION	WIRE	POLES	BKR SIZE	VA / PHASE			VA	BKR SIZE	POLES	WIRE	DESCRIPTION	CIRCUIT
					A	B	C						
1				0	0		0						2
3				0	0	0	0						4
5				0		0	0						6
7				0	0		0						8
9				0		0	0						10
11				0	0		0						12
13				0	0		0						14
15				0		0	0						16
17				0	0		0						18
19				0	0		0						20
21				0	0		0						22
23				0	0		0						24
25				0	0		0						26
27				0	0		0						28
29				0		0	0						30
31				0	0		0						32
33				0		0	0						34
35				0	0		0						36
37				0	0		0						38
39				0		0	0						40
41				0			0						42
NOTES:					TOTALS								
					0	0	0						
					0 VA							0.00 AMPS	

PANEL SCHEDULE

PANEL: LP2		INTERRUPTING RATING: 22 KAIC		MOUNTING: SURFACE									
VOLTAGE: 208Y/120V		PHASE: 3		WIRE: 4 BUS AMPS: 225A MAIN: 125A MCB									
NEMA 3R		NEUTRAL: 100%		COPPER GROUND BUS LOCATION:									
CIRCUIT	DESCRIPTION	WIRE	POLES	BKR SIZE	VA / PHASE			VA	BKR SIZE	POLES	WIRE	DESCRIPTION	CIRCUIT
					A	B	C						
1				0	0		0						2
3				0	0	0	0						4
5				0		0	0						6
7				0	0		0						8
9				0		0	0						10
11				0	0		0						12
13				0	0		0						14
15				0		0	0						16
17				0	0		0						18
19				0	0		0						20
21				0	0		0						22
23				0	0		0						24
25				0	0		0						26
27				0	0		0						28
29				0		0	0						30
31				0	0		0						32
33				0		0	0						34
35				0	0		0						36
37				0	0		0						38
39				0		0	0						40
41				0			0						42
NOTES:					TOTALS								
					0	0	0						
					0 VA							0.00 AMPS	

PHILADELPHIA
TRACTION POWER SUBSTATION REHABILITATION AUTHORITY
EMC DMS99
1200 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107

DATE PRINTED: 10/27/2025

PARK SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION ELECTRICAL PANEL SCHEDULES - SHEET 1

SCALE: AS SHOWN 1:1
DATE: 08/22/2025
DRAWN BY: HR
CHECKED BY: HR
SHEET NUMBER: 276482
E216
NO. OF 17 OF 18
SHEET NO. 208 OF 452
REVISION NO.
COMPUTER FILE NO.: 17AN-E216

50% SUBMISSION
NOT FOR CONSTRUCTION

C:\PW\WORKING\PTT\2025108\17AN-E216.DWG

PANEL SCHEDULE

PANEL SCHEDULE														
PANEL: PP1A			INTERRUPTING RATING: 22 KAIC			MOUNTING: SURFACE								
VOLTAGE: 208Y/120V			PHASE: 3			WIRE: 4			BUS AMPS: 100A			MAIN: 100A MCB		
NEMA 3R			NEUTRAL: 100%			COPPER GROUND BUS			LOCATION:					
CIRCUIT	DESCRIPTION	WIRE	POLES	BMR SIZE	VA	VA / PHASE			VA	BMR SIZE	POLES	WIRE	DESCRIPTION	CIRCUIT
						A	B	C						
1					0	0	0	0	0					2
3					0	0	0	0	0					4
5					0	0	0	0	0					6
7					0	0	0	0	0					8
9					0	0	0	0	0					10
11					0	0	0	0	0					12
13					0	0	0	0	0					14
15					0	0	0	0	0					16
17					0	0	0	0	0					18
19					0	0	0	0	0					20
21					0	0	0	0	0					22
23					0	0	0	0	0					24
25					0	0	0	0	0					26
27					0	0	0	0	0					28
29					0	0	0	0	0					30
31					0	0	0	0	0					32
33					0	0	0	0	0					34
35					0	0	0	0	0					36
37					0	0	0	0	0					38
39					0	0	0	0	0					40
41					0	0	0	0	0					42
NOTES:						TOTALS								
						0	0	0	0.00 AMPS					
						0 VA								



STEP NUMBER: 0000
STEP DESCRIPTION: 0000
STEP FILE NAME: 0000
STEP SHEET NUMBER: 0000
STEP SHEET TOTAL: 0000
PROJECT NUMBER: 0000



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ELECTRICAL
PANEL SCHEDULES - SHEET 2

SCALE: AS SHOWN
DATE: 08/22/2025
DRAWN BY: [Blank]
CHECKED BY: [Blank]
PROJECT NUMBER: 276482
SHEET NUMBER: **E217**
NO. OF SHEETS: 18 OF 18
SHEET NO: 209 OF 452
REVISION NO: [Blank]
COMPUTER FILE NO: 17AN-E217

50% SUBMISSION
NOT FOR CONSTRUCTION

C:\WORKING\PTT\072118\17AN-E217.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

LEGEND-SYMBOLS:	
SYMBOL	DESCRIPTION
-----	DEMOLITION WORK
————	EXISTING WORK
CM	NEW WORK
CM	CONTROL MODULE
MM	MONITORING MODULE
⊗	SMOKE DETECTOR
⊕	HEAT DETECTOR
FAFP	FIRE ALARM CONTROL PANEL
F	MANUAL PULLSTATION W/ PROTECTIVE COVER
⊗ (##)	FIRE ALARM WALL MOUNTED STROBE, (##) DENOTES CANDELA
⊗ (##)	FIRE ALARM WALL MOUNTED HORN/STROBE, (##) DENOTES CANDELA
⊗ (##) (WP)	(G) DENOTES PROTECTIVE GUARD (WP) DENOTES WEATHERPROOF ENCLOSURE
*HEAVY LINEWEIGHTS SHALL REPRESENT NEW WORK/NEW DEVICES.	
*LIGHT/LIGHTER LINEWEIGHTS SHALL REPRESENT EXISTING DEVICES.	

ABBREVIATIONS:			
A.F.F.	ABOVE FINISHED FLOOR	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
AHJ	AUTHORITY HAVING JURISDICTION	NFPA	NATIONAL FIRE PROTECTION ASSOCIATION
AWG	AMERICAN WIRE GAUGE	RGS	RIGID GALVANIZED STEEL
CD	CANDELA	SCADA	SUPERVISORY CONTROL AND DATA ACQUISITION
CKT	CIRCUIT	SLC	SIGNALING LINE CIRCUIT
CM	CONTROL MODULE	SPK	SPEAKER CIRCUIT
COL	END OF LINE	SUP	SUPERVISORY
FACP	FIRE ALARM CONTROL PANEL	TBL	TROUBLE
FMC	FLEXIBLE METAL CONDUIT	TS	TAMPER SWITCH
HVAC	HEATING, VENTILATION, AND AIR CONDITIONING	VAC	VOLTAGE -
IBC	INTERNATIONAL BUILDING CODE	VDC	VOLTAGE -
IDC	INITIATING DEVICE CIRCUIT	WESS	WAYSIDE ENERGY STORAGE SYSTEM
G	PROTECTIVE GUARD	WP	WEATHERPROOF
JB	JUNCTION BOX		
LPMC	LIQUID TIGHT FLEXIBLE METAL CONDUIT		
MM	MINIMUM		
MM	MONITORING MODULE		
NAC	NOTIFICATION APPLIANCE CIRCUIT		
NEC	NATIONAL ELECTRICAL CODE		

DEMOLITION NOTES:	
1.	THE CONTRACTOR SHALL BECOME FAMILIAR WITH EXISTING CONDITIONS AFFECTING THIS PROJECT AND COORDINATE WITH ALL OTHER TRADES.
2.	DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL CAPACITIES AND LOCATIONS OF EQUIPMENT TO BE REMOVED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR VISITING THE SITE TO DETERMINE ACTUAL PHYSICAL SIZE, CAPACITIES AND LOCATIONS OF EXISTING EQUIPMENT TO BE REMOVED.
3.	THE CONTRACTOR SHALL OBTAIN ALL REQUIRED PERMITS, COORDINATE ALL REQUIRED EQUIPMENT AND SYSTEMS SHUTDOWN WITH SEPTA, AND PROVIDE SEPTA TWO (2) WEEKS NOTICE OF SAME.
4.	THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CUTTING AND PATCHING AS IT MAY APPLY TO THE AREAS OF DEMOLITION, OR MAY BE AFFECTED BY PIPE, DUCTWORK, EQUIPMENT AND APPURTENANCES. PATCH AND REPAIR SHALL MATCH EXISTING BUILDING STRUCTURE.
5.	COORDINATE DEMOLITION WORK WITH ALL OTHER TRADES. STAGE WORK IN CONJUNCTION WITH OTHER TRADE STAGING AND STAGING DRAWINGS.
6.	THE DEMOLITION/REMOVAL OF ITEMS BY THE CONTRACTOR SHALL BE AS FOLLOWS, UNLESS SPECIFICALLY NOTED OTHERWISE, ITEMS SHOWN IN HEAVY LINEWEIGHT DASHED LINES ON DEMOLITION DRAWINGS ARE EXISTING ITEMS TO BE REMOVED; LIGHT LINEWEIGHT ITEMS ARE EXISTING ITEMS TO REMAIN.

DEMOLITION NOTES (CONT):	
7.	DEMOLISHED EQUIPMENT/SERVICES WILL BE REMOVED BACK TO THE LIMIT OF DEMOLITION AS INDICATED ON DRAWINGS, OR TO THE NEAREST HEADER OR JUNCTION. PROVIDE CAPS AS NECESSARY.
8.	THE CONTRACTOR SHALL FIELD VERIFY OTHER EQUIPMENT/UTILITIES NOT ASSOCIATED WITH THIS WORK BUT LYING WITHIN THE WORK AREA, AND WILL NOT DISTURB THAT EQUIPMENT/UTILITIES. THESE EQUIPMENT/UTILITIES SHALL BE PROTECTED SO THAT THE SERVICE IS NOT INTERRUPTED. THE CONTRACTOR SHALL REPAIR ANY DAMAGE DONE TO THE EQUIPMENT/UTILITIES IN PERFORMANCE OF THE WORK.
9.	ALL ITEMS BEING REMOVED SHALL BE TURNED OVER TO SEPTA OR REMOVED FROM SITE AS DIRECTED, UNLESS OTHERWISE DESIGNATED.
10.	THE CONTRACTOR SHALL KEEP WORK AREA CLEAN, ORDERLY, AND WORKMAN LIKE, AND REMOVE ALL DEMOLISHED TRASH/RUBBLE/CONSTRUCTION DEBRIS FROM SITE DAILY.
11.	UNLESS OTHERWISE INDICATED, DEMOLITION WASTE BECOMES PROPERTY OF THE CONTRACTOR.
12.	HISTORIC ITEMS, RELICS, ANTIQUES, AND SIMILAR OBJECTS INCLUDING, BUT NOT LIMITED TO, CORNERSTONES AND THEIR CONTENTS, COMMEMORATIVE PLAQUES AND TABLETS, AND OTHER ITEMS OF INTEREST OR VALUE TO SEPTA THAT MAY BE UNCOVERED DURING DEMOLITION REMAIN THE PROPERTY OF SEPTA. CAREFULLY SALVAGE IN A MANNER TO PREVENT DAMAGE AND PROMPTLY RETURN TO SEPTA.
13.	NOTIFY THE SEPTA PROJECT MANAGER OF DISCREPANCIES BETWEEN EXISTING CONDITIONS AND DRAWINGS BEFORE PROCEEDING WITH SELECTIVE DEMOLITION.
14.	IF SUSPECTED HAZARDOUS MATERIALS ARE ENCOUNTERED, DO NOT DISTURB; IMMEDIATELY NOTIFY THE SEPTA PROJECT MANAGER.
15.	REVIEW RECORD DOCUMENTS OF EXISTING CONSTRUCTION PROVIDED BY SEPTA. SEPTA DOES NOT GUARANTEE THAT EXISTING CONDITIONS ARE THE SAME AS THOSE INDICATED IN RECORD DOCUMENTS.
16.	WHEN UNANTICIPATED ELEMENTS THAT CONFLICT WITH INTENDED FUNCTION OR DESIGN ARE ENCOUNTERED, INVESTIGATE AND MEASURE THE NATURE AND EXTENT OF CONFLICT. PROMPTLY SUBMIT A WRITTEN REPORT TO THE SEPTA PROJECT MANAGER.
17.	COMPLY WITH HAULING AND DISPOSAL REGULATIONS OF AUTHORITIES HAVING JURISDICTION.
18.	PROCEED WITH SELECTIVE DEMOLITION SYSTEMATICALLY, FROM HIGHER TO LOWER LEVEL. COMPLETE SELECTIVE DEMOLITION OPERATIONS ABOVE EACH FLOOR OR TIER BEFORE DISTURBING SUPPORTING MEMBERS ON THE NEXT LOWER LEVEL.
19.	NEATLY CUT OPENINGS AND HOLES PLUMB, SQUARE AND TRUE TO DIMENSIONS REQUIRED. USE CUTTING METHODS LEAST LIKELY TO DAMAGE CONSTRUCTION TO REMAIN OR ADJOINING CONSTRUCTION.
20.	USE HAND TOOLS OR SMALL POWER TOOLS DESIGNED FOR SAWING OR GRINDING, NOT HAMMERING AND CHOPPING, TO MINIMIZE DISTURBANCE OF ADJACENT SURFACES. TEMPORARILY COVER OPENINGS TO REMAIN. CUT OR DRILL FROM THE EXPOSED OR FINISHED SIDE INTO CONCEALED SURFACES TO AVOID MARRING EXISTING FINISHED SURFACES.

GENERAL NOTES:	
1.	ALL WORK INDICATED ON THESE DRAWINGS IS BY THE CONTRACTOR, UNLESS OTHERWISE NOTED.
2.	EXISTING CONDITIONS SHOWN ARE BASED ON HISTORICAL DOCUMENTS, CIVIL SURVEYS AND SITE OBSERVATIONS. ALL DIMENSIONS AND CONDITIONS ARE TO BE VERIFIED IN THE FIELD.
3.	INSTALL ALL EQUIPMENT WITH ADEQUATE CLEARANCES FOR MAINTENANCE AND SERVICING AND IN ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTRUCTIONS AND APPLICABLE CODES.


GENERAL NOTES (CONT):	
4.	FIRE ALARM DEVICES SHALL BE ACCESSIBLE TO ALLOW PERIODIC INSPECTION, CLEANING AND MAINTENANCE. A FIRE ALARM DEVICE SHALL BE CONSIDERED ACCESSIBLE IF IT CAN BE READILY AND SAFELY ACCESSED WITH THE USE OF A LADDER OR A BOOM LIFT.
5.	OBTAIN AND PAY FOR ALL PERMITS AND PAY FOR ALL COSTS OF MATERIALS. HANDLE, STORE AND PROTECT ALL EQUIPMENT TO PREVENT DAMAGE BEFORE AND DURING INSTALLATION IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. PROTECT THE WORK SITE AND ALL WORK AGAINST ANY DAMAGE INCLUDING BUT NOT LIMITED TO WATER, DUST, HEAT, FREEZING ETC. UNTIL FINAL COMPLETION AND ACCEPTANCE BY SEPTA.
6.	REFER TO SPECIFICATIONS FOR MATERIALS TO BE USED AND METHODS OF INSTALLATION.
7.	SUBMIT EQUIPMENT TAG-OUT METHODS AND PROCEDURES TO THE SEPTA PROJECT MANAGER FOR REVIEW AND APPROVAL. WHERE UTILITIES AND/OR SERVICES REQUIRE SHUTDOWN FOR THE WORK TO BE PERFORMED, NOTIFY THE SEPTA PROJECT MANAGER, IN WRITING, A MINIMUM OF TWO (2) WEEKS PRIOR TO THE REQUESTED SHUTDOWN.
8.	STORAGE OF MATERIALS AND/OR EQUIPMENT IS NOT PERMITTED OTHER THAN WITHIN THE LIMITS OF THE STAGING AREA OR CONFINES OF THE PROJECT WORK AREA AND AS APPROVED BY THE SEPTA PROJECT MANAGER.
9.	PERFORM ALL WORK IN A NEAT AND WORKMANLIKE MANNER TO THE SATISFACTION OF SEPTA.
10.	REMOVE ALL CONSTRUCTION DEBRIS IN ACCORDANCE WITH APPROVED CONSTRUCTION WASTE MANAGEMENT PLAN.
11.	CONCEAL CONDUIT OR CABLE EXTENSIONS TO THE GREATEST EXTENT PRACTICABLE. KEEP SURFACE MOUNTED DEVICES, BOXES, AND EXPOSED SURFACE MOUNTED METAL RACEWAYS TO A MINIMUM AND ONLY AS APPROVED IN ADVANCED BY THE SEPTA PROJECT MANAGER. INSTALL EXPOSED HORIZONTAL CONDUIT RUNS SUPPORTED BY OVERHEAD STRUCTURE OR SUPPORTED HIGH ON WALLS.
12.	KEEP A COPY OF THE CURRENT SET OF CONTRACT DOCUMENTS WITH THE CONTRACTOR AS-BUILT INFORMATION AT THE JOB SITE AT ALL TIMES.
13.	REVIEW ALL PROJECT DOCUMENTS FOR A THOROUGH UNDERSTANDING OF PROJECT AND ANY CROSS REFERENCING OF WORK. REVIEW ALL PROJECT REQUIREMENTS PRIOR TO BIDDING. REPORT ANY DISCREPANCIES BETWEEN DOCUMENTS TO THE SEPTA PROJECT MANAGER PRIOR TO BIDDING.
14.	VERIFY ALL DIMENSIONS IN THE FIELD AND REPORT DISCREPANCIES, IF ANY, TO THE SEPTA PROJECT MANAGER FOR CLARIFICATION PRIOR TO STARTING ANY WORK.
15.	COORDINATE, PROVIDE AND INSTALL RACEWAY, BACKBOXES, JUNCTION BOXES, PULL BOXES, PULL STRING AND CONDUIT REQUIRED.
16.	RESTORE ALL EXISTING WORK DISTURBED BY THE CONSTRUCTION TO ITS PREVIOUS EXISTING CONDITION OR BETTER.
17.	PRIOR TO DELIVERY OF ANY MATERIALS TO THE SITE, PROVIDE SAFETY DATA SHEETS FOR ALL REQUIRED ITEMS AND MATERIALS, USED IN THE WORK, TO THE CONTRACTOR.
18.	PATCH AND REPAIR ALL OPENINGS LEFT IN EXISTING SURFACES BY THE REMOVAL OF EXISTING SURFACE AND OR SEMI-RECESSED BOXES OR RACEWAYS AND FINISH SUCH AREAS TO MATCH ADJACENT SURFACES.
19.	COMPLY WITH ALL SEPTA SAFETY STANDARDS AND INCLUDE ALL COSTS TO TRAIN AND QUALIFY THEIR PERSONNEL IN SEPTA SAFETY STANDARDS.
20.	REVIEW POTENTIAL ITEMS FOR SALVAGE AND RETENTION BY SEPTA WITH THE SEPTA PROJECT MANAGER PRIOR TO REMOVAL TO DETERMINE DISPOSITION.
21.	COORDINATE LOCATIONS OF EXPANSION JOINTS WITH STRUCTURAL DRAWINGS. FURNISH AND INSTALL UL LISTED EXPANSION JOINT FITTINGS FOR CONDUITS CROSSING EXPANSION JOINTS.
22.	SUPPORT ALL CONDUCTORS IN VERTICAL RACEWAYS WITH CONDUIT RISER CABLE GRIPS.
23.	COORDINATE INSTALLATION OF FIRE ALARM DEVICES WITH OTHER TRADES.

GENERAL NOTES (CONT):	
24.	FIRE ALARM DEVICES SHALL NOT BE INSTALLED WHERE THEY CANNOT BE MAINTAINED WITHOUT. A. SHUTTING DOWN POWER IN THE TPSS, OR B. ENDANGERING A MAINTENANCE TECHNICIAN.
25.	CEILING MOUNTED SMOKE DETECTORS TO BE MOUNTED TO UNDERSIDE OF STEEL BEAMS, IF APPLICABLE.
26.	THE DEMOLITION OF THE EXISTING FIRE ALARM SYSTEM WILL NOT COMMENCE UNTIL THE NEW FIRE ALARM SYSTEM IS FULLY INSTALLED AND ACCEPTED BY THE AUTHORITY HAVING JURISDICTION AND SEPTA.
27.	SPLICING OF WIRES AND USE OF WIRE NUTS IS NOT PERMITTED ANYWHERE IN THE FIRE ALARM SYSTEM.

FIRE ALARM NOTES:	
1.	THE FIRE ALARM WORK IS BY THE CONTRACTOR AND FIRE ALARM SUB-CONTRACTOR, UNLESS OTHERWISE NOTED.
2.	THE FIRE ALARM SYSTEM SCOPE OF WORK INCLUDES THE INSTALLATION AND TESTING OF A NEW FIRE ALARM CONTROL SYSTEM AND INVOLVES THE FOLLOWING: <ol style="list-style-type: none"> A. INSTALLATION OF A NEW FIRE ALARM CONTROL PANEL AND ASSOCIATED WIRING, BACK BOXES, ETC. AND ALL ASSOCIATED APPURTENANCES. B. INSTALLATION OF PULL STATIONS AS NEEDED. C. INSTALLATION OF HORN STROBES/STROBES TO INCLUDE A BOOSTER POWER SUPPLY AS NEEDED. D. INSTALLATION OF HEAT/SMOKE DETECTORS AS NEEDED. E. THE DEMOLITION SHALL OCCUR AT THE CONCLUSION OF THE FINAL TESTING AND ACCEPTANCE OF THE NEW FIRE ALARM SYSTEM.
3.	THE PROJECT SHALL BE IN ACCORDANCE WITH THE FOLLOWING CODES, STANDARDS, TESTING LABORATORIES AND UNDERWRITING AGENCY: <ol style="list-style-type: none"> A. 2010 CITY OF PHILADELPHIA BUILDING CODE (INTERNATIONAL BUILDING CODE 2009 AS AMENDED). B. 2010 CITY OF PHILADELPHIA FIRE CODE. C. 2010 CITY OF PHILADELPHIA MECHANICAL CODE. D. NFPA 70, NATIONAL ELECTRIC CODE, CURRENT EDITION. E. NFPA 72, NATIONAL FIRE ALARM CODE, CURRENT EDITION. F. ADAAG, ADA ACCESSIBILITY GUIDELINES FOR BUILDINGS AND FACILITIES, CURRENT EDITION. G. ANS/ASME A17.1. SAFETY CODE FOR ELEVATORS AND ESCALATORS, CURRENT EDITION. H. UL LISTED PRODUCTS FOR FIRE ALARM USE CONSIDERING ENVIRONMENTAL CONDITIONS. I. FM GLOBAL APPROVED PRODUCTS. J. PROJECT SPECIFICATIONS. K. SEPTA REQUIREMENTS.
4.	THIS DESIGN PACKAGE IS NOT MEANT TO PROVIDE FINAL QUANTITIES AS THEY ARE DIAGRAMMATICAL AND SHOW THE INTENT OF SEPTA'S REQUEST FOR A FULLY INSTALLED AND FULLY OPERATIONAL SYSTEM. ALL FINAL QUANTITIES OF ALL REQUIRED PARTS AND PIECES TO PROVIDE SAID COMPLETE SYSTEM ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR UNDER THIS CONTRACT. <ol style="list-style-type: none"> A. SEPTA REQUIREMENTS. B. FITTINGS, OUTLETS, JUNCTION BOXES, SUPPORTS, HANGERS, WIRE AND CABLE AND OTHER ITEMS INCIDENTAL TO AND/OR REQUIRED TO COMPLETE THE INSTALLATION, IN ACCORDANCE WITH THE INTENT OF THE DRAWINGS AND SPECIFICATIONS. THIS SHALL INCLUDE WIRE AND CONDUIT REQUIRED TO OPERATE BOTH NEW AND EXISTING EQUIPMENT CIRCUITS DURING EACH STAGE OF THE WORK. C. FINAL QUANTITIES OF FIRE ALARM CONTROL PANEL CABINETS, TO INCLUDE TRANSpondERS, ENCLOSURES AND BOOSTER RISERS SHALL BE COORDINATED.

FIRE ALARM NOTES (CONT):	
C.	FOR ANY EXPOSED EQUIPMENT AND RACEWAYS, SUBMIT PROPOSED LOCATIONS TO THE SEPTA PROJECT MANAGER IN ADVANCE.
D.	ALL 120V AC CIRCUITS REQUIRED TO POWER ALL PANELS AND OR ENCLOSURES AS COORDINATED ABOVE SHALL BE INCLUDED IN THIS SCOPE OF WORK. SUBMIT THIS INFORMATION IN ITS ENTIRETY TO THE SEPTA PROJECT MANAGER AS PART OF THE SHOP DRAWING PACKAGE.
E.	FAILURE TO COORDINATE AND INCLUDE ANY PART OR PIECE REQUIRED TO PROVIDE AN ENTIRELY COMPLETE AND FUNCTIONING FIRE ALARM SYSTEM PRIOR TO BID SHALL NOT BE SUBJECT TO A CHANGE ORDER, AND SHALL BE BORNE SOLELY BY THIS CONTRACTOR.
5.	SEPTA HAS THE RIGHT TO SALVAGE ANY EQUIPMENT TO BE REMOVED. ANY EQUIPMENT NOT SALVAGED SHALL BE REMOVED AND DISPOSED OF, OFF SITE PREMISES BY THE CONTRACTOR. THE CONTRACTOR SHALL MAKE PROVISIONS TO RETAIN ANY AND ALL REMOVED EQUIPMENT AS REQUESTED BY THE SEPTA PROJECT MANAGER.
6.	NOTIFY SEPTA SYSTEM SAFETY FIRE MARSHAL FOR ALL FIRE ALARM SHUTDOWNS, AND BEING PLACED IN TEST MODE WITHIN SEVEN (7) DAYS OF OPERATION.
7.	INITIATING DEVICE AND ANNUCIATOR DATA CIRCUIT WIRING SHALL BE 2C #16 TYPE FPLR UNLESS OTHERWISE INDICATED.
8.	NOTIFICATION CIRCUIT AND AUX POWER 24V DC WIRING SHALL BE 2C #14 TYPE FPLR UNLESS OTHERWISE INDICATED.
9.	MOUNT ALL DEVICES IN COMPLIANCE WITH PHILADELPHIA BUILDING CODE, NFPA CODES AND STANDARDS. REFER TO TYPICAL MOUNTING HEIGHT DETAIL ON THE FIRE ALARM DETAIL DRAWING AND COORDINATE WITH ARCHITECTURAL DRAWINGS.
10.	OBTAIN APPROVAL FROM THE SEPTA PROJECT MANAGER FOR ALL LOCATIONS IN ADVANCE OF LAYOUT.
11.	SHOW ACTUAL DETAILED RISER WITH DEVICE ADDRESSING AND NOMENCLATURE ON SHOP DRAWINGS.
12.	JUNCTION AND PULL BOXES ARE NOT NECESSARILY ALL INDICATED. PROVIDE JUNCTION BOXES AND PULL BOXES WHERE MANDATED BY THE NEC, AND AS REQUIRED TO FACILITATE EASE OF INSTALLATION. PROVIDE NEMA TYPE 4X STAINLESS STEEL JUNCTION BOXES AND SIZE IN ACCORDANCE WITH ARTICLE 314 OF THE NEC. SUBMIT PROPOSED LOCATIONS TO THE SEPTA PROJECT MANAGER FOR APPROVAL.
13.	ALL INTERIOR AND EXTERIOR RACEWAY SHALL BE RIGID CONDUIT. UTILIZE FMC AND LPMC, WHERE PERMITTED IN THE SPECIFICATIONS IN LIMITED LENGTHS NO MORE THAN 6'-0". USE MINIMUM CONDUIT SIZE OF 3/4", UNLESS OTHERWISE NOTED. DO NOT EXCEED CONDUIT FILL RATIO PER THE NEC.
14.	COORDINATE CONDUIT IN EXPOSED AREAS WITH EXISTING STRUCTURES, CABLE TRAYS AND PIPING; OBTAIN APPROVAL FROM THE SEPTA PROJECT MANAGER OF CONDUIT LAYOUT AND PATH PRIOR TO INSTALLATION.
15.	LABEL FIRE ALARM CONDUITS PER THE PROJECT SPECIFICATIONS. ALL "EXPOSED" FIRE ALARM CONDUIT SHALL BE PAINTED TO MATCH EXISTING FINISHES. PAINT SAMPLES SHALL BE SUBMITTED FOR APPROVAL WITHIN THE SHOP DRAWINGS PACKAGE TO THE SEPTA PROJECT MANAGER.
16.	PROTECT EXISTING CABLES AND EQUIPMENT DURING CONSTRUCTION. PAY FOR ALL COSTS ASSOCIATED WITH THE REPAIR OF ANY DAMAGED CABLES AND EQUIPMENT.
17.	FIRE ALARM DEVICES SHALL NOT BE INSTALLED WHERE ACCESS IS IMPEDED BY MECHANICAL SYSTEMS, DUCTS, PIPES OR CONDUITS.
18.	COORDINATE INSTALLATION OF FIRE ALARM DEVICES WITH THE MECHANICAL TRADE.
19.	CEILING MOUNTED SMOKE DETECTORS TO BE MOUNTED TO UNDERSIDE OF STEEL BEAMS, IF APPLICABLE.


50% SUBMISSION
NOT FOR CONSTRUCTION




COMMONWEALTH OF PENNSYLVANIA
DEPARTMENT OF TRANSPORTATION
AUTORITY
DATE 08/20/2025

1524 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19102

DATE PREPARED: _____ BY: _____
 DATE REVISIONS: _____ BY: _____
 PROJECT NUMBER: _____
 PROJECT DESCRIPTION: _____
 PROJECT LOCATION: _____



HDR Engineering, Inc.
Philadelphia, PA



BRAD J. FORD
No. 126070

NO.	DATE	DESCRIPTION


DATE PRINTED: 10/27/2025

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
FIRE ALARM
NOTES, SYMBOLS & ABBREVIATIONS

NO. SHOWN	SCALE FACTOR
AS SHOWN	1:1
DATE: 08/22/2025	DRAWN BY: USE
PROJECT NUMBER: 276482	PROJECT FILE #:
FA200	
SCALE: 1" = 8'	
DATE: 2/10/08	OR 4/32
PROJECT NO.:	
DATE: 11/18/08	
PROJECT NO. 17AN-FA200	

C:\PW\WORK\PROJECTS\10366\17AN-FA200.DWG

C:\P\WORKING\PTT\19086\17AN-FA201.DWG

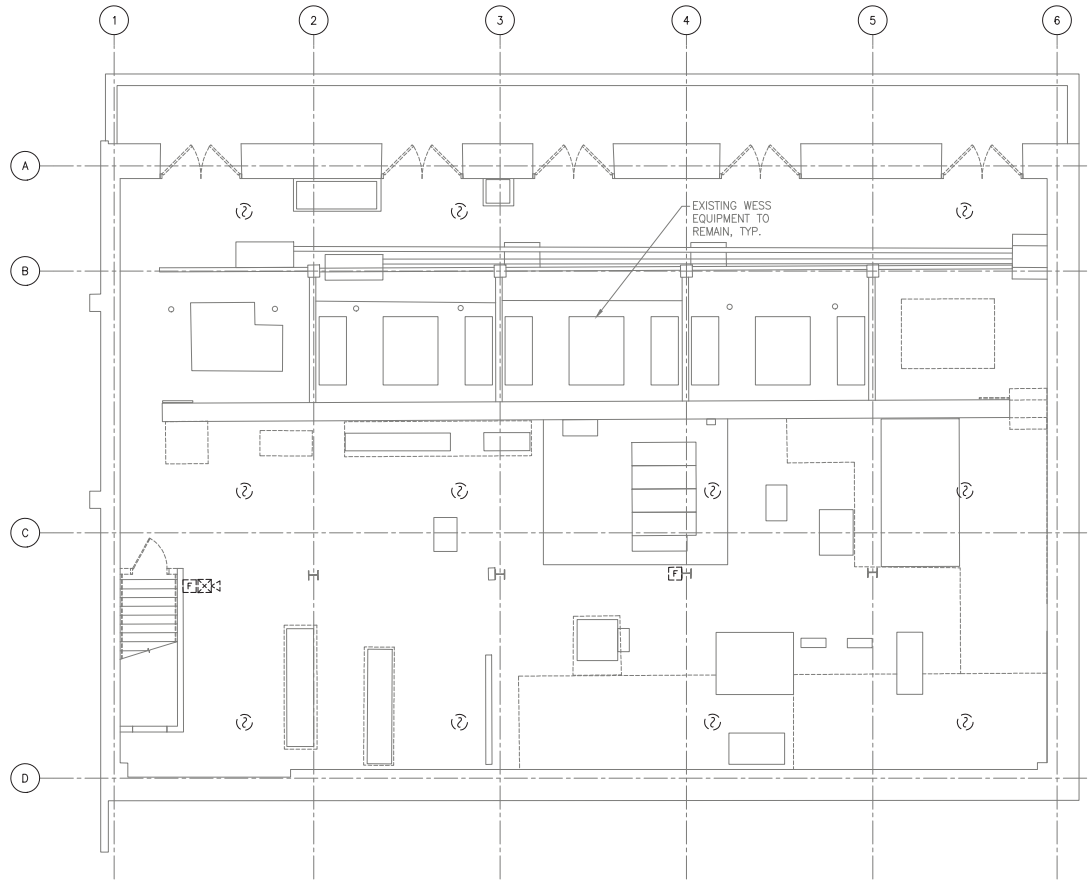

1 BASEMENT REMOVAL FLOOR PLAN
 SCALE: 3/16" = 1'-0"

GENERAL NOTES:

- REFER TO DRAWING FA200 FOR NOTES, SYMBOLS & ABBREVIATIONS.
- SEE FIRE ALARM DETAILS ON DRAWING FA207.



REGISTERED PROFESSIONAL ENGINEER
 PENNSYLVANIA REGISTRATION AUTHORITY
 EMC DIVISION
 1200 MARKET ST., 8TH FL.
 PHILADELPHIA, PA 19107

DATE PREPARED: DATE:
 DATE ENGINEERING CHECKED: DATE:
 DATE FOR TYPING/PRINT: DATE:
 DESIGNER:
 DIRECTOR OF ENGINEERING: DATE:
 GROUP/KEY: DATE:
 PROJECT NUMBER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
 TRACTION POWER SUBSTATION
 REHABILITATION
 FIRE ALARM
 DEMOLITION BASEMENT FLOOR PLAN


SCALE: 1:1
 DATE: 08/22/2025
 DRAWN BY: TMB
 CHECKED BY: LJM
 WORK ORDER NO: 276482
FA201
 SHEET NO: 2 OF 8
 PLOT NO: 211 OF 452
 PROJECT NO:
 COMPUTER FILE NO:
 17AN-FA201



50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025
 STATUS: 50% SUBMISSION

C:\P\WORKING\PTT\101886\17AN-FA202.DWG

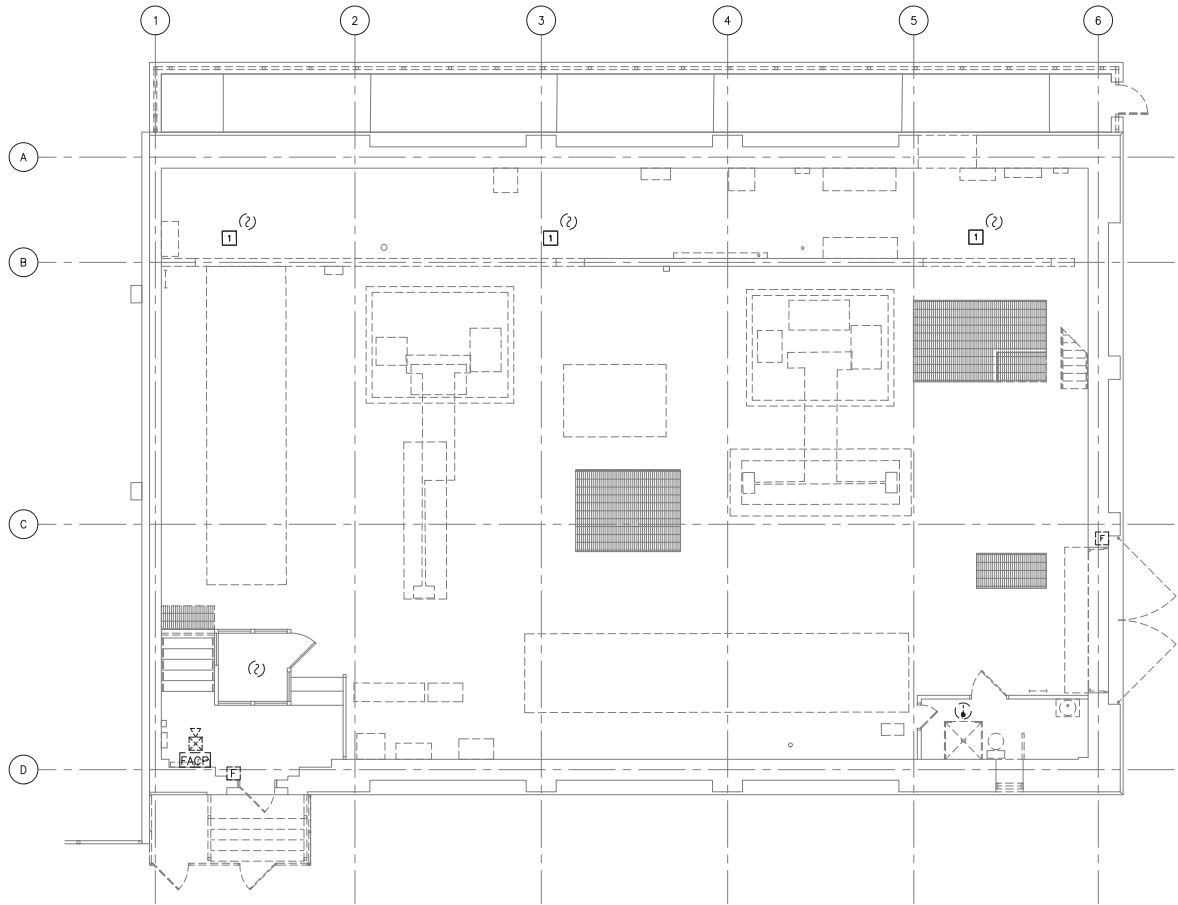

1
FA202 MAIN FLOOR REMOVAL PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

- REFER TO DRAWING FA200 FOR NOTES, SYMBOLS & ABBREVIATIONS.
- SEE FIRE ALARM DETAILS ON DRAWING FA207.

KEYED NOTES:

- 1** DEVICE LOCATED BELOW PLATFORM.



CHIEF ENGINEER: _____
 CHIEF ENGINEERING OFFICER: _____
 CHIEF ELECTRICAL OFFICER: _____
 UNIVERSITY: _____
 DIRECTOR OF ENGINEERING: _____
 MANAGER - PEEL/ENGINEERING: _____
 PROJECT MANAGER: _____

HDR
 HDR Engineering, Inc.
 Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
FIRE ALARM
 DEMOLITION FIRST FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	1004
WORK ORDER NO.:	276482	CHECKED BY:	1004
SHEET NUMBER:	FA202		
DWG. NO.:	3	OF	8
REV. NO.:	212	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-FA202		
REV. TO:			

6 4 2 0 6
 SCALE: 3/16" = 1'-0"

50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\PTT\10986\17AN-FA203.DWG

GENERAL NOTES:

1. REFER TO DRAWING FA200 FOR NOTES, SYMBOLS & ABBREVIATIONS.
2. SEE FIRE ALARM DETAILS ON DRAWING FA207.



DRP NUMBER: _____
 DRP ENGINEERING SPECIALIST: _____
 DRP ELECTRICAL SPECIALIST: _____
 UNIVERSITY: _____
 DIRECTOR OF ENGINEERING: _____
 MANAGER - ARCHITECTURE: _____
 PROJECT MANAGER: _____


HDR
 HDR Engineering, Inc.
 Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
FIRE ALARM
 DEMOLITION MEZZANINE FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	TRM
WORK ORDER NO.:	276482	CHECKED BY:	CLM
SHEET NUMBER:	FA203		
DWG. NO.:	4	OF:	8
SHT. NO.:	213	OF:	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-FA203	REV. NO.:	1

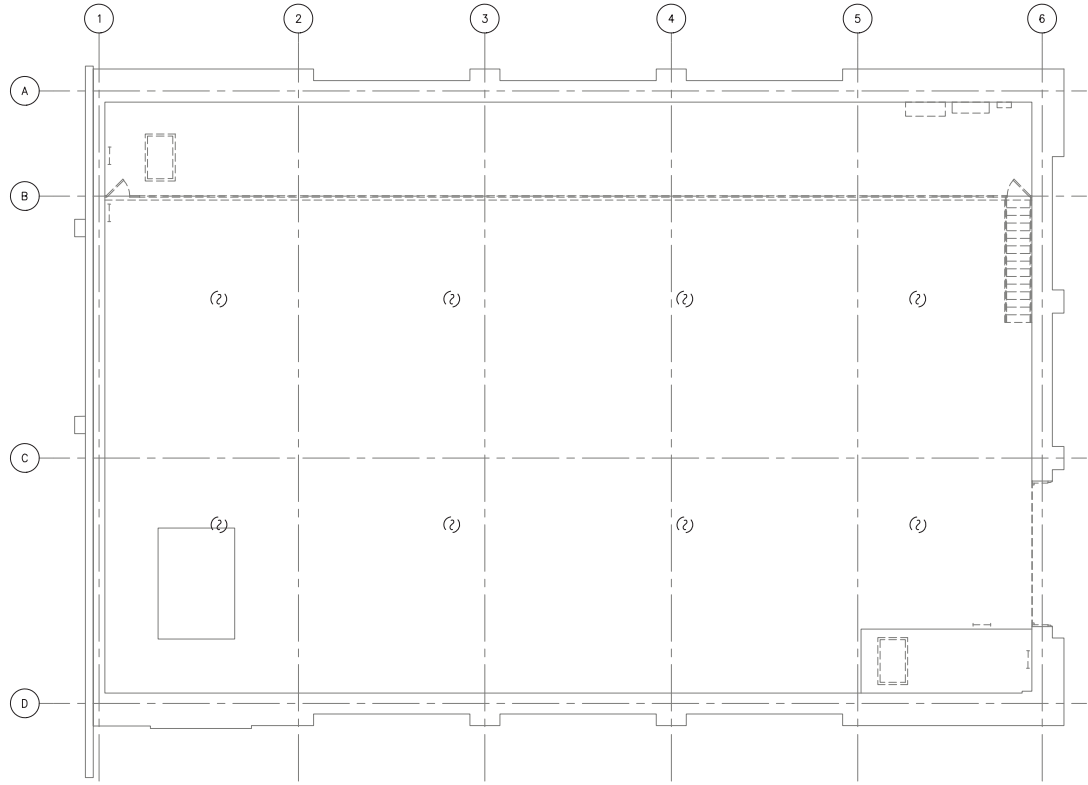

1
FA203
MEZZANINE REMOVAL FLOOR PLAN
 SCALE: 3/16" = 1'-0"

6 4 2 0 6
 SCALE: 3/16" = 1'0"

50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\PTT\10368\17AN-FA204.DWG

GENERAL NOTES:

- REFER TO DRAWING FA200 FOR NOTES, SYMBOLS & ABBREVIATIONS.
- SEE FIRE ALARM DETAILS ON DRAWING FA207.



SEPTA PROJECT NO.:	
SEPTA PROGRAM/PROJECT NO.:	
SEPTA LINE/STATION/SECTION:	
UNIVERSITY:	
DIRECTOR OF ENGINEERING:	
MANAGER - ARCHITECTURAL:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
FIRE ALARM
PROPOSED BASEMENT FLOOR PLAN


DATE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	TRM
DATE:		CHECKED BY:	CLM
WORK ORDER NO.:	276482		

FA204

DWG NO.:	5	OF	8
REV NO.:	214	OF	452
REV. DATE:			

COMPUTER FILE NO.: 17AN-FA204

STATUS: 50% SUBMISSION

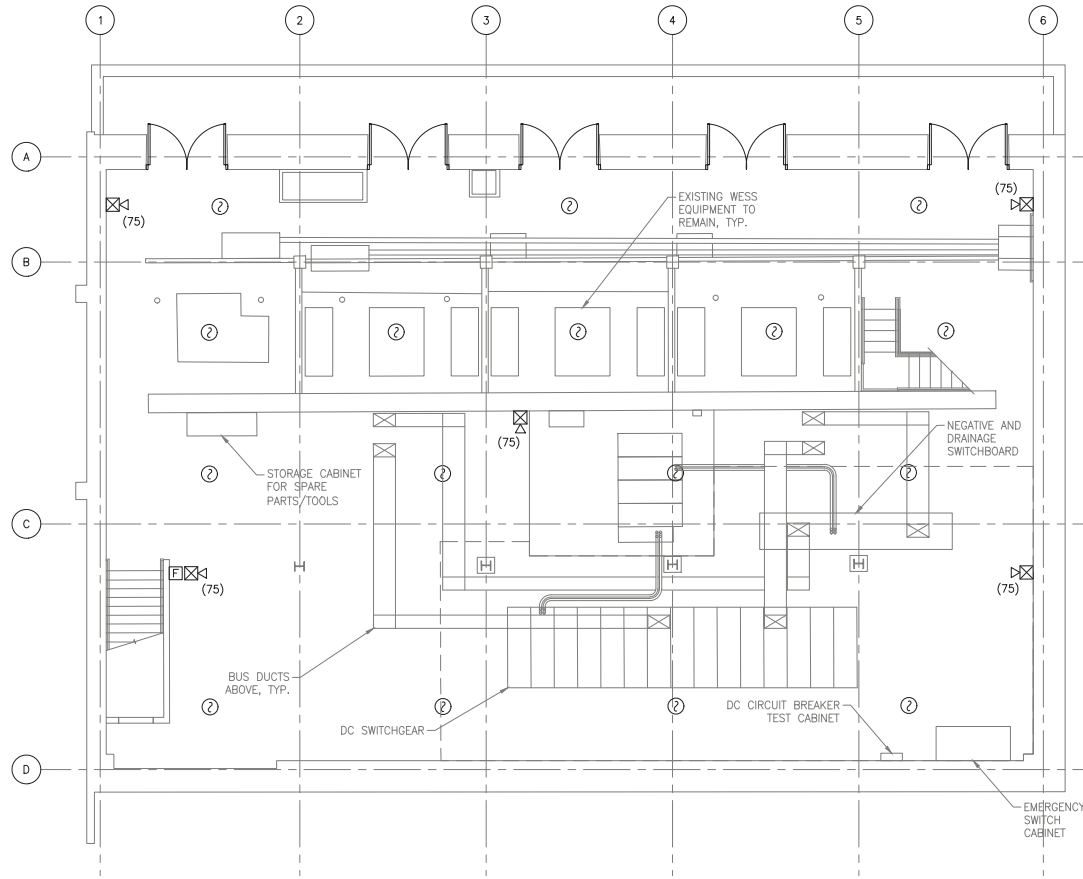


1 BASEMENT PROPOSED FLOOR PLAN
SCALE: 3/16" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION

C:\P\WORKING\PTT\10368\1717AN-FA205.DWG

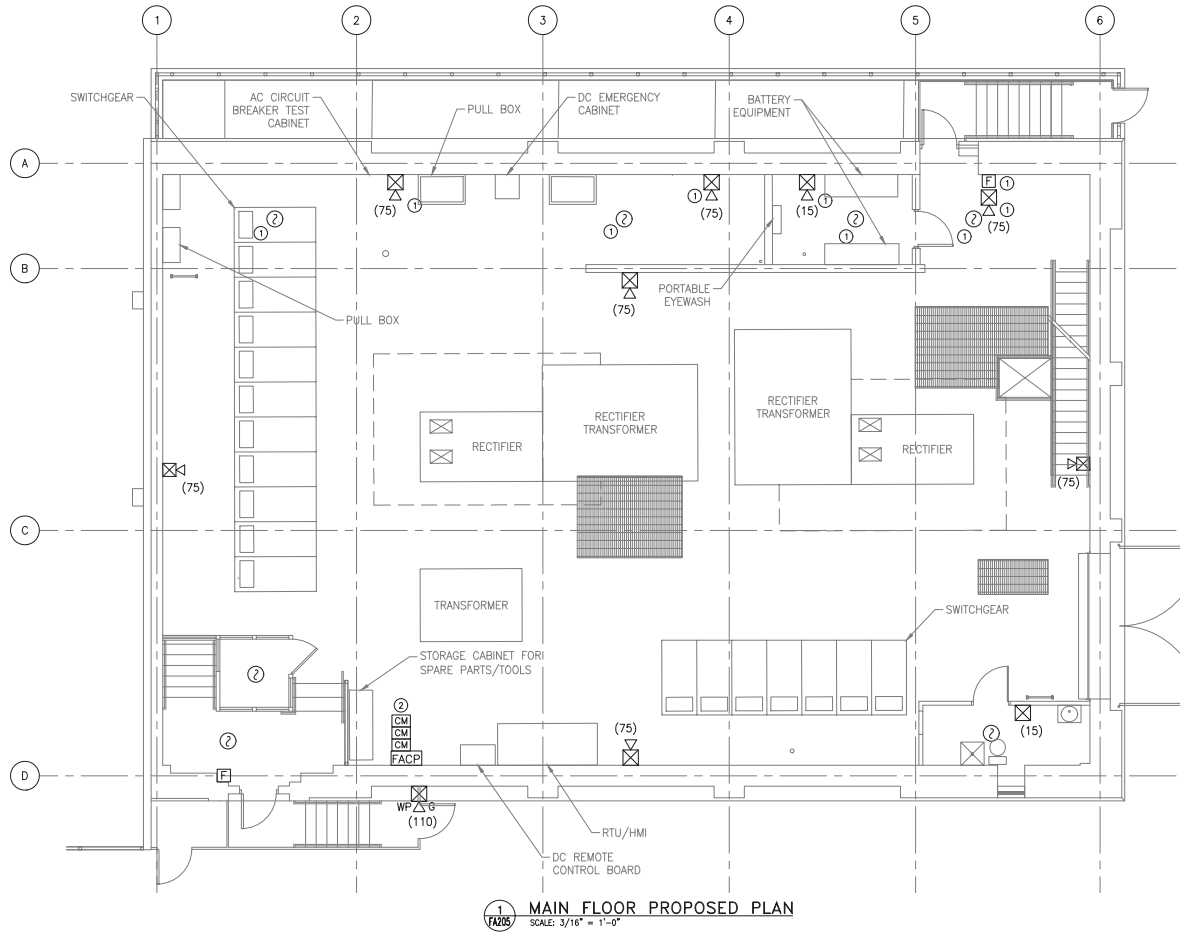

1
FA205
MAIN FLOOR PROPOSED PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. REFER TO DRAWING FA200 FOR NOTES, SYMBOLS & ABBREVIATIONS.
2. SEE FIRE ALARM DETAILS ON DRAWING FA207.

KEYED NOTES:

- ① DEVICE LOCATED BELOW PLATFORM.
- ② SEPTA APPROVED FIRE ALARM CONTROL PANEL WITH BATTERY CABINET MOUNTED BELOW. PROVIDE THE APPROPRIATE "CM" MODULES FOR INTERFACING WITH SEPTA'S SCADA SYSTEM. TRADE SHALL COORDINATE THE INTERFACE CONNECTIONS BETWEEN THE FIRE ALARM MODULES AND THE APPROPRIATE SCADA CONNECTION POINTS.



SEPTA/SEPTEN
PENNSYLVANIA
TRANSPORTATION
AUTHORITY
EMC DIVISION
1228 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107

DATE PLOTTED: DATE	
DATE ENGINEERING CHECKED: DATE	
DATE FOR TRANSMISSION	
DESIGNER	
DIRECTOR OF ENGINEERING: DATE	
PROJECT MANAGER	

HDR
HDR Engineering, Inc.
Philadelphia, PA

AMEC
AMEC Engineering Services
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
FIRE ALARM
PROPOSED FIRST FLOOR PLAN

SCALE: 1:1
DATE: 08/22/2025
DRAWN BY: TMB
CHECKED BY: LJM

WORK ORDER NO: 276482
FA205

NO. 10: 6 OF 8
REV. NO: 215 OF 452
REV. DATE:

COMPUTER FILE NO: 17AN-FA205




50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

C:\P\WORKING\PTTD\19268\17AN-FA206.DWG

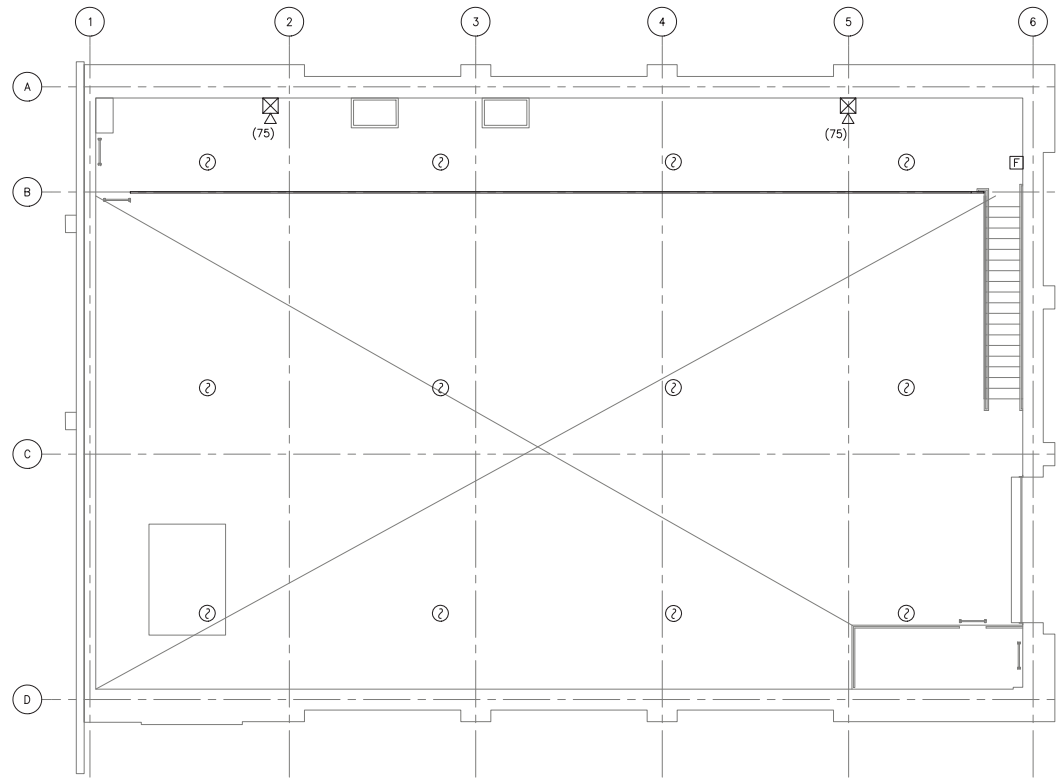

1
FA206 MEZZANINE PROPOSED FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. REFER TO DRAWING FA200 FOR NOTES, SYMBOLS & ABBREVIATIONS.
2. SEE FIRE ALARM DETAILS ON DRAWING FA207.



CHIEF ENGINEER: _____
 CHIEF ENGINEERING OFFICER: HDR
 CHIEF ELECTRICAL OFFICER: _____
 CHIEF MECHANICAL OFFICER: _____
 CHIEF SAFETY OFFICER: _____
 DIRECTOR OF ENGINEERING: HDR
 MANAGER: HDR ENGINEERING
 PROJECT MANAGER: _____

HDR
HDR Engineering, Inc.
Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
FIRE ALARM
 PROPOSED MEZZANINE FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	1004
WORK ORDER NO.:	276482	CHECKED BY:	1004
SHEET NUMBER:	FA206		
DWG. NO.:	7	OF	8
REV. NO.:	216	OF	452
COMPUTER FILE NO.:	17AN-FA206	REV. TO:	



50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\PTTD\081624\17AN\TP200.DWG

1 1M 1000 KCMIL DC POSITIVE CABLE
 1MR 1000 KCMIL DC NEGATIVE RETURN CABLE
 10GND NO. 10 AWG GROUND CONDUCTOR
 2M 2000 KCMIL DC POSITIVE CABLE
 2MR 2000 KCMIL DC NEGATIVE RETURN CABLE
 2 NO. 6 2 NO. 6 AWG CONDUCTOR
 2"C 2 INCH CONDUIT

A A AMPERES
 A-XD CURRENT TRANSDUCER
 AC ALTERNATING CURRENT
 AF AMPERES FRAME
 AFF ABOVE FINISHED FLOOR
 AIC AMPS INTERRUPTING CAPACITY
 AL ALUMINUM
 AM AMMETER
 ANN ANNUNCIATOR
 APPROX APPROXIMATE
 AS AMMETER SWITCH
 ASTM AMERICAN SOCIETY FOR TESTING AND MATERIALS
 AT AMPERES TRIP
 AUX AUXILIARY
 AVE AVENUE
 AWG AMERICAN WIRE GAUGE

B BDP BATTERY DISTRIBUTION PANEL
 BKR BREAKER
 BLDG BUILDING
 BLK BLOCKED OR BLOCKAGE
 BLVD BOULEVARD
 BT BUS TIE CIRCUIT BREAKER

C C CONDUIT, CONTACTOR
 CB CIRCUIT BREAKER
 CF CLOSING FUSE
 CI CAST IRON
 CL CURB LINE
 CKT CIRCUIT
 CLF CURRENT LIMITING FUSE
 COMP COMPRESSOR
 CONC CONCRETE
 CS CONTROL SWITCH
 CST CONTROL TEST SWITCH
 CT CURRENT TRANSFORMER
 CX DC CURRENT TRANSFORMER

D DB DECIBELS
 DC DIRECT CURRENT
 DEPT DEPARTMENT
 DET DETAIL
 DIA DIAMETER
 DIM DIMENSIONS
 DISC DISCONNECT
 DP DEEP
 DWG DRAWING

E E EAST
 EB EASTBOUND
 EL, ELEV ELEVATION
 EMG EMERGENCY
 EMH ELECTRIC MANHOLE
 EPR ETHYLENE PROPYLENE RUBBER
 EQ EQUAL

E ER ELECTRICALLY RESET
 EX EXISTING
 F F-XD FREQUENCY TRANSDUCER
 FDR FEEDER
 FL FLOOR
 FPP FIBER PATCH PANEL
 FRE FIBER REINFORCED EPOXY (SEE RTRC)
 FT FEET
 FUT FUTURE

G G GREEN
 GAL GALLON
 GALV GALVANIZED
 GIL GREEN INDICATING LIGHT
 GND GROUND
 GR GRADE
 GRS GALVANIZED RIGID STEEL

H HMI HUMAN MACHINE INTERFACE
 HORIZ HORIZONTAL
 HR HAND RESET
 HV HIGH VOLTAGE
 HW HOT WATER
 HZ HERTZ

I IB INBOUND
 ID INSIDE DIAMETER, IDENTIFICATION
 IED INTELLIGENT ELECTRONIC DEVICE
 IN INCH
 ISO ISOLATION
 INST INSTANTANEOUS

J JB JUNCTION BOX
 K KA KILO-AMPERES
 KCMIL THOUSAND CIRCULAR MILS
 KV KILO-VOLTS
 KVA KILO-VOLT AMPERES
 KW KILO-WATTS
 L L LOCAL
 LBS POUNDS
 LC LOAD CENTER
 LO LOCKOUT
 LP LIGHTING POLE FIXTURE, LOW POINT
 LS LIMIT SWITCH
 LV LOW VOLTAGE

M MAX MAXIMUM
 MAN, MNL MANUAL
 MCB MAIN CIRCUIT BREAKER
 MCM MILLION CIRCULAR MILLIMETERS
 MFR-M MULTI-FUNCTION RELAY METERING
 MH MANHOLE
 MIN MINIMUM
 MMFO MULTIMODE FIBER OPTIC CABLE
 MPR MOTOR PROTECTION RELAY
 MR MULTI-RATIO
 MV MILLIVOLT

N N NORTH
 NB NORTHBOUND
 NC, N.C. NORMALLY CLOSED
 NEG, N NEGATIVE
 NEUT, N NEUTRAL
 NIC NOT IN CONTRACT
 NLTC NO LOAD TAP CHANGER
 NO, N.O. NORMALLY OPEN
 N.T.S. NOT TO SCALE

O OB OUTBOUND
 OC ON-CENTER, OVERCURRENT
 OCS OVERHEAD CATENARY SYSTEM
 OD OUTSIDE DIAMETER
 OOS OUT OF SERVICE

P PAC PROGRAMMABLE AUTOMATION CONTROLLER
 PC PERSONAL COMPUTER
 PECO PHILADELPHIA ELECTRIC COMPANY
 PH, Ø PHASE
 PL POSITIVE LOCAL, PLATE, PROPERTY LINE
 PLC PROGRAMMABLE LOGIC CONTROLLER
 POL POLARIZING
 POS POSITIVE
 PROP PROPERTY
 PRT PHILADELPHIA RAPID TRANSIT
 PT POTENTIAL TRANSFORMER
 PTS POTENTIAL TRANSFORMERS
 PVC POLY VINYL CHLORIDE
 PWR POWER

Q QTY QUANTITY

R R RETURN NEGATIVE CABLE, RED
 REC RECEPTACLE
 RECT RECTIFIER
 REQ'D REQUIRED
 RES RESISTOR
 RGS RIGID GALVANIZED STEEL
 RIL RED LIGHT INDICATION
 RM ROOM
 RMC RIGID METAL CONDUIT
 ROW RIGHT OF WAY
 RTRC REINFORCED THERMOSETTING RESIN CONDUIT
 RTU REMOTE TERMINAL UNIT

S S SECTION, SOUTH, SUPERVISORY
 SA SURGE ARRESTOR
 SB SOUTHBOUND
 SC SHORT CIRCUIT, SURGE CAPACITOR
 SCADA SUPERVISORY CONTROL AND DATA ACQUISITION
 SE STORED ENERGY
 SEC SECOND
 SEPTA SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY
 SS SUBSTATION
 ST STREET
 STA STATIONING
 STD STANDARD

S SUPL OVERHEAD SUPPLEMENTARY CABLE
 SUPV SUPERVISORY
 SVC SERVICE
 SW SWITCH
 SWGR SWITCHGEAR

T T TRANSFORMER
 TEMP TEMPERATURE
 TF TRIPPING FUSE
 THK THICK
 TK TRACK
 TOT TOTALIZER
 TP Traction POWER
 TPSS TRACTION POWER SUBSTATION
 TRANSF TRANSFER
 TS TEST SWITCH
 TW TROLLEY WIRE
 TYP TYPICAL

U U/G UNDERGROUND
 UON UNLESS OTHERWISE NOTED

V V VOLTS OR VOLTAGE
 V-XD VOLTAGE TRANSDUCER
 VA VALVE, VOLT-AMPERE
 VAR VOLT-AMPERE REACTIVE
 VM VOLTMETER
 VS VOLTMETER SWITCH

W W WEST, WIRE, WHITE
 W/ WITH
 W-XD WATTAGE TRANSDUCER
 WB WESTBOUND
 WESS WAYSIDE ENERGY STORAGE SYSTEM
 WH WATT-HOUR METER
 WLI WHITE LIGHT INDICATION
 WP WATERPROOF

X XD TRANSDUCER
 XFMR TRANSFORMER

Y YEL YELLOW

Z ZL ZIP LINE, POLY PULL LINE



SEPTA PROJECT FILE NO.
 SEPTA PROJECT NUMBER
 SEPTA PROJECT NAME
 SEPTA PROJECT LOCATION



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 ABBREVIATIONS

SCALE: 1" = 10'-0"

DATE: 08/22/2025

PROJECT NUMBER: 276482

TP200

SHEET NO. 1 OF 35
 SHEET NAME: 218 OF 452
































































COMPUTER FILE NO.: 17AN-TP200

50% SUBMISSION
 NOT FOR CONSTRUCTION

STATUS: 50% SUBMISSION

DATE PRINTED: 10/21/2025

C:\P\WORKING\PTTD\08152017\TP201.DWG

	30E = CLEARING RATING FUSE		SECTION "2" AS SHOWN ON DRAWING TP130		GROUND		THREE-POLE SINGLE THROW SWITCH
	CLF = CURRENT LIMITING FUSE		DEVICE DISCONNECT CONTACTS		GROUND ROD		N.O. DISCONNECT SWITCH, 1-POLE
	TRANSFORMER		RELAY OPERATING COIL NUMBER DESIGNATES RELAY TYPE		CABLE ROUTE THROUGH FLOOR		N.C. = NORMALLY OPEN N.C. = NORMALLY CLOSED
	POTENTIAL TRANSFORMER UPPER = NO. RATIO LOWER = NO. QTY OF XFMR		DC CIRCUIT BREAKER		CABLE ROUTE THROUGH CEILING		DISCONNECT SWITCH 2-POLE
	CURRENT TRANSFORMER UPPER = NO. RATIO LOWER = NO. QTY OF XFMR		FUNCTIONAL INTERCONNECTION AMONG CONTROL PROTECTIVE AND POWER DEVICES (ARROW DENOTES DIRECTION OF CONTROL)		MANUAL-AUTOMATIC TRANSFER MODE SELECTOR SWITCH		BLUE INDICATING LAMP (HEATER AMMETER)
	3 PHASE DELTA CONNECTION		DIODE/DIODE RECTIFIER		CONTROL SWITCH		GREEN INDICATING LAMP (BREAKER OPEN)
	3 PHASE WYE CONNECTION		DC CURRENT SHUNT		STORED ENERGY DEVICE		RED INDICATING LAMP (BREAKER CLOSED)
	3 PHASE WYE CONNECTION (GROUNDED)		NEON HIGH VOLTAGE INDICATORS (CABLE ALIVE INDICATION)		MULTIFUNCTION RELAY/IED A = AMMETER V = VOLTMETER KWH = KILOWATT-HOUR METER		WHITE INDICATING LAMP (SPRINGS CHARGED)
	OPEN DELTA CONNECTION (GROUNDED / UN-GROUNDED)		CABLE TERMINATION SEALING END		KILO-WATT HOUR METER		KEY INTERLOCK
	BUS DUCT		WITHDRAWABLE SINGLE POLE DC CIRCUIT BREAKER WITH DIRECT ACTING TRIP ELEMENT		WATT HOUR METER DEMAND		LOCAL/SUPERVISORY CONTROL SWITCH
	MEDIUM VOLTAGE DRAWOUT CIRCUIT BREAKER		NORMALLY OPEN CONTACT		CURRENT TRANSDUCER		GROUND DETECTION RELAY
	FUSE DISCONNECT SWITCH		NORMALLY CLOSED CONTACT		VOLTAGE TRANSDUCER		CONNECTION TO SCADA
<u>MANHOLE DESIGNATIONS</u>			SURGE ARRESTER		AMMETER		
	ELECTRIC MANHOLE NO. 30		LIGHTNING ARRESTER		AMMETER SWITCH		
	TELEPHONE MANHOLE NO. 1		GENERATOR		VOLTMETER		
	MANHOLE AT GRADE		BATTERY		VOLTMETER SWITCH		
	EXISTING MANHOLE				TEST SWITCH		
					NO LOAD TAP CHANGER		
					PHASING RECEPTACLE		


REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 LEGENDS & SYMBOLS


SCALE:	NTS	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DM
WORK ORDER NO.:	276482	CHECKED BY:	DM
SHEET NUMBER:	TP201		
DWG. NO.:	2	OF	35
REV. NO.:	219	OF	453
COMPUTER FILE NO.:	17AN-TP201	REV. DATE:	

50% SUBMISSION
 NOT FOR CONSTRUCTION

CP:\WORKING\PTTD\181542\17AN-TP205.DWG

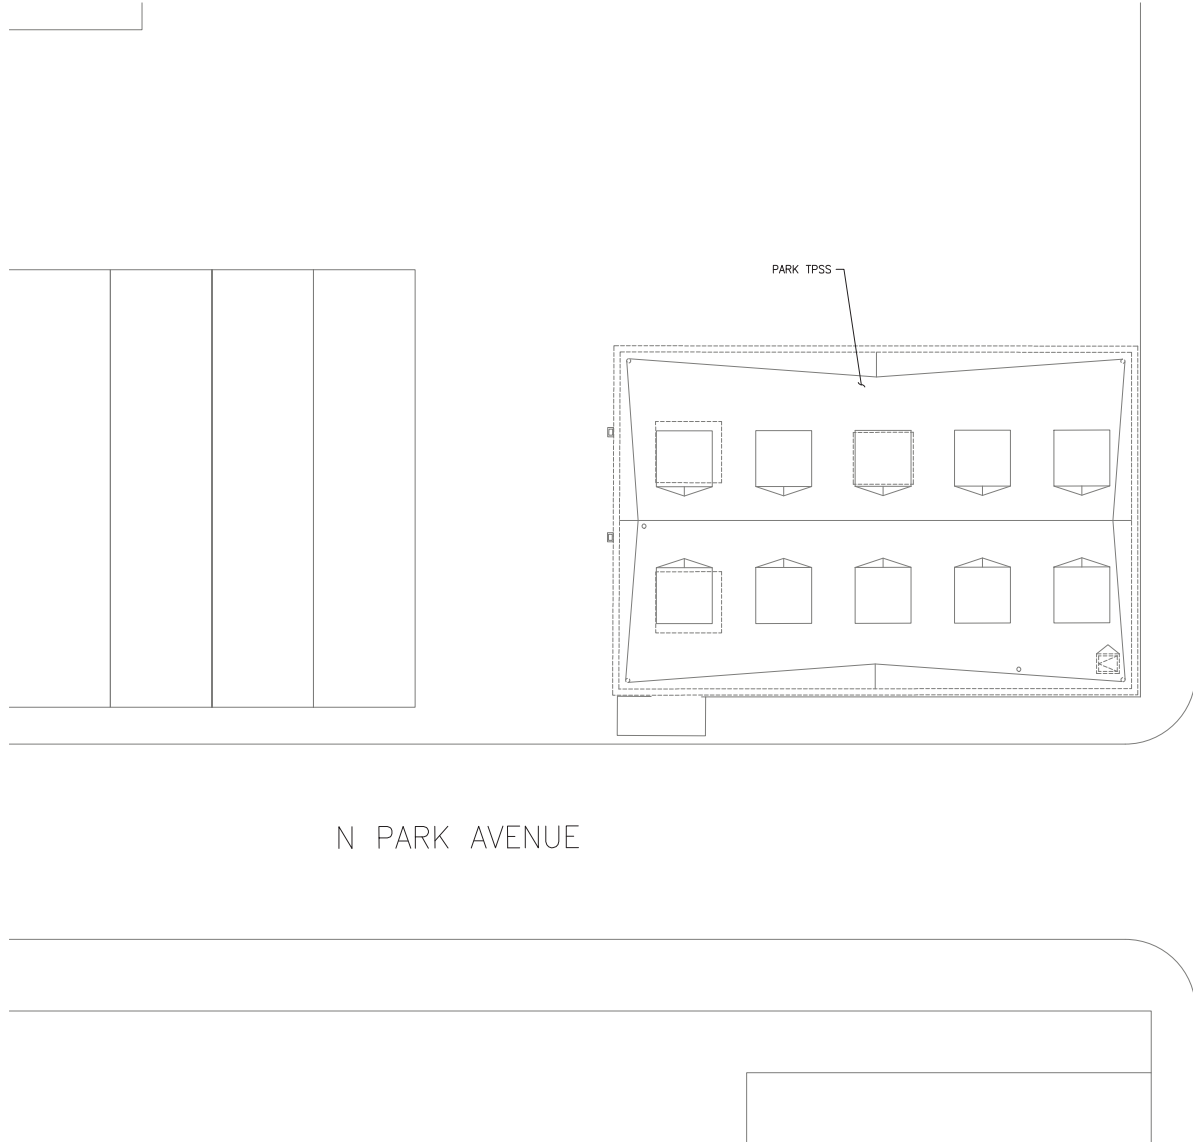

- NOTES:
1. THE CONTRACTOR TO FIELD VERIFY THE EXISTING TRACTION POWER DUCTBANKS AND MANHOLES, AND INSTALL NEW DC FEEDERS FROM TPSS TO THESE EXISTING MANHOLES VIA EXISTING DUCTBANKS.



50% SUBMISSION
NOT FOR CONSTRUCTION



SEPTA
SOUTHEASTERN
PENNSYLVANIA
TRANSPORTATION
AUTHORITY
DMC DIVISION
1234 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107




REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
SUBSTATION SITE PLAN

DATE: NTS	SCALE FACTOR: 1
DATE: 08/22/2025	DRAWN BY: DM
WORK ORDER NO: 276482	CHECKED BY: DM
SHEET NUMBER: TP205	
DWG NO: 4 OF 35	REV NO: 221 OF 453
PROJECT NO:	DATE: 17AN-TP205

DATE PRINTED: 10/27/2025
STATUS: 50% SUBMISSION

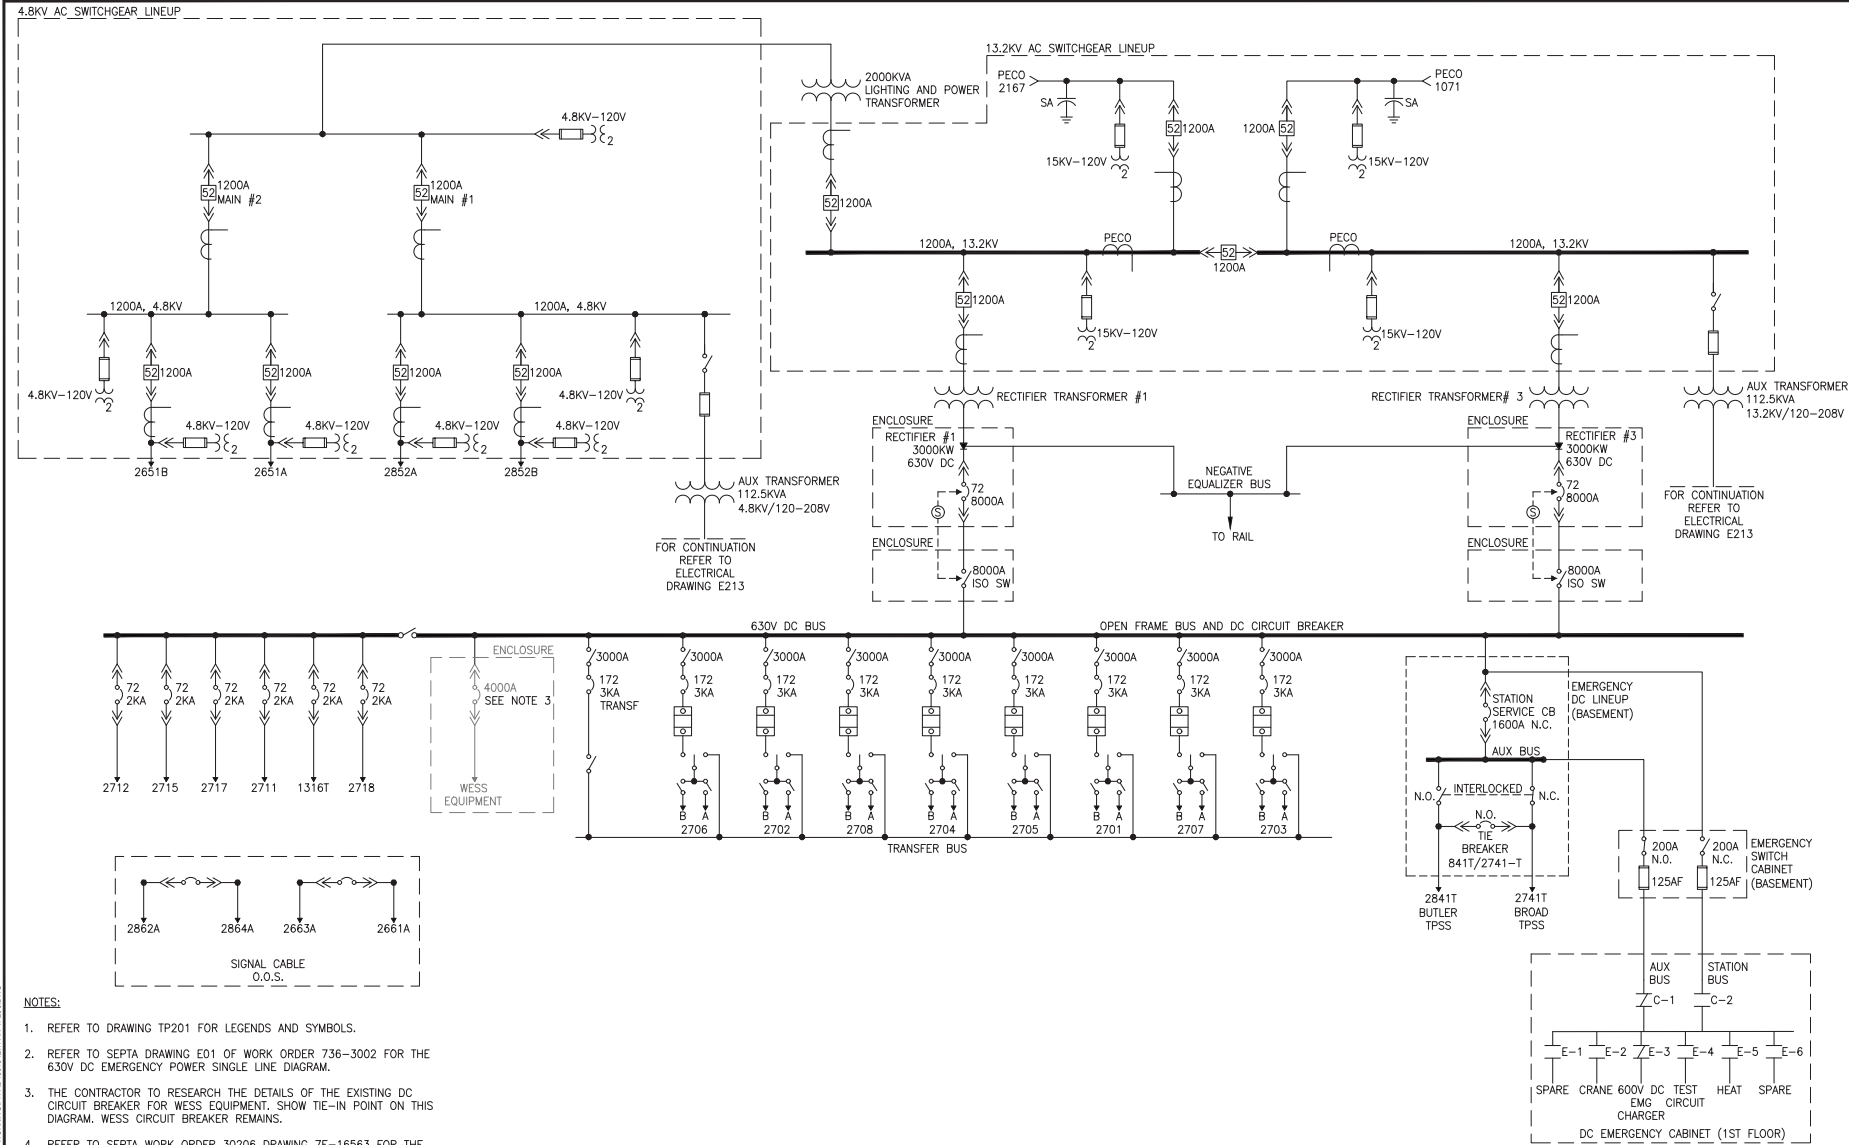

NOTES:

- REFER TO DRAWING TP201 FOR LEGENDS AND SYMBOLS.
- REFER TO SEPTA DRAWING E01 OF WORK ORDER 736-3002 FOR THE 630V DC EMERGENCY POWER SINGLE LINE DIAGRAM.
- THE CONTRACTOR TO RESEARCH THE DETAILS OF THE EXISTING DC CIRCUIT BREAKER FOR WESS EQUIPMENT. SHOW TIE-IN POINT ON THIS DIAGRAM. WESS CIRCUIT BREAKER REMAINS.
- REFER TO SEPTA WORK ORDER 30206 DRAWING 7E-16563 FOR THE 4800V SINGLE LINE DIAGRAM.
- EXISTING WESS EQUIPMENT SHALL REMAIN. DEMOLISH ALL OTHER TRACTION POWER EQUIPMENT.
- DEMOLISH EXISTING DC POSITIVE AND NEGATIVE CABLES OUT TO THE MANHOLES NEAREST THE TPSS BUILDING.

50% SUBMISSION
NOT FOR CONSTRUCTION



SHEET NO. 222 OF 453
 DATE 08/22/2025
 DRAWN BY: [blank]
 CHECKED BY: [blank]


HDR
 HDR Engineering, Inc.
 Philadelphia, PA

NO.	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 EXISTING SINGLE LINE DIAGRAM

SHEET NO. 222 OF 453
 DATE 08/22/2025
 DRAWN BY: [blank]
 CHECKED BY: [blank]
 WORK ORDER NO. 276482
TP206
 SHEET NO. 5 OF 35
 PART NO. 222 OF 453
 PROJECT FILE NO. 17AN-TP206

DATE PRINTED: 10/27/2025

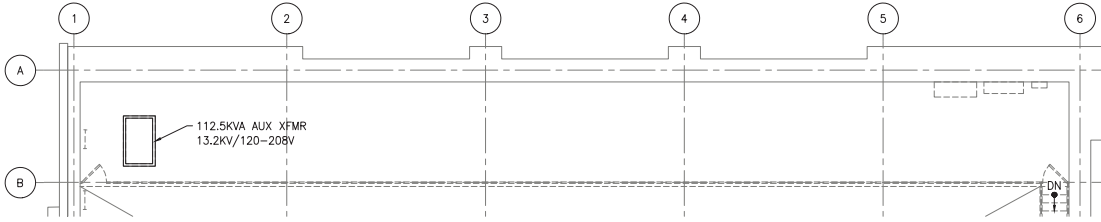


1 EXISTING MEZZANINE EQUIPMENT PLANS
SCALE: 1" = 5'

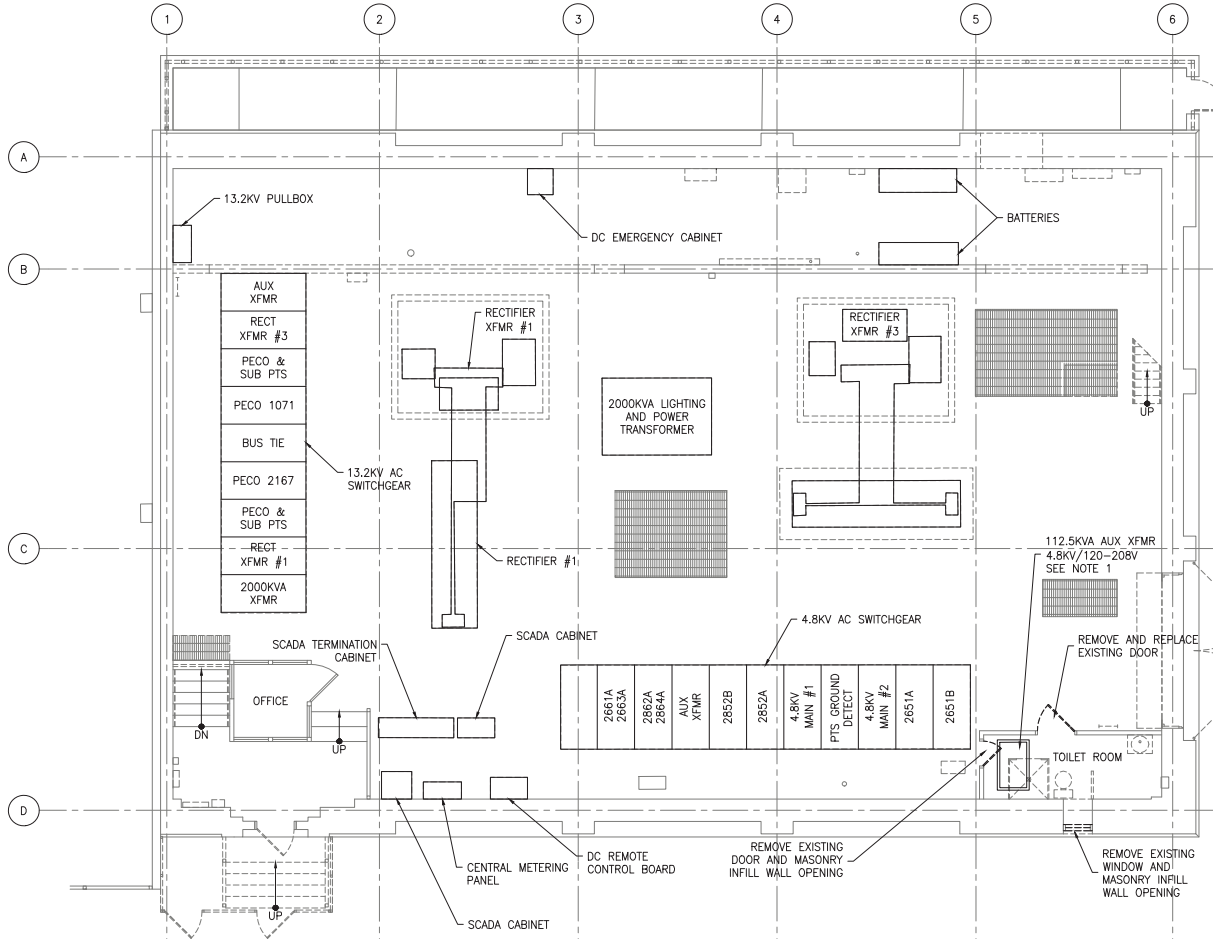

2 EXISTING FIRST FLOOR EQUIPMENT PLANS
SCALE: 1" = 5'

- NOTES:
1. 112.5KVA AUXILIARY TRANSFORMER IS LOCATED ABOVE TOILET ROOM.
 2. BOLD ITEMS ON THIS DRAWING TO BE DEMOLISHED.



50% SUBMISSION
NOT FOR CONSTRUCTION




PREPARED BY: _____
 CHECKED BY: _____
 DATE: _____
 PROJECT NUMBER: _____

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 EXIST MEZZ & FIRST FLOOR EQUIP PLANS

SHEET NUMBER:	TP207
DATE:	08/22/2025
DRAWN BY:	ASG
CHECKED BY:	SM
PROJECT NUMBER:	276482
SHEET NO.:	6 OF 35
DATE:	2/23 OF 4/53
REVISION:	
COMPUTER FILE NO.:	17AN-TP207
REV. NO.:	

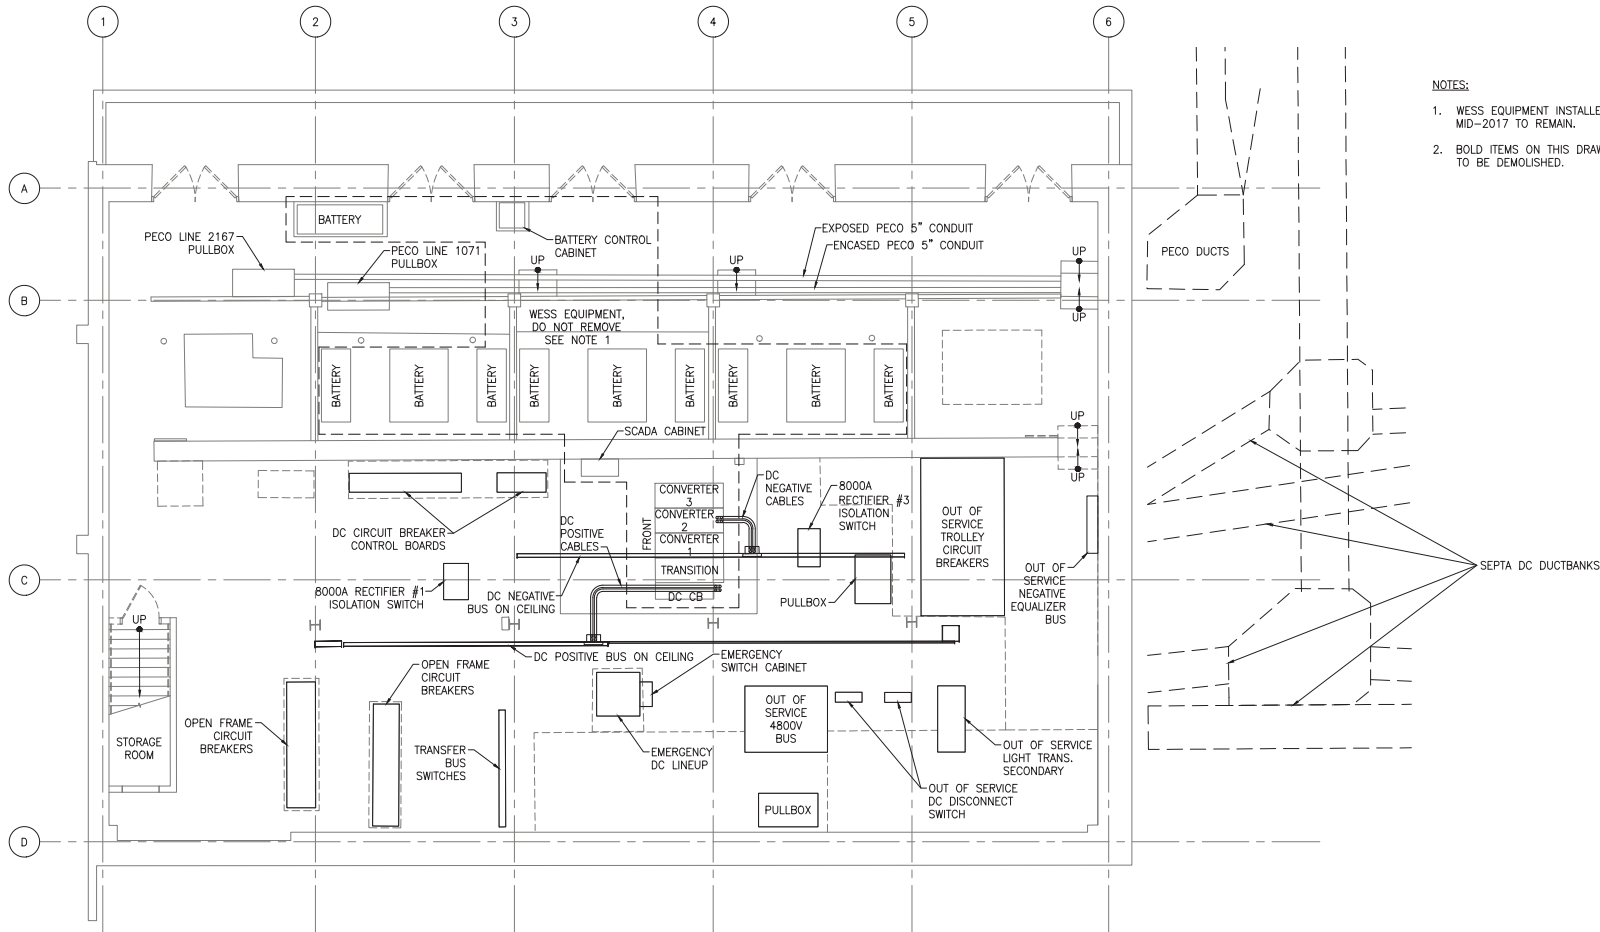

- NOTES:**
1. WESS EQUIPMENT INSTALLED MID-2017 TO REMAIN.
 2. BOLD ITEMS ON THIS DRAWING TO BE DEMOLISHED.

1 EXISTING BASEMENT EQUIPMENT PLAN
 TP208 SCALE: 1" = 5'



50% SUBMISSION
 NOT FOR CONSTRUCTION




DRY FURNISHING:	
DRY FINISHING SPECIALIST:	
DRY FINISHING SPECIALIST:	
DRY FINISHING SPECIALIST:	
DRY FINISHING SPECIALIST:	
DRY FINISHING SPECIALIST:	
DRY FINISHING SPECIALIST:	
DRY FINISHING SPECIALIST:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 EXISTING BASEMENT EQUIPMENT PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1
DATE:	08/22/2025	DRAWN BY:	SLJ
WORK ORDER NO.:	276482	CHECKED BY:	SLJ
SHEET NUMBER:	TP208		
DWG. NO.:	7	OF	35
PT. NO.:	224	OF	453
COMPUTER FILE NO.:	17AN-TP208	REV. NO.:	1

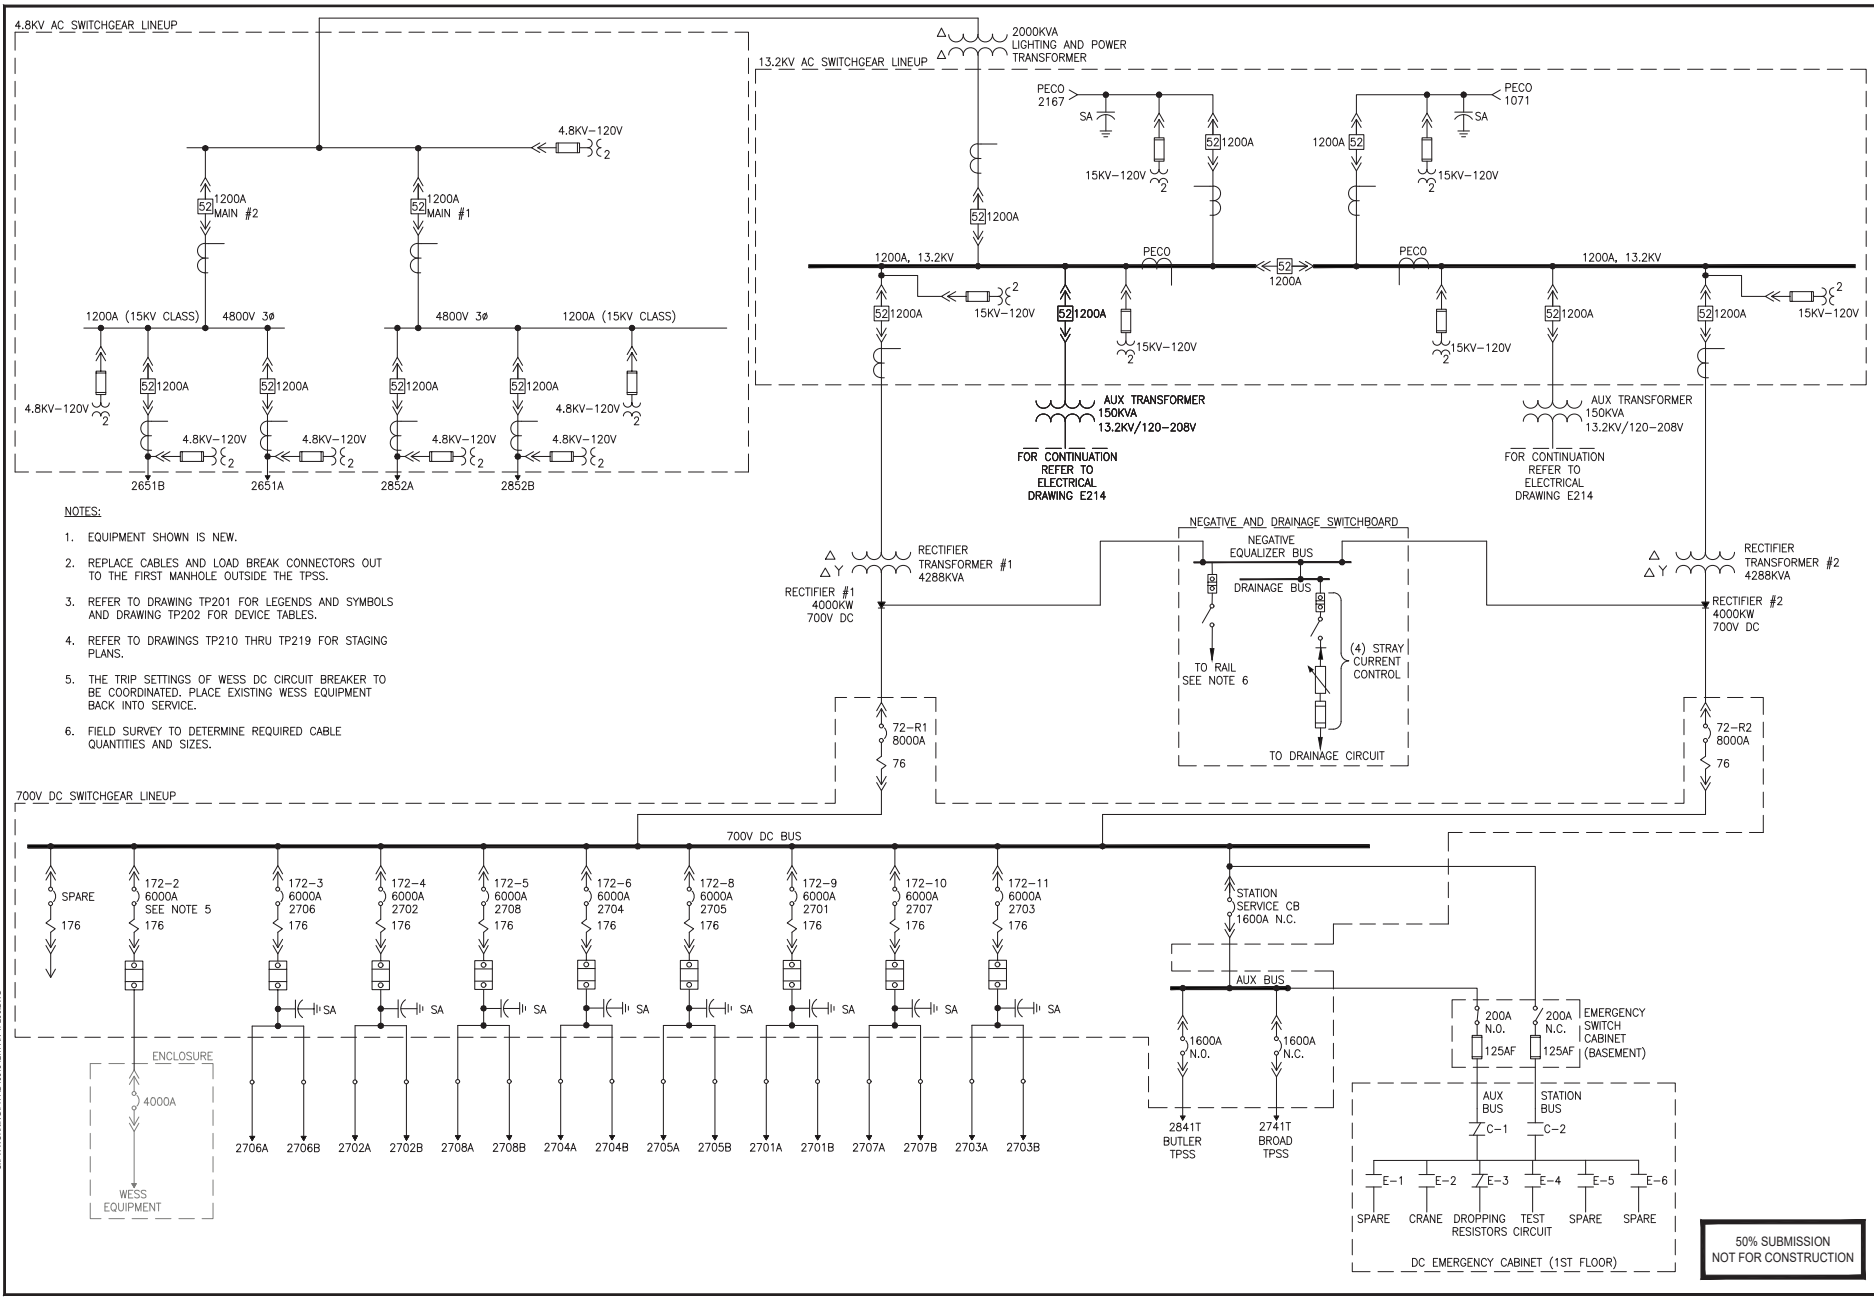

- NOTES:**
- EQUIPMENT SHOWN IS NEW.
 - REPLACE CABLES AND LOAD BREAK CONNECTORS OUT TO THE FIRST MANHOLE OUTSIDE THE TPSS.
 - REFER TO DRAWING TP201 FOR LEGENDS AND SYMBOLS AND DRAWING TP202 FOR DEVICE TABLES.
 - REFER TO DRAWINGS TP210 THRU TP219 FOR STAGING PLANS.
 - THE TRIP SETTINGS OF WESS DC CIRCUIT BREAKER TO BE COORDINATED. PLACE EXISTING WESS EQUIPMENT BACK INTO SERVICE.
 - FIELD SURVEY TO DETERMINE REQUIRED CABLE QUANTITIES AND SIZES.

HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
PROPOSED SINGLE LINE DIAGRAM


DATE: 08/22/2025	SCALE: -
DRAWN BY: JL	CHECKED BY: SA
SHEET NUMBER: 276482	
TP209	
NO. OF: 8 OF 35	DATE: 08/22/2025
REV. NO.: 225 OF 453	PROJECT NO.: 276482
COMPUTER FILED: 17AN-TP209	REV. NO.: -

50% SUBMISSION
NOT FOR CONSTRUCTION

C:\PWORKING\PTT\08152\21\AN\TP209.DWG

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

4.8KV AC SWITCHGEAR LINEUP

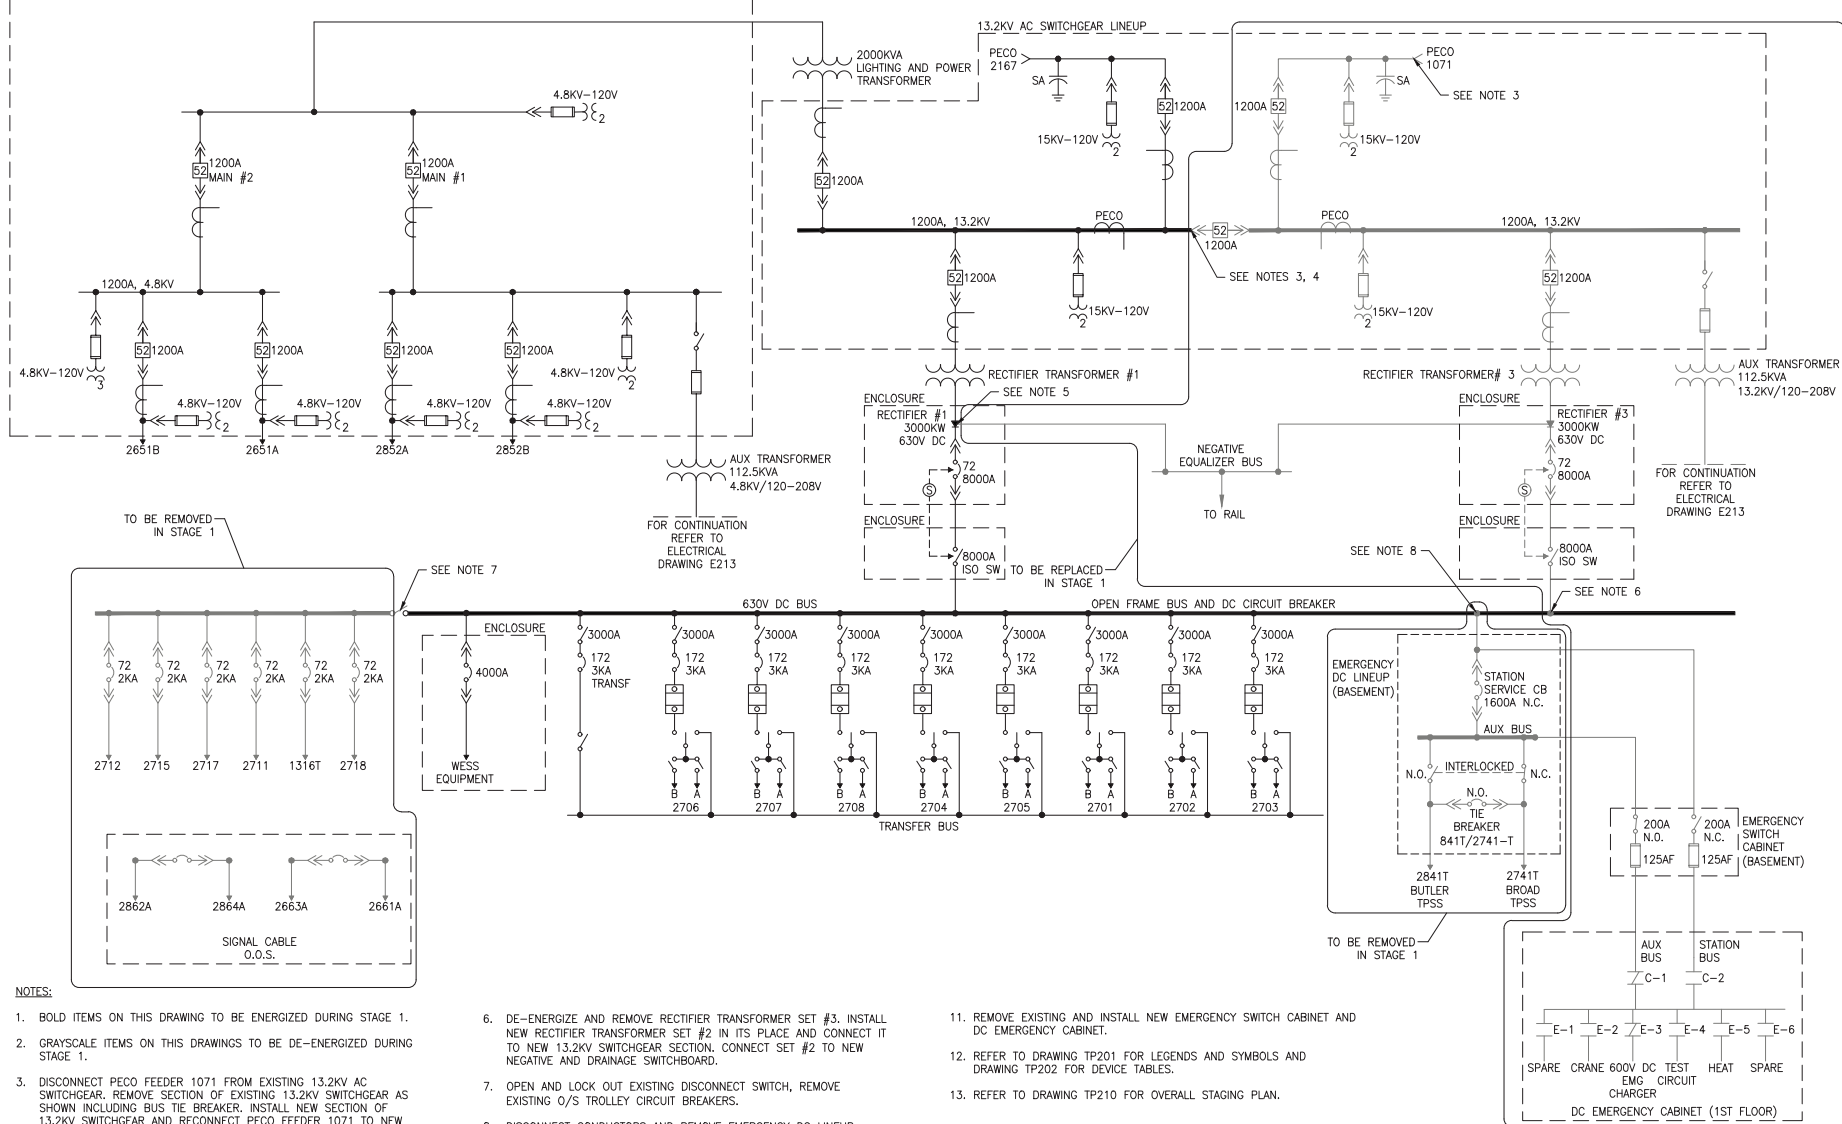

NOTES:

1. BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 1.
2. GRAYS/SCALE ITEMS ON THIS DRAWINGS TO BE DE-ENERGIZED DURING STAGE 1.
3. DISCONNECT PECO FEEDER 1071 FROM EXISTING 13.2KV AC SWITCHGEAR. REMOVE SECTION OF EXISTING 13.2KV SWITCHGEAR AS SHOWN INCLUDING BUS TIE BREAKER. INSTALL NEW SECTION OF 13.2KV SWITCHGEAR AND RECONNECT PECO FEEDER 1071 TO NEW SECTION.
4. DISCONNECT BUS TIE CIRCUIT BREAKER FROM EXISTING 13.2KV BUS.
5. INSTALL NEW NEGATIVE AND DRAINAGE SWITCHBOARD. DISCONNECT NEGATIVE CONNECTION FROM EXISTING RECTIFIER #1 AND TEMPORARY CONNECT EXISTING RECTIFIER #1 TO NEW NEGATIVE AND DRAINAGE SWITCHBOARD.
6. DE-ENERGIZE AND REMOVE RECTIFIER TRANSFORMER SET #3. INSTALL NEW RECTIFIER TRANSFORMER SET #2 IN ITS PLACE AND CONNECT IT TO NEW 13.2KV SWITCHGEAR SECTION. CONNECT SET #2 TO NEW NEGATIVE AND DRAINAGE SWITCHBOARD.
7. OPEN AND LOCK OUT EXISTING DISCONNECT SWITCH, REMOVE EXISTING O/S TROLLEY CIRCUIT BREAKERS.
8. DISCONNECT CONDUCTORS AND REMOVE EMERGENCY DC LINEUP.
9. INSTALL NEW SECTION OF DC SWITCHGEAR AND CONNECT IT TO RECTIFIER TRANSFORMER SET #2.
10. REMOVE EXISTING 112.5KVA, 13.2KV/120-208V AUXILIARY TRANSFORMER. INSTALL NEW 150KVA, 13.2KV/120-208V AUXILIARY TRANSFORMER ON THE FIRST FLOOR AND ENERGIZE IT FROM NEW SECTION OF 13.2KV SWITCHGEAR.
11. REMOVE EXISTING AND INSTALL NEW EMERGENCY SWITCH CABINET AND DC EMERGENCY CABINET.
12. REFER TO DRAWING TP201 FOR LEGENDS AND SYMBOLS AND DRAWING TP202 FOR DEVICE TABLES.
13. REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.

50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	DATE:
DATE REVISION:	DATE:
DATE CHECKED:	DATE:
DATE APPROVED:	DATE:
PROJECT NUMBER:	


HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REACTION POWER
STAGE 1 SINGLE LINE DIAGRAM

DATE:	SCALE:
08/22/2025	-
DRAWN BY: VL	CHECKED BY: VL
227	453
PROJECT NUMBER:	276482
TP211	
DATE:	SCALE:
17AN-TP211	

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

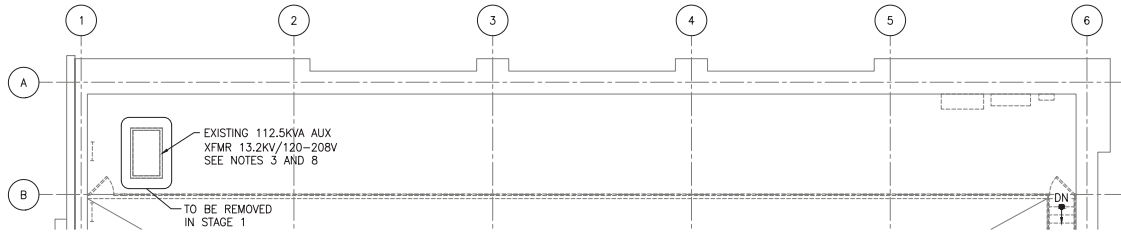


1 STAGE 1 MEZZANINE EQUIPMENT PLANS
 TP212 SCALE: 1" = 5'

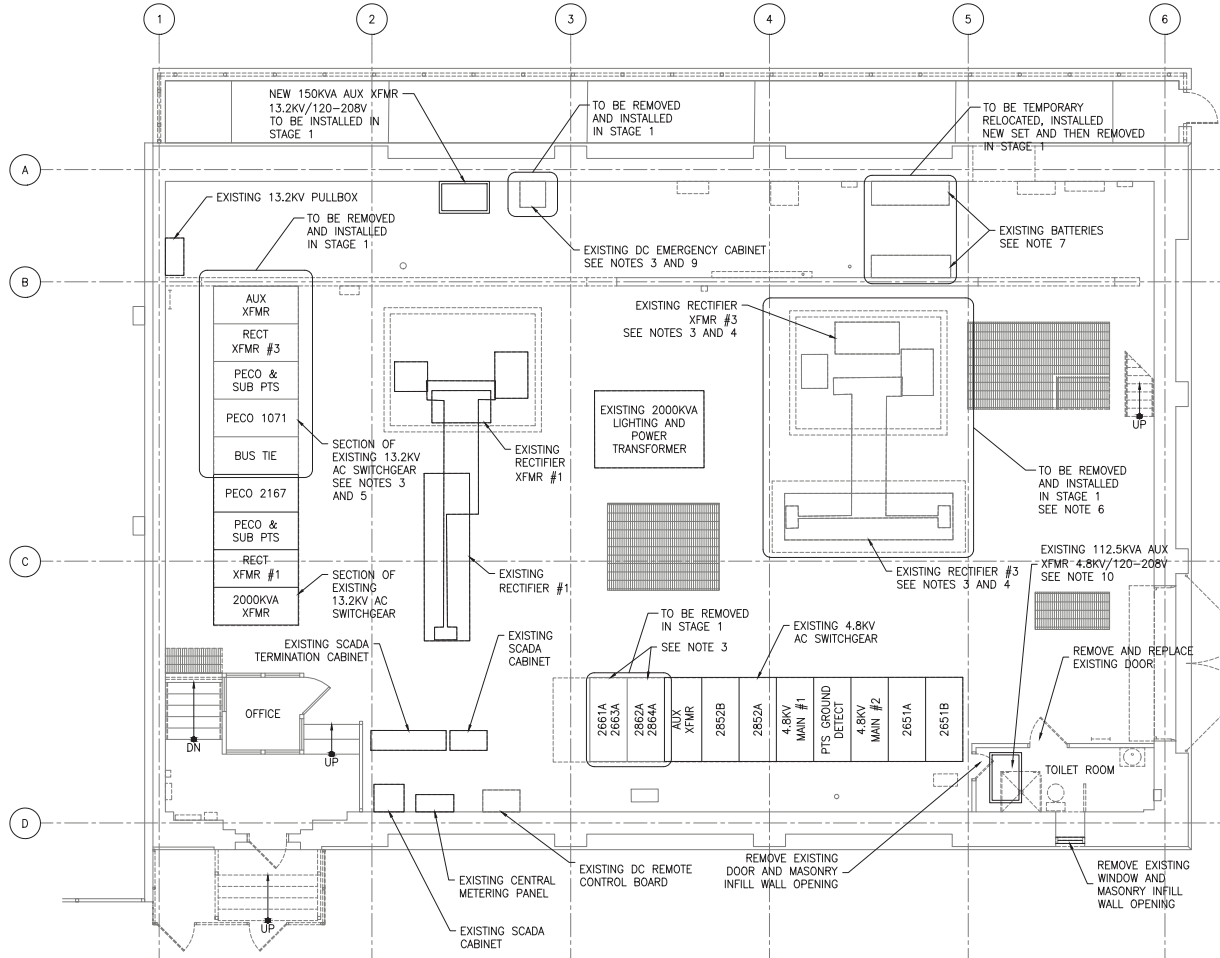

2 STAGE 1 FIRST FLOOR EQUIPMENT PLANS
 TP212 SCALE: 1" = 5'

NOTES:

- GRAYSCALE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 1.
- BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 1.
- REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
- REMOVE EXISTING RECTIFIER TRANSFORMER SET #3.
- REMOVE PECO INCOMING FEEDER 1071, SECTION OF EXISTING 13.2KV AC SWITCHGEAR. INSTALL NEW SECTION OF 13.2KV AC SWITCHGEAR AND RECONNECT PECO FEEDER 1071.
- INSTALL NEW RECTIFIER TRANSFORMER SET #2 AND CONNECT IT TO NEW SECTION OF 700V DC SWITCHGEAR IN BASEMENT AND NEW 13.2KV SWITCHGEAR.
- REPLACE EXISTING BATTERIES AND ASSOCIATED EQUIPMENT. FOR DETAILS SEE STAGE 1 ON DWG. TP210.
- REMOVE EXISTING 112.5KVA 13.2KV/120-208V AUXILIARY TRANSFORMER LOCATED ON MEZZANINE AND INSTALL NEW 150KVA 13.2KV/120-208V AUXILIARY TRANSFORMER ON THE FIRST FLOOR.
- REMOVE EXISTING DC EMERGENCY CABINET AND INSTALL NEW DC EMERGENCY CABINET.
- EXISTING 112.5KVA AUXILIARY TRANSFORMER IS LOCATED ABOVE TOILET ROOM.
- REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.
- REMOVE EXISTING INSULATED FLOOR COVERING. PROVIDE NEW INSULATED FLOOR COVERING CONFORMING TO THE SPECIFICATIONS.



50% SUBMISSION
 NOT FOR CONSTRUCTION



PROJECT NO.:	
DATE:	
BY:	
CHECKED BY:	
APPROVED BY:	
PROJECT MANAGER:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
TRACTION POWER
 STAGE 1 MEZZANINE & FIRST FLOOR EQUIP PLANS

DATE:	08/22/2025	SCALE FACTOR:	1
DRAWN BY:		CHECKED BY:	
PROJECT NO.:	276482		
TP212			
SHEET NO.:	11	OF	35
REV. NO.:	208	OF	453
PROJECT FILE NO.:	17AN-TP212		

C:\PWORKING\PTD\081521\17AN\TP212.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

PROJECT NUMBER:	
CLIENT:	
DATE:	
PROJECT LOCATION:	
PROJECT NAME:	
PROJECT NUMBER:	



 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 STAGE 1 BASEMENT EQUIPMENT PLAN

DATE:	AS SHOWN	SCALE FACTOR:	1
DATE:	08/22/2025	DRAWN BY:	MS
DATE:		CHECKED BY:	MS
PROJECT NUMBER:	276482		
TP213			
SHEET NO.:	12	OF	35
DATE:	209	OF	453
PROJECT NO.:			
DATE:			
PROJECT FILE NO.:	17AN-TP213		

- NOTES:**
- GRAYSACLE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 1.
 - BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 1.
 - INSTALL TEMPORARY PROTECTIVE BARRIERS AROUND EXISTING DC EQUIPMENT.
 - REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
 - INSTALL NEW NEGATIVE AND DRAINAGE SWITCHBOARD. TEMPORARILY CONNECT TRANSFORMER RECTIFIER SET #1 TO NEW NEGATIVE SWITCHBOARD. CONNECT EXISTING WESS EQUIPMENT TO NEW NEGATIVE SWITCHBOARD. REMOVE EXISTING NEGATIVE EQUALIZER BUS.
 - REMOVE EXISTING EMERGENCY SWITCH CABINET AND INSTALL NEW EMERGENCY SWITCH CABINET IN ANOTHER LOCATION (SEE TP216).
 - REMOVE EXISTING 8000A RECTIFIER #3 ISOLATION SWITCH.
 - INSTALL NEW SECTION OF 700V DC SWITCHGEAR. CONNECT NEW EMERGENCY SWITCH CABINET TO NEW DC SECTION. CONNECT NEW DC FEEDER BREAKERS 2707 AND 2703 TO TRACKS.
 - REMOVE EXISTING EMERGENCY DC LINEUP.
 - REMOVE EXISTING INSULATED FLOOR COVERING. PROVIDE NEW INSULATED FLOOR COVERING CONFORMING TO THE SPECIFICATIONS.
 - WESS EQUIPMENT INSTALLED MID-2017 TO REMAIN.
 - REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.

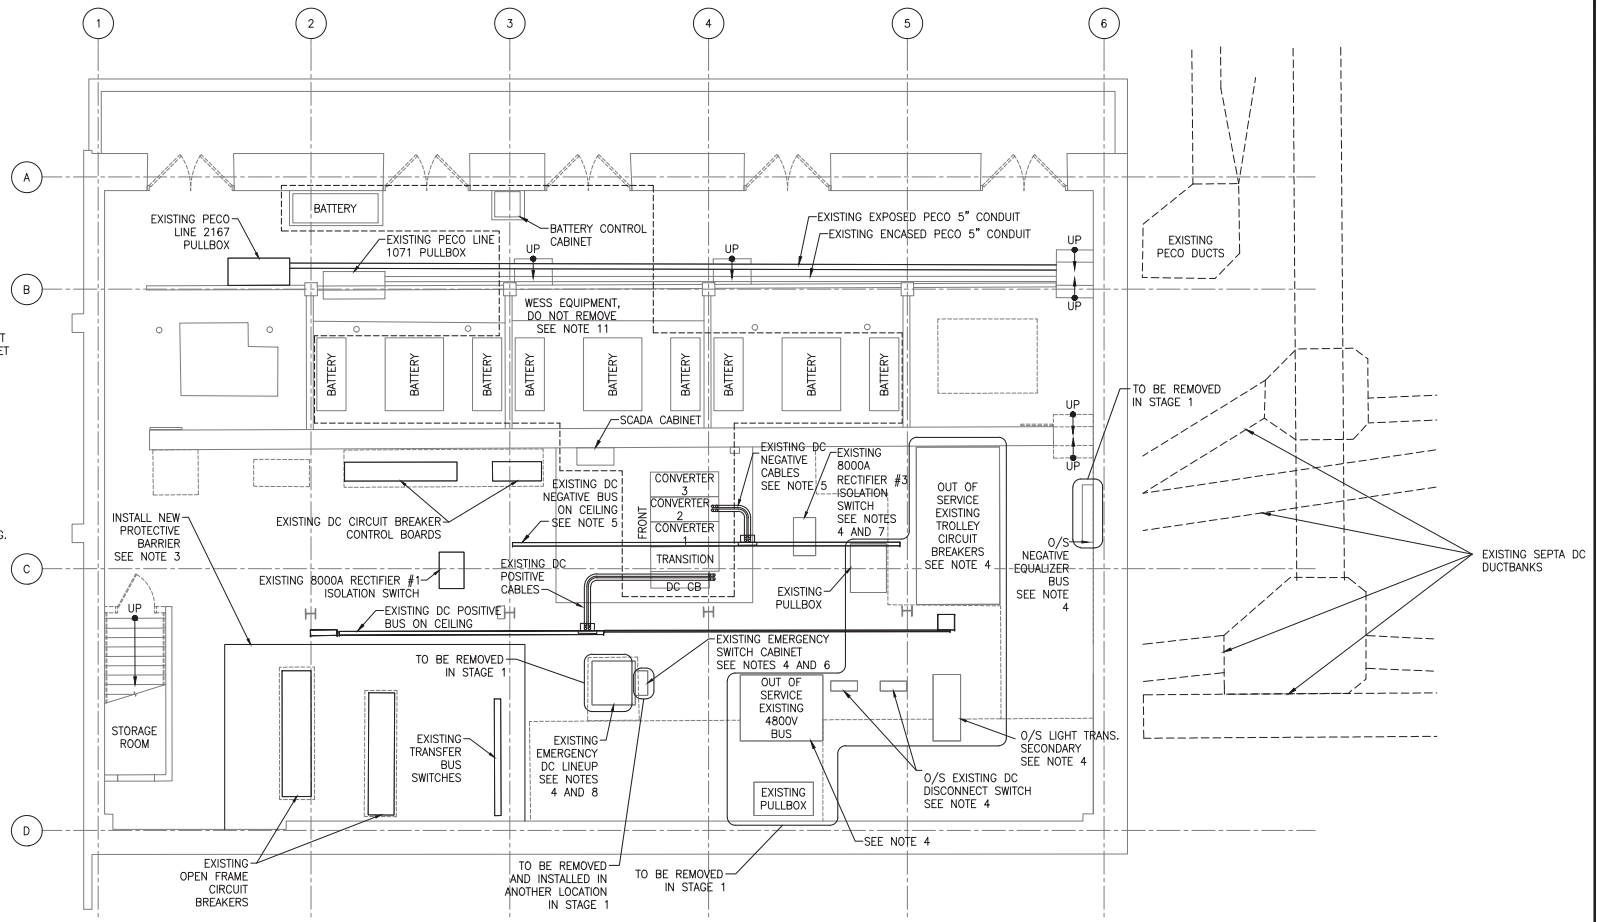

1
TP213
STAGE 1 BASEMENT EQUIPMENT PLAN
 SCALE: 1" = 5'




50% SUBMISSION
 NOT FOR CONSTRUCTION

C:\P\WORKING\PTTD\08152025\17AN-TP213.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

4.8KV AC SWITCHGEAR LINEUP

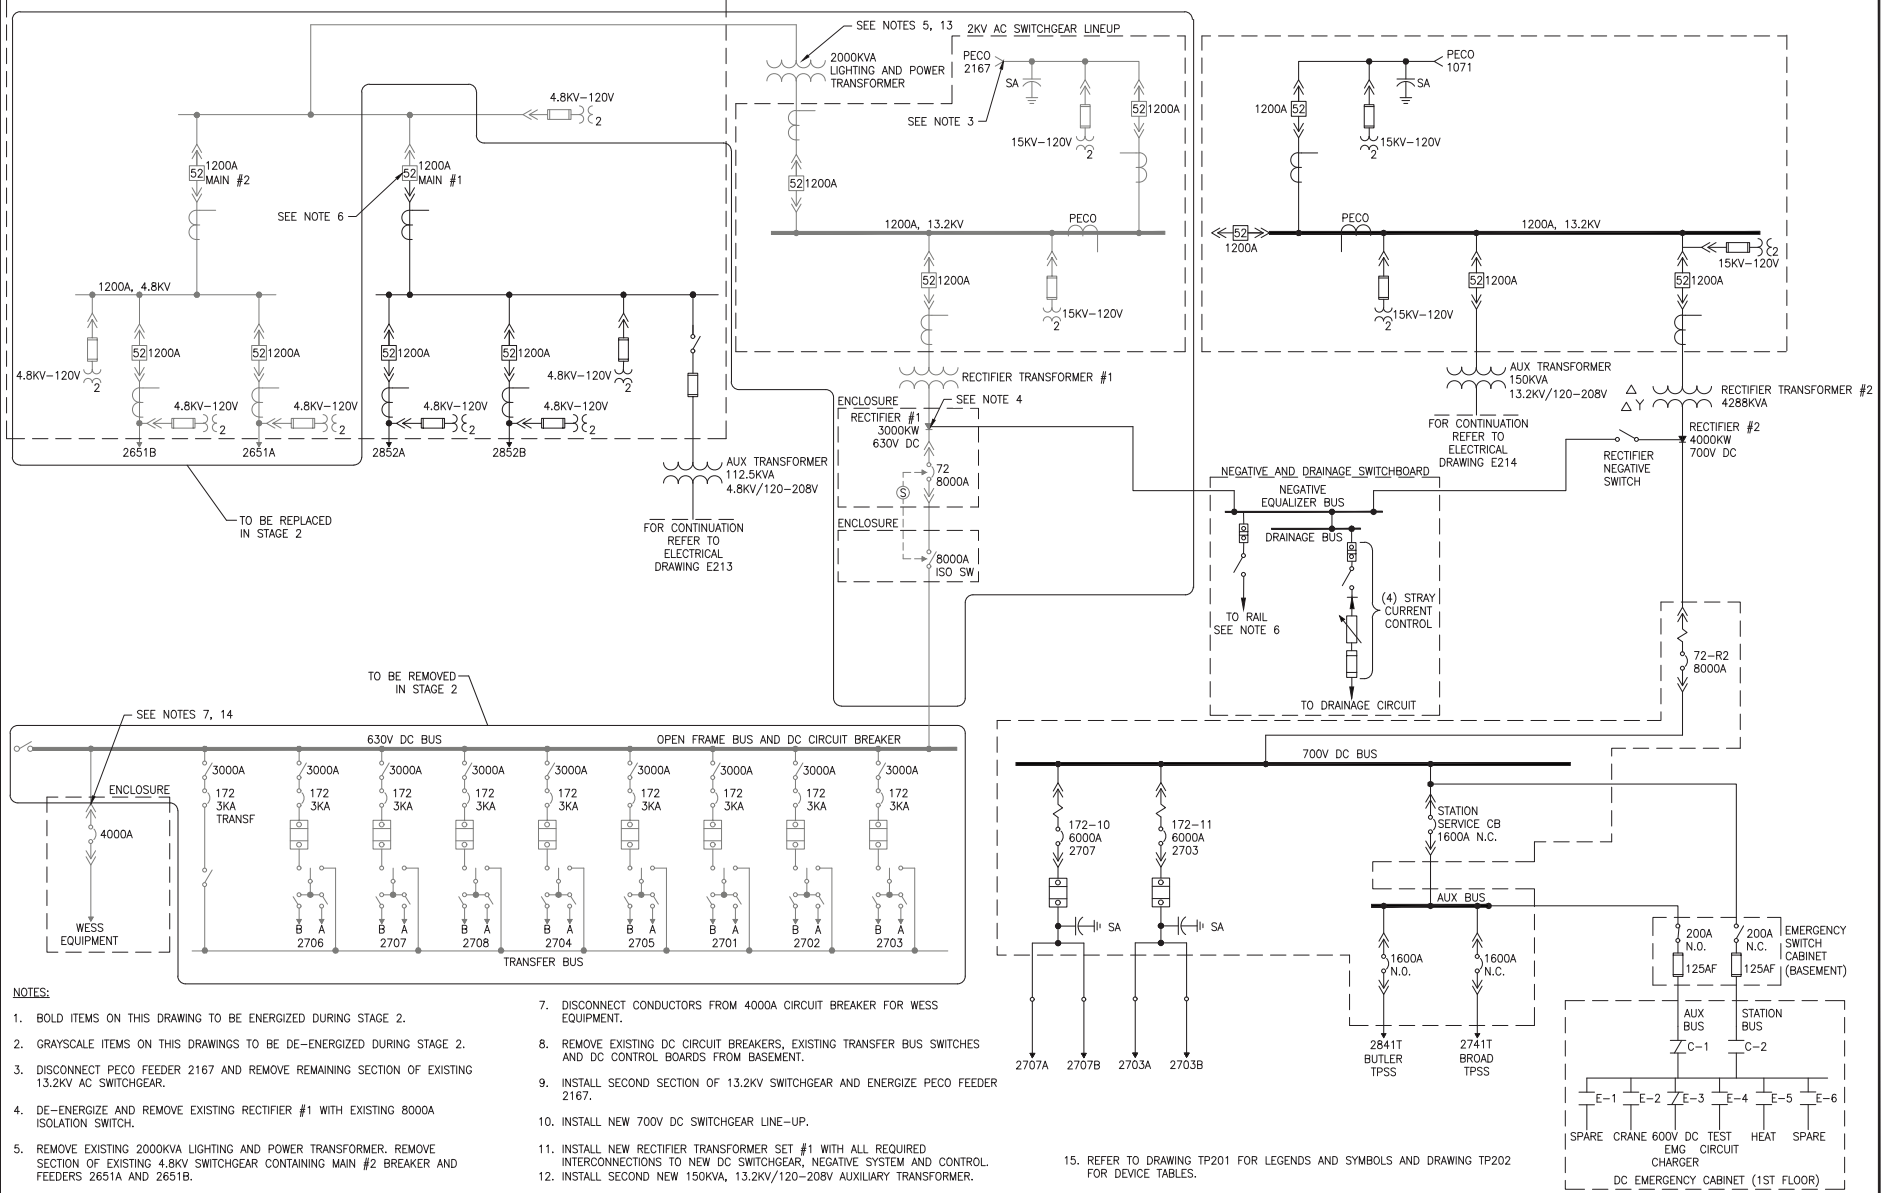

NOTES:

- BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 2.
- GRAYSCALE ITEMS ON THIS DRAWINGS TO BE DE-ENERGIZED DURING STAGE 2.
- DISCONNECT PECO FEEDER 2167 AND REMOVE REMAINING SECTION OF EXISTING 13.2KV AC SWITCHGEAR.
- DE-ENERGIZE AND REMOVE EXISTING RECTIFIER #1 WITH EXISTING 8000A ISOLATION SWITCH.
- REMOVE EXISTING 2000KVA LIGHTING AND POWER TRANSFORMER. REMOVE SECTION OF EXISTING 4.8KV SWITCHGEAR CONTAINING MAIN #2 BREAKER AND FEEDERS 2651A AND 2651B.
- OPEN EXISTING 4.8KV AC SWITCHGEAR MAIN #1 CIRCUIT BREAKER AND REMOVE CIRCUIT BREAKER FROM 4.8KV AC SWITCHGEAR CUBICLE. MAINTAIN SECTION OF THE 4.8KV SWITCHGEAR TO BACK FEED EXISTING 112.5KVA, 4.8KV/120-208V AUXILIARY TRANSFORMER.
- DISCONNECT CONDUCTORS FROM 4000A CIRCUIT BREAKER FOR WESS EQUIPMENT.
- REMOVE EXISTING DC CIRCUIT BREAKERS, EXISTING TRANSFER BUS SWITCHES AND DC CONTROL BOARDS FROM BASEMENT.
- INSTALL SECOND SECTION OF 13.2KV SWITCHGEAR AND ENERGIZE PECO FEEDER 2167.
- INSTALL NEW 700V DC SWITCHGEAR LINE-UP.
- INSTALL NEW RECTIFIER TRANSFORMER SET #1 WITH ALL REQUIRED INTERCONNECTIONS TO NEW DC SWITCHGEAR, NEGATIVE SYSTEM AND CONTROL.
- INSTALL NEW 2000KVA LIGHTING AND POWER TRANSFORMER AND NEW SECTION OF 4.8KV SWITCHGEAR INCLUDING MAIN #1, 2651A, AND 2651B BREAKERS.
- RECONNECT WESS EQUIPMENT TO NEW 700V DC SWITCHGEAR.
- REFER TO DRAWING TP201 FOR LEGENDS AND SYMBOLS AND DRAWING TP202 FOR DEVICE TABLES.
- REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.

50% SUBMISSION
NOT FOR CONSTRUCTION

SEPTA/SEPTEN PENNSYLVANIA TRANSPORTATION AUTHORITY
1200 MARKET ST., 18TH FL., PHILADELPHIA, PA 19107

DATE: 08/22/2025
DRAWN BY: TL
CHECKED BY: JL

TP214

SCALE: 1" = 100'

NO. OF SHEETS: 13 OF 35
SHEET NO.: 230 OF 453

PROJECT: 276482
SUBJECT: TP214


DATE PRINTED: 10/27/2025

**50% SUBMISSION
NOT FOR CONSTRUCTION**


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
REACTION POWER
 STAGE 2 SINGLE LINE DIAGRAM

C:\PWORKING\PTD\08152025\TP214.DWG

STATUS: 50% SUBMISSION

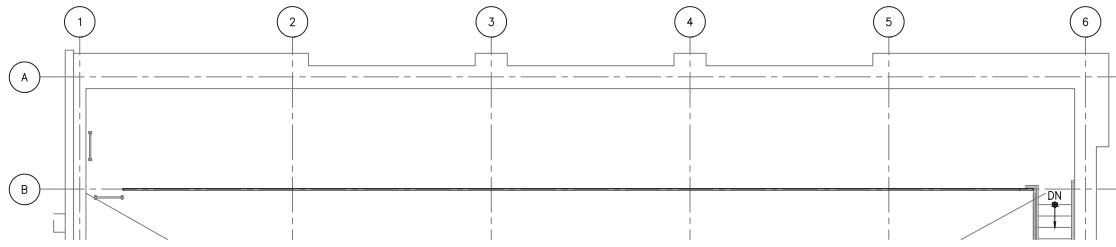


1 STAGE 2 MEZZANINE EQUIPMENT PLANS
TP215 SCALE: 1" = 5'

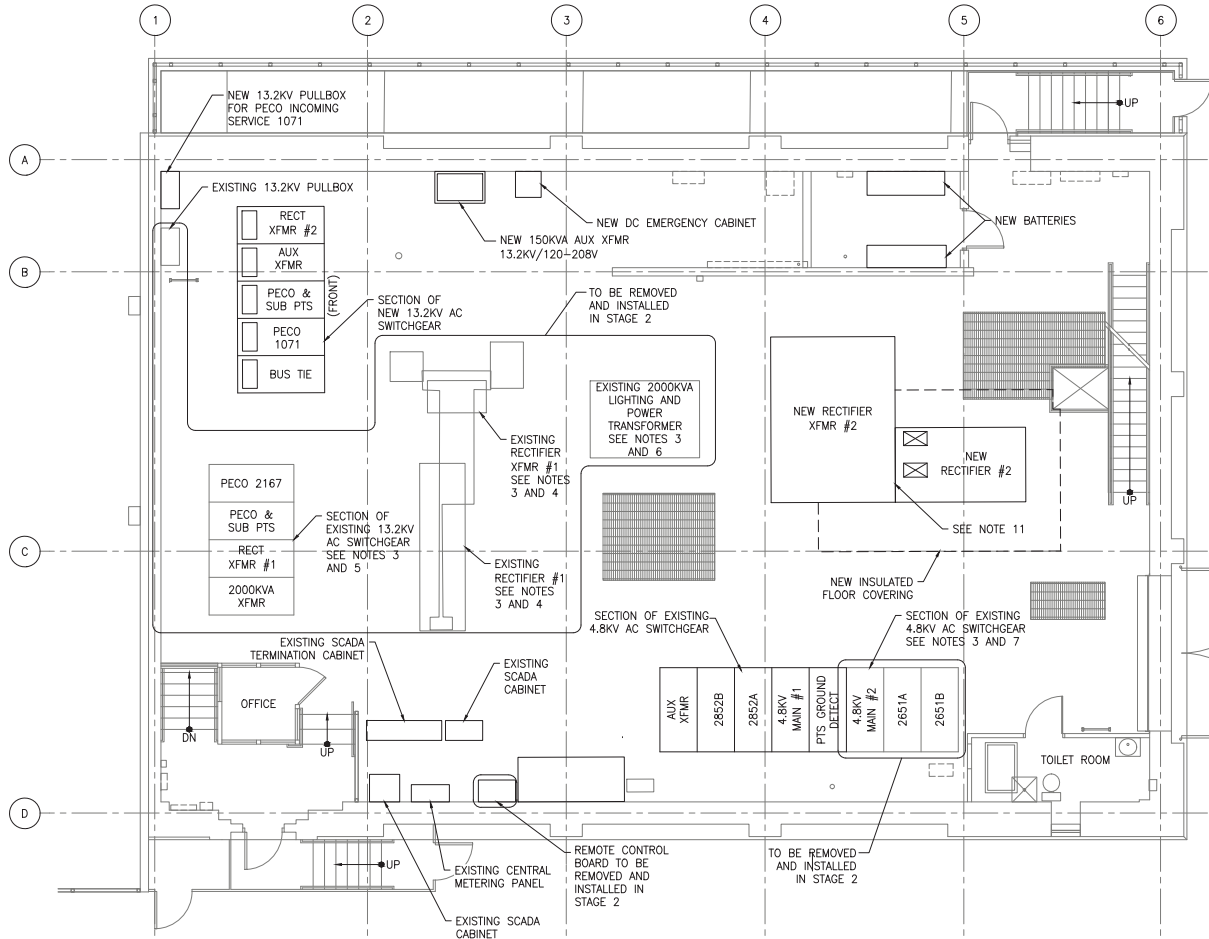

2 STAGE 2 FIRST FLOOR EQUIPMENT PLANS
TP215 SCALE: 1" = 5'

NOTES:

- GRAYSCALE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 2.
- BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 2.
- REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
- REMOVE EXISTING RECTIFIER TRANSFORMER SET #1. INSTALL NEW RECTIFIER TRANSFORMER SET #1 AND CONNECT TO NEW 700V DC SWITCHGEAR IN BASEMENT.
- DE-ENERGIZE PECO FEEDER 2167. REMOVE SECTION OF EXISTING 13.2KV AC SWITCHGEAR. INSTALL NEW SECTION OF 13.2KV AC SWITCHGEAR AND RECONNECT THE PECO FEEDER 2167.
- REMOVE EXISTING 2000KVA LIGHTING AND POWER TRANSFORMER AND INSTALL NEW 2000KVA LIGHTING AND POWER TRANSFORMER. FOR NEW TRANSFORMER LOCATION SEE DWG. TP220.
- REMOVE SECTION OF EXISTING 4.8KV AC SWITCHGEAR. INSTALL NEW SECTION OF 4.8KV AC SWITCHGEAR.
- INSTALL SECOND 150KVA, 13.2KV/120-208V AUXILIARY TRANSFORMER ON THE FIRST FLOOR. FOR NEW LOCATION SEE DWG. TP220.
- REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.
- REMOVE EXISTING INSULATED FLOOR COVERING. PROVIDE NEW INSULATED FLOOR COVERING CONFORMING TO THE SPECIFICATIONS.
- THE CONTRACTOR TO PROVIDE AN INSULATING BARRIER BETWEEN THE NEW RECTIFIER AND THE NEW RECTIFIER TRANSFORMER.




50% SUBMISSION
NOT FOR CONSTRUCTION

REV	DATE	DESCRIPTION	BY	CHKD	APPD


C:\P\WORKING\PTD\18152\17AN-TP215.DWG

STATUS: 50% SUBMISSION

C:\P\WORKING\PT110\181542\17AN\TP216.GEN

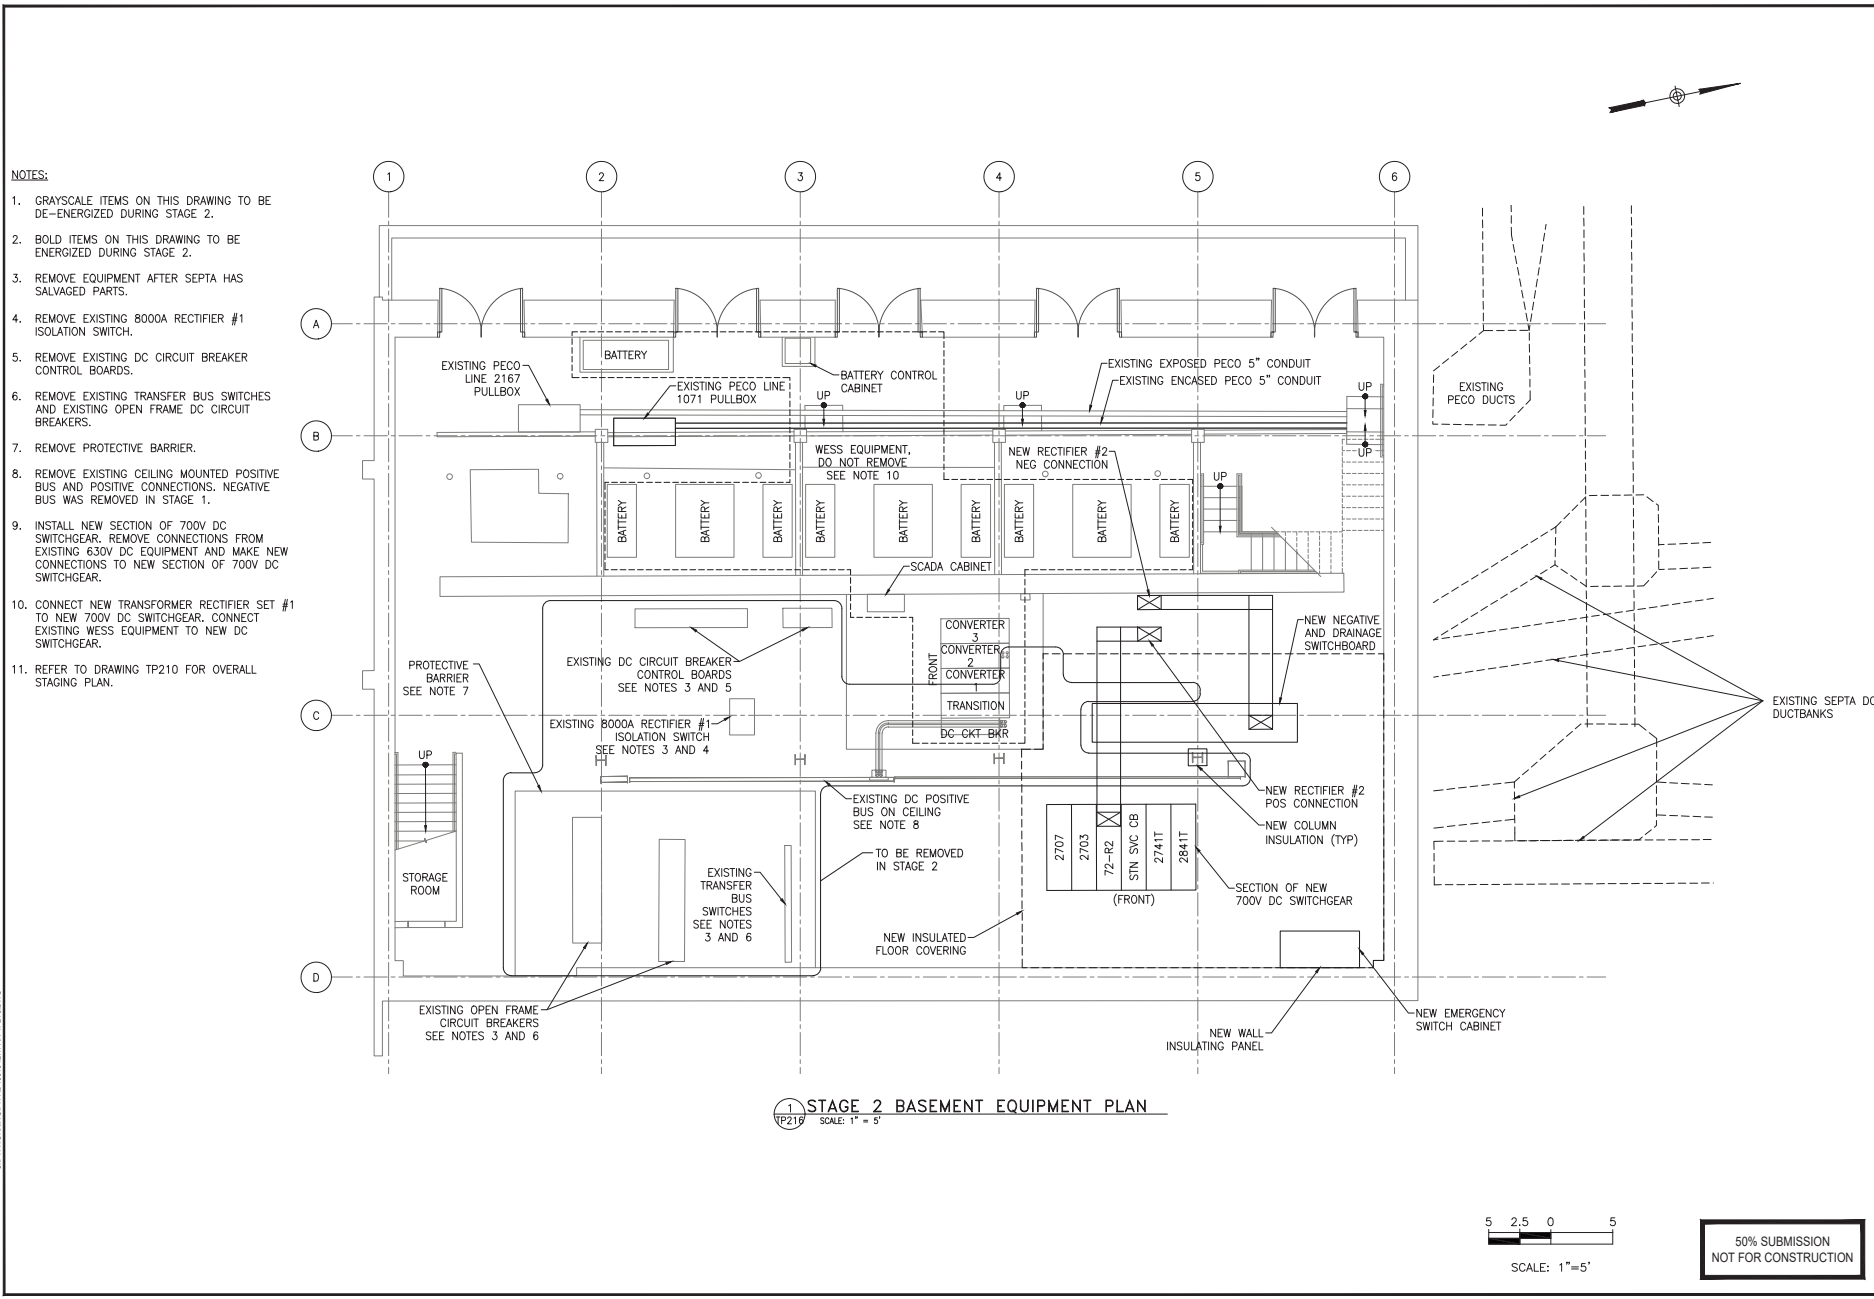


1 STAGE 2 BASEMENT EQUIPMENT PLAN
 (TP216) SCALE: 1" = 5'



50% SUBMISSION
 NOT FOR CONSTRUCTION

- NOTES:**
1. GRAYSCALE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 2.
 2. BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 2.
 3. REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
 4. REMOVE EXISTING 8000A RECTIFIER #1 ISOLATION SWITCH.
 5. REMOVE EXISTING DC CIRCUIT BREAKER CONTROL BOARDS.
 6. REMOVE EXISTING TRANSFER BUS SWITCHES AND EXISTING OPEN FRAME DC CIRCUIT BREAKERS.
 7. REMOVE PROTECTIVE BARRIER.
 8. REMOVE EXISTING CEILING MOUNTED POSITIVE BUS AND POSITIVE CONNECTIONS. NEGATIVE BUS WAS REMOVED IN STAGE 1.
 9. INSTALL NEW SECTION OF 700V DC SWITCHGEAR. REMOVE CONNECTIONS FROM EXISTING 630V DC EQUIPMENT AND MAKE NEW CONNECTIONS TO NEW SECTION OF 700V DC SWITCHGEAR.
 10. CONNECT NEW TRANSFORMER RECTIFIER SET #1 TO NEW 700V DC SWITCHGEAR. CONNECT EXISTING WESS EQUIPMENT TO NEW DC SWITCHGEAR.
 11. REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.



HDR
 HDR Engineering, Inc.
 Philadelphia, PA



PROJECT NUMBER: PROJECT TITLE: CLIENT: DATE:	BY: (C) (D) (E) (F) (G) (H) (I) (J) (K) (L) (M) (N) (O) (P) (Q) (R) (S) (T) (U) (V) (W) (X) (Y) (Z) CHECKED BY: DATE:
---	---

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 STAGE 2 BASEMENT EQUIPMENT PLAN

DATE: AS SHOWN	SCALE FACTOR: -
DATE: 08/22/2025	DRAWN BY: TL
WORK ORDER NO: 276482	CHECKED BY: JL
TP216	
DATE: 15 OF 35	DATE: 15 OF 35
DATE: 232 OF 453	DATE: 232 OF 453
DATE: 17AN-TP216	DATE: 17AN-TP216

DATE PRINTED: 10/27/2025
 STATUS: 50% SUBMISSION


SECTION OF NEW 4.8KV AC SWITCHGEAR LINEUP

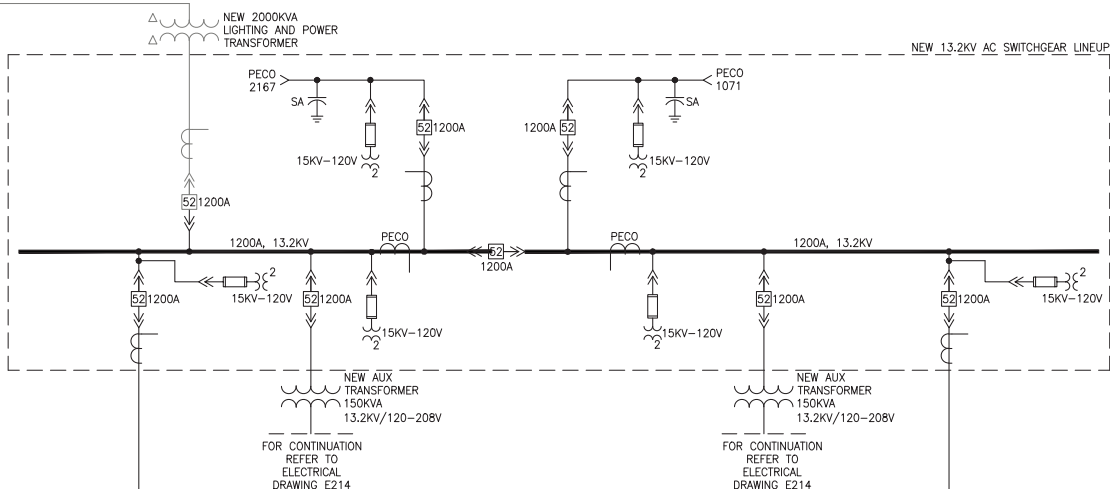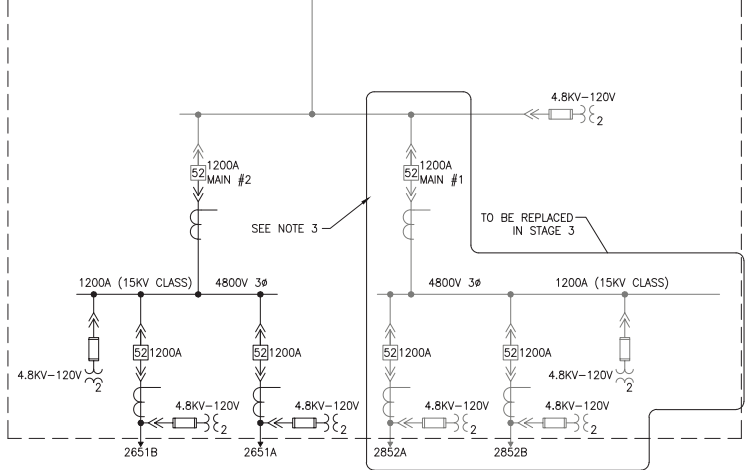

NOTES:

1. BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 3.
2. GRAYSCALE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 2.
3. REMOVE EXISTING AND INSTALL NEW REMAINING SECTION OF 4.8KV AC SWITCHGEAR INCLUDING MAIN #1 CIRCUIT BREAKER AND FEEDERS 2852A AND 2852B.
4. REMOVE EXISTING 112.5KVA 4.8KV/120-208 AUXILIARY TRANSFORMER ABOVE THE TOILET ROOM.
5. REFER TO DRAWING TP201 FOR LEGENDS AND SYMBOLS AND DRAWING TP202 FOR DEVICE TABLES.
6. REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.
7. THE TRIP SETTINGS OF WESS DC CIRCUIT BREAKER TO BE COORDINATED. PLACE EXISTING WESS EQUIPMENT BACK INTO SERVICE.

NEW 700V DC SWITCHGEAR LINEUP

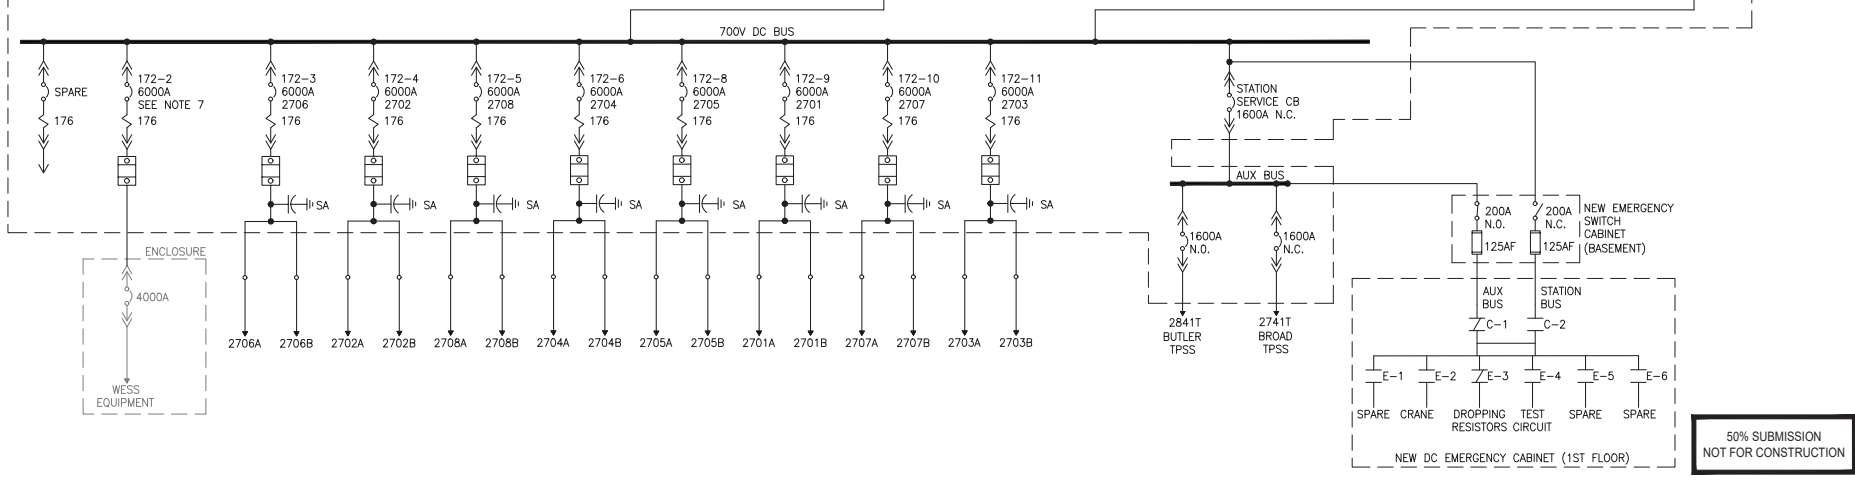

50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	DATE:
DATE ENGINEERING CHECKED:	DATE:
DATE FIELD CHECKED:	DATE:
DESIGNER:	DATE:
DRAWN BY:	DATE:
CHECKED BY:	DATE:
PROJECT NUMBER:	DATE:

HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
STAGE 3 SINGLE LINE DIAGRAM

DATE:	SCALE:
08/22/2025	1" = 10'
DRAWN BY: TL	CHECKED BY: JL
276482	
TP217	
SHEET NO. 16 OF 35	
REV. NO. 233 OF 453	
COMPUTER FILE NO. 17AN-TP217	REV. DATE

C:\P\WORKING\PTD\081624\17AN\TP217.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

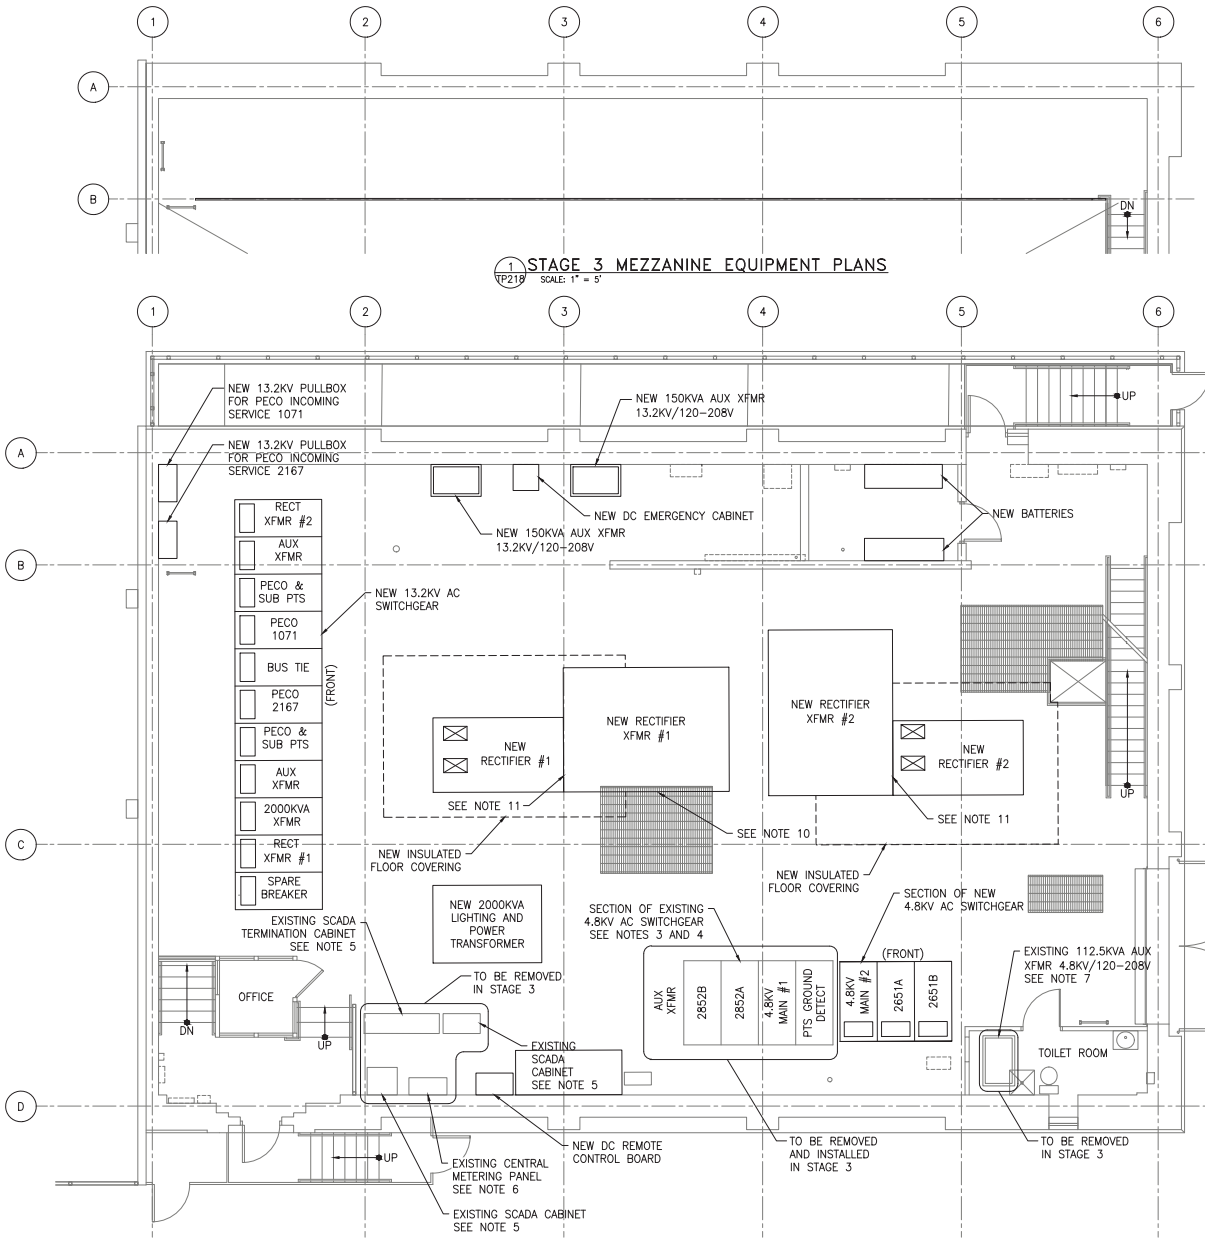


1
TP219
STAGE 3 MEZZANINE EQUIPMENT PLANS
 SCALE: 1" = 5'

2
TP218
STAGE 3 FIRST FLOOR EQUIPMENT PLANS
 SCALE: 1" = 5'

NOTES:

1. GRAYSACLE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 3.
2. BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 3.
3. REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
4. REMOVE SECTION OF EXISTING 4.8KV AC SWITCHGEAR. INSTALL NEW SECTION OF 4.8KV AC SWITCHGEAR.
5. REMOVE EXISTING SCADA AND SCADA TERMINATION CABINETS.
6. REMOVE EXISTING CENTRAL METERING PANEL.
7. REMOVE EXISTING 112.5KVA 4.8KV/120-208V AUXILIARY TRANSFORMER LOCATED ABOVE TOILET ROOM.
8. INSTALL NEW RTU/HMI CABINET.
9. REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.
10. THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GRATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.
11. THE CONTRACTOR TO PROVIDE AN INSULATING BARRIER BETWEEN THE NEW RECTIFIER AND NEW RECTIFIER TRANSFORMER.



50% SUBMISSION
 NOT FOR CONSTRUCTION



SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY
EMC DIVISION
 1228 MARKET ST., 18TH FL.
 PHILADELPHIA, PA 19107

DEPT. PROJECT NO.:
 DEPT. ENGINEERING OFFICE NO.:
 DEPT. RAIL TRAFFIC OFFICE:
 CONTRACT NO.:
 SECTION OF ENGINEERING NO.:
 DRAWING NO. (REV. NUMBER):
 PROJECT MANAGER:

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
TRACTION POWER
 STAGE 3 MEZZ & FIRST FLOOR EQUIPMENT PLANS


DATE: AS SHOWN SCALE FACTOR: 1
 DATE: 08/22/2025 DRAWN BY: JL
 CHECKED BY: JL
 WORK ORDER NO.: 276482
TP218
 SHEET NO.: 17 OF 35
 SHEET NO.: 234 OF 453
 PROJECT FILE NO.: 17AN-TP218

C:\PWORKING\PTD\081521\17AN\TP218.DWG


DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\PTTD\08152017\TP219.DWG

- NOTES:**
1. GRAYSCALE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 3.
 2. BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 3.
 3. REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
 4. DOTTED LINES DEMARCAT WEISS EQUIPMENT.
 5. REFER TO DRAWING TP210 FOR OVERALL STAGING PLAN.

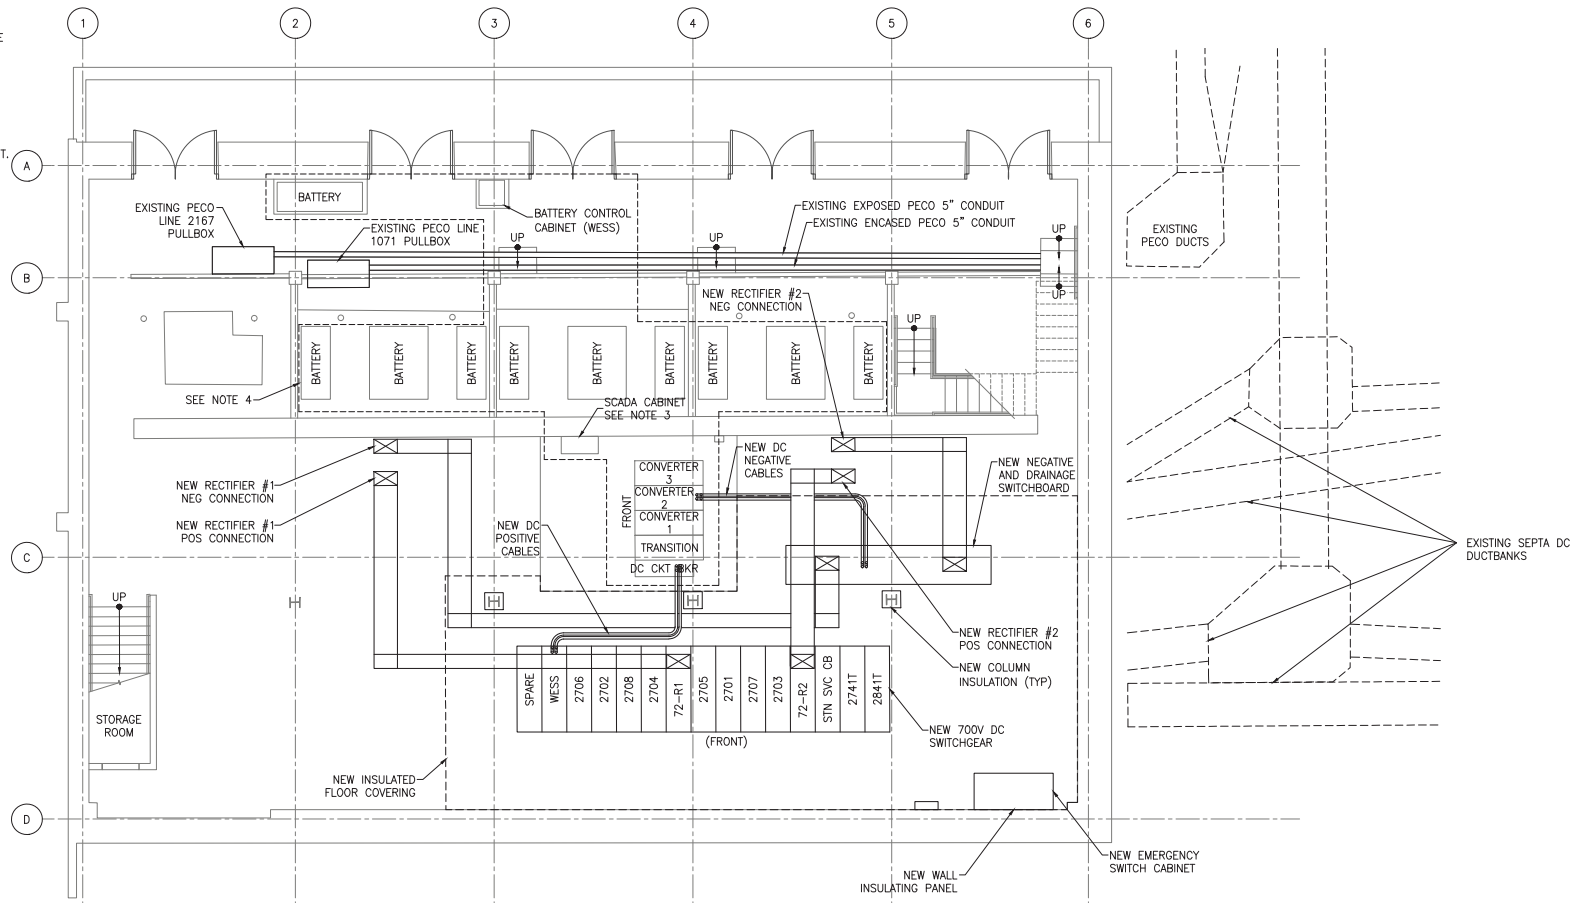

1 STAGE 3 BASEMENT EQUIPMENT PLAN
 TP219 SCALE: 1" = 4'



50% SUBMISSION
 NOT FOR CONSTRUCTION



PROJECT NUMBER:	
DATE:	
PROJECT NAME:	
PROJECT LOCATION:	
PROJECT OWNER:	
PROJECT MANAGER:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA


REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 STAGE 3 BASEMENT EQUIPMENT PLAN


SCALE:	AS SHOWN	SCALE FACTOR:	1
DATE:	08/22/2025	DRAWN BY:	TL
PROJECT NUMBER:	276482	CHECKED BY:	
TP219			
SHEET NO.:	18	OF:	35
DATE:	235	OF:	453
PROJECT FILE NO.:	17AN-TP219	REV. NO.:	

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\P\WORK\GPTT\081521\17AN-TP220.DWG

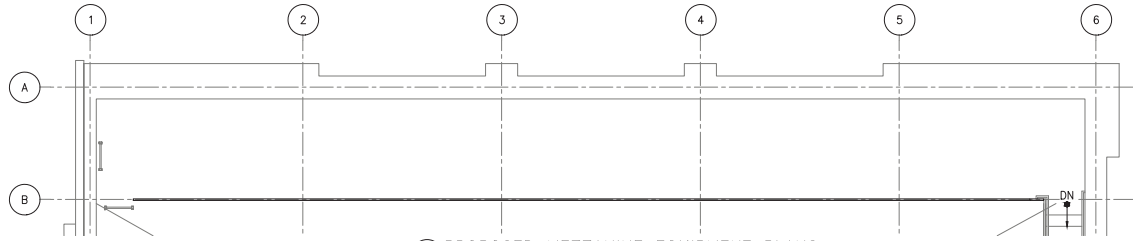


1
TP220
PROPOSED MEZZANINE EQUIPMENT PLANS
SCALE: 1" = 5'

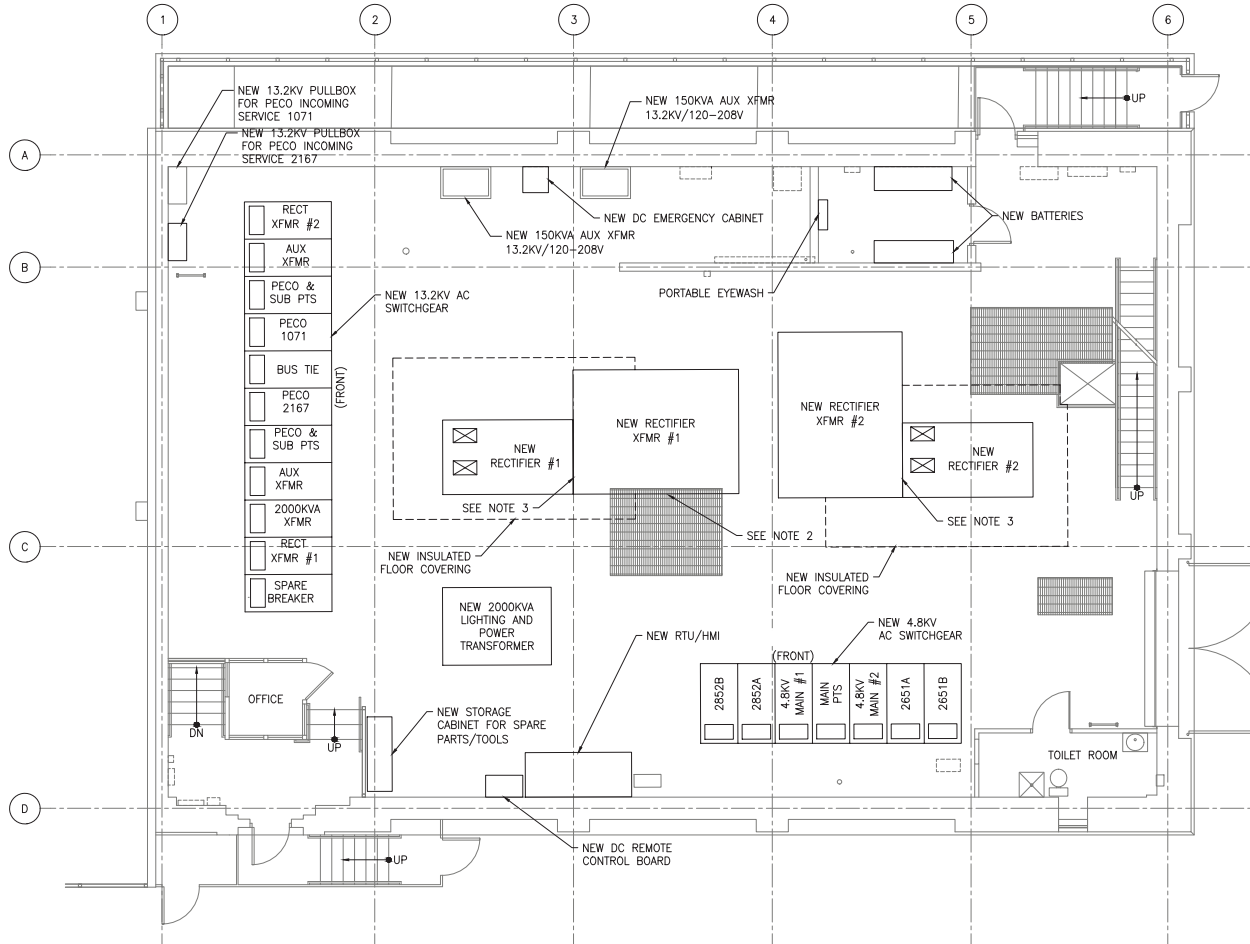

2
TP220
PROPOSED FIRST FLOOR EQUIPMENT PLANS
SCALE: 1" = 5'

NOTES:

1. THIS DRAWING REFLECTS THE FINAL CONFIGURATION OF TPSS EQUIPMENT BASED UPON THE CONSTRUCTION STAGING. REFER TO DRAWING TP210 FOR STAGING NOTES.
2. THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GRATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.
3. THE CONTRACTOR TO PROVIDE AN INSULATING BARRIER BETWEEN THE NEW RECTIFIER AND THE NEW RECTIFIER TRANSFORMER.



50% SUBMISSION
NOT FOR CONSTRUCTION



PREP: []
 CHECKED: []
 DESIGNED: []
 DRAWN: []
 PROJECT: []

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 FINAL MEZZ & FIRST FLOOR EQUIPMENT PLANS


TITLE: AS SHOWN
 DATE: 08/22/2025
 DRAWN BY: TL
 CHECKED BY: []
 WORK ORDER NO.: 276482
TP220
 SHEET NO.: 19 OF 35
 SHEET NO.: 236 OF 453
 COMPANY FILE NO.: 17AN-TP220

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION


C:\P\WORKING\PTTD\08152017\TP221.DWG

NOTES:

- THIS DRAWING REFLECTS THE FINAL CONFIGURATION OF TPSS EQUIPMENT BASED UPON THE CONSTRUCTION STAGING. REFER TO DRAWING TP210 FOR STAGING NOTES.
- WESS EQUIPMENT INSTALLED MID-2017 TO REMAIN.

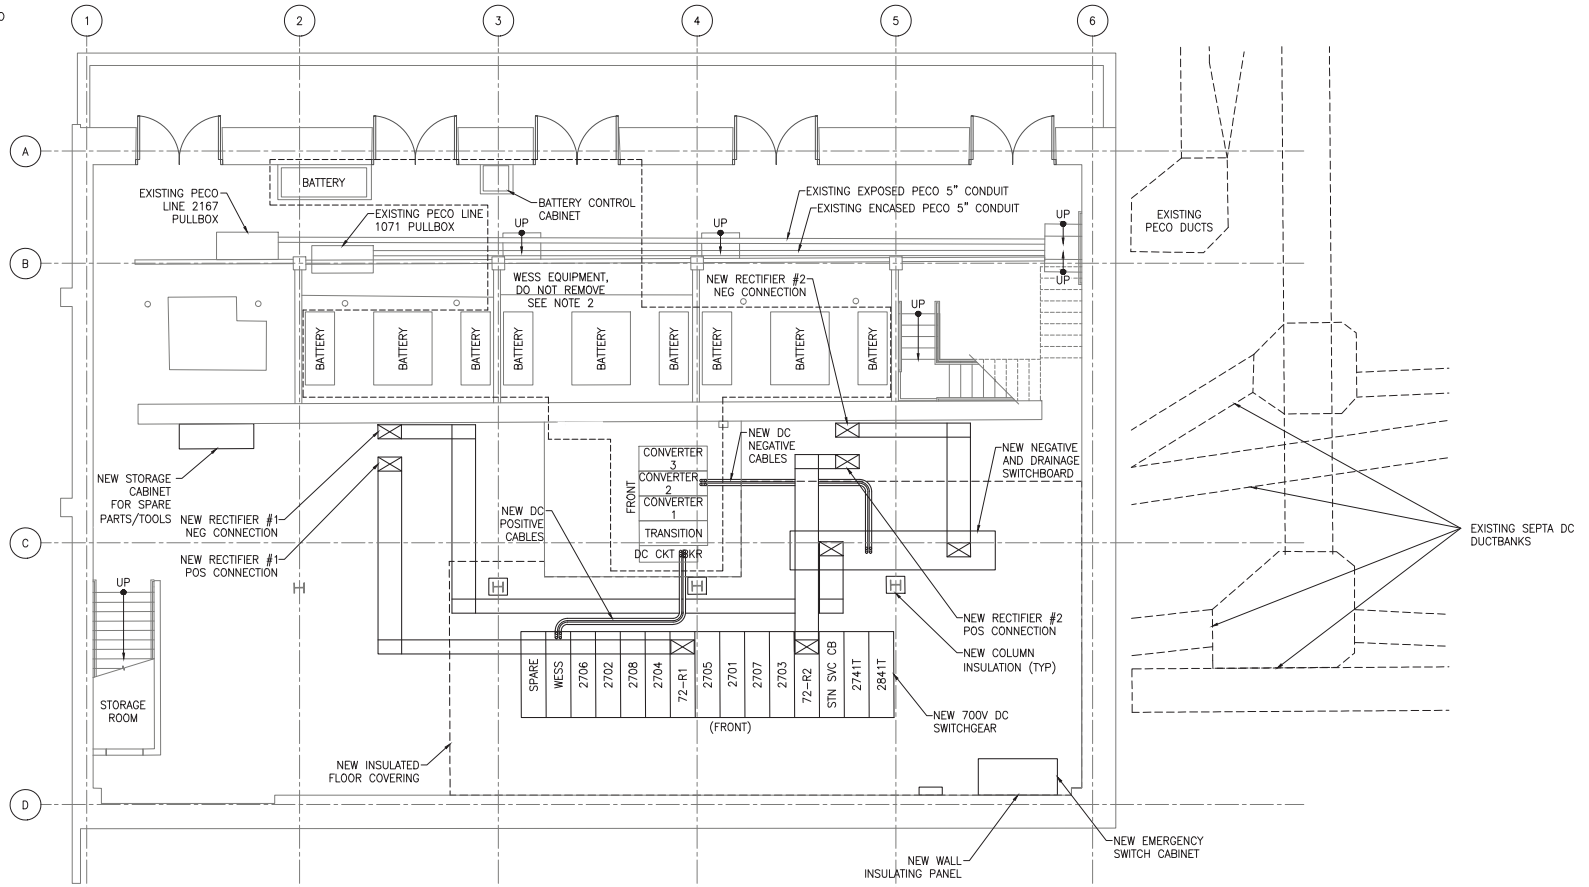

1 PROPOSED BASEMENT EQUIPMENT PLAN
 TP221 SCALE: 1" = 5'



50% SUBMISSION
 NOT FOR CONSTRUCTION



SEPTA
 SOUTH EASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY
 EMC 019090
 1330 MARKET ST., 15TH FL.
 PHILADELPHIA, PA 19107

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 PROPOSED BASEMENT EQUIPMENT PLAN

DATE:	AS SHOWN	SCALE FACTOR:	1
DATE:	08/22/2025	DRAWN BY:	MS
DATE:		CHECKED BY:	MS
WORK ORDER NO.:	276482		
SHEET NUMBER:	TP221		
DWG. NO.:	20	OF	35
PT. NO.:	237	OF	453
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-TP221	REV. NO.:	1

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\PTT\10815421\17AN-TP227.DWG



300 PENNSYLVANIA
 TRANSPORTATION
 AUTHORITY
 DMC DIVISION
 1325 MARKET ST., 15TH FL.
 PHILADELPHIA, PA 19107




HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 PROPOSED BASEMENT EQUIPMENT ELEVATIONS

DATE	NTS	SCALE FACTOR	+
DATE	08/22/2025	DRAWN BY	TL
DATE		CHECKED BY	TL
WORK ORDER NO.	276482		
SHEET NUMBER	TP227		
DWG. NO.	22	OF	35
PT. NO.	239	OF	453
PROJECT FILE NO.	17AN-TP227		

50% SUBMISSION
 NOT FOR CONSTRUCTION

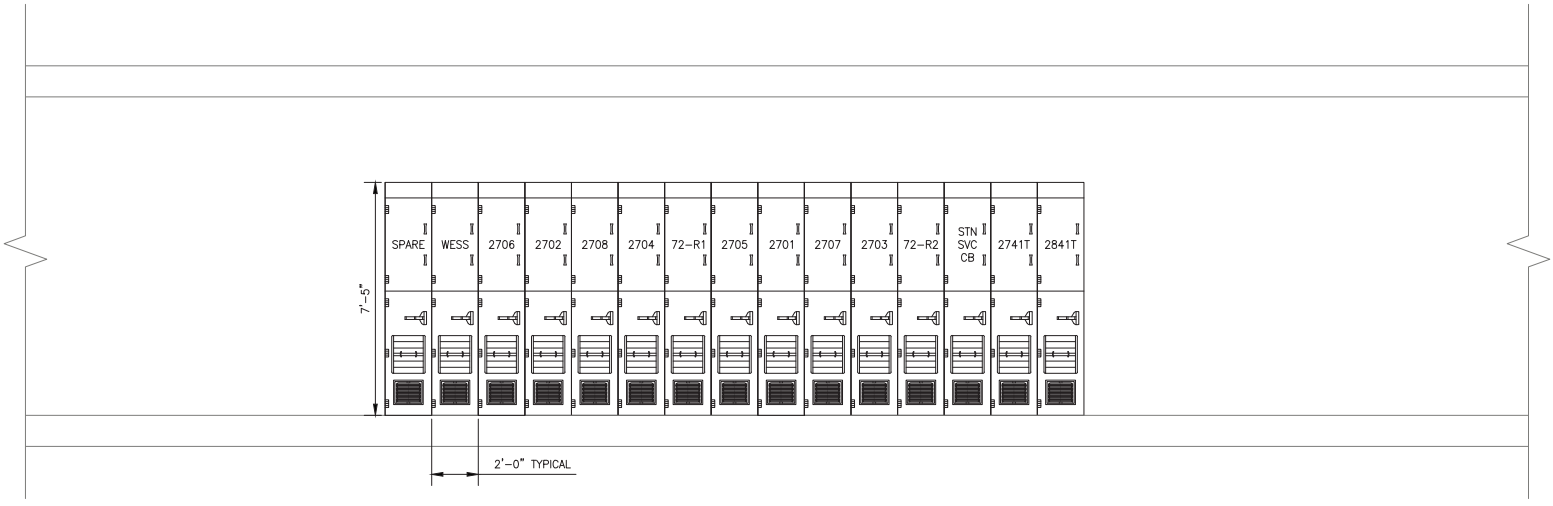

1 700V DC SWITCHGEAR FRONT ELEVATION
 TP227 SCALE: N.T.S.

- NOTES:
- REFER TO DRAWING TP221 FOR FINAL BASEMENT EQUIPMENT LAYOUT PLAN.

STATUS: 50% SUBMISSION

C:\P\WORKING\PTD\08152\17AN\TP232.DWG



DRP PROJECT NO.:	
DRP ENGINEERING OFFICE NO.:	
DRP RAIL TRANSIT OFFICE:	
CONSULTANT:	
DIRECTOR OF ENGINEERING NO.:	
MANAGER - RAIL OPERATIONS:	
PROJECT MANAGER:	



HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 13.2 KV CABLE & CONDUIT DUCT BANK

SCALE:	SCALE FACTOR:
AS SHOWN	1
DATE:	DRAWN BY:
08/22/2025	
CHECKED BY:	
WORK ORDER NO.:	276482
SHEET NUMBER:	TP232
DWG. NO.:	23 OF 35
INT. NO.:	240 OF 453
REVISED:	
COMPUTER FILE NO.:	17AN-TP232
REV. NO.:	

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

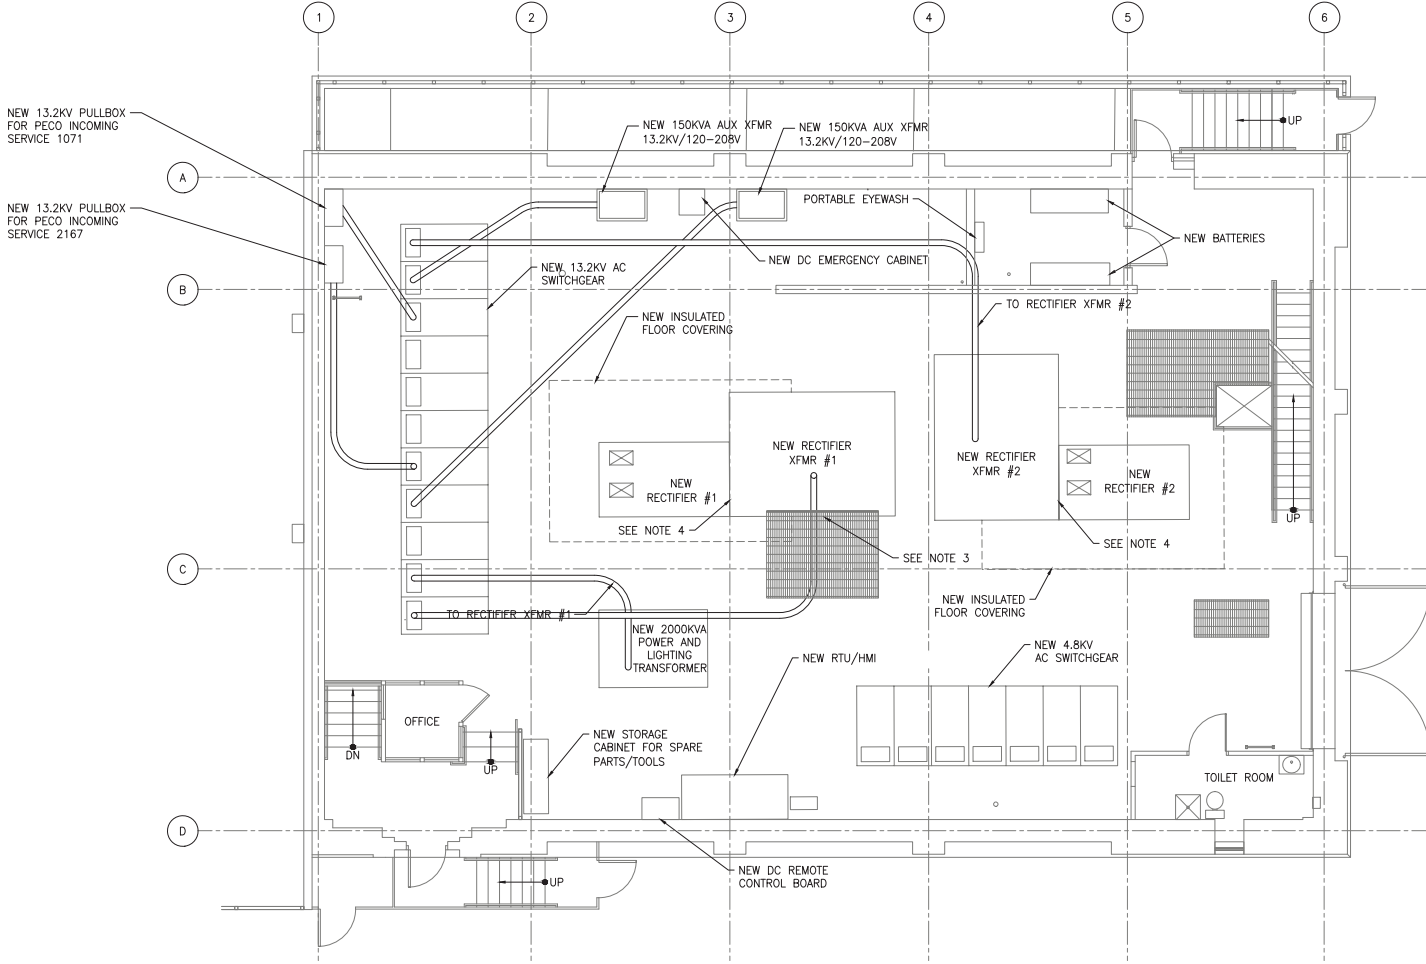


- NOTES:**
- EXACT LOCATION, SUPPORT AND SPACING OF CONDUITS TO BE DETERMINED BY FIELD CONDITIONS.
 - REFER TO DRAWING TP220 AND DRAWING TP221 FOR FINAL EQUIPMENT LAYOUT PLANS.
 - THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.
 - THE CONTRACTOR TO PROVIDE AN INSULATING BARRIER BETWEEN THE NEW RECTIFIER AND THE NEW RECTIFIER TRANSFORMER.




50% SUBMISSION
 NOT FOR CONSTRUCTION

C:\P\WORKING\PTTD\081521\17AN-TP233.DWG

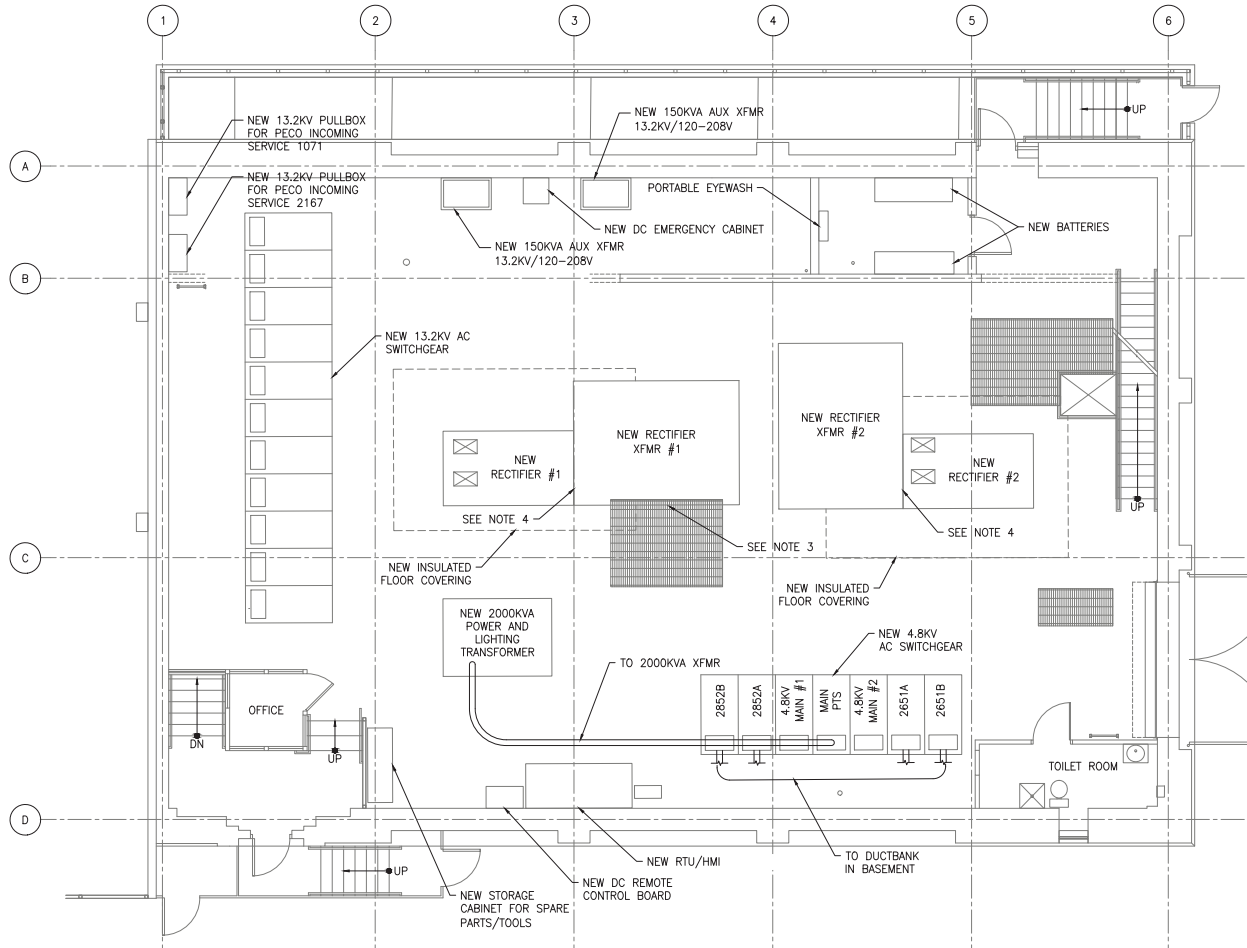

NOTES:

1. EXACT LOCATION, SUPPORT AND SPACING OF CONDUITS TO BE DETERMINED BY FIELD CONDITIONS.
2. REFER TO DRAWING TP220 AND DRAWING TP221 FOR FINAL EQUIPMENT LAYOUT PLANS.
3. THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.
4. THE CONTRACTOR TO PROVIDE AN INSULATING BARRIER BETWEEN THE NEW RECTIFIER AND THE NEW RECTIFIER TRANSFORMER.



50% SUBMISSION
NOT FOR CONSTRUCTION



1224 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107


HDR
HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION POWER
4.8 KV CABLE & DUCT BANK

SCALE FACTOR: -
AS SHOWN
DATE: 08/22/2025
DRAWN BY: SB
CHECKED BY: JL
WORK ORDER NO: 276482
SHEET NUMBER: **TP233**
SHEET NO: 24 OF 35
SHEET NO: 241 OF 453
REVISION NO:
COMPUTER FILE NO: 17AN-TP233

DATE PRINTED: 10/21/2025
STATUS: 50% SUBMISSION

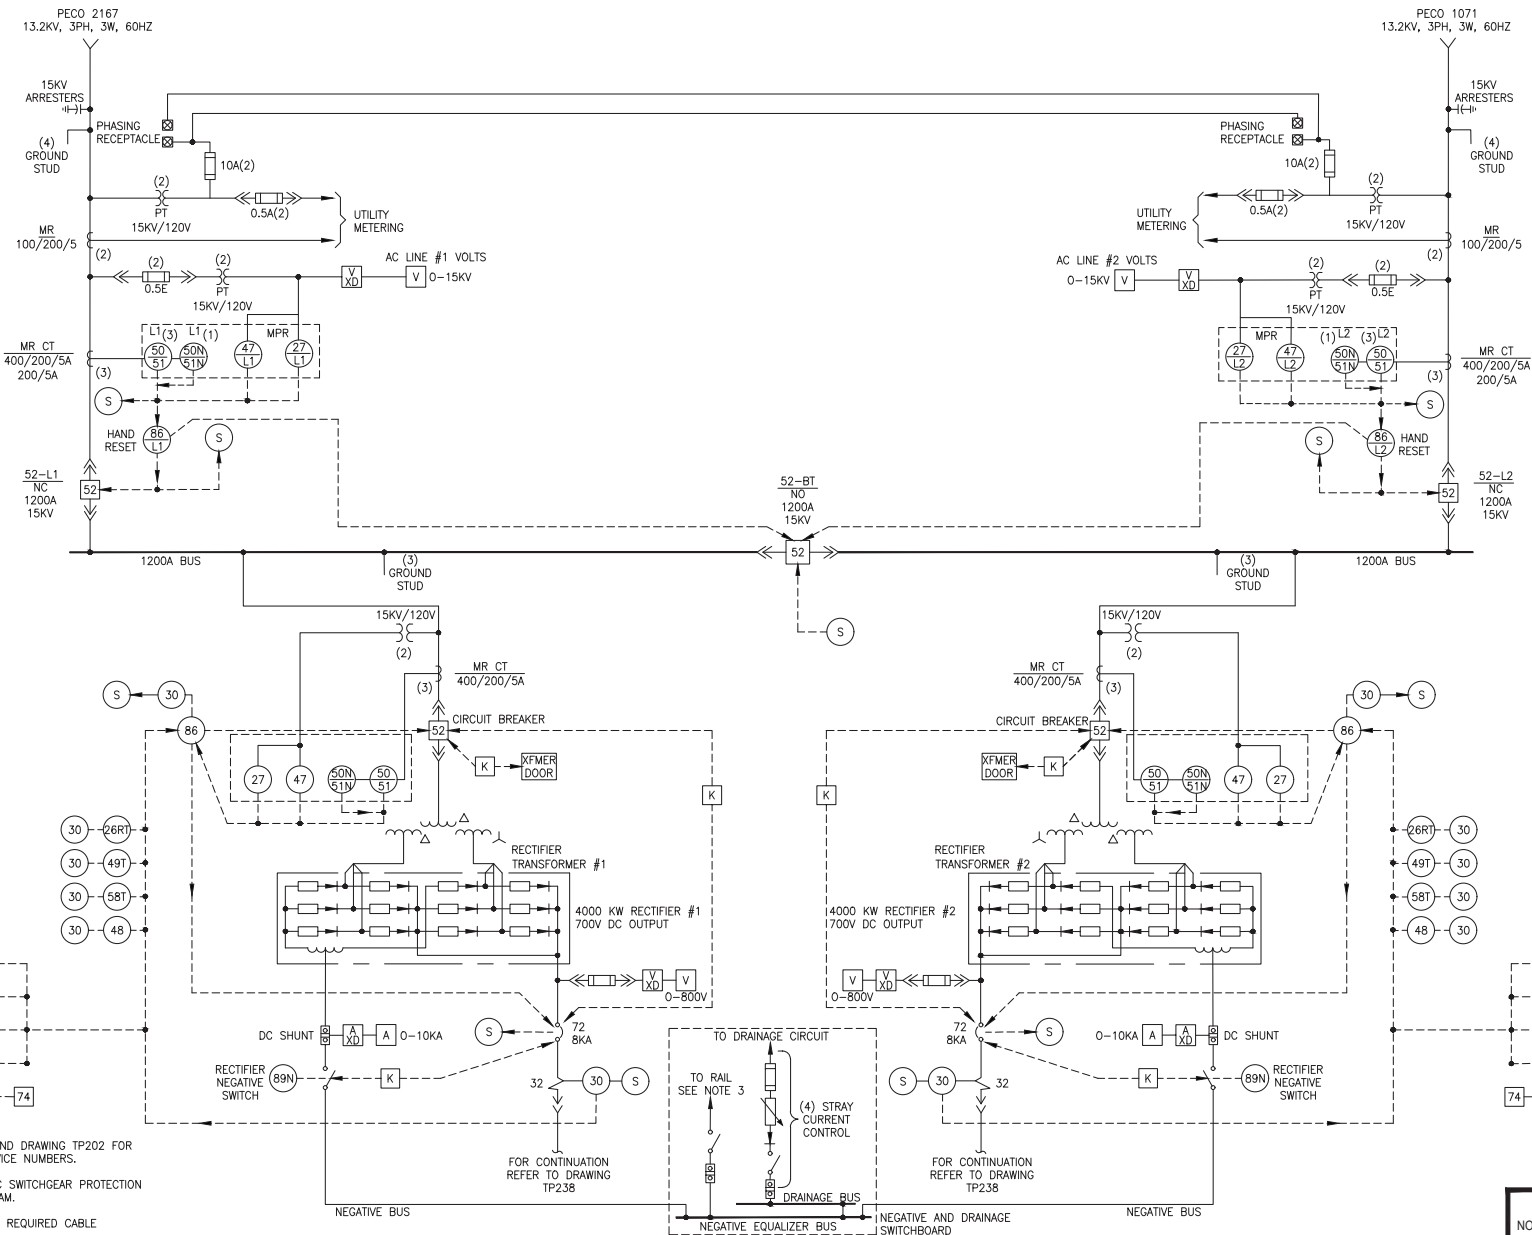

- NOTES:**
1. REFER TO DRAWING TP201 AND DRAWING TP202 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
 2. SEE DRAWING TP238 FOR DC SWITCHGEAR PROTECTION & RELAY SINGLE LINE DIAGRAM.
 3. FIELD SURVEY TO DETERMINE REQUIRED CABLE QUANTITIES AND SIZES.

50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	
DATE ENGINEERING CHECKED:	
DATE FIELD CHECKED:	
DESIGNER:	
ENGINEER:	
DIRECTOR OF ENGINEERING:	
SENIOR VICE PRESIDENT:	
PROJECT MANAGER:	



HDR
HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
PROTECTION & RELAY SINGLE LINE DIAGRAM - SHEET 1

DATE: 08/22/2025	SCALE: 1" = 100'
DRAWN BY: TL	CHECKED BY: JL
PROJECT NUMBER: 276482	
TP237	
DWG. NO. 26 OF 35	
REV. NO. 243 OF 453	
COMPUTER FILED: 17AN-TP237	

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

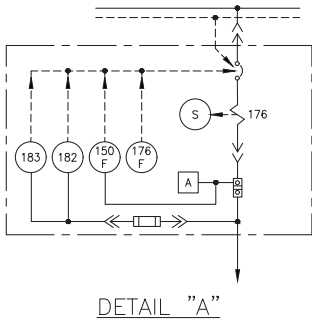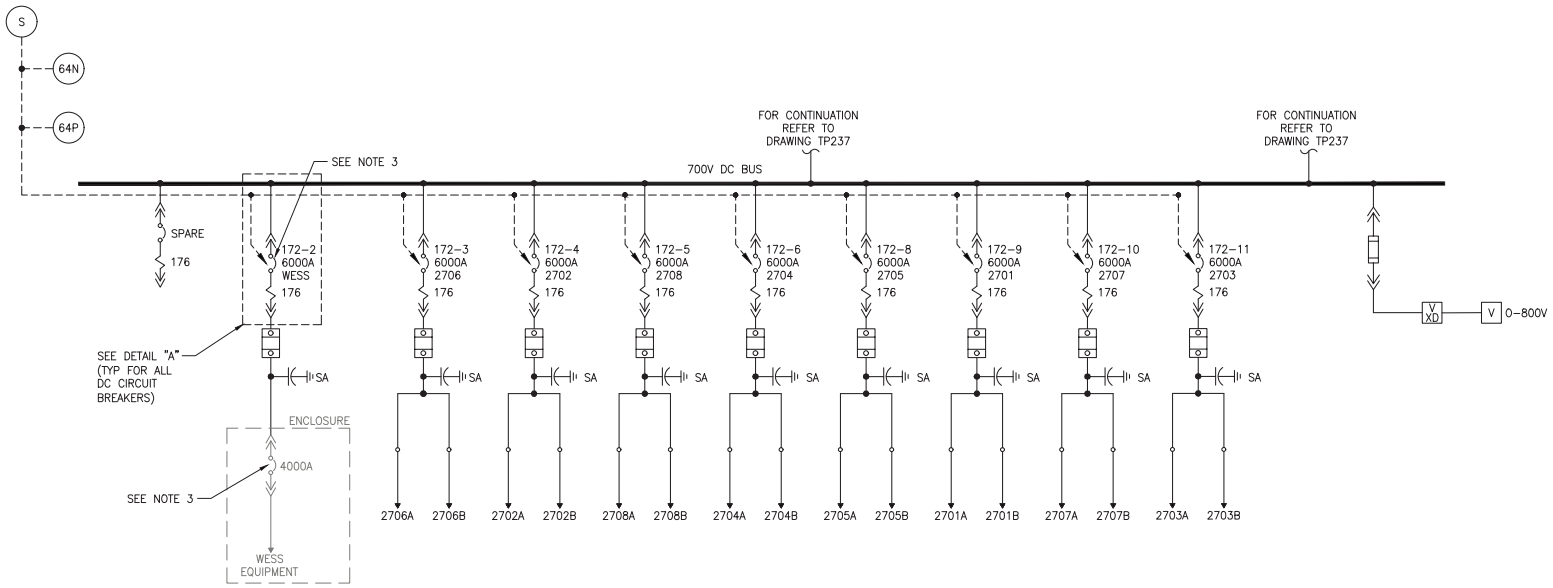

FOR CONTINUATION
REFER TO
DRAWING TP237

FOR CONTINUATION
REFER TO
DRAWING TP237

SEE DETAIL "A"
(TYP FOR ALL
DC CIRCUIT
BREAKERS)

SEE NOTE 3

SEE NOTE 3

700V DC BUS

NOTES:

- REFER TO DRAWING TP201 AND DRAWING TP202 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
- SEE DRAWING TP237 FOR AC SWITCHGEAR PROTECTION & RELAY SINGLE LINE DIAGRAM.
- THE CONTRACTOR TO DOCUMENT WESS DC POSITIVE CIRCUIT BREAKER PROTECTION ON THIS DRAWING AS PART OF THE FINAL DESIGN.

50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED: DATE
 DATE CHECKED/REVISED: DATE
 DATE FOR THE PROJECT: DATE
 PROJECT NUMBER: PROJECT NAME

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 PROTECTION & RELAY SINGLE LINE DIAGRAM - SHEET 2

SCALE: NTS	SCALE FACTOR: -
DATE: 08/22/2025	DRAWN BY: TL
WORK ORDER NO: 276482	CHECKED BY: JA
SHEET NUMBER: TP238	
DWG NO: 27 of 35	
SHT NO: 244 of 453	
PROJECT NO:	
COMPUTER FILE NO: 17AN-TP238	REV: 01

C:\P\MORNING\PTTD\081523\17AN-TP238.DWG


DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 CIRCUIT BREAKER CONTROL DIAGRAM

SHEET NO. TP239	SCALE FACTOR -
DATE 08/22/2025	DRAWN BY: DMR CHECKED BY: JR
WORK ORDER NO. 276482	PROJECT NO. TP239
SHEET NO. 28 OF 35	SHEET NO. 245 OF 453
COMPUTER FILED: 17AN-TP239	REV. NO. -



50% SUBMISSION
 NOT FOR CONSTRUCTION

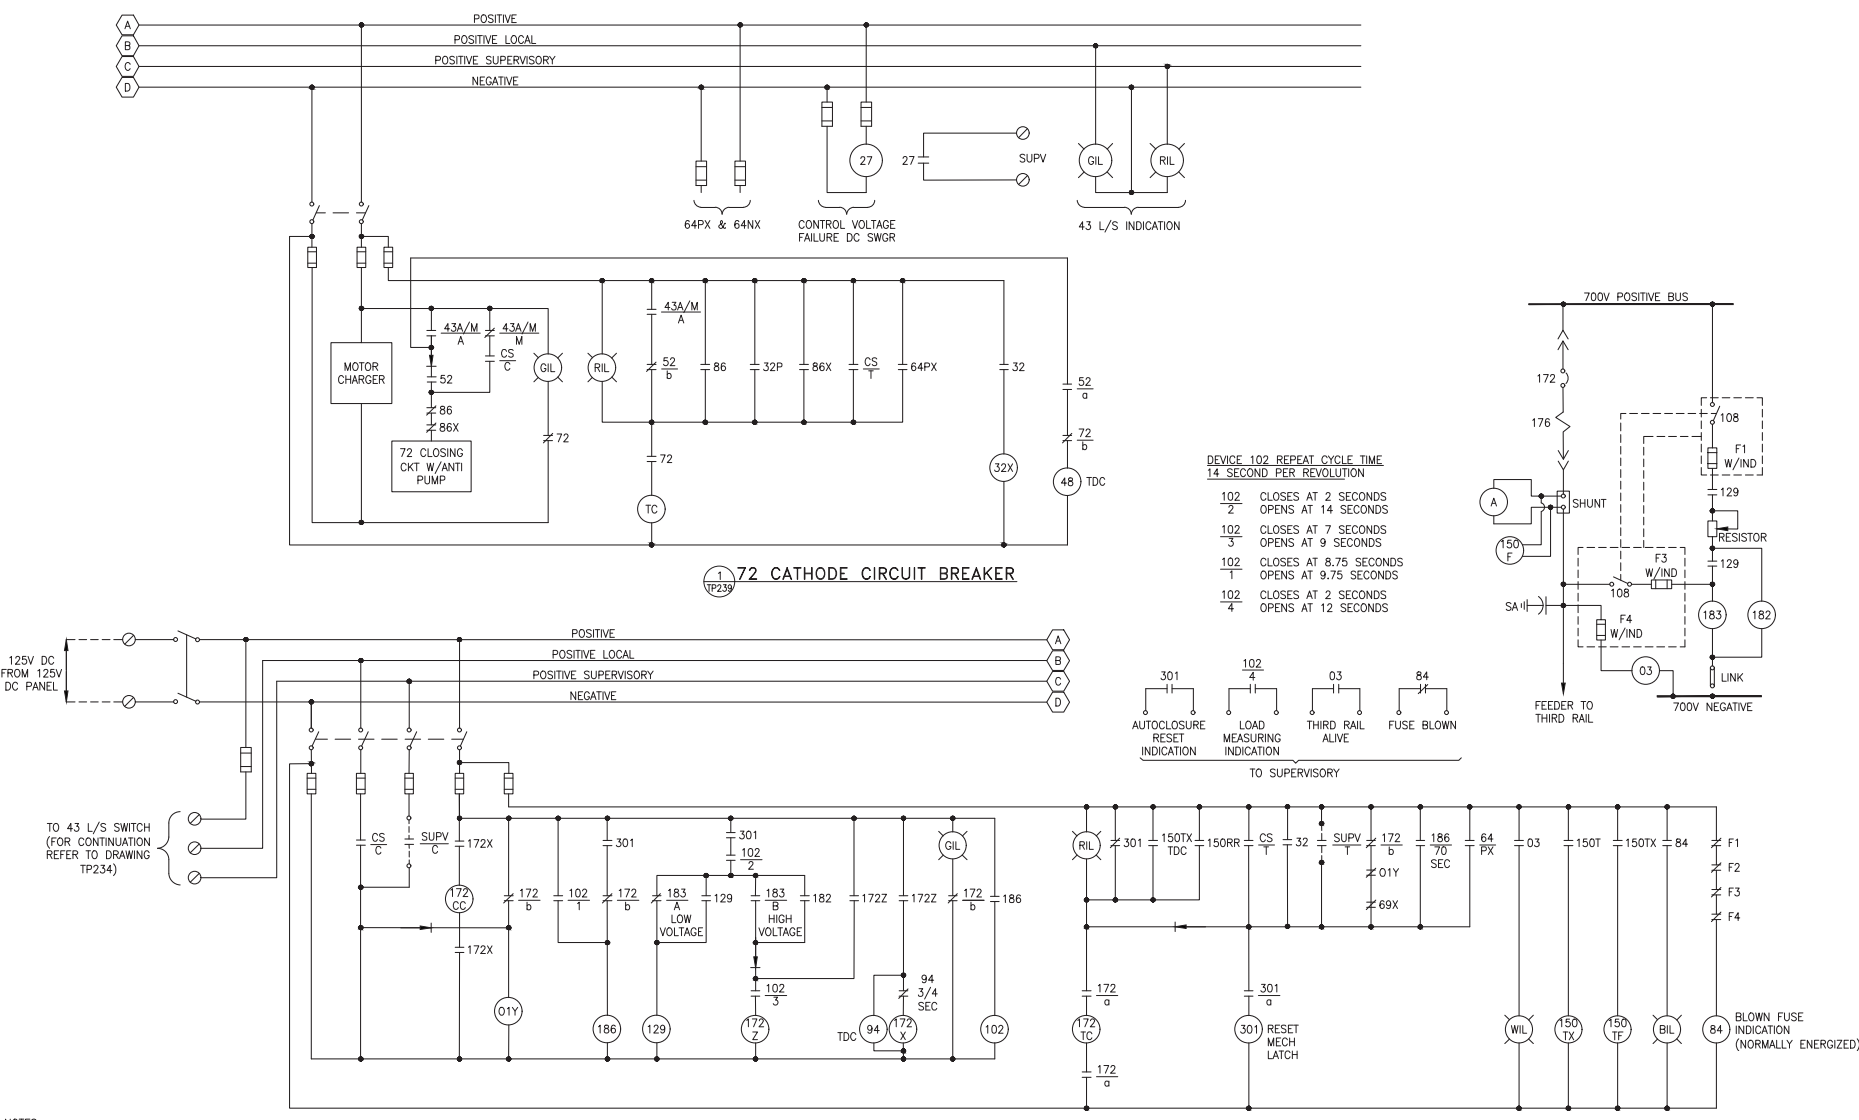

- NOTES:**
- REFER TO DRAWING TP201 AND DRAWING TP202 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
 - THESE ARE TYPICAL CONTROL DIAGRAMS. THE CONTRACTOR SHALL DEVELOP THE DESIGN TO 100 PERCENT BASED ON SITE CONDITIONS.
 - THE CONTRACTOR SHALL ESTABLISH CURRENT TRANSFORMER AND POTENTIAL TRANSFORMER RATIOS TO MEET THE PROTECTIVE RELAYING REQUIREMENTS.

DEVICE 102 REPEAT CYCLE TIME 14 SECOND PER REVOLUTION

102	CLOSES AT 2 SECONDS
2	OPENS AT 14 SECONDS
102	CLOSES AT 7 SECONDS
3	OPENS AT 9 SECONDS
102	CLOSES AT 8.75 SECONDS
1	OPENS AT 9.75 SECONDS
102	CLOSES AT 2 SECONDS
4	OPENS AT 12 SECONDS

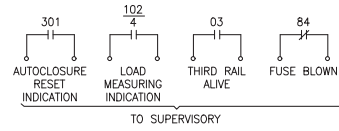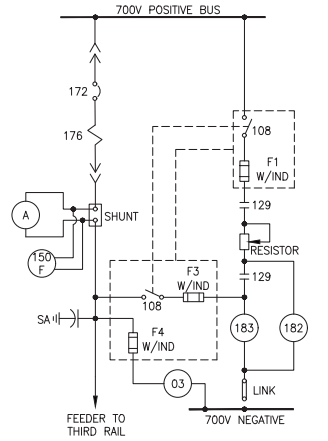


C:\P\WORKING\PTTD\08154271\AN\TP239.DWG

STATUS: 50% SUBMISSION

DATE PRINTED: 10/27/2025

C:\PW\WORKING\PTTD\181542\17AN\TP241.DWG

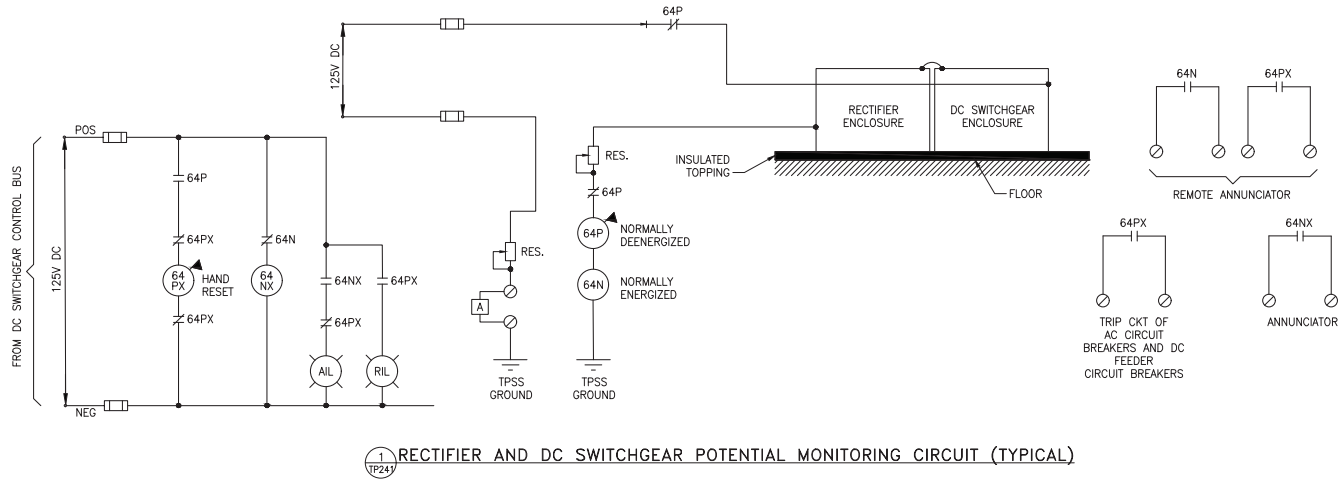

NOTES:

- REFER TO DRAWING TP201 AND DRAWING TP202 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
- THIS IS A TYPICAL DC GROUND FAULT PROTECTION SCHEME. THE CONTRACTOR SHALL DEVELOP THE DESIGN TO 100 PERCENT BASED ON SITE CONDITIONS.

50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PREPARED:	
DATE ENGINEERING CHECK:	
DATE FIELD INSPECTION:	
STATUS:	
DIRECTOR OF ENGINEERING:	
SUPERVISOR:	
PROJECT MANAGER:	


HDR
HDR Engineering, Inc.
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
DC GROUND FAULT PROTECTION SCHEME

SCALE:	SCALE FACTOR:
DATE:	DRAWN BY:
08/22/2025	CHECKED BY:
WORK ORDER NO:	276482
SHEET NUMBER:	TP241
TOTAL NO. OF SHEETS:	30 OF 35
SHEET NO.:	247 OF 453
COMPUTER FILE NO.:	17AN-TP241
REV. NO.:	

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

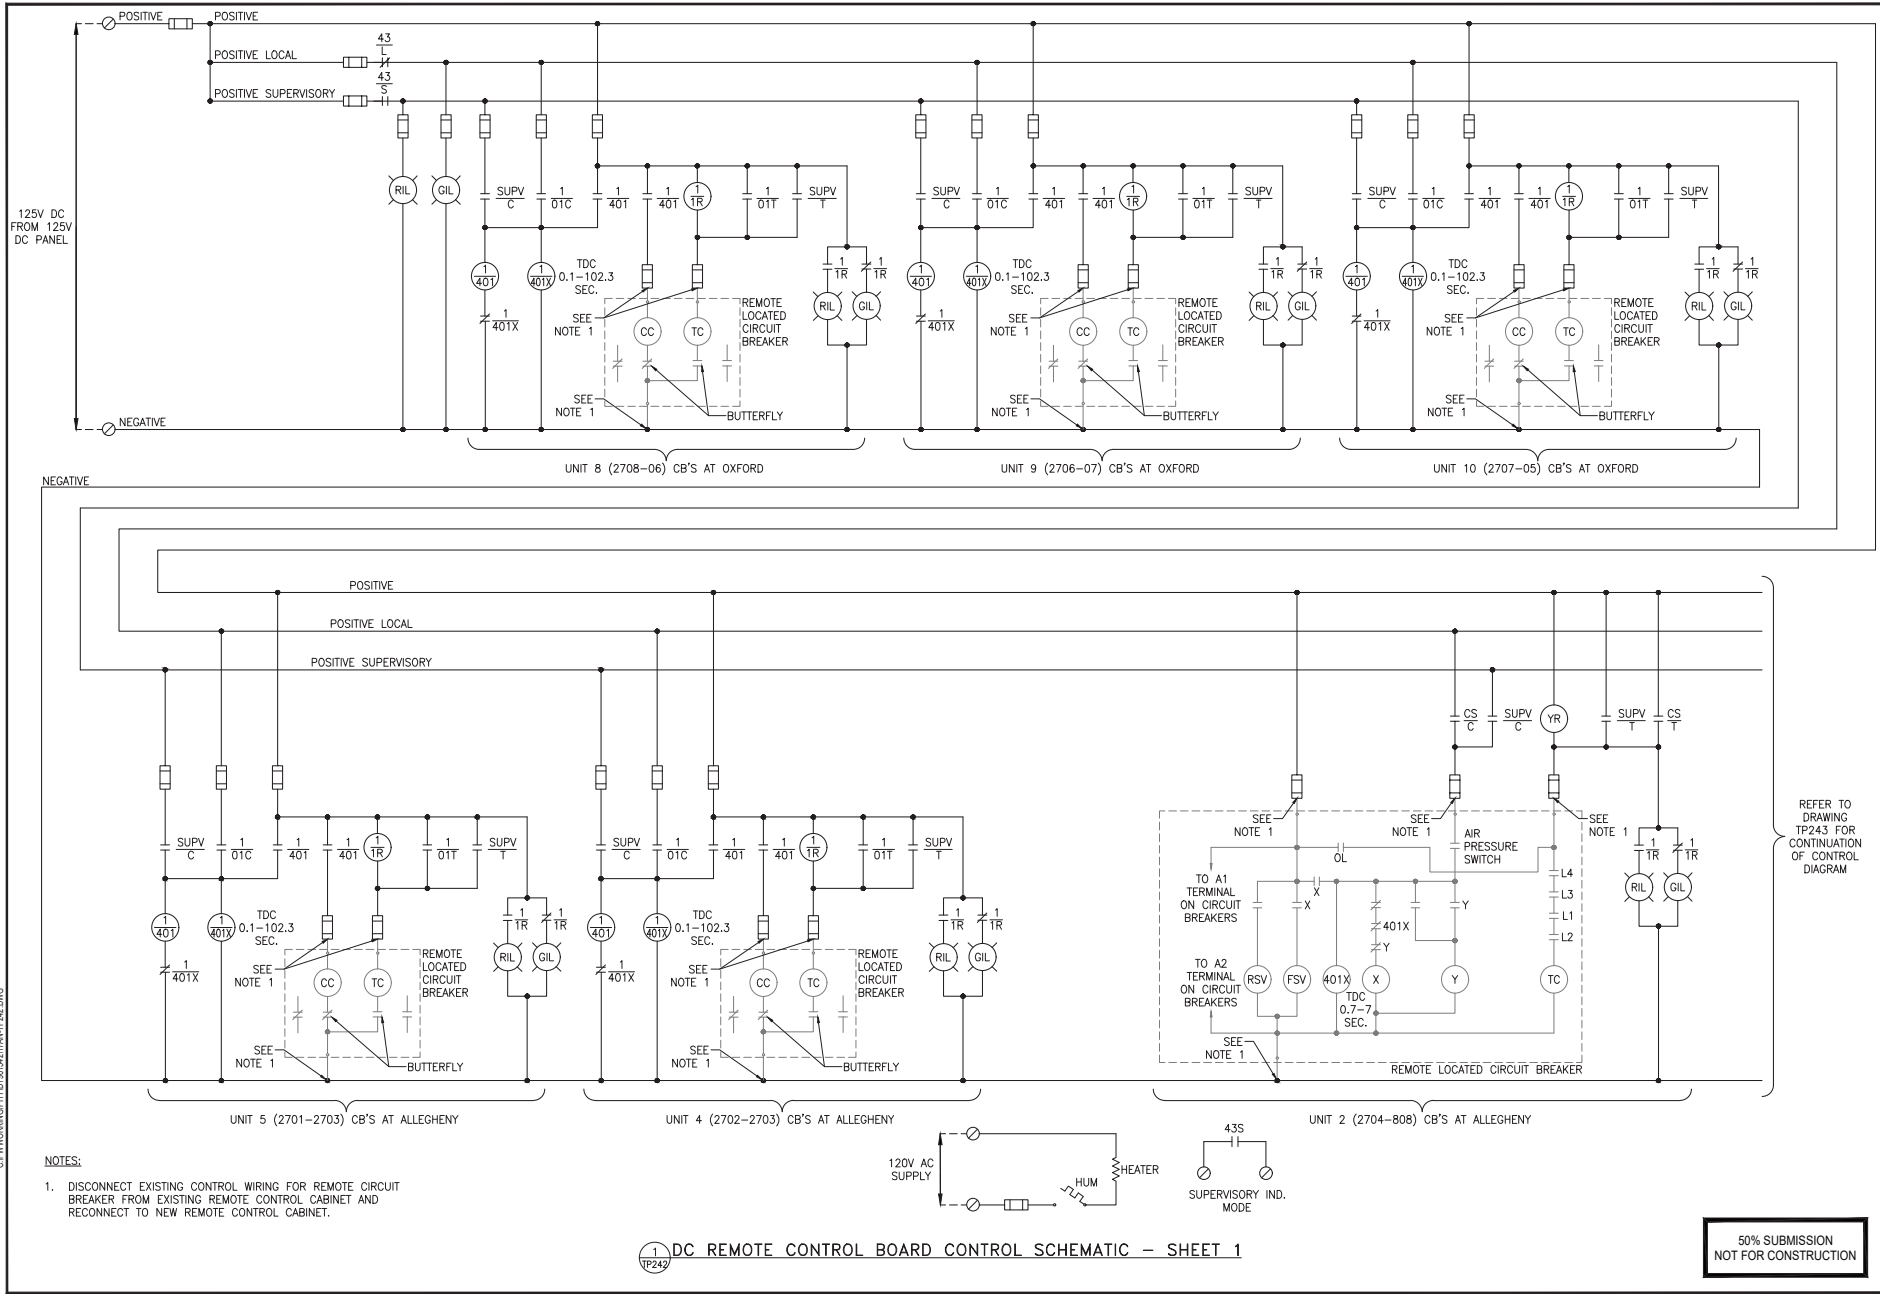

NOTES:
 1. DISCONNECT EXISTING CONTROL WIRING FOR REMOTE CIRCUIT BREAKER FROM EXISTING REMOTE CONTROL CABINET AND RECONNECT TO NEW REMOTE CONTROL CABINET.

DC REMOTE CONTROL BOARD CONTROL SCHEMATIC – SHEET 1

50% SUBMISSION
 NOT FOR CONSTRUCTION

1324 MARKET ST., 15TH FL. PHILADELPHIA, PA. 19107	
DRW ENGINEER: EMC DRW ENGINEERING OFFICE: BSA DRW RAIL TRACTOR OFFICE: PROJECT SAFETY: DIRECTOR OF ENGINEERING: BSA MANAGER ARCHITECTURE: PROJECT NUMBER:	BY: DGD DATE: APD DESCRIPTION:
HDR Engineering, Inc. Philadelphia, PA	
BROAD SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION TRACTION POWER DC REMOTE CTL BRD CONTROL SCHEMATIC - SHEET 1	
DATE: NTS DATE: 08/22/2025 DRAWING NO.: 276491 SHEET NUMBER: TP242	SCALE FACTOR: DESIGNED BY: NDR CHECKED BY: JL DATE: 08/22/2025 SHEET NO.: 31 of 35 DWT NO.: 248 of 453 PROJECT NO.: COMPUTER FILE NO.: 17AN-TP242 REV. NO.:
STATUS: 50% SUBMISSION	

REFER TO DRAWING TP243 FOR CONTINUATION OF CONTROL DIAGRAM

C:\PWORKING\BPT\17AN\17AN-TP242.DWG

CHIEF ENGINEER - DMC:
CHIEF ENGINEERING OFFICER - S&E:
CHIEF RAIL TRAFFIC OFFICER:
CONTROL SAFETY:
DIRECTOR OF ENGINEERING - S&E:
MANAGER - MECH. ENGINEERING:
PROJECT MANAGER:


NO.	DATE	BY	APP'D	DESCRIPTION

BROAD
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
DC REMOTE CTL BRD CONTROL SCHEMATIC - SHEET 2


DATE:	NTS	SCALE FACTOR:
REV:	08/22/2025	DRAWN BY: S&E
WORK ORDER NO.:	276491	CHECKED BY: S
SHEET NUMBER:	TP243	
DWG. NO.:	22	OF 35
APP. NO.:	249	OF 453
PROJECT NO.:		
COMPUTER FILE NO.:	17AN-TP243	REV. NO.:

50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PRINTED: 10/22/2025
STATUS: 50% SUBMISSION

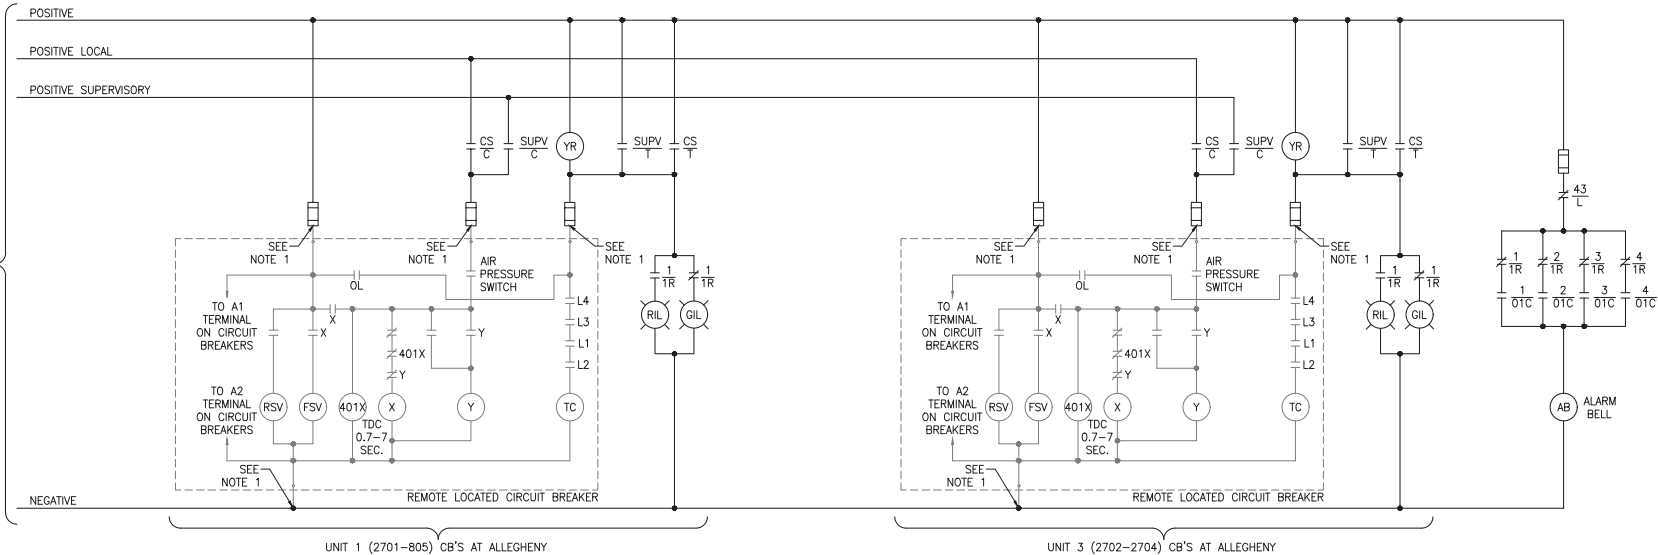

REFER TO DRAWING TP242 FOR CONTINUATION OF CONTROL DIAGRAM

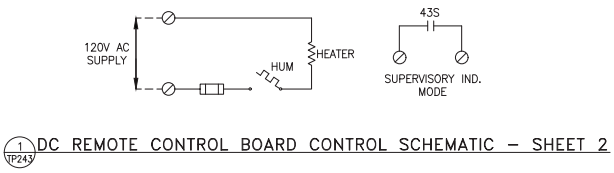

1 DC REMOTE CONTROL BOARD CONTROL SCHEMATIC - SHEET 2
TP243

- NOTES:**
1. DISCONNECT EXISTING CONTROL WIRING FOR REMOTE CIRCUIT BREAKER FROM EXISTING REMOTE CONTROL CABINET AND RECONNECT TO NEW REMOTE CONTROL CABINET.

BUS POTENTIAL TRANSFORMER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TELEMETRY POINTS		
15KV BUS 1	VOLTAGE	1
15KV BUS 2	VOLTAGE	2
SPARE	-	3
SPARE	-	4

RECTIFIER TRANSFORMER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TOTAL RECTIFIER TRANSFORMERS = 2		
TEMPERATURE (49)	ALARM-T1	1
	TRIP-T2	2
REFLECTIVE FAILURE (58T)	-	3
CONTROL POINTS		
NONE	-	-
TELEMETRY POINTS		
VOLTAGE	VOLTAGE	1

15KV CIRCUIT BREAKER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TOTAL 15KV AC CIRCUIT BREAKERS (FOR 13.2KV) = 6		
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
CIRCUIT BREAKER FAILURE RELAY (50BF)	OPERATED	3
	FAILURE	4
UNDER VOLTAGE RELAY (27)	TRIPPED	5
	SET	6
PHASE BALANCE RELAY (47)	TRIPPED	7
	SET	8
OVERCURRENT RELAY (50/51)	OPERATED	9
	FAILURE	10
LOCAL/REMOTE SWITCH	LOCAL	11
	REMOTE	12
CIRCUIT BREAKER TRIP	TRIPPER	13
CIRCUIT BREAKER READY	READY	14
	-	15
CIRCUIT BREAKER WATCHDOG	WATCHDOG	16
	-	17
RESERVED	N.O.	18
	N.C.	19
RESERVED	N.O.	20
	N.C.	21
RESERVED	N.O.	22
	N.C.	23
CONTROL POINTS		
CIRCUIT BREAKER	OPEN	1
	CLOSE	2
RESERVED	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1

INCOMING CIRCUIT BREAKER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
15KV LINE: PECO 504, PECO 532 TOTAL CIRCUIT BREAKERS = 2		
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
CONTROL POINTS		
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
RESERVED	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1
RESERVED	-	2
VOLTMETER (VM)	VOLTS	3

RECTIFIER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TOTAL RECTIFIERS = 2		
RECTIFIER COMPARTMENT DOOR SAFETY INTERLOCK (33R)	TRIP	1
RECTIFICATION FAILURE (58)	ALARM-T1	2
	TRIP-T2	3
RECTIFIER STRUCTURE GROUNDED (64N)	OPERATED	4
	FAILURE	5
RECTIFIER STRUCTURE HOT (64P)	OPERATED	6
	FAILURE	7
BLOWN FUSE IN SURGE PROTECTION CIRCUIT (99X)	ALARM	8
RECTIFIER HEAT SINK OVER-TEMPERATURE	ALARM-T1	9
	TRIP-T2	10

AUXILIARY AND LIGHTING AND POWER TRANSFORMER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TOTAL TRANSFORMERS = 3		
TEMPERATURE (49T)	ALARM-T1	1
	TRIP-T2	2
REFLECTIVE FAILURE (58T)	-	3
CONTROL POINTS		
NONE	-	-
TELEMETRY POINTS		
NONE	-	-

FIRE ALARM PANEL

DEVICE	STATUS INDICATION	POINT NUMBER
FIRE ALARM	ON	1
FACP STATUS	TROUBLE	2

BATTERY SYSTEM

DEVICE	STATUS INDICATION	POINT NUMBER
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
BATTERY STATUS	ENABLED	3
	DISABLED	4
BATTERY VOLTAGE	NORMAL	5
	LOW	6
CONTROL POWER	AC POWER	7
	NO AC POWER	8
MAINTENANCE	OVERVOLTAGE	9
	UNDERVOLTAGE	10
GAS DETECTION ALARM	NORMAL	11
	ALARM	12
CONTROL POINTS		
NONE	-	-
TELEMETRY POINTS		
NONE	-	-

DC SWITCHGEAR SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TOTAL CATHODE CIRCUIT BREAKERS = 2 TOTAL DC FEEDER CIRCUIT BREAKERS = 10		
CATHODE CIRCUIT BREAKER	OPENED	1
	CLOSED	2
CATHODE CIRCUIT BREAKER DIRECTIONAL POWER RELAY	OPERATED	3
	FAILURE	4
DC FEEDER CIRCUIT BREAKER	OPENED	5
	CLOSED	6
DC FEEDER CIRCUIT BREAKER RATE OF RISE AND OVER CURRENT RELAY	150F	7
DC FEEDER CIRCUIT BREAKER OVER VOLTAGE RELAY	176	8
LOSS OF DC AUXILIARY SUPPLY (27A AND 27T)	ALARM-T1	9
	TRIP-T2	10
CONTROL POINTS		
CATHODE CIRCUIT BREAKER	OPEN	1
	CLOSE	2
DC FEEDER CIRCUIT BREAKER	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1

INTRUSION PANEL

DEVICE	STATUS INDICATION	POINT NUMBER
INTRUSION ALARM	ON	1
INTRUSION PANEL STATUS	TROUBLE	2
CONTROL POINTS		
INTRUSION ALARM	ARM	1
	DISARM	2

15KV CIRCUIT BREAKER SCADA POINTS

DEVICE	STATUS INDICATION	POINT NUMBER
TOTAL 15KV AC CIRCUIT BREAKERS (FOR 4.8KV) = 9		
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
CIRCUIT BREAKER FAILURE RELAY (50BF)	OPERATED	3
	FAILURE	4
UNDER VOLTAGE RELAY (27)	TRIPPED	5
	SET	6
PHASE BALANCE RELAY (47)	TRIPPED	7
	SET	8
OVERCURRENT RELAY (50/51)	OPERATED	9
	FAILURE	10
LOCAL/REMOTE SWITCH	LOCAL	11
	REMOTE	12
CIRCUIT BREAKER TRIP	TRIPPER	13
CIRCUIT BREAKER READY	READY	14
	-	15
CIRCUIT BREAKER WATCHDOG	WATCHDOG	16
	-	17
RESERVED	N.O.	18
	N.C.	19
RESERVED	N.O.	20
	N.C.	21
RESERVED	N.O.	22
	N.C.	23
CONTROL POINTS		
CIRCUIT BREAKER	OPEN	1
	CLOSE	2
RESERVED	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1

BATTERY TRANSFER PANEL

DEVICE	STATUS INDICATION	POINT NUMBER
CONTACTOR #1	OPENED	1
	CLOSED	2
CONTACTOR #2	OPENED	3
	CLOSED	4
CONTROL POINTS		
CONTACTOR #1	OPEN	1
	CLOSE	2
CONTACTOR #2	OPEN	3
	CLOSE	4
TELEMETRY POINTS		
NONE	-	-

NOTES:

1. THERE IS ONLY ONE LOCAL/REMOTE SELECTOR SWITCH.
2. THIS SCADA POINTS LIST IS FOR GUIDANCE ONLY. THE CONTRACTOR IS TO DEVELOP A FINAL POINT COUNT AS PART OF THE FINAL DESIGN AND ANY SEPTA SPECIFIC ADDITIONS AT THIS LOCATION.

50% SUBMISSION
NOT FOR CONSTRUCTION

HDR Engineering, Inc.
 Philadelphia, PA

NO.	DATE	DESCRIPTION	BY	CHKD	APPD


SHEET NO. **TP244**
 DATE: 08/22/2025
 DRAWN BY: MLL
 CHECKED BY: JG
 PROJECT NO.: 276482
 SHEET NO.: 33 of 35
 PART NO.: 290 of 453
 REV. NO.:
 COMPUTER FILE NO.: 17AN-TP244
 REV. NO.:

C:\P\WORKING\PTT\1081542\17AN-TP244.DWG



DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

C:\PWORKING\PTTD\081521\17AN-TP245.DWG

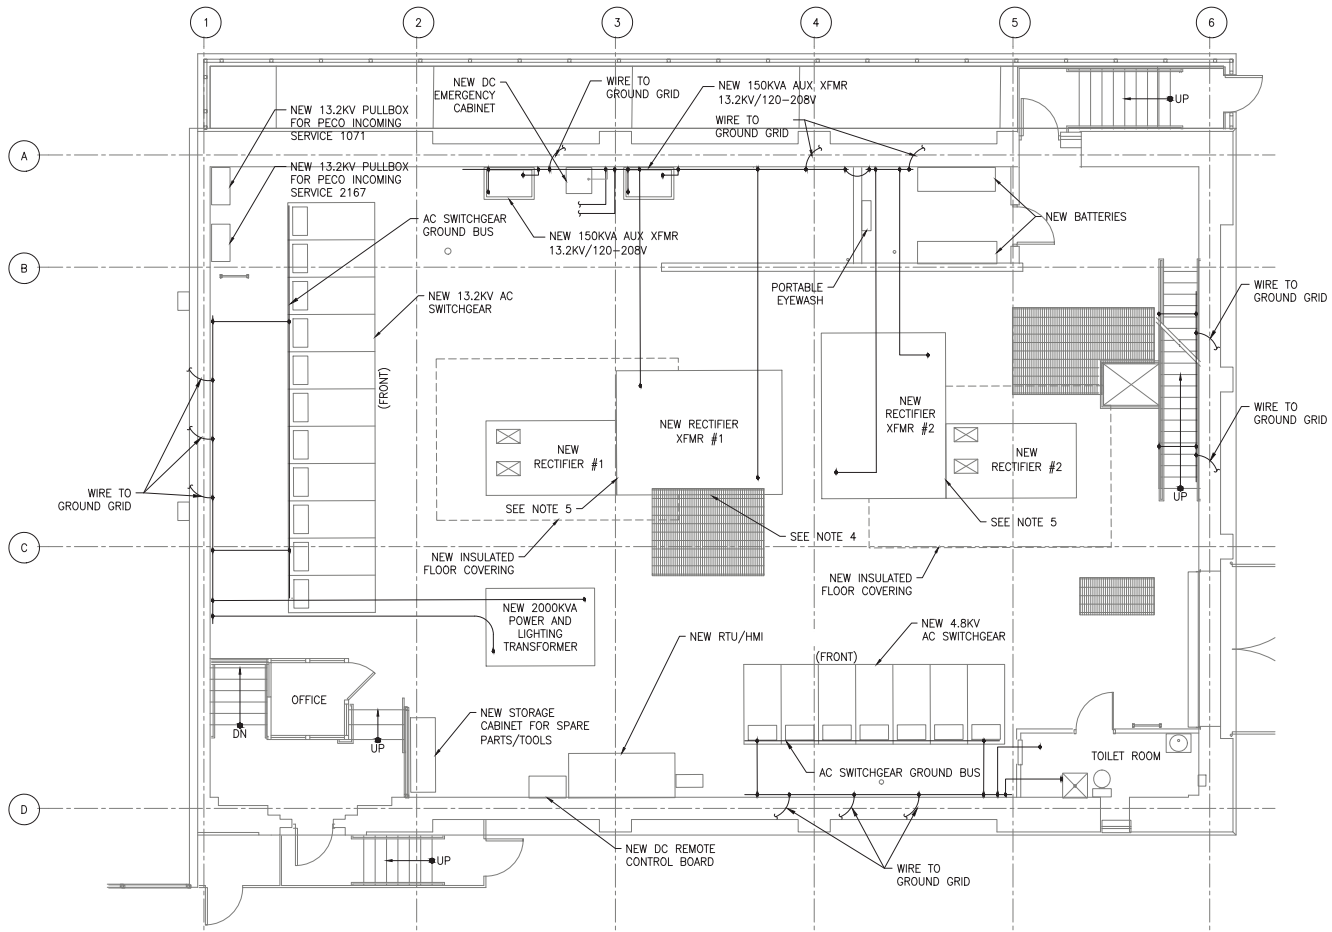

- NOTES:**
- GROUND CABLES SHALL, IN GENERAL, RUN PARALLEL TO OR AT RIGHT ANGLES TO FLOORS, WALLS AND STRUCTURAL MEMBERS.
 - THIS DRAWING IS DIAGRAMMATIC ONLY. REFER TO SPECIFICATIONS FOR DETAIL.
 - GROUND CABLE PASSING THROUGH CONCRETE INTO EXPOSED AREAS SHALL BE PROTECTED AGAINST ABRASION AT POURED IN PLACE CONCRETE SLABS.
 - THE CONTRACTOR TO PROVIDE A DESIGN FOR A REDUCED SIZE GRATE IN ORDER FOR THE INSTALLATION OF NEW RECTIFIER TRANSFORMER SET #1 AND INSULATED FLOOR COVERING.
 - THE CONTRACTOR TO PROVIDE AN INSULATING BARRIER BETWEEN THE NEW RECTIFIER AND THE NEW RECTIFIER TRANSFORMER.
 - ALL ELECTRICAL ENCLOSURES THROUGHOUT THE SUBSTATION SHALL BE CONNECTED TO SUBSTATION'S GROUND BUS.



50% SUBMISSION
NOT FOR CONSTRUCTION

PREPARED BY: _____
 CHECKED BY: _____
 DESIGNED BY: _____
 DRAWN BY: _____
 DATE: _____

HDR
 HDR Engineering, Inc.
 Philadelphia, PA








REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
TRACTION POWER
 GROUNDING PLAN



TITLE: AS SHOWN DATE: 08/22/2025 WORK ORDER NO: 276482 SHEET NUMBER: TP245	SCALE FACTOR: - DRAWN BY: sb CHECKED BY: ll TBL NO: 34 OF 35 SHEET NO: 251 OF 453 COMPUTER FILE NO.: 17AN-TP245
--	--

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

SECURITY SYMBOLS LEGEND:

SYMBOL	DESCRIPTION
	CCTV CAMERA, FIXED WITH ENVIRONMENTAL DOME. PROVIDE BACK BOX AND RGS CONDUIT. (2) CAT6 CABLES PER CAMERA. INSTALL CONNECTOR AND COIL. SPARE CABLE IN JUNCTION BOX. INDOOR SHALL BE CMP AND OUTDOOR SHALL BE CMX-OUTDOOR RATED JACKETS.
	DOOR CONTACT. PROVIDE UTP IN 3/4" RGS. SURFACE MOUNT.
	INDOOR/OUTDOOR SELF CONTAINED ARMORED SIREN/STROBE. PROVIDE UTP IN MIN 3/4" RGS.
	INTRUSION DETECTION KEY PAD. PROVIDE UTP IN 3/4" RGS TO PANEL
	MOTION DETECTOR. PROVIDE UTP IN MIN 3/4" RGS.
	DOOR CONTACT TO BE REMOVED.
	SILENCE PUSH BUTTON TO BE REMOVED.

TELECOMMUNICATION SYMBOLS LEGEND:

SYMBOL	DESCRIPTION
	VOICE CONNECTION - SINGLE GANG JUNCTION BOX WITH RGS CONDUIT AS INDICATED ROUTED TO TELEPHONE BLOCK IN TELECOM CABINET.
W:	WALL MOUNTED PHONE OUTLET WITH (1) ONE CAT6 VOICE CABLE.
	VOICE CONNECTION TO BE REMOVED

LINETYPE CONVENTIONS:

-----	DEMO
_____	EXISTING
_____	NEW

SYMBOL	DESCRIPTION
AF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
APPROX.	APPROXIMATELY
AWG	AMERICAN WIRE GAUGE
AVPA	AUDIO/VISUAL PUBLIC ADDRESS
BICSI	BUILDING INDUSTRY CONSULTING SERVICES INTERNATIONAL CONDUIT
C	CATEGORY
CAT	CENTER CITY DISTRICT
CCD	CLOSED CIRCUIT TELEVISION
CCTV	COMMUNICATIONS PLENUM
CMF	COMMUNICATIONS RESIDENTIAL COMMUNICATION
CMX	COMMERCIAL OFF THE SHELF
COMM	CENTRAL PROCESSING UNIT
COTS	COPPER
CPU	DIAMETER
CU	DIGITAL VISUAL INTERFACE
DIA	DIGITAL VIDEO RECORDER
DVI	ELECTRONIC INDUSTRIES ALLIANCE
DVR	EMERGENCY
EIA	ET CETERA
EM	EXISTING EQUIPMENT TO REMAIN
ETC	FIRE ALARM CONTROL PANEL
(E)	FLEXIBLE METALLIC CONDUIT
FACP	HUMAN MACHINE INTERFACE
FMC	INTRUSION DETECTION PANEL
HMI	INTRUSION DETECTION SYSTEM
IDP	JUNCTION BOX
IDS	KEYBOARD
JB	KEYBOARD VIDEO MOUSE
KBD	FOUND
KVM	LIQUID CRYSTAL DISPLAY
LB	LIQUID TIGHT FLEXIBLE METAL CONDUIT
LCD	ELECTRO-MAGNETIC LOCK
LFMC	MAXIMUM
ML	MINIMUM
MAX	MONITOR
MIN	NEW WORK/EQUIPMENT TO BE PROVIDED
MON	(N) NATIONAL ELECTRICAL CODE
(N)	NATIONAL ELECTRICAL CODE
NEC	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NEMA	NATIONAL FIRE PROTECTION ASSOCIATION
NFPA	NOMINAL
NOM	NEW PAYMENT TECHNOLOGY
NPT	NUMBER
NO	NETWORK VIDEO RECORDER
NVR	OUTER DIAMETER
OD	PERSONAL COMPUTER
PC	POWER DISTRIBUTION UNIT
PDU	PATCH PANEL
PP	PAN/TILT/ZOOM
PTZ	RELOCATED EXISTING
(RE)	RIGID GALVANIZED STEEL
RGS	REMOTE TERMINAL UNIT
RTU	REQUEST TO EXIT
RX	SUPERVISORY CONTROL AND DATA ACQUISITION
SCADA	TRANSPORTATION AGENT
TA	TELECOMMUNICATIONS DISTRIBUTION METHODS MANUAL
TDM	TELECOMMUNICATIONS INDUSTRY ASSOCIATION
TIA	TRACTION POWER SUBSTATION
TPSS	TRANSIENT VOLTAGE SURGE SUPPRESSION
TVSS	TWISTED PAIR
TWPR	TYPICAL
TYP	UNINTERRUPTIBLE POWER SUPPLY
UPS	UNIVERSAL SERIAL BUS
USB	UNSHIELDED TWISTED PAIR
UTP	VOLT AMPERE
VA	VOLTS ALTERNATING CURRENT
VAC	VIDEO GRAPHICS ARRAY
VGA	WITH
W/	

C:\WORKING\PTD\1838\BITAN\COM200.DWG

ELECTRONICS ABBREVIATIONS:


SYMBOL	DESCRIPTION
AF	ABOVE FINISHED FLOOR
AFG	ABOVE FINISHED GRADE
APPROX.	APPROXIMATELY
AWG	AMERICAN WIRE GAUGE
AVPA	AUDIO/VISUAL PUBLIC ADDRESS
BICSI	BUILDING INDUSTRY CONSULTING SERVICES INTERNATIONAL CONDUIT
C	CATEGORY
CAT	CENTER CITY DISTRICT
CCD	CLOSED CIRCUIT TELEVISION
CCTV	COMMUNICATIONS PLENUM
CMF	COMMUNICATIONS RESIDENTIAL COMMUNICATION
CMX	COMMERCIAL OFF THE SHELF
COMM	CENTRAL PROCESSING UNIT
COTS	COPPER
CPU	DIAMETER
CU	DIGITAL VISUAL INTERFACE
DIA	DIGITAL VIDEO RECORDER
DVI	ELECTRONIC INDUSTRIES ALLIANCE
DVR	EMERGENCY
EIA	ET CETERA
EM	EXISTING EQUIPMENT TO REMAIN
ETC	FIRE ALARM CONTROL PANEL
(E)	FLEXIBLE METALLIC CONDUIT
FACP	HUMAN MACHINE INTERFACE
FMC	INTRUSION DETECTION PANEL
HMI	INTRUSION DETECTION SYSTEM
IDP	JUNCTION BOX
IDS	KEYBOARD
JB	KEYBOARD VIDEO MOUSE
KBD	FOUND
KVM	LIQUID CRYSTAL DISPLAY
LB	LIQUID TIGHT FLEXIBLE METAL CONDUIT
LCD	ELECTRO-MAGNETIC LOCK
LFMC	MAXIMUM
ML	MINIMUM
MAX	MONITOR
MIN	NEW WORK/EQUIPMENT TO BE PROVIDED
MON	(N) NATIONAL ELECTRICAL CODE
(N)	NATIONAL ELECTRICAL CODE
NEC	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
NEMA	NATIONAL FIRE PROTECTION ASSOCIATION
NFPA	NOMINAL
NOM	NEW PAYMENT TECHNOLOGY
NPT	NUMBER
NO	NETWORK VIDEO RECORDER
NVR	OUTER DIAMETER
OD	PERSONAL COMPUTER
PC	POWER DISTRIBUTION UNIT
PDU	PATCH PANEL
PP	PAN/TILT/ZOOM
PTZ	RELOCATED EXISTING
(RE)	RIGID GALVANIZED STEEL
RGS	REMOTE TERMINAL UNIT
RTU	REQUEST TO EXIT
RX	SUPERVISORY CONTROL AND DATA ACQUISITION
SCADA	TRANSPORTATION AGENT
TA	TELECOMMUNICATIONS DISTRIBUTION METHODS MANUAL
TDM	TELECOMMUNICATIONS INDUSTRY ASSOCIATION
TIA	TRACTION POWER SUBSTATION
TPSS	TRANSIENT VOLTAGE SURGE SUPPRESSION
TVSS	TWISTED PAIR
TWPR	TYPICAL
TYP	UNINTERRUPTIBLE POWER SUPPLY
UPS	UNIVERSAL SERIAL BUS
USB	UNSHIELDED TWISTED PAIR
UTP	VOLT AMPERE
VA	VOLTS ALTERNATING CURRENT
VAC	VIDEO GRAPHICS ARRAY
VGA	WITH
W/	

GENERAL CONSTRUCTION NOTES:

- COMPLY WITH LATEST APPLICABLE EDITION OF NFPA 70 (NEC), AND WITH THE REQUIREMENTS OF THE LOCAL AUTHORITY HAVING JURISDICTION, THE DEPARTMENT OF LICENSES AND INSPECTIONS (L & I) AND THE CITY OF PHILADELPHIA.
- INSTALL ALL EQUIPMENT WITH ADEQUATE CLEARANCES FOR MAINTENANCE AND SERVICING AND IN ACCORDANCE WITH THE MANUFACTURER'S WRITTEN INSTRUCTIONS AND APPLICABLE CODES.
- OBTAIN AND PAY FOR ALL PERMITS AND PAY FOR ALL COSTS OF MATERIALS. HANDLE, STORE AND PROTECT ALL EQUIPMENT TO PREVENT DAMAGE BEFORE AND DURING INSTALLATION IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS. PROTECT THE WORK SITE AND ALL WORK AGAINST ANY DAMAGE (INCLUDING BUT NOT LIMITED TO WATER, DUST, HEAT, FREEZING, ETC.) UNTIL FINAL COMPLETION AND ACCEPTANCE BY SEPTA.
- REFER TO SPECIFICATIONS FOR MATERIALS TO BE USED AND METHODS OF INSTALLATION.
- WHERE UTILITIES AND/OR SERVICES REQUIRE SHUTDOWN FOR THE WORK TO BE PERFORMED, NOTIFY THE SEPTA PROJECT MANAGER, IN WRITING, A MINIMUM OF TWO (2) WEEKS PRIOR TO THE SCHEDULED SHUTDOWN.
- STORAGE OF MATERIALS AND/OR EQUIPMENT IS NOT PERMITTED OTHER THAN WITHIN THE LIMITS OF THE STAGING AREA OR CONFINES OF THE PROJECT WORK AREA AND AS APPROVED BY THE SEPTA PROJECT MANAGER.
- REMOVE ALL CONSTRUCTION DEBRIS IN ACCORDANCE WITH APPROVED CONSTRUCTION WASTE MANAGEMENT PLAN.
- KEEP A COPY OF THE CURRENT SET OF CONTRACT DOCUMENTS (WITH AS-BUILT INFORMATION) AT THE JOB SITE AT ALL TIMES.
- REVIEW ALL PROJECT DOCUMENTS OF ALL TRADES FOR A THOROUGH UNDERSTANDING OF PROJECT AND ANY CROSS REFERENCING OF WORK. REVIEW ALL PROJECT REQUIREMENTS PRIOR TO BIDDING. REPORT ANY DISCREPANCIES BETWEEN DOCUMENTS TO THE SEPTA PROJECT MANAGER PRIOR TO BIDDING.
- PRIOR TO DELIVERY OF ANY MATERIALS TO THE SITE, PROVIDE SAFETY DATA SHEETS FOR ALL REQUIRED ITEMS AND MATERIALS, USED IN THE WORK, TO THE SEPTA PROJECT MANAGER.
- COMPLY WITH ALL SEPTA SAFETY STANDARDS AND INCLUDE ALL COSTS TO TRAIN AND QUALIFY PERSONNEL IN SEPTA SAFETY STANDARDS.
- UTILIZE PENNSYLVANIA ONE CALL PRIOR TO ANY UNDERGROUND WORK INCLUDING TRENCHING OR DIGGING. COMPLIANCE WITH ALL LAWS, RULES AND REGULATIONS REGARDING UTILITY CROSSING SHALL BE CONSIDERED AS PART OF THIS CONTRACT. THE CONTRACTOR SHALL NOT SEEK ADDITIONAL REIMBURSEMENT FOR ALTERNATIVE MEANS OF INSTALLATION FOR COMPLIANCE.
- THE CONTRACTOR SHALL ROPE AND ROD ALL CONDUITS INTENDED FOR REUSE AT THE EXPENSE OF THE CONTRACTOR. SEPTA SHALL BE PRESENT. IF A CONDUIT CANNOT BE REUSED THIS SHALL BE REPORTED TO THE SEPTA PROJECT MANAGER AT ONCE.


GENERAL TELECOMMUNICATIONS NOTES:

- IF CONFLICTS ARE FOUND BETWEEN THE TELECOMMUNICATIONS DRAWINGS AND ANY OTHER DRAWINGS ASSOCIATED WITH THE PROJECT, NOTIFY THE SEPTA PROJECT MANAGER AT ONCE AND FIELD VERIFY PRIOR TO INSTALLATION OF ANY PATHWAY AND/OR DEVICE.
- JUNCTION AND PULL BOXES ARE NOT NECESSARILY ALL INDICATED. PROVIDE JUNCTION BOXES AND PULL BOXES WHERE MANDATED BY THE NEC, AND AS REQUIRED FOR EASE OF INSTALLATION. PROVIDE BOXES SIZED IN ACCORDANCE WITH ARTICLE 314 OF THE NEC AND PER APPROVED CONTRACTOR COORDINATION DRAWINGS.
- CONCEAL CONDUIT OR CABLE EXTENSIONS TO THE GREATEST EXTENT PRACTICABLE. KEEP SURFACE MOUNTED DEVICES, BOXES, AND EXPOSED SURFACE MOUNTED METAL RACEWAYS TO A MINIMUM AND ONLY AS APPROVED IN ADVANCED BY THE SEPTA PROJECT MANAGER.
- VERIFY ALL DIMENSIONS IN THE FIELD AND REPORT DISCREPANCIES, IF ANY, TO THE SEPTA PROJECT MANAGER FOR CLARIFICATION PRIOR TO STARTING ANY WORK.
- ALL INTERIOR AND EXTERIOR RACEWAY SHALL BE RGS CONDUIT. UTILIZE FMC AND LFMC IN LIMITED LENGTHS AS NECESSARY, OR AS REQUIRED BY THE NEC. USE MINIMUM CONDUIT SIZE OF 3/4", UNLESS OTHERWISE NOTED. DO NOT EXCEED CONDUIT FILL RATIO PER THE NEC.
- PATCH AND REPAIR ALL OPENINGS LEFT IN EXISTING SURFACES BY THE REMOVAL OF EXISTING SURFACE AND OR SEMI-RECESSED BOXES OR RACEWAYS AND FINISH SUCH AREAS TO MATCH ADJACENT SURFACES.
- MAINTAIN MINIMUM BEND RADIUS OF 10 TIMES THE OUTER DIAMETER FOR CONDUITS GREATER THAN 2" DIAMETER AND 6 TIMES THE OUTER DIAMETER FOR CONDUITS EQUAL OR LESS THAN 2" DIAMETER.
- REAM AND BUSH THE ENDS OF ALL CONDUITS. PROVIDE AND LEAVE IN PLACE PULL STRINGS IN ALL EMPTY CONDUITS.
- PROVIDE HANGERS, ANCHORS, MOUNTING HARDWARE, GROUND LUGS AND STRAPS AS REQUIRED TO ENSURE PROPER INSTALLATION OF PATHWAY COMPONENTS. INSTALL ALL COMPONENTS AS PER MANUFACTURER'S RECOMMENDATIONS AND PER ALL APPLICABLE CODES.
- GROUND ALL CONDUITS, CABINETS AND EQUIPMENT AS PER MANUFACTURER'S RECOMMENDATIONS AND PER ALL APPLICABLE CODES.
- PROPERLY LABEL ALL CABLES, RECEPTACLES, CONNECTION BLOCKS AND PATCH PANELS IN ACCORDANCE WITH TIA-606B AND BICSI TDM 13TH EDITION.
- PROVIDE WHITE LABEL WITH TYPE WRITTEN LEGIBLE CHARACTERS, PRINTED WITH NON-SMEAR INK AND INDUSTRIAL GRADE SELF ADHESIVE BACKING. PROVIDE ROOM NUMBERS AND CABLE LENGTHS FOR EACH END OF THE INSTALLED CABLE.
- PRIOR TO SYSTEM ACCEPTANCE, SUBMIT AN AS-BUILT LABEL REPORT PROVIDING THE ROOM NUMBERS AND THE CABLE LENGTHS FOR EACH OF THE INSTALLED CABLES.
- INSTALLATION OF CATEGORY 6 UTP CABLE SHALL BE IN ACCORDANCE WITH EIA/TIA GUIDELINES. CABLE INSTALLATION AND TERMINATIONS THAT DO NOT COMPLY SHALL BE REPLACED BY THE CONTRACTOR AT NO ADDITIONAL COST TO SEPTA.
 - THE MAXIMUM PULLING TENSION FOR A SINGLE CABLE SHALL NOT EXCEED 25 POUNDS.
 - THE MINIMUM BENDING RADIUS OF THE CABLE SHALL NOT BE LESS THAN 4 TIMES THE OUTSIDE DIAMETER OF THE CABLE.
 - THE CABLE SHALL BE INSTALLED WITHOUT KINKS OR TWISTS AND THE APPLICATION OF CABLE TIES SHALL NOT DEFORM THE CABLE BUNDLE. CONDUITS SHALL TRANSITION INTO CABLE TRAYS USING CONDUIT END BELLS. NO CABLE SHALL BE INSTALLED OVER ROUGH CONDUIT EDGES IN ANY TRANSITION.
 - STRIP BACK ONLY AS MUCH CABLE JACKET AS IS REQUIRED TO TERMINATE THE CABLE. CABLE PAIRS SHALL NOT BE UNTWISTED MORE THAN 1/2 INCH. CABLES SHALL BE TESTED PER THE SPECIFICATIONS. CABLES WHICH DO NOT PASS TESTS SHALL BE REPLACED OR RECTIFIED BY THE CONTRACTOR AT NO ADDITIONAL COST.
 - THE CONTRACTOR SHALL NOT INSTALL ANY NEW CATEGORY 6 CABLE AT LENGTHS GREATER THAN 90 METERS FROM PATCH PANEL TO OUTLET BOX. THE CONTRACTOR SHALL BRING ANY CONDITIONS EXCEEDING THE CABLE LIMIT DISTANCE TO THE SEPTA PROJECT MANAGER.




SEPTA
SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY
1524 MARKET ST., 18TH FL.
PHILADELPHIA, PA 19107

DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)
DATE PLOTTED: DATE	BY: (C) (S) (P) (D)



HDR
HDR Engineering, Inc.
Philadelphia, PA



ANSI

NO.	DESCRIPTION	REV.	DATE

COM200

NO. 10 # OF 34
REV. NO. ## OF 453
REV. 1

DATE PLOTTED: 08/22/2025
SCALE: 1:1
DRAWN BY: JL
CHECKED BY: JL

WORK ORDER NO. 276482

PROJECT NUMBER
COM200


COMPUTER FILE NO.: 17AN-COM200

50% SUBMISSION
NOT FOR CONSTRUCTION

STATUS: 50% SUBMISSION

DATE PLOTTED: 10/27/2025

C:\WORKING\PTD\16886817AN\COM201.DWG

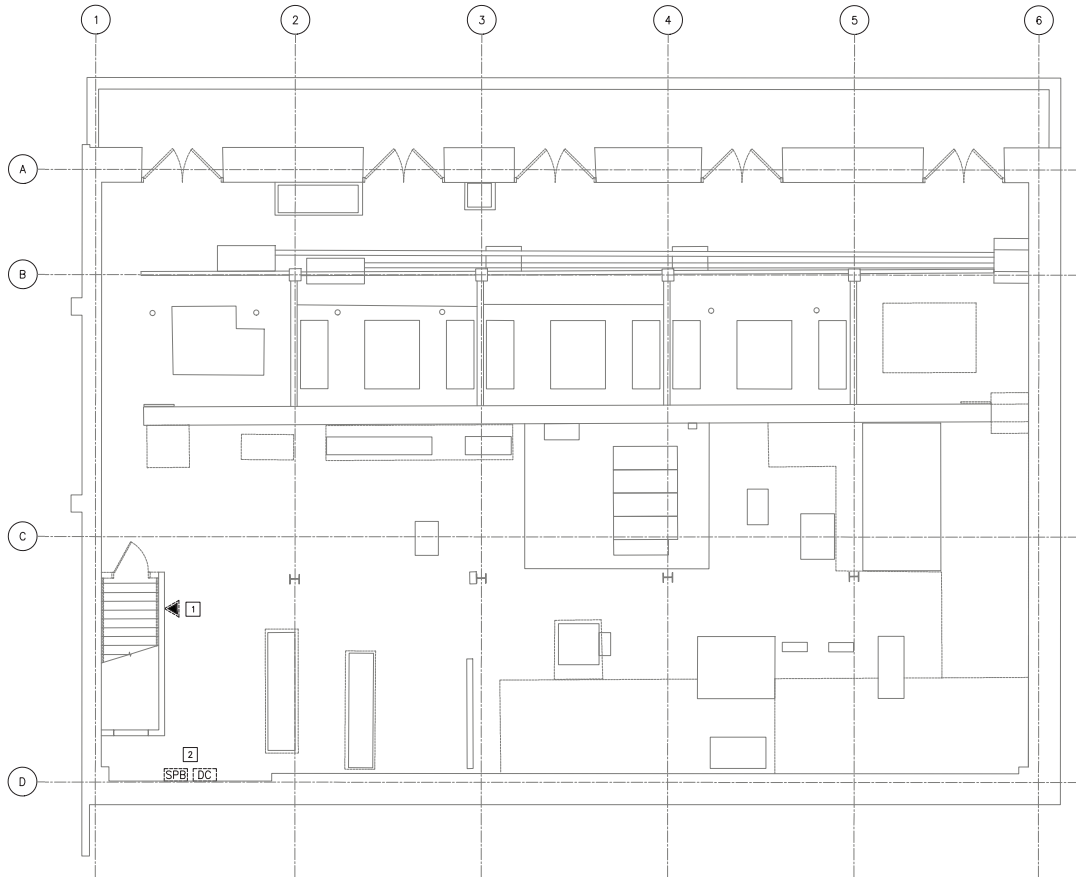

1 DEMOLITION BASEMENT FLOOR PLAN
 SCALE: 3/16" = 1'-0"

6 4 2 0 6
 SCALE: 3/16"=1'0"

50% SUBMISSION
 NOT FOR CONSTRUCTION

GENERAL NOTES:

1. FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS REFER TO DRAWING COM200.
2. REMOVE ALL CONDUITS, CABLES, STATION JACKS AND BOXES RELATED TO TELECOMMUNICATIONS TO SOURCE.
3. DISCARD ALL REMOVED EQUIPMENT.

KEYED NOTES:

- 1 REMOVE PHONE, CABLE AND ASSOCIATED APPURTENANCES TO SOURCE.
- 2 REMOVE DOOR CONTACT, SILENCE PUSH BUTTON, CONDUIT AND WIRING BACK TO SOURCE.



DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED:	
DATE PLOTTED BY:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA




REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
COMMUNICATIONS
 DEMOLITION BASEMENT FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DL
WORK ORDER NO.:	276482	CHECKED BY:	DL
SHEET NUMBER:	COM201		
DWG. NO.:	#	OF	34
SET NO.:	##	OF	453
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-COM201	REV. NO.:	1

DATE PRINTED: 10/27/2025
 STATUS: 50% SUBMISSION

C:\WORKING\PTD\16888\17AN-COM202.DWG

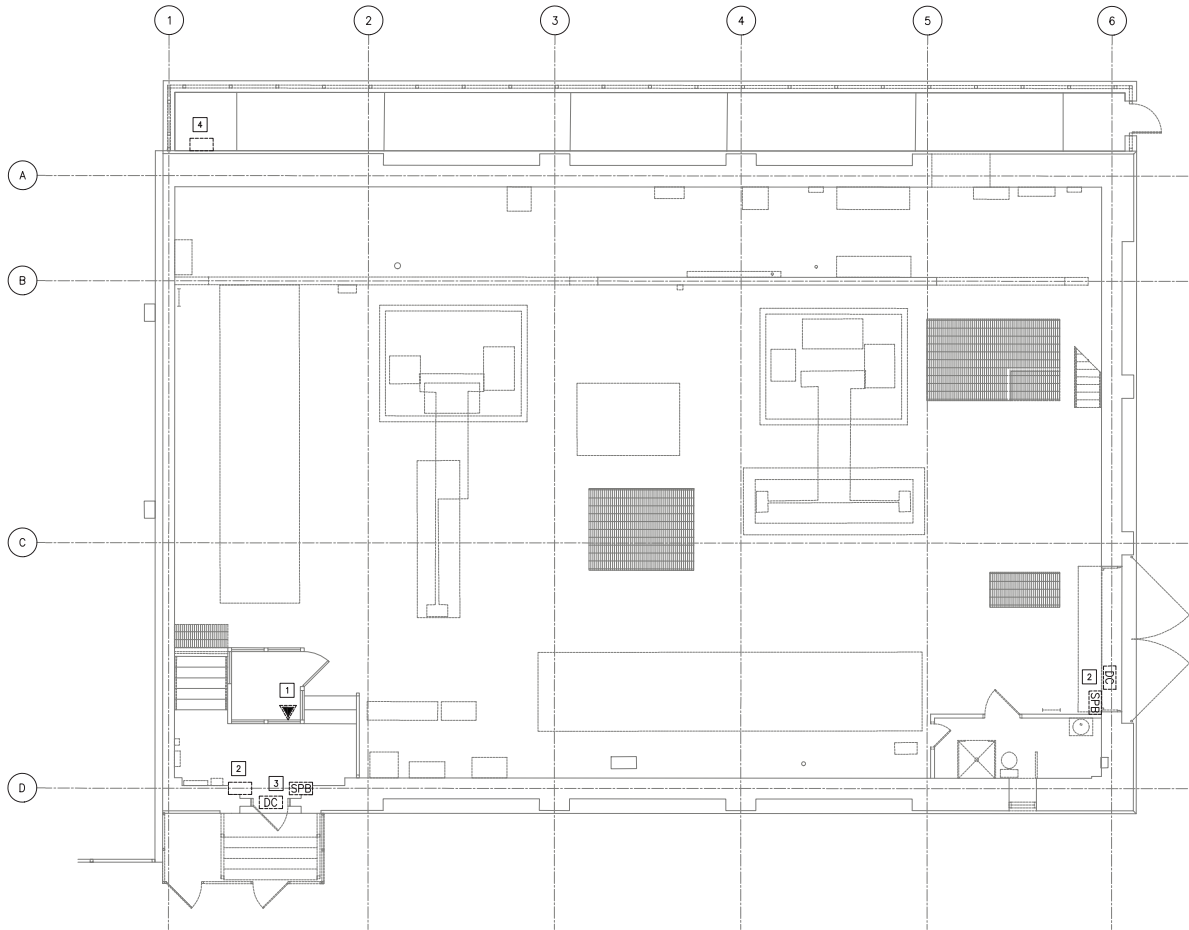

1 DEMOLITION FIRST FLOOR PLAN
 SCALE: 3/16" = 1'-0"

GENERAL NOTES:

1. FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS REFER TO DRAWING COM200.
2. REMOVE ALL CONDUITS, CABLES, STATION JACKS AND BOXES RELATED TO TELECOMMUNICATIONS TO SOURCE.
3. DISCARD ALL REMOVED EQUIPMENT.

KEYED NOTES:

- 1 REMOVE PHONE, CABLE AND ASSOCIATED APPURTENANCES TO SOURCE.
- 2 EXISTING DOOR INTRUSION ALARM PANEL AND ASSOCIATED EQUIPMENT AND WIRING TO BE REMOVED.
- 3 REMOVE DOOR CONTACT, SILENCE PUSH BUTTON, CONDUIT AND WIRING BACK TO SOURCE.
- 4 EXISTING TELECOM DEMARCATION BOX. REMOVE BOX AND PUNCH DOWN BLOCKS. PROTECT INCOMING PHONE SERVICE CABLE FROM LAST TELEPHONE POLE.



50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	
DATE PLOTTED:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
COMMUNICATIONS
 DEMOLITION FIRST FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DL
WORK ORDER NO.:	276482	CHECKED BY:	DL
SHEET NUMBER:	COM202		
DWG. NO.:	#	OF	34
REV. NO.:	##	OF	453
PROJECT NO.:	17AN-COM202		

DATE PLOTTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\WORKING\PTTD\168836\17AN-COM203.DWG



1228 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107

DATE PREPARED:	
DESIGNED BY:	
CHECKED BY:	
DATE:	
PROJECT NO.:	
PROJECT NAME:	

HDR
HDR Engineering, Inc.
Philadelphia, PA

NO.	REV.	DATE	DESCRIPTION	BY	CHKD	APPD.


PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
COMMUNICATIONS
INTERFACE CABINET & CABLE PLANS

SCALE:	AS SHOWN	SCALE FACTOR:	1
DATE:	08/22/2025	DRAWN BY:	MLB
PROJECT NO.:	276482	CHECKED BY:	MLB
SHEET NUMBER:	COM203		
DWG. NO.:	#	OF	34
PT. NO.:	##	OF	453
REV. NO.:			
COMPOSITE FILE NO.:	17AN-COM203	REV. NO.:	

STATUS: 50% SUBMISSION




WEST CUMBERLAND STREET

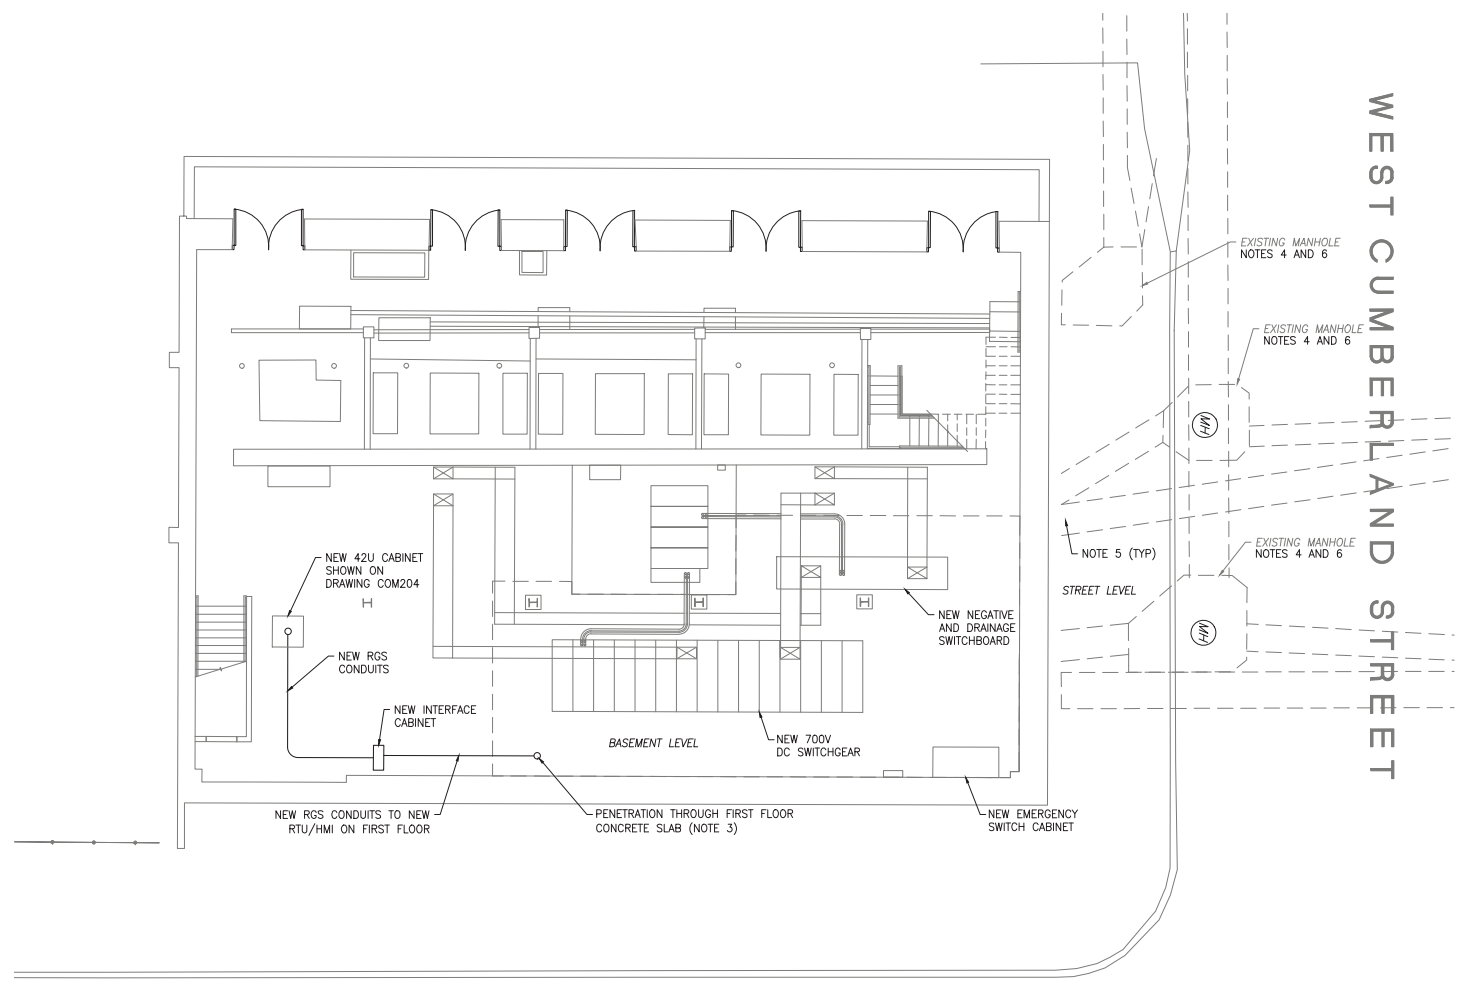


- NOTES:**
1. GRAYSCALE ITEMS ON THIS DRAWING TO REMAIN.
 2. BOLD ITEMS ON THIS DRAWING ARE NEW.
 3. REFER TO DRAWING TP220 FOR LOCATION OF NEW RTU/HMI ON FIRST FLOOR.
 4. INSPECT EXISTING MANHOLES WITH SEPTA SUPERVISION AND DETERMINE EXACT COMMUNICATION CABLE PATHS INTO THE BUILDING.
 5. REMOVE EXISTING COMMUNICATION CABLES, CONDUITS AND EQUIPMENT ONCE NEW PRODUCTS ARE INSTALLED AND TESTED AS FUNCTIONAL. PULL INTO THE TPSS NEW FIBER OPTIC CABLE. (BY SEPTA) FROM AN EXISTING MAN-HOLE OFF WEST CUMBERLAND STREET.
 6. REMOVE FROM THE TPSS EACH INDIVIDUAL ABANDONED COMMUNICATION CABLE OUT TO EXISTING MANHOLES IN COORDINATION WITH EXISTING TPSS EQUIPMENT REMOVALS.

NORTH PARK AVE.



50% SUBMISSION
NOT FOR CONSTRUCTION

C:\WORKING\PTD\18888\17AN-COM204.DWG

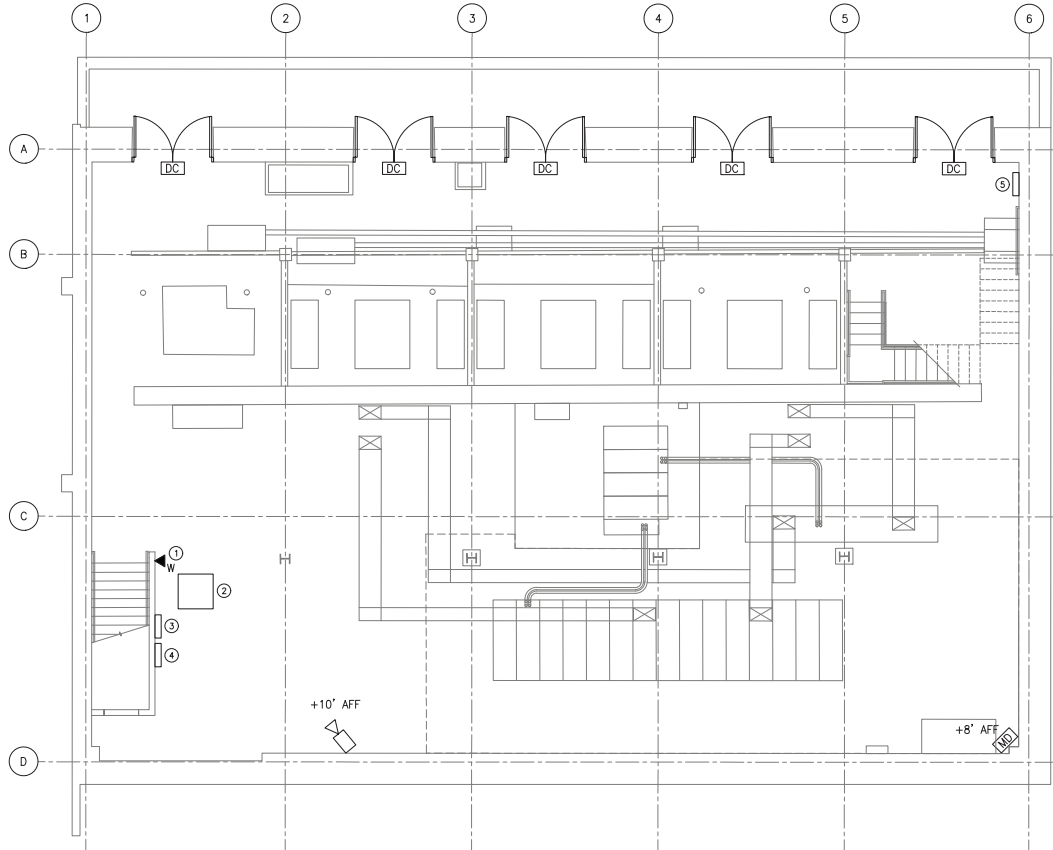


1 BASEMENT PROPOSED FLOOR PLAN
SCALE: 3/16" = 1'-0"

GENERAL NOTES:

- FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS REFER TO DRAWING COM200.
- COORDINATE ALL FINAL LOCATIONS, MOUNTING HEIGHTS AND DETAILS, EQUIPMENT QUANTITIES WITH SEPTA C&S. ENSURE CAMERA LINE OF SIGHT.

KEYED NOTES:

- NEW TELEPHONE SHALL UTILIZE THE EXISTING INCOMING SERVICE CONNECTION. ALL CABLE SHALL BE IN MINIMUM 3/4" RGS CONDUIT. INSTALL (N) CAT6 CABLE TO (N) TERMINATION 110 BLOCK IN (N) BUILDING ENTRANCE TERMINAL.
- FURNISH AND INSTALL NEW 42U, LOCKABLE CABINET. FURNISH AND INSTALL FOLLOWING COMPONENTS PER SPECIFICATION:
 - CCTV LCD/KEYBOARD CONSOLE.
 - RIGID PC.
 - CAT 6 PATCH PANEL.
 - SHELF MOUNTED MEDIA CONVERTER.
 - 2200VA UPS.
 COORDINATE FINAL EQUIPMENT LIST WITH SEPTA C&S.
- FURNISH AND INSTALL A 12 POSITION TERMINAL BLOCK HOUSED IN A LOCKABLE 8" X 8" X 4" NEMA 3R ENCLOSURE. EXTEND SIGNAL CABLE FROM THE IDS PANEL AND TERMINATE ON TERMINAL BLOCK FOR IDS MONITORING. COORDINATE FINAL CONNECTION TO THE RTU.
- INTRUSION DETECTION PANEL. ALL COMPONENT CABLING SHALL BE IN MINIMUM OF 3/4" RGS CONDUIT. PROGRAM SYSTEM PER SPECIFICATION 13700.
- BUILDING ENTRANCE TERMINAL WITH LIGHTNING PROTECTION AND 110 TELEPHONE BLOCK FOR APPROPRIATE PAIR COUNT IN A LOCKABLE NEMA 3R ENCLOSURE. CREATE (N) PENETRATION THROUGH BUILDING CLOSEST TO TELEPHONE POLE INTO BASEMENT. FIRESTOP/SEAL AROUND CABLE PENETRATION.



50% SUBMISSION
NOT FOR CONSTRUCTION



DATE PLOTTED:	
DATE EXAMINED/ISSUED:	
DATE FOR TRANSMISSION:	
DESIGNER:	
DIRECTOR OF ENGINEERING:	
PROJECT MANAGER:	




REV	DATE	DESCRIPTION	BY	CHKD	APPD


PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATIONS
COMMUNICATIONS
PROPOSED BASEMENT FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DL
WORK ORDER NO.:	276482	CHECKED BY:	
SHEET NUMBER:	COM204		
DWG. NO.:	#	OF	34
REV. NO.:	##	OF	453
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-COM204	REV. NO.:	1


DATE PRINTED: 10/27/2025
STATUS: 50% SUBMISSION

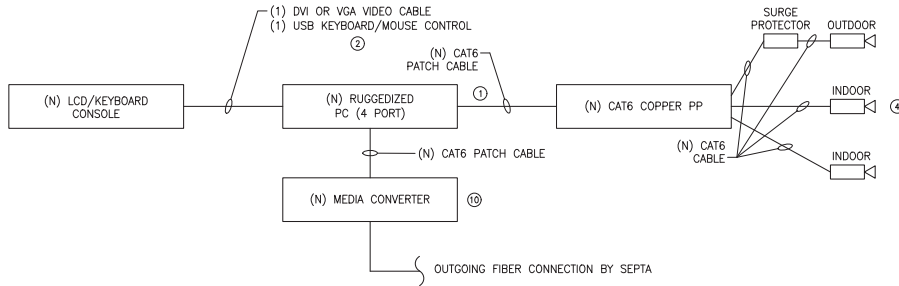


1 **COM206** **CCTV BLOCK DIAGRAM**
SCALE: NOT TO SCALE

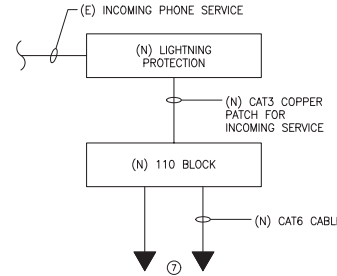

2 **COM206** **VOICE BLOCK DIAGRAM**
SCALE: NOT TO SCALE

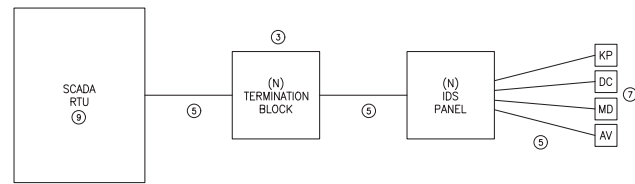

3 **COM206** **INTRUSION DETECTION BLOCK DIAGRAM**
SCALE: NOT TO SCALE

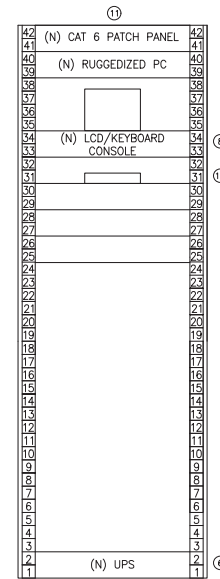

4 **COM206** **TELECOM CABINET ELEVATION**
SCALE: NOT TO SCALE

KEYED NOTES:

- COORDINATE ALL HARDWARE AND FINAL QUANTITIES WITH SEPTA C&S.
- FURNISH AND INSTALL GENETIC PRO BASE SOFTWARE ON PC, (1) CAMERA LICENSE PER CAMERA AND (1) FEDERATION LICENSE FOR THE SITE.
- THE CONTRACTOR SHALL FURNISH AND INSTALL SIGNAL CABLE FROM IDS PANEL TO TERMINATION BLOCK. COORDINATE CONNECTION TO RTU.
- REFER TO DRAWINGS COM204 AND COM205 FOR PROPER QUANTITIES. UTILIZE CMX OUTDOOR JACKET FOR OUTDOOR CAMERAS. OUTDOOR CABLE MAY NOT EXCEED 50 FEET INSIDE BUILDING.
- ALL MULTI-CONDUCTOR CABLE SHALL BE IN 3/4" RGS. ALL SECURITY CABLE SHALL BE LOW IMPEDANCE AND A MINIMUM OF NO. 18 AWG CONDUCTOR SIZE. CONDUCTOR QUANTITIES ARE PER MANUFACTURER'S SPECIFICATION.
- NETWORK ADDRESSABLE UPS. APPROXIMATELY 2200VA AND SHALL LAST MINIMUM 70 MINUTES. PHYSICAL SIZE SHALL MAINTAIN 2 RACK UNITS SPACE WITH NECESSARY BATTERY PACK QUANTITIES.
- REFER TO DRAWINGS COM204 AND COM205 FOR PROPER QUANTITIES.
- FURNISH AND INSTALL RACK-MOUNTED 17" LCD/KEYBOARD CONSOLE.
- REFER TO TRACTION POWER DRAWINGS FOR SCADA RTU CONNECTION DETAILS.
- COPPER TO FIBER MEDIA CONVERTER ON RACK MOUNT SHELF CONNECT CCTV PC FOR CONNECTIVITY OVER SEPTA'S FIBER NETWORK. FINAL FIBER CONNECTION BY SEPTA.
- COORDINATE FINAL RACK LAYOUT WITH SEPTA C&S.



SEPTA PROJECT NO.:	
SEPTA PROJECT OFFICE:	
SEPTA PROJECT OFFICER:	
SEPTA PROJECT MANAGER:	
SEPTA PROJECT ENGINEER:	
SEPTA PROJECT ARCHITECT:	
SEPTA PROJECT MANAGER:	



REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
COMMUNICATIONS
SINGLE LINE DIAGRAM

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	DL
PROJECT NUMBER:	276482	CHECKED BY:	DL
COM206			
DWG. NO.:	#	OF	34
REV. NO.:	##	OF	453
PROJECT FILE NO.:			
COMPUTER FILE NO.:	17AN-COM206	REV. NO.:	


50% SUBMISSION
NOT FOR CONSTRUCTION

C:\WORKING\PTD\16888\17AN-COM206.DWG


DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

C:\WORKING\PTTD\16888\17AN-COM207.DWG

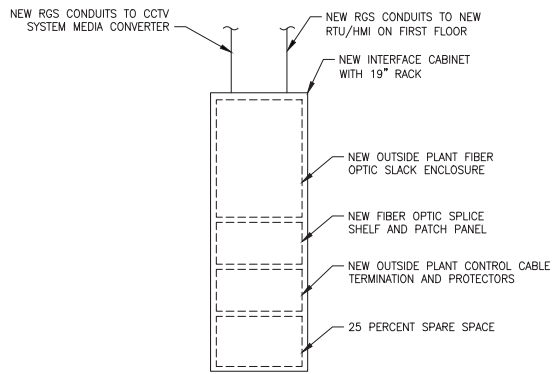

1
COM/INTERFACE CABINETS DETAIL
ELEVATION VIEW
N.T.S.

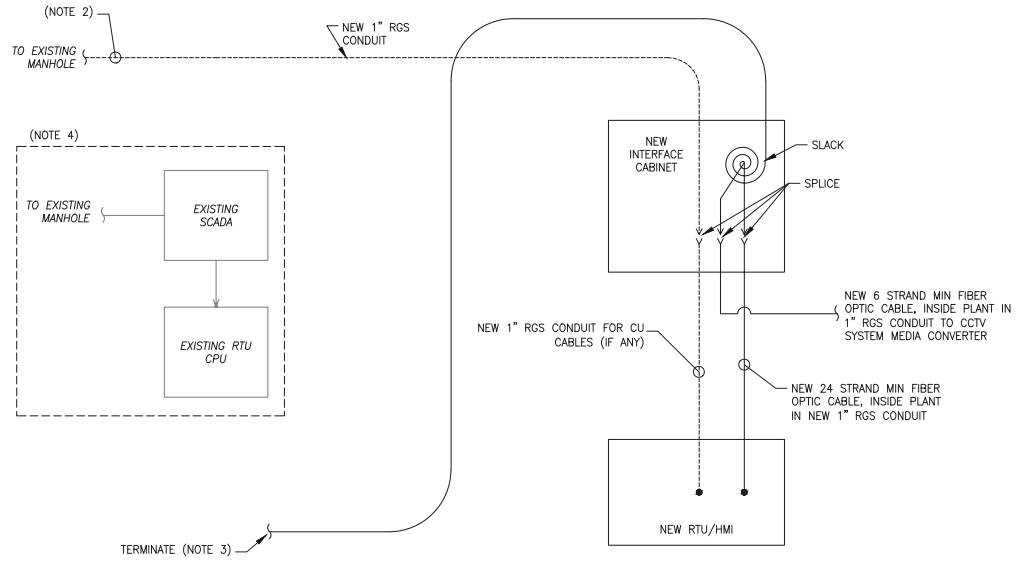

2
COM207
FIBER NODE DIAGRAM
N.T.S.

NOTES:

1. CABINET ARRANGEMENT TO BE FRONT ACCESS ONLY FOR ENCLOSED TIA/EIA 19" RACK.
2. THE CONTRACTOR TO INSTALL NEW CONTROL CABLE FROM AN EXISTING MANHOLE ON WEST CUMBERLAND STREET TO NEW INTERFACE CABINET.
3. THE CONTRACTOR TO TRANSFER OVER FROM EXISTING FIBER TO NEW CONTROL ROOM.
4. REMOVE EXISTING COMMUNICATION CABLES, CONDUITS AND EQUIPMENT ONCE NEW PRODUCTS ARE INSTALLED AND TESTED AS FUNCTIONAL.
5. BOLD ITEMS ON THIS DRAWING ARE NEW.
6. GRAYSCALE ITEMS ON THIS DRAWING TO REMAIN.



DATE PLOTTED: DATE
DATE EXAMINED/ISSUED: DATE
DATE FOR TRANSFER: DATE
DESIGNER: NAME
DIRECTOR OF ENGINEERING: NAME
GROUP: NAME/NUMBER
PROJECT NUMBER

HDR
HDR Engineering, Inc.
Philadelphia, PA


REV	DATE	DESCRIPTION	BY	CHKD	APPD

PARK
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
COMMUNICATIONS
FIBER NODE DIAGRAM

SCALE	SCALE FACTOR
NTS	-
DATE	DRAWN BY: NAME
08/22/2025	CHECKED BY: NAME
WORK ORDER NO.	276482
COM207	
DWG. NO.	# OF
17AN-COM207	34
REV. NO.	OF
##	453
COMPUTER FILE NO.	REV. NO.
17AN-COM207	-


50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PLOTTED: 10/27/2025
STATUS: 50% SUBMISSION

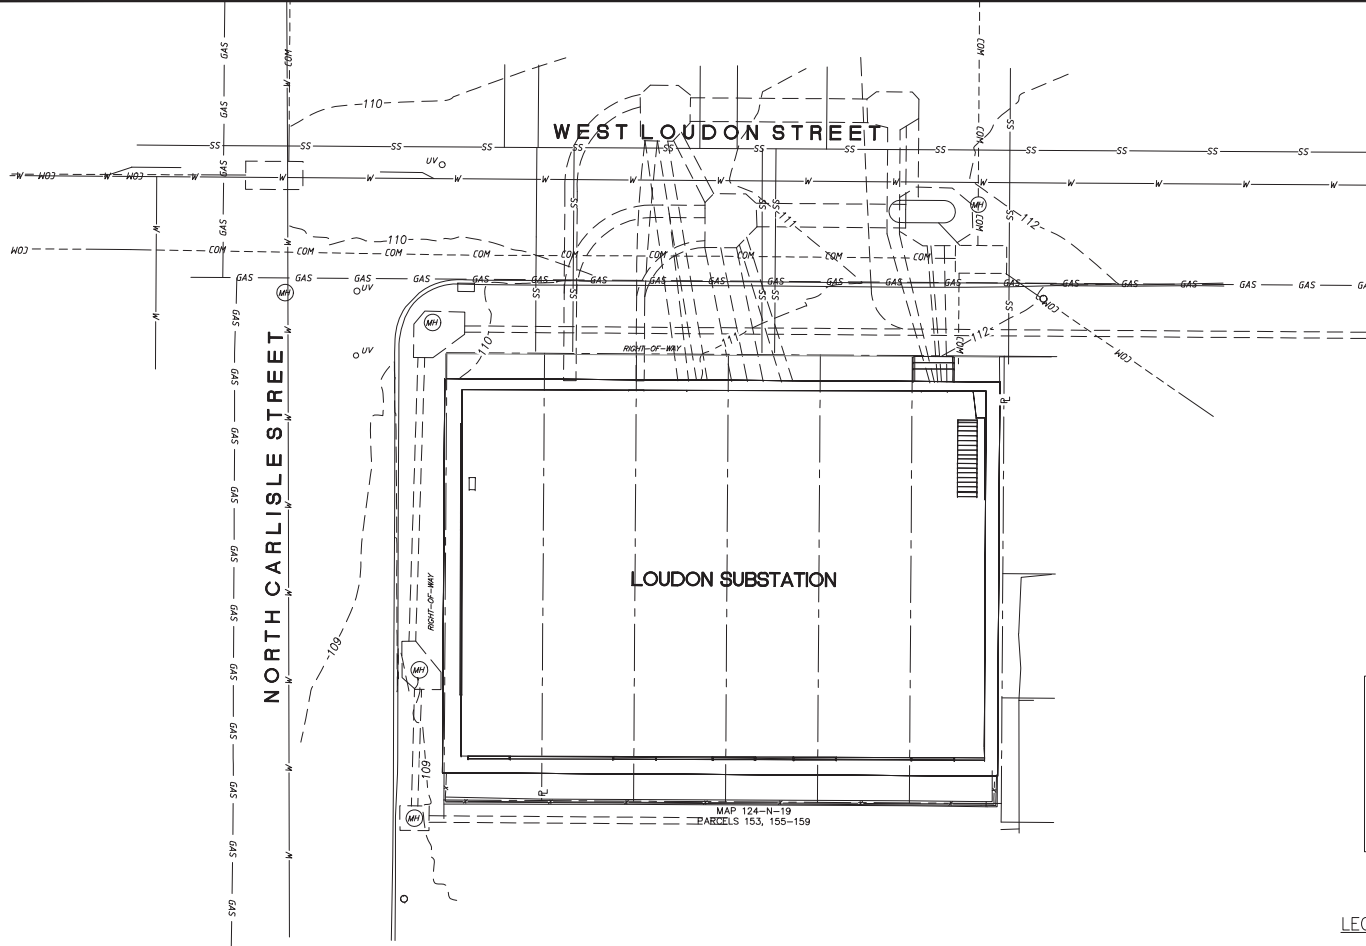

CALL BEFORE YOU DIG
 PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS
 NOTICE FOR CONSTRUCTION PHASE AND 10
 WORKING DAYS IN DESIGN STAGE - STOP
 CALL 1-800-242-1776
 WWW.PA1CALL.ORG
 DESIGN # 2016 358 0706
 CONSTRUCTION # _____

- LEGEND:**
- W ——— EXISTING WATER LINE
 - - - - - COM ——— EXISTING UNDERGROUND COMMUNICATION LINE
 - EU ——— EXISTING UNDERGROUND ELECTRIC
 - - - - - EXISTING DUCT BANK
 - GAS — GAS — EXISTING GAS LINE
 - - - - - SS ——— EXISTING SANITARY/SEWER
 - - - - - P ——— PROPERTY LINE
 - - - - - X ——— EXISTING FENCE
 - (MH) ——— EXISTING MANHOLE



- NOTES:**
- VERTICAL DATUM NAVD 88 AND HORIZONTAL DATUM PENNSYLVANIA STATE PLANE COORDINATE SYSTEM SOUTH ZONE (NAD 83) ESTABLISHED BY GLOBAL POSITIONING SYSTEM METHODOLOGY.
 - UNDERGROUND UTILITIES AND FACILITIES HAVE BEEN PLOTTED FROM MULTIPLE SOURCES AND ARE SHOWN IN APPROXIMATE LOCATIONS. FIELD VERIFY AS NECESSARY.
 - PROPERTY LINE INFORMATION HEREON SHOULD BE CONSIDERED APPROXIMATE AND IS SHOWN FOR INFORMATIONAL PURPOSES ONLY, BASED ON PHILADELPHIA DEPARTMENT OF RECORDS TAX MAP 124-N-19.

50% SUBMISSION
 NOT FOR CONSTRUCTION

HDR Engineering, Inc.
Philadelphia, PA


	BY (CKD) JPD
	DESCRIPTION
	REV DATE

DATE PRINTED: 10/27/2025


LOUDON SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION CIVIL EXISTING CONDITIONS

TITLE: AS SHOWN	SCALE: FACTOR: -
DATE: 08/22/2025	DRAWN BY: HGS
PROJECT NUMBER: 276494	CHECKED BY: SA
C300	
DWG. NO: 1 OF 3	
SHEET NO: 261 OF 452	
PROJECT NO:	
COMPUTER FILE NO: 17AN-C300	REV. NO: -

C:\P\WORKING\17\10\17AN-C300.DWG

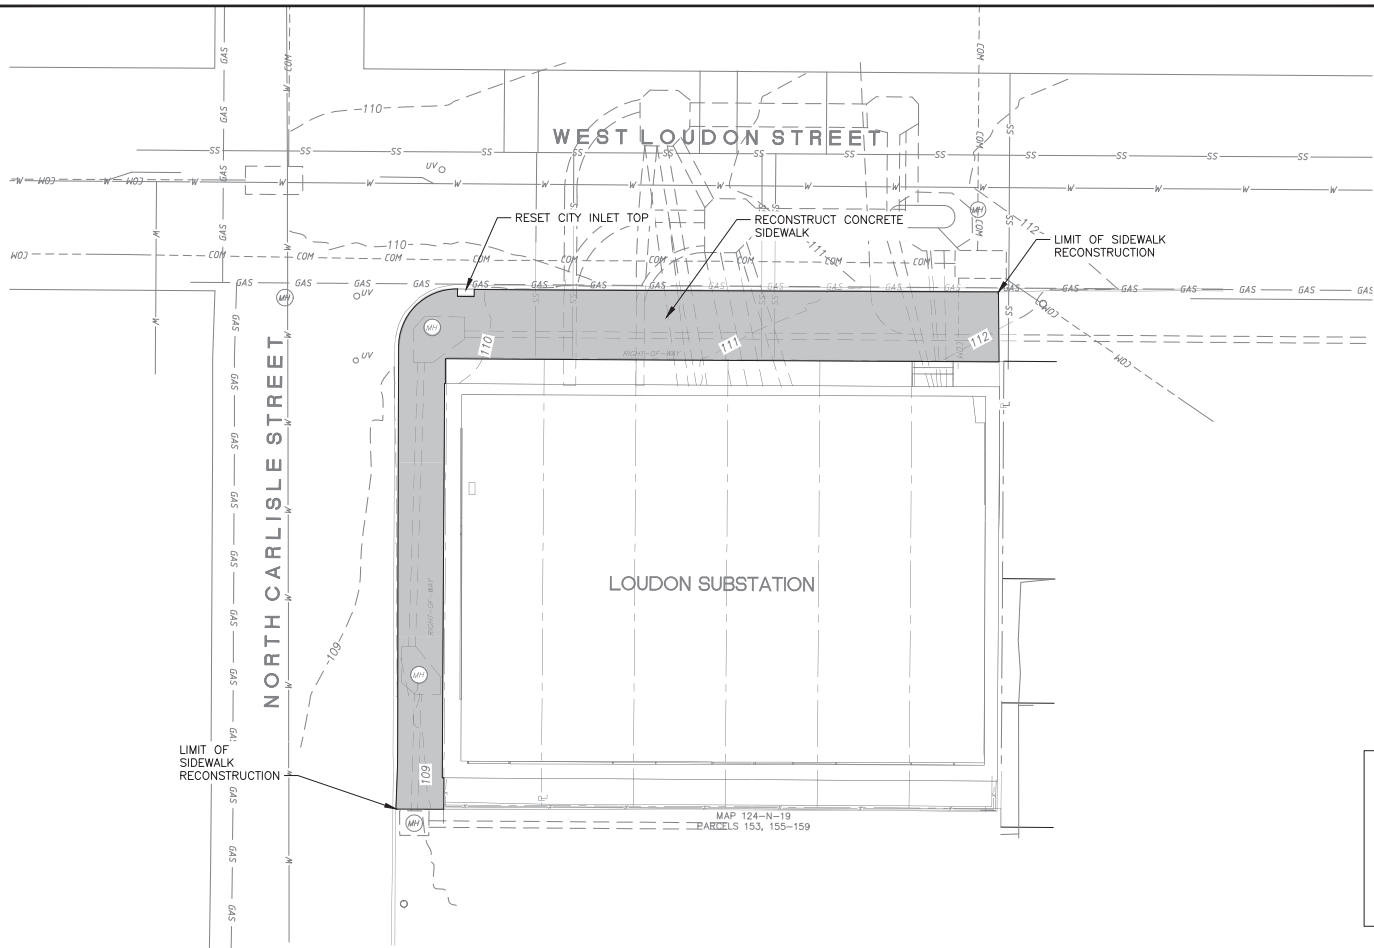

CALL BEFORE YOU DIG
 PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS
 NOTICE FOR CONSTRUCTION PHASE AND 10
 WORKING DAYS IN DESIGN STAGE - STOP
 CALL 1-800-242-1776
 WWW.PA1CALL.ORG
 DESIGN # 2016 358 0706
 CONSTRUCTION # _____



- LEGEND:**
- W ——— EXISTING WATER LINE
 - — — — — COM ——— EXISTING UNDERGROUND COMMUNICATION LINE
 - — — — — EU ——— EXISTING UNDERGROUND ELECTRIC
 - — — — — EXISTING DUCT BANK
 - GAS ——— EXISTING GAS LINE
 - SS ——— EXISTING SANITARY/SEWER
 - PL ——— PROPERTY LINE
 - X ——— EXISTING FENCE
 - (MH) ——— EXISTING MANHOLE
 - CONCRETE REPLACEMENT

**50% SUBMISSION
 NOT FOR CONSTRUCTION**

- NOTES:**
1. VERTICAL DATUM NAVD 88 AND HORIZONTAL DATUM PENNSYLVANIA STATE PLANE COORDINATE SYSTEM SOUTH ZONE (NAD 83) ESTABLISHED BY GLOBAL POSITIONING SYSTEM METHODOLOGY.



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
APPROVED BY:	
DATE:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
 REHABILITATION
 CIVIL
 SITE PLAN


TITLE:	AS SHOWN	SCALE FACTOR:	-
DATE:	08/22/2025	DRAWN BY:	MS
DESIGNED BY:		CHECKED BY:	MS
PROJECT NUMBER:	276494		
SHEET NUMBER:	C301		
DWG. NO.:	2	OF:	3
SHT. NO.:	282	OF:	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-C301		
REV. NO.:			

C:\P\WORKING\171\17101338\171AN-C301.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

C:\PW\WORK\GPTT\17\170333817\AN-C302.DWG

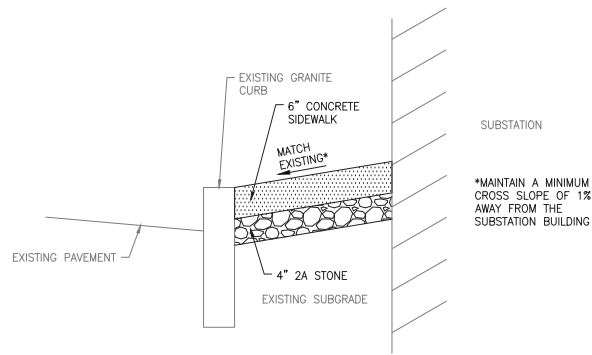

TYPICAL SECTION
CONCRETE SIDEWALK
 N.T.S.

SUBSTATION

*MAINTAIN A MINIMUM CROSS SLOPE OF 1% AWAY FROM THE SUBSTATION BUILDING



 CHIEF ENGINEER/DATE

 CHIEF ENGINEERING OFFICER/DATE

 CHIEF PLAN/PROJECT OFFICER

 SUPERVISOR

 DIRECTOR OF ENGINEERING/DATE

 MANAGER - HIGHWAY/TRANSPORTATION

 PROJECT MANAGER

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
 CIVIL
 CURB & PAVEMENT DETAILS

TITLE	SCALE FACTOR
AS SHOWN	-
DATE	DRAWN BY: MS
08/22/2025	CHECKED BY: JS
WORK ORDER NO.	276494
SHEET NUMBER	C302
DWG NO.	3 OF 3
REV NO.	263 OF 452
PROJECT NO.	
COMPUTER FILE NO.	REV. NO.
17AN-C302	

50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025
 STATUS: 50% SUBMISSION

LEGEND—SYMBOLS:

SYMBOL	DESCRIPTION
	DIMENSION TO CENTER LINE
	DIMENSION TO FINISHED FACE
	DIMENSION TO ROUGH FACE
	DRAWING TITLE
	ELEVATION REFERENCE
	INTERIOR ELEVATION REFERENCE
	DETAIL REFERENCE
	SECTION REFERENCE
	PARTITION TYPE
	REVISION NUMBER
	DOOR NUMBER
	WINDOW NUMBER
	COLUMN GRID NUMBER
	REFERENCE ELEVATION LINE
	EXISTING DOOR
	NEW DOOR
	ACCESSIBLE SYMBOL
	STAIR/RAMP DIRECTION
	ROOF PITCH
	EXISTING SPOT ELEVATION
	NEW SPOT ELEVATION
	NORTH ARROW

LEGEND—HATCH PATTERNS:

SYMBOL	DESCRIPTION
	EARTH
	SAND
	CAST STONE
	CONCRETE
	BRICK
	MASONRY—CMU
	GLAZED CMU
	2-HOUR FIRE RATED CMU WALL
	CERAMIC TILE
	RIGID INSULATION BOARD
	SOFT INSULATION
	WOOD FRAMING—CONTINUOUS
	WOOD BLOCKING
	PLYWOOD
	FINISH WOOD
	STEEL
	ALUMINUM

GENERAL NOTES:

- ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE CONTRACT DOCUMENTS INCLUDING THE SPECIFICATIONS AND THESE DRAWINGS.
- DETAILS SHOWN ARE TYPICAL; SIMILAR DETAILS APPLY TO SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
- THE DRAWINGS INDICATE A SPECIFIC DESIGN INTENT. THIS INTENT IS NOT SUBJECT TO SUBSTITUTION. WHERE SPECIFIC MATERIALS ARE IDENTIFIED AND ARCHITECTURAL STYLES SHOWN, THESE SHALL BE PROVIDED UNLESS APPROVED OTHERWISE.
- ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE COMMONWEALTH OF PENNSYLVANIA CODES, RULES AND REGULATIONS, LOCAL CODES AND ALL OTHER STATE AGENCIES HAVING JURISDICTION OVER ANY PORTION OF WORK SPECIFIED IN THESE DOCUMENTS.
- THE CONTRACTOR SHALL SUBMIT A WORKPLAN FOR SEPTA APPROVAL, SHOWING A DETAILED WORK SCHEDULE.
- THE DIMENSIONS SHOWN ON THE DRAWINGS MAY VARY FROM THE ACTUAL EXISTING DIMENSIONS IN THE FIELD. IT IS, THEREFORE, IMPERATIVE THAT THE CONTRACTOR, PRIOR TO COMMENCEMENT OF WORK, TAKE EXACT MEASUREMENTS TO VERIFY ALL DIMENSIONS SHOWN ON THE DRAWINGS AS WELL AS OBTAIN OTHER NECESSARY DIMENSIONS FOR THE PURPOSE OF PREPARING SUBMITTALS. SHOP DRAWINGS AND ANY OTHER DRAWINGS PREPARED BY THE CONTRACTOR SHALL INCLUDE A STATEMENT CERTIFYING THAT THOSE HAVE BEEN PREPARED IN ACCORDANCE WITH THE FIELD-MEASURED DIMENSIONS.
- THE SEPTA PROJECT MANAGER SHALL BE NOTIFIED IN WRITING OF ANY CONDITIONS THAT VARY FROM THOSE SHOWN ON THE DRAWINGS. THE CONTRACTOR'S WORK SHALL NOT VARY FROM THE DRAWINGS WITHOUT THE EXPRESS WRITTEN APPROVAL OF THE SEPTA PROJECT MANAGER.
- THE CONTRACTOR IS INSTRUCTED TO COOPERATE WITH SEPTA'S REPRESENTATIVES AND ALL OTHER CONTRACTORS PERFORMING WORK ON THIS JOB SITE DURING THE PERFORMANCE OF THIS CONTRACT.
- UNLESS OTHERWISE NOTED ON THE DRAWINGS AND SPECIFICATIONS, ALL FACILITIES SHALL REMAIN IN PLACE AND IN SERVICE DURING DEMOLITION AND CONSTRUCTION UNLESS OTHERWISE NOTED. THE CONTRACTOR SHALL PROTECT, PRESERVE, INCORPORATE, AND TEMPORARILY RELOCATE (IF REQUIRED) AND SUPPORT ALL EXISTING FACILITIES, STRUCTURE, UTILITIES, AND OTHER ITEMS TO REMAIN, SUBJECT TO THE APPROVAL OF THE SEPTA PROJECT MANAGER. THE CONTRACTOR IS TO REPAIR OR REPLACE ANY ITEMS DAMAGED DURING THE COURSE OF WORK TO THE SATISFACTION AND APPROVAL OF THE SEPTA PROJECT MANAGER AT NO ADDITIONAL COST TO SEPTA.
- THE CONTRACTOR SHALL MAINTAIN FLOW FOR ALL EXISTING UTILITIES. COORDINATE ANY REQUIRED SHUTDOWNS WITH THE SEPTA PROJECT MANAGER.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND INCURRING THE COST OF ALL REQUIRED PERMITS AND CERTIFICATES.
- THE CONTRACTOR SHALL COMPLY WITH ALL REQUIRED PERMITS.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO EXAMINE ALL DRAWINGS AND SPECIFICATIONS, AND COORDINATE WORK WITH ALL OTHER CONTRACTORS AND SUBCONTRACTORS FOR THIS PROJECT.
- THE CONTRACTOR SHALL TAKE REASONABLE CARE TO MAINTAIN A SAFE AND SECURE WORK AREA AT ALL TIMES THROUGH THE USE OF, AMONG OTHER THINGS, SAFETY EQUIPMENT, FENCING, TEMPORARY DIRECTIONAL SIGNAGE AND FALL PROTECTION.
- ACCESS TO THE WORK SITE AND STORAGE OF MATERIALS AND EQUIPMENT ON THE PREMISES OR AS DETERMINED BY SEPTA SHALL BE APPROVED BY THE SEPTA PROJECT MANAGER.
- THE CONTRACTOR SHALL KEEP THE ADJACENT WORK AREAS, STAGING AREAS AND BUILDING ACCESS AREAS CLEAN OF DEBRIS, AND WILL BE RESPONSIBLE FOR ALL MAINTENANCE AND CLEANING OF THESE AREAS DURING THE COURSE OF THE PROJECT.
- SEPTA REQUIRES ALL PERSONNEL WORKING ON THEIR PROPERTY TO HAVE A SEPTA PHOTO IDENTIFICATION. SEPTA WILL ARRANGE TO HAVE THE IDENTIFICATION CARDS MADE AT THE BEGINNING OF THE CONTRACT AND THROUGHOUT THE DURATION OF THE CONTRACT.
- SHOULD UNFORESEEN CONDITIONS OR OTHER CAUSES NECESSITATE CONSTRUCTION DETAILS NOT IN ACCORDANCE WITH THESE DRAWINGS, THE CONTRACTOR SHALL NOTIFY THE SEPTA PROJECT MANAGER.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROCURE AND PAY FOR THE RENTAL EXPENSES AND THE MAINTENANCE OF TRAILERS AND OTHER RENTAL EQUIPMENT FOR THE ENTIRE DURATION OF THE PROJECT. THIS CONSISTS OF BUT IS NOT LIMITED TO ALL LABOR, MATERIAL, EQUIPMENT AND SERVICES REQUIRED.
- WRITTEN DIMENSIONS ON THE DRAWINGS SHALL TAKE PRECEDENCE, SCALING OF DRAWINGS IS PROHIBITED. LARGE SCALE DRAWINGS SHALL TAKE PRECEDENCE OVER SMALL SCALE DRAWINGS.
- ALL LUMBER EXPOSED TO THE ELEMENTS OR IN CONTACT WITH MASONRY SHALL BE PRESSURE-TREATED.
- THE CONTRACTOR IS TO PROTECT ALL AREAS IN SUCH A MANNER AS TO ELIMINATE HAZARDS TO PERSONS AND PROPERTY; TO MINIMIZE INTERFERENCE WITH USE OF ADJACENT AREAS, UTILITIES AND STRUCTURES, OR INTERRUPTION OF USE OF SUCH UTILITIES.
- IF A CHANGE TO THE PROJECT IS REQUIRED, THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING INFORMATION ABOUT IMPACT OF CHANGE ON CONSTRUCTION SCHEDULE.
- ALL FINISH COLORS TO BE DETERMINED BY THE SEPTA PROJECT MANAGER.
- ALL EXISTING CONDITIONS ARE TO BE FIELD-VERIFIED BEFORE COMMENCEMENT OF WORK.
- ALL NEWLY INSTALLED MATERIALS SHALL BE ASBESTOS-FREE.
- ALL SPECIFIED MANUFACTURERS AND MODEL NUMBERS INDICATE BASIS OF DESIGN PRODUCTS. PROPOSED ALTERNATES AND EQUIVALENTS MUST BE REVIEWED AND APPROVED BY THE SEPTA PROJECT MANAGER.
- ALL MATERIALS AND PRODUCTS IN THIS PROJECT MUST COMPLY WITH THE BUY AMERICA ACT.
- THE CONTRACTOR IS RESPONSIBLE FOR SECURITY OF HIS MATERIAL AND PROPERTY.
- THE CONTRACTOR IS RESPONSIBLE FOR ALL TEMPORARY UTILITIES.
- THE CONTRACTOR IS RESPONSIBLE FOR SNOW REMOVAL.
- CONSTRUCTION/TREATMENTS/ETC AT THE SPECIFIC SITE WILL BE SIMILAR AT ALL OTHER LOCATIONS UNDER THE CONTRACT UNLESS OTHERWISE NOTED.

DEMOLITION NOTES:

- DO NOT ALLOW DEMOLISHED OR REMOVED MATERIALS TO DROP, FALL OR IMPACT AGAINST STRUCTURES TO REMAIN. PROTECT ALL STRUCTURES TO REMAIN FROM DAMAGE OF ANY KIND.
- REMOVE ALL DEMOLISHED MATERIAL PROMPTLY FROM SITE.
- AFTER REMOVAL AND PATCHING OF ELEMENTS, THE FINISHED APPEARANCE SHALL MATCH ADJACENT EXISTING SURFACES AND FINISHES.
- NO DIGGING OR EXCAVATION MAY TAKE PLACE PRIOR TO PLACING A PA ONE CALL FOR THE ENTIRE PROJECT SITE. IN ADDITION, NO DIGGING OR EXCAVATION MAY TAKE PLACE PRIOR TO THE LOCATING OF NEAR AND ADJACENT BURIED AND OVERHEAD UTILITIES.
- WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
- WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.

SEPTA
 SUBWAY/RAIL TRANSIT AUTHORITY
 1324 MARKET ST., 15TH FL.
 PHILADELPHIA, PA 19107

DATE PREPARED: _____
 DATE REVISION: _____
 DRAWN BY: _____
 CHECKED BY: _____
 PROJECT NUMBER: _____

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 GENERAL NOTES & LEGENDS

SCALE: 1:1

DATE: 08/22/2025

PROJECT NUMBER: 276494

SHEET NUMBER: _____

TOTAL SHEETS: 1 OF 20

SHEET NO: 264 OF 452

COMPUTER FILE NO: 17AN-A300

50% SUBMISSION
NOT FOR CONSTRUCTION

REV	DATE	DESCRIPTION	BY	CHKD	APPD


ROOM NAME	AREA	FUNCTION	LOAD FACTOR	OCCUPANTS
GROUND FLOOR	4,915	EQUIP	300 SF/PP	16
BATTERY ROOM	130	EQUIP	300 SF/PP	1
BASEMENT	4,973	EQUIP	300 SF/PP	17
TOTAL				34

2018 INTERNATIONAL EXISTING BUILDING CODE
CHAPTER 6 - CLASSIFICATION OF WORK
603.1 ALTERATION LEVEL 2




2018 INTERNATIONAL BUILDING CODE	CODE SECTION	SECTION TITLE	CODE REQUIREMENT	EXISTING	PROVIDED	REMARKS
CHAPTER 3 - USE AND OCCUPANCY CRITERIA	306	USE GROUP	F-1	F-1	F-1	BUILDING IS UNMANNED AND TYPICALLY UNOCCUPIED
CHAPTER 5 - USE AND OCCUPANCY CLASSIFICATION	TABLE 504.3, 504.4, AND 506.2	HEIGHT/AREA	2 ST (55 FT) 15,500 SF	2 ST (51.5 FT) 9,888 SF	2 ST (51.5 FT) 9,888 SF	
CHAPTER 6 - TYPES OF CONSTRUCTION	TABLE 601	FIRE RESISTANCE RATING				
		PRIMARY STRUCTURE	IIB	IIB	IIB	
		BEARING WALLS EXTERIOR	0	0	0	
		BEARING WALLS INTERIOR	0	0	0	
		NON-BEARING WALLS EXT.	SEE TABLE 602	0	0	
		NON-BEARING WALLS INT.	0	0	0	
		FLOOR CONSTRUCTION	0	0	0	
		ROOF CONSTRUCTION	0	0	0	
CHAPTER 7 - FIRE AND SMOKE PROTECTION FEATURES	713.4	SHAFT ENCLOSURE, LESS THAN 4 STORIES	1 HOUR RATED	N/A	N/A	
CHAPTER 8 - INTERIOR FINISHES	TABLE 803.13	INTERIOR WALL AND CEILING FINISHES (NOT SPRINKLERED) ROOMS AND ENCLOSED SPACES	CLASS C	N/A	CLASS C	
		CORRIDORS	CLASS C	N/A	CLASS C	
		EXIT PASSAGEWAYS	CLASS B	N/A	CLASS B	
CHAPTER 9 - FIRE PROTECTION SYSTEMS	903.2.4	GROUP F-1				
		AREA EXCEEDS FIRE AREA LOCATED MORE THAN 3 STORIES ABOVE GRADE	12,000 SF	9,888 SF	9,888 SF	
		COMBINED FIRE AREA	3 STORIES 24,000 SF	2 STORY 9,888 SF	2 STORY 9,888 SF	
CHAPTER 10 - MEANS OF EGRESS	TABLE 1004.5	ACCESSORY STORAGE AREA/ MECHANICAL EQUIPMENT ROOM	300 SF/PER PERSON	34 PERSONS	34 PERSONS	
	1005.3	MINIMUM REQUIRED EGRESS WIDTH				
		STAIRS	0.3" PER PERSON	32"	76"	
		OTHER EGRESS COMPONENTS	0.2" PER PERSON	34"	68"	


2018 - INTERNATIONAL PLUMBING CODE	CODE SECTION	SECTION TITLE	CODE REQUIREMENT	EXISTING	PROVIDED	REMARKS
TABLE 403.1	MINIMUM NUMBER OF PLUMBING FIXTURES					
	WATER CLOSET (MALE/FEMALE)	1 PER 100 PERSONS=	1	1	1	
	LAVATORY (MALE/FEMALE)	1 PER 100 PERSONS=	1	1	1	
	DRINKING FOUNTAIN	1 PER 400 PERSONS=	1	1	1	EXISTING WATER COOLER
	SERVICE SINK	1 PER 100 PERSONS=	1	1	1	

NOTE
1. BUILDING IS UNMANNED AND TYPICALLY UNOCCUPIED.

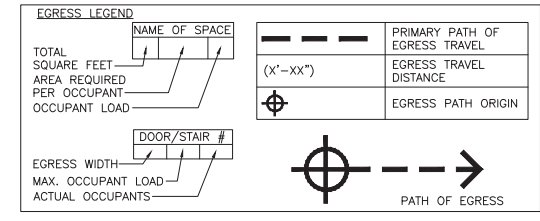

**50% SUBMISSION
NOT FOR CONSTRUCTION**

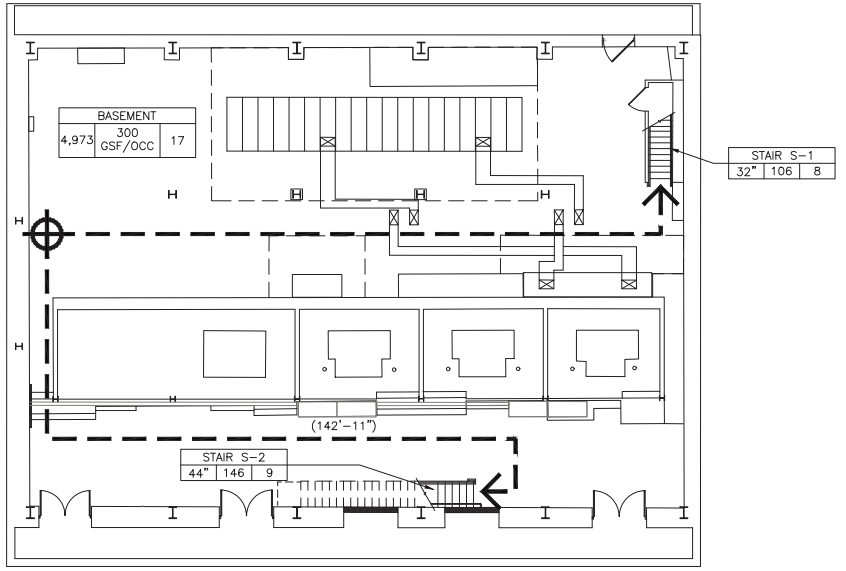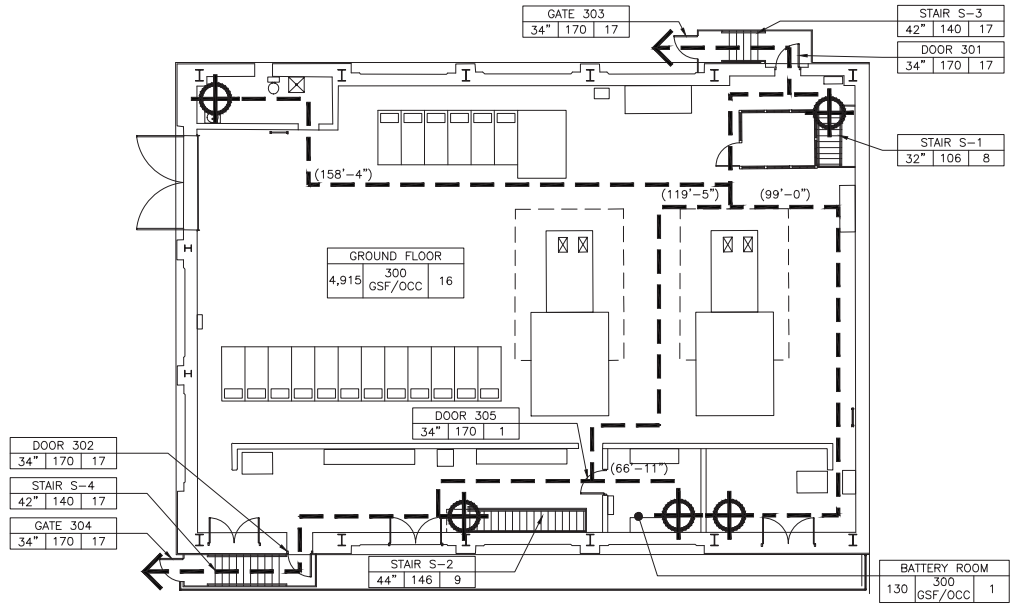


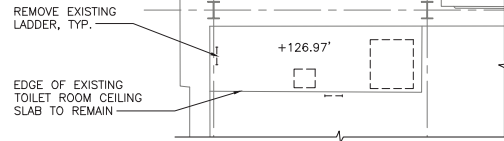

2 NORTHWEST CORNER PLATFORM REMOVAL PLAN
SCALE: 3/16" = 1'-0"


NOTES:

1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
6. FLOOR WILL BE MADE AVAILABLE IN STAGES AS THE EXISTING EQUIPMENT IS REMOVED PER OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN.
7. REMOVE APPROXIMATELY 4200 SQUARE FEET OF FLOOR AT NORTHWEST CORNER. REFER TO STRUCTURAL DRAWINGS.
8. SEAL ALL ABANDONED PENETRATIONS PER DETAIL 5/A318.
9. REPAIR ALL ACTIVE PENETRATIONS PER DETAIL 6/A318.
10. REMOVE EXISTING LIGHT FIXTURES, REFER TO ELECTRICAL DRAWINGS E303 AND E304, TYPICAL.
11. REMOVE ALL EXISTING TRACTION POWER EQUIPMENT, REFER TO TRACTION POWER DRAWINGS TP311 THROUGH TP319, TYPICAL.

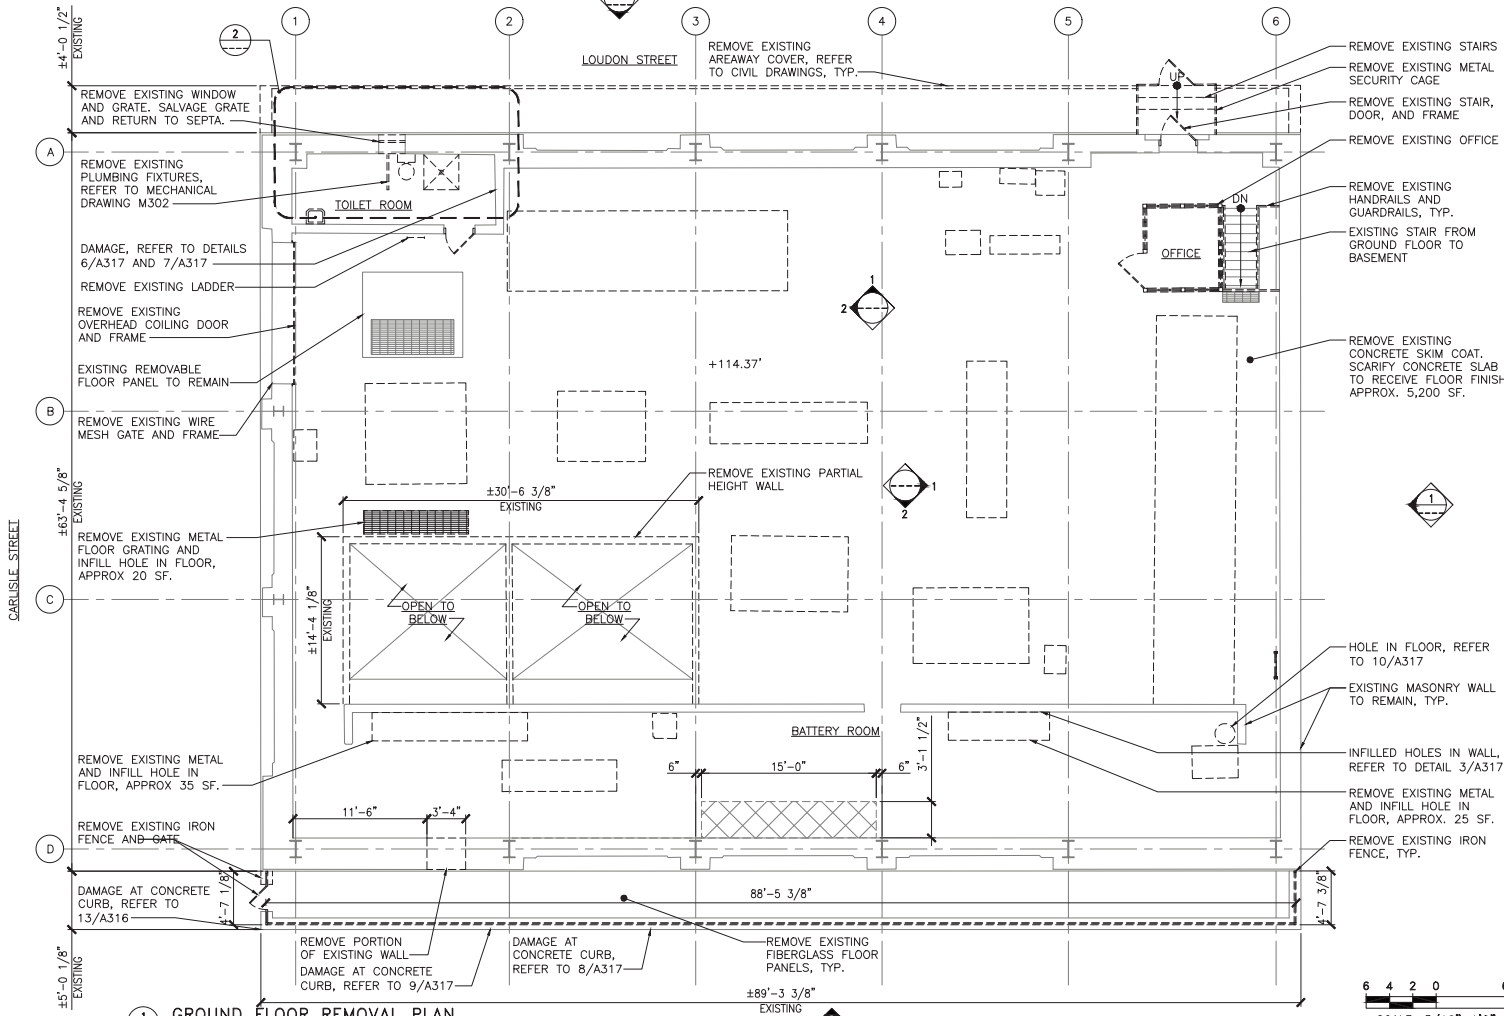

LEGEND:

AREA OF FLOOR TO BE REMOVED, APPROX. 52 SF.



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
PROJECT MANAGER:	



REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDBON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
GROUND FLOOR REMOVAL PLAN

TITLE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	JC
PROJECT NUMBER:	276494	CHECKED BY:	JR
SHEET NUMBER:			
TOTAL SHEETS:	4	OF:	20
REV. NO.:	264	OF:	452
COMPUTER FILE NO.:	17AN-A303	REV. NO.:	


C:\P\WORKING\PT\2025\17AN-A303.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

NOTES:

1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
6. FLOOR WILL BE MADE AVAILABLE IN STAGES AS THE EXISTING EQUIPMENT IS REMOVED PER OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN.
7. REMOVE EXISTING LIGHT FIXTURES, REFER TO ELECTRICAL DRAWINGS, TYP.
8. LEVEL EXISTING BASEMENT FLOOR. REMOVE ALL CURBS, HOUSEKEEPING PADS AND ELEVATED FLOOR AREAS INDICATED. FLOOR SHALL BE LEVEL WITH ADJACENT EXISTING FLOOR AT ELEVATION 101.38'. FLOOR AREA TO BE LEVELED APPROXIMATELY 10,000 SQUARE FEET. REFER TO STRUCTURAL DRAWINGS.
9. SEAL ALL ABANDONED PENETRATIONS PER DETAIL 5/A318.
10. REPAIR ALL ACTIVE PENETRATIONS PER DETAIL 6/A318.
11. REMOVE ALL EXISTING LIGHT FIXTURES, REFER TO ELECTRICAL DRAWINGS E303 AND E304, TYPICAL.
12. REMOVE ALL EXISTING TRACTION POWER EQUIPMENT, REFER TO TRACTION POWER DRAWINGS TP311 THROUGH TP319, TYPICAL.

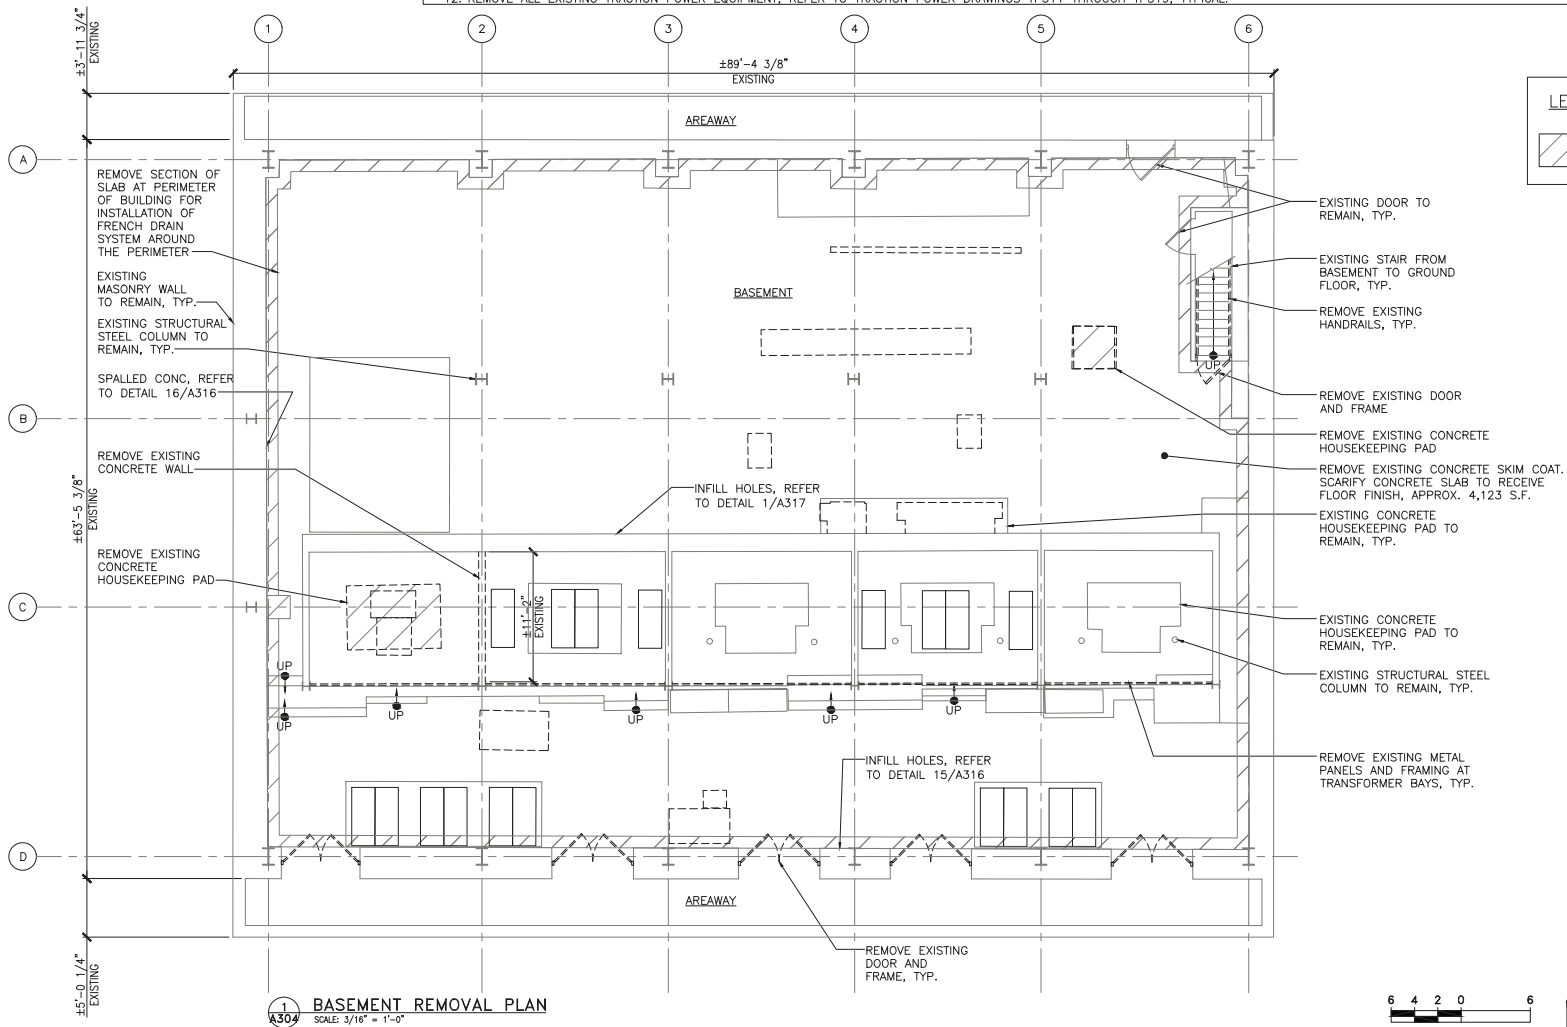

LEGEND:

AREA OF FLOOR TO BE LOWERED, APPROX. 65 S.F.

PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
APPROVED BY:	
PROJECT MANAGER:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI SULLIVAN


REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 BASEMENT REMOVAL PLAN

TITLE:	AS SHOWN	SCALE/FACED:	1:1
DATE:	08/22/2025	DRAWN BY:	JL
		CHECKED BY:	JL
WORK ORDER NO.:	276494		
SHEET NUMBER:	A304		
TOTAL NO. SHEETS:	5	OF	20
SHEET NO.:	265	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A304	REV. NO.:	

50% SUBMISSION
 NOT FOR CONSTRUCTION


C:\PWORKING\1707\17AN-A305.DWG

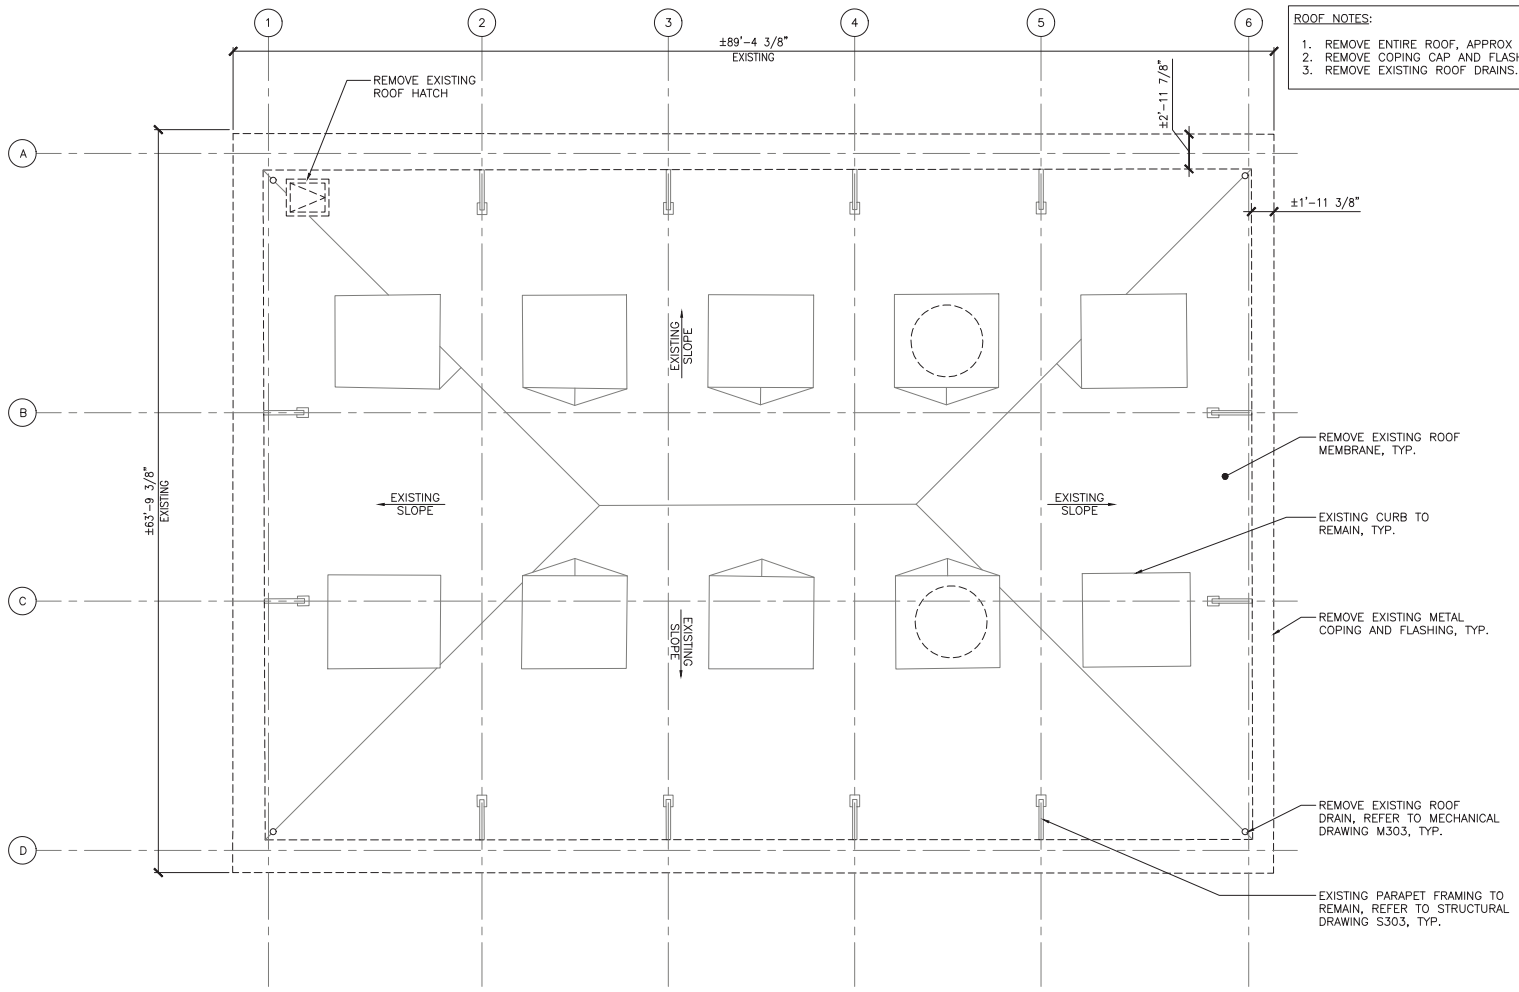


- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 4. WORK SHALL BY PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING A POWER OUTAGE.

- ROOF NOTES:**
1. REMOVE ENTIRE ROOF, APPROX 4880 SF.
 2. REMOVE COPING CAP AND FLASHING, APPROX 306 LF.
 3. REMOVE EXISTING ROOF DRAINS.

1 ROOF REMOVAL PLAN
SCALE: 3/16" = 1'-0"




50% SUBMISSION
NOT FOR CONSTRUCTION



1228 MARKET ST., 17TH FL.
PHILADELPHIA, PA 19107

PROJECT NUMBER: _____ DATE: _____ PROJECT LOCATION: _____ PROJECT NAME: _____	PROJECT MANAGER: _____ PROJECT ENGINEER: _____ PROJECT ARCHITECT: _____ PROJECT CONTRACTOR: _____
--	--




REV	DATE	DESCRIPTION	BY	CHKD	APPD


LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
A-305 ROOF REMOVAL PLAN

TITLE: AS SHOWN DATE: 08/22/2025 WORK ORDER NO: 276494 SHEET NUMBER: _____	SCALE: 1:1 DRAWN BY: JC CHECKED BY: JH SHEET NO: 6 OF 20 PLOT NO: 266 OF 452 PROJECT NO: _____ COMPUTER FILE NO: 17AN-A305 REV: 0
---	--

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

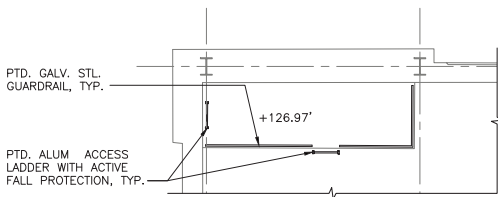


2 NORTHWEST CORNER PLATFORM PLAN
SCALE: 3/16" = 1'-0"

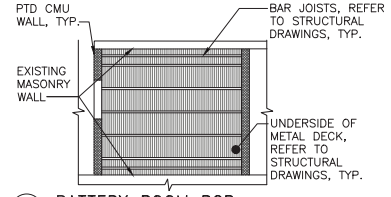


3 BATTERY ROOM RCP
SCALE: 3/16" = 1'-0"

- NOTES:
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
 6. FLOOR WILL BE MADE AVAILABLE IN STAGES AS THE EXISTING EQUIPMENT IS REMOVED PER OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN.
 7. SCRAPE, PREPARE, PRIME, AND PAINT ENTIRE SURFACE OF EXISTING CONCRETE CEILING AND ALL CONCRETE BEAMS.
 8. SCRAPE, PREPARE, PRIME AND PAINT ALL EXPOSED STRUCTURAL STEEL FRAMING, TYP.
 9. ALL LADDERS ARE TO COMPLY WITH REQUIREMENTS PER OSHA 1919. 23, TYPICAL.

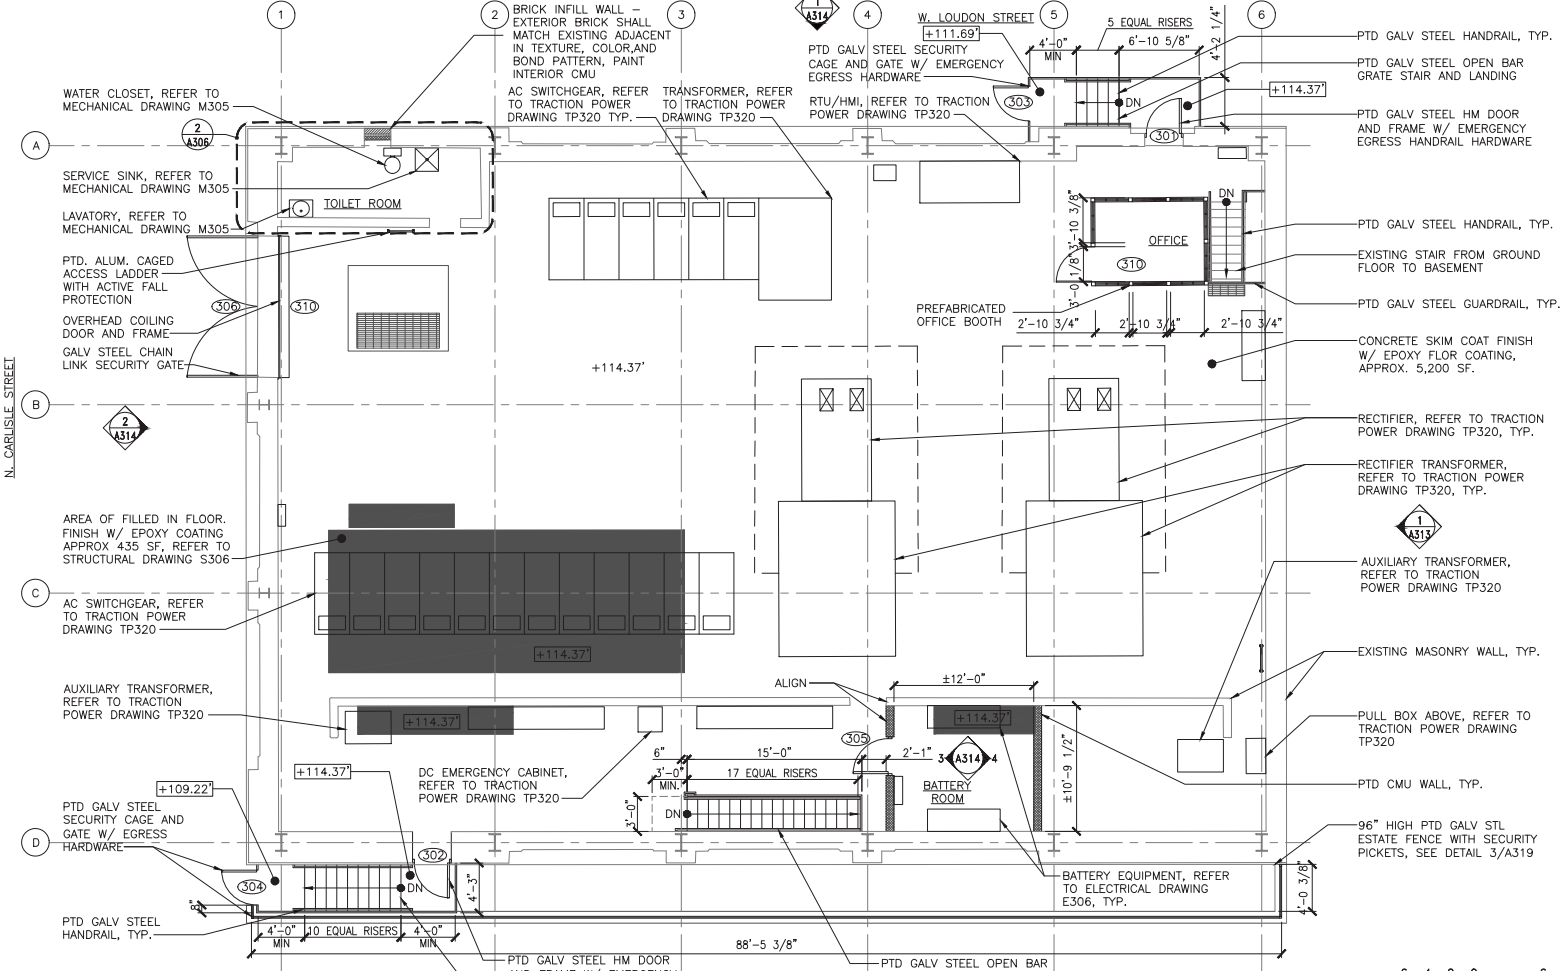

1 GROUND FLOOR PLAN
SCALE: 3/16" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION



PROJECT NUMBER:	DATE:
DESIGNER:	DATE:
CHECKER:	DATE:
APPROVER:	DATE:
PROJECT MANAGER:	DATE:

HDR Engineering, Inc.
Philadelphia, PA

SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
PROPOSED GROUND FLOOR PLAN

TITLE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	KL
PROJECT NUMBER:	276494	CHECKED BY:	JR
SHEET NUMBER:	276494	DATE:	
NO. OF SHEETS:	7 OF 20	DATE:	
PROJECT NO.:	276494	DATE:	
COMPUTER FILE:	17AN-A306	DATE:	

C:\P\WORKING\1707\17AN-A306.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

C:\P\WORKING\1707\17AN-A307.DWG

NOTES:

1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
6. FLOOR WILL BE MADE AVAILABLE IN STAGES AS THE EXISTING EQUIPMENT IS REMOVED PER OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN.
7. SCRAPE, PREPARE, PRIME, AND PAINT ENTIRE SURFACE OF CONCRETE CEILING AND CONCRETE BEAMS.
8. SCRAPE, PREPARE, PRIME AND PAINT ENTIRE SURFACE OF CONCRETE WALLS.



INCORPORATED
PENNSYLVANIA
REGISTRATION
AUTHORITY
DEC 09/09
1224 MARKET ST., 15TH FL.
PHILADELPHIA, PA 19107

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN


DATE: 08/22/2025

BY: JCD / JPD

DESCRIPTION: PROPOSED BASEMENT FLOOR PLAN

DATE: 08/22/2025

BY: JCD / JPD

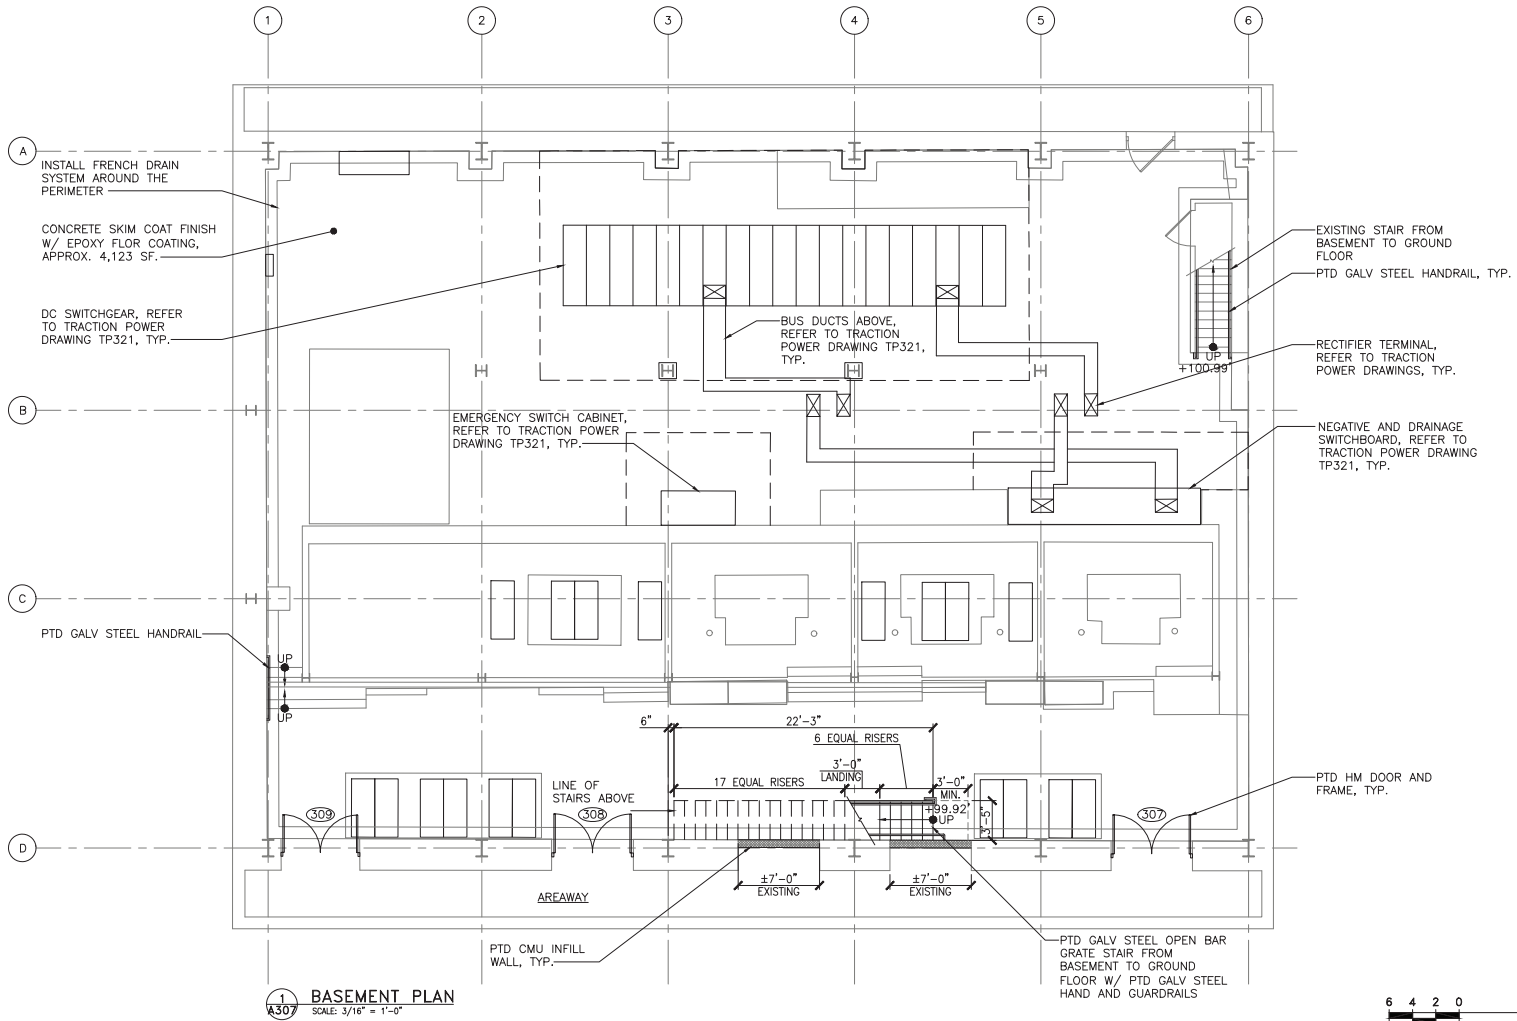

1
A307
BASEMENT PLAN
SCALE: 3/16" = 1'-0"

6 4 2 0 6
SCALE: 3/16" = 1'0"

50% SUBMISSION
NOT FOR CONSTRUCTION

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
PROPOSED BASEMENT FLOOR PLAN

SCALE: 1:1
DATE: 08/22/2025
DRAWN BY: JCD
CHECKED BY: JPD
SHEET NUMBER: 276494
A307
NO. OF SHEETS: 8 OF 20
SHEET NO.: 271 OF 452
PROJECT NO.:
COMPUTER FILE NO.: 17AN-A307

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

C:\PWORKING\1707\17AN-A308.DWG



PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
SCALE:	
PROJECT NAME:	

HDR
HDR Engineering, Inc.
Philadelphia, PA

SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD


LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
PROPOSED ROOF PLAN

TITLE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	JL
WORK ORDER NO.:	276494	CHECKED BY:	JL
SHEET NUMBER:	276494		


DWG. NO.:	9	OF	20
SHT. NO.:	272	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A308		

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 4. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING A POWER OUTAGE.
 5. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.

- ROOF NOTES:**
1. REPLACE ENTIRE ROOF, APPROX 4880 SF.
 2. REPLACE COPING CAP AND FLASHING, APPROX 306 LF.
 3. REPLACE EXISTING ROOF DRAINS.
 4. ROOFING SYSTEM SHALL MEET FM GLOBAL REQUIREMENTS.

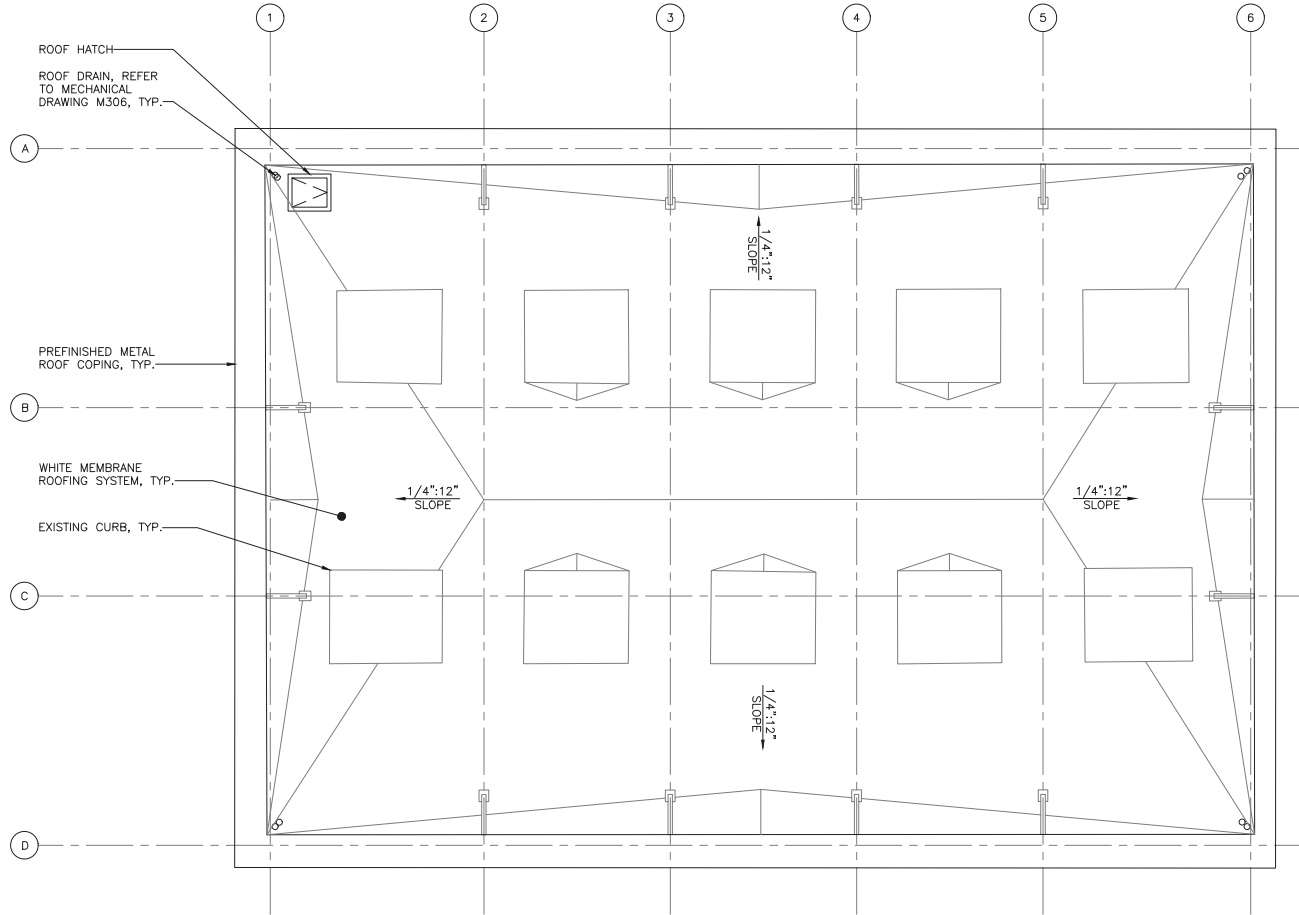

1 ROOF PLAN
SCALE: 3/16" = 1'-0"



50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025
STATUS: 50% SUBMISSION

PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
DATE:	
PROJECT NAME:	

HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI
 SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 EXISTING ELEVATIONS - SHEET 2

TITLE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	AC
		CHECKED BY:	JR
WORK ORDER NO.:	276494		
SHEET NUMBER:	276494		


DWG. NO.:	11	OF	20
PT. NO.:	271	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A310		

NOTES:


1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
5. CLEAN ENTIRE FACADE, EACH ELEVATION.
6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.

BRICK LEGEND:


1. BRICK TYPE 1 = HY-TEX BRICK
2. BRICK TYPE 2 = ENAMELED BRICK - "GREEN"
3. BRICK TYPE 3 = ENAMELED BRICK - "GRANITE MARBLE"
4. BRICK TYPE 4 = FACE BRICK

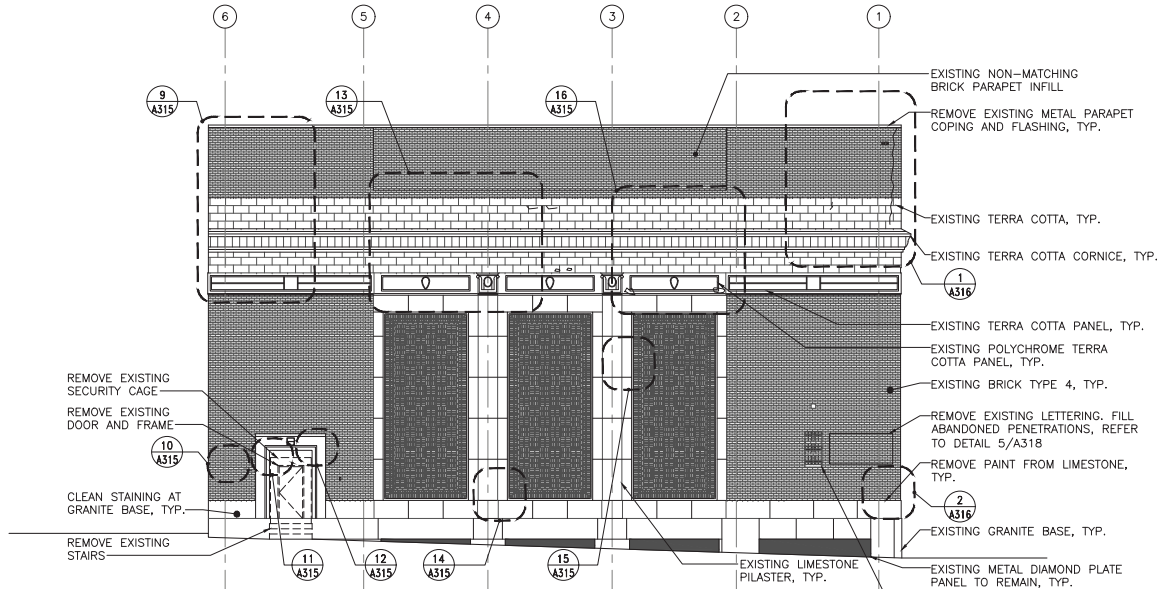

1 EXISTING NORTH ELEVATION
 SCALE: 1/8" = 1'-0"
 REF: A303

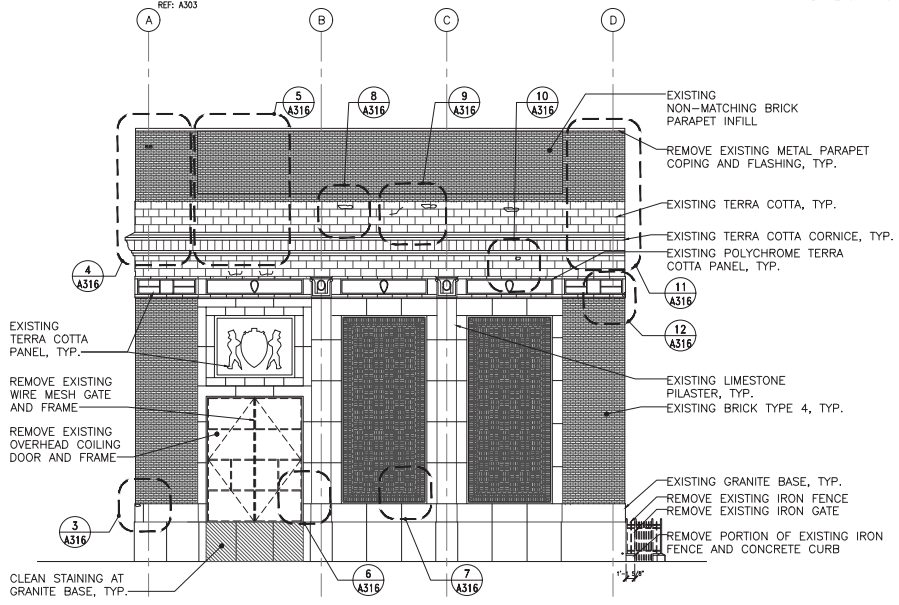

2 EXISTING WEST ELEVATION
 SCALE: 1/8" = 1'-0"
 REF: A303



50% SUBMISSION
 NOT FOR CONSTRUCTION


REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 EXISTING INTERIOR ELEVATIONS - SHEET 1


DATE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	KL
DATE:		CHECKED BY:	JR
PROJECT NUMBER:	276494		
SHEET NUMBER:	A311		
TOTAL NO. SHEETS:	12	OF:	20
SHEET NO.:	272	OF:	452
PROJECT FILE:			
COMPUTER FILE:	17AN-A311		

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
 5. CLEAN ENTIRE FACADE, EACH ELEVATION.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
 8. SCRAPE, PREPARE, PRIME, AND PAINT EXISTING OVERHEAD CRANE, CRANE RAIL, AND ASSOCIATED STEEL SUPPORT FRAMING, TYPICAL.
 9. SCRAPE, PREPARE, PRIME AND PAINT ALL EXPOSED STEEL FRAMING, TYPICAL.
 10. SCRAPE, PREPARE, PRIME, AND PAINT EXISTING MECHANICAL EQUIPMENT PLATFORM AND ASSOCIATED GUARDRAILS.
 11. SCRAPE, PREPARE, PRIME AND PAINT ALL EXPOSED CMU.
 12. SEAL ALL ABANDONED PENETRATIONS PER DETAIL 5/A318.
 13. REPAIR ALL ACTIVE PENETRATIONS PER DETAIL 6/A318.
 14. REMOVE ALL EXISTING LIGHT FIXTURES, REFER TO ELECTRICAL DRAWINGS E303 AND E304, TYPICAL.
 15. REMOVE ALL EXISTING TRACTION POWER EQUIPMENT, REFER TO TRACTION POWER DRAWINGS TP311 THROUGH TP319, TYPICAL.
 16. CONTACT CRANE MANUFACTURER TO VERIFY EXISTING WARRANTY.
 17. CRANE TO BE FULLY INSPECTED TO VERIFY REQUIREMENTS TO BRING CRANE SYSTEM BACK INTO OPERATION. FOR BIDDING PURPOSES, ASSUME COSTS FOR THE FOLLOWING:
 - A. INSPECTION
 - B. CRANE TESTING
 - C. HOIST REPLACEMENT
 - D. REFURBISHMENT OF REMAINING SYSTEM INCLUDING CLEANING AND PAINTING


- BRICK LEGEND:**
1. BRICK TYPE 1=HY-TEX BRICK
 2. BRICK TYPE 2=ENAMELED BRICK-"GREEN"
 3. BRICK TYPE 3=ENAMELED BRICK-"GRANITE MARBLE"
 4. BRICK TYPE 4=FACE BRICK

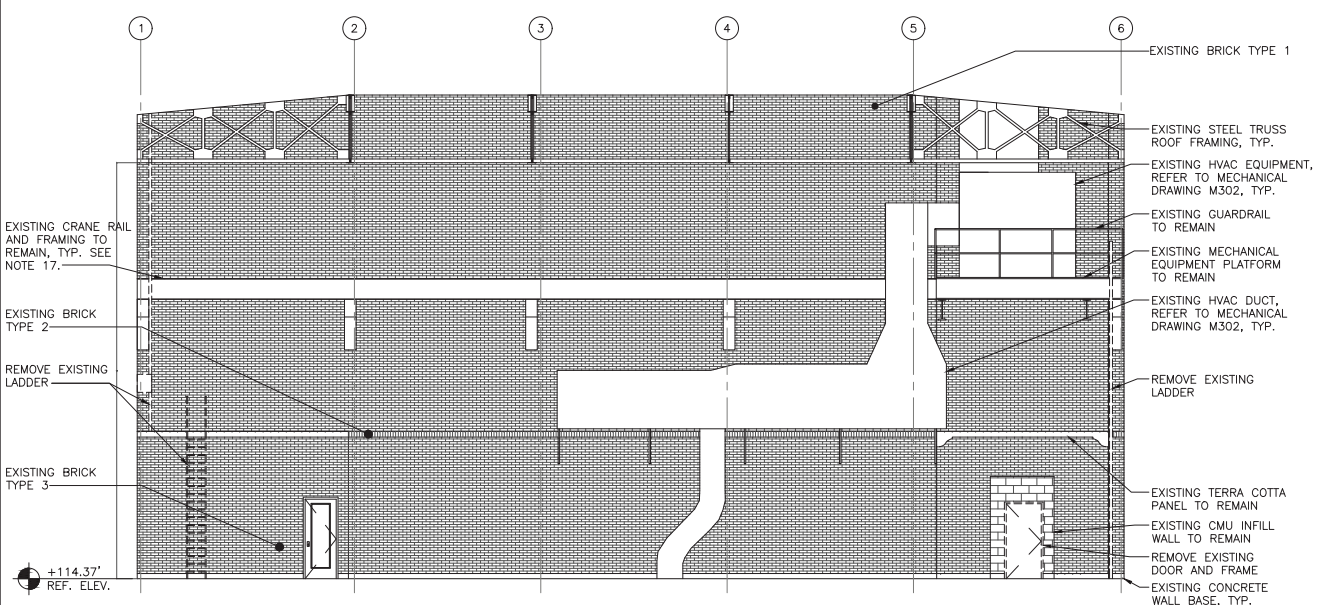

1
A311
 EXISTING NORTH INTERIOR ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A303

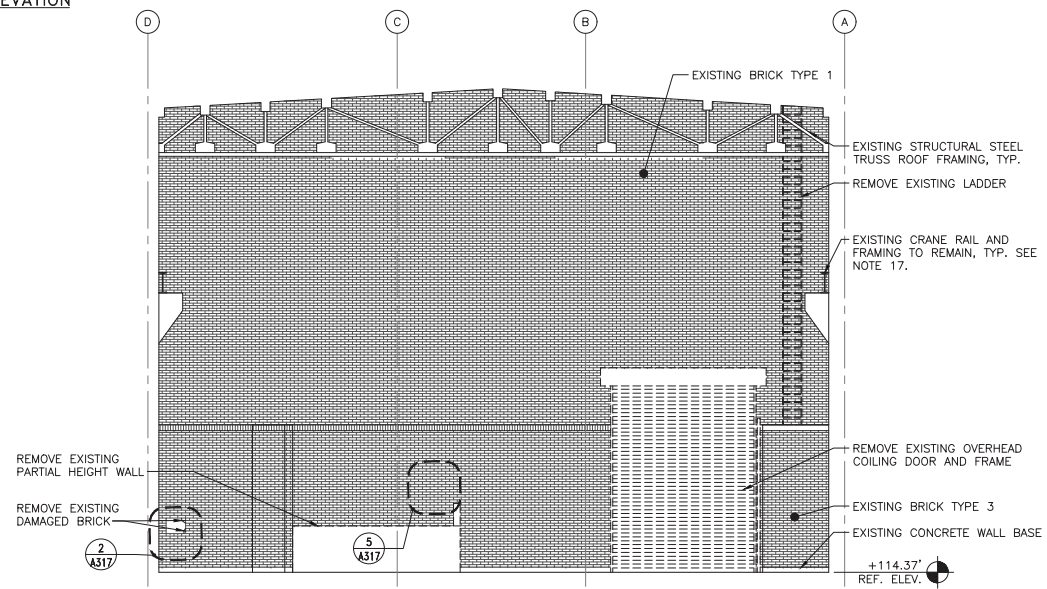

2
A311
 EXISTING WEST INTERIOR ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A303




50% SUBMISSION
 NOT FOR CONSTRUCTION

C:\P\WORKING\17072024\17AN-A311.DWG

DATE PRINTED: 10/21/2025


STATUS: 50% SUBMISSION

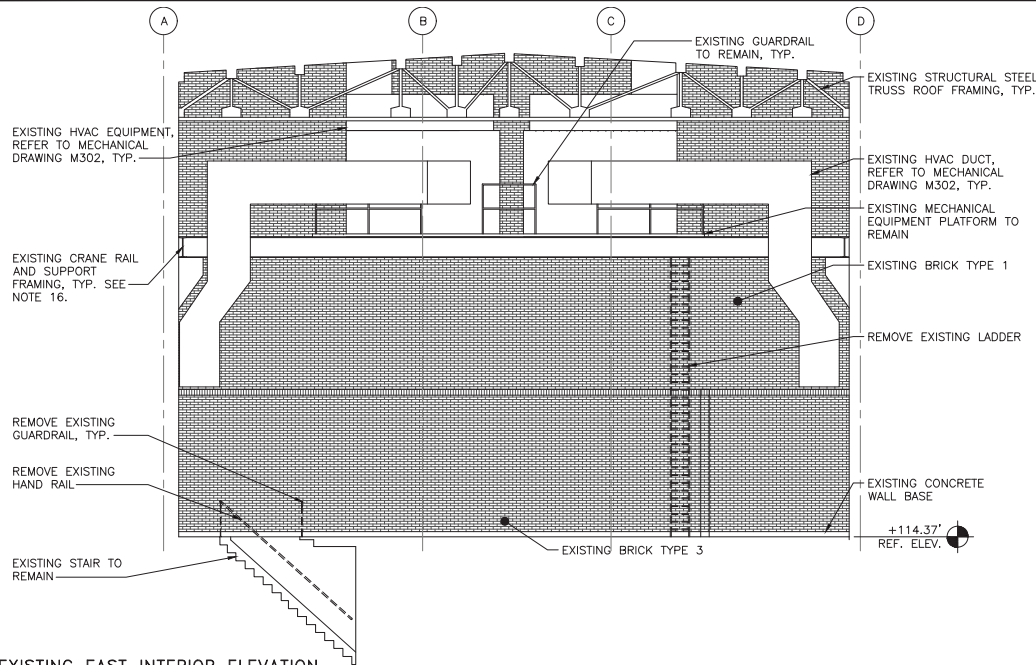


1
A312
EXISTING EAST INTERIOR ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A303

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
 5. CLEAN ENTIRE FACADE, EACH ELEVATION.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
 8. SCRAPE, PREPARE, PRIME, AND PAINT EXISTING OVERHEAD CRANE, CRANE RAIL, AND ASSOCIATED STEEL SUPPORT FRAMING, TYPICAL.
 9. SCRAPE, PREPARE, PRIME AND PAINT ALL EXPOSED STEEL FRAMING, TYPICAL.
 10. SCRAPE, PREPARE, PRIME, AND PAINT EXISTING MECHANICAL EQUIPMENT PLATFORM AND ASSOCIATED GUARDRAILS.
 11. SCRAP, PREPARE, PRIME AND PAINT ALL EXPOSED CMU.
 12. SEAL ALL ABANDONED PENETRATIONS PER DETAIL 5/A318.
 13. REPAIR ALL ACTIVE PENETRATIONS PER DETAIL 6/A318.
 14. REMOVE ALL EXISTING LIGHT FIXTURES, REFER TO ELECTRICAL DRAWINGS E303 AND E304, TYPICAL.
 15. REMOVE ALL EXISTING TRACTION POWER EQUIPMENT, REFER TO TRACTION POWER DRAWINGS TP311 THROUGH TP319, TYPICAL.
 16. CRANE TO BE FULLY INSPECTED TO VERIFY REQUIREMENTS TO BRING CRANE SYSTEM BACK INTO OPERATION. FOR BIDDING PURPOSES, ASSUME COSTS FOR THE FOLLOWING:
 - A. INSPECTION
 - B. CRANE TESTING
 - C. HOIST REPLACEMENT
 - D. REFURBISHMENT OF REMAINING SYSTEM INCLUDING CLEANING AND PAINTING

- BRICK LEGEND:**
1. BRICK TYPE 1 = HY-TEX BRICK
 2. BRICK TYPE 2 = ENAMELED BRICK - "GREEN"
 3. BRICK TYPE 3 = ENAMELED BRICK - "GRANITE MARBLE"
 4. BRICK TYPE 4 = FACE BRICK

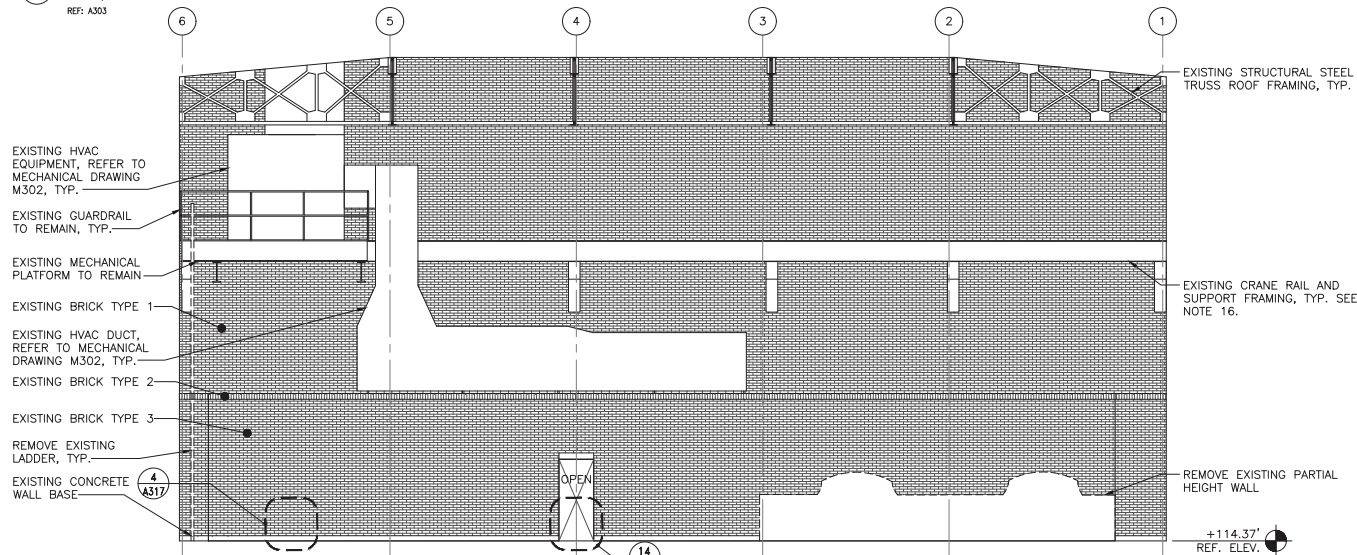

2
A312
EXISTING SOUTH INTERIOR ELEVATION
 SCALE: 3/16" = 1'-0"
 REF: A303



50% SUBMISSION
 NOT FOR CONSTRUCTION

DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED:	
DATE PLOTTED BY:	

HDR
 HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 EXISTING INTERIOR ELEVATIONS - SHEET 2

DATE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	KL
PROJECT NUMBER:	276494	CHECKED BY:	
A312			
DWG NO:	13	OF	20
SHEET NO:	273	OF	452
PROJECT NO:			
COMPUTER FILE:			
17AN-A312			

PROJECT NUMBER:	
DATE:	
DESIGNER:	
CHECKER:	
DATE:	
PROJECT MANAGER:	

HDR Engineering, Inc.
 Philadelphia, PA

SOWINSKI
 SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD


LOUDON
 SUBWAY/ELEVATED TRAINS
 TRACTION POWER SUBSTATION
 REHABILITATION
 ARCHITECTURAL
 PROPOSED ELEVATIONS - SHEET 1

TITLE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	JL
WORK ORDER NO.:	276494	CHECKED BY:	JL
SHEET NUMBER:	276494		


TOTAL NO. SHEETS:	14	OF	20
SHEET NO.:	277	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A313	REV. NO.:	

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
 5. CLEAN ENTIRE FACADE, EACH ELEVATION.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.

- BRICK LEGEND:**
1. BRICK TYPE 1=HY-TEX BRICK
 2. BRICK TYPE 2=ENAMELED BRICK-"GREEN"
 3. BRICK TYPE 3=ENAMELED BRICK-"GRANITE MARBLE"
 4. BRICK TYPE 4=FACE BRICK

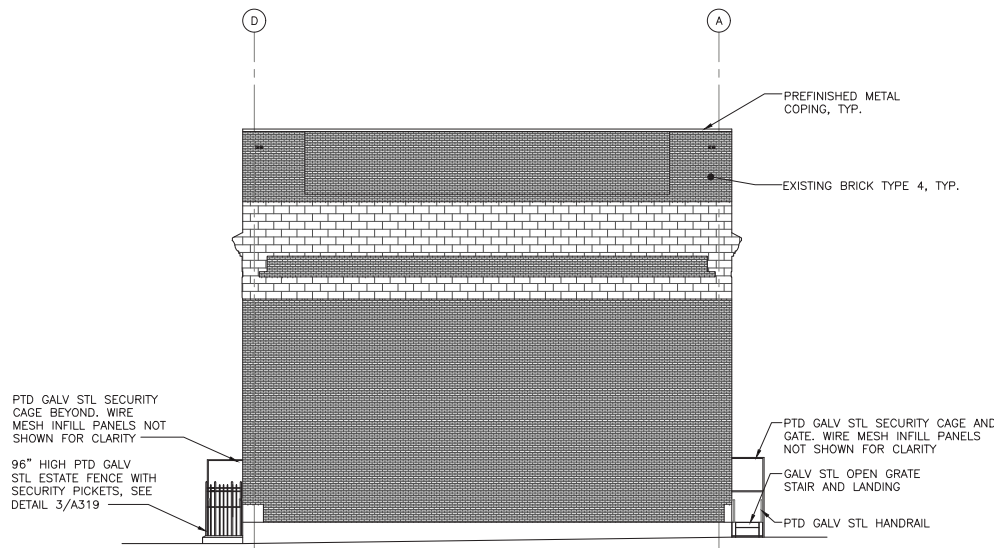


1 EAST ELEVATION
 SCALE: 1/8" = 1'-0"
 REF: A306

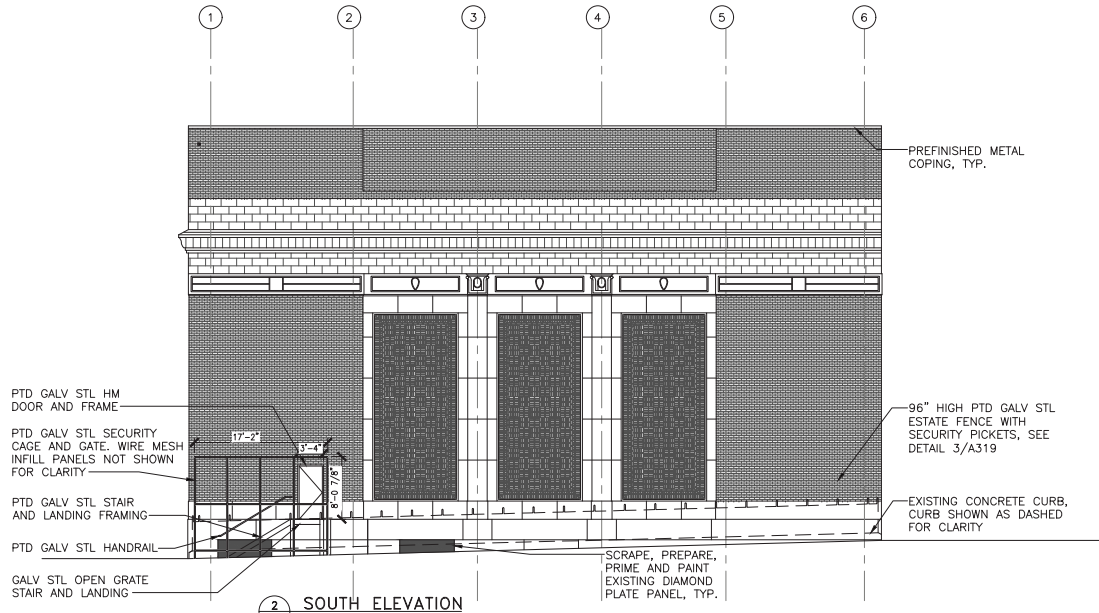

2 SOUTH ELEVATION
 SCALE: 1/8" = 1'-0"
 REF: A306




8 6 4 2 0 8
 SCALE: 1/8" = 1'-0"

50% SUBMISSION
 NOT FOR CONSTRUCTION

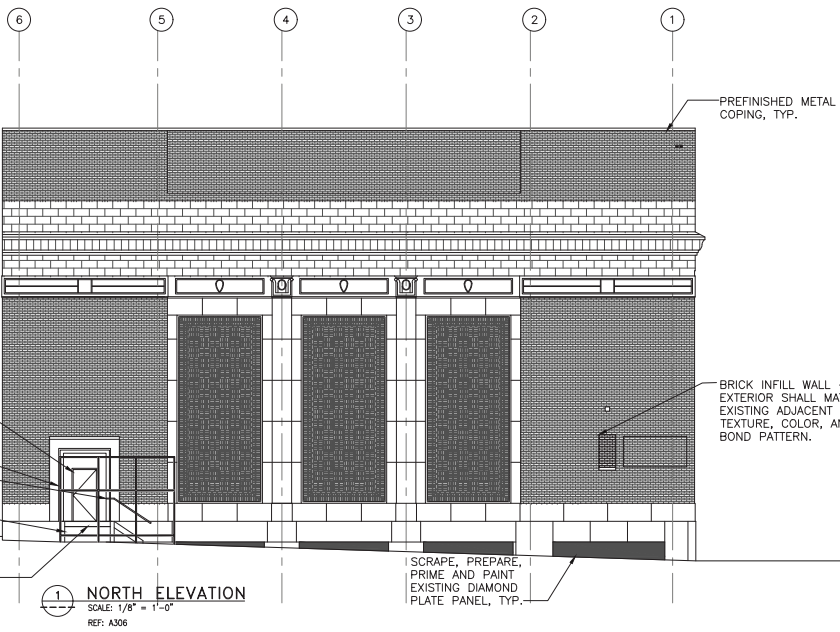

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. RAKE AND REPOINT DAMAGED MORTAR JOINTS, EACH ELEVATION.
 5. CLEAN ENTIRE FACADE, EACH ELEVATION.
 6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
 7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.

- BRICK LEGEND:**
1. BRICK TYPE 1 = HY-TEX BRICK
 2. BRICK TYPE 2 = ENAMELED BRICK - "GREEN"
 3. BRICK TYPE 3 = ENAMELED BRICK - "GRANITE MARBLE"
 4. BRICK TYPE 4 = FACE BRICK

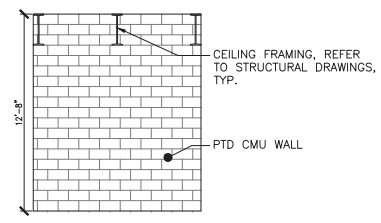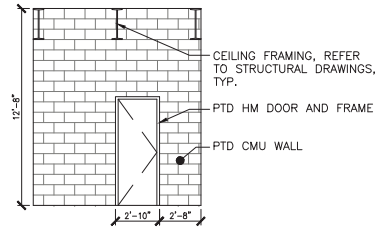

50% SUBMISSION
NOT FOR CONSTRUCTION

1200 MARKET ST., 15TH FL.
 PHILADELPHIA, PA 19107

SHEET NUMBER: 276494
 PROJECT NUMBER: 17AN-A314

DATE: 08/22/2025
 DRAWN BY: JC
 CHECKED BY: JH

SHEET TITLE: LOUDON SUBWAY/ELEVATED TRAINS TRACTION POWER SUBSTATION REHABILITATION ARCHITECTURAL PROPOSED ELEVATIONS - SHEET 2

SCALE: AS SHOWN 1:1
 SHEET NUMBER: 276494
 TOTAL SHEETS: 15 OF 20
 SHEET NO.: 276 OF 452

STATUS: 50% SUBMISSION
 DATE PRINTED: 10/27/2025


C:\P\WORKING\17072025\17AN-A314.DWG

DATE PLOTTED: DATE:	
DATE PLOTTED: OFFICE: NAME:	
DATE PLOTTED: PROJECT:	
DATE PLOTTED: UNIVERSITY:	
DATE PLOTTED: DIRECTOR OF ENGINEERING: NAME:	
DATE PLOTTED: BRIDGE/VEHICLE: IDENTIFICATION:	
DATE PLOTTED: PROJECT: NUMBER:	


REV	DATE	DESCRIPTION	BY	CHKD	APPD

LOUDON
 SUBWAY/ELEVATED TRAINS
 TRACTION POWER SUBSTATION
 REHABILITATION
 ARCHITECTURAL
 PHOTO DETAILS - SHEET 1

SCALE: AS SHOWN	SCALE: FACTOR: 1:1
DATE: 08/22/2025	DRAWN BY: J.C.
ISSUE NUMBER: 276494	CHECKED BY: J.P.
SHEET NUMBER: *****	
TOTAL NO: 16	OF: 20
SHT NO: 219	OF: 452
PROJECT NO: 17AN-A315	

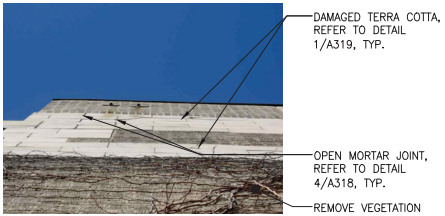


1 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A309

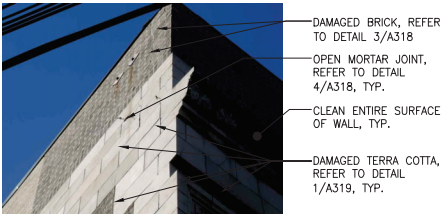


2 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A309




3 DAMAGED PARAPET
 SCALE: NOT TO SCALE
 REF: A309

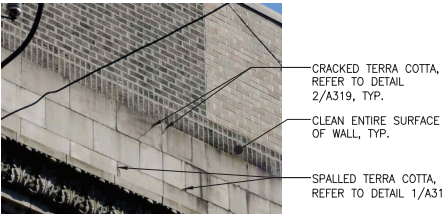


4 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A309

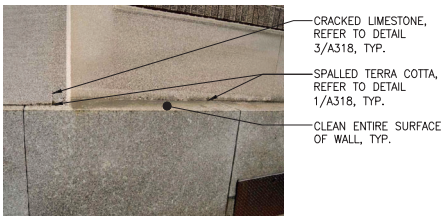


5 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A309

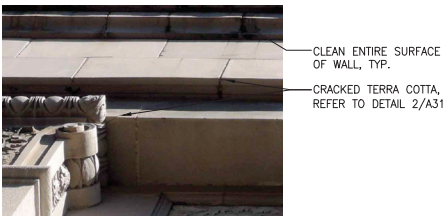


6 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A309

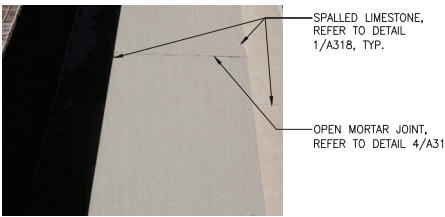


7 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A309

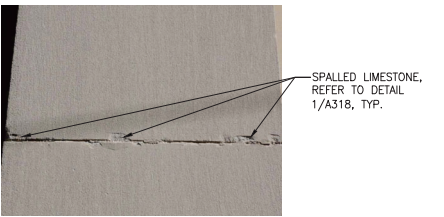


8 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A309

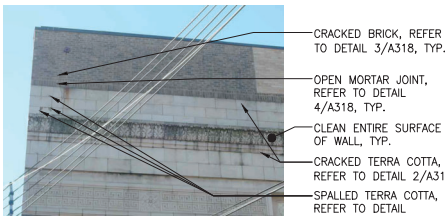


9 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

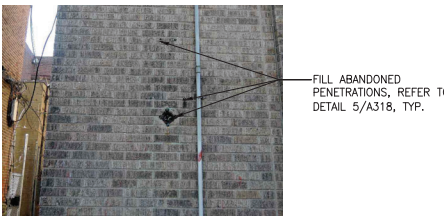


10 DAMAGED BRICK
 SCALE: NOT TO SCALE
 REF: A310

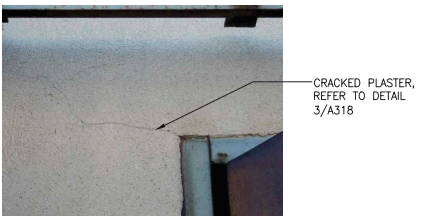


11 CRACKED PLASTER
 SCALE: NOT TO SCALE
 REF: A310

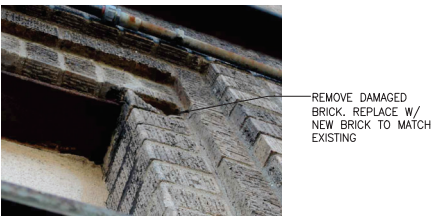


12 DAMAGED BRICK
 SCALE: NOT TO SCALE
 REF: A310

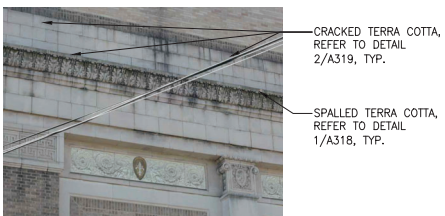


13 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

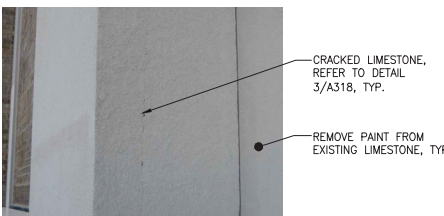

14 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A310

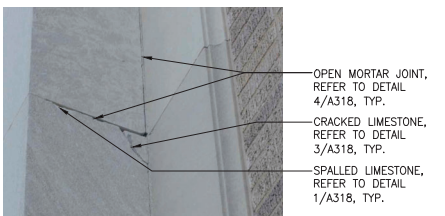

15 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A310

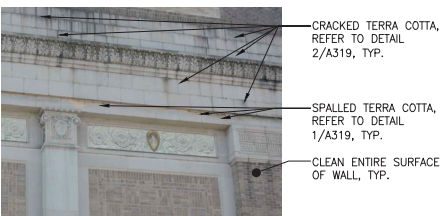

16 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

50% SUBMISSION
NOT FOR CONSTRUCTION

C:\PW\WORKING\17072024\17AN-A315.DWG

DATE PLOTTED: 10/27/2025

STATUS: 50% SUBMISSION

PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
PROJECT MANAGER:	


 HDR Engineering, Inc.
 Philadelphia, PA



 SOWINSKI SULLIVAN

REV	DATE	DESCRIPTION	BY	CHKD	APPD


LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 PHOTO DETAILS - SHEET 2

DATE:	AS SHOWN	SCALE:	1:1
DATE:	08/22/2025	DRAWN BY:	KL
PROJECT NUMBER:	276494	CHECKED BY:	JR
SHEET NUMBER:	*****		
TOTAL NO. SHEETS:	17	OF:	20
SHEET NO.:	280	OF:	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A316	REV. NO.:	1


50% SUBMISSION
NOT FOR CONSTRUCTION

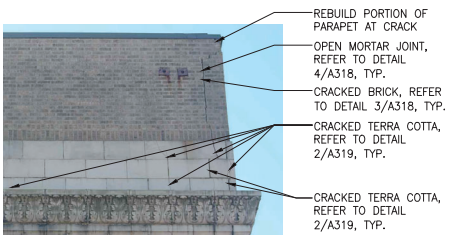


1 DAMAGED PARAPET
 SCALE: NOT TO SCALE
 REF: A310

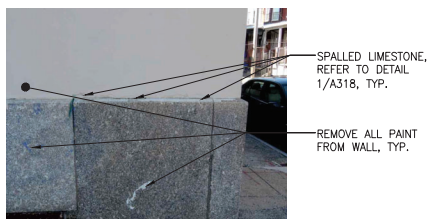


2 DAMAGED LIMESTONE AND GRANITE
 SCALE: NOT TO SCALE
 REF: A310

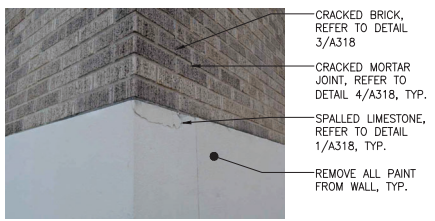


3 DAMAGED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A310

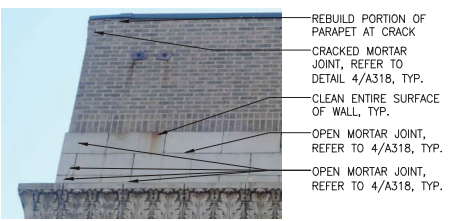


4 DAMAGED PARAPET
 SCALE: NOT TO SCALE
 REF: A310

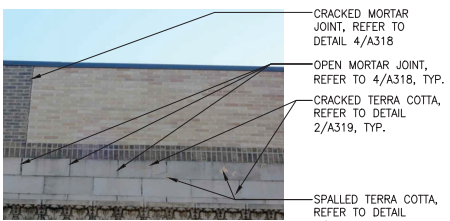


5 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

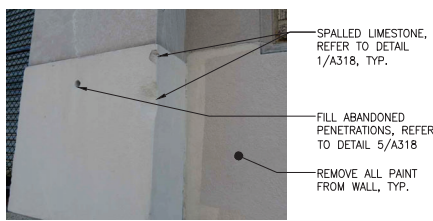


6 SPALLED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A310

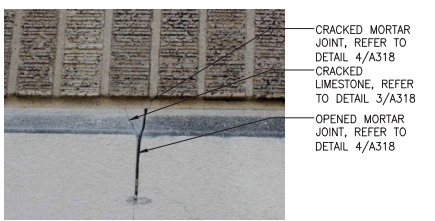


7 CRACKED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A310

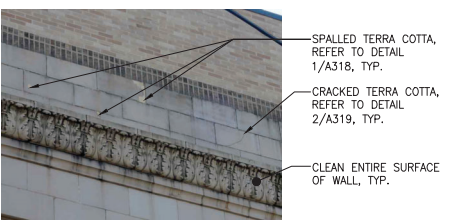


8 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

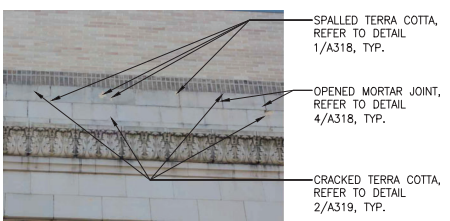


9 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

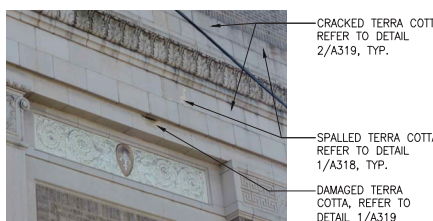


10 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

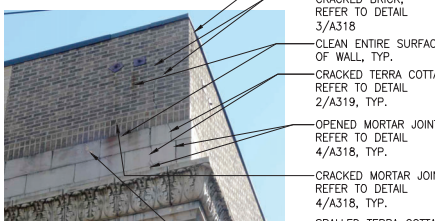


11 CRACKED LIMESTONE
 SCALE: NOT TO SCALE
 REF: A310

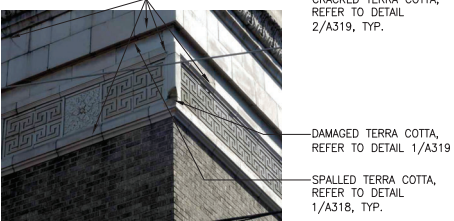


12 DAMAGED TERRA COTTA
 SCALE: NOT TO SCALE
 REF: A310

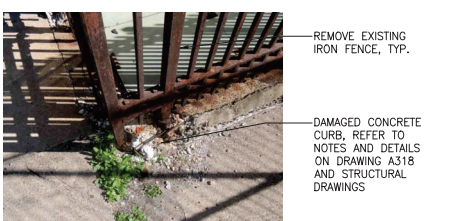


13 DAMAGED CURB
 SCALE: NOT TO SCALE
 REF: A303, A309

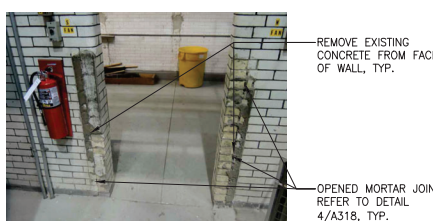

14 DAMAGED BRICK
 SCALE: NOT TO SCALE
 REF: A312

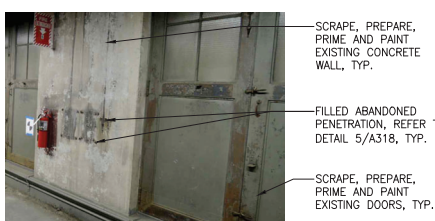

15 ABANDONED PENETRATIONS
 SCALE: NOT TO SCALE
 REF: A304

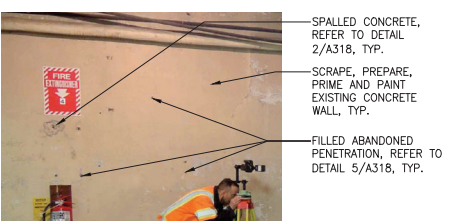


16 SPALLED CONCRETE
 SCALE: NOT TO SCALE
 REF: A304

C:\P\WORKING\17072021\17AN-A316.DWG

DATE PRINTED: 10/27/2025

STATUS: 50% SUBMISSION

C:\PWORKING\1707\17AN-A317.DWG



FILL ABANDONED PENETRATION, REFER TO DETAIL 5/A318, TYP.

SCRAPE, PREPARE, PRIME AND PAINT EXISTING CONCRETE WALL, TYP.

1 ABANDONED PENETRATIONS
SCALE: NOT TO SCALE
REF: A304



REMOVE DAMAGED AND BROKEN BRICK. SQUARE AND PLUMB ALL EDGES OF OPENING

INSTALL PTD. GALV. STL. ACCESS PANEL AT OPENING

2 DAMAGED WALL
SCALE: NOT TO SCALE
REF: A311



FILL ABANDONED PENETRATION, REFER TO DETAIL 5/A318

SPALLED BRICK, REFER TO DETAIL 1/A318

3 ABANDONED PENETRATIONS
SCALE: NOT TO SCALE
REF: A303



REMOVE CONCRETE FROM SURFACE OF WALL, TYP.

OPEN MORTAR JOINT, REFER TO DETAIL 4/A318, TYP.

FILL ABANDONED PENETRATION, REFER TO DETAIL 5/A318

4 DAMAGED BRICK
SCALE: NOT TO SCALE
REF: A312



REMOVE AND REPLACE DAMAGED BRICK, TYP.

FILL ABANDONED PENETRATION, REFER TO DETAIL 5/A318, TYP.

5 DAMAGED BRICK
SCALE: NOT TO SCALE
REF: A311



REPLACE MISSING BRICK WITH BRICK TO MATCH EXISTING, TYP.

6 DAMAGED WALL
SCALE: NOT TO SCALE
REF: A303



SPALLED CONCRETE, REFER TO DETAIL 2/A318

SCRAPE, PREPARE, PRIME AND PAINT EXISTING CONCRETE CEILING, TYP.


7 SPALLED CONCRETE
SCALE: NOT TO SCALE
REF: A303



REMOVE EXISTING IRON FENCE, TYP.

DAMAGED CONCRETE CURB, REFER TO NOTES AND DETAILS ON DRAWING A318 AND STRUCTURAL DRAWINGS


8 DAMAGED CURB
SCALE: NOT TO SCALE
REF: A303



REMOVE EXISTING IRON FENCE, TYP.

DAMAGED CONCRETE CURB, REFER TO NOTES AND DETAILS ON DRAWING A318 AND STRUCTURAL DRAWINGS

9 DAMAGED CURB
SCALE: NOT TO SCALE
REF: A303



REFER TO STRUCTURAL DRAWING S310 FOR CONCRETE REPAIR

10 HOLE IN FLOOR
SCALE: NOT TO SCALE
REF: A303

PROJECT NUMBER:	
DATE:	
DESIGNED BY:	
CHECKED BY:	
APPROVED BY:	
DATE:	

REV	DATE	DESCRIPTION	BY	CHKD	APPD

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	AC
WORK ORDER NO.:	276494	CHECKED BY:	JH
SHEET NUMBER:	*****		
DWG. NO.:	18	OF	20
REV. NO.:	281	OF	452
PROJECT NO.:			
COMPUTER FILE NO.:	17AN-A317	REV. NO.:	

50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PRINTED: 10/27/2025 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
 2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
 3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
 4. PATCHING CEMENT SHALL BE DESIGNED FOR THE REPAIR OF HORIZONTAL, VERTICAL, AND OVERHEAD CONCRETE AND MASONRY SURFACES.
 5. MORTAR SHALL BE COMPATIBLE WITH EXISTING MORTAR IN HARDNESS, TEXTURE AND COLOR.

REPAIR NOTES

- BRICK:**
1. POWERWASH ALL BRICK SURFACES TO REMOVE DIRT AND GRIME.
 2. RAKE AND REPOINT ALL AREAS OF DAMAGED MORTAR JOINTS.
 3. REMOVE AND RE-INSTALL BRICKS AT SEVERE CRACK LOCATIONS.
 4. GRIND OUT CRACK, PREP PRIME AND PAINT METAL SURFACE OF SHELF ANGLE, REMORTAR.
 5. WATERPROOF BRICK WALLS WITH AN APPROVED BREATHABLE, CLEAR SILANE SOLUTION.
 6. REPLACE ALL MISSING, CRACKED, BROKEN AND SPALLED BRICK.
 7. REPAIR CRACKS IN WALLS.
 8. REMOVE AND REBUILD THE BOWING AREA OF BRICK WALL LOCATED IN THE CENTER END OF THE WEST ELEVATION, APPROXIMATELY 150 S.F. WORK AREA, 10 S.F. OF THIS AREA IS TO BE REMOVED AND REBUILT.
 9. REPAIR ALL CRACKED BRICK, MAXIMUM CRACK WIDTH 1/8". REPLACE BRICK WHERE CRACK EXCEEDS 1/8".
 10. REPOINT OPEN MORTAR JOINTS IN EXISTING AREAS AS SHOWN.
 11. REMOVE ALL EXISTING PAINT ON BRICK.

- WALL PENETRATIONS:**
1. REMOVE ABANDONED PROJECTIONS, FILL OPEN HOLES SOLID WITH NON-SHRINK GROUT.
 2. AT SMALL PIPE/CONDUIT WALL PENETRATIONS SEAL VOID BETWEEN PIPE AND WALL WITH BACKER ROD AND SEALANT.
 3. SEAL PERIMETER OF CONDUIT AND SLEEVES.
 4. REMOVE ABANDONED PIPING, FILL OPEN HOLES SOLID WITH NON-SHRINK GROUT.

- STEEL LINTELS:**
1. EXISTING FAILING LINTELS TO BE REMOVED & REPLACED.
 2. RAKE AND RE-CAULK METAL/ MASONRY TIE-IN.
 3. PREPARE RUSTED LINTEL TO BARE METAL, PRIME (1 COAT) AND PAINT (2 COATS).
 4. REMOVE AND REPLACE DAMAGED LINTELS. COORDINATE WITH STRUCTURAL DRAWINGS.

- POWERWASHING, SCRAPING, AND SANDING:**
1. TESTING SHALL BE PERFORMED TO DETERMINE PRESENCE OF LEAD. IF LEAD IS PRESENT, ALL INSTANCES SHALL BE REMEDIATED. ALL REMEDIATION WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND LAWS.
 2. PAINTED SURFACES BEING POWERWASHED SHALL BE "CONTAINED" AS PER CODE.
 3. DRY SCRAPING OR SANDING OF PAINTED SURFACES MAY ONLY BE PERFORMED WITH EQUIPMENT UTILIZING VACUUM ATTACHMENT W/ HEPA FILTER, AS PER CODE.

- ASBESTOS REMOVAL:**
1. TESTING SHALL BE PERFORMED TO DETERMINE THE PRESENCE OF ASBESTOS. IF ASBESTOS IS PRESENT, ALL INSTANCES SHALL BE ABATED. ALL ABATEMENT WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND LAWS.
 2. REMOVAL OF NON-FRABLE ASBESTOS CONTAINING MATERIALS SHALL BE PERFORMED IN SUCH A MANNER THAT THE MATERIALS REMAIN NON-FRABLE DURING THE RENOVATION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT THE MATERIALS ARE REMOVED WITHOUT RENDERING THE MATERIAL FRABLE. ASBESTOS MATERIALS TO BE PACKAGED AND SEALED AFTER REMOVAL. REFER TO ASBESTOS ABATEMENT SPECIFICATIONS FOR ADDITIONAL INFORMATION ON REMOVAL PROCEDURES.

- GRANITE:**
1. REMOVE ALL EXISTING PAINT ON GRANITE.
 2. POWERWASH ALL GRANITE SURFACES TO REMOVE DIRT AND GRIME.
 3. REPAIR CRACKS IN WALLS.
 4. REPOINT ALL OPEN MORTAR JOINTS.
 5. WATERPROOF GRANITE WITH APPROVED, CLEAR, BREATHABLE SILANE SOLUTION.


- LIMESTONE:**
1. REMOVE ALL EXISTING PAINT ON LIMESTONE.
 2. POWERWASH ALL SURFACES TO CLEAN STONES.
 3. REPAIR AND RESTORE ALL SPALLED AND BROKEN LIMESTONE.
 4. RAKE AND REPOINT ALL OPEN JOINTS.
 5. WATERPROOF LIMESTONE WITH APPROVED, CLEAR, BREATHABLE SILANE SOLUTION.

- TERRA COTTA:**
1. POWER WASH ALL SURFACES TO REMOVE DIRT AND GRIME.
 2. REPAIR AND RESTORE DAMAGED TERRA COTTA.
 3. REPLACE TERRA COTTA UNITS WITH SEVERE SPALLING.
 4. RAKE AND REPOINT ALL OPEN JOINTS.
 5. WATERPROOF TERRA COTTA WITH APPROVED SEALANT PER SPECIFICATION 04212.


- POLYCHROME TERRA COTTA:**
1. POWER WASH ALL SURFACES TO REMOVE DIRT AND GRIME.
 2. MECHANICALLY ABRASE SURFACES TO REMOVE LOOSE GLAZING.
 3. FILL IN CRACKS, REBUILD DAMAGED SECTIONS AND CROSS JOINTS WITH THE ELASTOMERIC COATING SYSTEM'S APPROVED PASTE.
 4. REMOVE AND REINSTALL SECTIONS THAT HAVE SEPARATED MORE THAN 3/8" FROM EACH OTHER AT HORIZONTAL JOINTS.
 5. PRIME SURFACE.
 6. APPLY COLOR CAST.

- CEMENT PARGE:**
1. POWER WASH REPAIR AREA AND SURROUNDING AREA.
 2. APPLY CEMENT PARGE EVENLY WITH EXISTING.
 3. PAINT TO MATCH EXISTING.


50% SUBMISSION
NOT FOR CONSTRUCTION

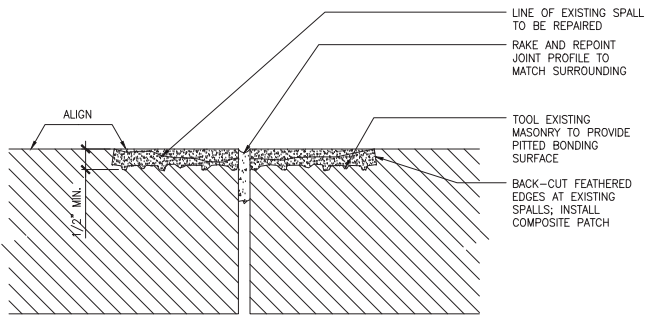


1 MASONRY SPALL REPAIR AT JOINT
SCALE: 6"=1'-0"

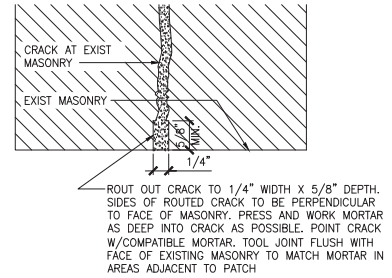


3 MASONRY CRACK REPAIR
SCALE: 6"=1'-0"

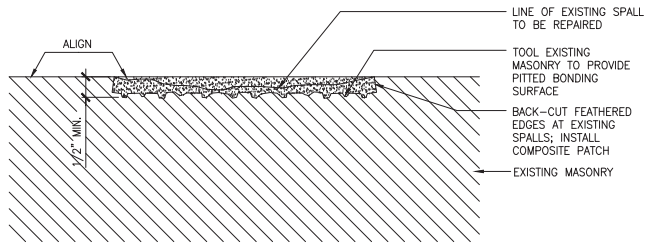


2 MASONRY SPALL REPAIR
SCALE: 6"=1'-0"

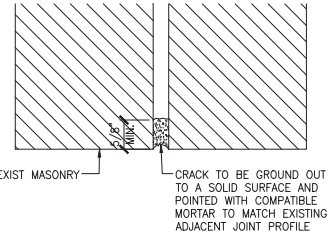


4 MORTAR JOINT REPAIR
SCALE: 6"=1'-0"

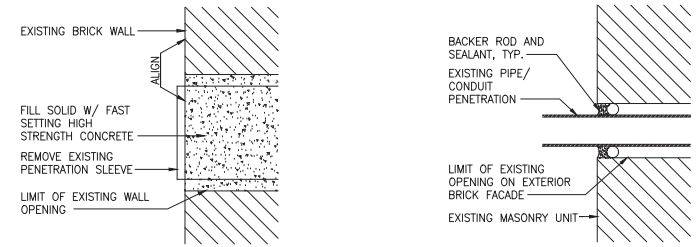

5 ABANDONED PENETRATION REPAIR
SCALE: 6"=1'-0"




6 PENETRATION REPAIR
SCALE: 6"=1'-0"




NOTES:


1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
3. PATCHING CEMENT SHALL BE DESIGNED FOR THE REPAIR OF HORIZONTAL, VERTICAL, AND OVERHEAD CONCRETE AND MASONRY SURFACES.
4. MORTAR SHALL BE COMPATIBLE WITH EXISTING MORTAR IN HARDNESS, TEXTURE AND COLOR.

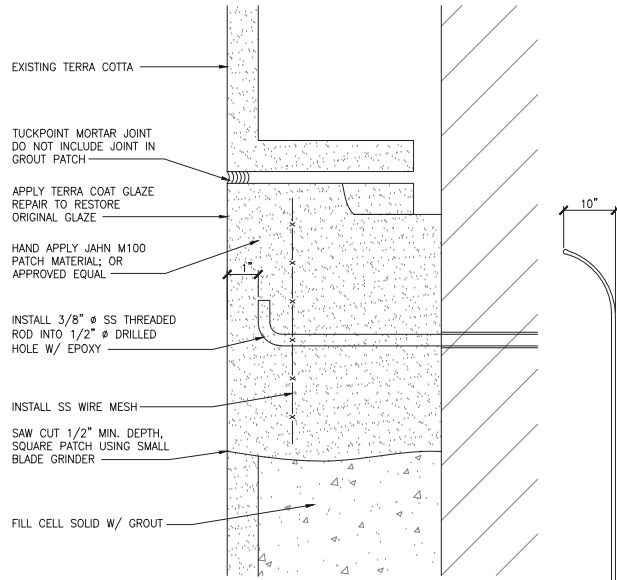



1 GROUT PATCH FOR TERRA COTTA
SCALE: 6" = 1'-0"

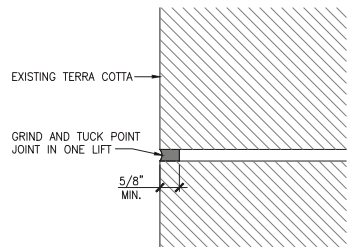

2 POINTING FOR TERRA COTTA
SCALE: 6" = 1'-0"

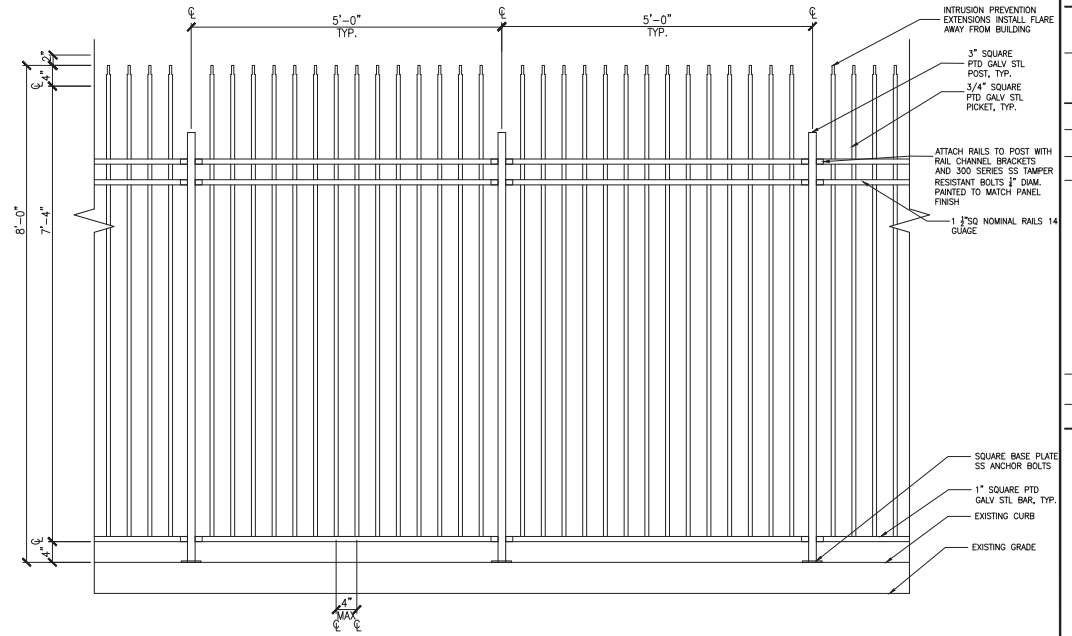

3 TYPICAL FENCE ELEVATION
SCALE: 1" = 1'-0"




50% SUBMISSION
NOT FOR CONSTRUCTION

DATE PLOTTED:	
DATE PLOTTED BY:	
DATE PLOTTED FOR:	
PROJECT:	
SECTION OF DRAWING:	
SCALE:	
PROJECT NUMBER:	
BY:	
DATE:	
DESCRIPTION:	

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
ARCHITECTURAL
 A319 DETAILS II

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	08/22/2025	DRAWN BY:	JL
WORK ORDER NO.:	276494	CHECKED BY:	JL
SHEET NUMBER:	283	TOTAL SHEETS:	452
DATE:	08/22/2025	PROJECT NO.:	17AN-A319

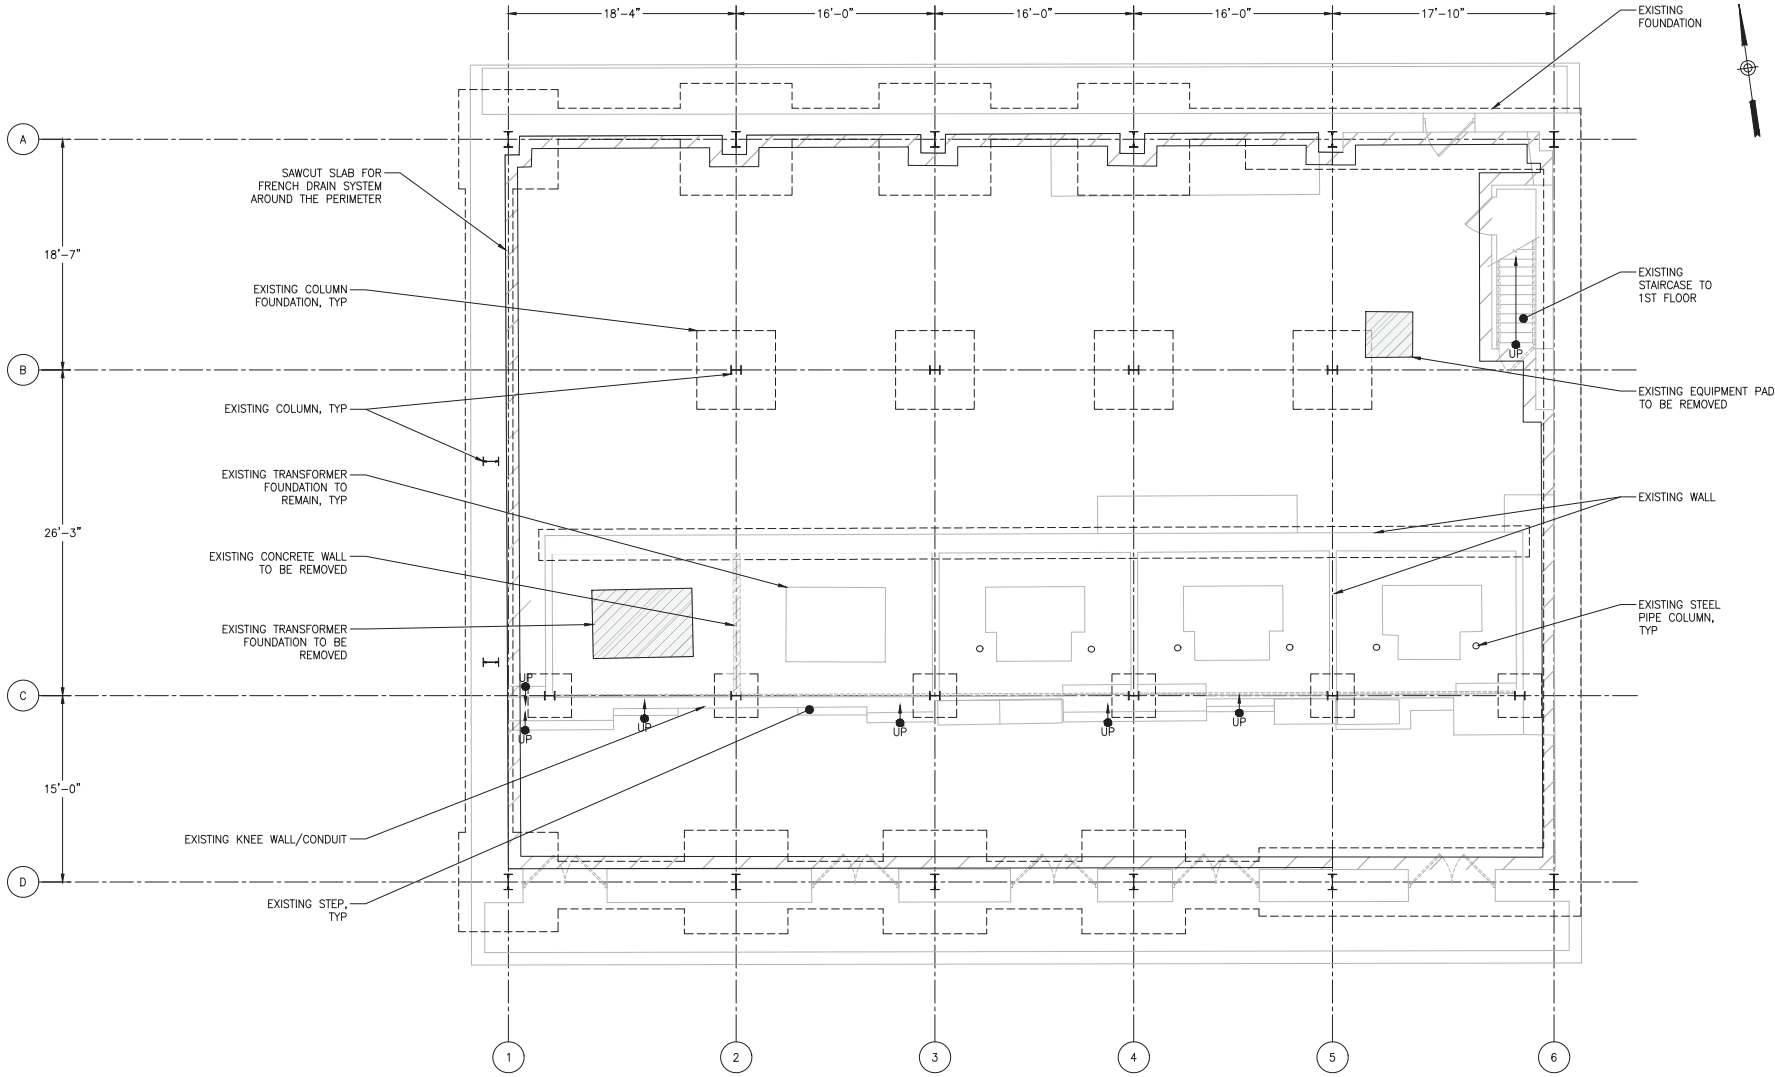


NOTES:

1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.

WORK ON THIS DRAWING:

- SELECT DEMOLITION OF EXISTING CONCRETE EQUIPMENT PADS.
- SELECT DEMOLITION OF EXISTING CONCRETE WALL.

EXISTING CONDITIONS & REMOVAL - BASEMENT
1"=5'



SCALE: 1"=5'

50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 15TH FL.
PHILADELPHIA, PA. 19107

SEPTA PROJECT OFFICER: _____

SEPTA PROJECT MANAGER: _____

SEPTA PROJECT ENGINEER: _____

SEPTA PROJECT ARCHITECT: _____

SEPTA PROJECT CONTRACTOR: _____


HDR Engineering, Inc.
Philadelphia, PA
MELIGRA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146
1610 933-0123

NO.	REV.	DATE	DESCRIPTION	BY	CHK

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
EXISTING CONDITIONS & REMOVAL - BASEMENT

DATE:	11/5/21	SCALE FACTOR:	
DATE:	08/22/2025	DRAWN BY:	SSJ
PROJECT NUMBER:	276494	CHECKED BY:	JJA
S301			
DWG NO.:	2	OF	21
APP. NO.:	282	OF	448
PROJECT FILE NO.:	17AN-S301		


C:\P\WORKING\PT171221\171AN-S302.DWG

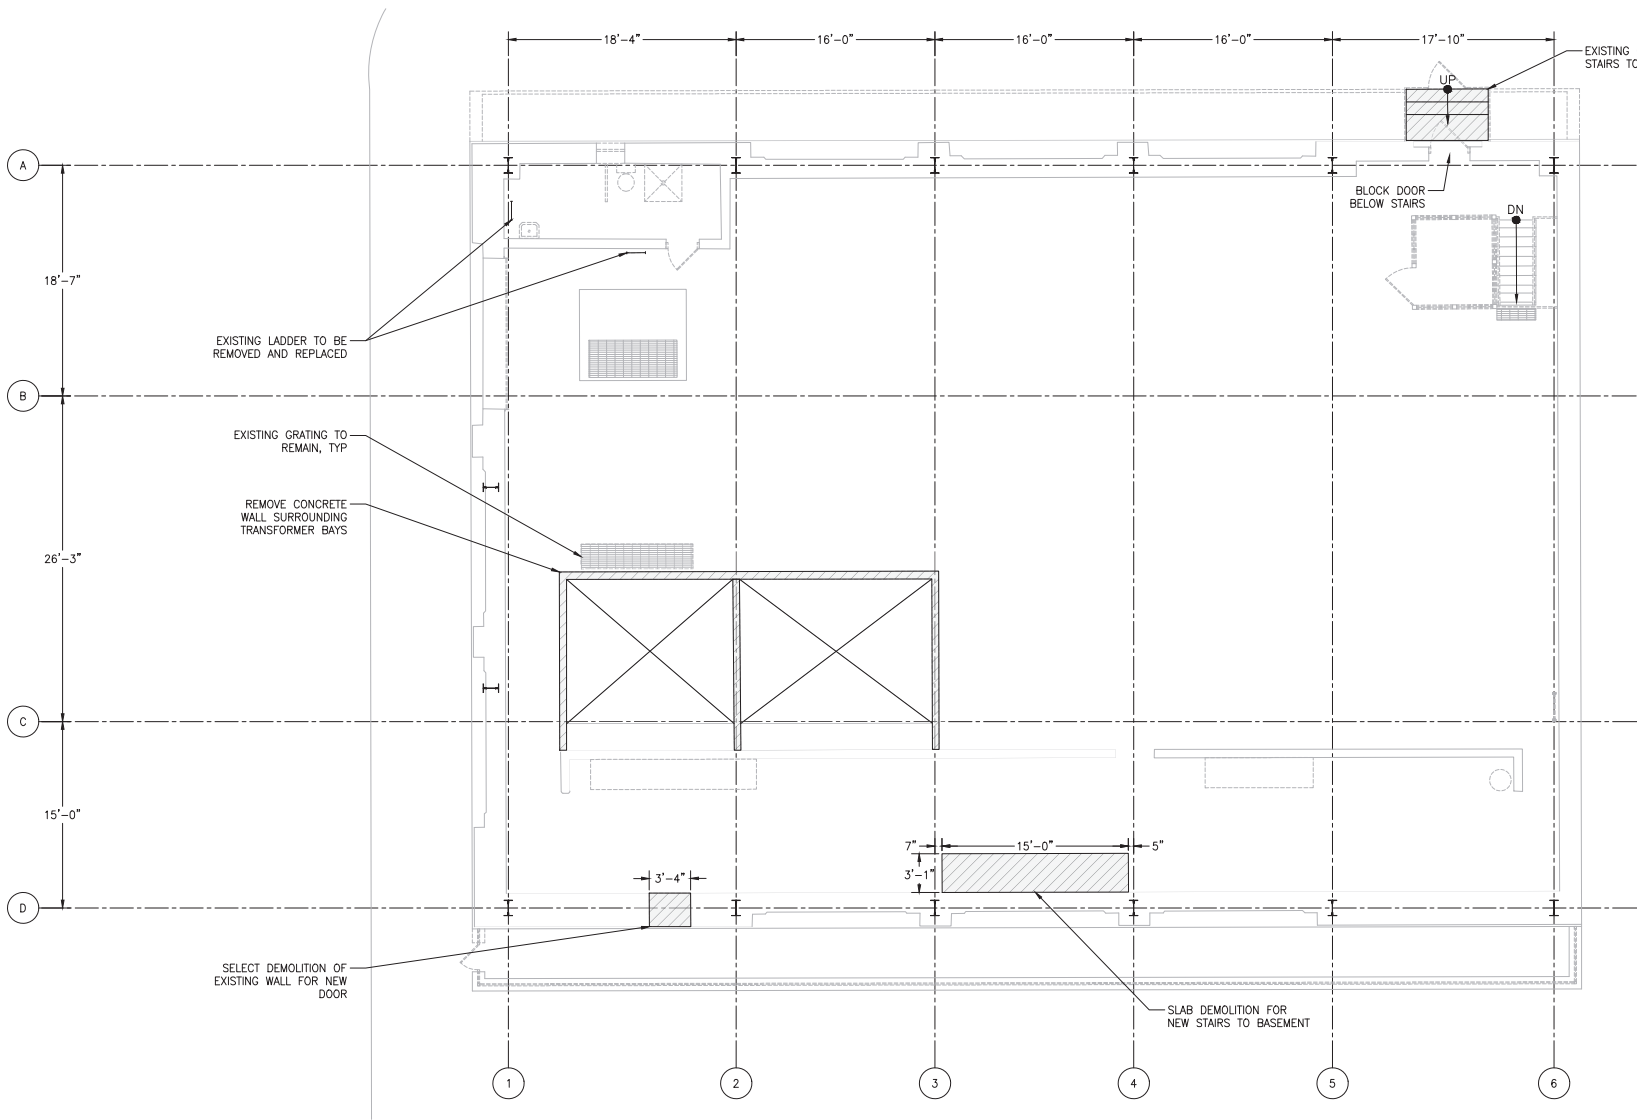

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
- WORK ON THIS DRAWING:
- DEMOLISH LOW WALL AROUND FLOOR SLAB OPENING.
 - SELECT DEMOLITION OF FLOOR SLAB FOR NEW STAIRS.
 - SELECT DEMOLITION OF EXISTING EXTERIOR WALL FOR NEW DOOR.
 - REMOVE EXISTING LADDERS (2).
 - DEMOLISH EXISTING CONCRETE STAIRS.

EXISTING CONDITIONS & REMOVAL - FIRST FLOOR

1"=5'



SCALE: 1"=5'

50% SUBMISSION
NOT FOR CONSTRUCTION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

SEPTA ENGINEER: DEAC
SEPTA ENGINEERING OFFICER: SEE
SEPTA RAIL TRACTOR OFFICER:
PROJECT SHEET:
DIRECTOR OF ENGINEERING: SEE
SEPTA ARCHITECT/ENGINEER:
PROJECT NUMBER:

HDR
HDR Engineering, Inc.
Philadelphia, PA
MELIGRA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146-0
16101 933-0123


NO.	DATE	BY	DESCRIPTION

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
EXISTING CONDITIONS & REMOVAL - FIRST FLOOR

DATE: 11-5-21	SCALE FACTOR:
DATE: 08/22/2025	DRAWN BY: JSA
PROJECT NUMBER: 276494	CHECKED BY: JSA
S302	
DWG NO: 3 of 21	
DWG NO: 283 of 448	
REV. NO: -	
COMPUTER FILE NO: 17AN-S302	

DATE PLOTTED: 10/19/2025
STATUS: 50% SUBMISSION


C:\P\WORK\BPT\1771221001\17AN-S303.DWG

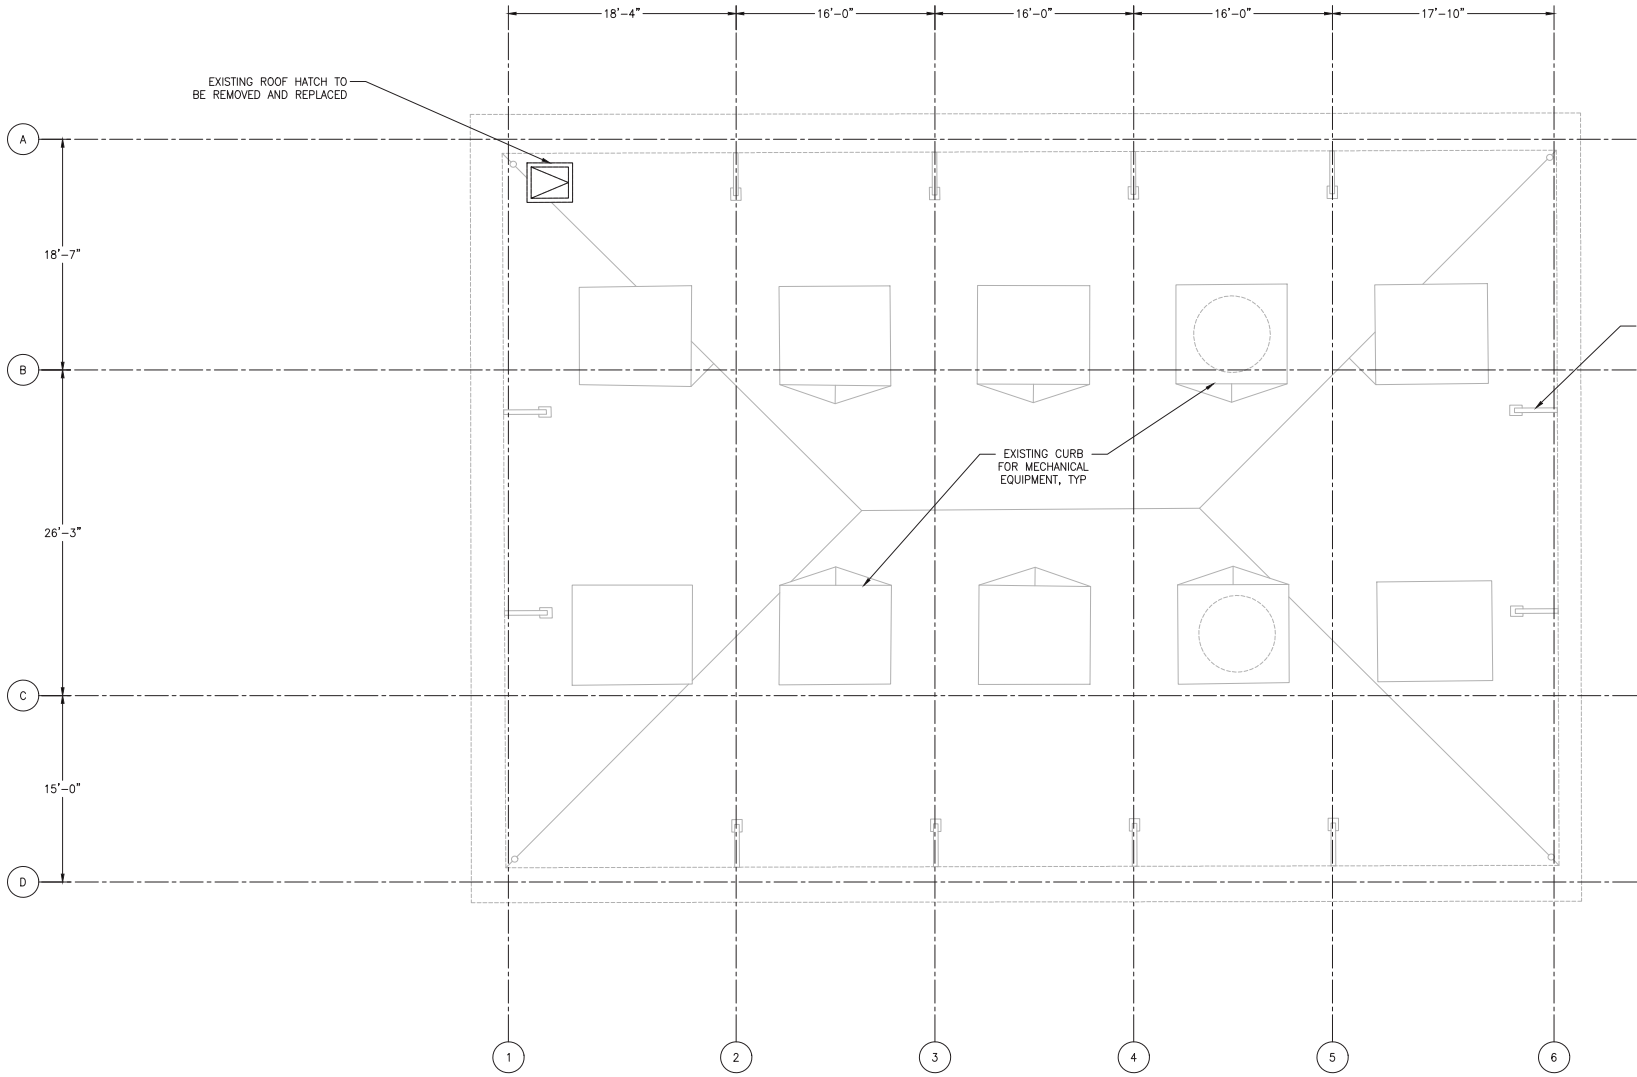

NOTES:

- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
- WORK ON THIS DRAWING:
- REMOVE EXISTING ROOF HATCH.

EXISTING CONDITIONS & REMOVAL - ROOF
1"=5'



SCALE: 1"=5'

50% SUBMISSION
NOT FOR CONSTRUCTION



1124 MARKET ST., 19th FL.
PHILADELPHIA, PA. 19107

SEPTA ENGINEER - DMC:	
SEPTA ENGINEERING OFFICER - SE:	
SEPTA RAIL TRACT OFFICER:	
SEPTA SAFETY:	
DIRECTOR OF ENGINEERING - SE:	
MANAGER ARCHITECTURE/ENGINEERING:	
PROJECT MANAGER:	

HDR
HDR Engineering, Inc.
Philadelphia, PA
MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146-0
16101 933-0123

NO.	DATE	DESCRIPTION	BY	CHK	APP

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
EXISTING CONDITIONS & REMOVAL - ROOF

DATE:	11-5'	SCALE FACTOR:	
DATE:	08/22/2025	DRAWN BY:	SSJ
PROJECT NUMBER:	276494	CHECKED BY:	JJA
SHEET NUMBER:	S303		
DWG NO.:	4	OF	21
DTG NO.:	284	OF	448
REV. NO.:			
COMPUTER FILE NO.:	17AN-S303		
REV. NO.:			

DATE PLOTTED: 10/09/2025
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHK	APP

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
PROPOSED BASEMENT PLAN


SCALE:	1"=5'	SCALE FACTOR:	
DATE:	08/22/2025	DRAWN BY:	SSB
PROJECT NUMBER:	276494	CHECKED BY:	JJA
SHEET NUMBER:	S305		

DATE:	6	OF	21
DATE:	286	OF	448
DATE:			
COMPUTER FILE NO.:	17AN-S305	REV. NO.:	

50% SUBMISSION
NOT FOR CONSTRUCTION




SCALE: 1"=5'

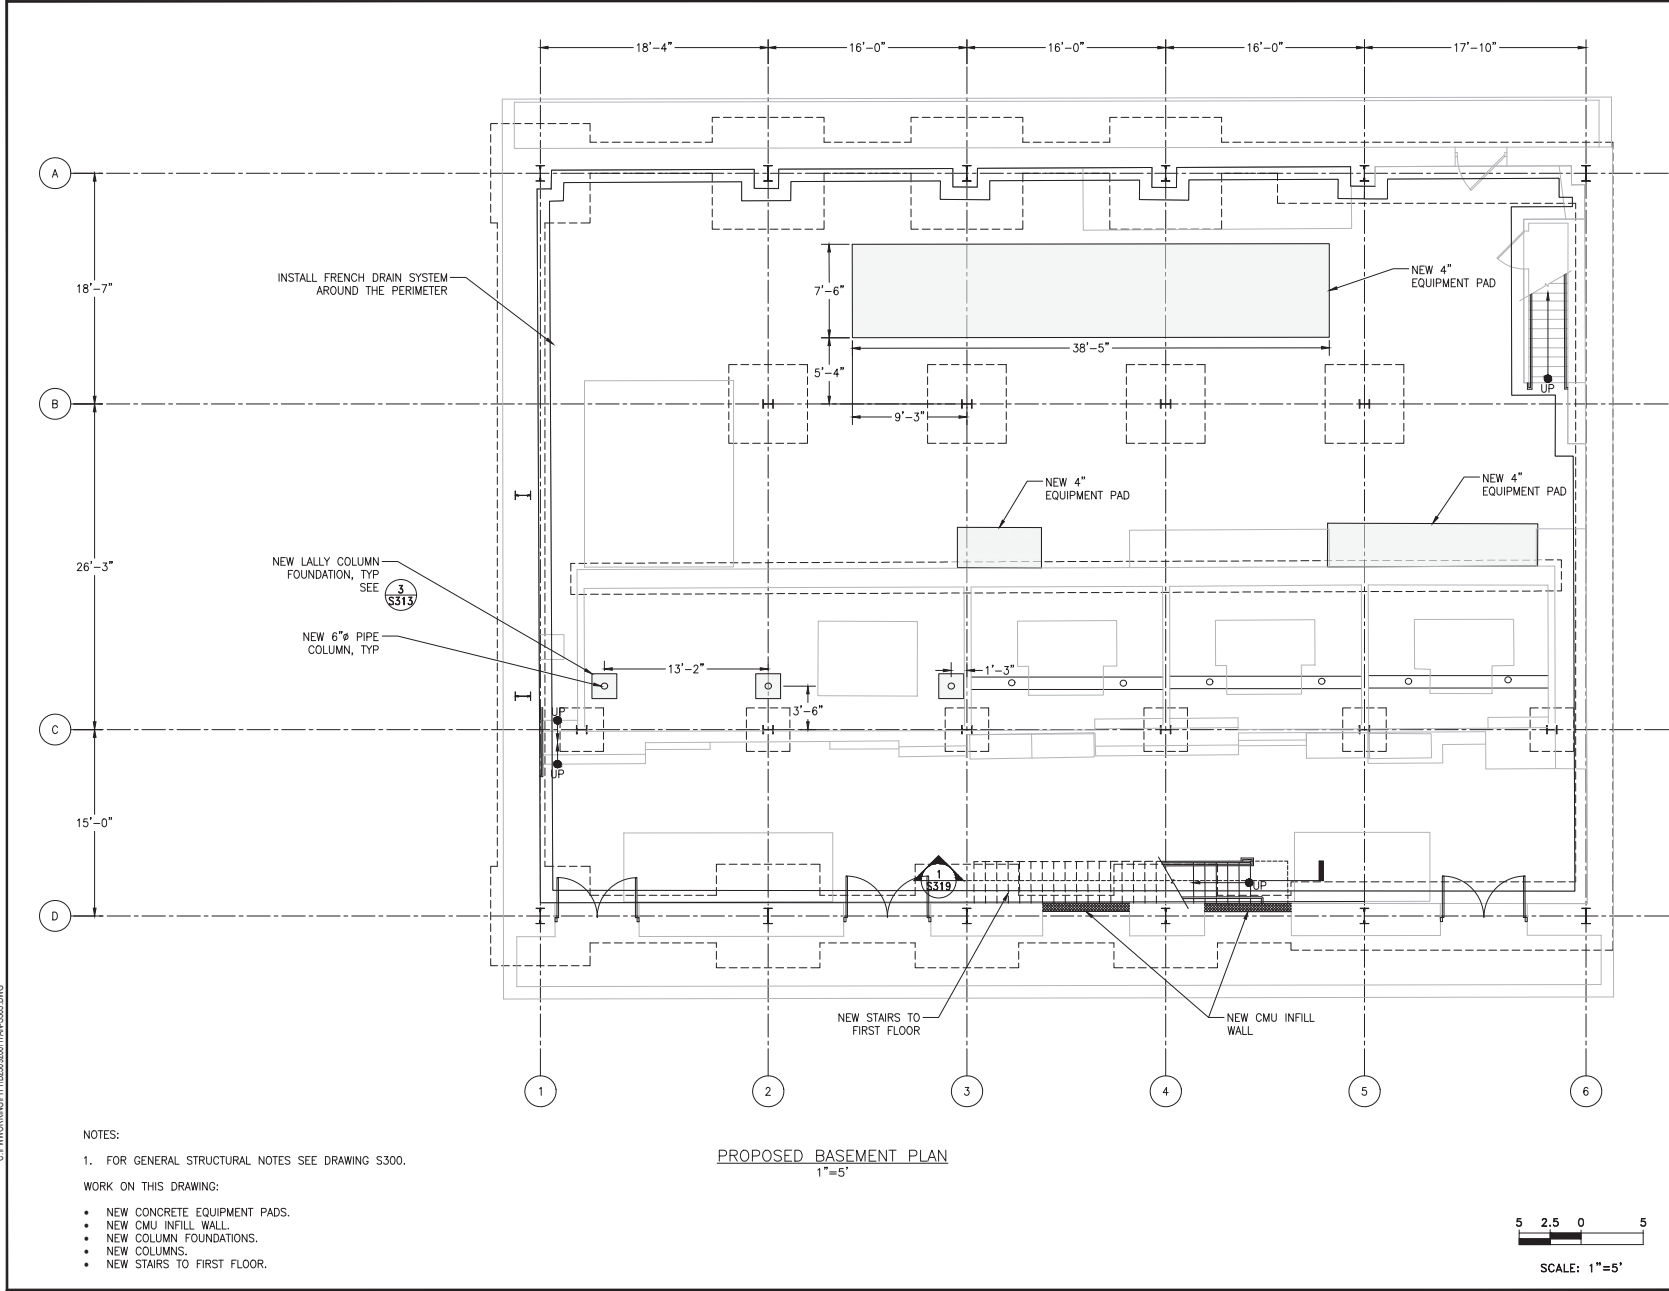

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
- WORK ON THIS DRAWING:
- NEW CONCRETE EQUIPMENT PADS.
 - NEW CMU INFILL WALL.
 - NEW COLUMN FOUNDATIONS.
 - NEW COLUMNS.
 - NEW STAIRS TO FIRST FLOOR.


C:\P\WORK\PHILADELPHIA\17AN-S306.DWG

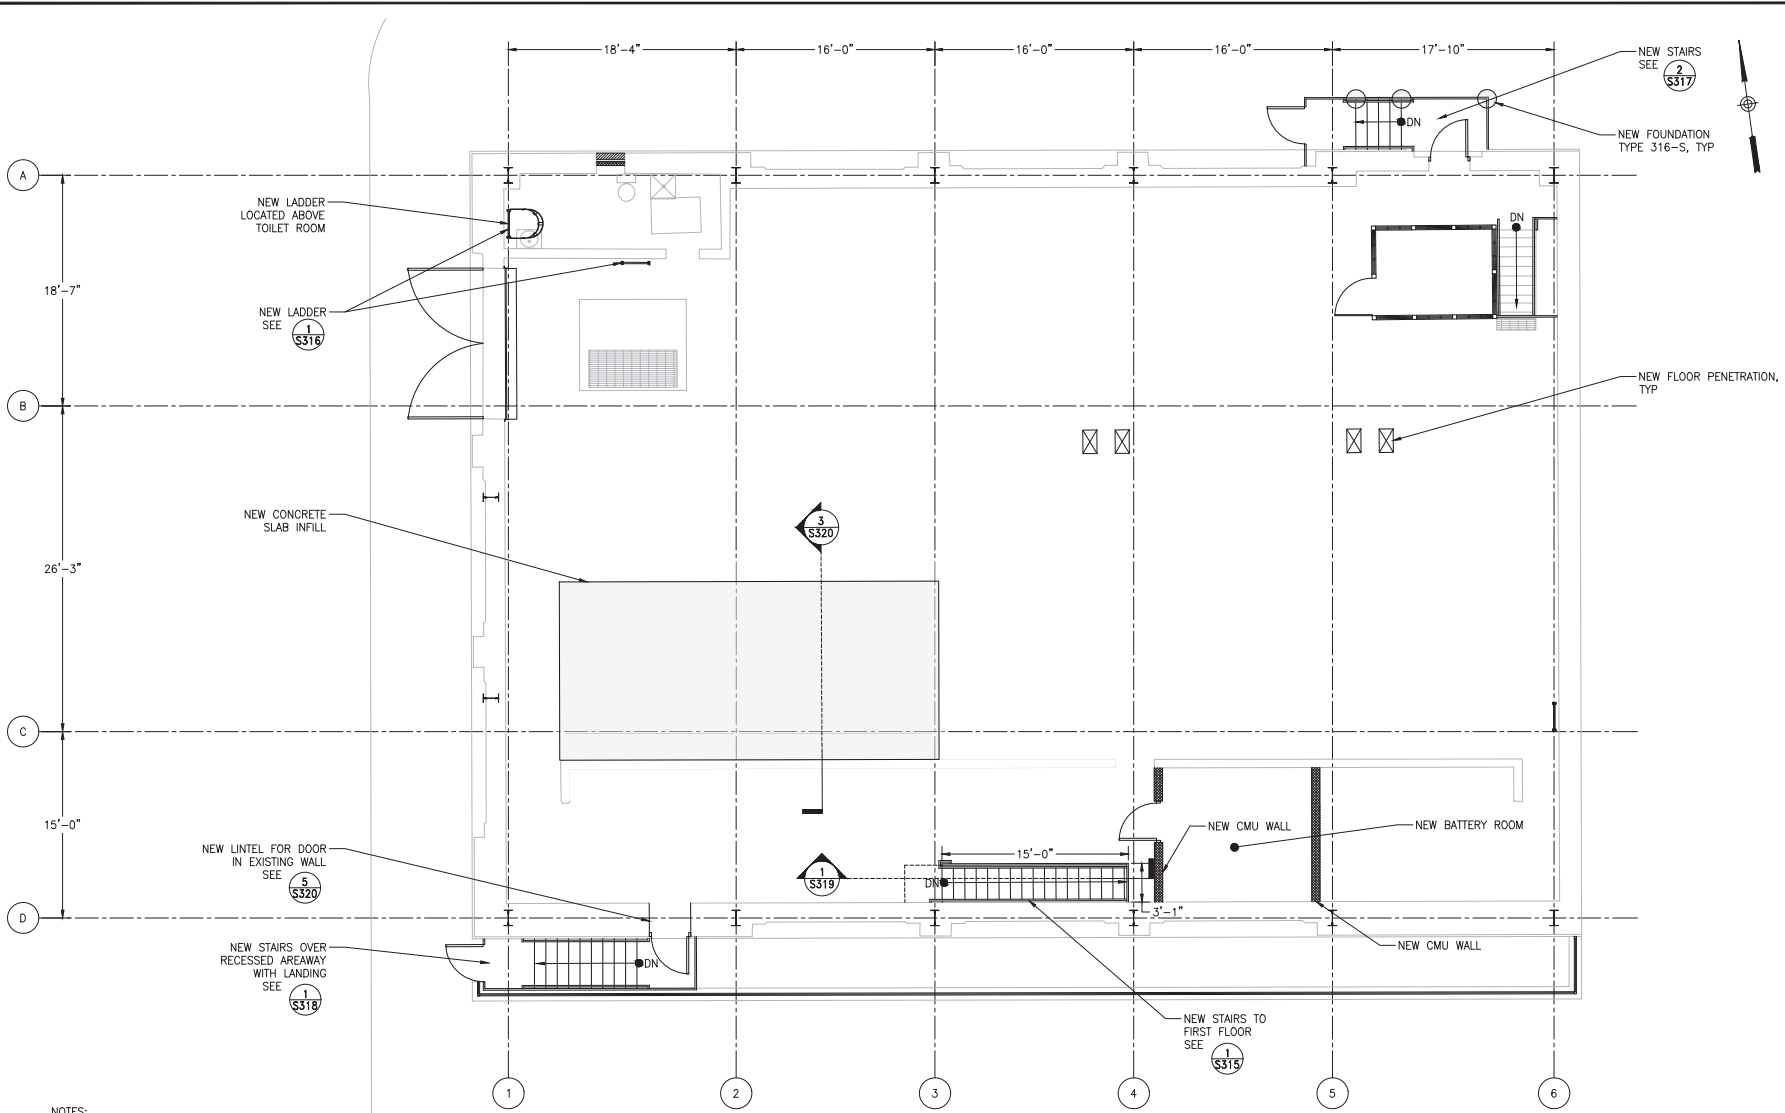


- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
 - FOR NEW BATTERY ROOM CEILING FRAMING PLAN SEE DRAWING S320.

- WORK ON THIS DRAWING:
- NEW INFILL FLOOR SLAB.
 - NEW INTERIOR STAIRS TO BASEMENT.
 - NEW EXTERIOR STAIRS (2).
 - NEW LADDERS (2).
 - NEW FLOOR PENETRATIONS.
 - NEW LINTEL FOR DOOR IN EXTERIOR WALL.

PROPOSED FIRST FLOOR PLAN
1"=5'



50% SUBMISSION
NOT FOR CONSTRUCTION



**SOUTHEASTERN
PENNSYLVANIA
TRANSPORTATION
AUTHORITY**
DMC DIVISION
1324 MARKET ST., 15TH FL.
PHILADELPHIA, PA. 19107

DRY ENGINEER: DMC
 DRY ENGINEERING OFFICE: BSA
 DRY RAIL TRACT OFFICE:
 SITE/DRY/ST:
 DIRECTOR OF ENGINEERING: BSA
 GROUP ARCHITECT/ENGINEER:
 PROJECT NUMBER:

HDR Engineering, Inc.
 Philadelphia, PA
 MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146-0
 16 (D) 933-0123

REV	DATE	BY	DESCRIPTION


LOUON
 SUBWAY/ELEVATED TRAINS
 TRACTION POWER SUBSTATION
 REHABILITATION
 STRUCTURAL
 PROPOSED FIRST FLOOR PLAN

DATE:	11/25/21	SCALE FACTOR:	
DATE:	08/22/2025	DRAWN BY:	SSB
PROJECT NUMBER:	276494	CHECKED BY:	JJA
KEY NUMBER:	S306		
DATE:	7/21		
DATE:	2/27		

COMPUTER FILE NO.: 17AN-S306
 REV. NO.: -


DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION

C:\P\WORK\BPT\17712212001\17AN-S307.DWG

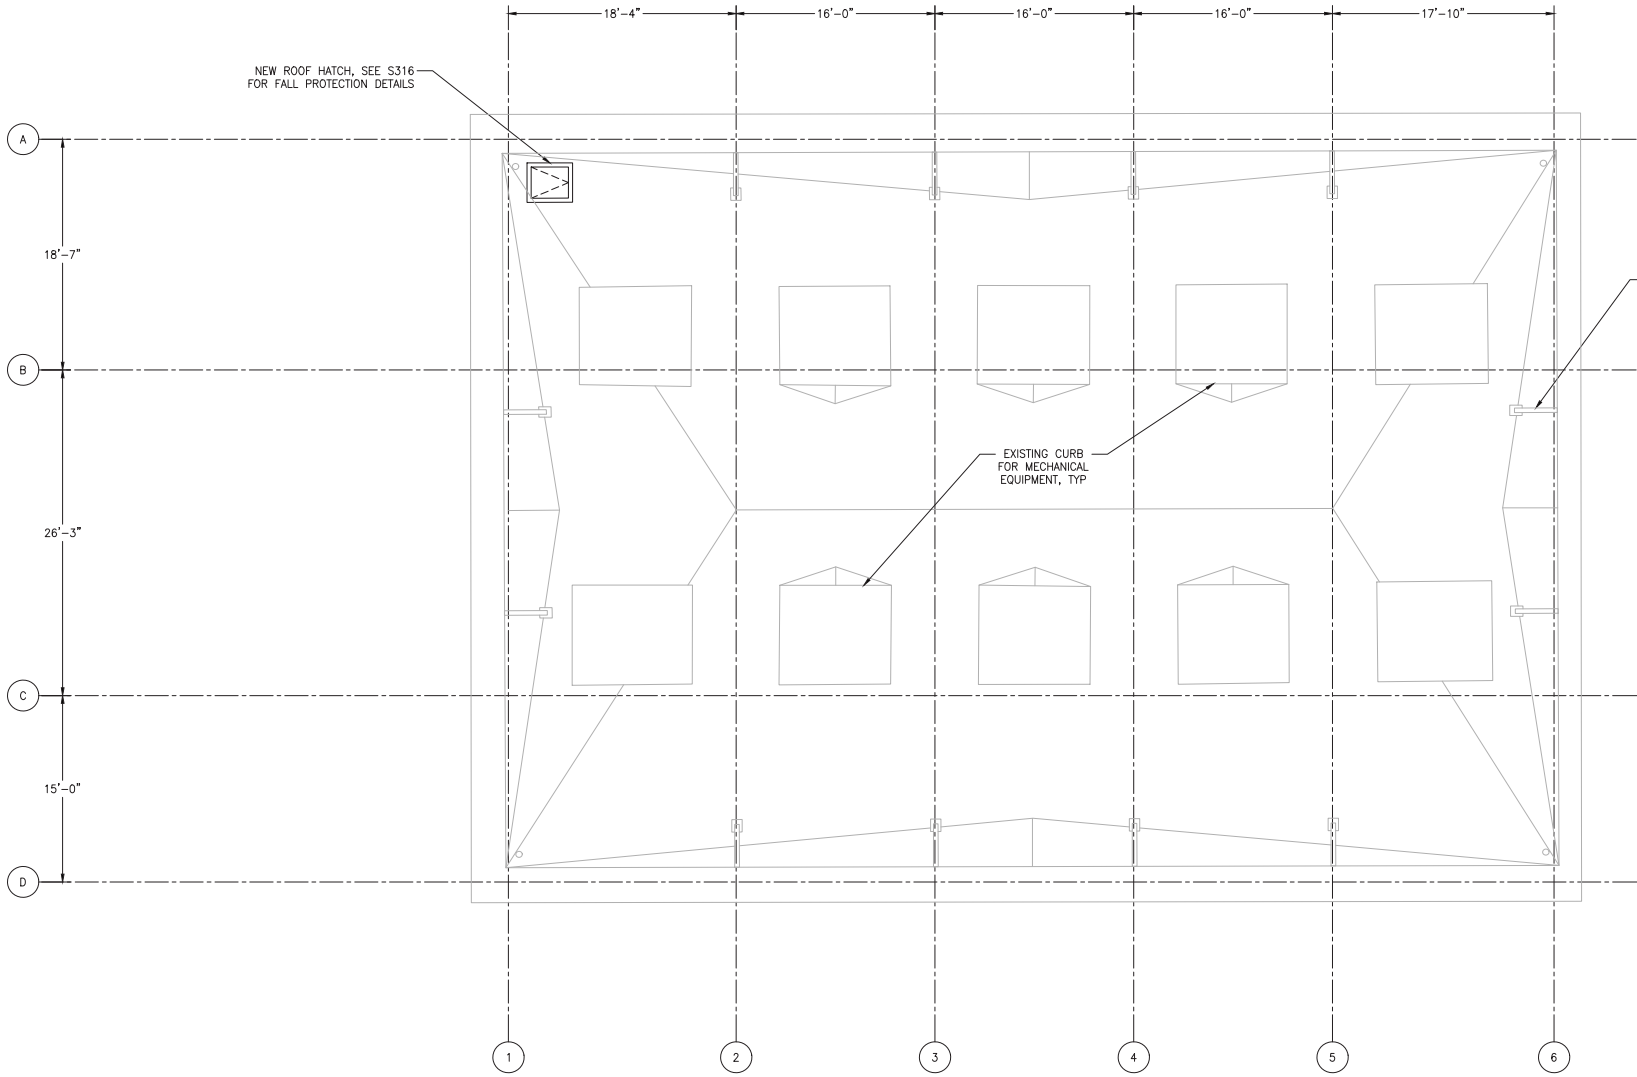

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
- WORK ON THIS DRAWING:
- CLEAN, PRIME AND PAINT PARAPET BRACES.
 - NEW ROOF HATCH.

PROPOSED ROOF PLAN
1"=5'



50% SUBMISSION
NOT FOR CONSTRUCTION



1124 MARKET ST., 15th FL.
PHILADELPHIA, PA. 19107

DRG ENGINEER: DMC
DRG ENGINEERING OFFICER: SEE
DRG RAIL TRACT OFFICER
DRG DESIGN
DIRECTOR OF ENGINEERING: SEE
SENIOR ARCHITECT/ENGINEER
PROJECT MANAGER

HDR
HDR Engineering, Inc.
Philadelphia, PA
MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146
16101 933-0123


REV	DATE	DESCRIPTION	BY	CHK	APP

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
PROPOSED ROOF PLAN

DATE: 11/21/21	SCALE FACTOR:
DATE: 08/22/2025	DRAWN BY: DMC
PROJECT NUMBER: 276494	CHECKED BY: DMC
S307	
DRG NO.: 8 of 21	
DRG NO.: 288 of 448	
REVISION NO.:	
COMPUTER FILE NO.: 17AN-S307	
REV. NO.:	


DATE PLOTTED: 10/19/2025
STATUS: 50% SUBMISSION

C:\P\WORKING\PT17\17AN-S308.DWG

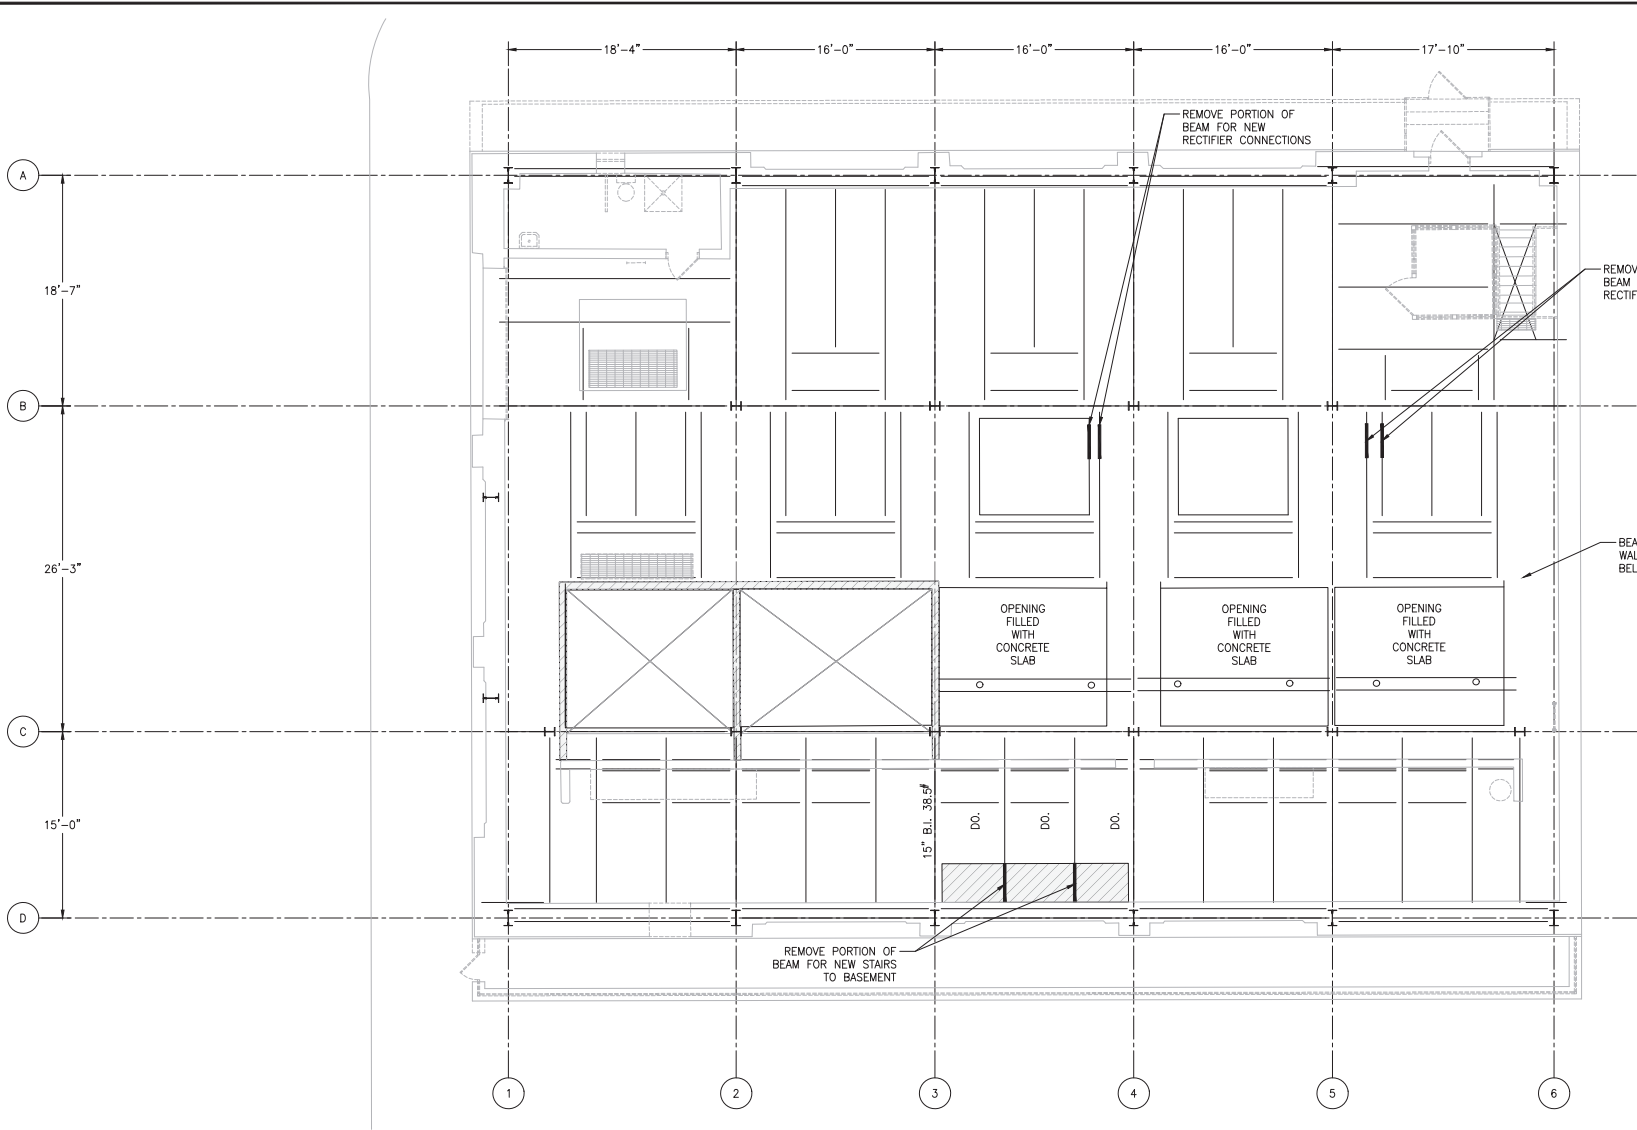

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
 WORK ON THIS DRAWING:
 • SELECT BEAM REMOVAL FOR NEW STAIRS TO BASEMENT.
 • SELECT BEAM REMOVAL FOR RECTIFIER CONNECTIONS.

EXISTING FIRST FLOOR FRAMING PLAN
 1"=5'



50% SUBMISSION
 NOT FOR CONSTRUCTION

SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY
DMC DIVISION

1324 MARKET ST., 15TH FL.
 PHILADELPHIA, PA. 19107

DRW NUMBER: DMC
 DRW ENGINEERING OFFICE: BEE
 DRW RAIL TRACT OFFICE:
 DTED DATE:
 DIRECTOR OF ENGINEERING: BEE
 MANAGER ARCHITECTURE:
 PROJECT NUMBER:

HDR
HDR Engineering, Inc.
 Philadelphia, PA
MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146
 (610) 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
 STRUCTURAL
 EXISTING FIRST FLOOR FRAMING PLAN

<small>DATE:</small> 1"=5'	<small>SCALE FACTOR:</small>
<small>DATE:</small> 08/22/2025	<small>DRAWN BY:</small> JSA
<small>PROJECT NUMBER:</small> 276494	<small>CHECKED BY:</small> JSA
<small>PROJECT NUMBER:</small> S308	<small>DATE:</small> 9 of 21
<small>DATE:</small> 289 of 448	<small>REV. NO.:</small>
<small>DATE:</small>	<small>REV. NO.:</small>

COMPUTER FILE NO.: 17AN-S308

DATE PLOTTED: 10/19/2025 STATUS: 50% SUBMISSION



1324 MARKET ST., 19104 PHILADELPHIA, PA. 19107

CHIEF ENGINEER: DAC
 CHIEF ENGINEERING OFFICER: BBA
 CHIEF RAIL TRAFFIC OFFICER:
 PROJECT MANAGER:
 PROJECT NUMBER:


HDR
 HDR Engineering, Inc.
 Philadelphia, PA
 MELIGRA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA 19146-0
 16101 933-0123

REV	DATE	DESCRIPTION	BY	CHK	APP

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 PROPOSED FIRST FLOOR FRAMING PLAN


DATE: 08/22/2025
 DRAWN BY: JBA
 CHECKED BY: JBA
 PROJECT NUMBER: 276494

S309
 SHEET NUMBER:
 DATE: 10 of 21
 SHEET NO.: 290 of 448
 PROJECT NO.:
 COMPUTER FILE NO.: 17AN-S309

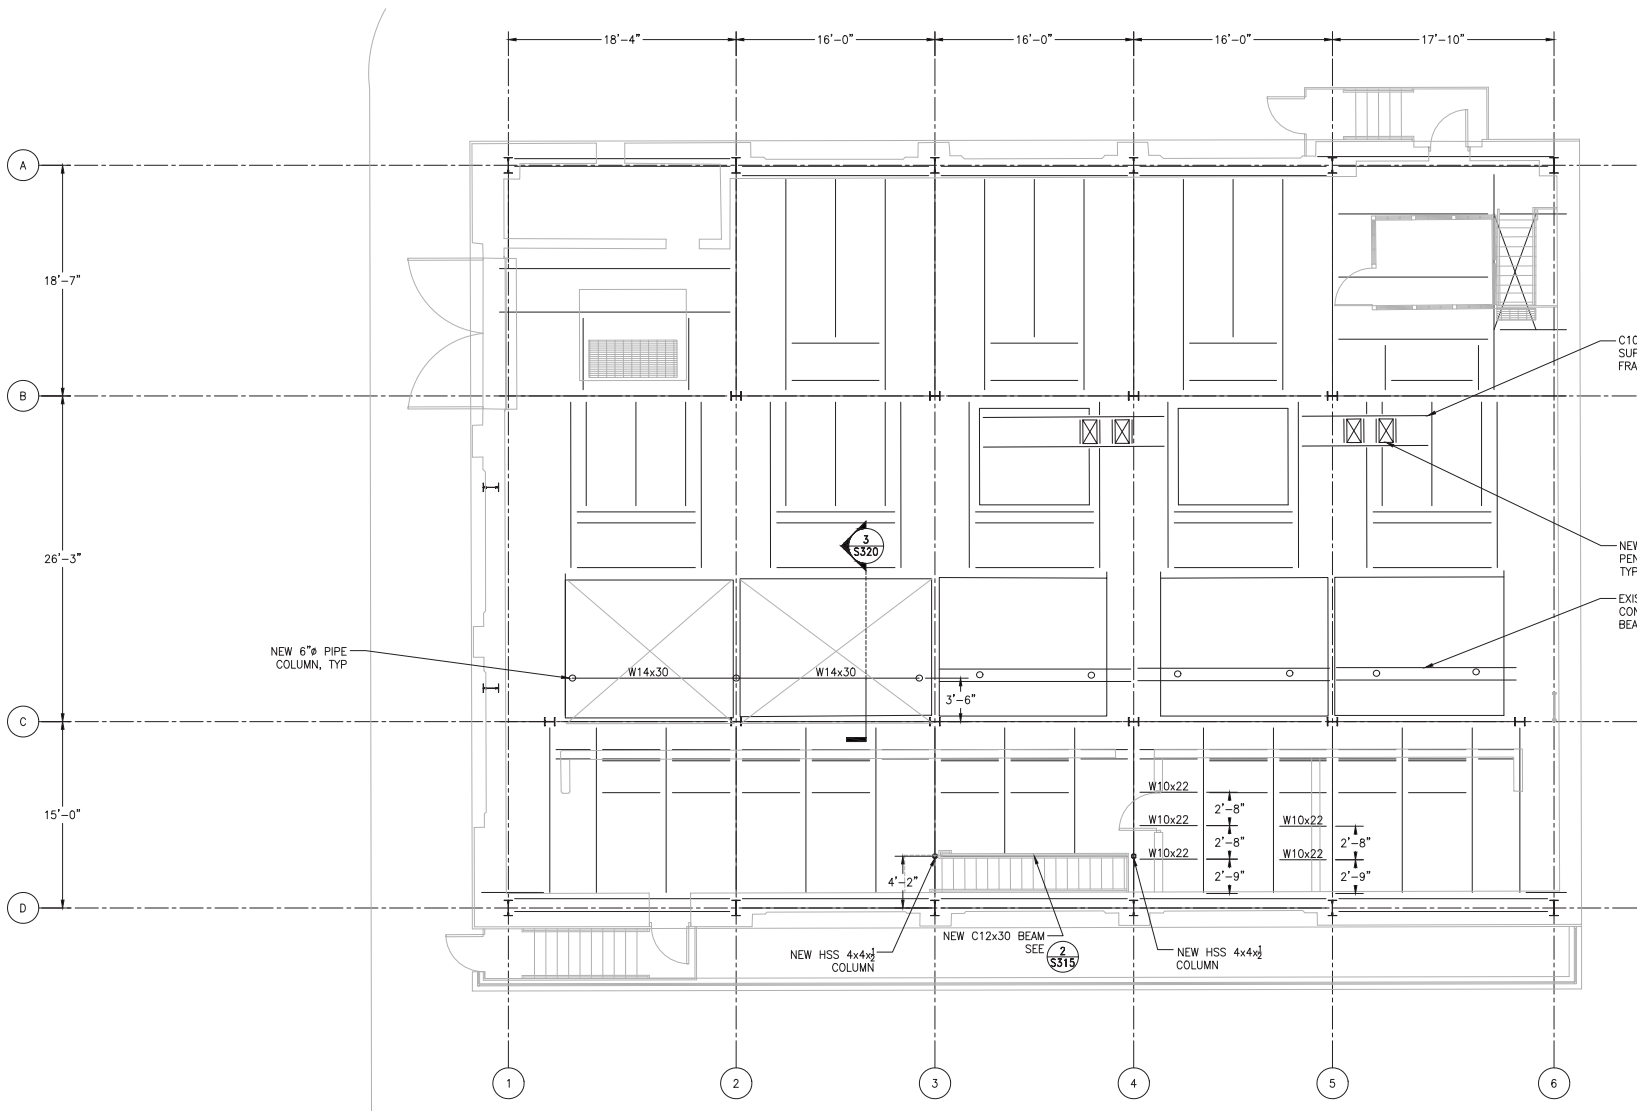

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
 WORK ON THIS DRAWING:
 • NEW STEEL BEAMS.
 • REINFORCE EXISTING BEAMS.
 • NEW FLOOR PENETRATIONS.

PROPOSED FIRST FLOOR FRAMING PLAN
 1"=5'




SCALE: 1"=5'


50% SUBMISSION
 NOT FOR CONSTRUCTION

C:\P\WORKING\PT\17AN-S309.DWG


DATE PLOTTED: 10/19/2025 STATUS: 50% SUBMISSION

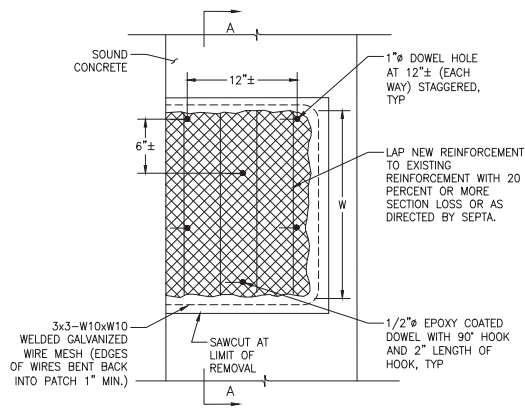


ELEVATION VIEW

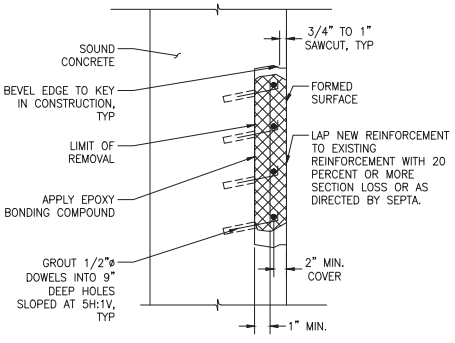

SECTION A-A
NEW REINFORCEMENT

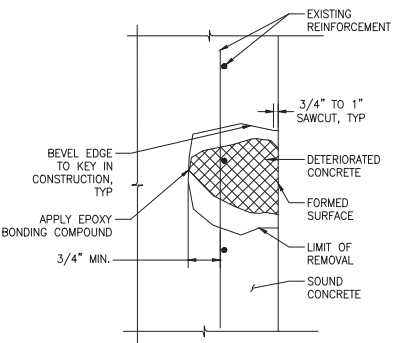

SECTION A-A
EXISTING REINFORCEMENT

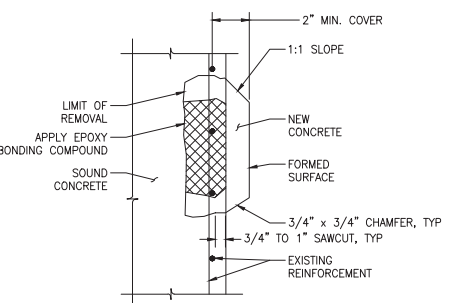

SECTION A-A
BLISTER DETAIL

1 CONCRETE REPAIR TYPE 2
SCALE: N.T.S.

NOTE:

REPAIR TYPE 2 IS USED WHEN DEPTH OF DETERIORATED CONCRETE IS GREATER THAN 3/4" AND EXISTING REINFORCEMENT SPACED ≤ 12" ON CENTERS. OTHERWISE USE REPAIR TYPE 2A.

NOTE:


CONCRETE REPAIR TYPE 2 DETAIL FOR AREAS WITH EXISTING REINFORCEMENT HAVING LESS THAN 2" OF COVER.

REINFORCED CONCRETE REPAIR TYPE 2 NOTES:


- SQUARE OFF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MINIMUM TO 1" MAXIMUM BUT NOT TO THE DEPTH OF THE REINFORCEMENT STEEL. BACK BEVEL EDGE BEYOND SAWCUT.
- USE HAND TOOLS TO REMOVE ALL LOOSE AND DELAMINATED CONCRETE THAT PROVIDES A SOUND BOND BETWEEN EXISTING CONCRETE AND NEW CONCRETE. PNEUMATIC HAMMERS WITH IMPACT RATINGS OF 3 FT-LBS OR LESS MAY BE USED IF REQUIRED.
- IF DETERIORATED CONCRETE EXTENDS BEYOND THE PRIMARY REINFORCEMENT, REMOVE THE CONCRETE TO AT LEAST 3/4" BEHIND THE REINFORCEMENT.
- APPLY AN EPOXY BONDING COMPOUND BETWEEN THE EXISTING AND THE NEW CLASS AA CEMENT CONCRETE.
- "W" REPRESENTS LEAST DIMENSION OF DETERIORATED CONCRETE.
- USE DOWELS ONLY WHEN "W" DIMENSION OF DETERIORATED CONCRETE IS GREATER THAN 2'-0" AND NEW OR EXISTING REINFORCEMENT CANNOT ADEQUATELY BE DEVELOPED BY LAPPING WITH EXISTING REINFORCEMENT.
- USE A PACHOMETER TO LOCATE EXISTING REINFORCEMENT WHEN DRILLING DOWEL HOLES TO AVOID DRILLING THRU EXISTING BARS.
- AN APPROVED EPOXY ANCHORING SYSTEM IN 90° HOLES MAY REPLACE GROUT IN SLOPED HOLES. USE A 6" MINIMUM EMBEDMENT AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- A #4 DEFORMED REINFORCEMENT BENT "L" BAR MAY REPLACE THE 1/2" DIAMETER DOWEL HOOK.
- ALTERNATE WIRE MESH MAY BE SUBSTITUTED FOR 3x3-W10xW10, PROVIDED WIRE SPACING DOES NOT EXCEED 4" AND AN EQUIVALENT STEEL AREA IS PROVIDED. NEW REINFORCEMENT BARS MAY BE OMITTED IF WIRE MESH STEEL AREA EXCEEDS EXISTING REINFORCEMENT.
- CLEAN EXISTING REINFORCEMENT BY MECHANICAL MEANS.
- LAP EQUIVALENT NEW REINFORCEMENT TO THE EXISTING REINFORCEMENT AS DIRECTED.
- REINFORCEMENT BARS TO BE EPOXY COATED.

NOTES:

- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
- WORK ON THIS DRAWING:
- CONCRETE REPAIRS.

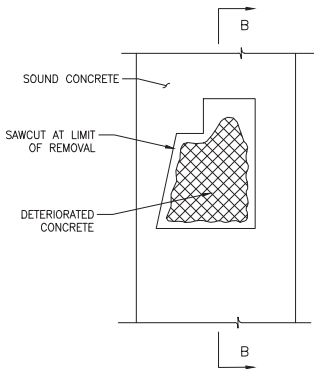

ELEVATION VIEW

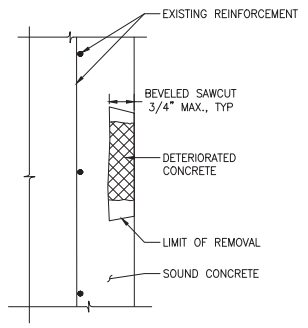

SECTION B-B

2 CONCRETE REPAIR TYPE 1
SCALE: N.T.S.

NOTE:

REPAIR TYPE 1 IS USED WHEN DEPTH OF DETERIORATED CONCRETE IS LESS THAN EQUAL TO 3/4".

REINFORCED CONCRETE REPAIR TYPE 1 NOTES:

- SQUARE OFF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MAXIMUM.
- REMOVE ALL LOOSE AND DELAMINATED CONCRETE TO PROVIDE A SOUND BOND BETWEEN EXISTING CONCRETE AND PATCHING.
- APPLY A RAPID HARDENING CONCRETE PATCHING MATERIAL FROM AN APPROVED MANUFACTURER AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

LEGEND

REMOVE DETERIORATED CONCRETE



1324 MARKET ST., 19TH FL. PHILADELPHIA, PA. 19107

DATE PLOTTED:	
DATE REVISION:	
DATE APPROVED:	
DATE CHECKED:	
DATE DESIGNED:	
DATE DRAWN:	
DATE IN CHARGE:	
DATE REVIEWED:	
DATE REVISION:	
DATE APPROVED:	

HDR Engineering, Inc.
Philadelphia, PA
MELISSA DESIGN
250 MORGAN STREET
PHILADELPHIA, PA 19146-0
(610) 933-0123

NO.	REV. DATE	DESCRIPTION	BY	APP'D

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
CONCRETE REPAIR DETAILS - SHEET 1

DATE:	AS NOTED	SCALE FACTOR:	
DATE:	08/22/2025	DRAWN BY:	MS
DATE:		CHECKED BY:	JAK
PROJECT NO.:	276494		
S310			
SHEET NO.:	11	OF	21
DATE:	25	OF	48
PROJECT NO.:			
COMPUTER FILE NO.:			
DATE:			

50% SUBMISSION
NOT FOR CONSTRUCTION

C:\P\WORK\REPT\177\177AN-S310.DWG

DATE PLOTTED: 10/9/2025




STATUS: 50% SUBMISSION

NO.	REV.	DATE	BY	APP'D	DESCRIPTION

LOUDON
 SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
 CONCRETE REPAIR DETAILS - SHEET 2

DATE:	AS NOTED	SCALE FACTOR:
DATE:	08/22/2025	DESIGNED BY: MCH
PROJECT NUMBER:	276494	CHECKED BY: SRA
SHEET NUMBER:	S311	
DWG. NO.:	12 of 21	
CITY NO.:	292 of 448	
ARCHIVE NO.:		
COMPUTER FILE NO.:		
FILE NO.:	17AN-S311	

50% SUBMISSION
 NOT FOR CONSTRUCTION

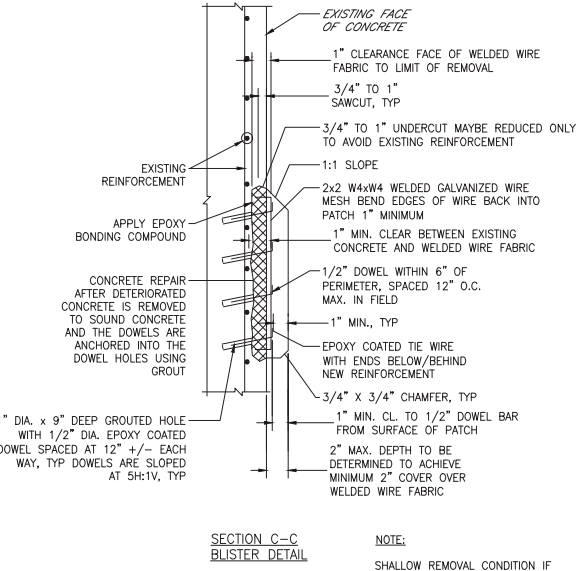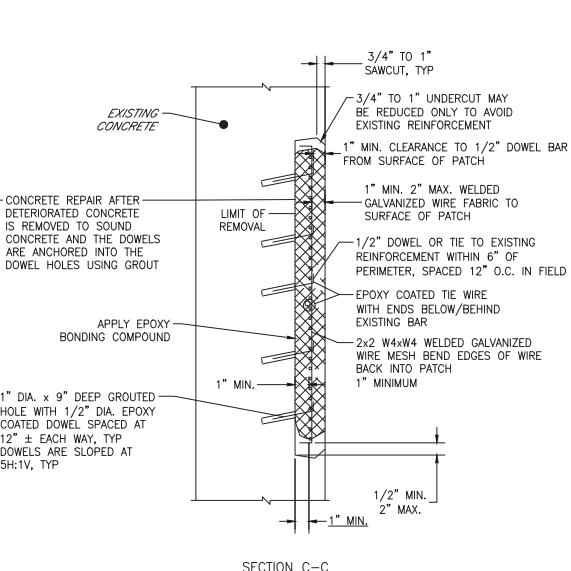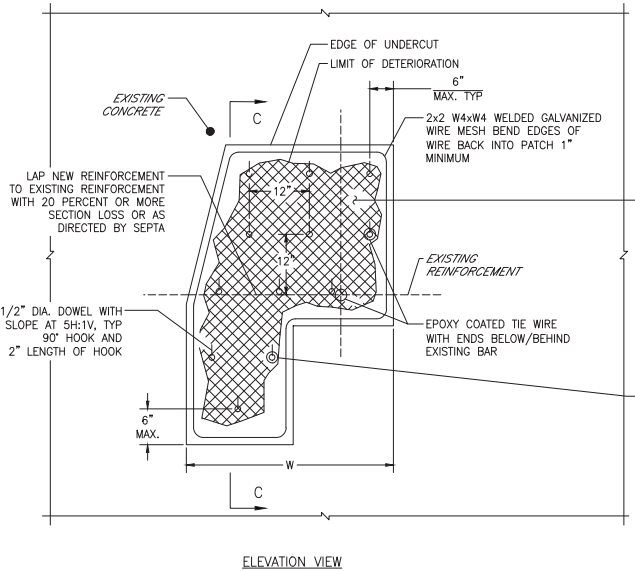

1 CONCRETE REPAIR TYPE 2A
 SCALE: N.T.S.

REINFORCED CONCRETE REPAIR TYPE 2A NOTES:

- REPAIR TYPE 2A IS USED WHEN DEPTH OF DETERIORATION IS GREATER THAN 3/4" AND EXISTING REINFORCEMENT IS SPACED GREATER THAN 12" ON CENTER.
- PROVIDE EPOXY COATED WIRE TIE TO CONNECT EXISTING REINFORCEMENT AND EPOXY COATED 2x2 W4xW4 WELDED WIRE MESH ALONG THE PERIMETER OF THE REMOVAL AREA AT A MAXIMUM SPACING OF 6" FROM THE EDGE OF THE REMOVAL. PROVIDE TIES AT 12" SPACING IN BOTH HORIZONTAL AND VERTICAL DIRECTIONS ALONG THE PERIMETER AND WITHIN THE AREA OF REMOVAL. IF EXISTING REINFORCEMENT IS SPACED AT GREATER THAN 12" SPACING OR NOT LOCATED TO PROVIDE THE LOCATIONS AS LISTED ABOVE, PROVIDE 1/2" GROUDED DOWELS AS SHOWN ON THE DRAWING TO PROVIDE THE LOCATIONS AT THE SAME SPACINGS.
- USE ONLY AN APPROVED POLYMER MODIFIED AND SPECIAL CEMENTS, MORTARS AND CONCRETES AS LISTED IN THE SPECIFICATIONS.
- SQUARE OF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MINIMUM TO 1" MAXIMUM BUT NOT TO THE DEPTH OF THE REINFORCEMENT STEEL BACK BEVEL EDGE BEYOND SAWCUT.
- USE HAND TOOLS TO REMOVE ALL LOOSE AND DELAMINATED CONCRETE TO PROVIDE A SOUND BOND BETWEEN EXISTING CONCRETE AND NEW CONCRETE. PNEUMATIC HAMMER WITH IMPACT RATINGS OF 3 FT-LBS OR LESS MAY BE USED IF REQUIRED.
- IF DETERIORATED CONCRETE EXTENDS BEYOND THE PRIMARY REINFORCEMENT, REMOVE THE CONCRETE TO AT LEAST 1" BEHIND THE REINFORCEMENT.
- APPLY AN EPOXY BONDING COMPOUND BETWEEN THE EXISTING AND THE NEW 3500 PSI CONCRETE.
- "W" REPRESENTS LEAST DIMENSION OF DETERIORATED CONCRETE.
- USE DOWELS ONLY WHEN "W" DIMENSION OF DETERIORATED CONCRETE IS GREATER THAN 2'-0" AND NEW OR EXISTING REINFORCEMENT CANNOT ADEQUATELY BE DEVELOPED BY LAPPING WITH EXISTING REINFORCEMENT.
- USE A PACHOMETER TO LOCATE EXISTING REINFORCEMENT WHEN DRILLING DOWEL HOLES TO LOCATE DRILLING THRU EXISTING BARS.
- AN APPROVED EPOXY ANCHORING SYSTEM IN 90° HOLES MAY REPLACE GROUT IN SLOPED HOLES. USE A 6" MINIMUM EMBEDMENT AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- A #4 DEFORMED EPOXY COATED OR GALVANIZED REINFORCEMENT BENT "L" BAR MAY REPLACE THE 1/2" DIAMETER DOWEL HOOK.
- ALTERNATIVE WIRE MESH MAY BE SUBSTITUTED FOR 2x2-W4xW4, PROVIDED WIRE SPACING DOES NOT EXCEED 4", AND AN EQUIVALENT STEEL AREA IS PROVIDED. NEW REINFORCEMENT BARS MAY BE OMITTED IF WIRE MESH STEEL EXCEEDS EXISTING REINFORCEMENT.
- CLEAN EXISTING REINFORCEMENT BY MECHANICAL MEANS AND APPLY EPOXY COATING.
- LAP EQUIVALENT NEW REINFORCEMENT TO THE EXISTING REINFORCEMENT AS DIRECTED.
- EXISTING AND NEW REINFORCEMENT BARS TO BE EPOXY COATED AND WELDED WIRE MESH TO BE GALVANIZED.

LEGEND

- REMOVE DETERIORATED CONCRETE.

- NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
 WORK ON THIS DRAWING:
 • CONCRETE REPAIRS.

C:\P\WORK\REF\17AN-S311.DWG


DATE PLOTTED: 10/9/2025

STATUS: 50% SUBMISSION

DRP ENGINEER: DMC
DRP ENGINEERING OFFICER: SB
DRP RAIL TRAFFIC OFFICER:
DRP SAFETY:
DRP SUPERVISING ENGINEER: SB
DRP GROUP ARCHITECT/ENGINEER:
PROJECT NUMBER:


HDR
HDR Engineering, Inc.
 Philadelphia, PA
MELISSA DESIGN
 250 MORGAN STREET
 PHILADELPHIA, PA. 19146
 (610) 933-0123

NO.	REV. DATE	BY	DESCRIPTION

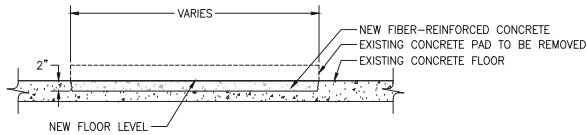


REMOVE EXISTING CONCRETE PAD TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. POUR NEW FIBER REINFORCED CONCRETE TO LEVEL FLOOR.

1 INTERIOR CONCRETE PAD REMOVAL
 S313 SCALE: N.T.S.



REMOVE EXISTING CONCRETE SLAB TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. SET FORM. POUR NEW FIBER REINFORCED CONCRETE TO NEW PAD LEVEL.


2 NEW INTERIOR CONCRETE PAD
 S313 SCALE: N.T.S.

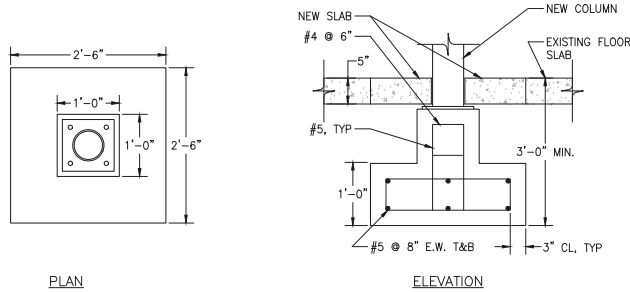

3 LALLY COLUMN FOUNDATION
 S313 SCALE: 1"=1'-0"

NOTES:
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.

WORK ON THIS DRAWING:
 • REMOVAL OF EXISTING CONCRETE EQUIPMENT PADS.
 • NEW CONCRETE EQUIPMENT PADS IN EXISTING SLAB.
 • NEW LALLY COLUMN FOUNDATION.




50% SUBMISSION
NOT FOR CONSTRUCTION


DATE: AS NOTED	SCALE FACTOR:
DATE: 08/22/2025	DRAWN BY: SB
PROJECT ORDER NO.: 276494	CHECKED BY: SB
SHEET NUMBER: S313	
DWG NO.: 14 of 21	
DTG NO.: 294 of 448	
ARCHIVE NO.:	
COMPUTER FILE NO.: 17AN-S313	
REV. NO.:	

DATE PLOTTED: 10/19/2025
 STATUS: 50% SUBMISSION


C:\P\WORKING\PROJECTS\17AN-S316.DWG

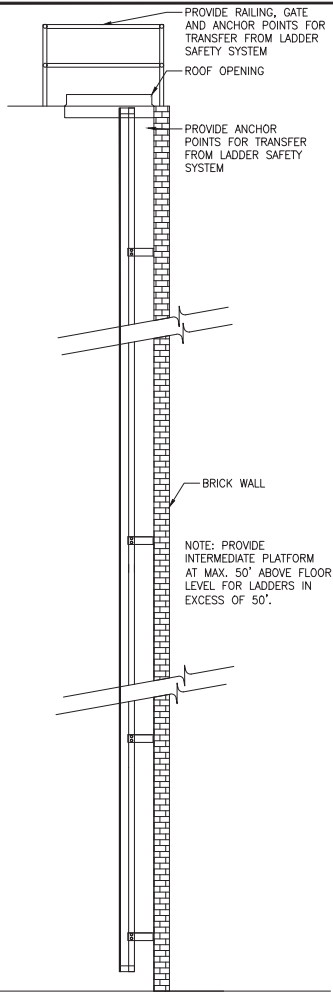


1 LADDER - SIDE ELEVATION
S316/SCALE: 3/8" = 1'-0"

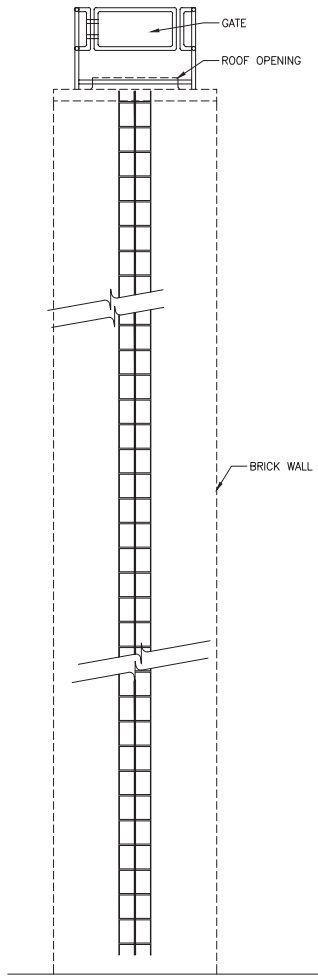


2 LADDER - FRONT ELEVATION
S316/SCALE: 3/8" = 1'-0"

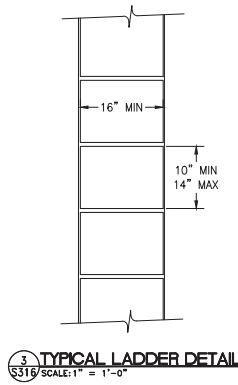


3 TYPICAL LADDER DETAIL
S316/SCALE: 1" = 1'-0"




4 FALL PROTECTION ON WALKWAY
S316/SCALE: 1" = 1'-0"

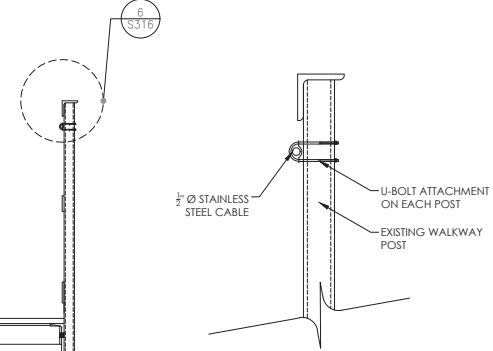

6 FALL PROTECTION ON WALKWAY
S316/SCALE: 3" = 1'-0"

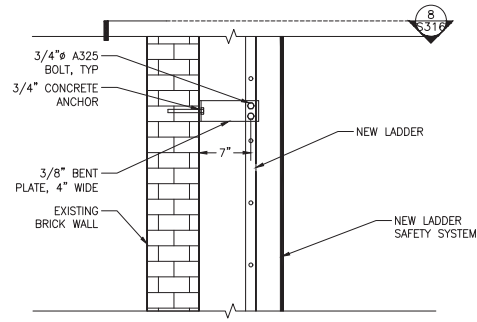

7 LADDER TO WALL CONNECTION
S316/SCALE: 1" = 1'-0"

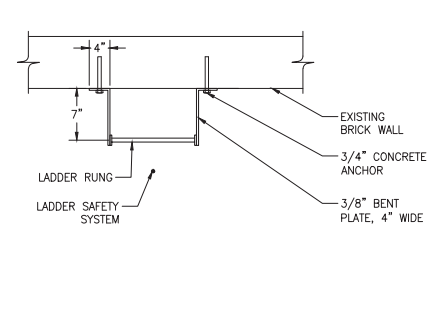

8 LADDER TO WALL CONNECTION
S316/SCALE: 1" = 1'-0"

NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
2. EXISTING ACCESS LADDERS SHALL BE REMOVED AND REPLACED WITH OSHA COMPLIANT LADDERS PER THIS DRAWING.

WORK ON THIS DRAWING:
• NEW LADDER.

LADDER SAFETY SYSTEM REQUIRED FOR ANY LADDER TALLER THAN 24', OR FOR ANY LADDER WHERE THE POTENTIAL FALL DISTANCE IS GREATER THAN 24'



SCALE: 3/8" = 1'-0"



1 INCH

50% SUBMISSION
NOT FOR CONSTRUCTION



1124 MARKET ST., 15TH FL.
PHILADELPHIA, PA. 19107

DRP ENGINEER: DMSC
DRP ENGINEERING OFFICE: DMSC
DRP RAIL TRAFFIC OFFICER:
DRP SAFETY:
DRP DIRECTOR OF ENGINEERING: DMSC
DRP GROUP ARCHITECT/ENGINEER:
PROJECT NUMBER:

HDR
HDR Engineering, Inc.
Philadelphia, PA
MELISSA DESIGN
250 MORRAN STREET
PHILADELPHIA, PA 19146-0
16 101 933-0123

NO.	DATE	BY	DESCRIPTION

LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
FALL PROTECTION DETAILS - SHEET 1

DATE: AS NOTED
DATE: 08/22/2025
PROJECT NUMBER: 276494
SHEET NUMBER: **S316**
DRAWING NO.: 17 OF 21
SHEET NO.: 297 OF 448
COMPUTER FILE NO.: 17AN-S316

DATE PLOTTED: 10/9/2025
STATUS: 50% SUBMISSION


DRP ENGINEER - DMC:	
DRP ENGINEERING OFFICER - SBA:	
DRP RAIL TRAFFIC OFFICER:	
DRP SAFETY:	
DIRECTOR OF ENGINEERING - SBA:	
SENIOR ARCHITECT/ENGINEER:	
PROJECT MANAGER:	

REV	DATE	DESCRIPTION	BY	APP'D


LOUDON
SUBWAY/ELEVATED TRAINS
TRACTION POWER SUBSTATION
REHABILITATION
STRUCTURAL
BUILDING DETAILS - SHEET 1

DATE:	AS NOTED	SCALE FACTOR:	
DATE:	08/22/2025	DRAWN BY:	SSJ
PROJECT NUMBER:	276494	CHECKED BY:	JJA
SHEET NUMBER:	S317		
DWG NO.:	18	OF	21
CON. NO.:	288	OF	448
PROJECT FILE NO.:	17AN-S317		


DATE PLOTTED: 10/19/2025
STATUS: 50% SUBMISSION

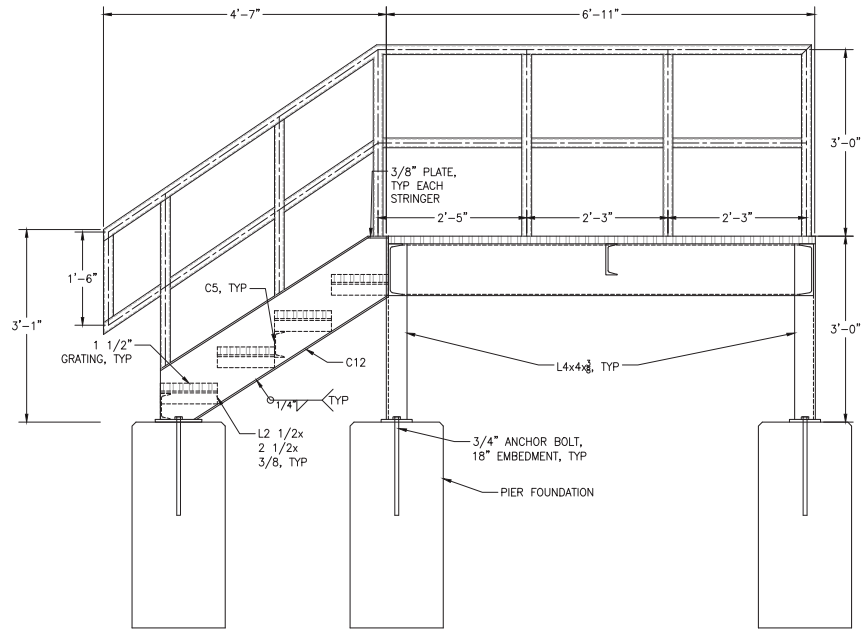

1 FRONT METAL STAIRS - SECTION
S317 SCALE: 1" = 1'-0"

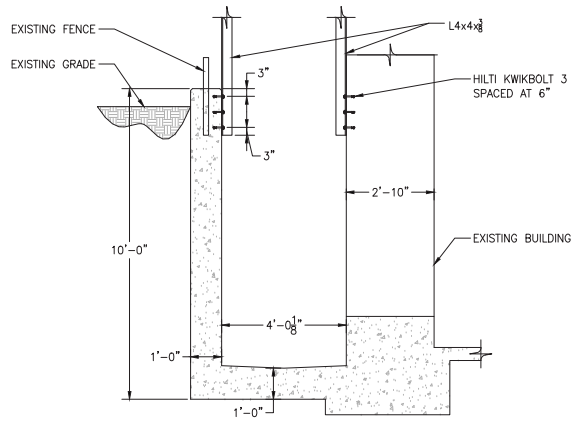


3 REAR AFTAWAY STAIR DETAIL
S317 SCALE: N.T.S.

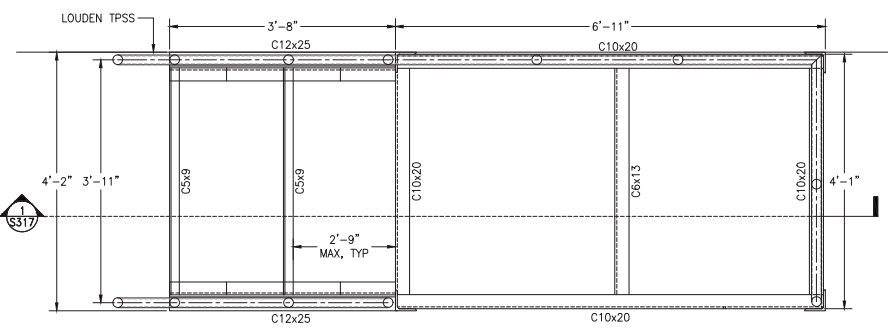

2 FRONT METAL STAIRS - PLAN
S317 SCALE: 1" = 1'-0"

NOTES:
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S300.
WORK ON THIS DRAWING:
• NEW STAIRS.



50% SUBMISSION
NOT FOR CONSTRUCTION

