
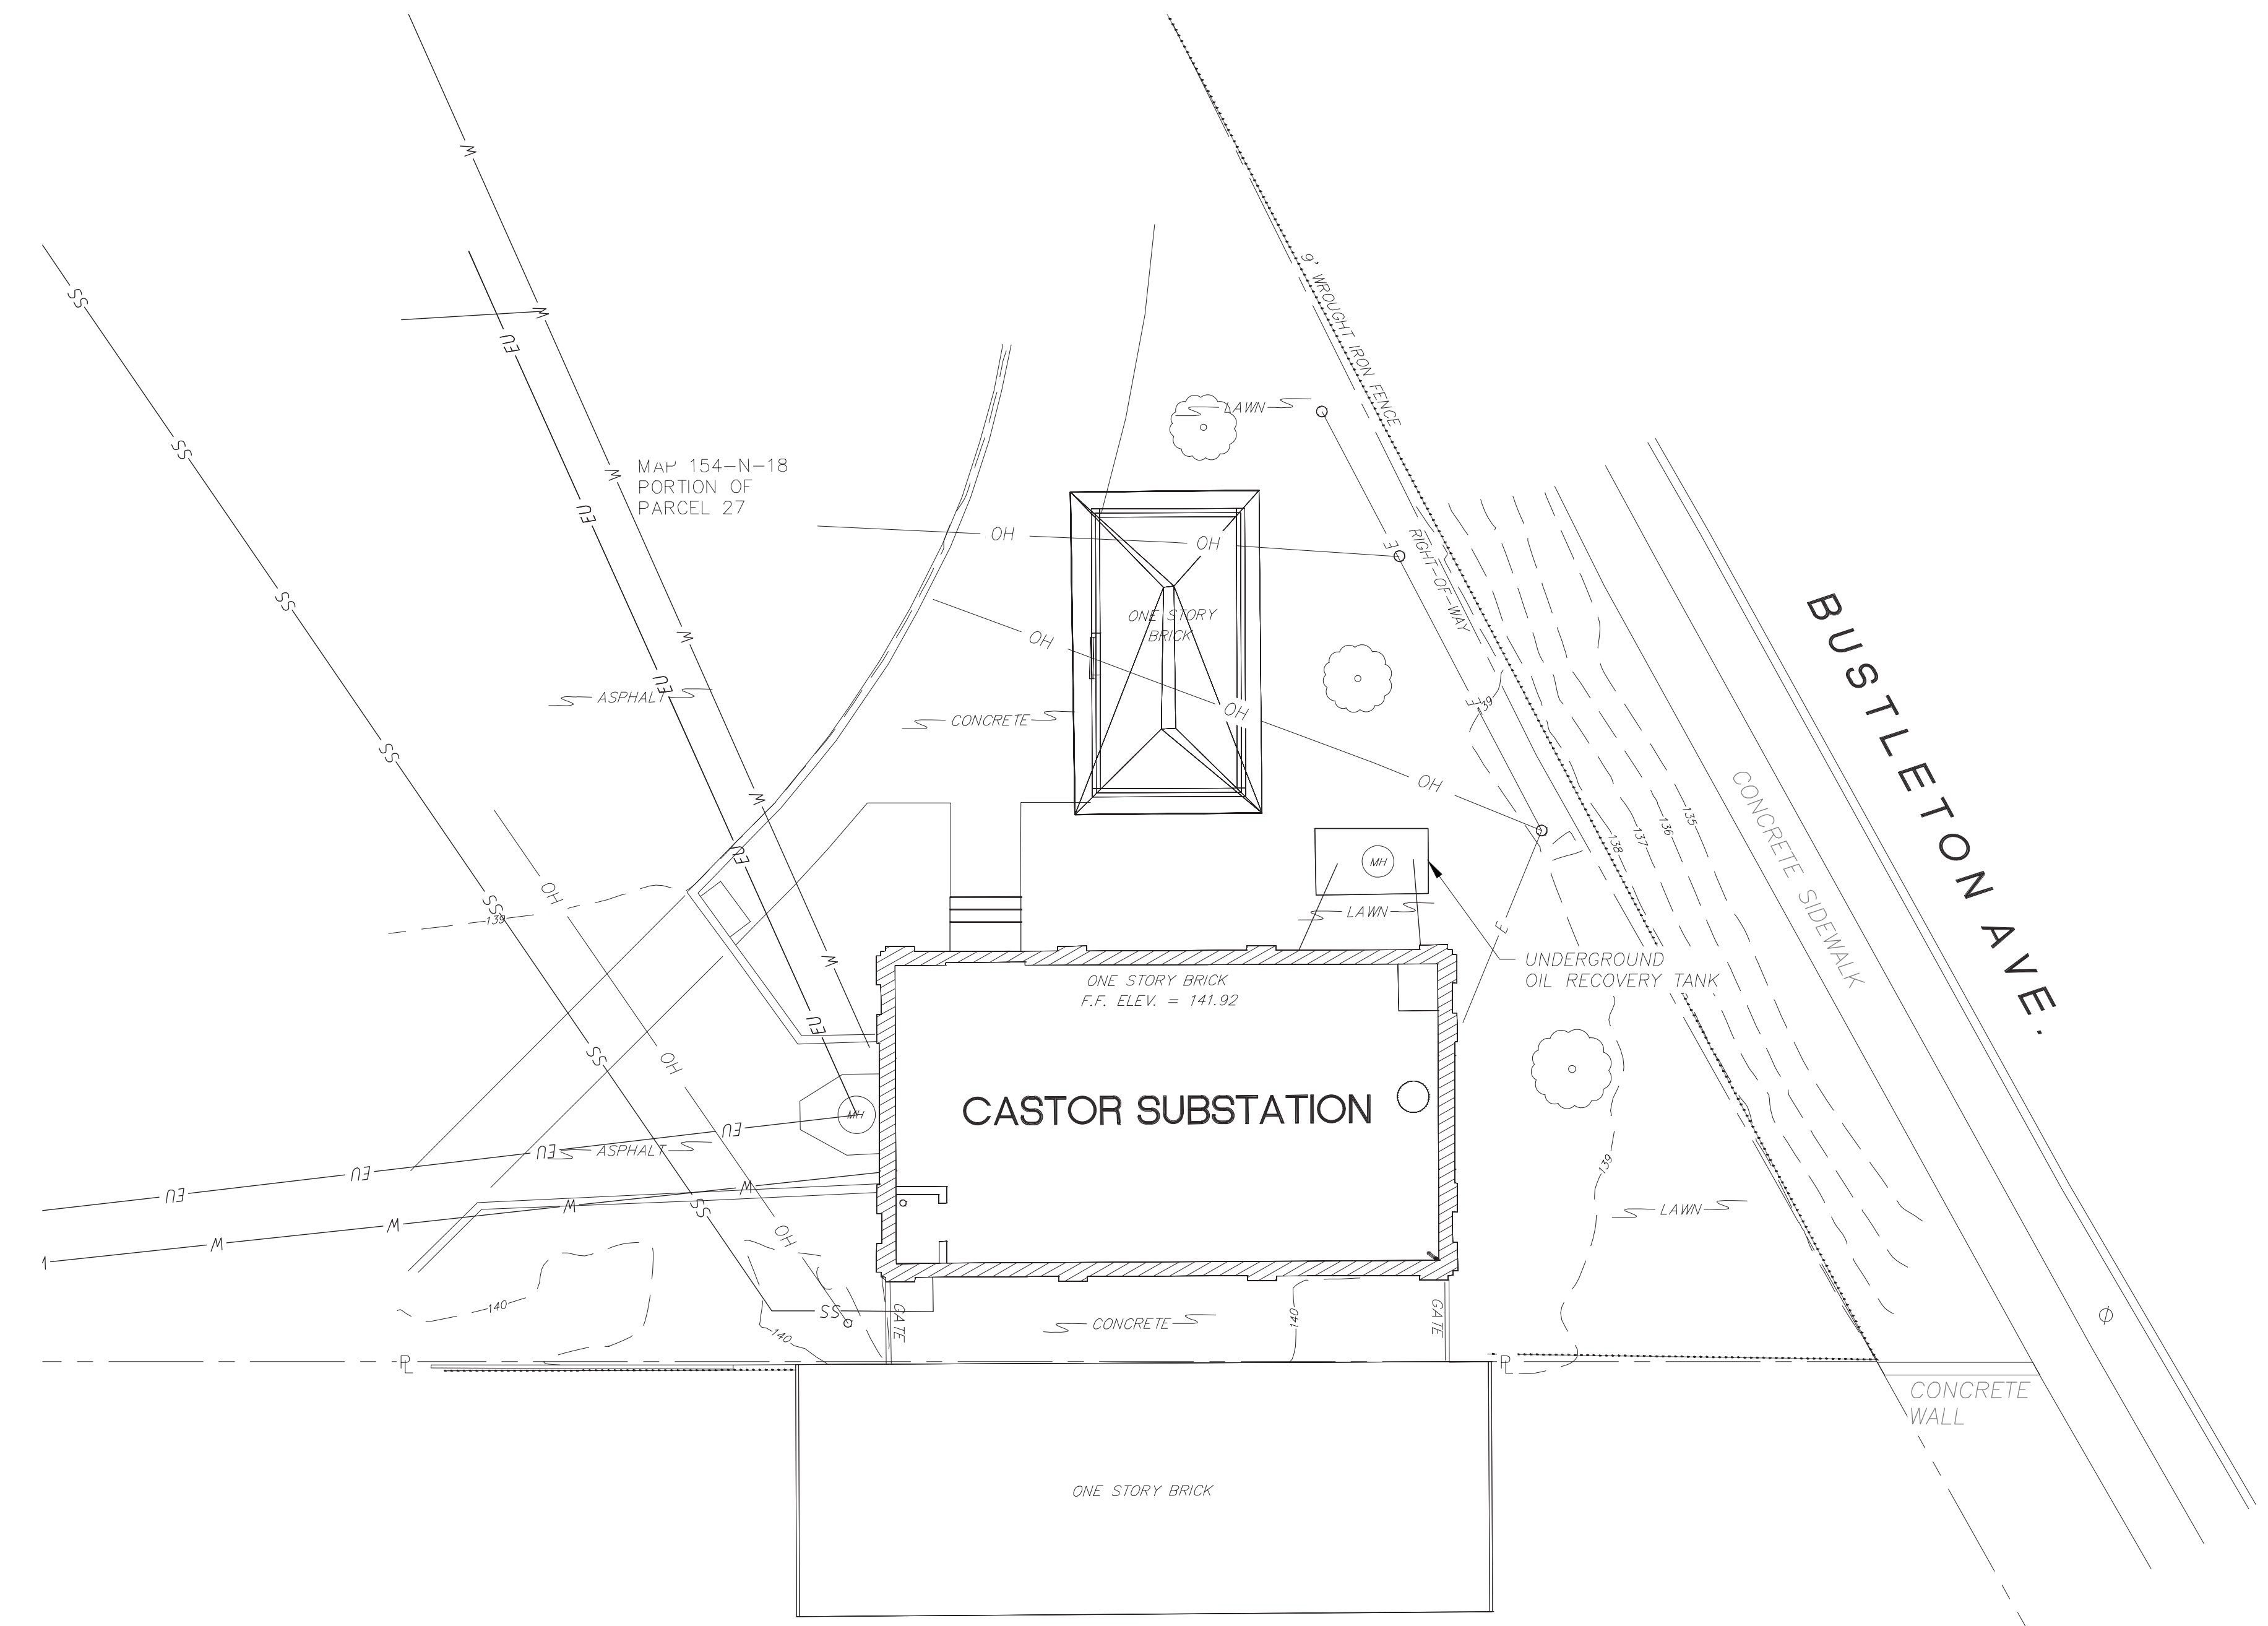


REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**CIVIL**  
EXISTING CONDITIONS

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	ARG
		CHECKED BY:	SG
WORK ORDER NO.:	276496		
SHEET NUMBER:	<b>C400</b>		
DWG. NO.:	1	OF	3
SHT. NO.:	378	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-C400	REV. NO.:	-

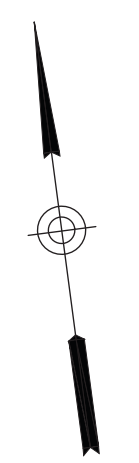

**CALL BEFORE YOU DIG**  
PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS NOTICE FOR CONSTRUCTION PHASE AND 10 WORKING DAYS IN DESIGN STAGE - STOP CALL 1-800-242-1776  
[WWW.PA1CALL.ORG](http://WWW.PA1CALL.ORG)  
DESIGN # 2017 038 1861  
CONSTRUCTION # \_\_\_\_\_

- LEGEND:**
- W— EXISTING WATER LINE
  - EU— EXISTING UNDERGROUND ELECTRIC
  - E— EXISTING ELECTRIC
  - OH— OCS SUPPORT CABLE
  - SS— EXISTING SANITARY SEWER
  - R— PROPERTY LINE
  - (MH) EXISTING MANHOLE

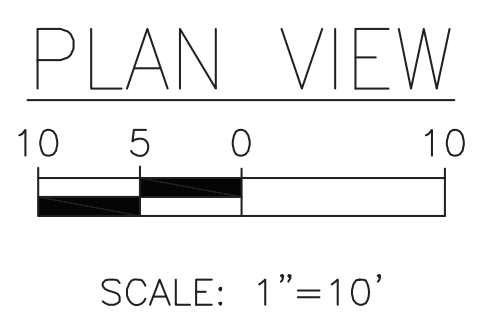

- NOTES:**
- VERTICAL DATUM NAVD 88 AND HORIZONTAL DATUM PENNSYLVANIA STATE PLANE COORDINATE SYSTEM SOUTH ZONE (NAD 83) ESTABLISHED BY GLOBAL POSITIONING SYSTEM METHODOLOGY.
  - UNDERGROUND UTILITIES AND FACILITIES HAVE BEEN PLOTTED FROM MULTIPLE SOURCES AND ARE SHOWN IN APPROXIMATE LOCATIONS. FIELD VERIFY AS NECESSARY.
  - EXISTING FEATURES SHOWN HEREON ARE DEPICTED AS THEY EXISTED IN MARCH 2016.
  - PROPERTY LINE INFORMATION HEREON SHOULD BE CONSIDERED APPROXIMATE AND SHOWN FOR INFORMATIONAL PURPOSES ONLY, BASED ON THE PHILADELPHIA DEPARTMENT OF RECORDS TAX MAP 154-N-18.

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**



C:\PI\WORKING\PI\17\17AN-C400.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**CIVIL**  
SITE PLAN

SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: ARG
WORK ORDER NO: 276496	CHECKED BY: SG
SHEET NUMBER: <b>C401</b>	
DWG. NO.: 2 OF 3	SHT. NO.: 379 OF 452
COMPUTER FILE NO.: 17AN-C401	REV. NO.: -

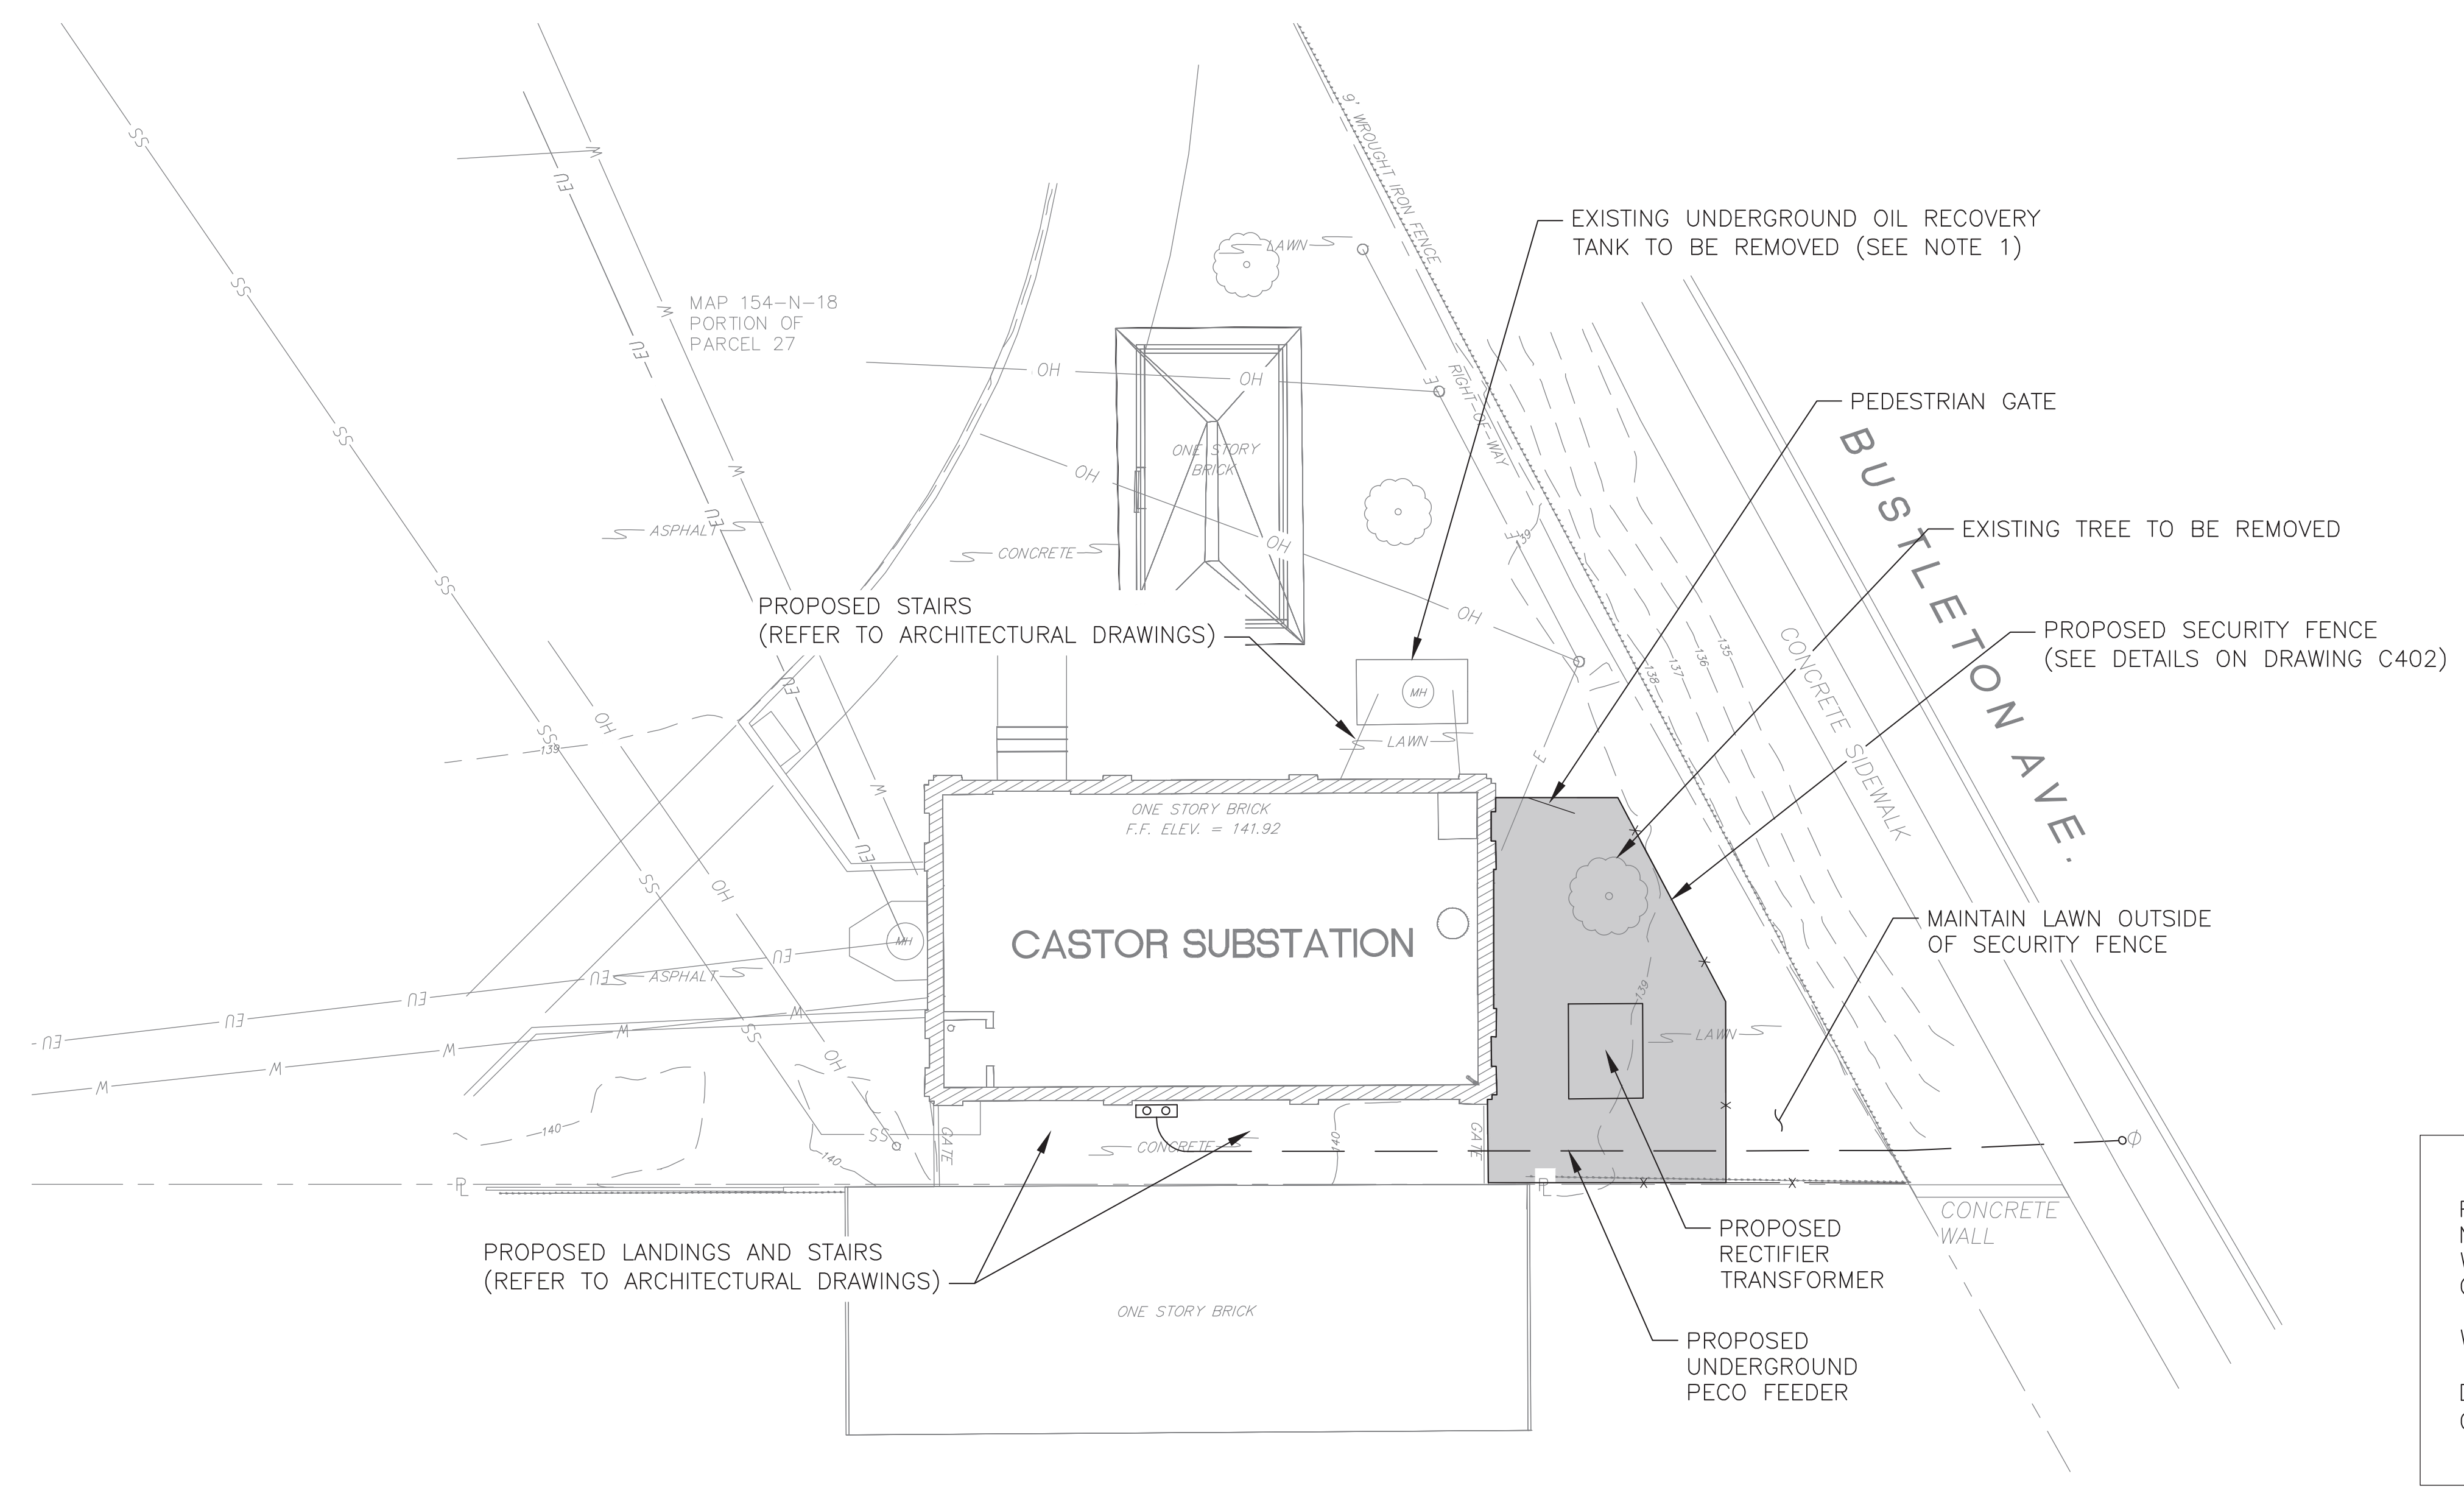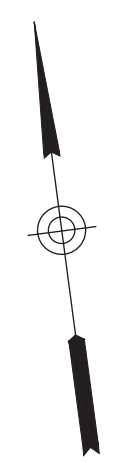


**CALL BEFORE YOU DIG**  
PENNSYLVANIA LAW REQUIRES 3 WORKING DAYS NOTICE FOR CONSTRUCTION PHASE AND 10 WORKING DAYS IN DESIGN STAGE - STOP CALL 1-800-242-1776

WWW.PA1CALL.ORG

DESIGN # 2017 038 1861  
CONSTRUCTION # \_\_\_\_\_

- LEGEND:**
- W— EXISTING WATER LINE
  - EU— EXISTING UNDERGROUND ELECTRIC
  - E— EXISTING ELECTRIC
  - OH— OCS SUPPORT CABLE
  - SS— EXISTING SANITARY SEWER
  - PL— PROPERTY LINE
  - MH— EXISTING MANHOLE
  - X— PROPOSED FENCE
  - TRANSFORMER YARD CRUSHED STONE
  - — — PROPOSED PECO FEEDER

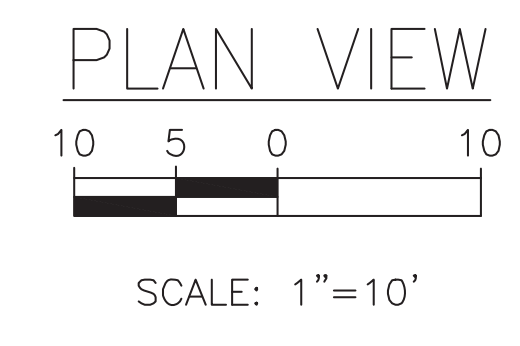

- NOTES:**
- RESTORE LOCATION OF OIL RECOVERY TANK TO PRE CONSTRUCTION GRADE AND RESTORE LAWN COVER.
  - TRANSFORMER YARD TO BE LINED WITH 4" CRUSHED STONE ON A GEOTEXTILE LINER. (SEE DETAIL ON DRAWING C402). CRUSHED STONE TO EXTEND 6 FEET BEYOND PERIMETER OF NEW FENCE.

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\PI\WORKING\PI\10197913317AN-C401.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION



**LEGEND—SYMBOLS:**

SYMBOL	DESCRIPTION
	DIMENSION TO CENTER LINE
	DIMENSION TO FINISHED FACE
	DIMENSION TO ROUGH FACE
	DRAWING TITLE
	ELEVATION REFERENCE
	INTERIOR ELEVATION REFERENCE
	DETAIL REFERENCE
	SECTION REFERENCE
	PARTITION TYPE
	REVISION NUMBER
	DOOR NUMBER
	WINDOW NUMBER
	COLUMN GRID NUMBER
	REFERENCE ELEVATION LINE
	EXISTING DOOR
	NEW DOOR
	ACCESSIBLE SYMBOL
	STAIR/RAMP DIRECTION
	ROOF PITCH
	EXISTING SPOT ELEVATION
	NEW SPOT ELEVATION
	NORTH ARROW

**LEGEND—HATCH PATTERNS:**

SYMBOL	DESCRIPTION
	EARTH
	SAND
	CAST STONE
	CONCRETE
	BRICK
	MASONRY—CMU
	GLAZED CMU
	2-HOUR FIRE RATED CMU WALL
	CERAMIC TILE
	RIGID INSULATION BOARD
	SOFT INSULATION
	WOOD FRAMING—CONTINUOUS
	WOOD BLOCKING
	PLYWOOD
	FINISH WOOD
	STEEL
	ALUMINUM

**GENERAL NOTES:**

- ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE CONTRACT DOCUMENTS INCLUDING THE SPECIFICATIONS AND THESE DRAWINGS.
- DETAILS SHOWN ARE TYPICAL; SIMILAR DETAILS APPLY TO SIMILAR CONDITIONS UNLESS OTHERWISE NOTED.
- THE DRAWINGS INDICATE A SPECIFIC DESIGN INTENT. THIS INTENT IS NOT SUBJECT TO SUBSTITUTION. WHERE SPECIFIC MATERIALS ARE IDENTIFIED AND ARCHITECTURAL STYLES SHOWN, THESE SHALL BE PROVIDED UNLESS APPROVED OTHERWISE.
- ALL WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE COMMONWEALTH OF PENNSYLVANIA CODES, RULES AND REGULATIONS, LOCAL CODES AND ALL OTHER STATE AGENCIES HAVING JURISDICTION OVER ANY PORTION OF WORK SPECIFIED IN THESE DOCUMENTS.
- THE CONTRACTOR SHALL SUBMIT A WORKPLAN FOR SEPTA APPROVAL, SHOWING A DETAILED WORK SCHEDULE.
- THE DIMENSIONS SHOWN ON THE DRAWINGS MAY VARY FROM THE ACTUAL EXISTING DIMENSIONS IN THE FIELD. IT IS, THEREFORE, IMPERATIVE THAT THE CONTRACTOR, PRIOR TO COMMENCEMENT OF WORK, TAKE EXACT MEASUREMENTS TO VERIFY ALL DIMENSIONS SHOWN ON THE DRAWINGS AS WELL AS OBTAIN OTHER NECESSARY DIMENSIONS FOR THE PURPOSE OF PREPARING SUBMITTALS. SHOP DRAWINGS AND ANY OTHER DRAWINGS PREPARED BY THE CONTRACTOR SHALL INCLUDE A STATEMENT CERTIFYING THAT THOSE HAVE BEEN PREPARED IN ACCORDANCE WITH THE FIELD—MEASURED DIMENSIONS.
- THE SEPTA PROJECT MANAGER SHALL BE NOTIFIED IN WRITING OF ANY CONDITIONS THAT VARY FROM THOSE SHOWN ON THE DRAWINGS. THE CONTRACTOR'S WORK SHALL NOT VARY FROM THE DRAWINGS WITHOUT THE EXPRESS WRITTEN APPROVAL OF THE SEPTA PROJECT MANAGER.
- THE CONTRACTOR IS INSTRUCTED TO COOPERATE WITH SEPTA'S REPRESENTATIVES AND ALL OTHER CONTRACTORS PERFORMING WORK ON THIS JOB SITE DURING THE PERFORMANCE OF THIS CONTRACT.
- UNLESS OTHERWISE NOTED ON THE DRAWINGS AND SPECIFICATIONS, ALL FACILITIES SHALL REMAIN IN PLACE AND IN SERVICE DURING DEMOLITION AND CONSTRUCTION UNLESS OTHERWISE NOTED. THE CONTRACTOR SHALL PROTECT, PRESERVE, INCORPORATE, AND TEMPORARILY RELOCATE (IF REQUIRED) AND SUPPORT ALL EXISTING FACILITIES, STRUCTURE, UTILITIES, AND OTHER ITEMS TO REMAIN, SUBJECT TO THE APPROVAL OF THE SEPTA PROJECT MANAGER. THE CONTRACTOR IS TO REPAIR OR REPLACE ANY ITEMS DAMAGED DURING THE COURSE OF WORK TO THE SATISFACTION AND APPROVAL OF THE SEPTA PROJECT MANAGER AT NO ADDITIONAL COST TO SEPTA.
- THE CONTRACTOR SHALL MAINTAIN FLOW FOR ALL EXISTING UTILITIES. COORDINATE ANY REQUIRED SHUTDOWNS WITH THE SEPTA PROJECT MANAGER.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND INCURRING THE COST OF ALL REQUIRED PERMITS AND CERTIFICATES.
- THE CONTRACTOR SHALL COMPLY WITH ALL REQUIRED PERMITS.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO EXAMINE ALL DRAWINGS AND SPECIFICATIONS, AND COORDINATE WORK WITH ALL OTHER CONTRACTORS AND SUBCONTRACTORS FOR THIS PROJECT.
- THE CONTRACTOR SHALL TAKE REASONABLE CARE TO MAINTAIN A SAFE AND SECURE WORK AREA AT ALL TIMES THROUGH THE USE OF, AMONG OTHER THINGS, SAFETY EQUIPMENT, FENCING, TEMPORARY DIRECTIONAL SIGNAGE AND FALL PROTECTION.
- ACCESS TO THE WORK SITE AND STORAGE OF MATERIALS AND EQUIPMENT ON THE PREMISES OR AS DETERMINED BY SEPTA SHALL BE APPROVED BY THE SEPTA PROJECT MANAGER.
- THE CONTRACTOR SHALL KEEP THE ADJACENT WORK AREAS, STAGING AREAS AND BUILDING ACCESS AREAS CLEAN OF DEBRIS, AND WILL BE RESPONSIBLE FOR ALL MAINTENANCE AND CLEANING OF THESE AREAS DURING THE COURSE OF THE PROJECT.
- SEPTA REQUIRES ALL PERSONNEL WORKING ON THEIR PROPERTY TO HAVE A SEPTA PHOTO IDENTIFICATION. SEPTA WILL ARRANGE TO HAVE THE IDENTIFICATION CARDS MADE AT THE BEGINNING OF THE CONTRACT AND THROUGHOUT THE DURATION OF THE CONTRACT.
- SHOULD UNFORESEEN CONDITIONS OR OTHER CAUSES NECESSITATE CONSTRUCTION DETAILS NOT IN ACCORDANCE WITH THESE DRAWINGS, THE CONTRACTOR SHALL NOTIFY THE SEPTA PROJECT MANAGER.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO PROCURE AND PAY FOR THE RENTAL EXPENSES AND THE MAINTENANCE OF TRAILERS AND OTHER RENTAL EQUIPMENT FOR THE ENTIRE DURATION OF THE PROJECT. THIS CONSISTS OF BUT IS NOT LIMITED TO ALL LABOR, MATERIAL, EQUIPMENT AND SERVICES REQUIRED.
- WRITTEN DIMENSIONS ON THE DRAWINGS SHALL TAKE PRECEDENCE, SCALING OF DRAWINGS IS PROHIBITED. LARGE SCALE DRAWINGS SHALL TAKE PRECEDENCE OVER SMALL SCALE DRAWINGS.
- ALL LUMBER EXPOSED TO THE ELEMENTS OR IN CONTACT WITH MASONRY SHALL BE PRESSURE—TREATED.
- THE CONTRACTOR IS TO PROTECT ALL AREAS IN SUCH A MANNER AS TO ELIMINATE HAZARDS TO PERSONS AND PROPERTY; TO MINIMIZE INTERFERENCE WITH USE OF ADJACENT AREAS, UTILITIES AND STRUCTURES, OR INTERRUPTION OF USE OF SUCH UTILITIES.
- IF CHANGE TO THE PROJECT IS REQUIRED, THE CONTRACTOR IS RESPONSIBLE FOR PROVIDING INFORMATION ABOUT IMPACT OF CHANGE ON CONSTRUCTION SCHEDULE.
- ALL FINISH COLORS TO BE DETERMINED BY THE SEPTA PROJECT MANAGER.
- ALL EXISTING CONDITIONS ARE TO BE FIELD—VERIFIED BEFORE COMMENCEMENT OF WORK.
- ALL NEWLY INSTALLED MATERIALS SHALL BE ASBESTOS—FREE.
- ALL SPECIFIED MANUFACTURERS AND MODEL NUMBERS INDICATE BASIS OF DESIGN PRODUCTS. PROPOSED ALTERNATES AND EQUIVALENTS MUST BE REVIEWED AND APPROVED BY THE SEPTA PROJECT MANAGER.
- ALL MATERIALS AND PRODUCTS IN THIS PROJECT MUST COMPLY WITH THE BUY AMERICA ACT.
- THE CONTRACTOR IS RESPONSIBLE FOR SECURITY OF HIS MATERIAL AND PROPERTY.
- THE CONTRACTOR IS RESPONSIBLE FOR ALL TEMPORARY UTILITIES.
- THE CONTRACTOR IS RESPONSIBLE FOR SNOW REMOVAL.
- CONSTRUCTION/TREATMENTS/ETC AT THE SPECIFIC SITE WILL BE SIMILAR AT ALL OTHER LOCATIONS UNDER THE CONTRACT UNLESS OTHERWISE NOTED.

**DEMOLITION NOTES:**

- DO NOT ALLOW DEMOLISHED OR REMOVED MATERIALS TO DROP, FALL OR IMPACT AGAINST STRUCTURES TO REMAIN. PROTECT ALL STRUCTURES TO REMAIN FROM DAMAGE OF ANY KIND.
- REMOVE ALL DEMOLISHED MATERIAL PROMPTLY FROM SITE.
- AFTER REMOVAL AND PATCHING OF ELEMENTS, THE FINISHED APPEARANCE SHALL MATCH ADJACENT EXISTING SURFACES AND FINISHES.
- NO DIGGING OR EXCAVATION MAY TAKE PLACE PRIOR TO PLACING A PA ONE CALL FOR THE ENTIRE PROJECT SITE. IN ADDITION, NO DIGGING OR EXCAVATION MAY TAKE PLACE PRIOR TO THE LOCATING OF NEAR AND ADJACENT BURIED AND OVERHEAD UTILITIES.
- WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
- WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.

**SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY**  
EMBC DIVISION  
1234 MARKET ST., 13TH FL.  
PHILADELPHIA, PA 19107

CHEF ENGINEER-EMBC  
CHEF ENGINEERING OFFICER-EMBC  
CHEF RAIL TRANSIT OFFICER  
SYSTEM SAFETY  
DIRECTOR OF ENGINEERING-EMBC  
MANAGER-ARCHITECTURAL ENGINEERING  
PROJECT MANAGER

**HDR**  
HDR Engineering, Inc.  
Philadelphia, PA

**SOWINSKI SULLIVAN**

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
GENERAL NOTES & LEGENDS

SCALE: AS SHOWN  
DATE: 10/16/2017  
WORK ORDER NO.: 276496  
SHEET NUMBER: **A400**  
DWG. NO.: 1 OF 12  
SHT. NO.: 380 OF 452  
ARCHIVE NO.:  
COMPUTER FILE NO.: 17AN-A400  
REV. NO.: -

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\689\0517AN-A400.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION



REV	DATE	DESCRIPTION	BY	CHKD	APPD

DATE PRINTED: 10/21/2025

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
CODE DATA


SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	10/16/2017	DRAWN BY:	AC
WORK ORDER NO.:	276496	CHECKED BY:	BF
SHEET NUMBER:	<b>A402</b>		
DWG. NO.:	3	OF	12
SHT. NO.:	382	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-A402	REV. NO.:	1

STATUS: 50% SUBMISSION


2009 INTERNATIONAL EXISTING BUILDING CODE	
CHAPTER 4 - CLASSIFICATION OF WORK	
404.1	ALTERATION LEVEL 2

2009 INTERNATIONAL BUILDING CODE					
CODE SECTION	SECTION TITLE	CODE REQUIREMENT	EXISTING	PROVIDED	REMARKS
CHAPTER 3 - USE AND OCCUPANCY CRITERIA					
306	USE GROUP	F-1	F-1	F-1	BUILDING IS UNMANNED AND TYPICALLY UNOCCUPIED
CHAPTER 5 - USE AND OCCUPANCY CLASSIFICATION					
TABLE 503	HEIGHT/AREA	2 ST (55 FT) 15,500 SF	1 ST 1,020 SF	1 ST 1,020 SF	
CHAPTER 6 - TYPES OF CONSTRUCTION					
TABLE 601	FIRE RESISTANCE RATING				
	PRIMARY STRUCTURE	IIB	IIB	IIB	
	BEARING WALLS EXTERIOR	0	0	0	
	BEARING WALLS INTERIOR	0	0	0	
	NON-BEARING WALLS EXT.	SEE TABLE 602			
	NON-BEARING WALLS INT.	0	0	0	
	FLOOR CONSTRUCTION	0	0	0	
	ROOF CONSTRUCTION	0	0	0	
TABLE 602	FIRE-RESISTANCE RATING REQUIREMENTS FOR EXTERIOR WALLS BASED ON FIRE SEPARATION DISTANCE				
	5 FT TO LESS THAN 10 FT	1 HOUR	0 HOURS	0 HOURS	EXISTING NON COMPLIANT
CHAPTER 7 - FIRE AND SMOKE PROTECTION FEATURES					
708.4	SHAFT ENCLOSURE, LESS THAN 4 STORIES	1 HOUR RATED	N/A	N/A	
TABLE 705.8	MAXIMUM AREA OF EXTERIOR WALL OPENINGS BASED ON FIRE SEPARATION DISTANCE AND DEGREE OF PROTECTION				
	5 FT TO LESS THAN 10 FT UNPROTECTED, NON-SPRINKLERED	10%	21%	13%	EXISTING NON-COMPLIANT
CHAPTER 8 - INTERIOR FINISHES					
TABLE 803.9	INTERIOR WALL AND CEILING FINISHES (NOT SPRINKLERED)				
	ROOMS AND ENCLOSED SPACES	CLASS C	N/A	CLASS C	
	CORRIDORS	CLASS C	N/A	CLASS C	
	EXIT PASSAGEWAYS	CLASS B	N/A	CLASS B	
CHAPTER 9 - FIRE PROTECTION SYSTEMS					
903.2.4	GROUP F-1				
	AREA EXCEEDS FIRE AREA LOCATED MORE THAN 3 STORIES ABOVE GRADE	12,000 SF	1,020 SF	1,020 SF	
	COMBINED FIRE AREA	3 STORIES 24,000 SF	1 STORY 1,020 SF	1 STORY 1,020 SF	
CHAPTER 10 - MEANS OF EGRESS					
TABLE 1004.1.1	OCCUPANT LOAD				
	ACCESSORY STORAGE AREA/ MECHANICAL EQUIPMENT ROOM	300 SF/PER PERSON	4 PERSONS	4 PERSONS	
1005.1	MINIMUM REQUIRED EGRESS WIDTH				
	STAIRS	0.3" PER PERSON	58"	166"	
	OTHER EGRESS COMPONENTS	0.2" PER PERSON	34"	175"	
NOTE					
1. AUTOMATIC SPRINKLER SYSTEM NOT REQUIRED IF ALL THREE CRITERIA ARE MET PER 903.2.4.					
2. BUILDING IS UNMANNED AND TYPICALLY UNOCCUPIED.					

PHILADELPHIA PLUMBING CODE					
CODE SECTION	SECTION TITLE	CODE REQUIREMENT	EXISTING	PROVIDED	REMARKS
TABLE P-701 MINIMUM NUMBER OF PLUMBING FIXTURES					
	WATER CLOSET (MALE/FEMALE)	1-10 PERSONS=1	1	1	
	LAVATORY (MALE/FEMALE)	1 PER 10 PERSONS=1	1	1	
	DRINKING FOUNTAIN	1 PER 75 PERSONS=1	1	1	EXISTING WATER COOLER
NOTE					
1. WATER CLOSET AND 1 LAVATORY MAY BE USED FOR BOTH SEXES FOR OCCUPANT LOAD OF 6 OR FEWER.					
2. DRINKING FOUNTAIN NOT REQUIRED FOR OCCUPANT LOAD OF 6 OR FEWER.					
3. BUILDING IS UNMANNED AND TYPICALLY UNOCCUPIED.					

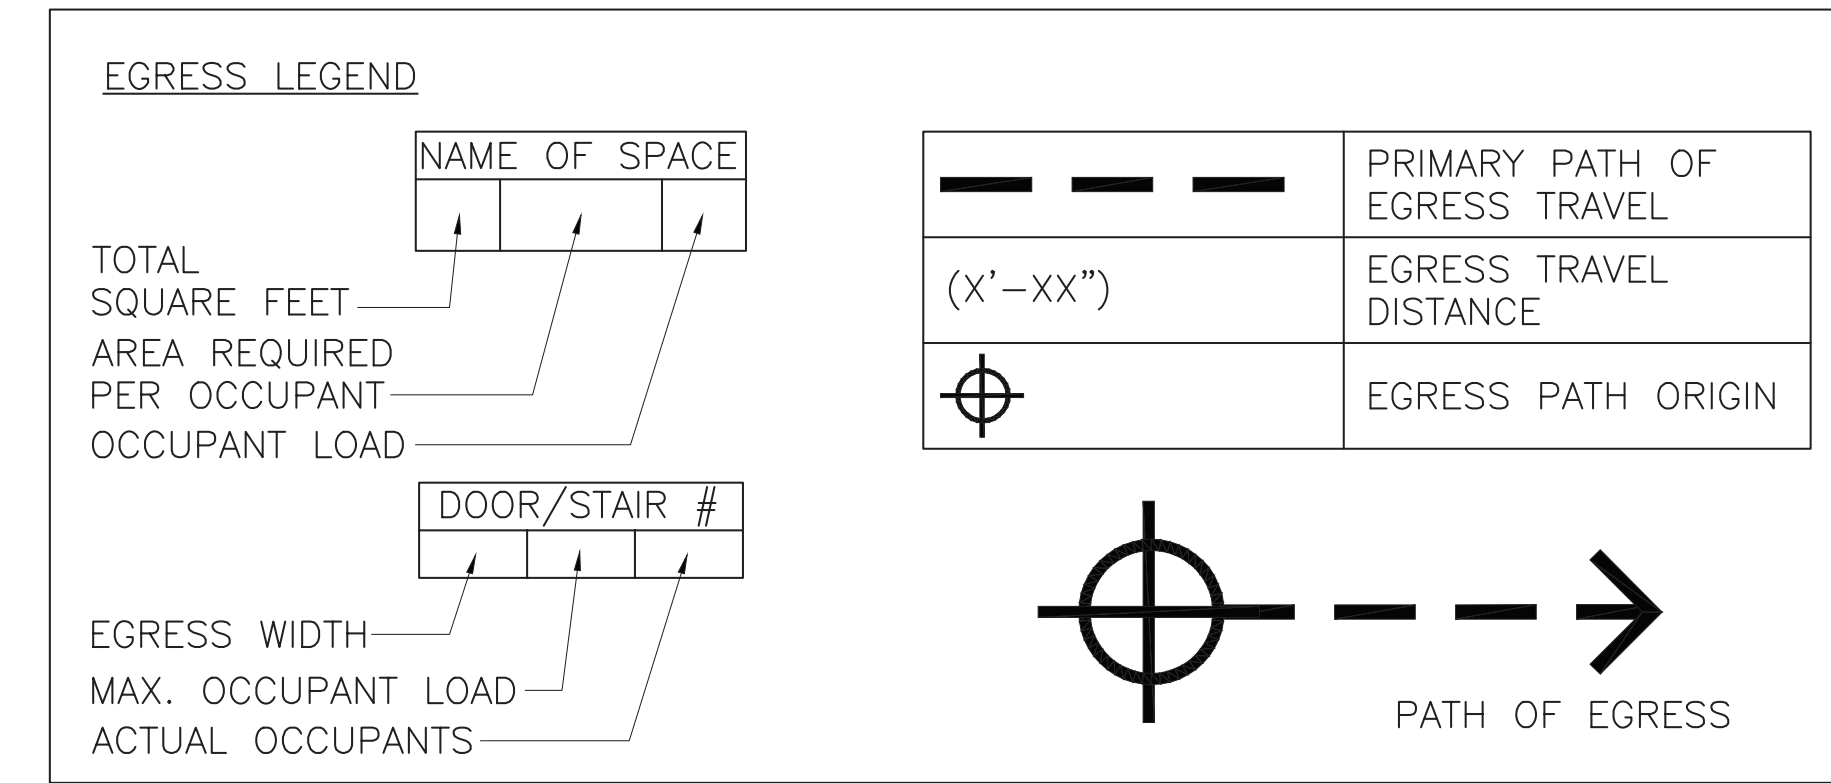

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

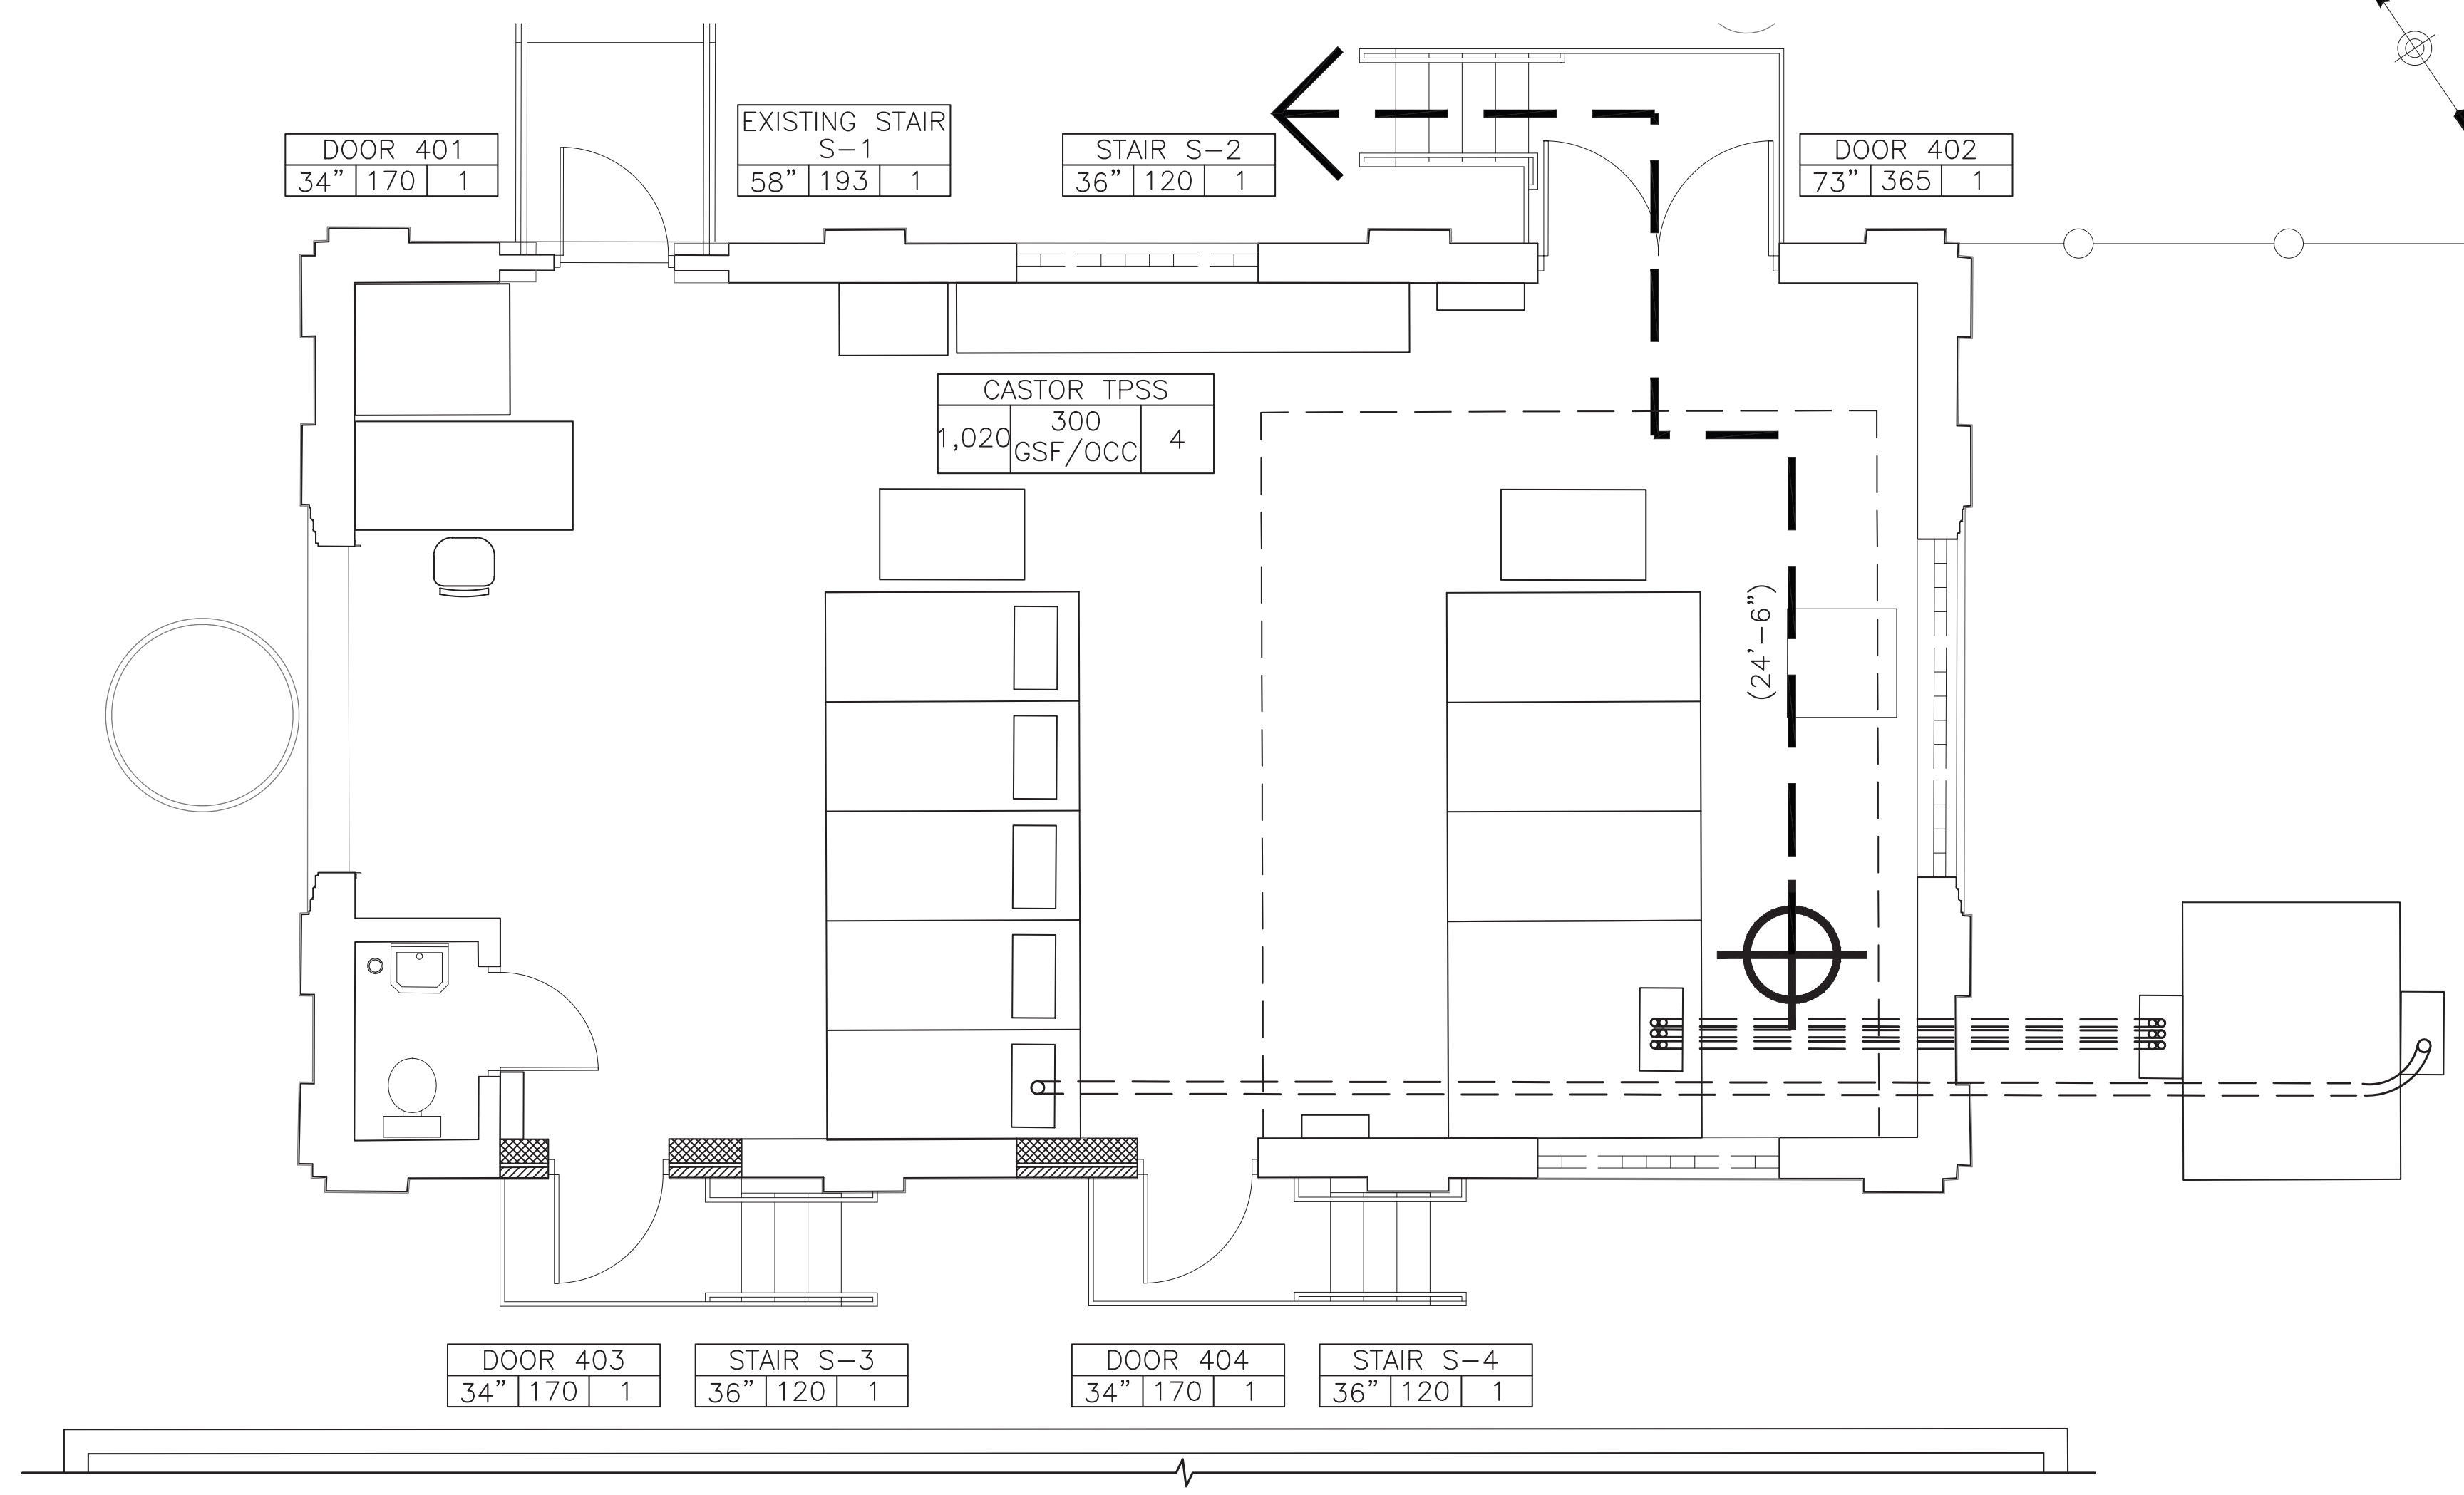

**1** EGRESS PLAN  
SCALE: 1/4" = 1'-0"  
SCALE: 1/4" = 1'-0"


C:\P\WORKING\PTTD\68910517AN-A402.DWG

REV	DATE	DESCRIPTION	BY	CHKD	APPD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
GROUND FLOOR REMOVAL PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	10/16/2017	DRAWN BY:	AC
		CHECKED BY:	BF
WORK ORDER NO.:	276496		
SHEET NUMBER:	<b>A403</b>		
DWG. NO.:	4	OF	12
SHT. NO.:	383	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-A403		
REV. NO.:	-		

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
  2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
  3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
  4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
  5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
  6. FLOOR WILL BE MADE AVAILABLE IN STAGES AS THE EXISTING EQUIPMENT IS REMOVED PER OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN.
  7. REMOVE ALL EXISTING TRACTION POWER EQUIPMENT, REFER TO TRACTION POWER DRAWINGS TP411 AND TP412, TYPICAL.
  8. REMOVE ALL LIGHT FIXTURES, REFER TO ELECTRICAL DRAWING E402, TYPICAL.

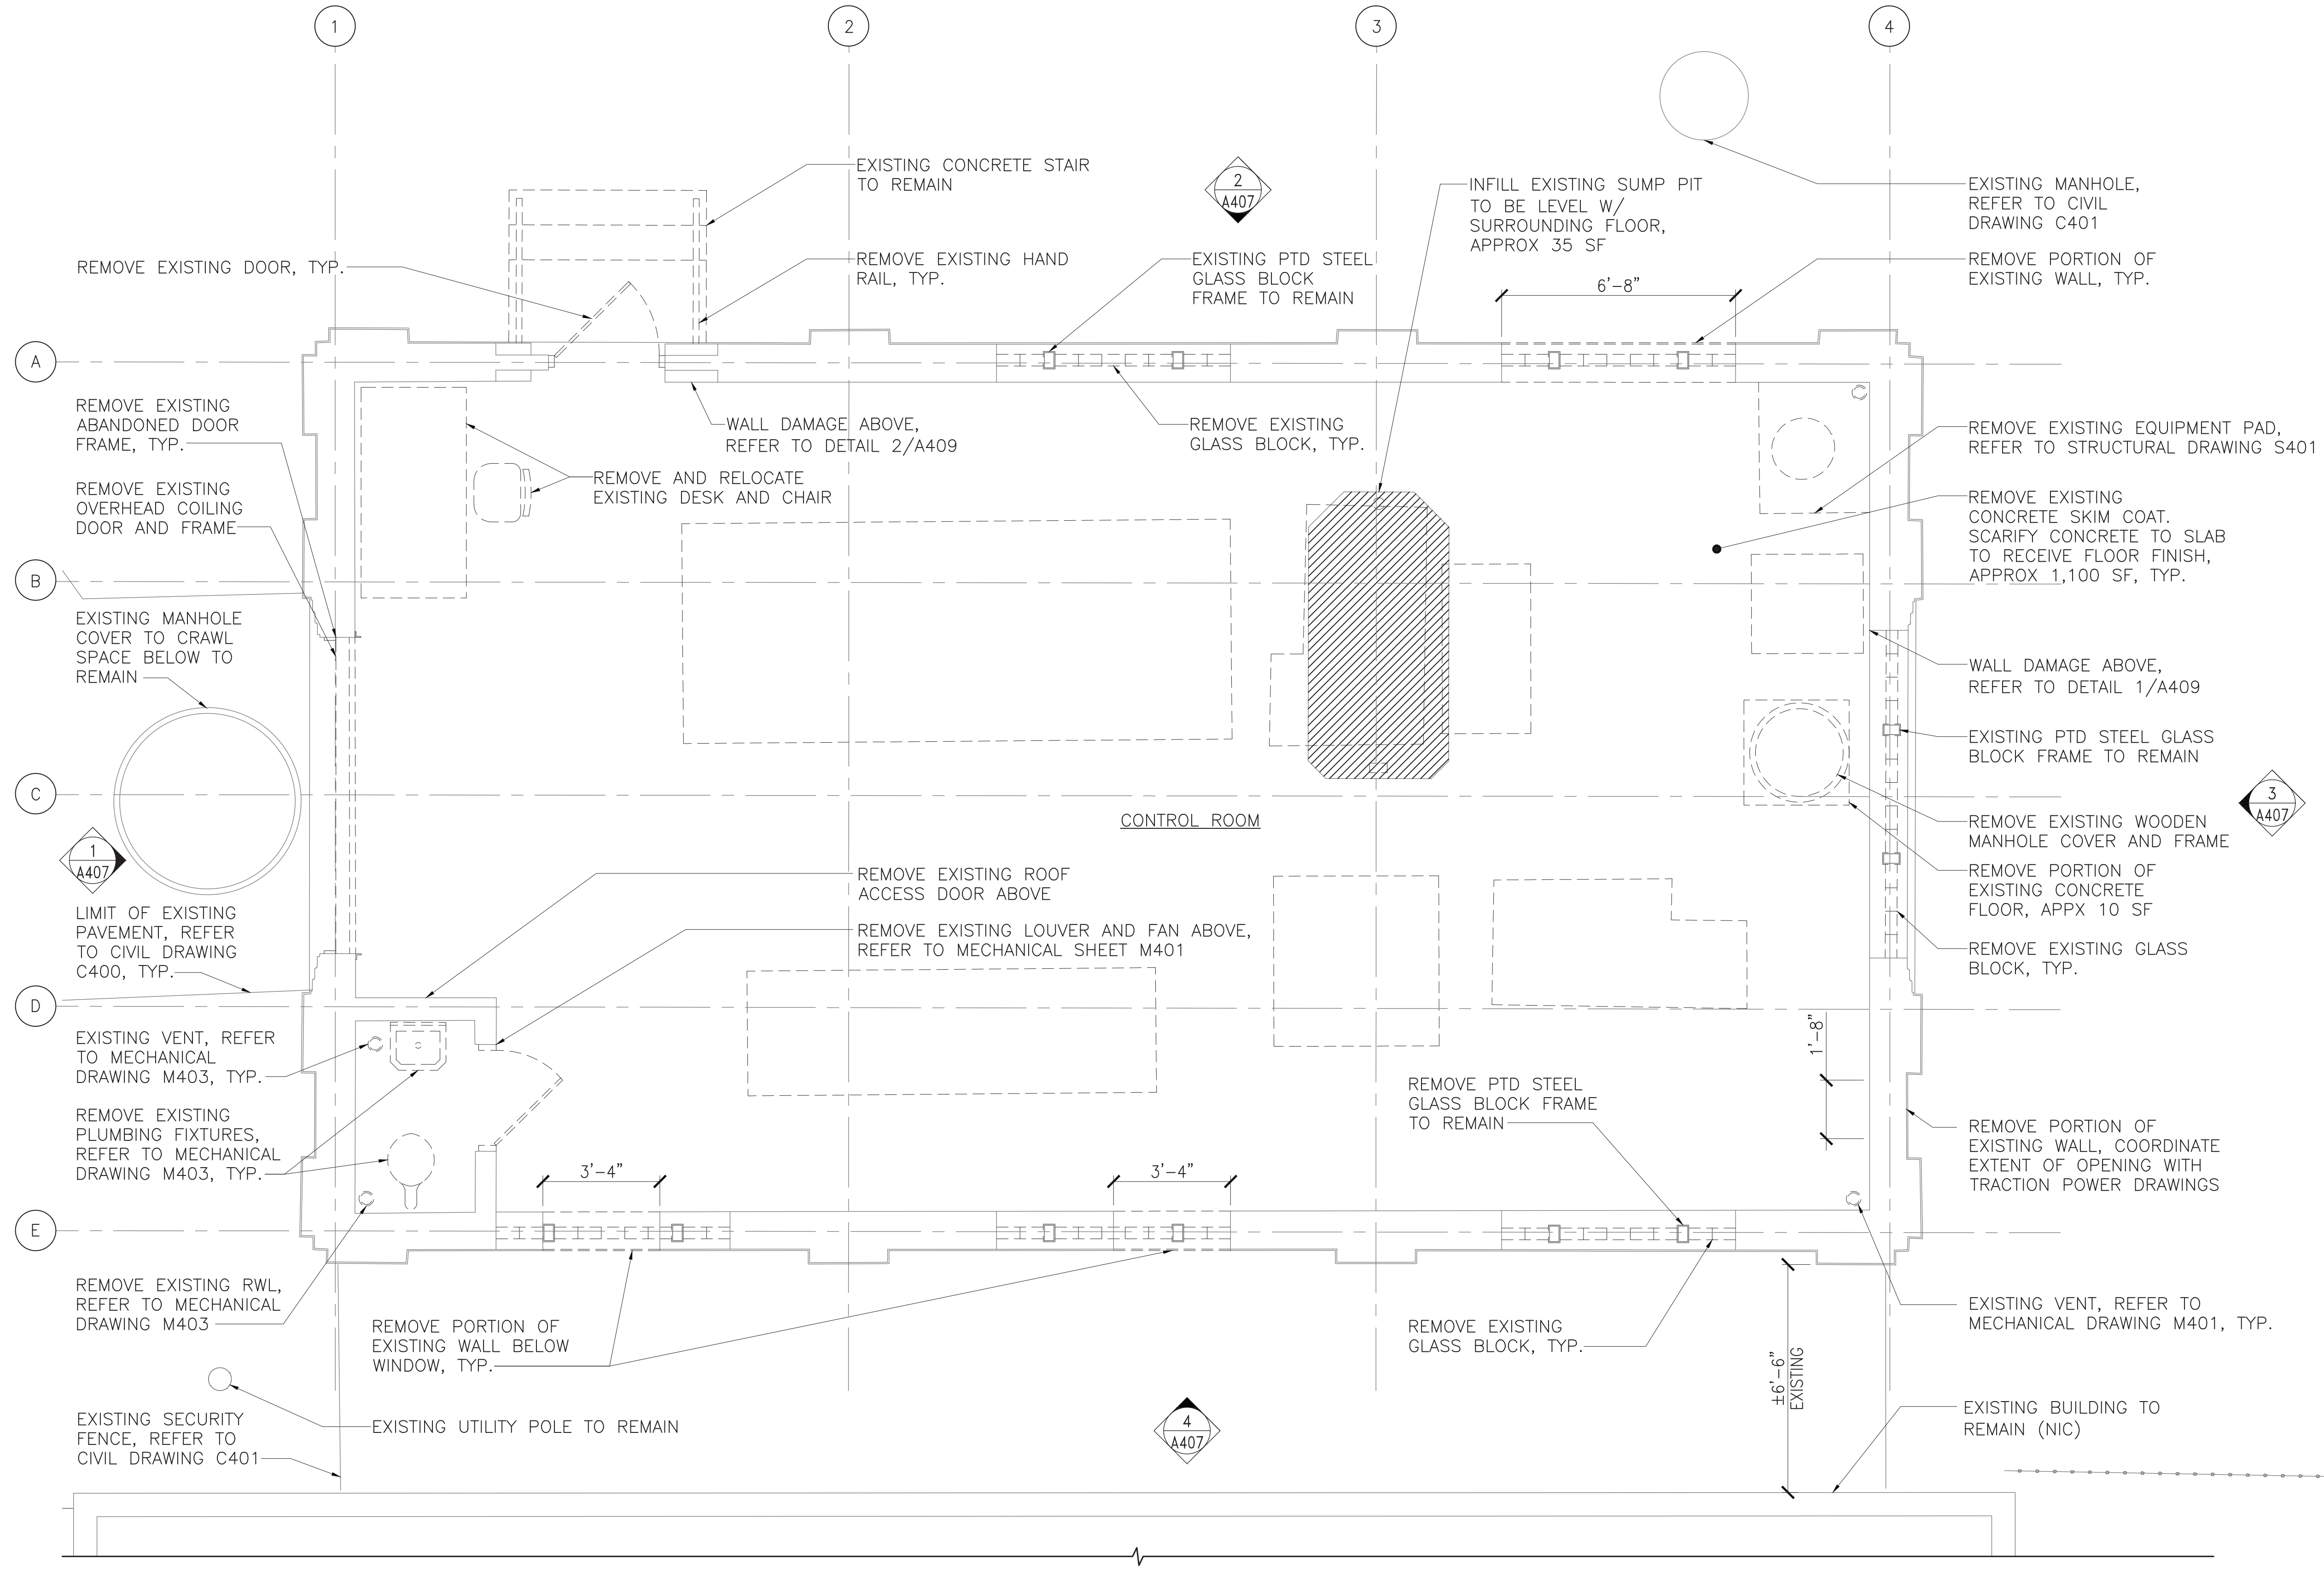

**1**  
**A403** EXISTING BUILDING REMOVAL PLAN  
SCALE: 3/8" = 1'-0"

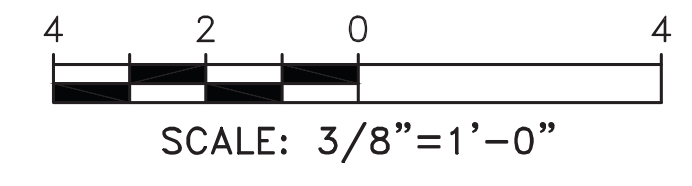

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\689\0517AN-A403.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION


REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
ROOF REMOVAL PLAN


SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: AC
WORK ORDER NO.: 276496	CHECKED BY: BF
SHEET NUMBER	
<b>A404</b>	
DWG. NO.: 5	OF 12
SHT. NO.: 384	OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-A404	REV. NO.:

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
  2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
  3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
  4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
  5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
  6. REMOVE ALL EXISTING COPPER FLASHING AT COPING, TYPICAL.

- ROOF NOTES:**
1. REMOVE ENTIRE ROOF, APPROX 1,090 SF.
  2. REMOVE ALL COPPER FLASHING AT COPING APPROX 155 LF.
  3. REPAIR ALL SEALS AT EXISTING CONCRETE COPING.
  4. REMOVE ALL ROOF DRAINS.

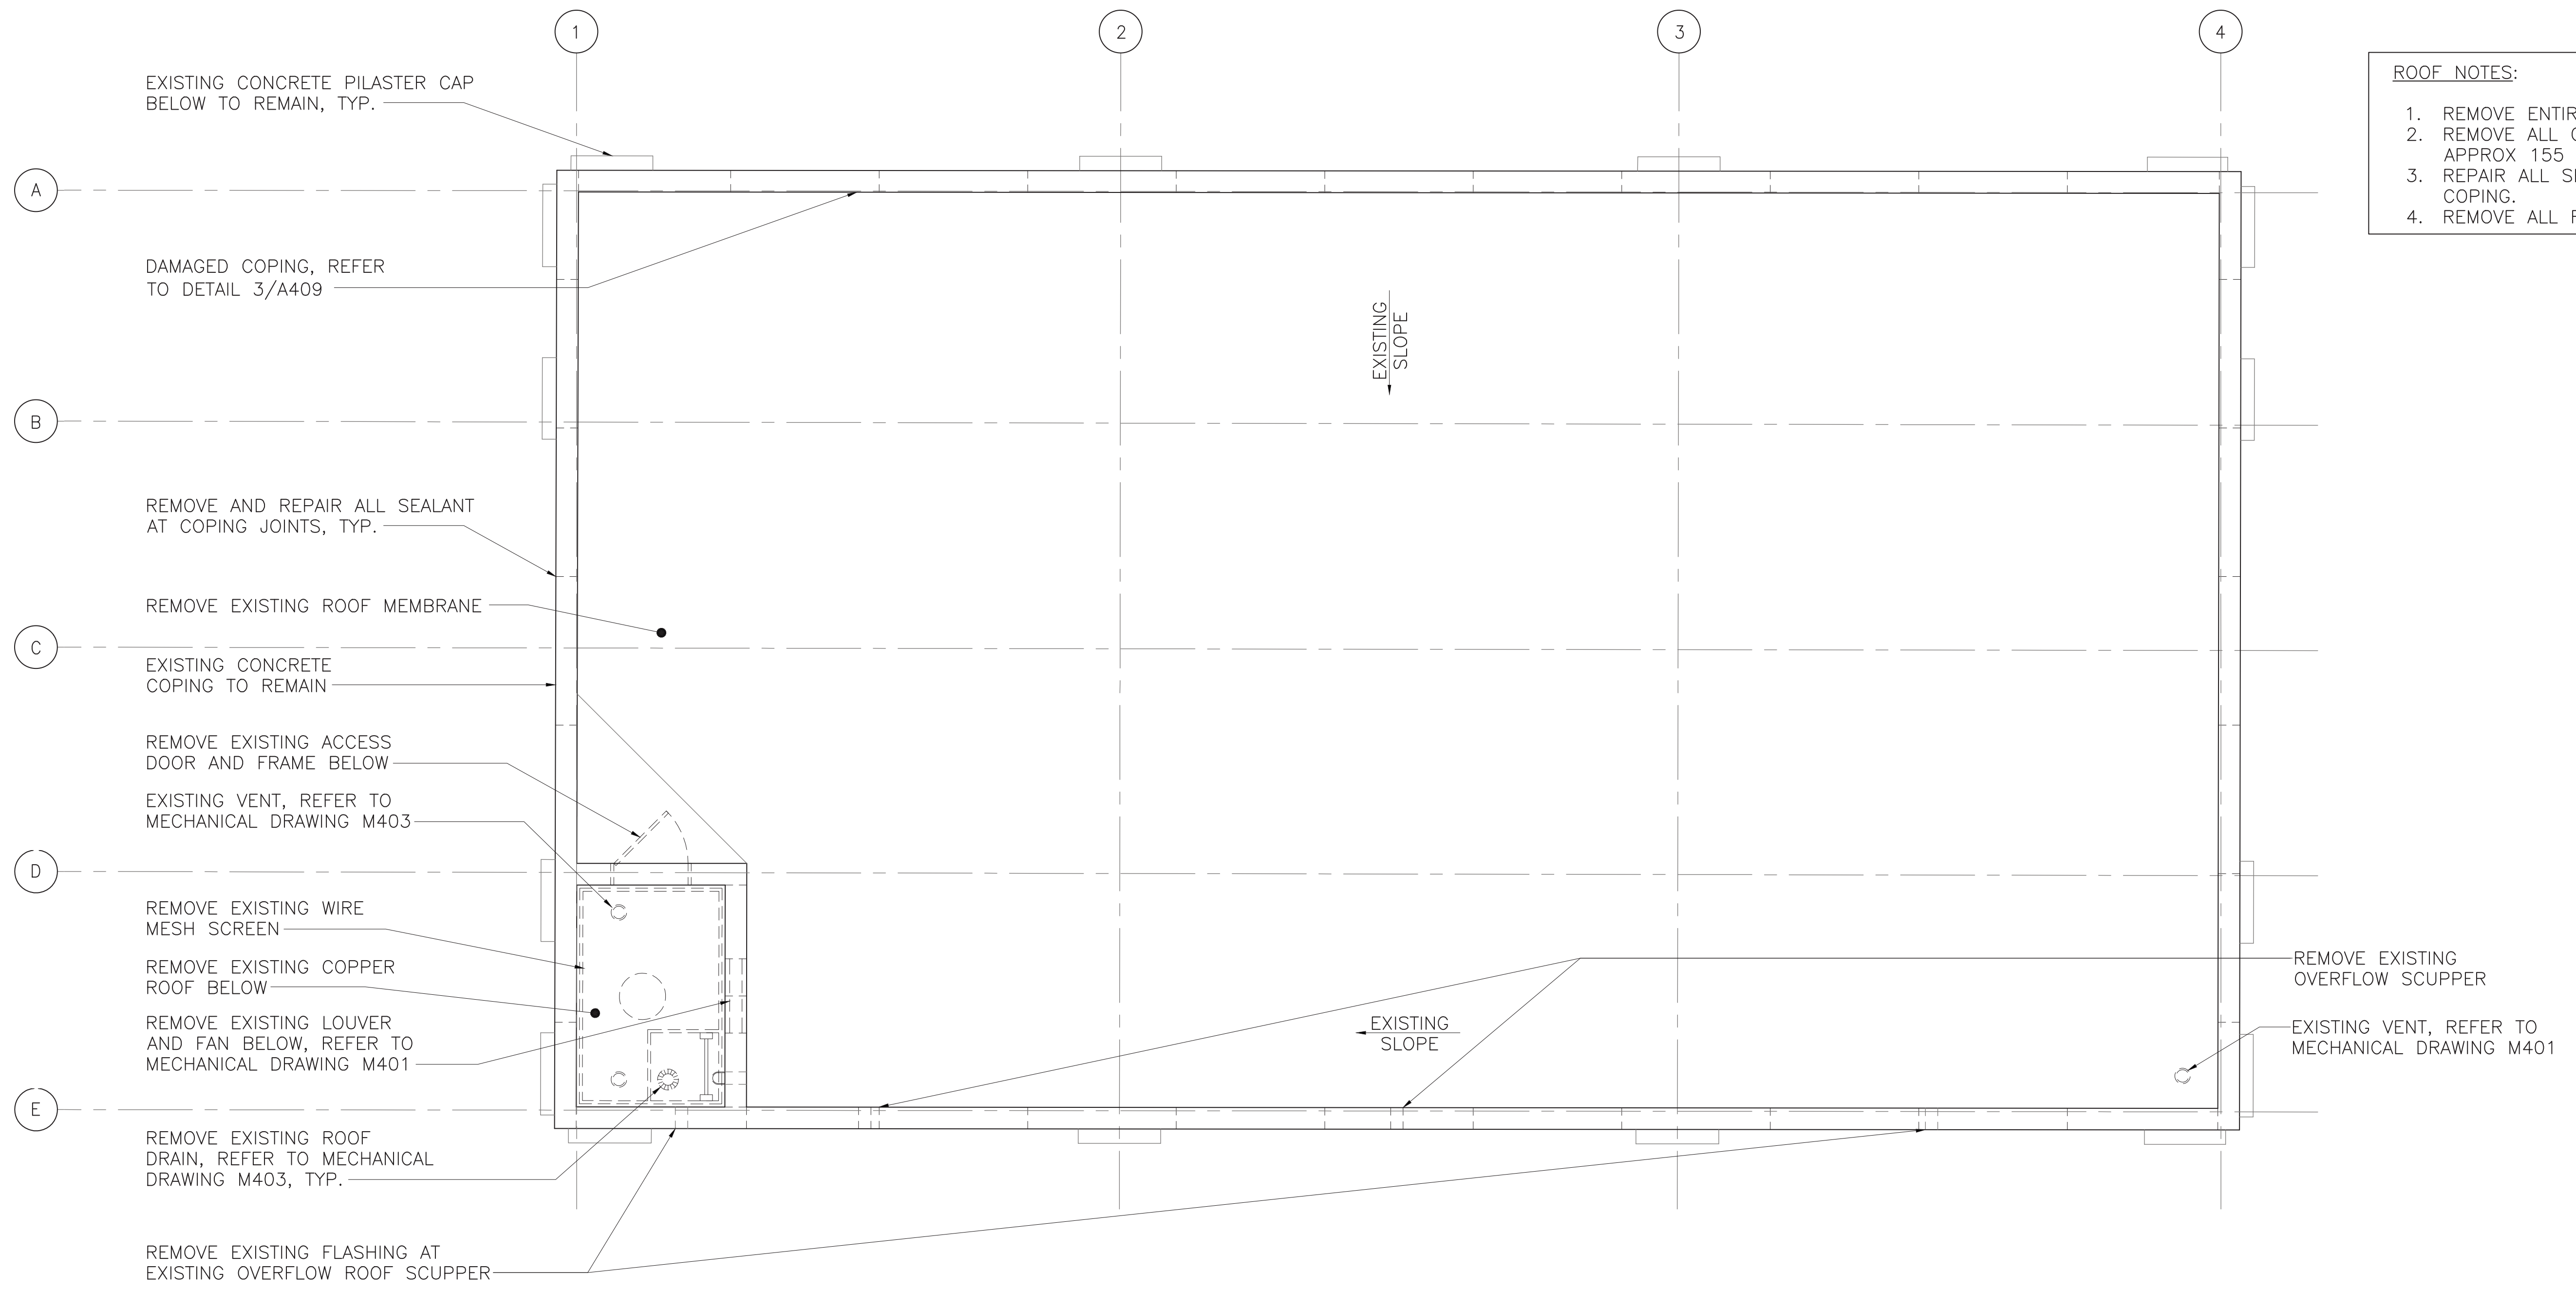

**1**  
**A404** **ROOF REMOVAL PLAN**  
SCALE: 3/8" = 1'-0"

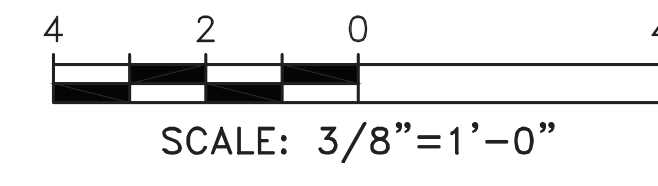

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\PI\WORKING\PTTD\68910517AN-A404.DWG




DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR ROUTE 59 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION ARCHITECTURAL PROPOSED GROUND FLOOR PLAN**

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: AC
WORK ORDER NO.: 276496	CHECKED BY: BF
SHEET NUMBER: <b>A405</b>	
DWG. NO.: 6 OF 12	
SHT. NO.: 385 OF 452	
COMPUTER FILE NO.: 17AN-A405	REV. NO.: 1

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
  2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
  3. DRAWING INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
  4. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
  5. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
  6. FLOOR WILL BE MADE AVAILABLE IN STAGES AS THE EXISTING EQUIPMENT IS REMOVED PER OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN.
  7. FURNITURE LAYOUT IS TENTATIVE PENDING FINAL EQUIPMENT LOCATIONS.
  8. FILL ALL ABANDONED PENETRATIONS PER DETAIL 5/A411, TYPICAL.
  9. REPAIR ALL ACTIVE PENETRATIONS PER DETAIL 6/A411, TYPICAL.
  10. SCRAPE, PREPARE, PRIME AND PAINT ALL EXISTING EXPOSED STEEL ROOF FRAMING, TYPICAL.
  11. SCRAPE, PREPARE, PRIME AND PAINT ENTIRE SURFACE OF EXISTING CONCRETE CEILING.

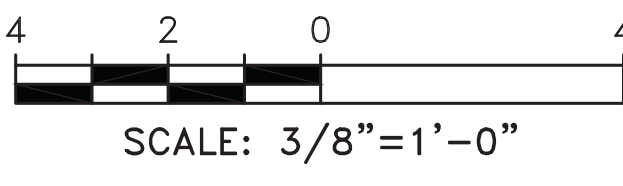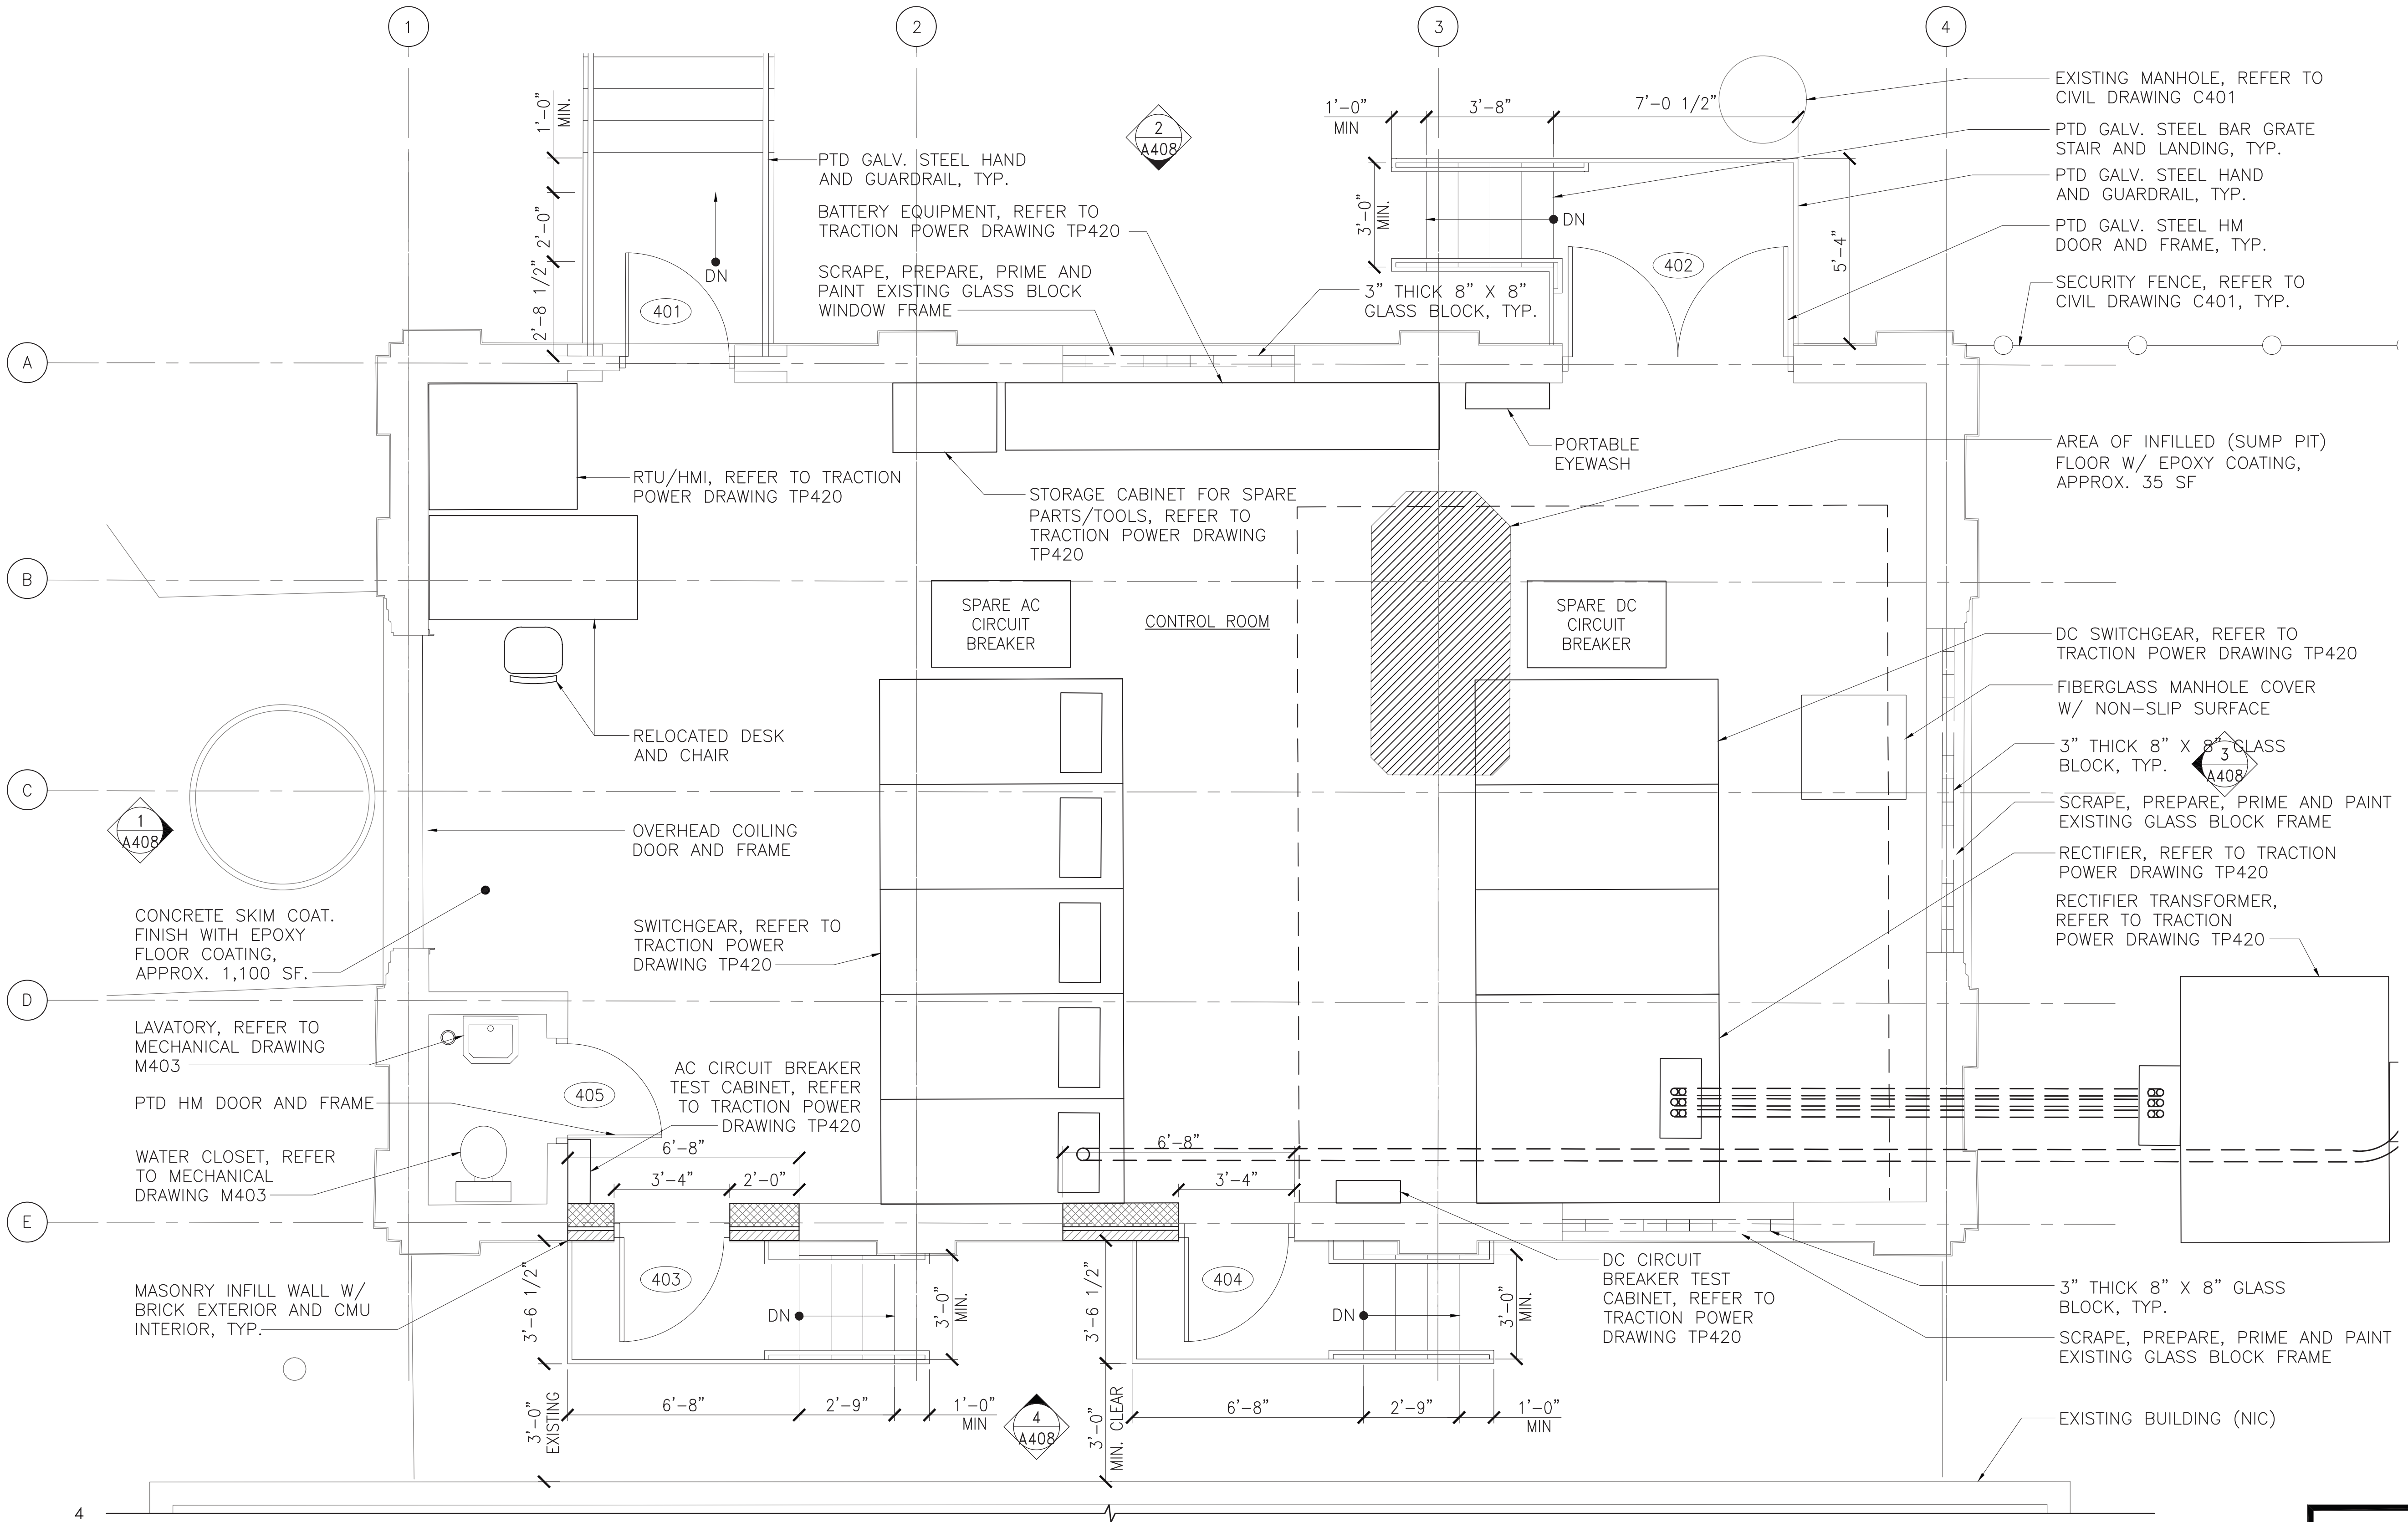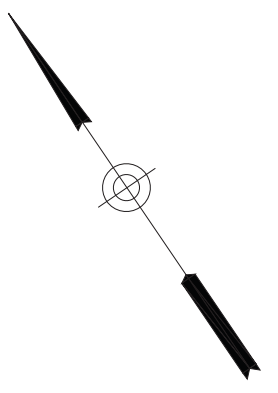

**1 A405 PROPOSED FLOOR PLAN**  
SCALE: 3/8" = 1'-0"

**50% SUBMISSION NOT FOR CONSTRUCTION**

C:\P\WORKING\PTD\68910517AN-A405.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
PROPOSED ROOF PLAN

SCALE: AS SHOWN SCALE FACTOR: 1:1

DATE: 10/16/2017 DRAWN BY: AC CHECKED BY: BF

WORK ORDER NO.: 276496


SHEET NUMBER: **A406**

DWG. NO.: 7 OF 12  
SHT. NO.: 386 OF 452  
ARCHIVE NO.:


COMPUTER FILE NO.: 17AN-A406  
REV. NO.:

- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
  2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
  3. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
  4. WORK SHALL BY PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING A POWER OUTAGE.
  5. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.

- ROOF AND ROOF PARAPET NOTES**
1. REPLACE ENTIRE ROOF (APPROX. 1,090 SF).
  2. INSTALL PREFINISHED METAL COPING AND COPPER FLASHING (APPROX. 155 LF).
  3. REPLACE EXISTING ROOF DRAINS.

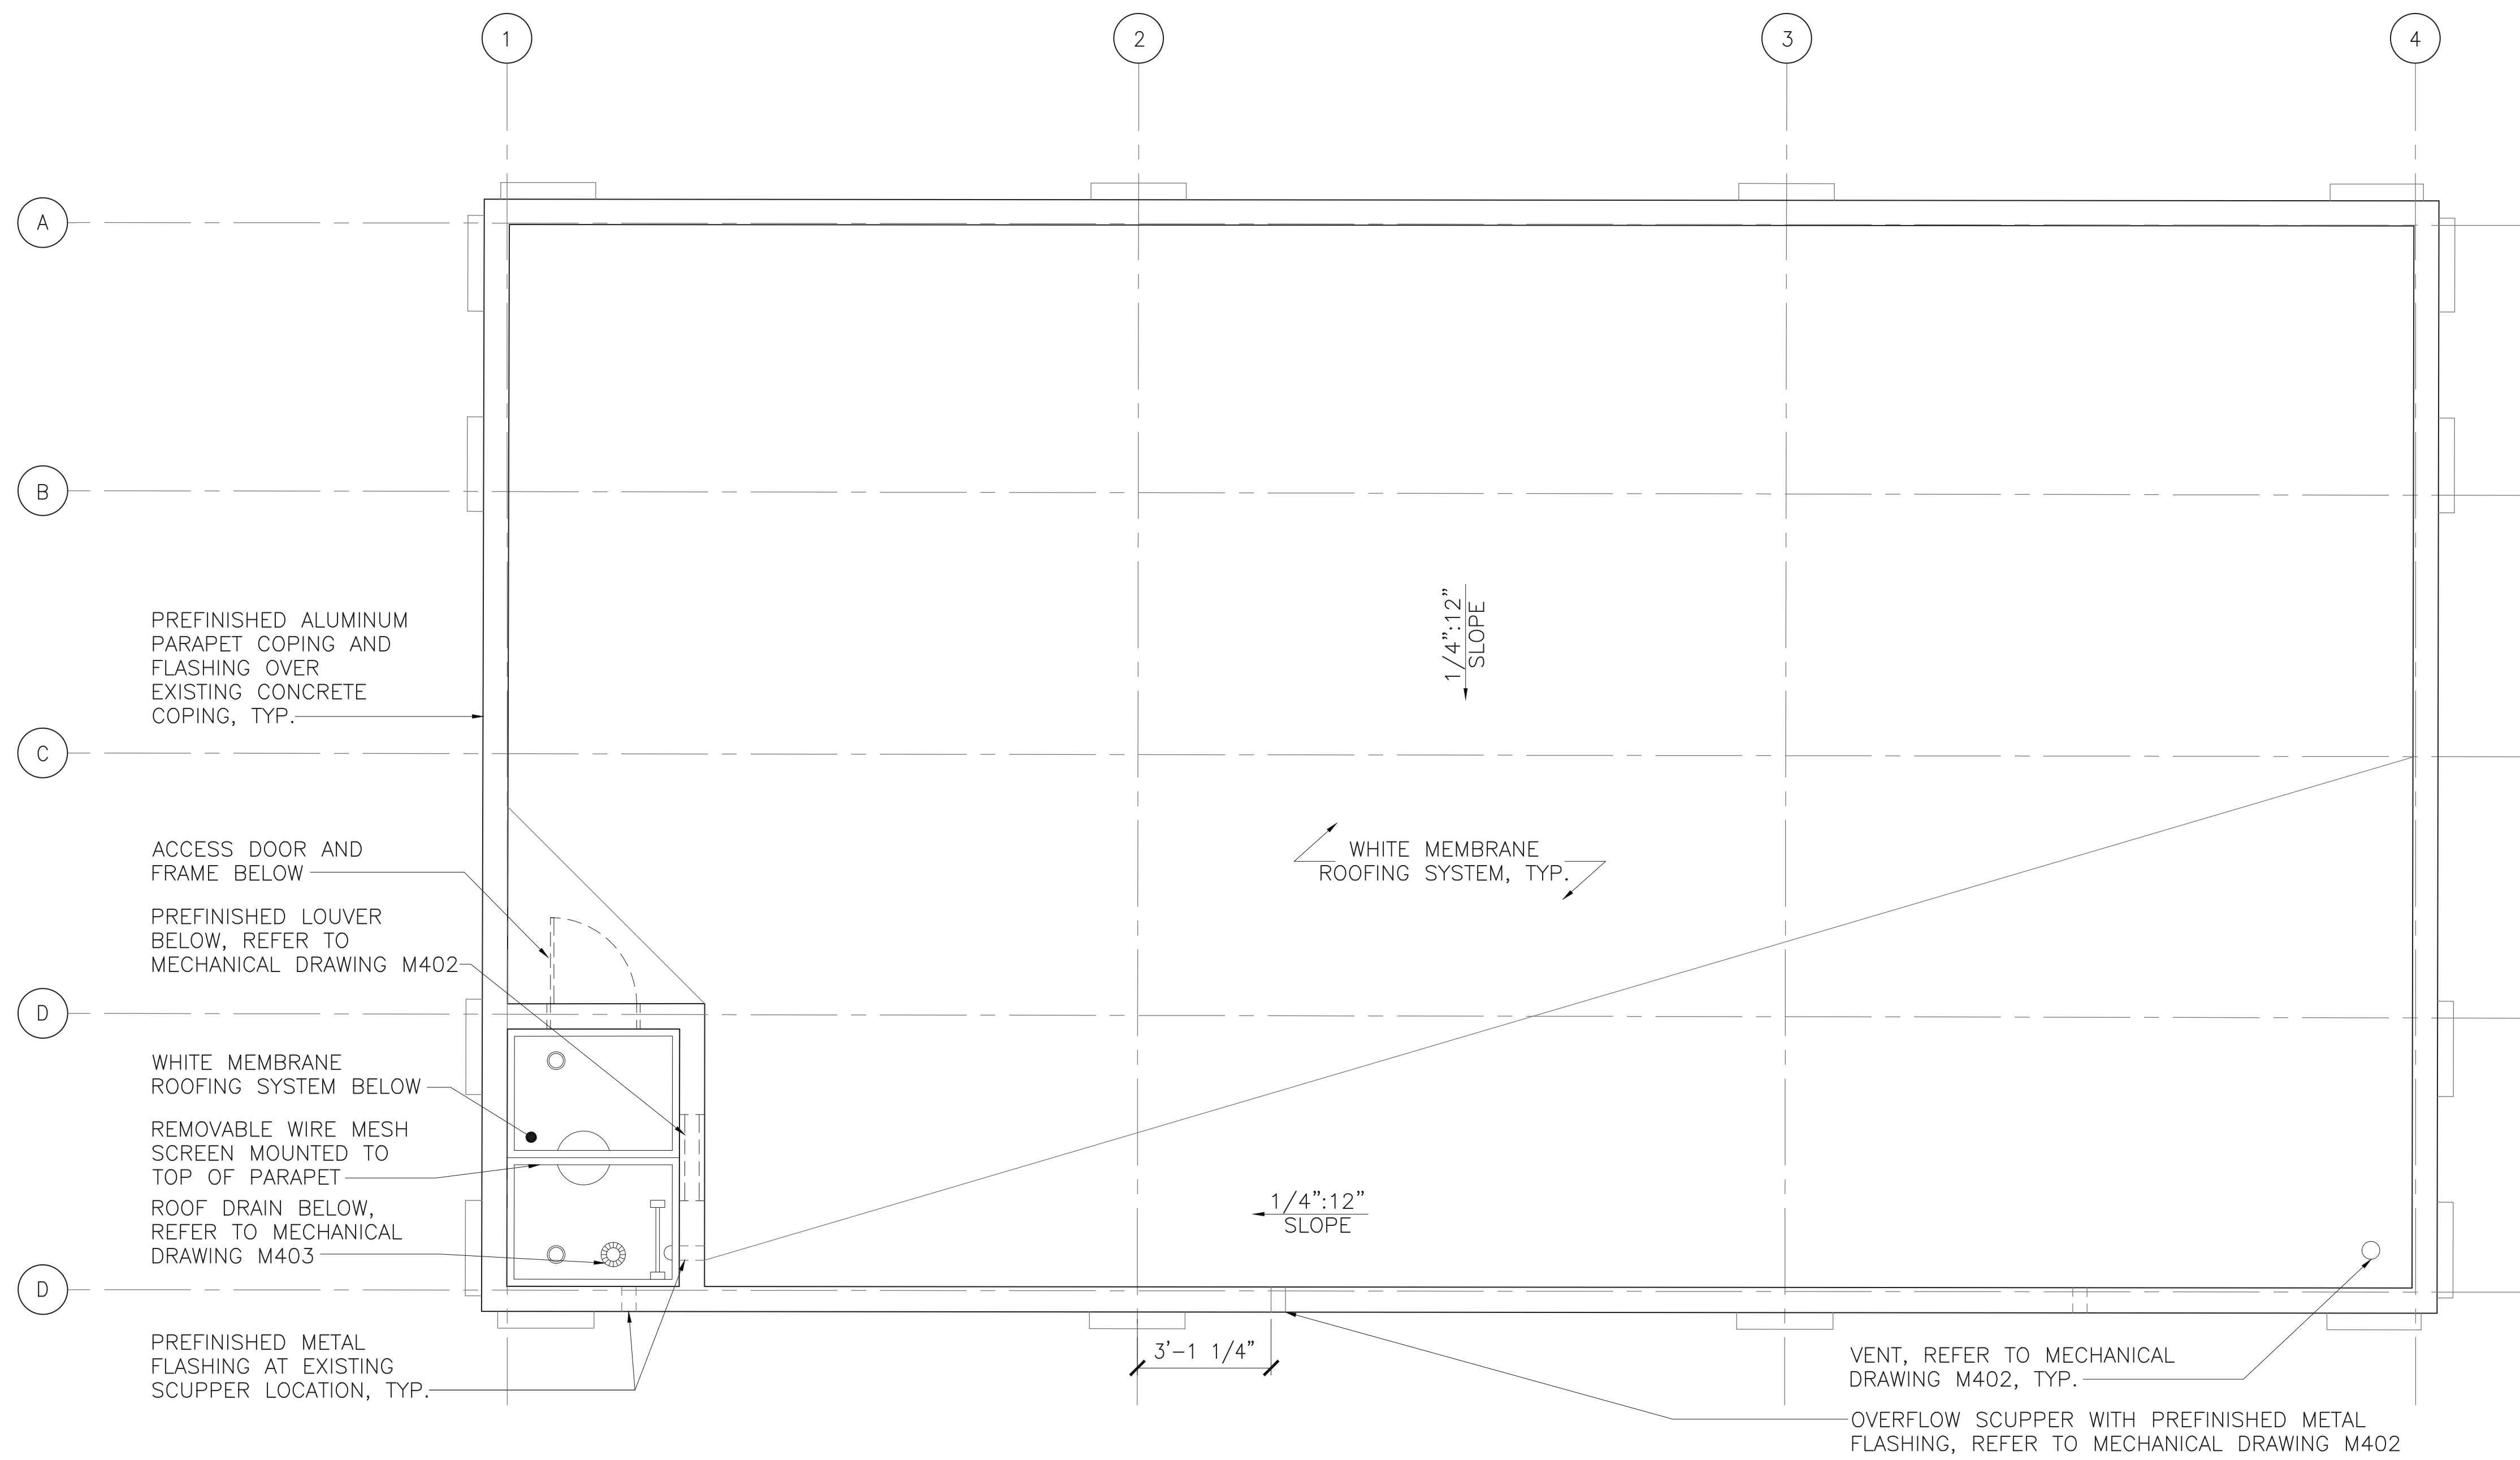

**1**  
**A406** PROPOSED ROOF PLAN  
SCALE: 3/8" = 1'-0"

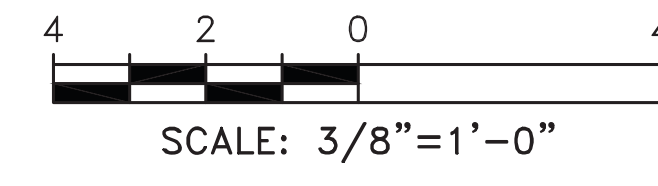

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\PI\WORKING\PTTD\68910517AN-A406.DWG

DATE PRINTED: 10/21/2025


STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD


**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
EXISTING ELEVATIONS

SCALE: AS SHOWN      SCALE FACTOR: 1:1  
DATE: 10/16/2017      DRAWN BY: AC  
WORK ORDER NO.: 276496      CHECKED BY: BF  
SHEET NUMBER: **A407**  
DWG. NO.: 8 OF 12  
SHT. NO.: 387 OF 452  
ARCHIVE NO.:  
COMPUTER FILE NO.: 17AN-A407      REV. NO.: 1


- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
  2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
  3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
  4. RAKE AND REPOINT BRICK, ENTIRE FACADE, EACH ELEVATION.
  5. CLEAN ENTIRE FACADE, EACH ELEVATION.
  6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
  7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.
  8. EQUIPMENT ON SOUTH ELEVATION IS LIVE. WORK MAY ONLY BE PERFORMED DURING AN OUTAGE OR AFTER EQUIPMENT HAS BEEN DE-COMMISSIONED.

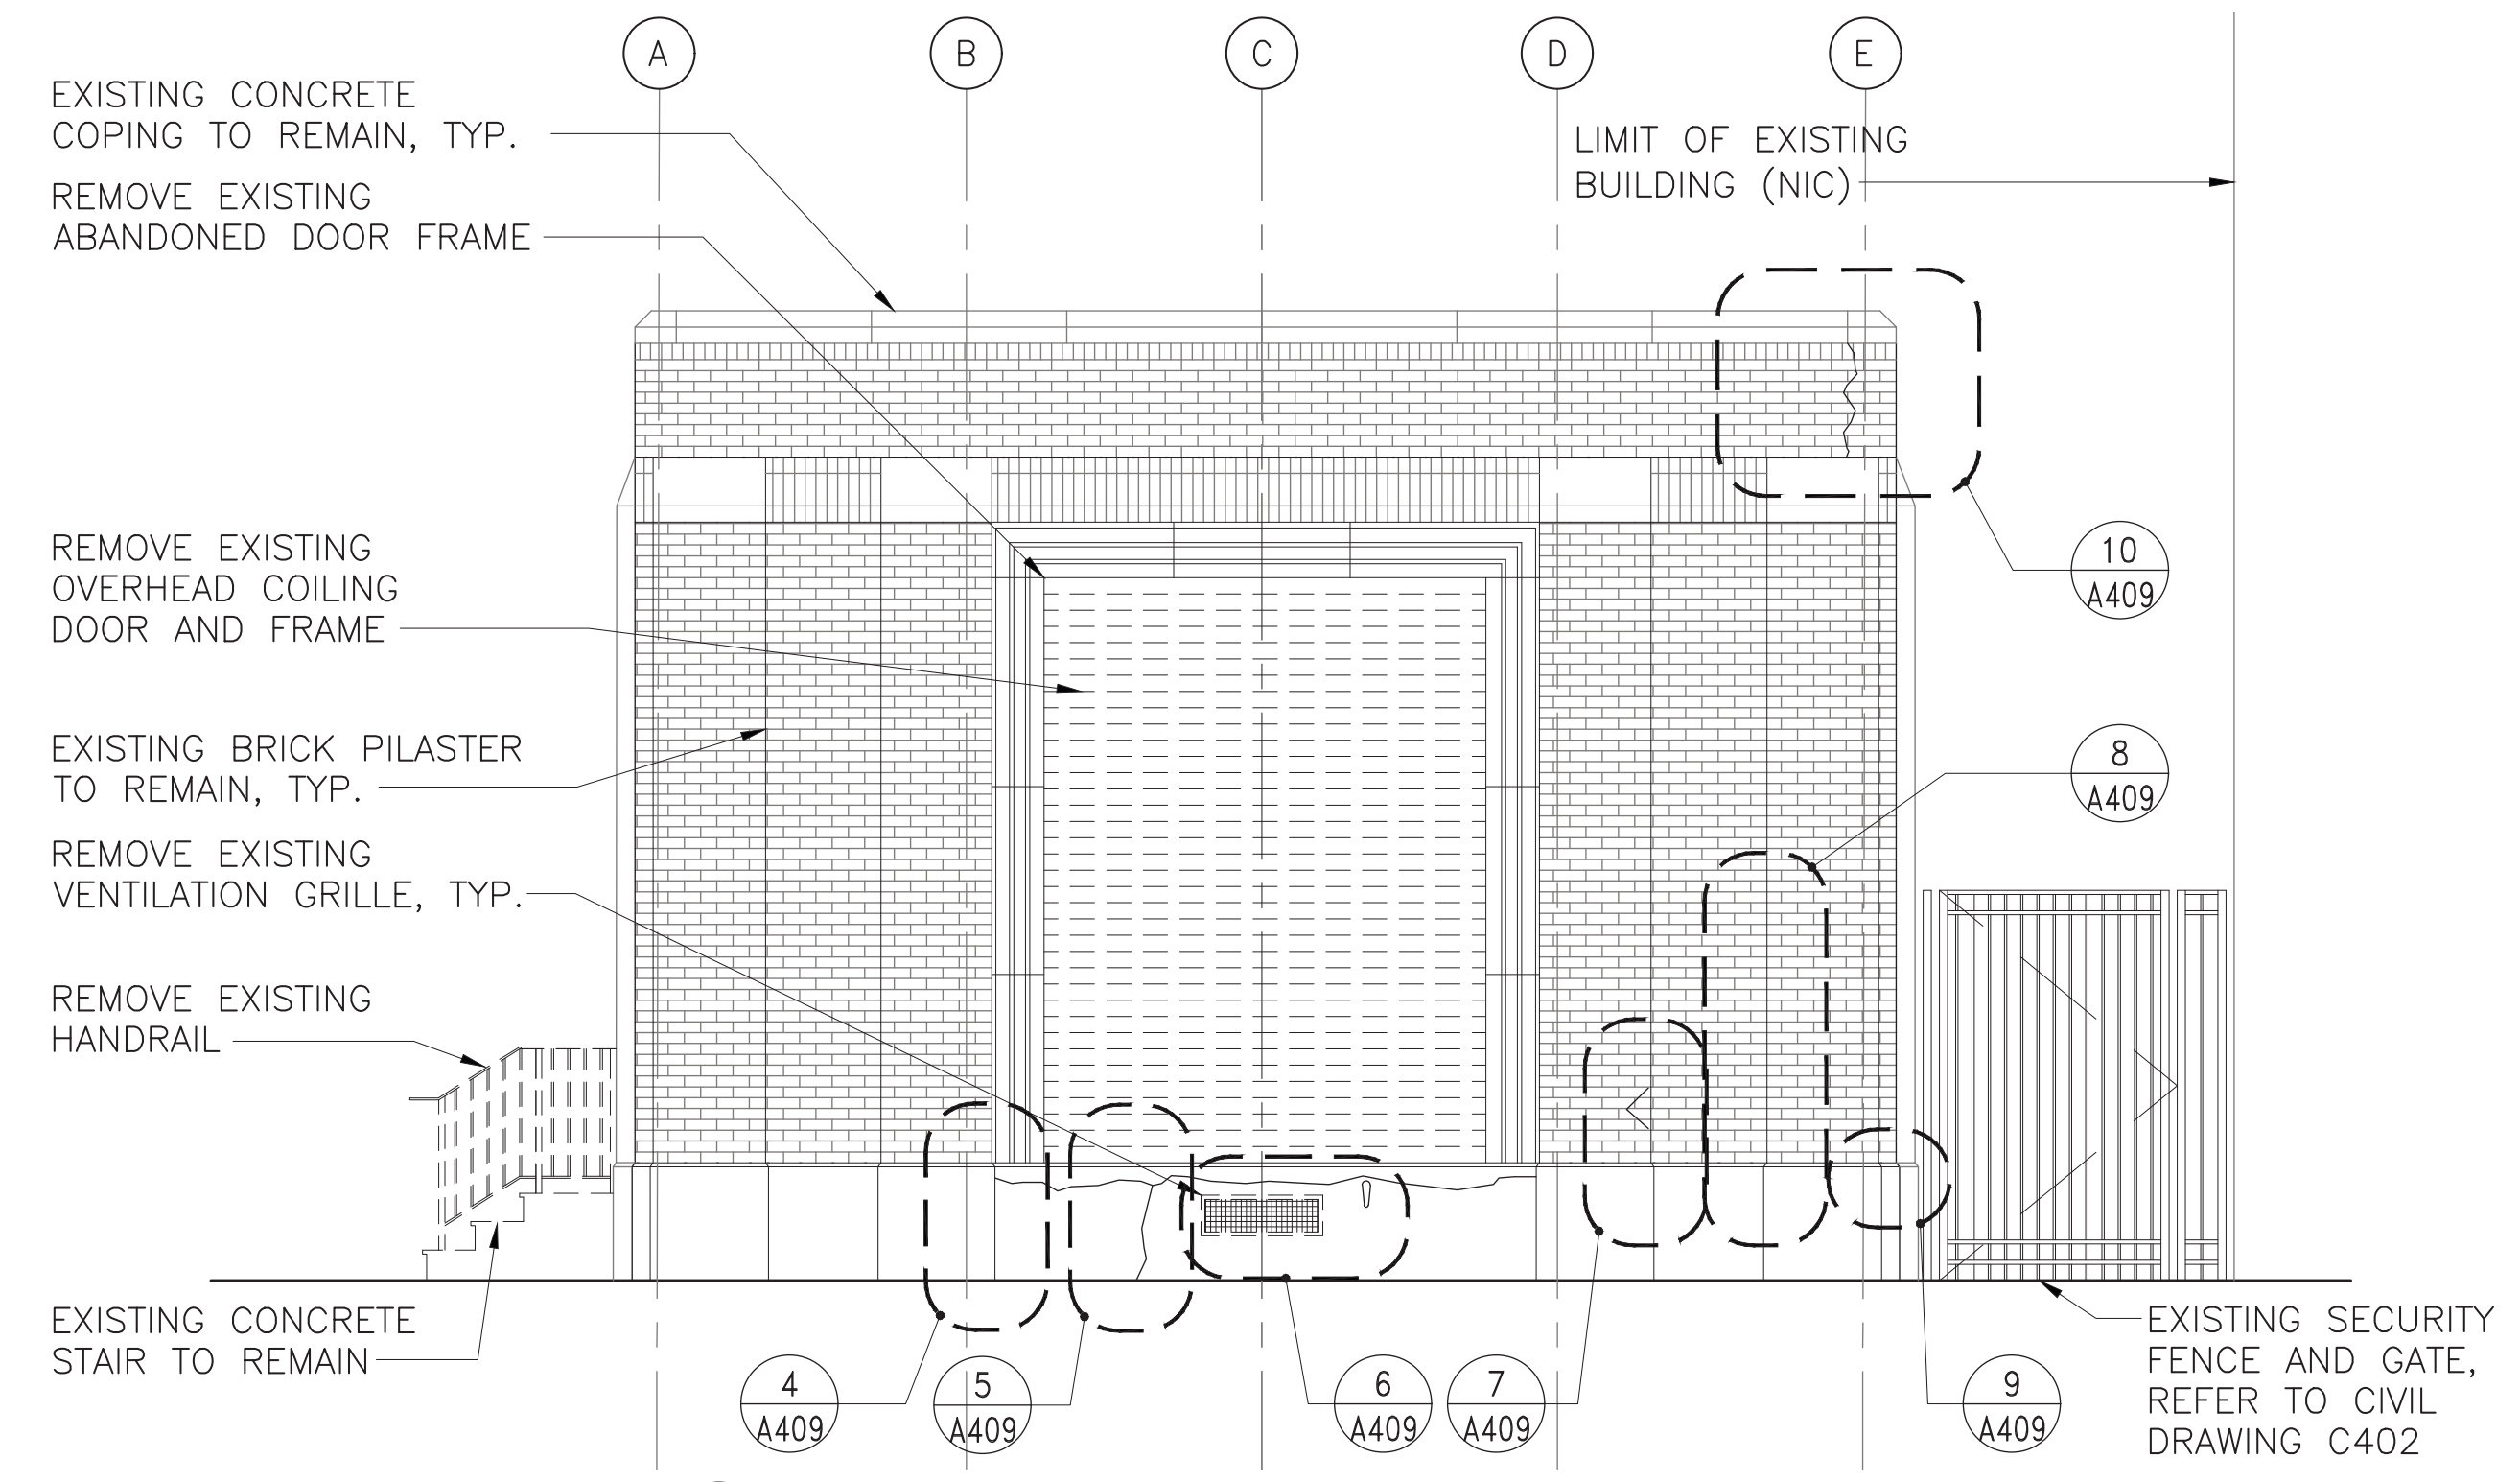


**1**  
A407  
**EXISTING WEST ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A403

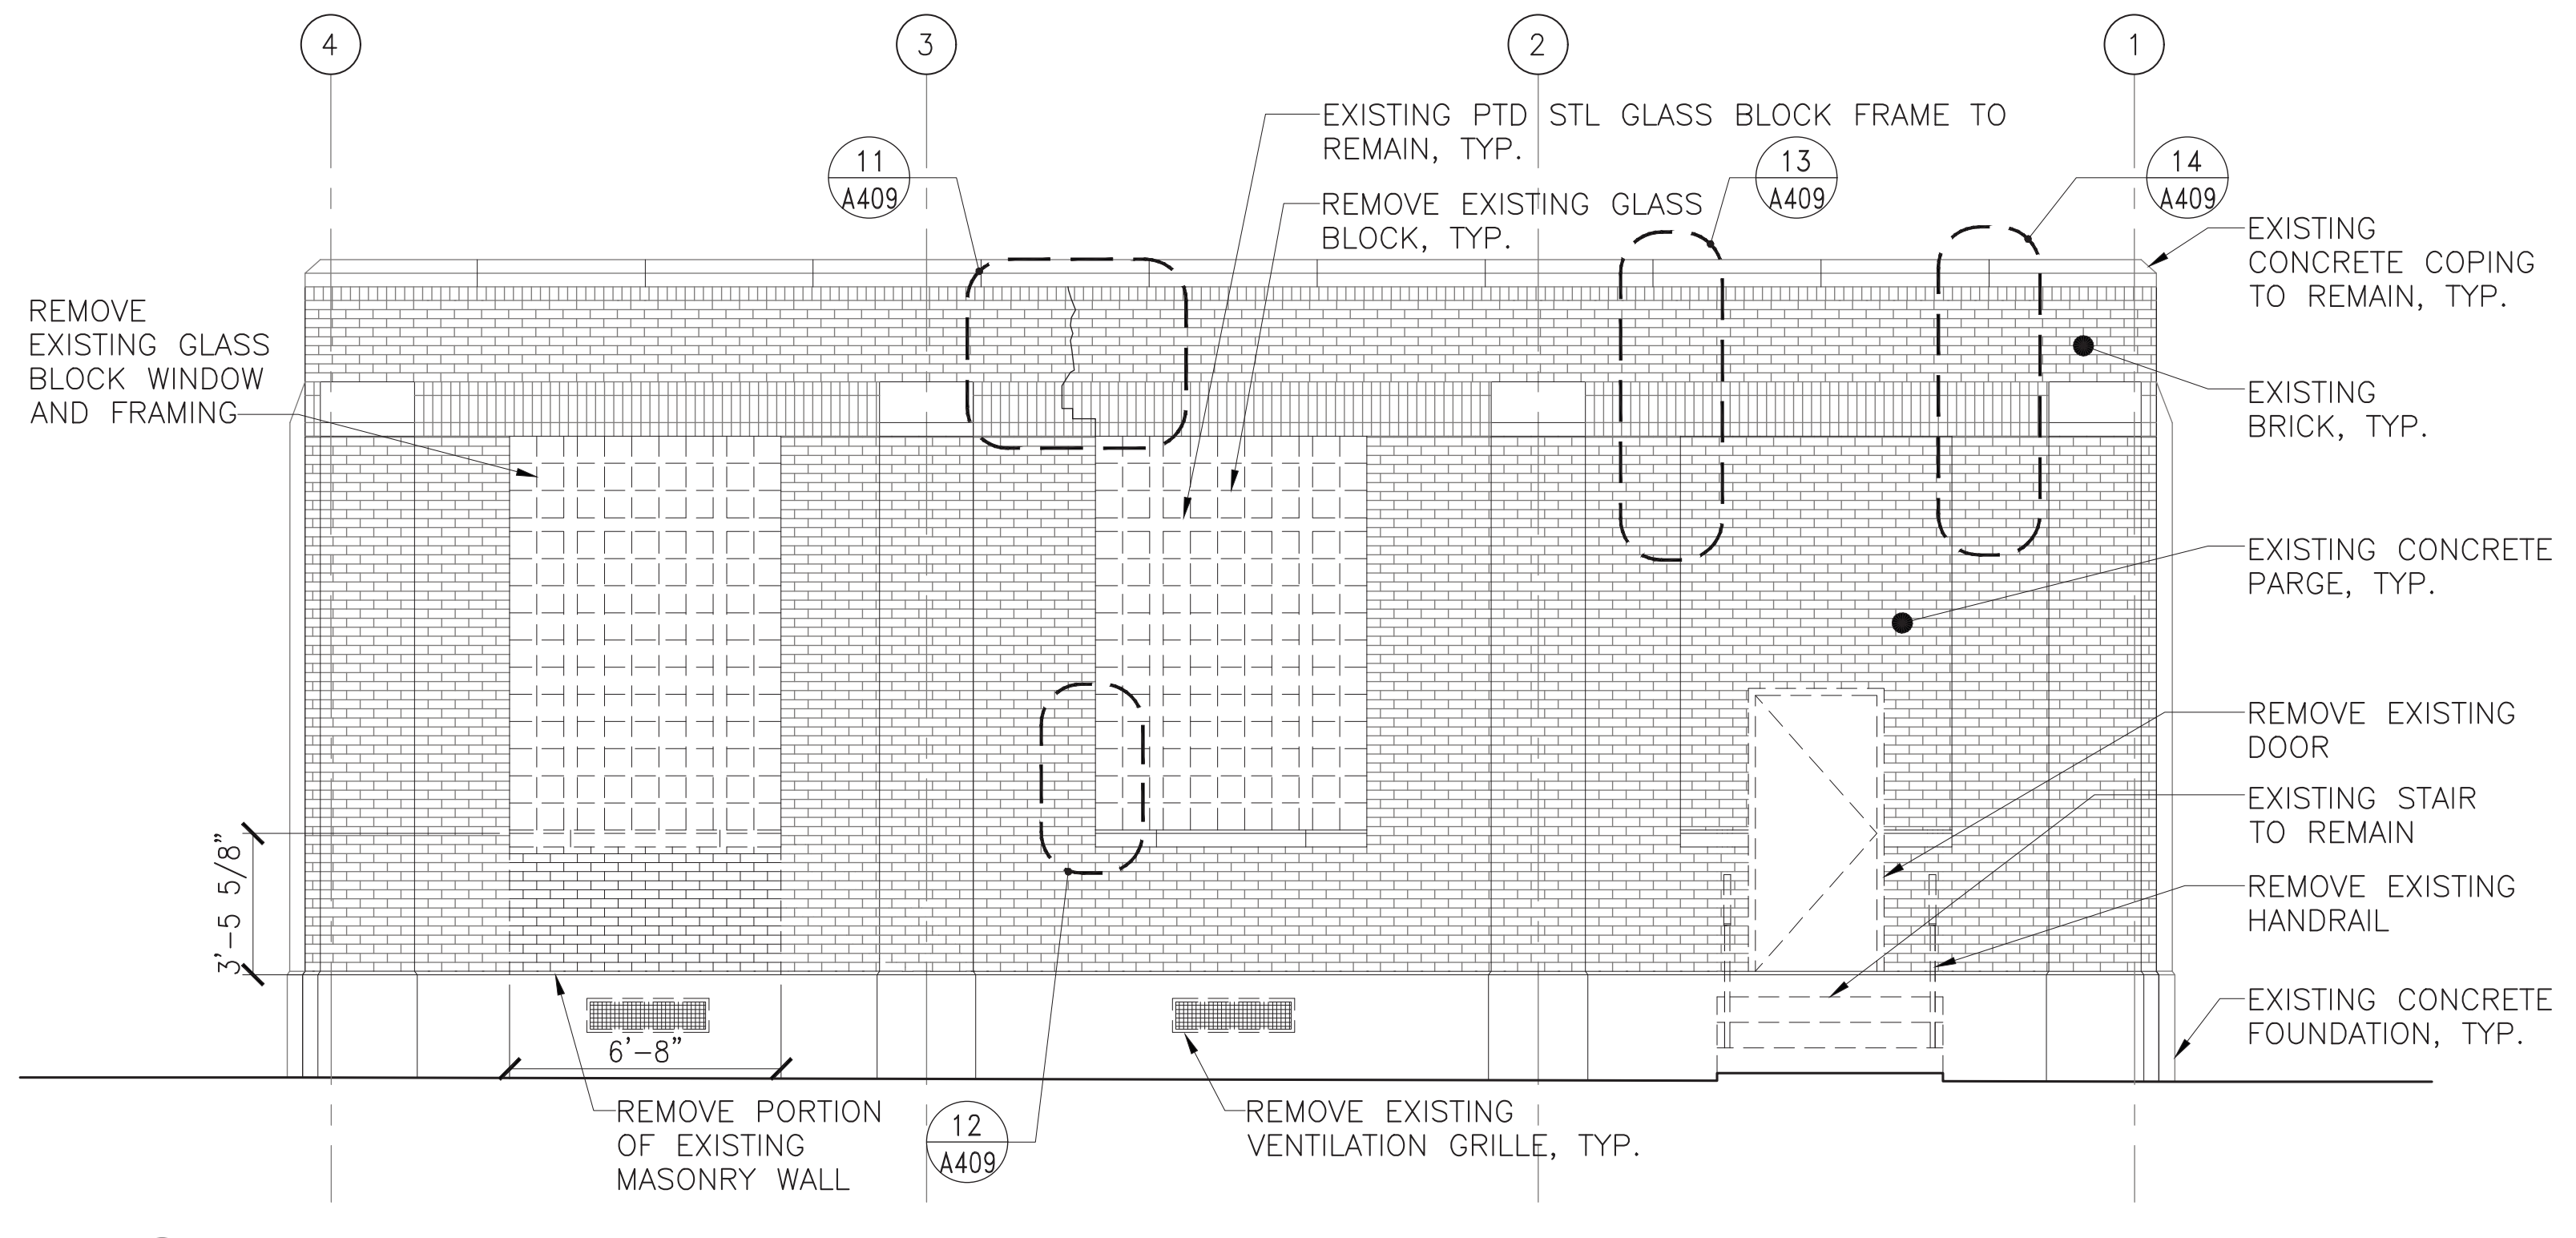


**2**  
A407  
**EXISTING NORTH ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A403

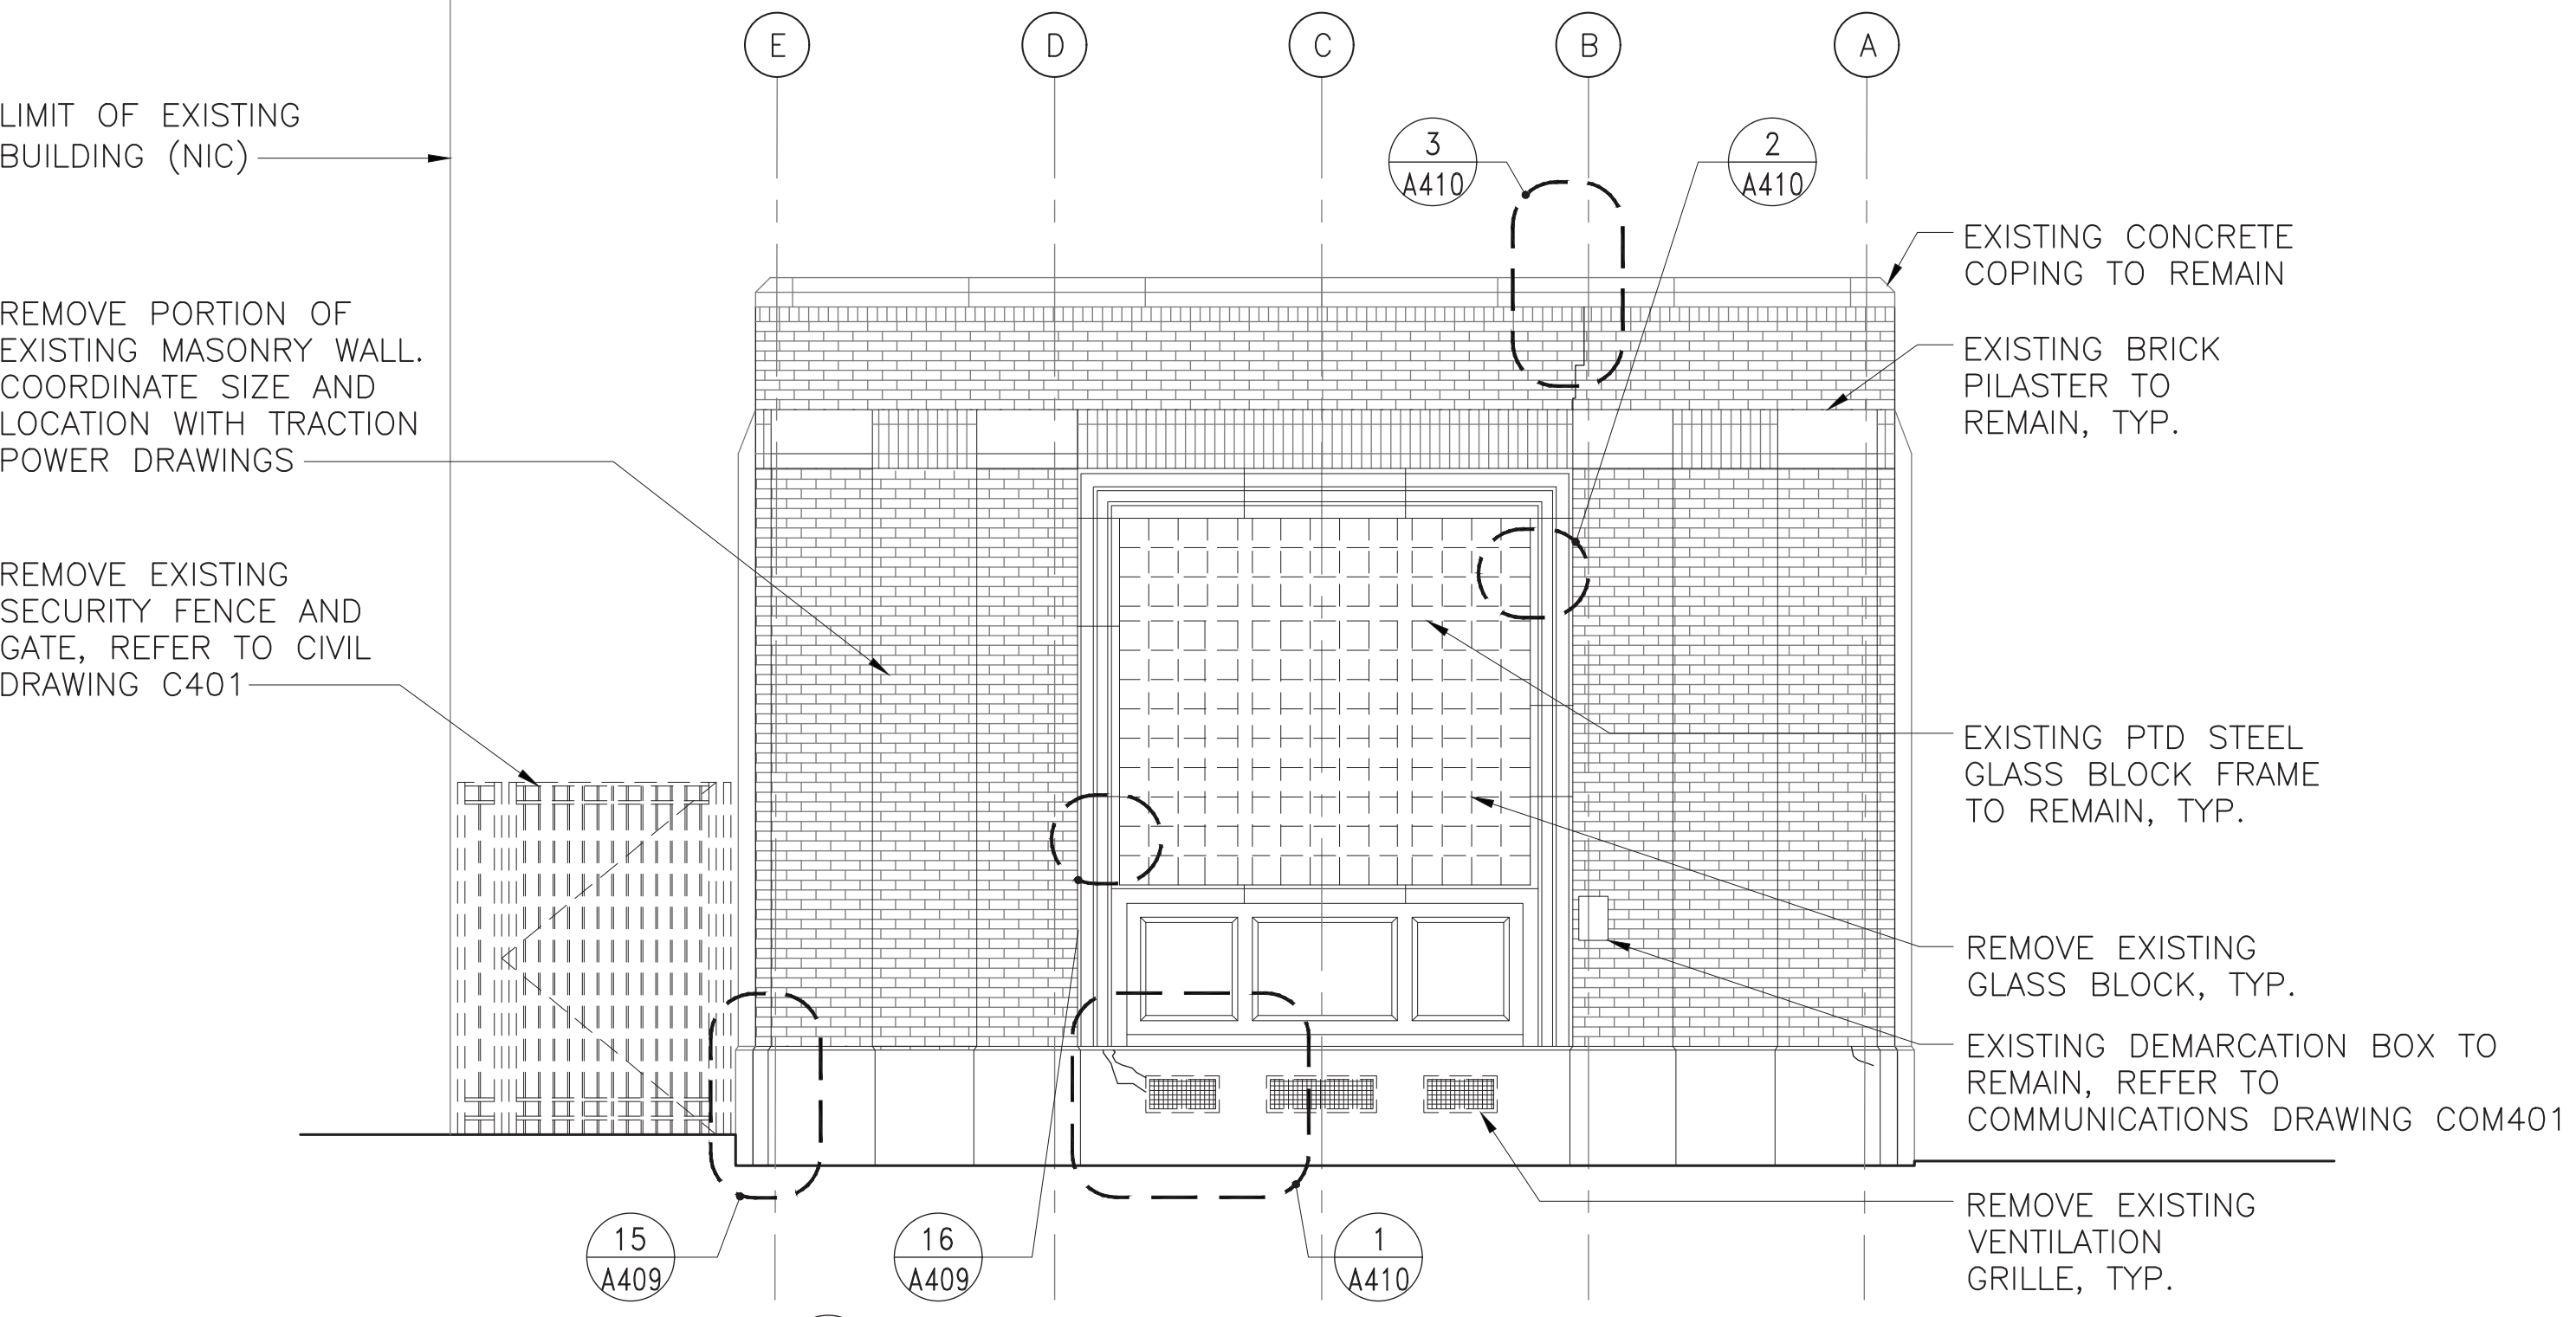

**3**  
A407  
**EXISTING EAST ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A403

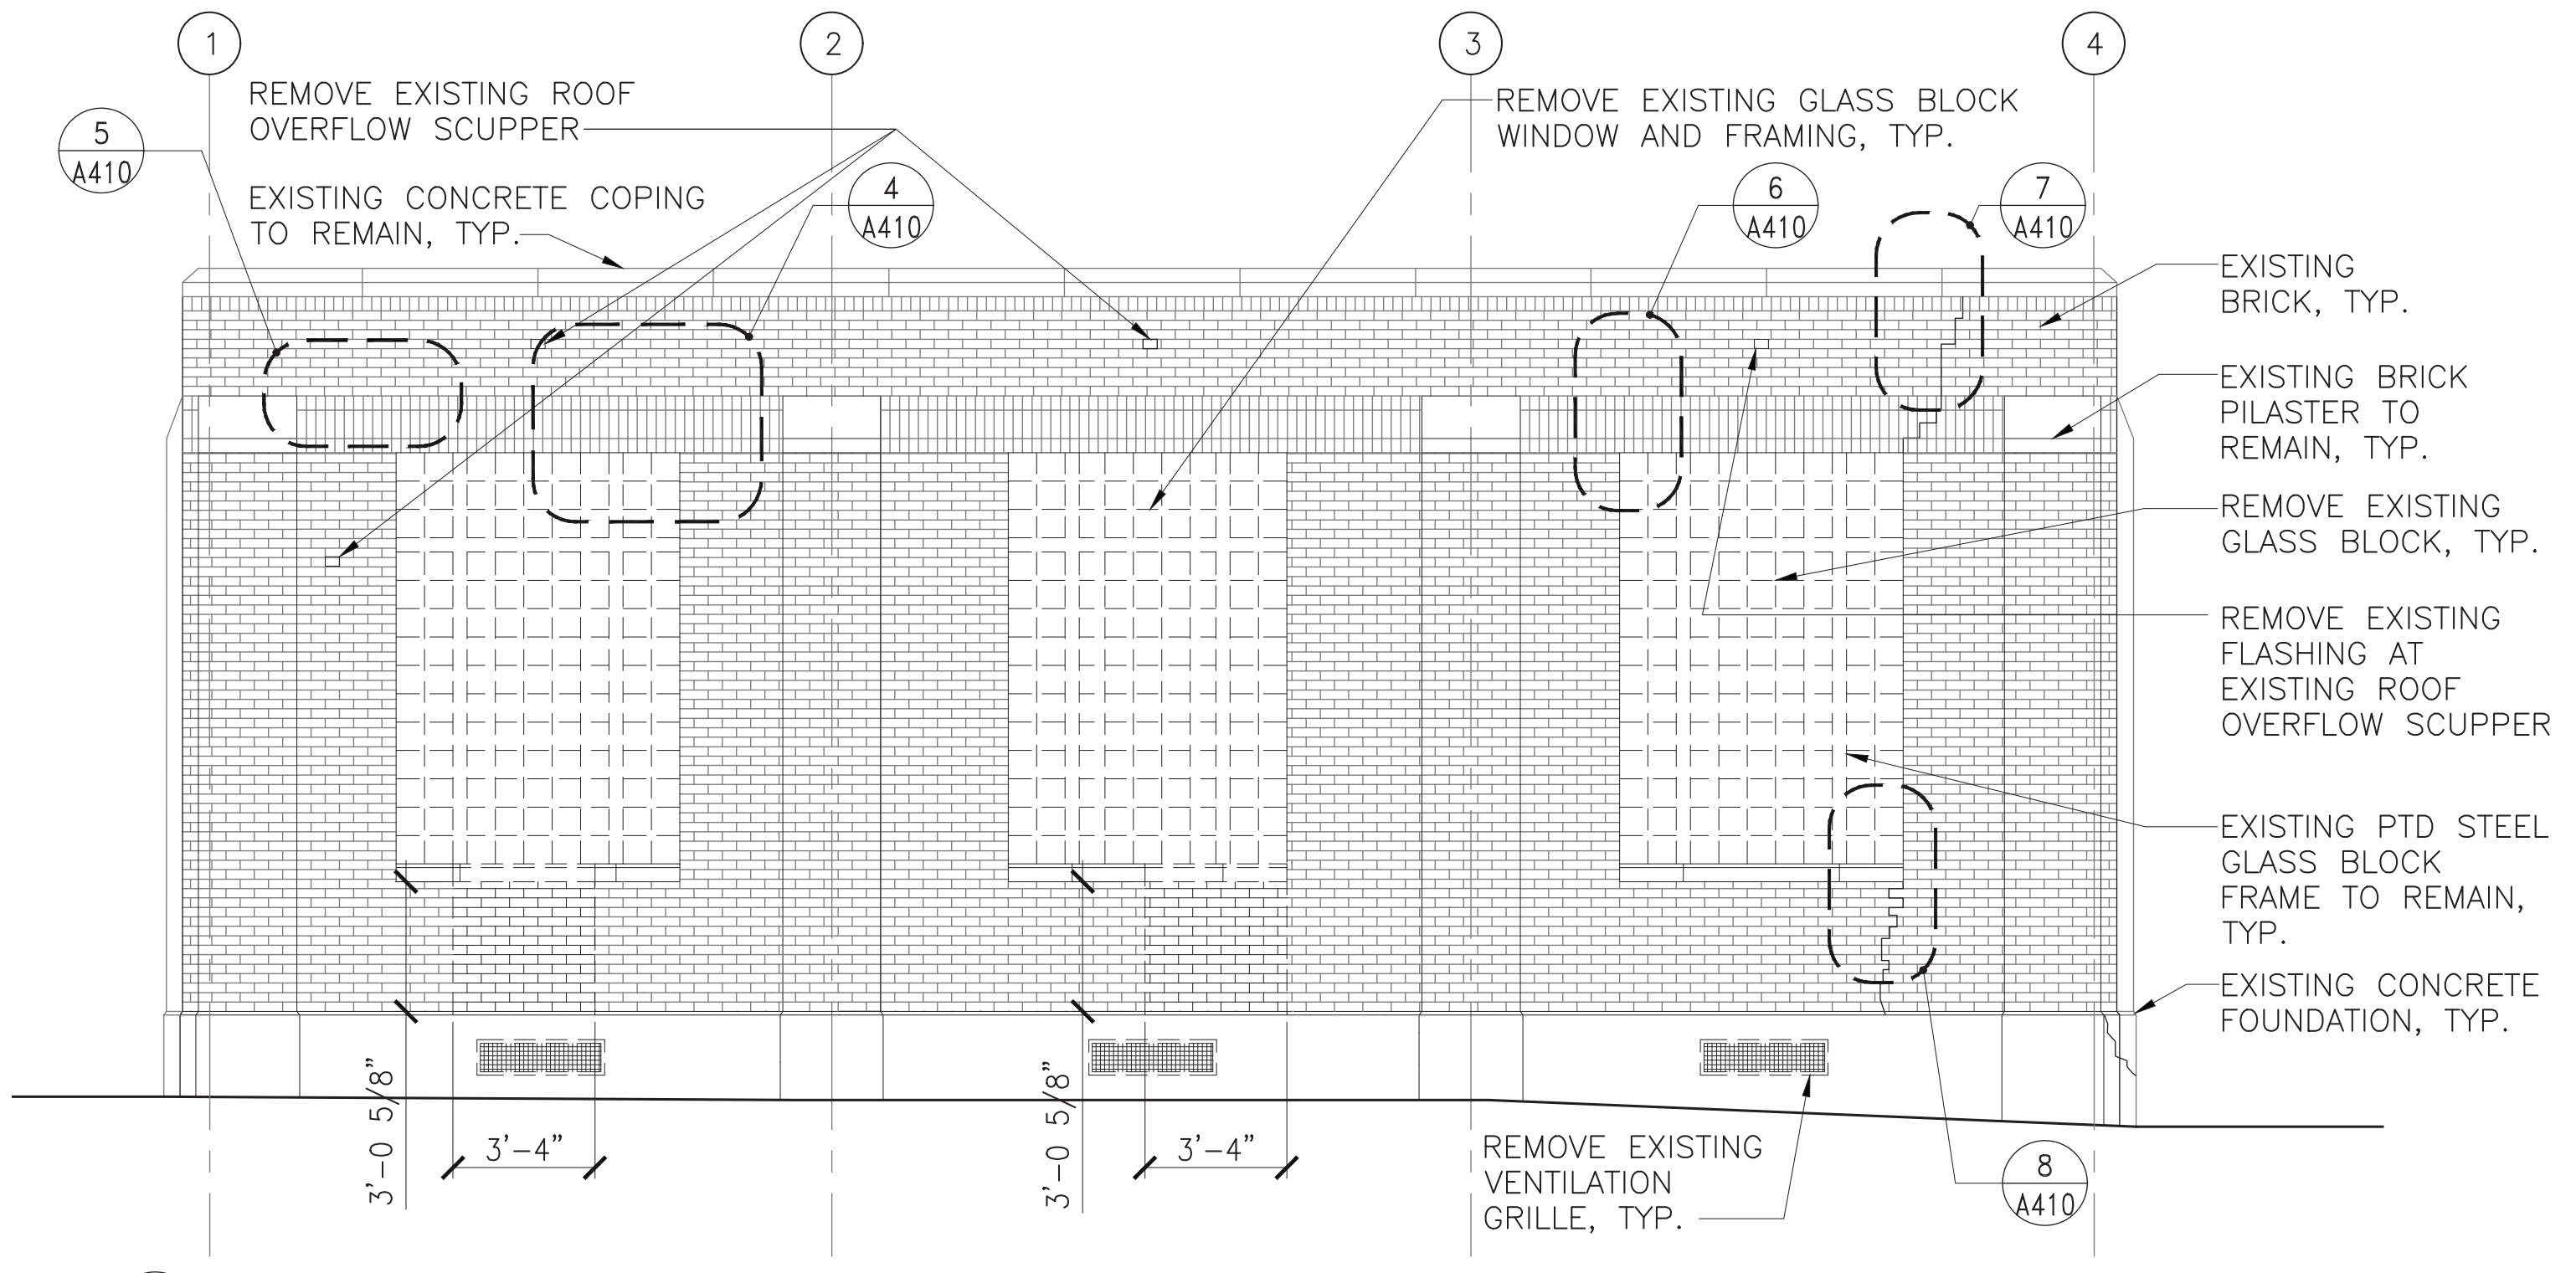

**4**  
A407  
**EXISTING SOUTH ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A403

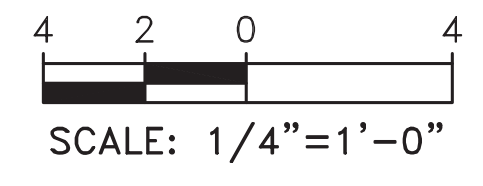

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\689\0517\AN-A407.DWG

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

DATE PRINTED: 10/21/2025

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
PROPOSED ELEVATIONS

SCALE: AS SHOWN SCALE FACTOR: 1:1

DATE: 10/16/2017 DRAWN BY: AC

WORK ORDER NO.: 276496 CHECKED BY: BF

SHEET NUMBER

**A408**

DWG. NO.: 9 OF 12


SHT. NO.: 388 OF 452

ARCHIVE NO. REV. NO.


COMPUTER FILE NO.: 17AN-A408

STATUS: 50% SUBMISSION


- NOTES:**
1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
  2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
  3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
  4. RAKE AND REPOINT BRICK, ENTIRE FACADE, EACH ELEVATION.
  5. CLEAN ENTIRE FACADE, EACH ELEVATION.
  6. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). FOLLOW ALL SEPTA SAFETY RULES.
  7. WORK SHALL BE PERFORMED IN STAGES ACCORDING TO OVERALL CONSTRUCTION STAGING AND SEQUENCING PLAN. SOME WORK MAY ONLY BE PERFORMED DURING POWER OUTAGE.

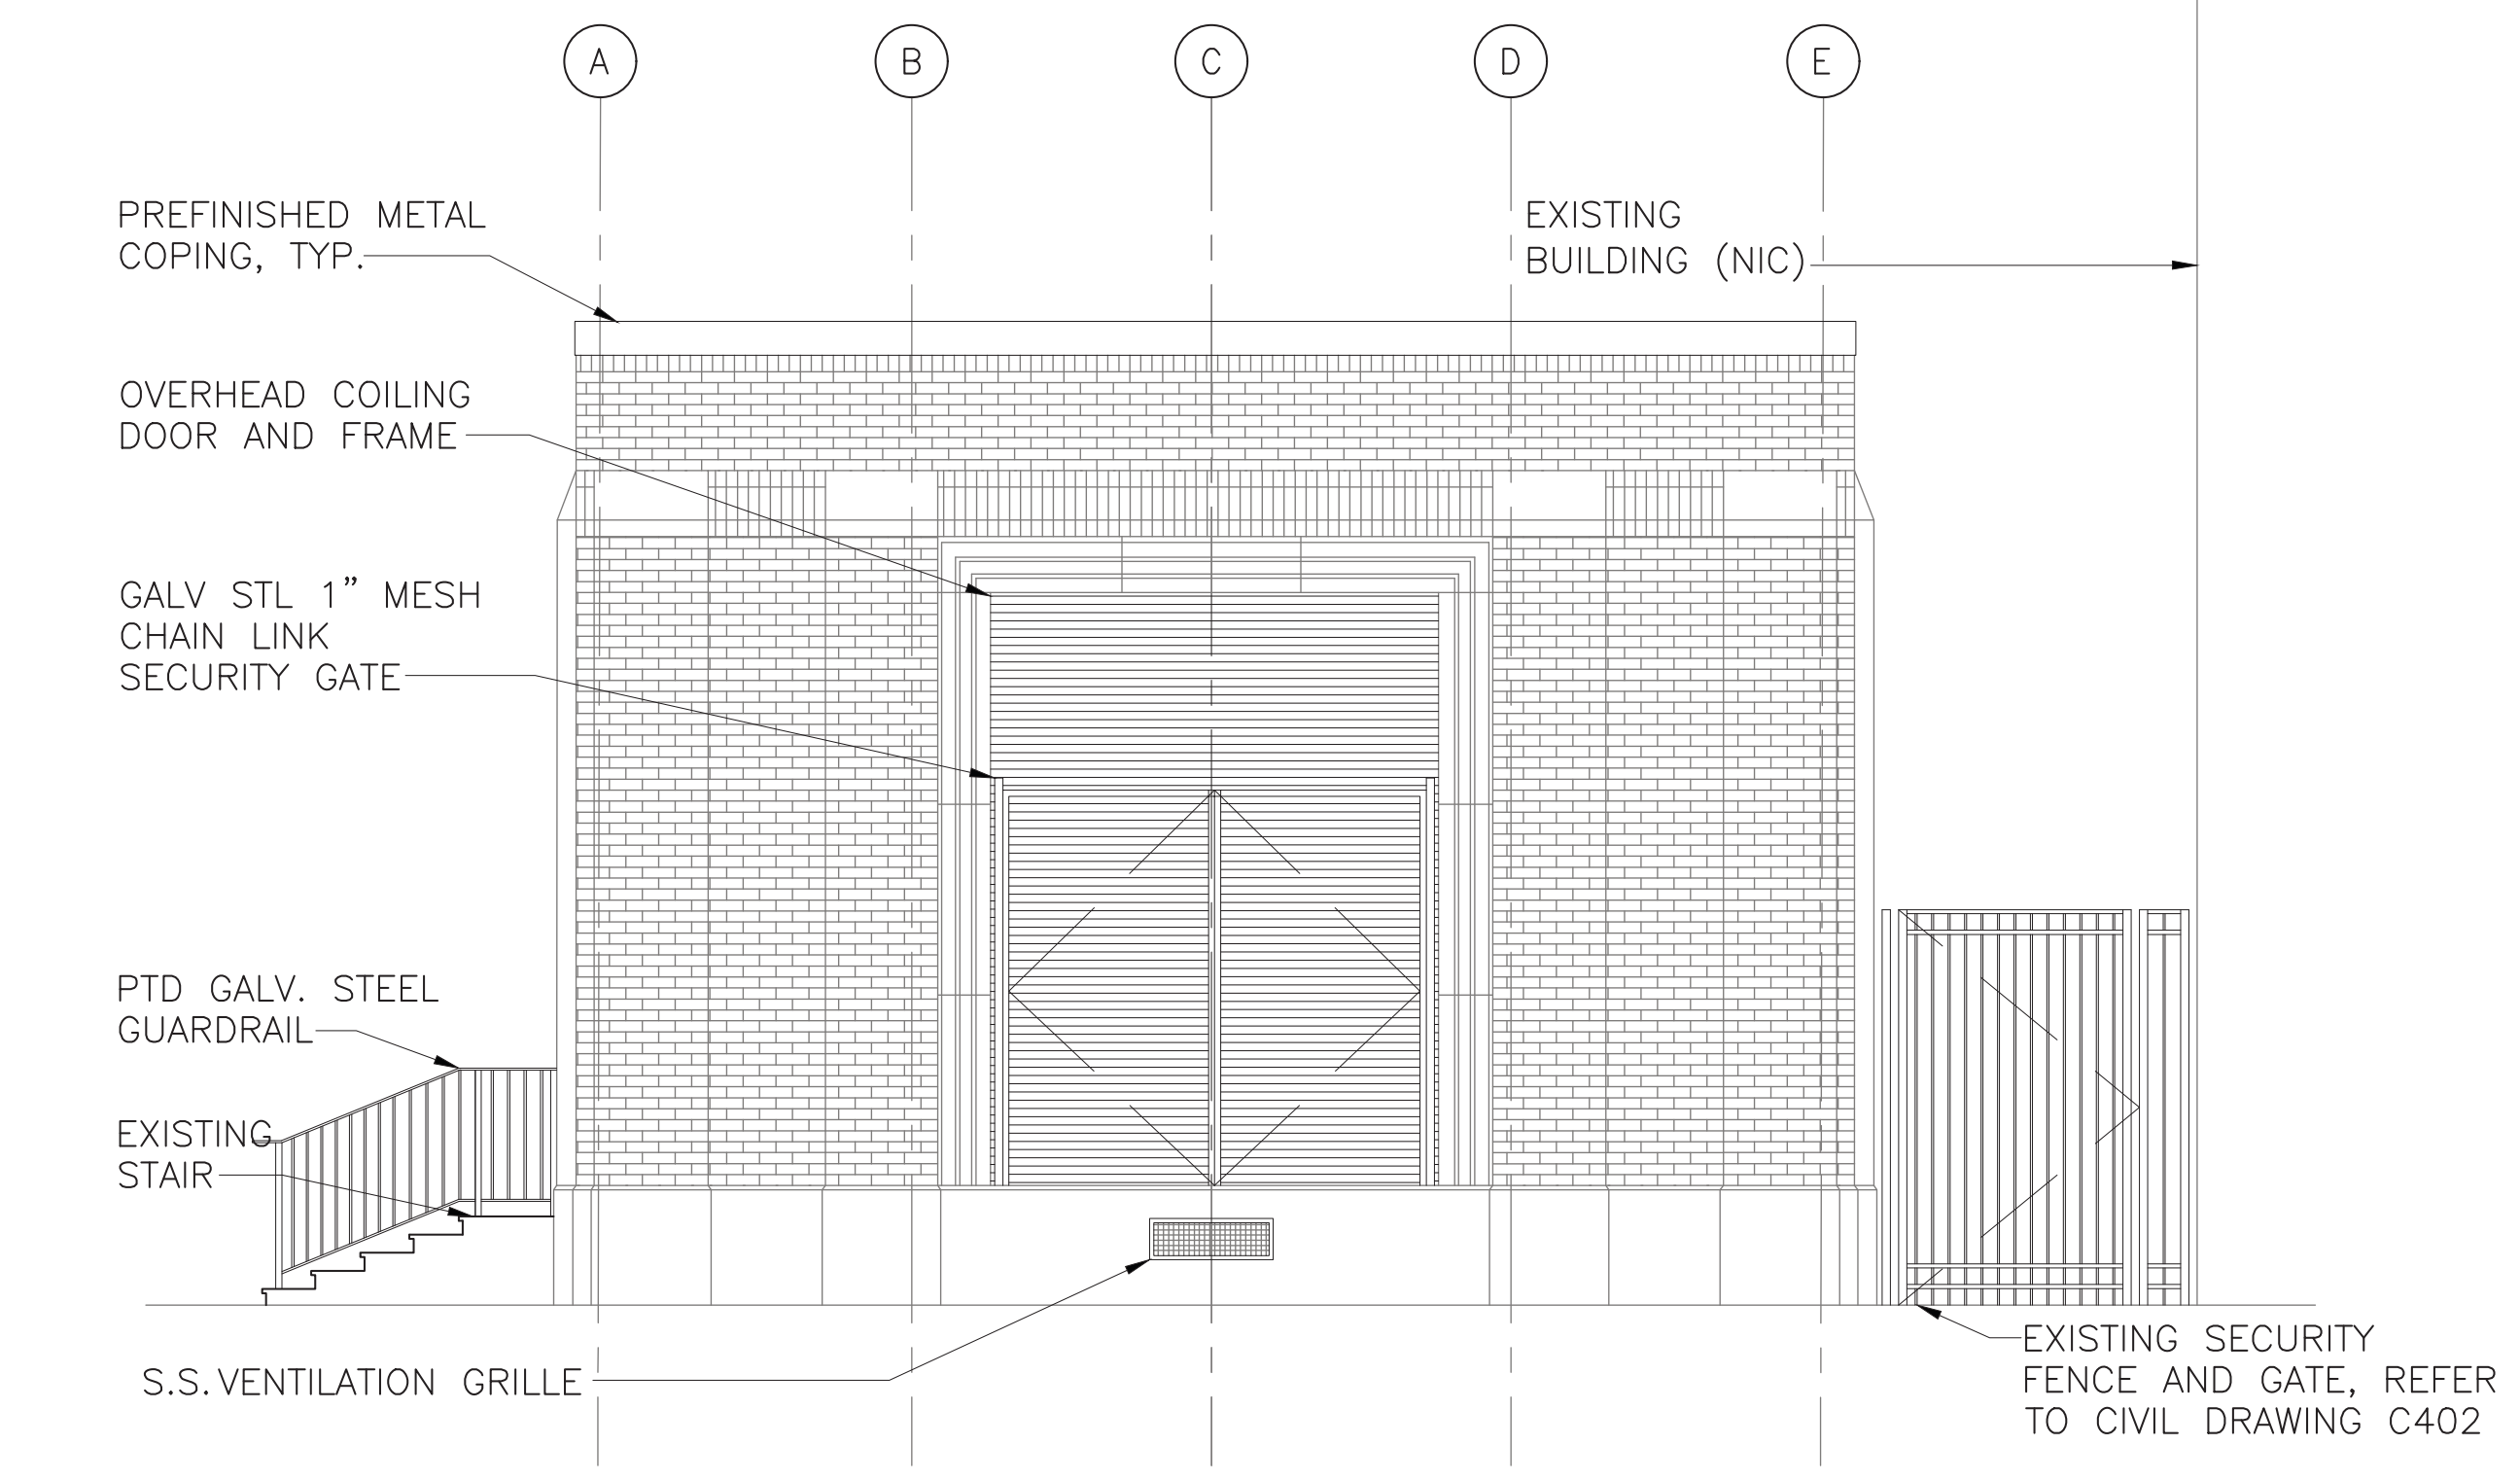


**1 WEST ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A405

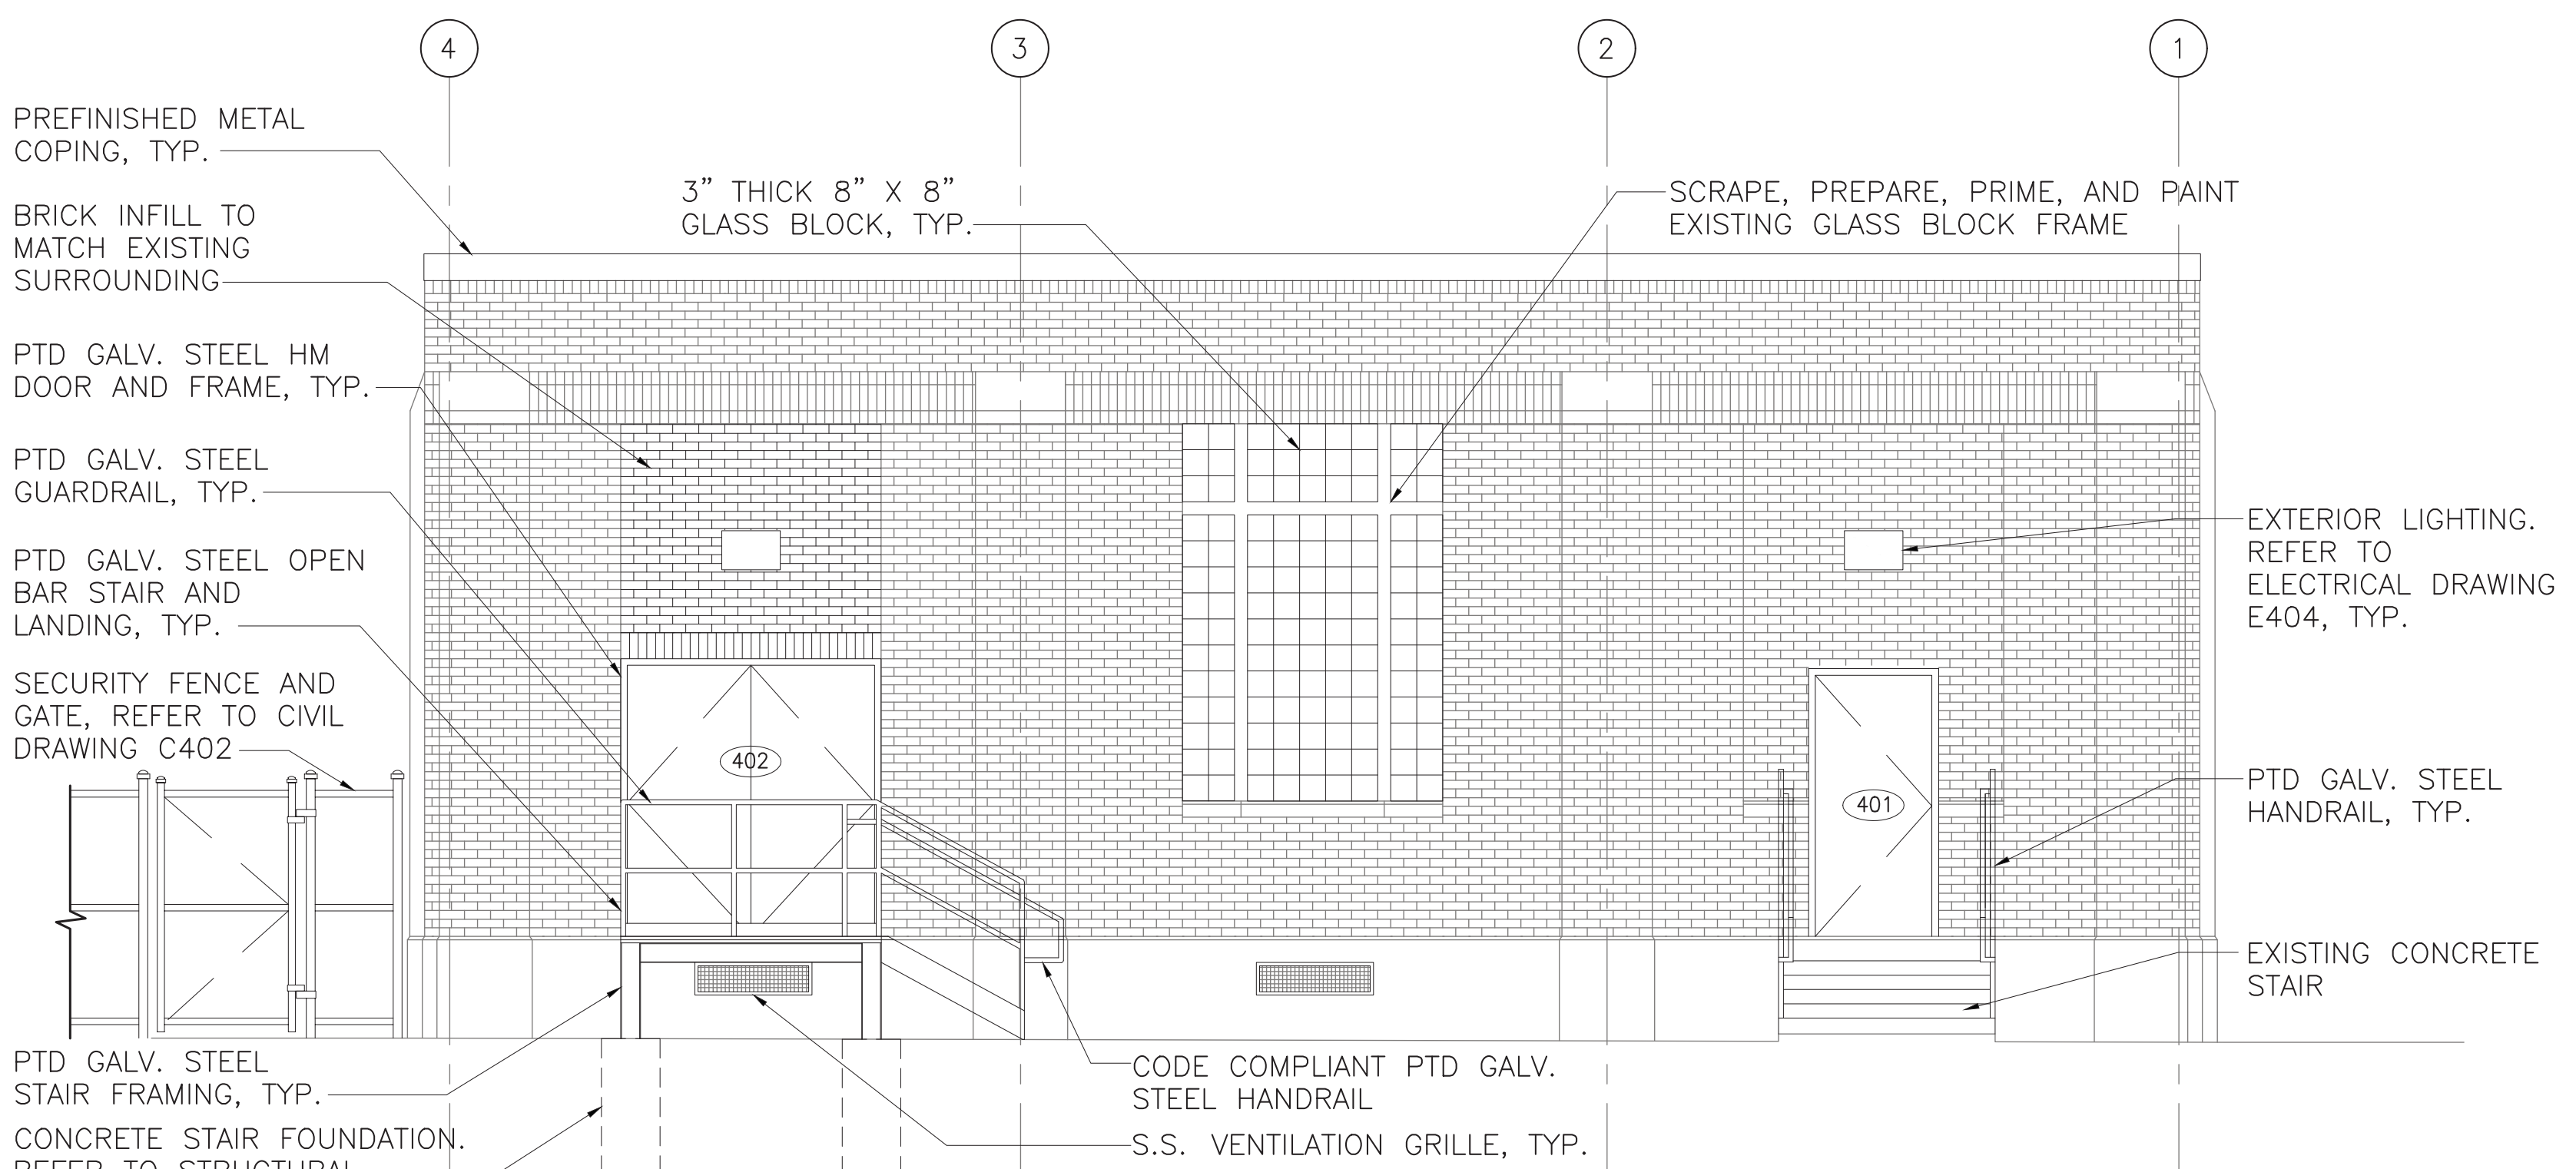


**2 NORTH ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A405

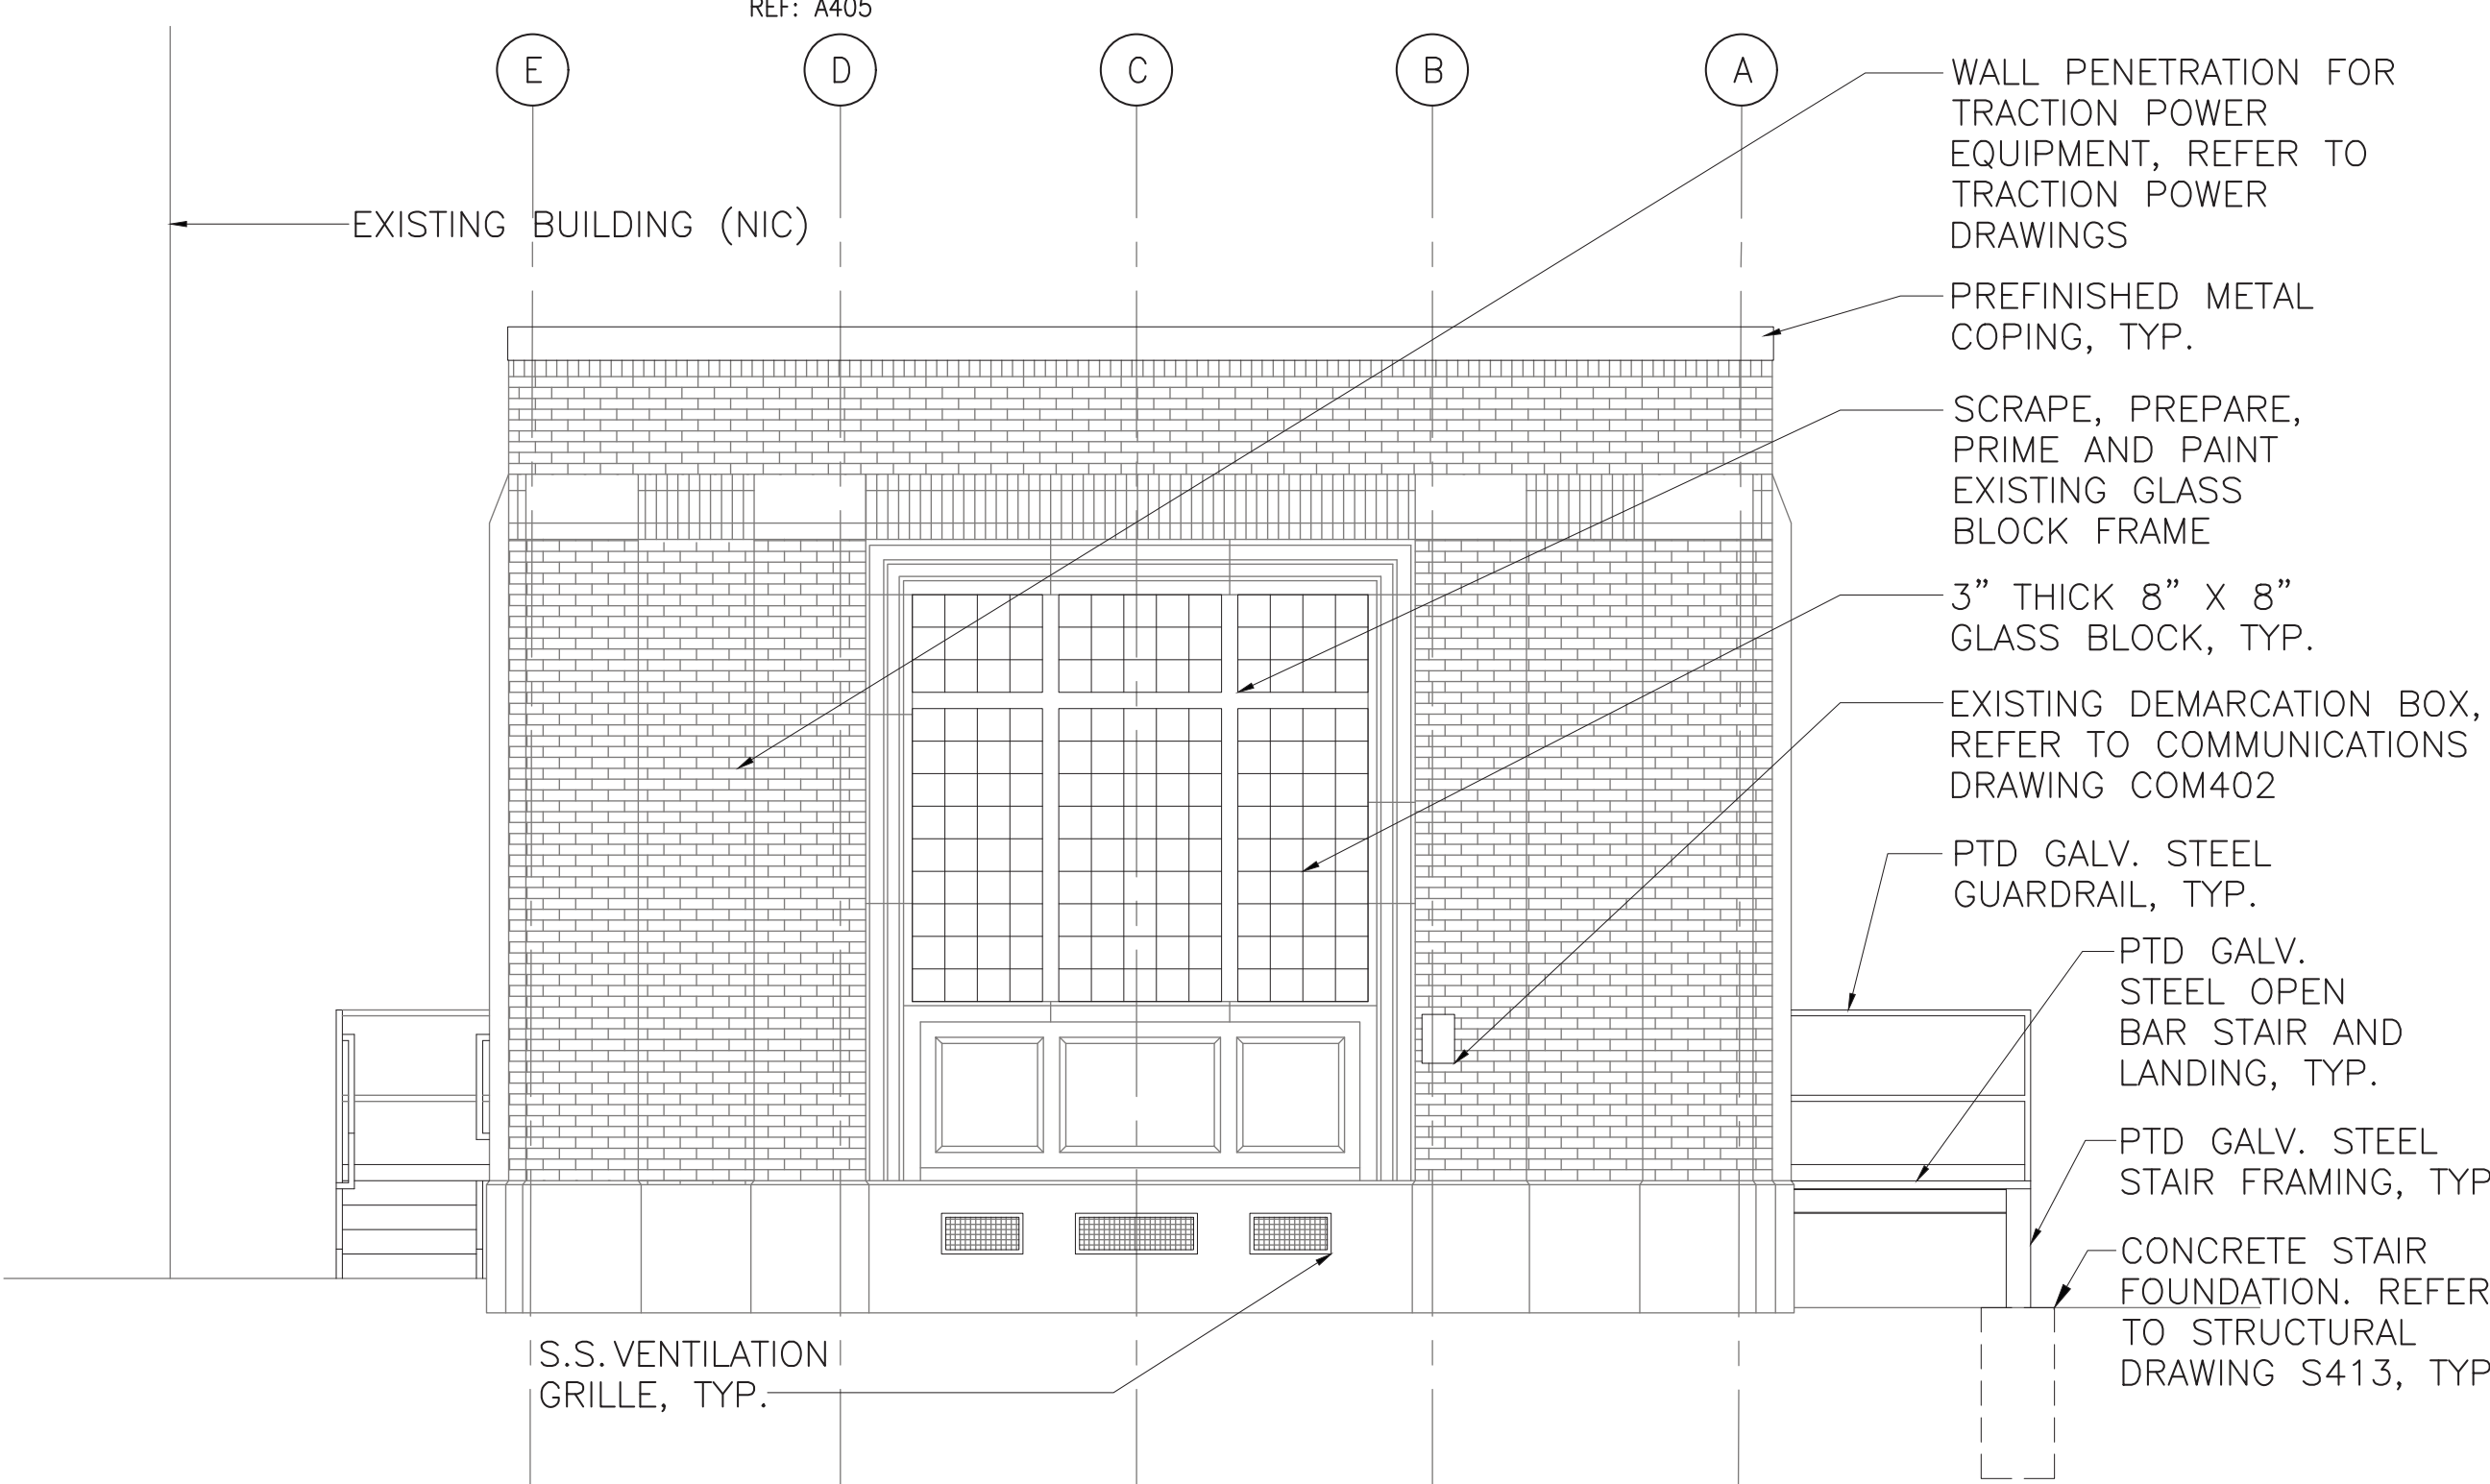

**3 EAST ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A405

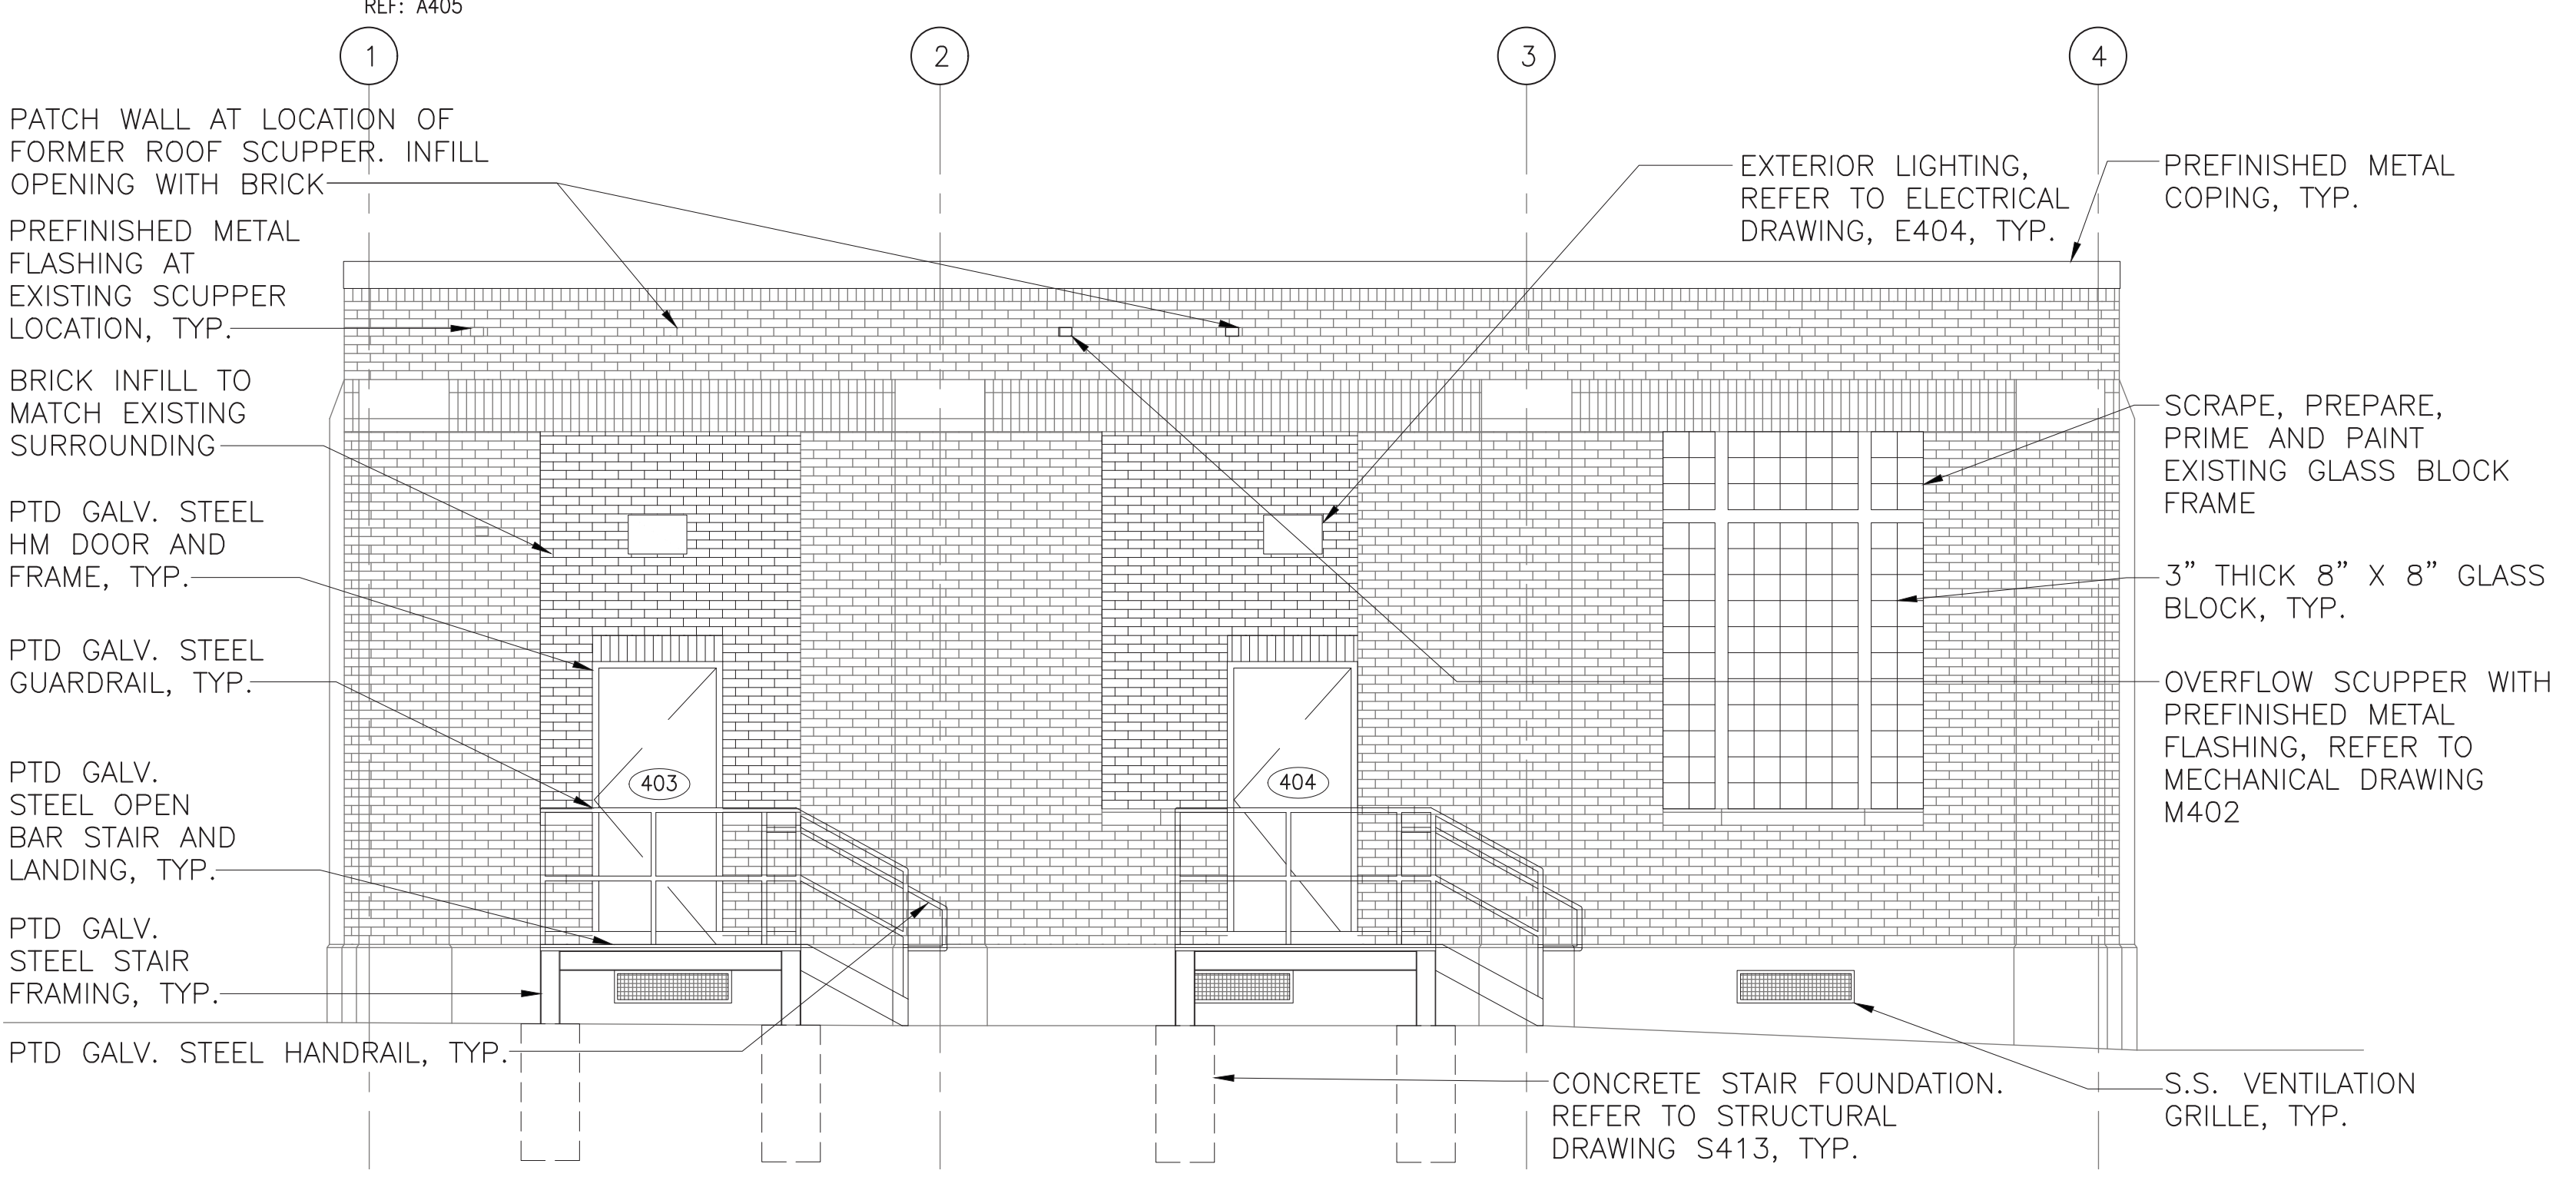

**4 SOUTH ELEVATION**  
SCALE: 1/4" = 1'-0"  
REF: A405

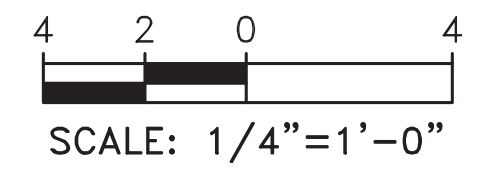

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\68910517AN-A408.DWG

REV	DATE	DESCRIPTION

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
PHOTO DETAILS - SHEET 1

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: AC
WORK ORDER NO: 276496	CHECKED BY: BF
SHEET NUMBER <b>A409</b>	
DWG. NO.: 10	OF 12
SHT. NO.: 389	OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-A409	REV. NO.:

DATE PRINTED: 10/21/2025  
STATUS: 90% SUBMISSION



**1**  
A409  
**CRACKED BRICK**  
SCALE: NOT TO SCALE  
REF: A403

CRACKED MORTAR, SEE REPAIR DETAIL 4/A411  
CRACKED BRICK, SEE REPAIR DETAIL 3/A411



**2**  
A409  
**DAMAGED WALL**  
SCALE: NOT TO SCALE  
REF: A403

CRACKED CEMENT PARGE, SEE REPAIR DETAIL 3/A411  
NOTE:  
WHILE DOOR IS REMOVED, INVESTIGATE AND REPAIR POSSIBLE DAMAGE TO EXISTING LINTEL



**3**  
A409  
**DAMAGED COPING**  
SCALE: NOT TO SCALE  
REF: A404

SPALLED CONCRETE, SEE REPAIR DETAIL 2/A411, TYP.

REMOVE EXISTING COPPER FLASHING, TYP.



**4**  
A409  
**CRACKED FOUNDATION**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED CONCRETE, SEE REPAIR DETAIL 3/A411



**5**  
A409  
**CRACKED FOUNDATION**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED CONCRETE, SEE REPAIR DETAIL 3/A411  
SPALLED CONCRETE, SEE REPAIR DETAIL 2/A411  
REMOVE EXISTING VENTILATION GRILLE



**6**  
A409  
**CRACKED FOUNDATION**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED CONCRETE, SEE REPAIR DETAIL 3/A411  
SPALLED CONCRETE, SEE REPAIR DETAIL 2/A411  
REMOVE EXISTING VENTILATION GRILLE




**7**  
A409  
**DAMAGED BRICK**  
SCALE: NOT TO SCALE  
REF: A407

REMOVE DAMAGED BRICK. REPLACE WITH BRICK TO MATCH EXISTING



**8**  
A409  
**CRACKED MORTAR JOINT**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411

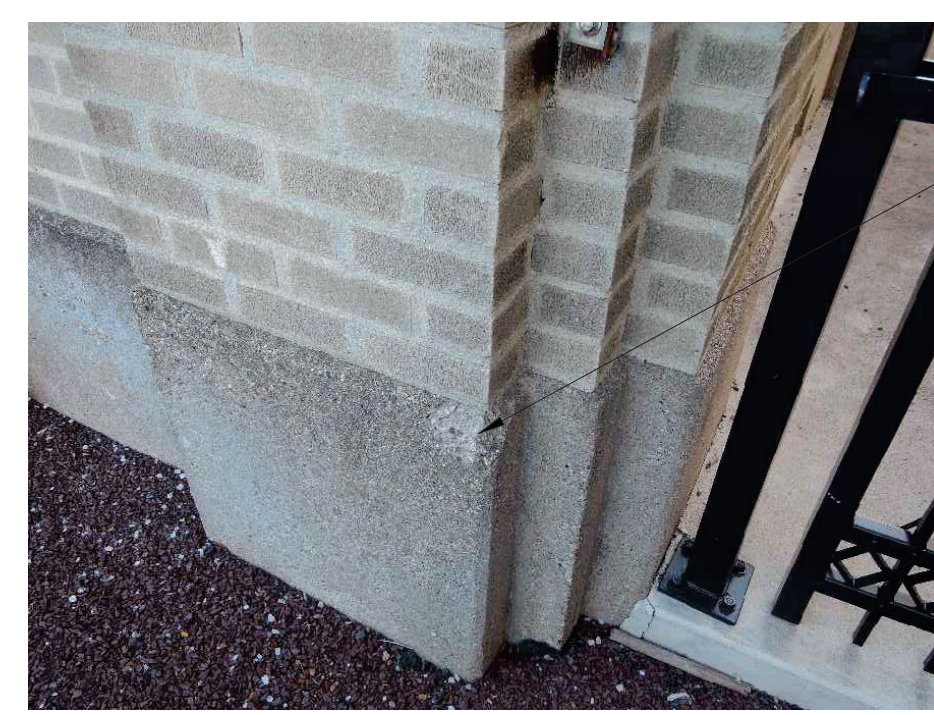

**9**  
A409  
**SPALLED CONCRETE**  
SCALE: NOT TO SCALE  
REF: A407

SPALLED CONCRETE, SEE REPAIR DETAIL 2/A411




**10**  
A409  
**CRACKED BRICK**  
SCALE: NOT TO SCALE  
REF: A407

REMOVE ALL SEALANT FROM WALL. REPOINT PER DETAIL 4/A411  
CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411  
CRACKED BRICK, SEE REPAIR DETAIL 3/A411



**11**  
A409  
**CRACKED BRICK**  
SCALE: NOT TO SCALE  
REF: A407

REMOVE SEALANT FROM WALL. RE-SEAL ABANDONED PENETRATION PER DETAIL 5/A411  
REMOVE ALL SEALANT FROM WALL. REPOINT PER DETAIL 4/A411  
CRACKED BRICK, SEE REPAIR DETAIL 3/A411  
CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411  
DAMAGED MASONRY/LINTEL TIE-IN, REFER TO NOTES AND DETAILS ON DRAWING A411

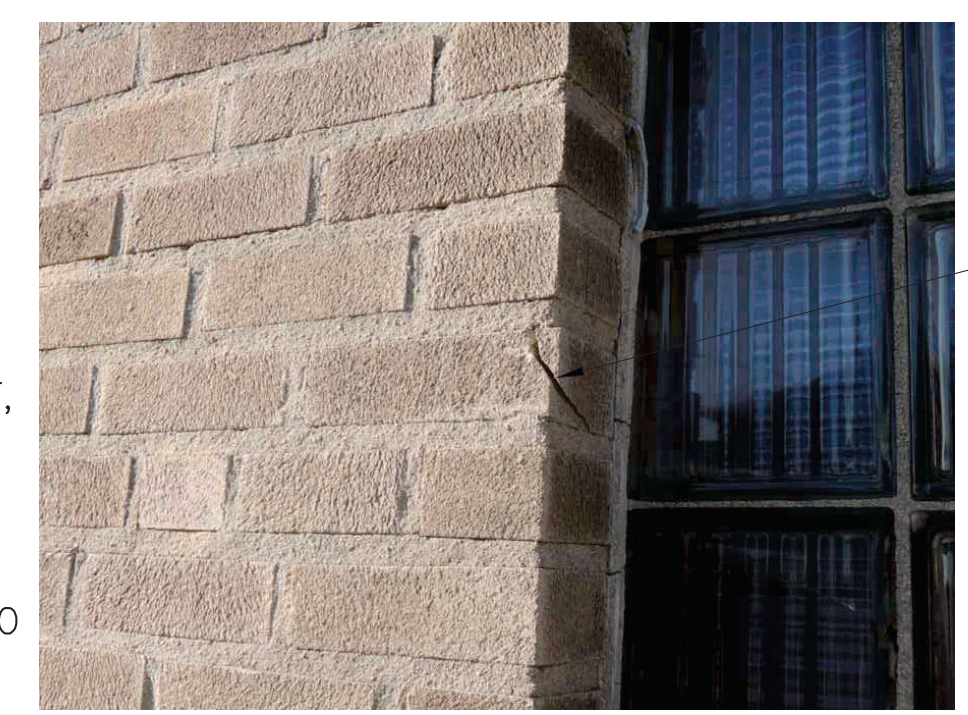


**12**  
A409  
**DAMAGED BRICK**  
SCALE: NOT TO SCALE  
REF: A407

REMOVE DAMAGED BRICK. REPLACE WITH BRICK TO MATCH EXISTING



**13**  
A409  
**CRACKED MORTAR JOINT**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411  
OPEN MORTAR JOINT, SEE REPAIR DETAIL 4/A411

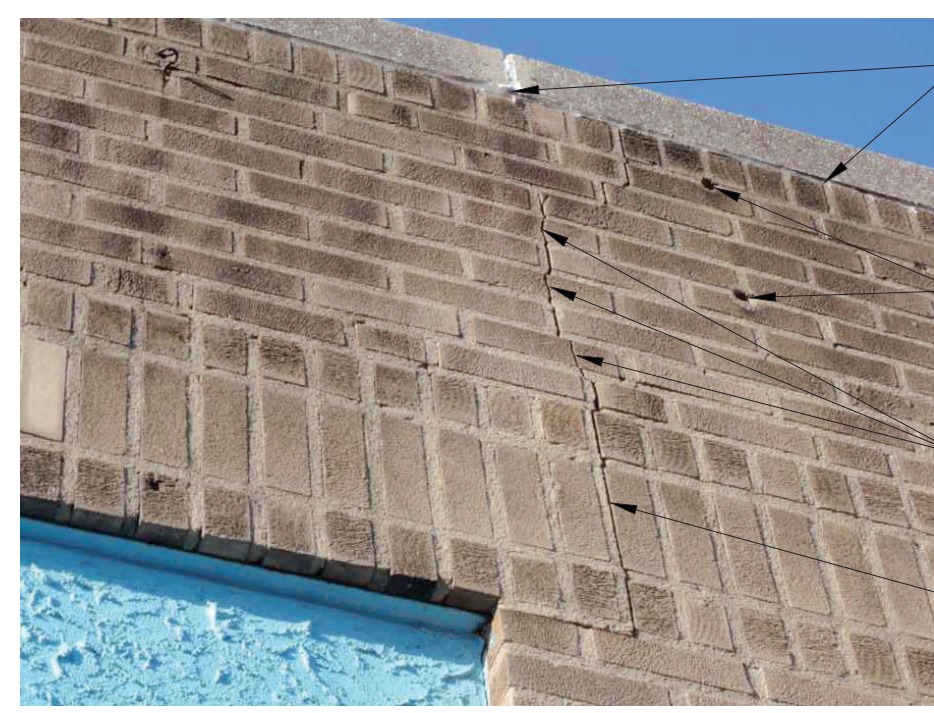

**14**  
A409  
**CRACKED BRICK**  
SCALE: NOT TO SCALE  
REF: A407

REMOVE ALL SEALANT FROM WALL. REPOINT PER DETAIL 4/A411  
SEAL ABANDONED PENETRATION, SEE REPAIR DETAIL 5/A411  
CRACKED BRICK, SEE REPAIR DETAIL 3/A411  
CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411



**15**  
A409  
**CRACKED FOUNDATION**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED CONCRETE, SEE REPAIR DETAIL 3/A411



**16**  
A409  
**OPEN MORTAR JOINT**  
SCALE: NOT TO SCALE  
REF: A407

OPEN MORTAR JOINT, SEE REPAIR DETAIL 4/A411

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\PIWORKING\PTTD\68910517AN-A409.DWG

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
PHOTO DETAILS - SHEET 2


SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	10/16/2017	DRAWN BY:	AC
WORK ORDER NO.:	276496	CHECKED BY:	BF
SHEET NUMBER:	<b>A410</b>		
DWG. NO.:	11	OF	12
SHT. NO.:	390	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-A410	REV. NO.:	1

50% SUBMISSION  
NOT FOR CONSTRUCTION



**1**  
**A410**  
**CRACKED FOUNDATION**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED CONCRETE, SEE REPAIR DETAIL 3/A411, TYP.  
REMOVE EXISTING VENTILATION GRILLE

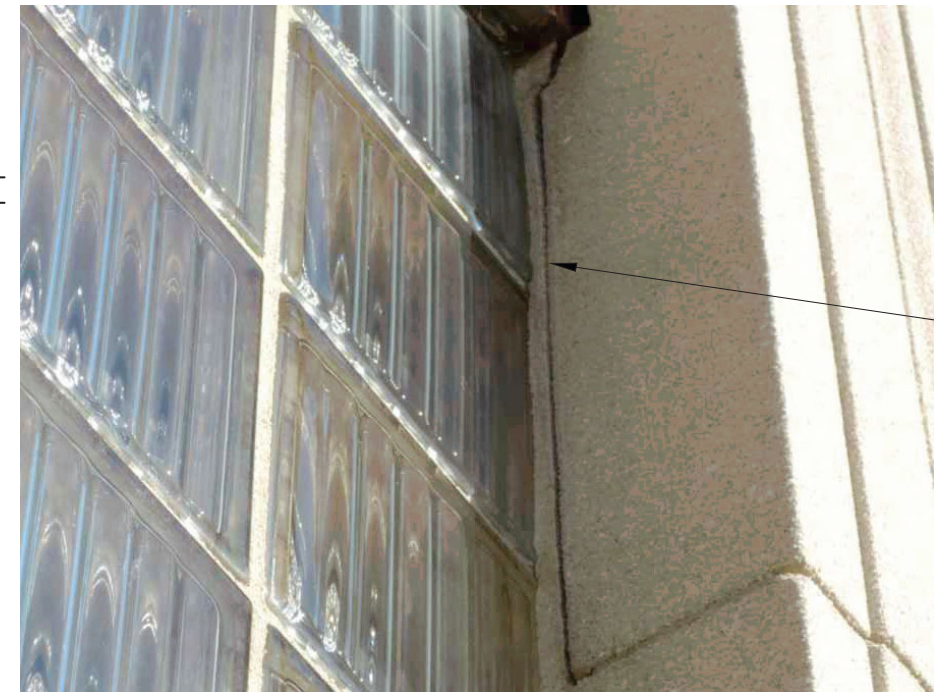

**2**  
**A410**  
**CRACKED MORTAR JOINT**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411



**3**  
**A410**  
**MORTAR CRACK**  
SCALE: NOT TO SCALE  
REF: A407

REMOVE ALL SEALANT FROM WALL. REPOINT PER DETAIL 4/A411  
CRACKED BRICK, SEE REPAIR DETAIL 3/A411  
CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411




**4**  
**A410**  
**DAMAGED LINTEL**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, REFER TO DETAIL 4/A411  
REMOVE AND RESET PORTION OF WALL AT LINTEL WHICH IS OUT OF PLUMB WITH WALL  
DAMAGED MASONRY/LINTEL TIE-IN, REFER TO NOTES AND DETAILS ON DRAWING A411



**5**  
**A410**  
**DAMAGED LINTEL**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411, TYP.  
REMOVE AND RESET PORTION OF WALL AT LINTEL WHICH IS OUT OF PLUMB WITH WALL  
DAMAGED MASONRY/LINTEL TIE-IN, REFER TO NOTES AND DETAILS ON DRAWING A411

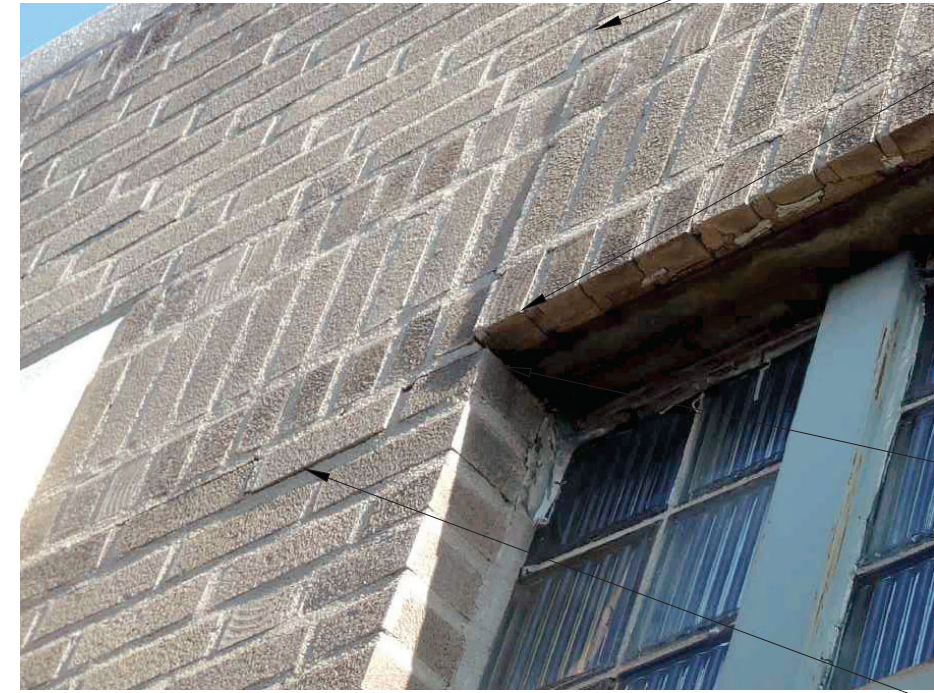


**6**  
**A410**  
**DAMAGED LINTEL**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411, TYP.  
REMOVE AND RESET PORTION OF WALL AT LINTEL WHICH IS OUT OF PLUMB WITH WALL AND REPLACE LINTEL. REFER TO STRUCTURAL DRAWING S412  
DAMAGED MASONRY/LINTEL TIE-IN, REFER TO NOTES AND DETAILS ON DRAWING A411  
CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411, TYP.



**7**  
**A410**  
**DAMAGED LINTEL**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED BRICK, SEE REPAIR DETAIL 3/A411  
REMOVE SEALANT FROM WALL. RE-SEAL ABANDONED PENETRATION PER DETAIL 5/A411  
CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411, TYP.  
DAMAGED MASONRY/LINTEL TIE-IN, REFER TO NOTES AND DETAILS ON DRAWING A411

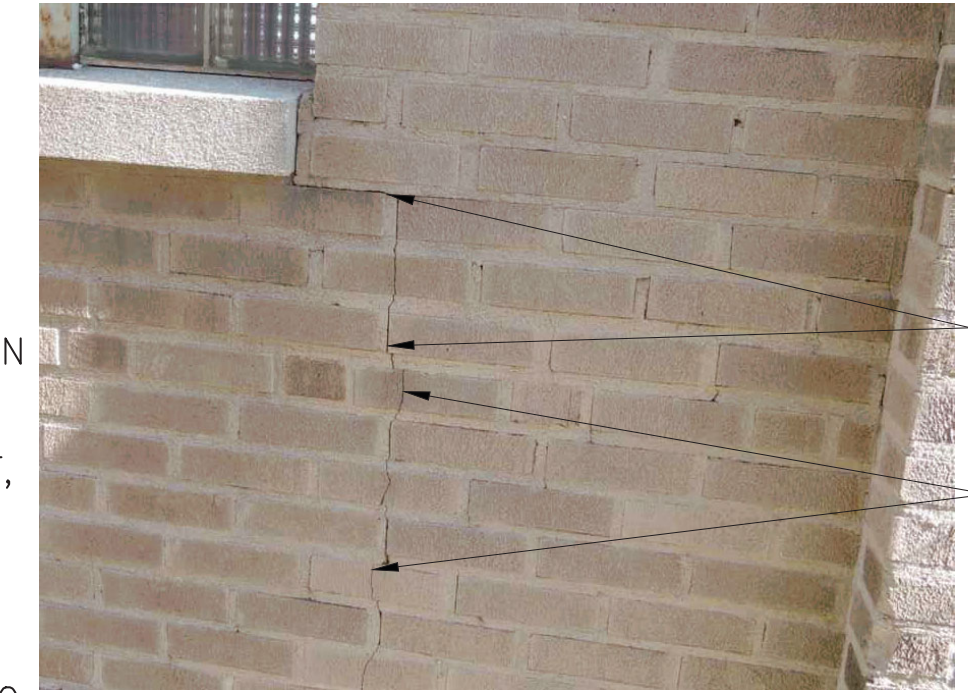

**8**  
**A410**  
**MORTAR CRACK**  
SCALE: NOT TO SCALE  
REF: A407

CRACKED MORTAR JOINT, SEE REPAIR DETAIL 4/A411, TYP.  
CRACKED BRICK, SEE REPAIR DETAIL 3/A411

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ARCHITECTURAL**  
MISCELLANEOUS DETAILS

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: AC CHECKED BY: BF
WORK ORDER NO: 276496	SHEET NUMBER: <b>A411</b>
DWG. NO.: 12 OF 12	SHT. NO.: 391 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-A411	REV. NO.:

**NOTES:**

1. ALL CONDITIONS ARE EXISTING UNLESS NOTED OTHERWISE, TYPICAL.
2. ALL EXISTING DIMENSIONS SHALL BE VERIFIED IN FIELD, TYPICAL.
3. DRAWINGS INDICATE THE VARIOUS TYPES OF REPAIRS REQUIRED AT THE MOST SEVERE LOCATIONS. DRAWINGS SHOW THE INTENT OF THE SCOPE OF WORK BUT DO NOT INCLUDE EVERY SMALL AREA REQUIRING REPAIR, RESTORATION OR REFINISH.
4. PATCHING CEMENT SHALL BE DESIGNED FOR THE REPAIR OF HORIZONTAL, VERTICAL, AND OVERHEAD CONCRETE AND MASONRY SURFACES.
5. MORTAR SHALL BE COMPATIBLE WITH EXISTING MORTAR IN HARDNESS, TEXTURE AND COLOR.
6. REFER TO STRUCTURAL DRAWINGS S406 AND S409 FOR STRUCTURAL REPAIRS, TYPICAL.

**REPAIR NOTES**

**BRICK:**

1. POWERWASH ALL BRICK SURFACES TO REMOVE DIRT AND GRIME.
2. RAKE AND REPOINT ALL AREAS OF DAMAGED MORTAR JOINTS.
3. REMOVE AND RE-INSTALL BRICKS AT SEVERE CRACK LOCATIONS.
4. GRIND OUT CRACK. PREP, PRIME AND PAINT METAL SURFACE OF SHELF ANGLE, REMORTAR.
5. WATERPROOF BRICK WALLS WITH AN APPROVED BREATHABLE, CLEAR SILANE SOLUTION.
6. REPLACE ALL MISSING, CRACKED, BROKEN AND SPALLED BRICK.
7. REPAIR CRACKS IN WALLS.
8. REMOVE AND REBUILD THE BOWING AREA OF BRICK WALL LOCATED IN THE CENTER END OF THE WEST ELEVATION. APPROXIMATELY 150 S.F. WORK AREA, 10 S.F. OF THIS AREA IS TO BE REMOVED AND REBUILT.
9. REPAIR ALL CRACKED BRICK, MAXIMUM CRACK WIDTH 1/8". REPLACE BRICK WHERE CRACK EXCEEDS 1/8".
10. REPOINT OPEN MORTAR JOINTS IN EXISTING AREAS AS SHOWN.
11. REMOVE ALL EXISTING PAINT ON BRICK.

**WALL PENETRATIONS:**

1. REMOVE ABANDONED PROJECTIONS, FILL OPEN HOLES SOLID WITH NON-SHRINK GROUT.
2. AT SMALL PIPE/CONDUIT WALL PENETRATIONS SEAL VOID BETWEEN PIPE AND WALL WITH BACKER ROD AND SEALANT.
3. SEAL PERIMETER OF CONDUIT AND SLEEVES.
4. REMOVE ABANDONED PIPING, FILL OPEN HOLES SOLID WITH NON-SHRINK GROUT.

**STEEL LINTELS:**

1. EXISTING FAILING LINTELS TO BE REMOVED & REPLACED.
2. RAKE AND RE-CAULK METAL/ MASONRY TIE-IN
3. PREPARE RUSTED LINTEL TO BARE METAL, PRIME (1 COAT) AND PAINT (2 COATS).
4. REMOVE AND REPLACE DAMAGED LINTELS. COORDINATE WITH STRUCTURAL DRAWINGS

**POWERWASHING, SCRAPING, AND SANDING:**


1. TESTING SHALL BE PERFORMED TO DETERMINE PRESENCE OF LEAD. IF LEAD IS PRESENT, ALL INSTANCES SHALL BE REMEDIATED. ALL REMEDIATION WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND LAWS.
2. PAINTED SURFACES BEING POWERWASHED SHALL BE "CONTAINED" AS PER CODE.
3. DRY SCRAPING OR SANDING OF PAINTED SURFACES MAY ONLY BE PERFORMED WITH EQUIPMENT UTILIZING VACUUM ATTACHMENT W/ HEPA FILTER, AS PER CODE.

**ASBESTOS REMOVAL:**


1. TESTING SHALL BE PERFORMED TO DETERMINE THE PRESENCE OF ASBESTOS. IF ASBESTOS IS PRESENT, ALL INSTANCES SHALL BE ABATED. ALL ABATEMENT WORK SHALL BE PERFORMED IN ACCORDANCE WITH ALL APPLICABLE CODES AND LAWS.
2. REMOVAL OF NON-FRIABLE ASBESTOS CONTAINING MATERIALS SHALL BE PERFORMED IN SUCH A MANNER THAT THE MATERIALS REMAIN NON-FRIABLE DURING THE RENOVATION. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE THAT THE MATERIALS ARE REMOVED WITHOUT RENDERING THE MATERIAL FRIABLE. REFER TO ASBESTOS ABATEMENT SPECIFICATIONS FOR ADDITIONAL INFORMATION ON REMOVAL PROCEDURES.

**CEMENT PARGE:**


1. POWER WASH REPAIR AREA AND SURROUNDING AREA.
2. APPLY CEMENT PARGE EVENLY WITH EXISTING.
3. PAINT TO MATCH EXISTING.

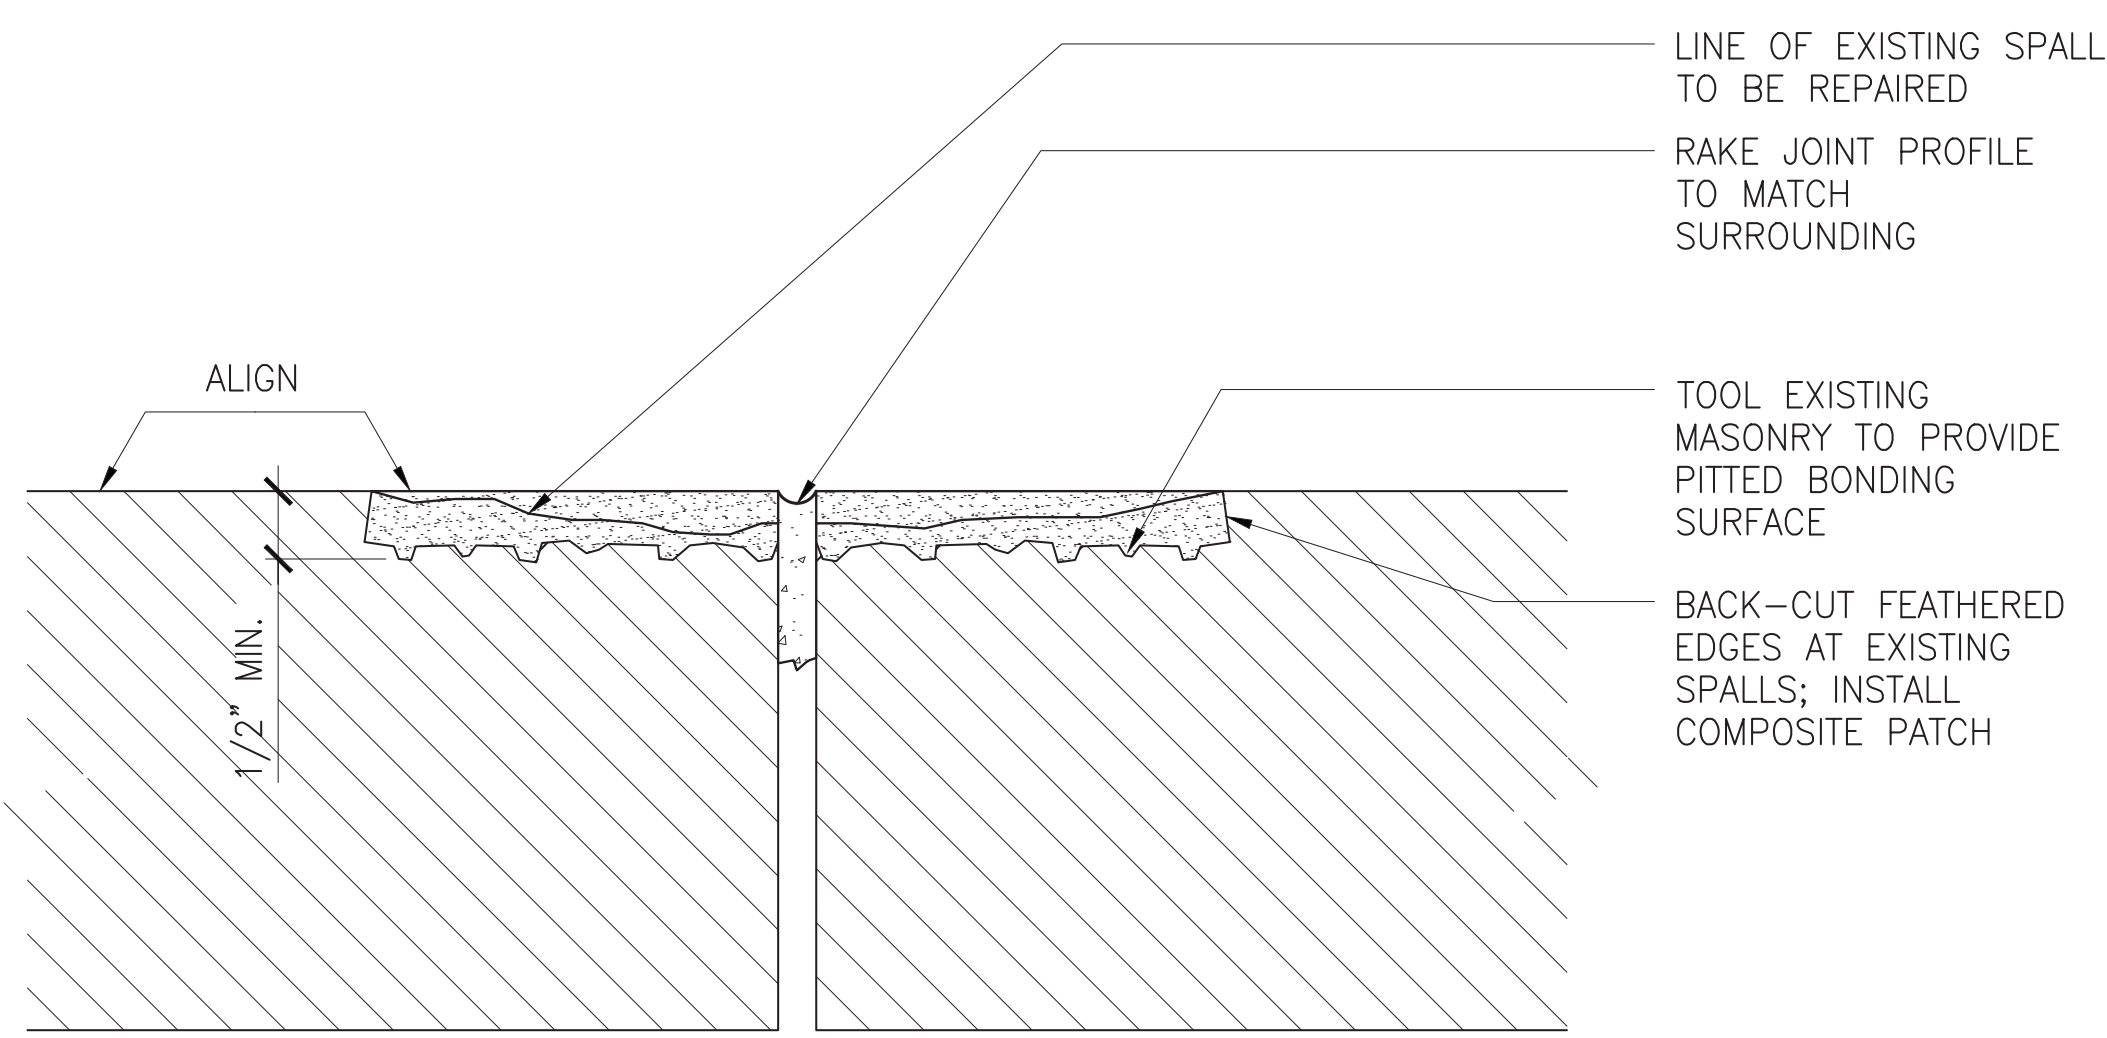


**1 MASONRY SPALL REPAIR AT JOINT**  
SCALE: 6" = 1'-0"

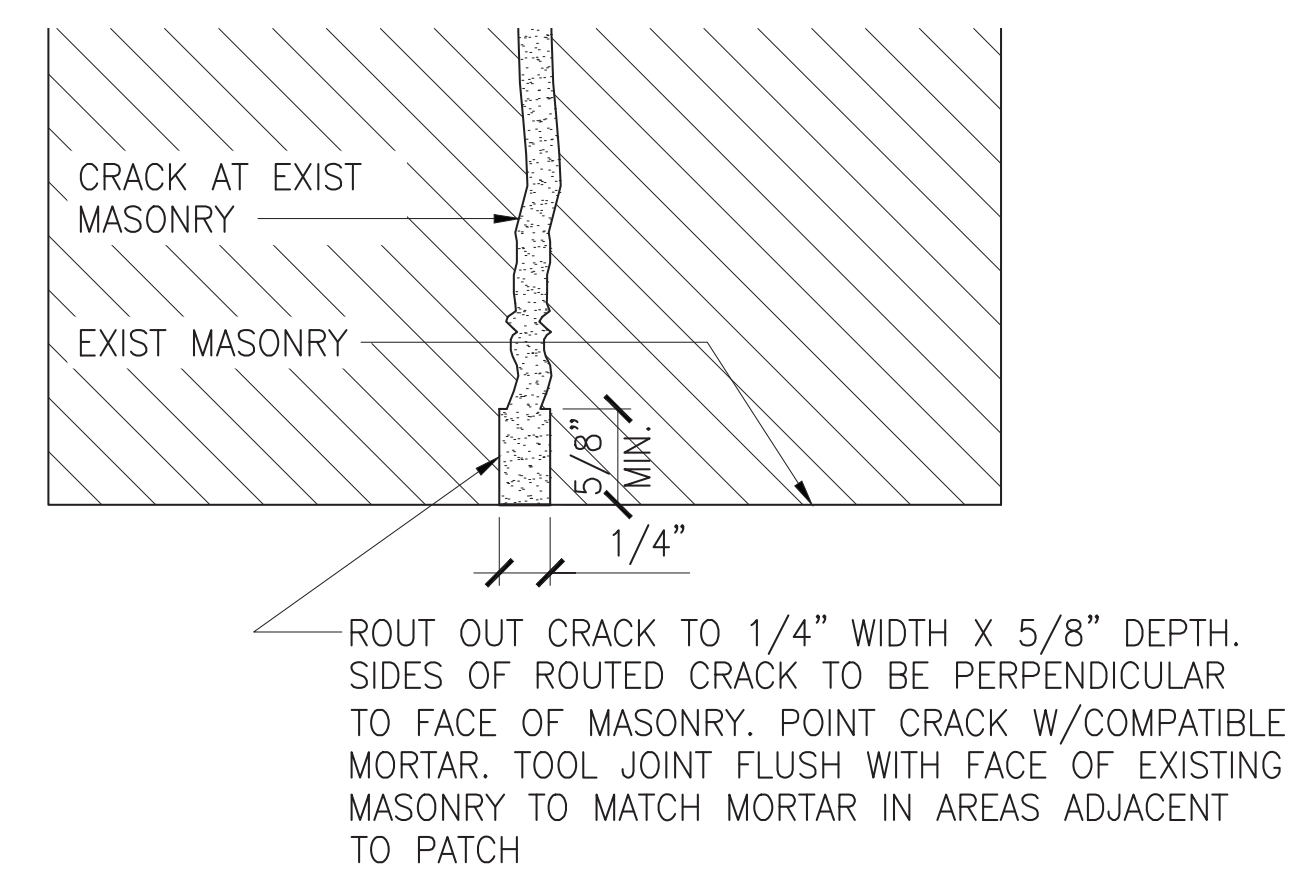


**3 MASONRY CRACK REPAIR**  
SCALE: 6" = 1'-0"

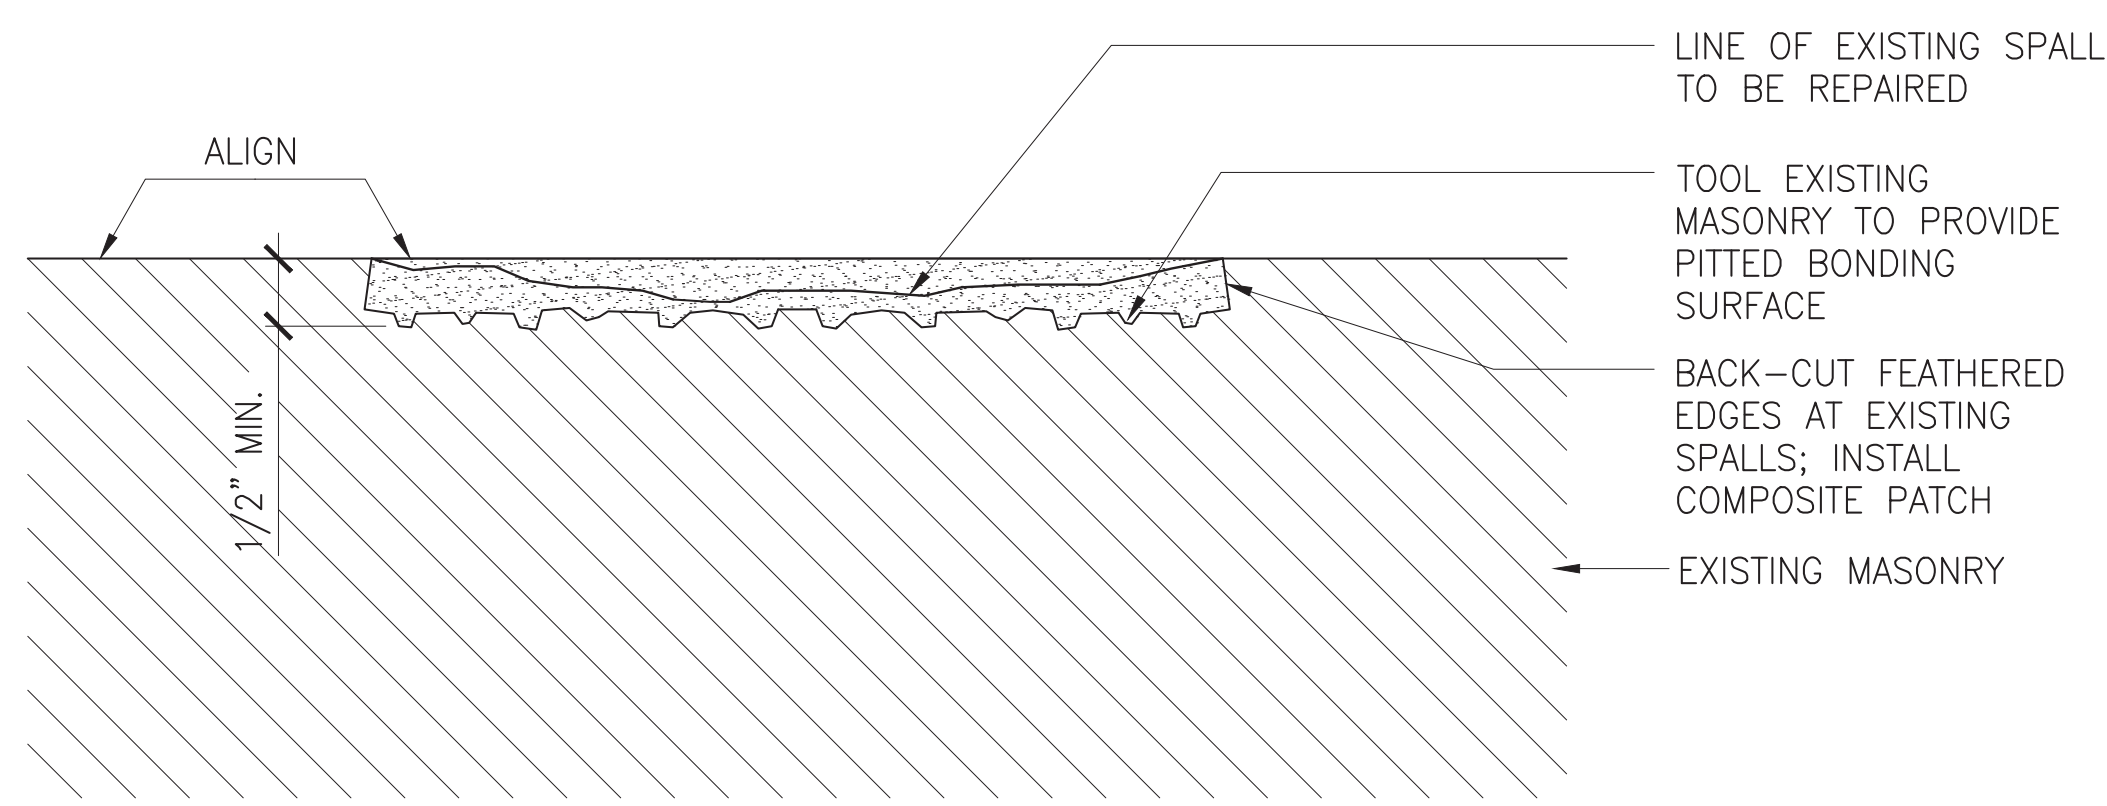


**2 MASONRY SPALL REPAIR**  
SCALE: 6" = 1'-0"

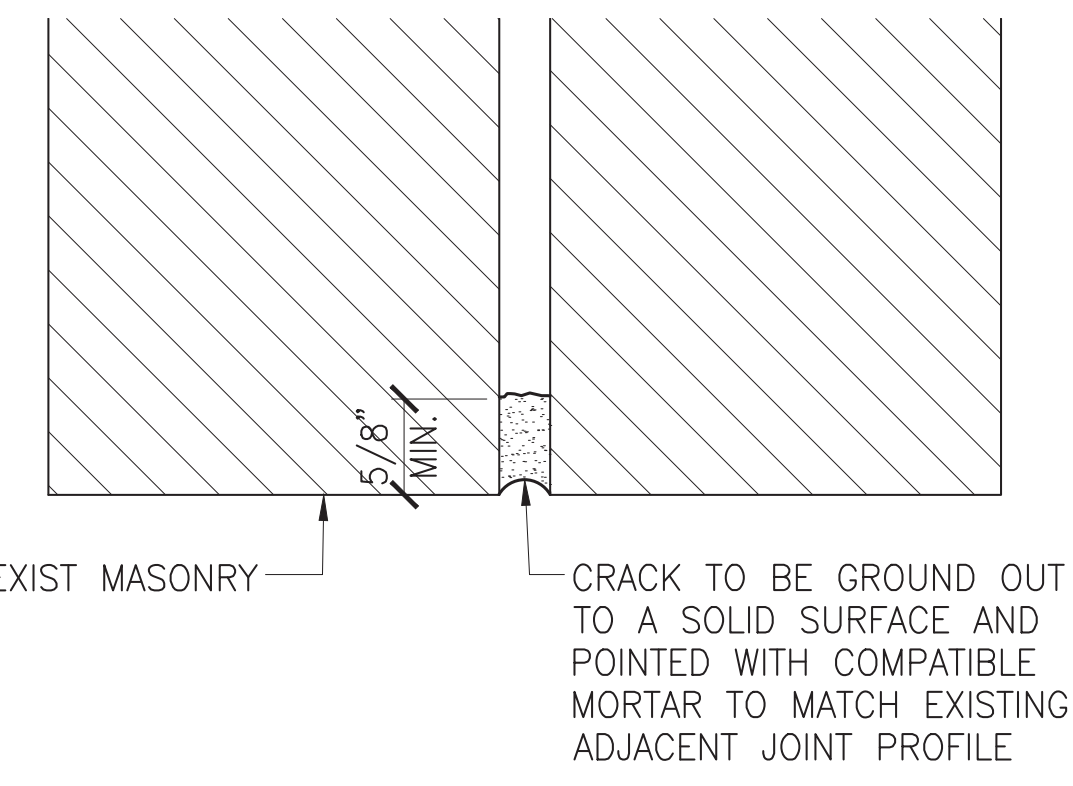


**4 MORTAR JOINT REPAIR**  
SCALE: 6" = 1'-0"

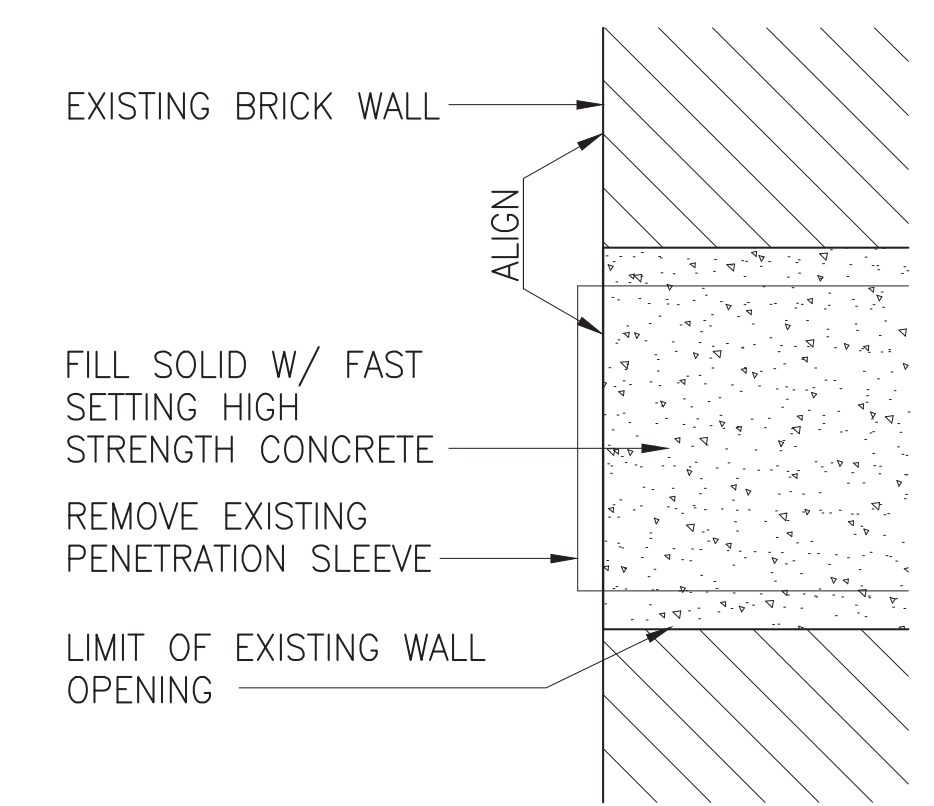

**5 ABANDONED PENETRATION REPAIR**  
SCALE: 6" = 1'-0"

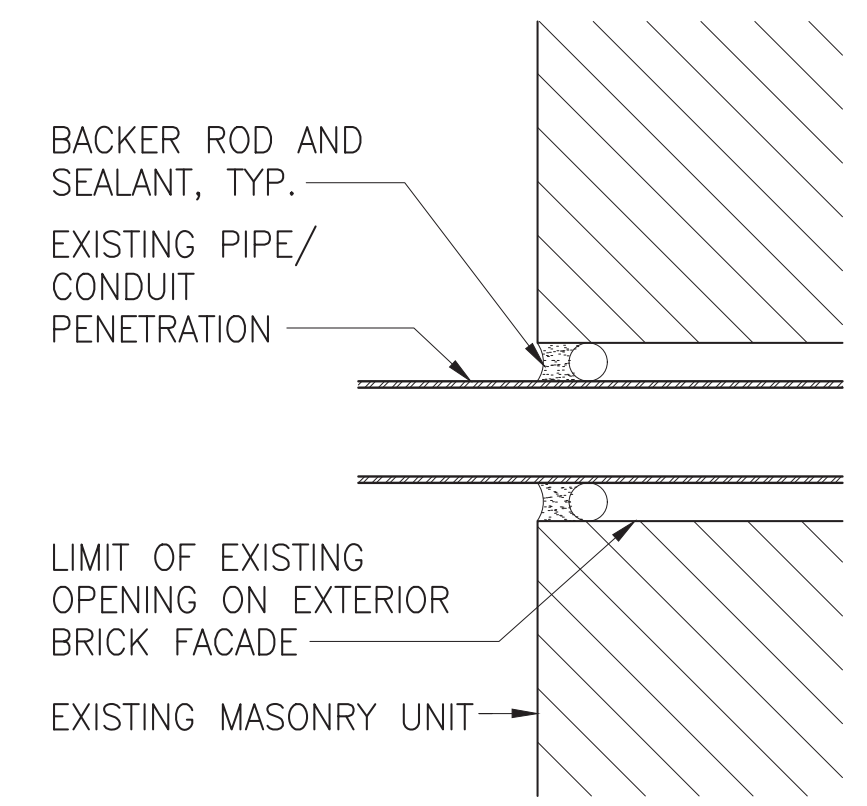

**6 PENETRATION REPAIR**  
SCALE: 6" = 1'-0"

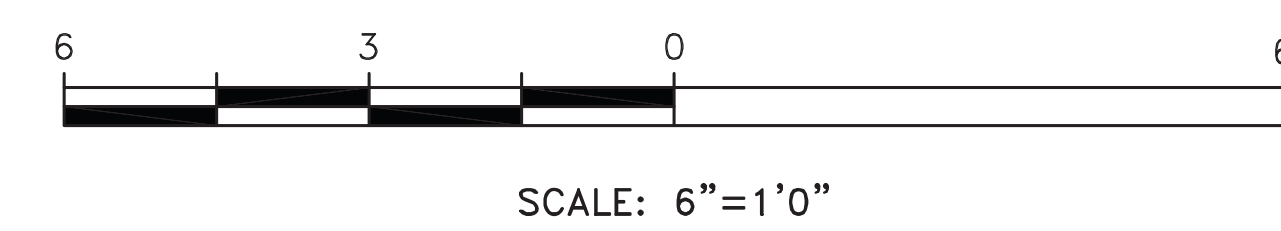

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\689\0517AN-A411.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

GENERAL:

- 1. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH ALL DRAWINGS AND SPECIFICATIONS CONTAINED HEREIN.
2. ALL WORK RELATED TO THE STAGING, CONSTRUCTION PRACTICES AND SAFETY OF THE PROJECT'S WORKERS AND PROPERTY SHALL BE CONSIDERED MEANS AND METHODS AND SHALL BE COMPLETED BY THE CONTRACTOR IN ACCORDANCE WITH STANDARD INDUSTRY PRACTICE AND ALL CODES AND STANDARDS.
3. ALL DRAWINGS HAVE BEEN PREPARED IN ACCORDANCE WITH THE 2009 INTERNATIONAL BUILDING CODE AS WELL AS ALL REFERENCED STANDARDS CONTAINED THEREIN.
4. EVALUATION AND COMPLIANCE WITH LOADING RESTRICTIONS FOR MEANS AND METHODS OF CONSTRUCTION AS WELL AS STAGING FOR OTHER TRADES ARE THE RESPONSIBILITY OF THE CONTRACTOR.
5. ALL WORK SHALL BE INSPECTED IN ACCORDANCE WITH CHAPTER 17 OF THE REFERENCED BUILDING CODE. SUBMIT ALL REPORTS TO THE SEPTA PROJECT MANAGER FOR REVIEW. AT THE COMPLETION OF THE PROJECT, THE SPECIAL INSPECTION REPORT SHALL BE COMPLETED, SIGNED BY THE SPECIAL INSPECTOR AND SUBMITTED TO THE SEPTA PROJECT MANAGER FOR RECORD PURPOSES.
6. SCALING OF DRAWINGS TO DETERMINE DIMENSIONS OF ELEMENTS IS NOT PERMITTED.
7. ALL HORIZONTAL AND VERTICAL DIMENSIONS CONTAINED ON THE STRUCTURAL DRAWINGS WERE DEVELOPED USING EXISTING SURVEY INFORMATION FOR THE PURPOSE OF THIS PROJECT. ANY DIMENSIONS NOT SHOWN ON THE STRUCTURAL DRAWINGS SHOULD BE COORDINATED WITH THE OTHER DISCIPLINE DRAWINGS.
8. THE STRUCTURAL DOCUMENTS ARE TO BE USED IN COORDINATION WITH THE ELECTRICAL AND CIVIL, DRAWINGS AND SPECIFICATIONS AS WELL AS THOSE OF ALL OTHER DISCIPLINES. ANY DISCREPANCIES SHOULD BE BROUGHT TO THE ATTENTION OF THE SEPTA PROJECT MANAGER PRIOR TO THE COMMENCEMENT OF WORK.
9. DESIGN LOADS FOR THE PROJECT ARE LISTED IN THE LOAD SCHEDULE BELOW:
a. SNOW LOAD 25 PSF
b. DEAD LOAD VARIES, SEE INDIVIDUAL DRAWINGS
c. WIND LOAD PER IBC CODE

EXISTING CONSTRUCTION:

- 1. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN, COORDINATION AND INSTALLATION OF SHORING AND STABILIZATION OF EXISTING CONSTRUCTION AS REQUIRED TO PERFORM THE WORK CONTAINED IN THE DRAWINGS AND SPECIFICATIONS.
2. DIMENSIONS SHOWN REFERRING TO EXISTING STRUCTURES ARE FOR REFERENCE ONLY. ALL DIMENSIONS RELATED TO EXISTING FRAMING SHOULD BE VERIFIED BY THE CONTRACTOR PRIOR TO THE COMMENCEMENT OF WORK.
3. THE CONTRACTOR SHALL NOTIFY THE SEPTA PROJECT MANAGER OF ANY INFORMATION RELATING TO EXISTING STRUCTURES THAT HAS BEEN UNCOVERED DUE TO DEMOLITION.

FOUNDATIONS:

- 1. EXCAVATE THE FOUNDATION AREAS TO THE DEPTH AND EXTENT INDICATED ON THE FOUNDATION DRAWINGS. ALL FOOTING AND SLAB SUBGRADES SHALL BE APPROVED IN WRITING BY THE SEPTA PROJECT MANAGER PRIOR TO BACKFILLING. SUBMIT ALL REPORTS TO THE SEPTA PROJECT MANAGER FOR RECORD.
2. BOTTOM OF FOUNDATIONS SHALL BEAR ON SOIL CAPABLE OF SAFELY SUPPORTING 3000 PSF.
3. BOTTOM OF FOOTINGS SHALL BEAR ON:
a. UNDISTURBED VIRGIN SOIL.
b. CONTROLLED COMPACTED FILL.
c. DENSIFIED NATURAL SOIL.
d. ROCK.
e. OTHER.
CAPABLE OF SAFELY SUPPORTING 3000 PSF.
4. BOTTOM OF FOOTING SUBGRADE MUST BE INSPECTED AND APPROVED BY A REGISTERED GEOTECHNICAL ENGINEER BEFORE PLACING ANY CONCRETE FOUNDATIONS. APPROVAL IN WRITING MUST INDICATE THE SOIL IS ADEQUATE TO SAFELY SUSTAIN THE SPECIFIED BEARING PRESSURE. SUBMIT ALL REPORTS TO THE SEPTA PROJECT MANAGER FOR RECORD.
5. BOTTOM OF ALL FOOTINGS SUBJECT TO FREEZE THAW CONDITIONS SHALL BE A MINIMUM 3 FEET BELOW FINISH GRADE OR TOP OF SLAB ELEVATION WHICHEVER IS LOWER.
6. RETAINING WALLS SHALL BE BACKFILLED AND COMPACTED WITH MATERIAL PRODUCING A MAXIMUM ACTIVE EQUIVALENT FLUID LATERAL EARTH PRESSURE OF 45 PSF.
7. WALLS RETAINING EARTH SHALL NOT BE BACKFILLED UNTIL A MINIMUM OF 70 PERCENT OF SPECIFIED COMPRESSIVE STRENGTH IS ACHIEVED. BASEMENT WALLS SHALL NOT BE BACKFILLED, UNLESS ADEQUATELY BRACED, UNTIL FLOOR SLAB IS IN PLACE AND ATTAINS A MINIMUM OF 70 PERCENT OF SPECIFIED COMPRESSIVE STRENGTH.
8. SITE RETAINING WALLS AND EXPOSED CONCRETE WALLS SHALL HAVE CONTROL JOINTS A MAXIMUM OF 20 FEET ON CENTER UNLESS OTHERWISE NOTED ON THE DRAWINGS. MASONRY OR CONCRETE WALLS WITH INTEGRAL COLUMN PIERS OR PILASTERS SHALL HAVE A FORMED CONTROL JOINT ON ONE SIDE OF EACH PIER ON THE EXPOSED FACE OF THE WALL. JOINTS SHALL BE FILLED WITH SEALANT AS NOTED ON THE ARCHITECTURAL DRAWINGS.
9. UNDERPINNING, SHEETING AND SHORING NOTED ON THE DRAWINGS SHALL BE DESIGNED AND DETAILED BY A REGISTERED PROFESSIONAL ENGINEER WITH A MINIMUM OF 3 YEARS EXPERIENCE IN THE DESIGN OF FOUNDATION SHORING. SUBMIT SIGNED AND SEALED DRAWINGS, CALCULATIONS, AND A STAGING PLAN TO THE SEPTA PROJECT MANAGER FOR REVIEW AND RECORD.

CONCRETE:

- 1. ALL CONCRETE SHALL BE READY-MIX AND HAVE THE FOLLOWING CHARACTERISTICS:
a. SLABS ON GRADE:
1). A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS.
2). A MINIMUM OF 520 LBS. OF CEMENT PER CUBIC YARD.
3). SLUMP (AT POINT OF CONCRETE PLACEMENT) SHALL BE 3 INCH MINIMUM AND 5 INCH MAXIMUM.
b. FOOTINGS AND FOUNDATION WALLS:
1). A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS.
2). A MINIMUM OF 520 LBS. OF CEMENT PER CUBIC YARD.
3). SLUMP (AT POINT OF CONCRETE PLACEMENT) SHALL BE 3 INCH MINIMUM AND 5 INCH MAXIMUM.
2. ALL CONCRETE EXPOSED TO EXTERIOR CONDITIONS SHALL HAVE CHARACTERISTICS IN ACCORDANCE WITH ACI BUILDING CODE (ACI 318) AND THE 2012 INTERNATIONAL BUILDING CODE:
a. MAXIMUM WATER-CEMENTITIOUS MATERIAL RATIO SHALL BE 0.45.
b. MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS.
3. ALL CONCRETE WORK SHALL COMPLY WITH THE REQUIREMENTS OF THE LATEST EDITIONS OF THE FOLLOWING CODES AND STANDARDS:
a. ACI BUILDING CODE (ACI 318).
b. THE ACI DETAILING MANUAL (SP.66).

- 4. ALL REINFORCING STEEL SHALL BE GALVANIZED AND SHALL BE MANUFACTURED FROM HIGH STRENGTH BILLET STEEL CONFORMING TO ASTM DESIGNATION A615 GRADE 60. LAP ALL BARS MINIMUM 48 BAR DIAMETERS UNLESS OTHERWISE NOTED OTHERWISE.
5. ALL WWF SHALL BE EPOXY GALVANIZED AND SHALL BE MANUFACTURED FROM HIGH STRENGTH STEEL CONFORMING TO ASTM A185. LAP ALL WWF A MINIMUM OF 6 INCHES.
6. PLACE TRANSVERSE REINFORCING (SWB) IN BOTTOM LAYER OF CONTINUOUS FOOTINGS. PROVIDE CORNER BARS IN FOOTINGS TO MATCH CONTINUOUS REINFORCEMENT. EXTEND WALL FOOTING REINFORCING INTO COLUMN FOOTINGS A MINIMUM OF 2 FEET.
7. PROVIDE KEYS IN CONCRETE WALLS, PIERS, GRADE BEAMS AND FOOTINGS AT INTERSECTIONS UNLESS NOTED OTHERWISE. PROVIDE CORNER BARS TO MATCH HORIZONTAL REINFORCEMENT AT WALL CORNERS AND TEE INTERSECTIONS.
8. CONCRETE SHALL ACHIEVE A MINIMUM OF 70 PERCENT OF THE DESIGN STRENGTH PRIOR TO STEEL ERECTION. WRITTEN CONFIRMATION OF THIS STRENGTH SHOULD BE SUBMITTED TO THE SEPTA PROJECT MANAGER PRIOR TO THE COMMENCEMENT OF STEEL ERECTION.
9. CONCRETE COVER OVER REINFORCING STEEL SHALL BE IN ACCORDANCE WITH ACI 318.

STEEL:

- 1. ALL STRUCTURAL STEEL SHALL BE FABRICATED AND ERECTED IN ACCORDANCE WITH THE LATEST AISC CODE. ALL STRUCTURAL STEEL WIDE FLANGE (W) SHAPES SHALL BE ASTM A992 GRADE 50 (V50). ALL STRUCTURAL STEEL S, M, AND HP SHAPES SHALL BE ASTM A572 GRADE 50 (V50). ALL OTHER STRUCTURAL STEEL SHALL BE ASTM A36 UNLESS OTHERWISE NOTED.
2. ALL STEEL SHALL BE THOROUGHLY CLEANED IN ACCORDANCE WITH SSPC. SP3 AND BE TREATED AS FOLLOWS:
a. HAVE A SHOP COAT OF RUST INHIBITIVE PAINT.
3. ORIENT ALL MILL CAMBER UPWARD DURING FABRICATION AND ERECTION.
4. ALL SHOP AND FIELD WELDING SHALL BE PERFORMED BY WELDERS CERTIFIED, AS DESCRIBED IN THE LATEST EDITION OF THE AMERICAN WELDING SOCIETY'S STANDARD QUALIFICATION PROCEDURE, AWS D1.1, TO PERFORM THE TYPE OF WORK REQUIRED.
5. ALL BOLTS USED FOR THE ANCHORAGE TO CONCRETE AS SPECIFIED ON THE DRAWINGS SHALL CONFORM TO ASTM F1554.
6. ALL STEEL CONNECTIONS SHALL BE BOLTED WITH A MINIMUM OF 3/4" A325N HIGH STRENGTH BOLTS OR WELDED AS DESIGNED BY THE STEEL FABRICATOR.
7. ALL TENSION CONTROLLED BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM F1852 AND ASTM F2280.
8. ALL BRACE CONNECTIONS SHALL BE BOLTED WITH A MINIMUM OF 3/4" DIAMETER A490.SC HIGH STRENGTH BOLTS OR WELDED.
9. ALL ALUMINUM AND STEEL MEMBERS SHALL BE TREATED OR PROPERLY SEPARATED TO PREVENT GALVANIC AND CORROSIVE EFFECTS.
10. ALL STEEL WELDING RODS SHALL BE AS FOLLOWS:
a. E70XX FOR STEEL CONNECTIONS.
b. E80XX FOR BRACE CONNECTIONS.
c. E60XX FOR STEEL TO METAL STUD CONNECTIONS.
11. SUBMIT ALL STEEL SHOP DRAWINGS FOR REVIEW PRIOR TO ANY FABRICATION. SUBMIT CALCULATIONS FOR ALL BRACE CONNECTIONS TO COLUMNS (CALCULATIONS NEED NOT BE SIGNED AND SEALED).
12. STEEL FABRICATOR IS SOLELY RESPONSIBLE FOR COORDINATING WITH THE CONTRACTOR FOR THE PURPOSE OF SURVEYING AND VERIFICATION OF EXISTING CONDITIONS INCLUDING BUT NOT LIMITED TO THE LOCATION, ELEVATION, AND DIMENSIONS OF WALLS AND FRAMING THAT EXIST AT THE TIME OF THE STEEL ERECTION.
13. ALL LINTELS AND SHELF ANGLES SHALL BE PAINTED AND GALVANIZED. ANY POINTS OF WELDING SHALL BE TOUCHED UP IN THE FIELD WITH A ZINC-RICH PAINT BY THE STEEL ERECTOR.
14. ALL EXPOSED STEEL (GANTRY COLUMNS AND WALKWAYS, ETC.) SHALL BE HOT DIP GALVANIZED. ANY POINTS OF WELDING SHALL BE TOUCHED UP IN THE FIELD WITH A ZINC-RICH PAINT BY THE STEEL ERECTOR.

MASONRY:

- 1. MASONRY UNITS SHALL BE:
a. NORMAL WEIGHT MASONRY UNITS.
b. ASTM C90 SOLID OR ASTM C90 HOLLOW GROUTED SOLID BELOW GRADE.
c. ASTM C90 HOLLOW ABOVE GRADE.
d. WITH MINIMUM COMPRESSIVE STRENGTH OF 1900 PSI (AVERAGE OF 3 UNITS).
e. ALL CMU SHALL BE LAID IN A FULL BED OF MORTAR.
f. CONSTRUCT COLUMN PIERS INTEGRALLY WITH FOUNDATION AND ABOVE GRADE WALLS AND CONTINUE HORIZONTAL WALL REINFORCEMENT THROUGH THE PIER.
g. GROUT COLUMN PIERS AND WALLS MONOLITHICALLY.
2. FOLLOWING ARE THE BLOCK STRENGTHS REQUIRED:
a. ASTM C90 SOLID 2000 PSI ON GROSS AREA OF INDIVIDUAL UNITS.
b. ASTM C90 SOLID 1500 PSI ON NET AREA OF AVERAGE OF 3 UNITS PER ACI.530.
c. ASTM C90 HOLLOW 1700 PSI ON NET AREA OF INDIVIDUAL UNITS.
3. ALL MORTAR SHALL BE ASTM C270 TYPE S WITH A MINIMUM COMPRESSIVE STRENGTH OF 1800 PSI AT 28 DAYS.
4. ALL MORTAR SHALL BE FIELD OBTAINED MORTAR CUBES TESTED IN ACCORDANCE WITH ASTM C270 AND ASTM C780.
5. GROUT SHALL BE A HIGH SLUMP MIX:
a. IN ACCORDANCE WITH ASTM C476.
b. HAVING A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI.
c. FROM FIELD OBTAINED TEST PRISMS.
6. ALL CONCRETE MASONRY SHALL BE CONSTRUCTED IN ACCORDANCE WITH THE LATEST EDITION OF THE BUILDING CODE REQUIREMENTS FOR MASONRY STRUCTURES ACI 530/ASCE 5/TMS 402 AND THE SPECIFICATION FOR MASONRY STRUCTURES ACI 530.1/ASCE 6/TMS 602.
7. PROVIDE HOT-DIPPED GALVANIZED TRUSS TYPE HORIZONTAL JOINT REINFORCEMENT, MIN. 9 GA. AT 16" ON CENTER VERTICAL IN ALL MASONRY WALLS. SPACE HORIZONTAL JOINT REINFORCEMENT AT 8 INCHES ON CENTER IN ALL PARAPETS. USE SHOP FABRICATED SPECIAL PIECES AT ALL CORNERS AND TEES.

PAINTING:

- 1. ALL STEEL SHALL BE CLEANED, PRIMED AND REPAINTED. NOTE EXISTING PAINT MAY BE LEAD BASED. PROPER CONTAINMENT AND DISPOSAL MUST BE PROVIDED.

Table with 2 columns: MATERIAL THICKNESS OF THINNER PART JOINED (IN.), MINIMUM SIZE OF FILET WELD (IN.). Rows include TO 1/4 INCLUSIVE, OVER 1/4 TO 1/2, OVER 1/2 TO 3/4, OVER 3/4.

ABBREVIATIONS

Table listing abbreviations and their full names, such as ACI AMERICAN CONCRETE INSTITUTE, ASCE AMERICAN SOCIETY OF CIVIL ENGINEERS, ASTM AMERICAN SOCIETY OF TESTING AND MATERIALS, etc.

NOTE:

- 1. WORK SITE IS AN ACTIVE TRACTION POWER SUBSTATION (TPSS). ALL WORK REFERENCED ON THESE DRAWINGS SHALL BE PERFORMED DURING AN OUTAGE AND UNDER THE DIRECTION OF SEPTA.
2. FOR MORE GENERAL NOTES SEE DRAWING G106.



1234 MARKET ST, 13TH FL, PHILADELPHIA, PA 19107

CHIEF ENGINEER - ENGC

CHIEF ENGINEERING OFFICER - BAB

CHIEF RAIL TRANSIT OFFICER

SYSTEM SAFETY

DIRECTOR OF ENGINEERING - BAB

MANAGER - ARCHITECTURE ENGINEERING

PROJECT MANAGER

HDR Engineering, Inc. Philadelphia, PA

MELORA DESIGN Civil, Water Resources, and Structural Engineering 259 MORGAN STREET PHOENIXVILLE, PA 19460 (610) 933-0123

APD CKD BY DESCRIPTION REV DATE

CASTOR ROUTE 69 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION STRUCTURAL GENERAL NOTES & ABBREVIATIONS

SCALE: N/A SCALE FACTOR: - DATE: 10/16/2017 DRAWN BY: JEB CHECKED BY: JAA WORK ORDER NO.: 276496 SHEET NUMBER: S400

DWG. NO.: 1 OF 14 SHT. NO.: 392 OF 452 ARCHIVE NO.: COMPUTER FILE NO.: 17AN-S400 REV. NO.: -

50% SUBMISSION NOT FOR CONSTRUCTION

DATE PRINTED: 10/19/2025

STATUS: 50% SUBMISSION



C:\PIPWOR\KING\PTTD\689125\17AN-S400.DWG

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
EXISTING CONDITIONS & REMOVAL - MAIN FLOOR

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	WBT
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S401</b>		
DWG. NO.:	2	OF	14
SHT. NO.:	393	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-S401	REV. NO.:	-

50% SUBMISSION  
NOT FOR CONSTRUCTION

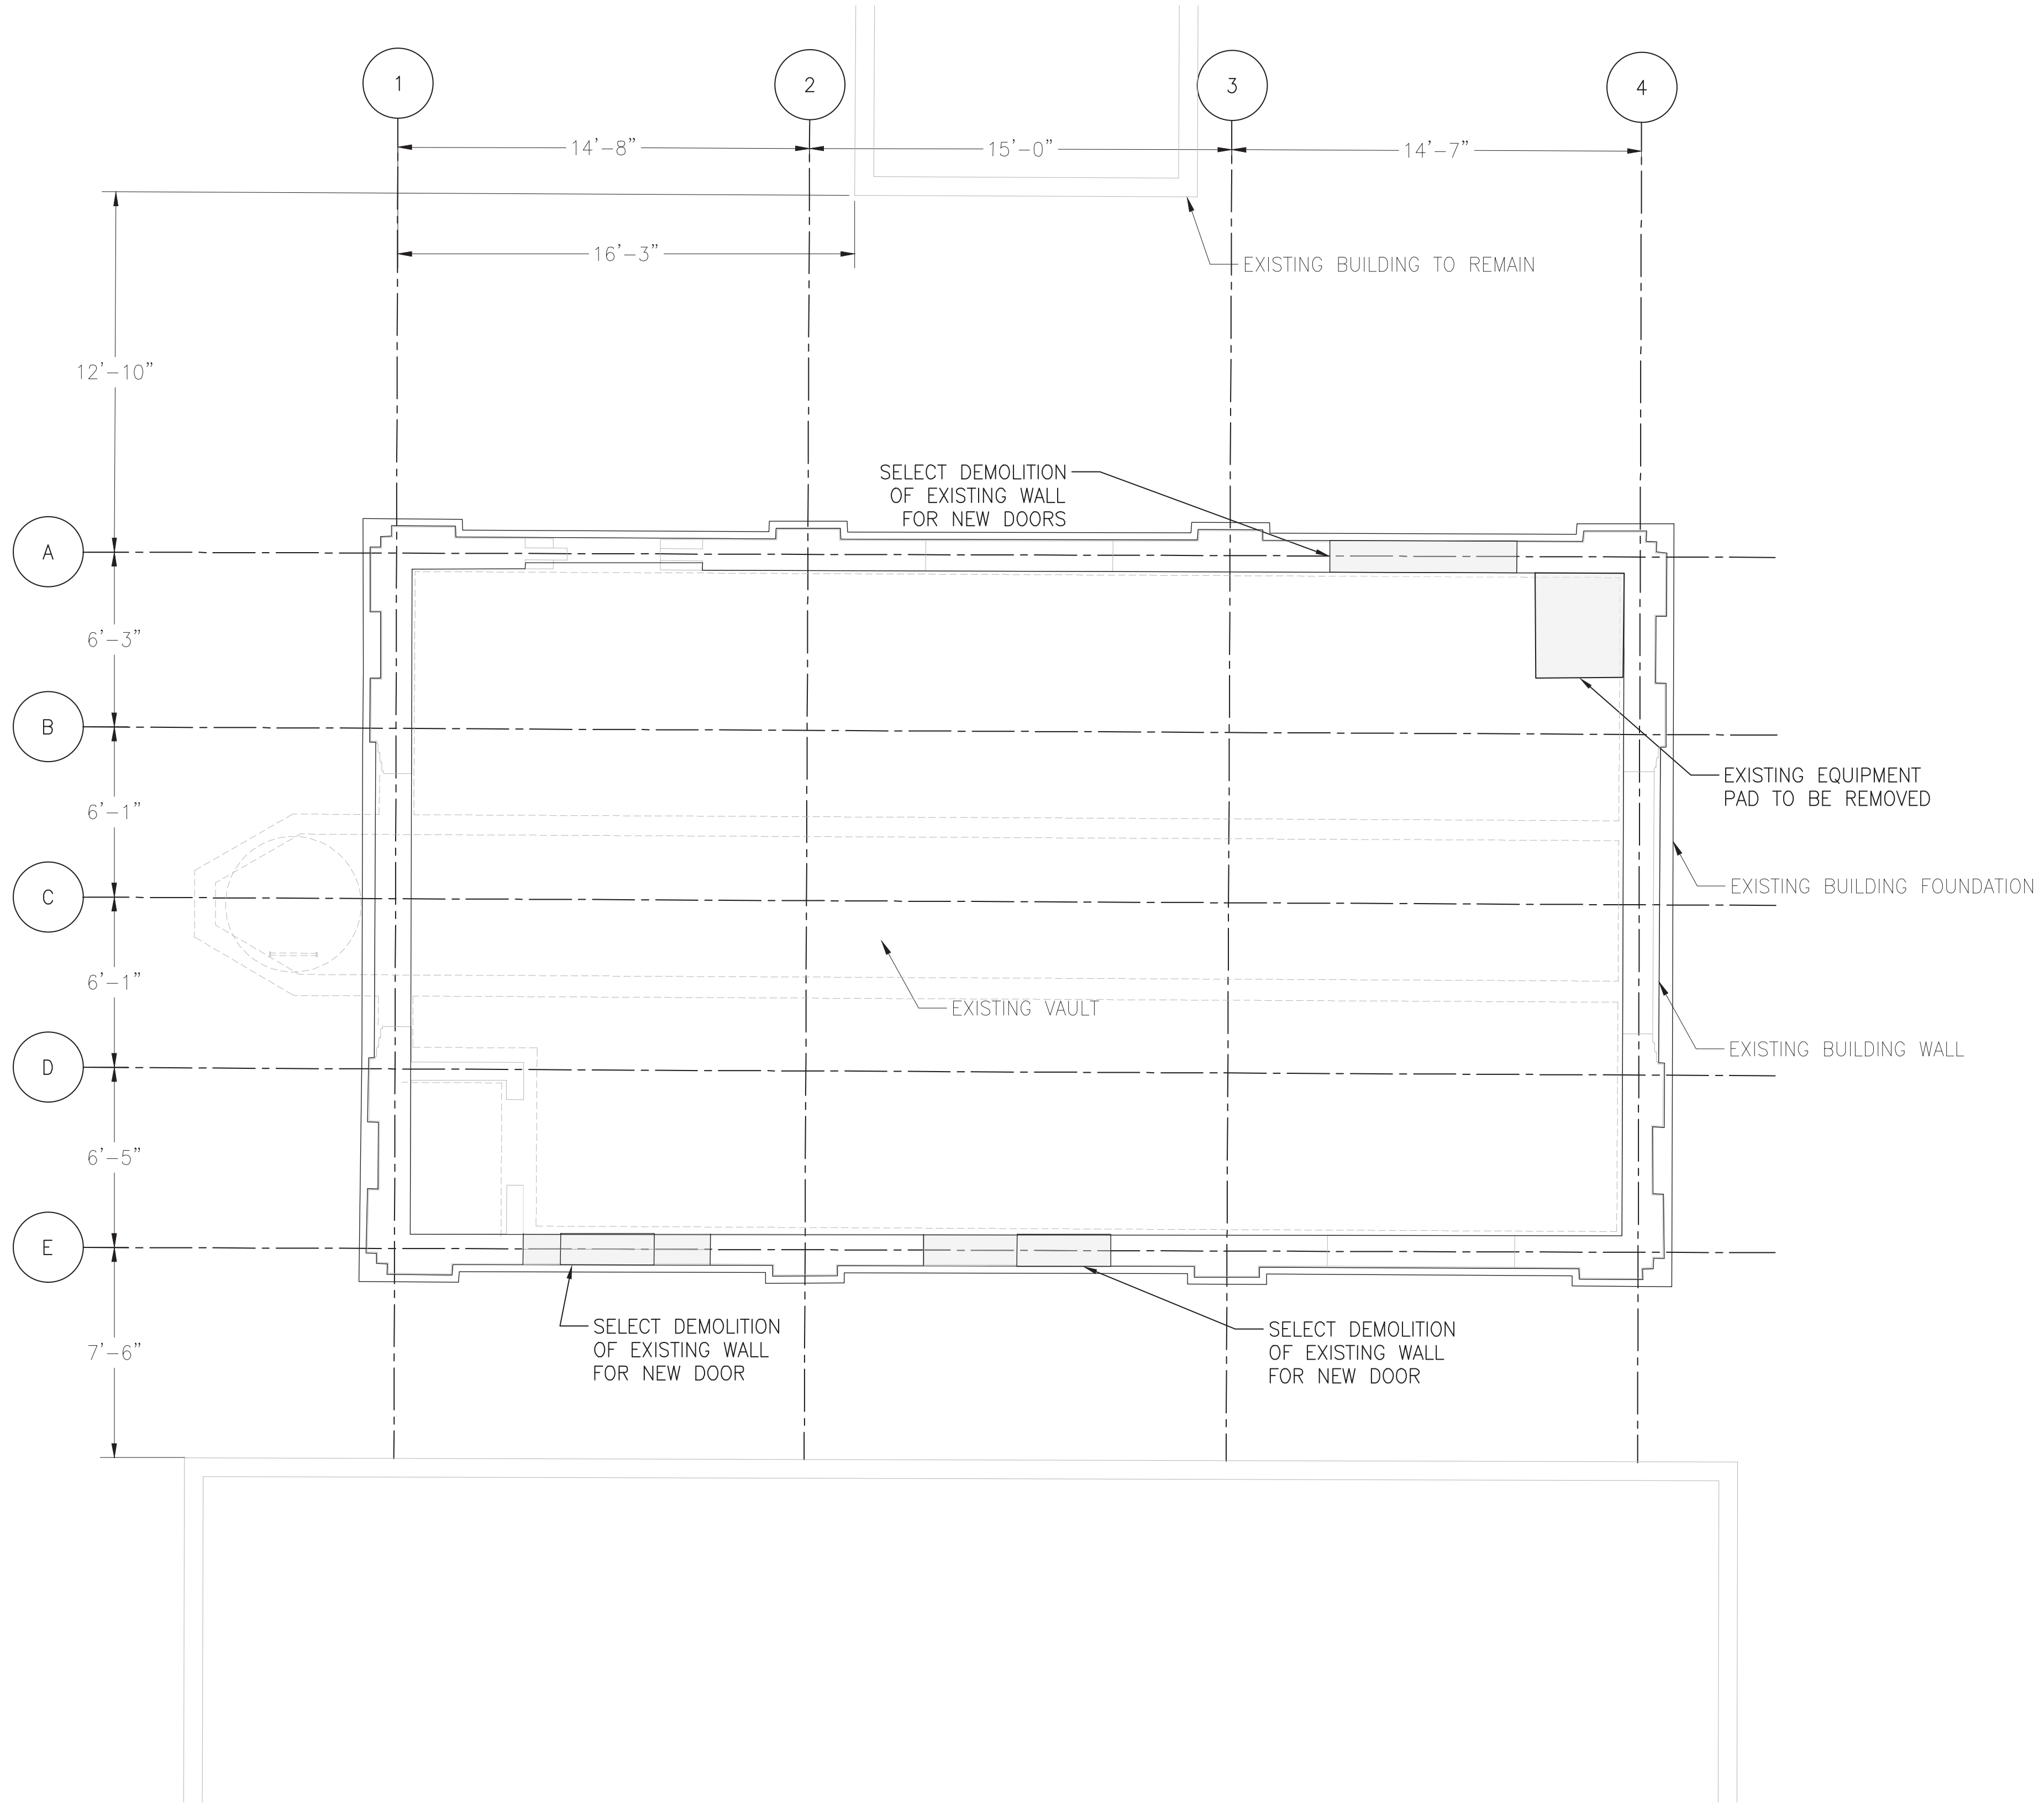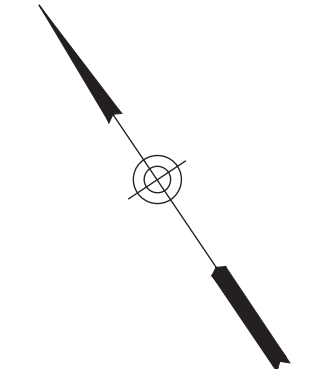

EXISTING CONDITIONS & REMOVAL - MAIN FLOOR  
1/4" = 1'-0"


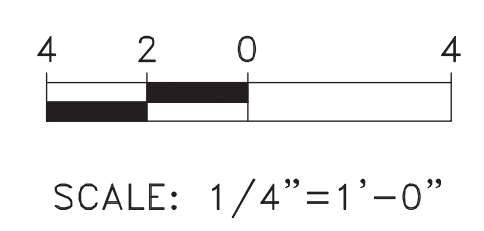


- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.
- WORK ON THIS DRAWING:
- SELECT DEMOLITION OF EXISTING EXTERIOR WALL.
  - FOUNDATION REMOVAL.

C:\P\WORKING\PTTD\688125\17AN-S401.DWG


DATE PRINTED: 10/19/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CK'D	AP'D

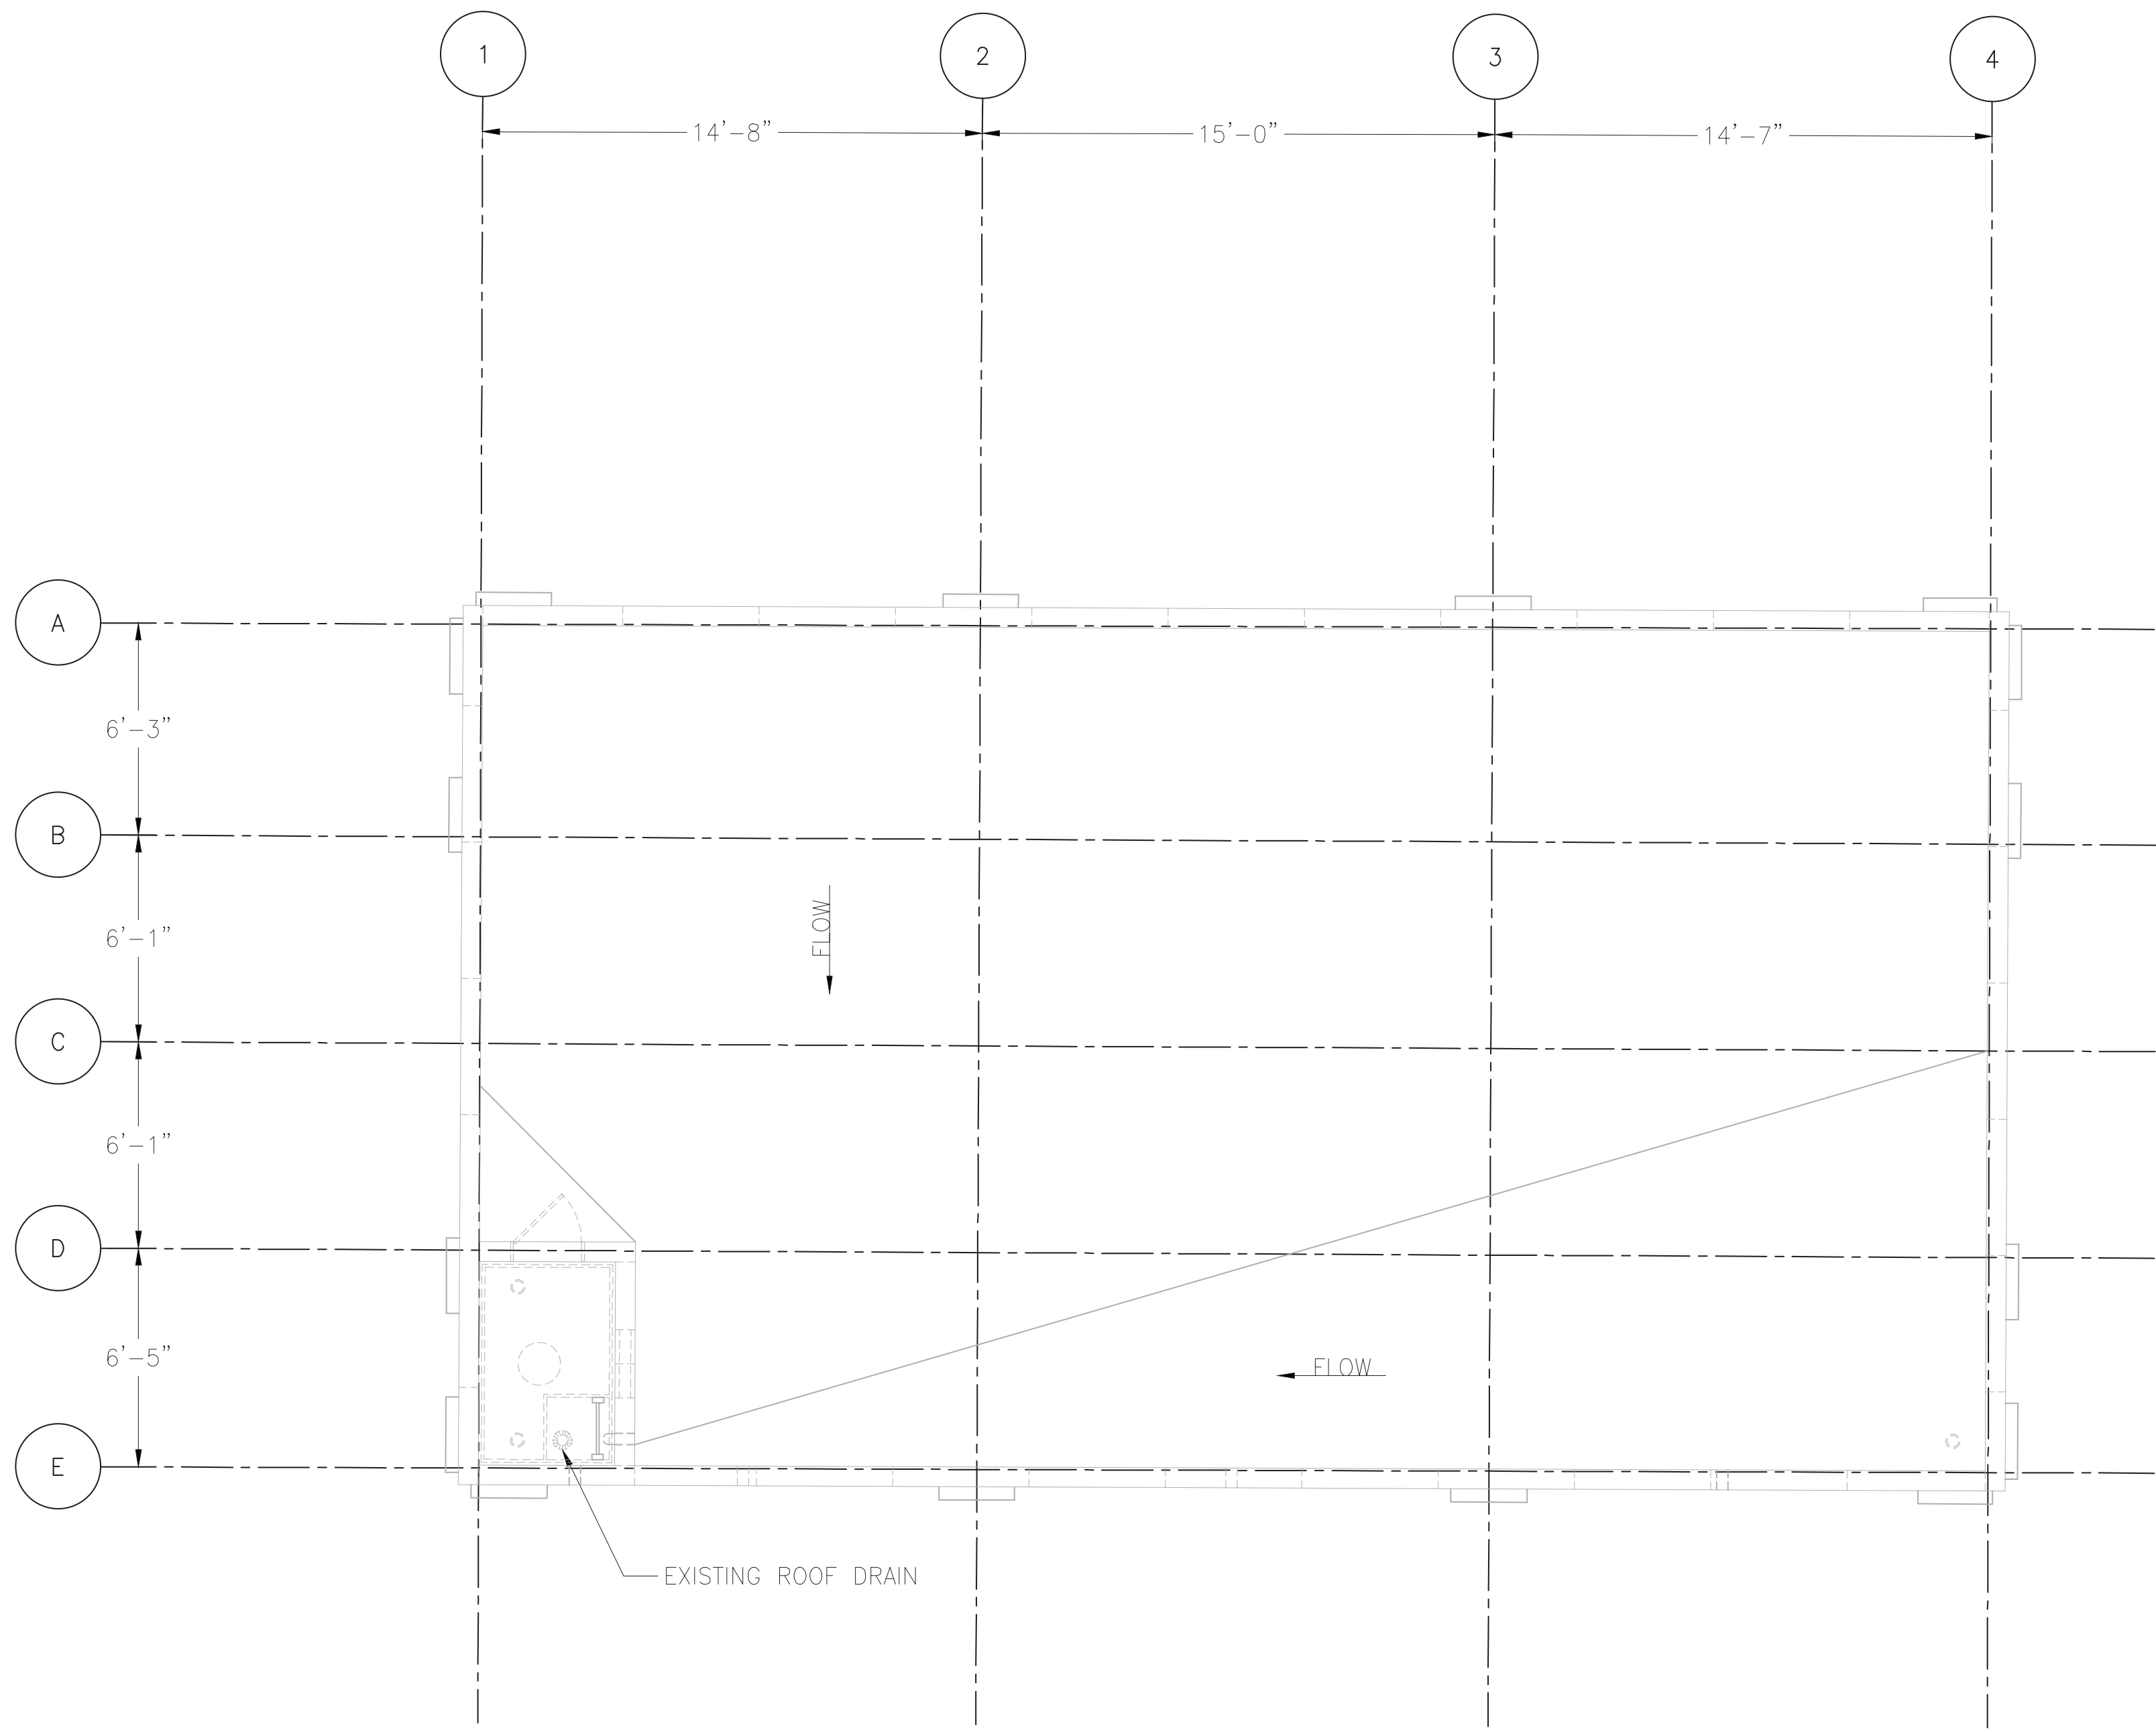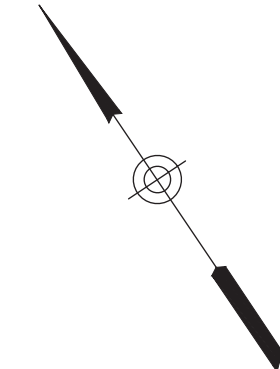

EXISTING CONDITIONS & REMOVAL - ROOF  
1/4" = 1'-0"

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.
- WORK ON THIS DRAWING:
- NONE.

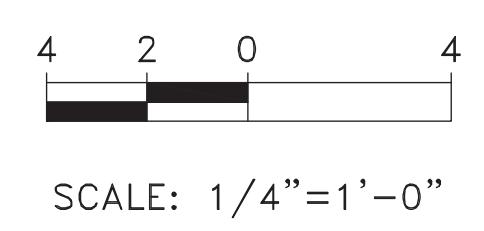

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
EXISTING CONDITIONS & REMOVAL - ROOF

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	WBT
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S402</b>	COMPUTER FILE NO.:	17AN-S402
DWG. NO.:	3	OF	14
SHT. NO.:	394	OF	452
ARCHIVE NO.:		REV. NO.:	-

C:\P\WORKING\PTTD\688125\17AN-S402.DWG



DATE PRINTED: 10/19/2025 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
PROPOSED MAIN FLOOR PLAN


SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: WBT
WORK ORDER NO.: 276496	CHECKED BY: JWA
SHEET NUMBER: <b>S403</b>	
DWG. NO.: 4 of 14	
SHT. NO.: 395 of 452	
ARCHIVE NO.:	
COMPUTER FILE NO.: 17AN-S403	REV. NO.:

50% SUBMISSION  
NOT FOR CONSTRUCTION

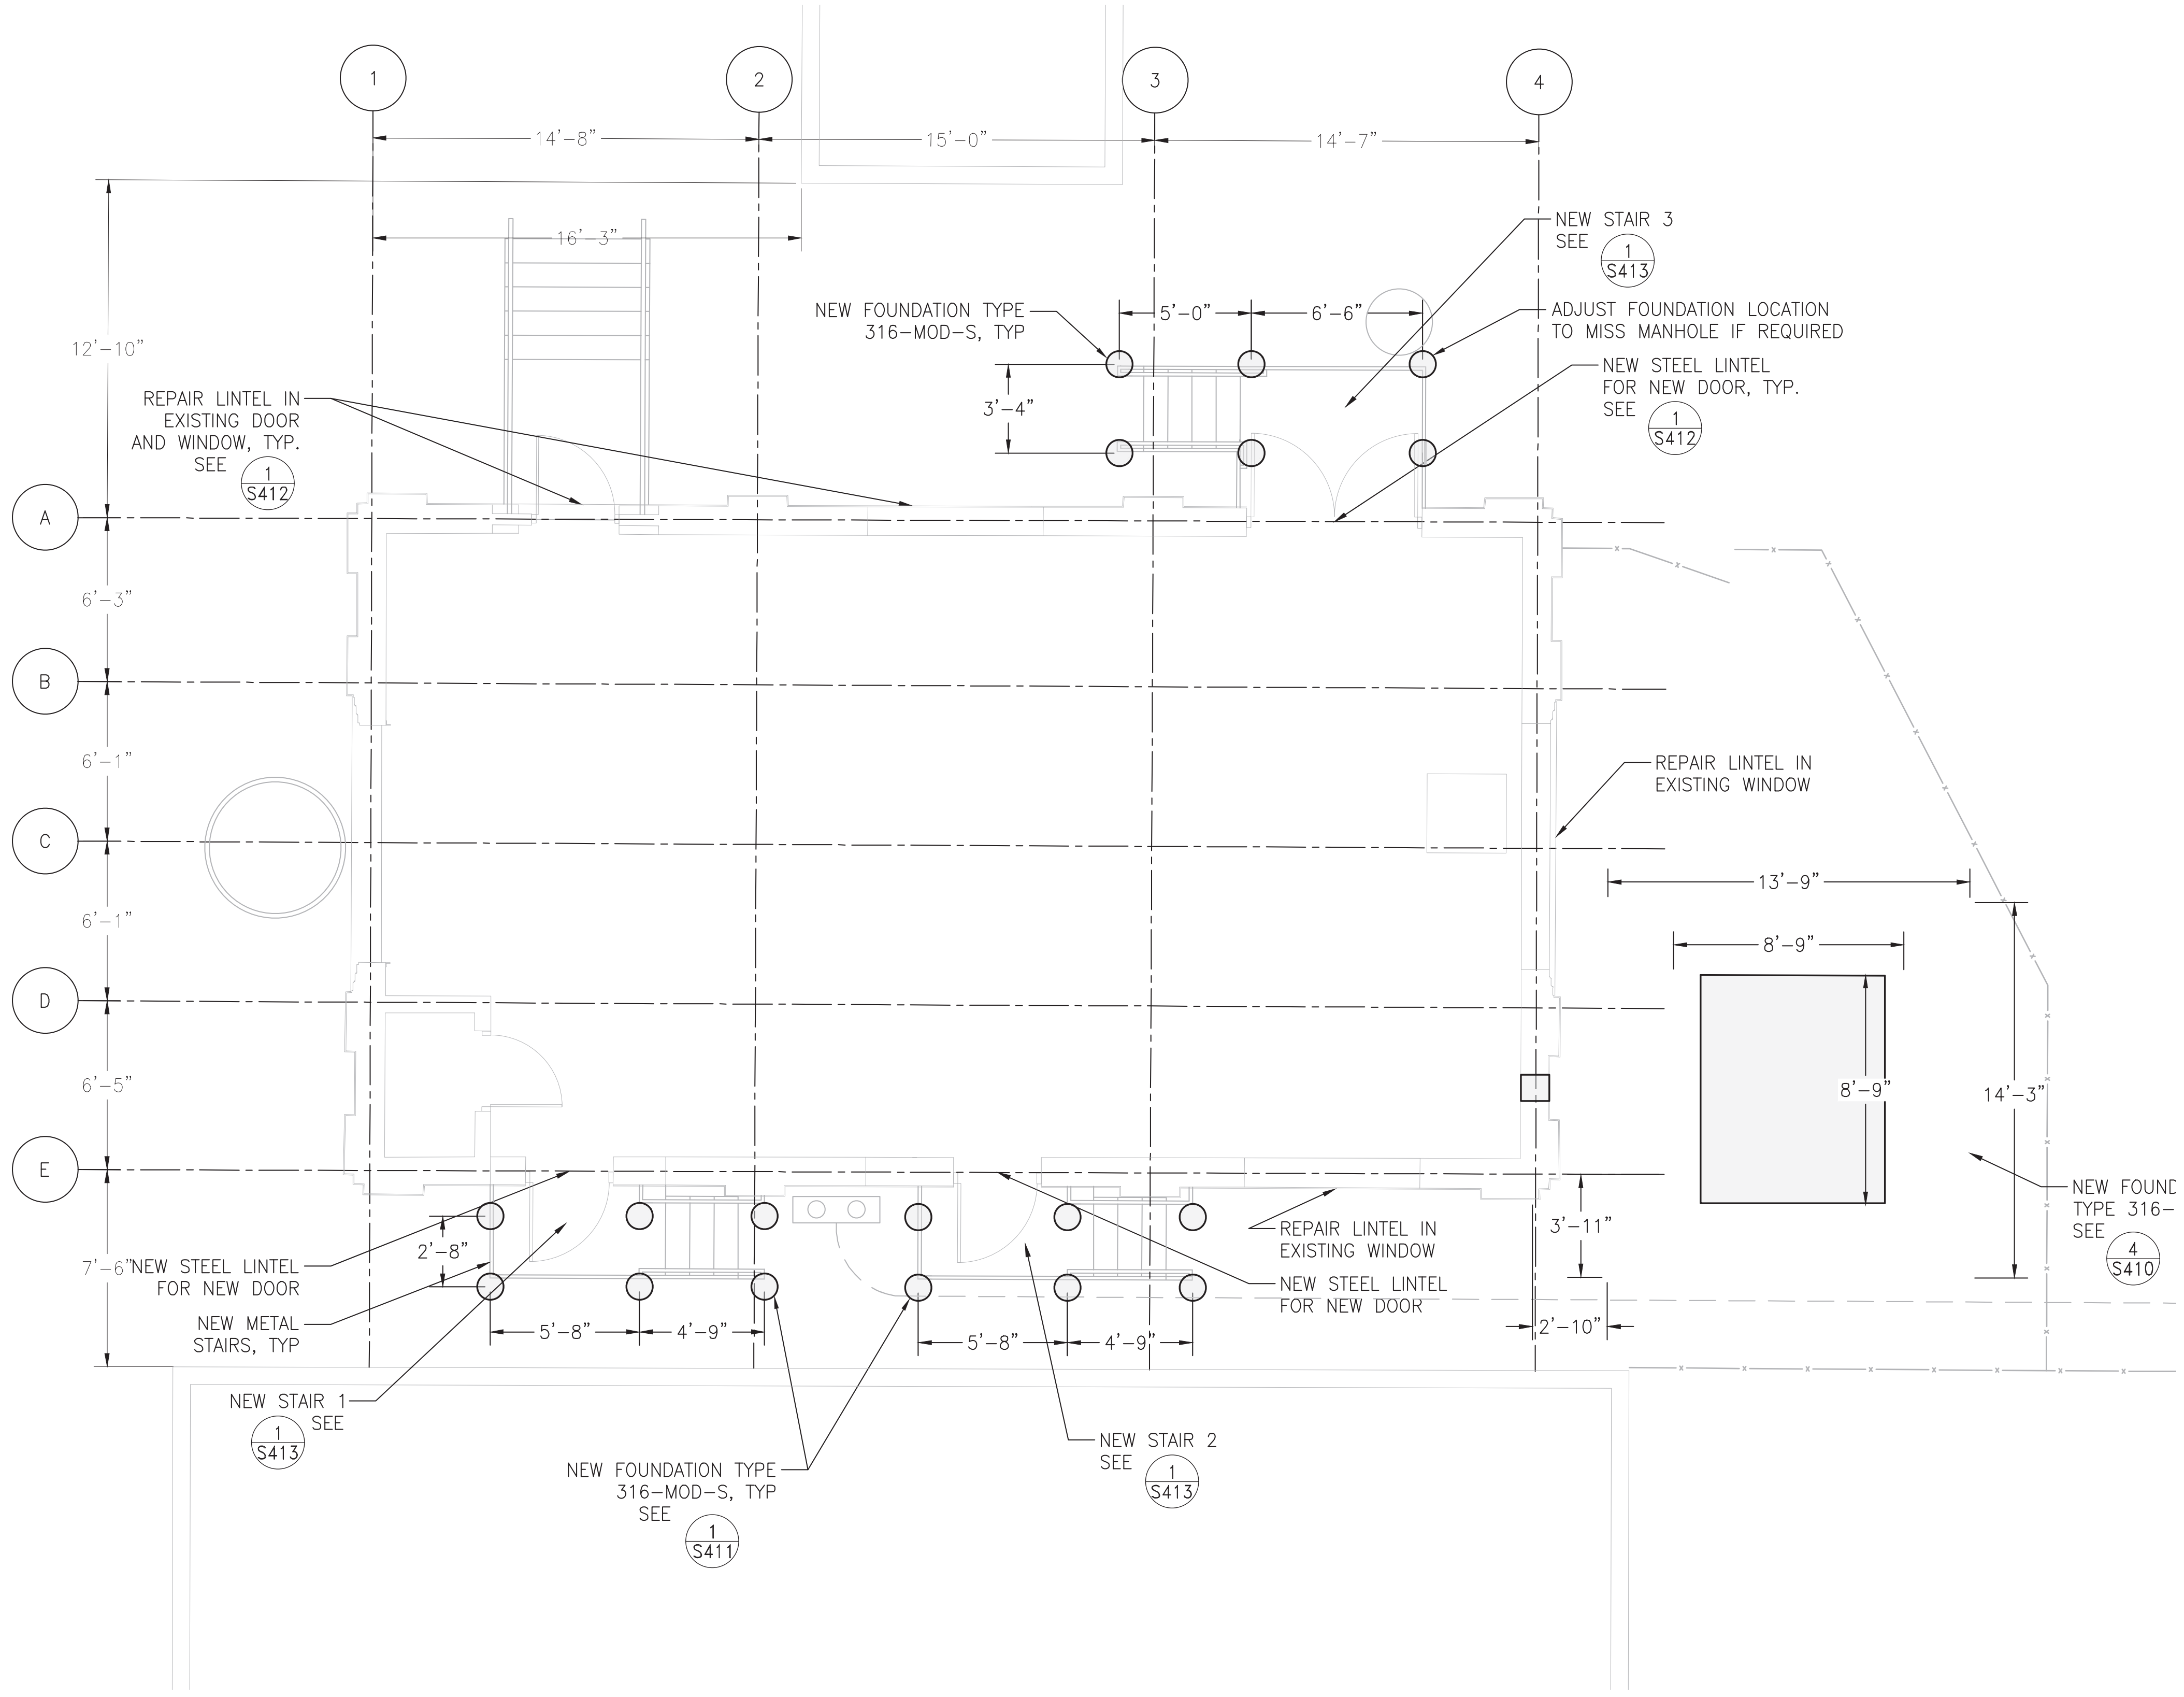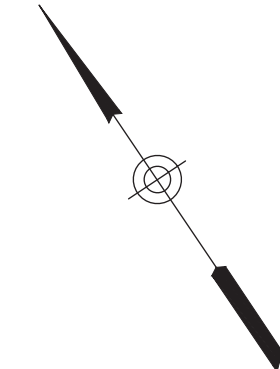

PROPOSED MAIN FLOOR PLAN  
1/4" = 1'-0"

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.
  - THE LOWEST ENERGIZED PART OF THE RECTIFIER TRANSFORMER SHALL BE 9 FEET ABOVE FINISHED GRADE.
- WORK ON THIS DRAWING:
- NEW PIER FOUNDATIONS FOR NEW STAIRS.
  - NEW STEEL STAIRS.
  - NEW LINTELS AT PROPOSED DOORWAYS.
  - LINTEL REPAIRS AT EXISTING DOOR AND WINDOWS.
  - NEW FOUNDATION FOR NEW RECTIFIER TRANSFORMER.

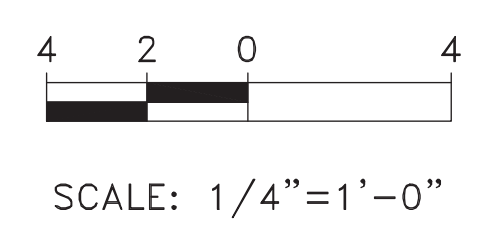



C:\PI\WORKING\PTTD\689125\17AN-S403.DWG

DATE PRINTED: 10/19/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CK'D	AP'D


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
REHABILITATION  
**STRUCTURAL**  
PROPOSED ROOF PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	WBT
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S404</b>	COMPUTER FILE NO.:	17AN-S404
DWG. NO.:	5	OF	14
SHT. NO.:	396	OF	452
ARCHIVE NO.:		REV. NO.:	-

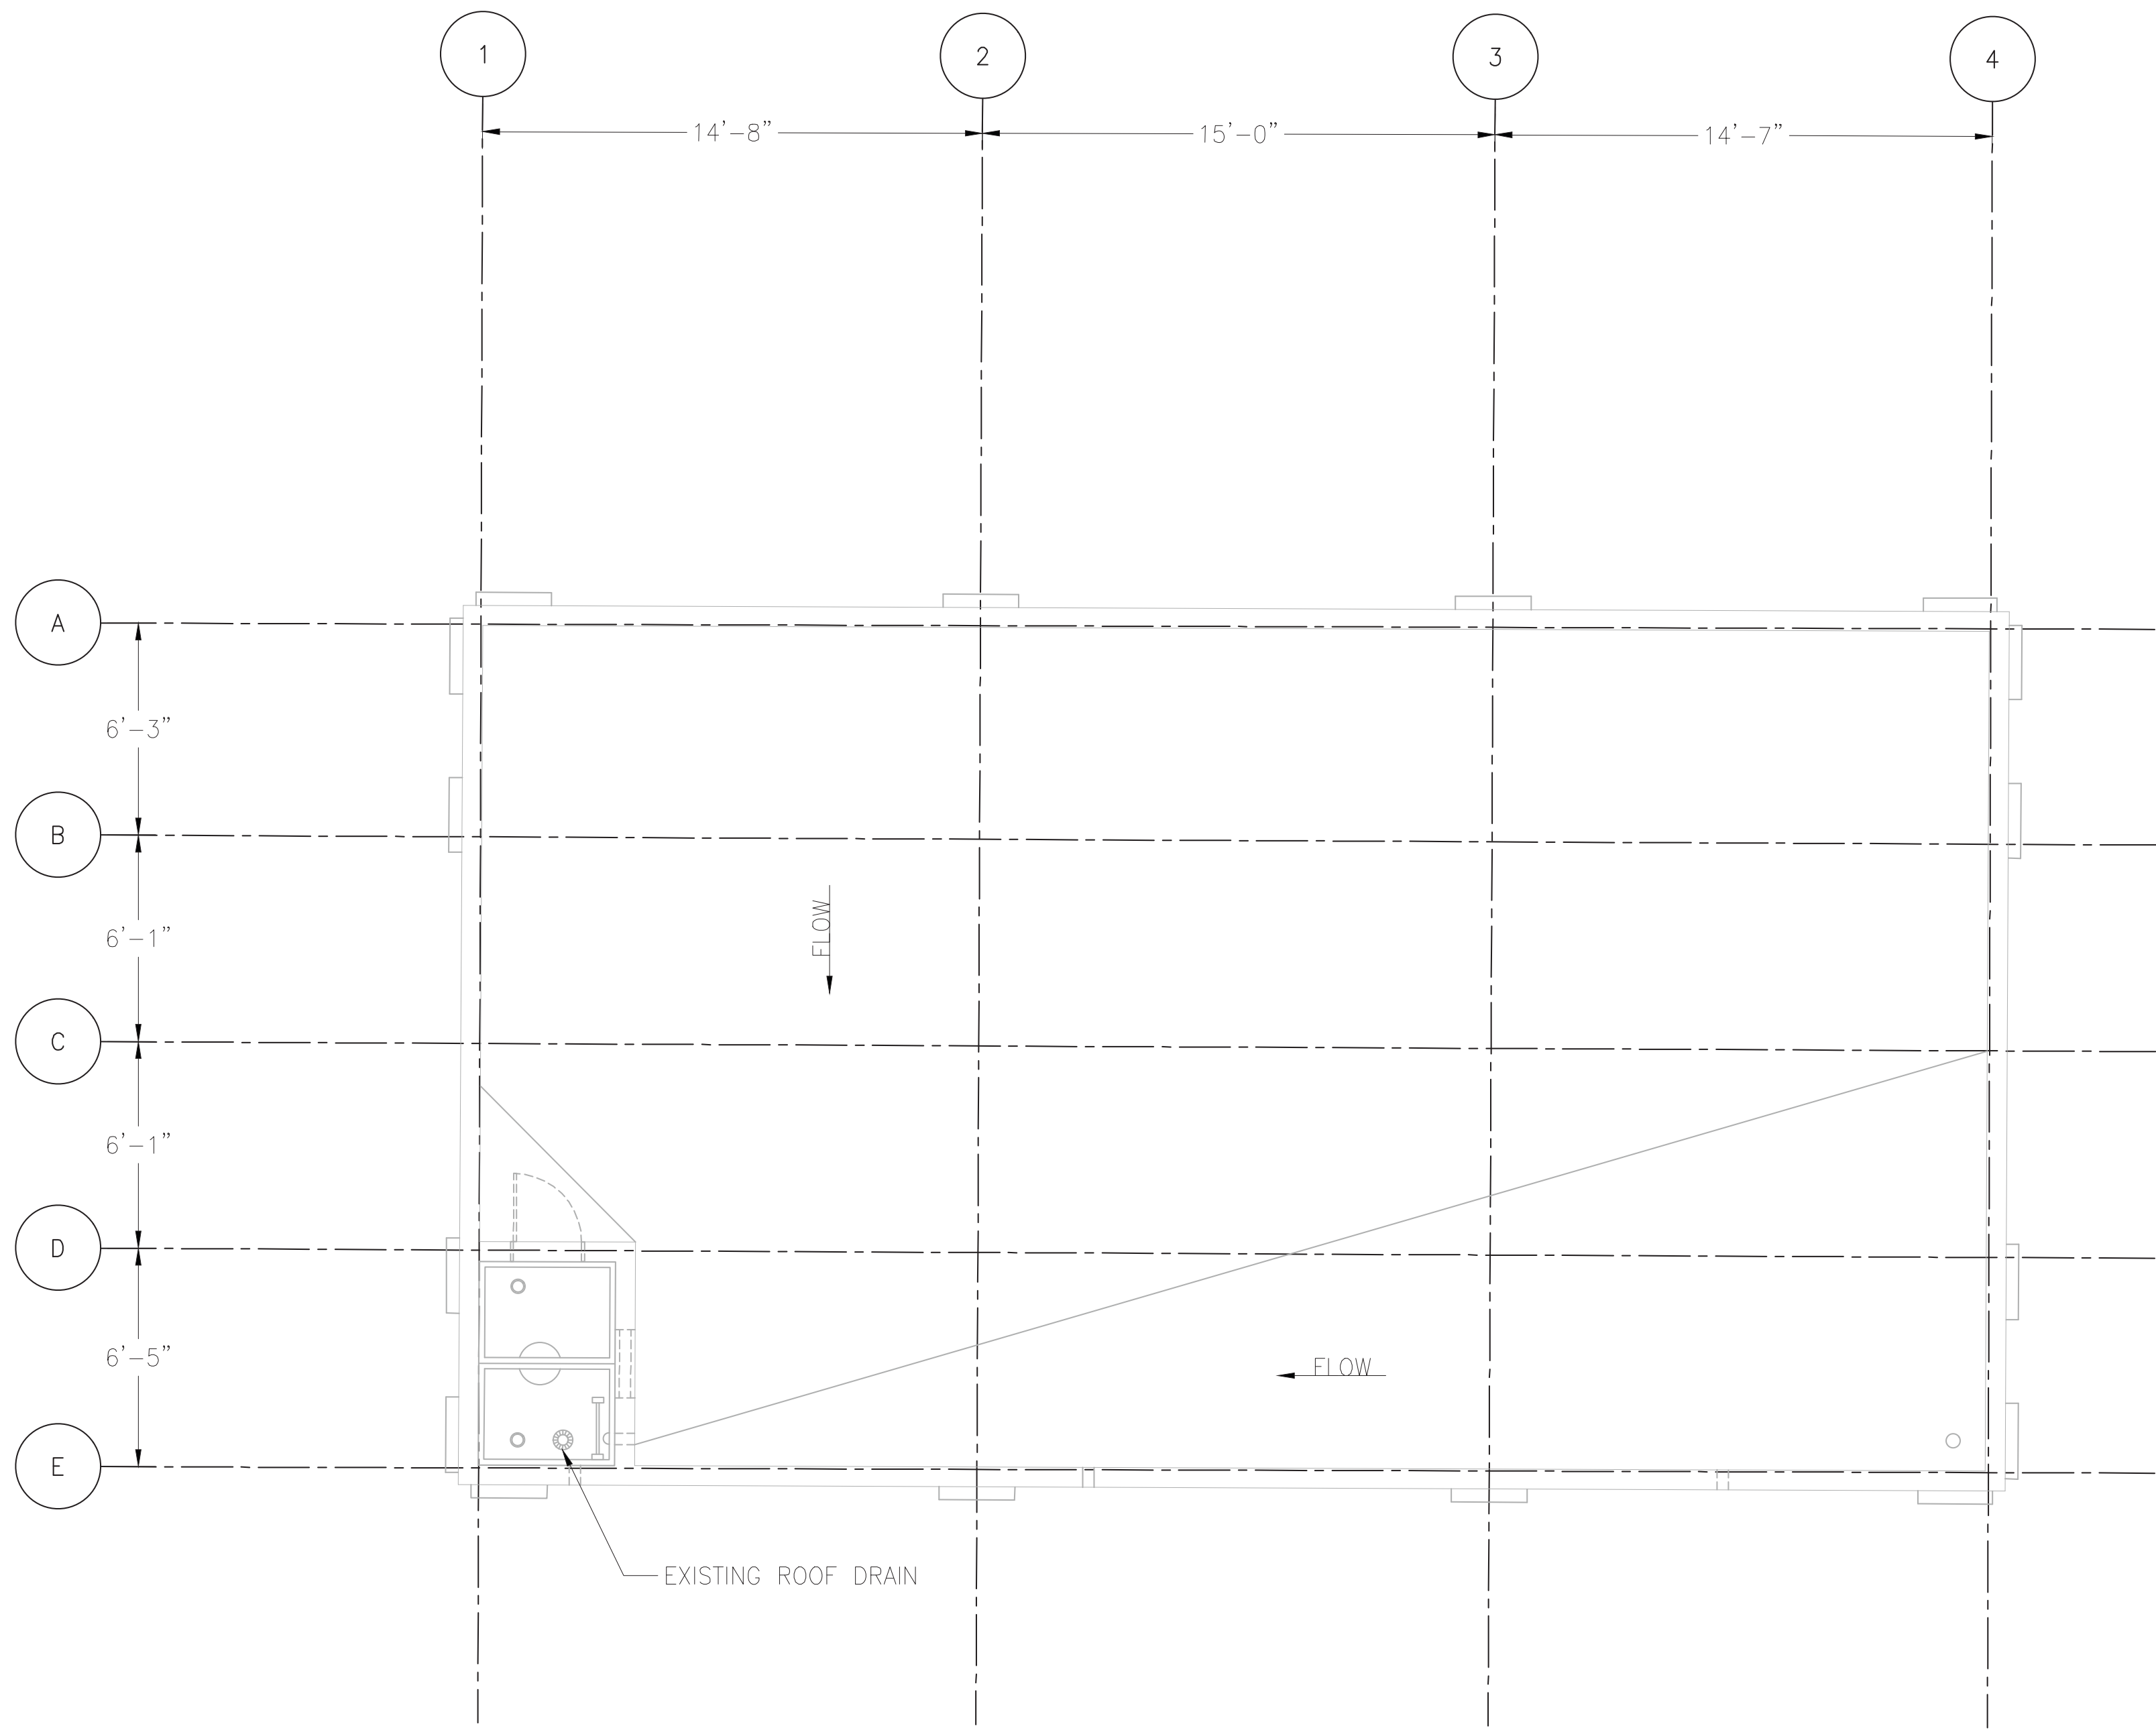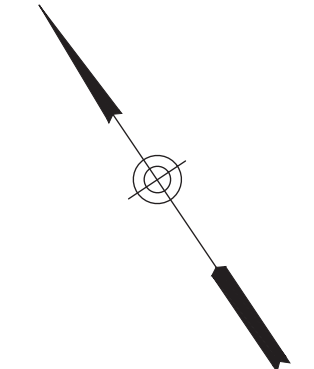

PROPOSED ROOF PLAN  
1/4" = 1'-0"

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.
- WORK ON THIS DRAWING:
- NONE.


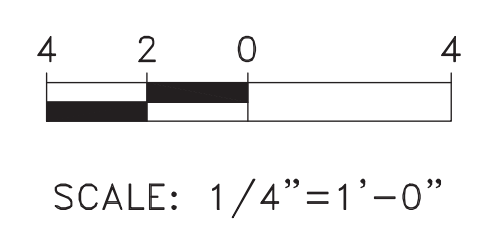


**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

REV	DATE	DESCRIPTION	BY	CK'D	AP'D


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
ROOF FRAMING PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	WBT
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S405</b>		
DWG. NO.:	6	OF	14
SHT. NO.:	397	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-S405	REV. NO.:	-

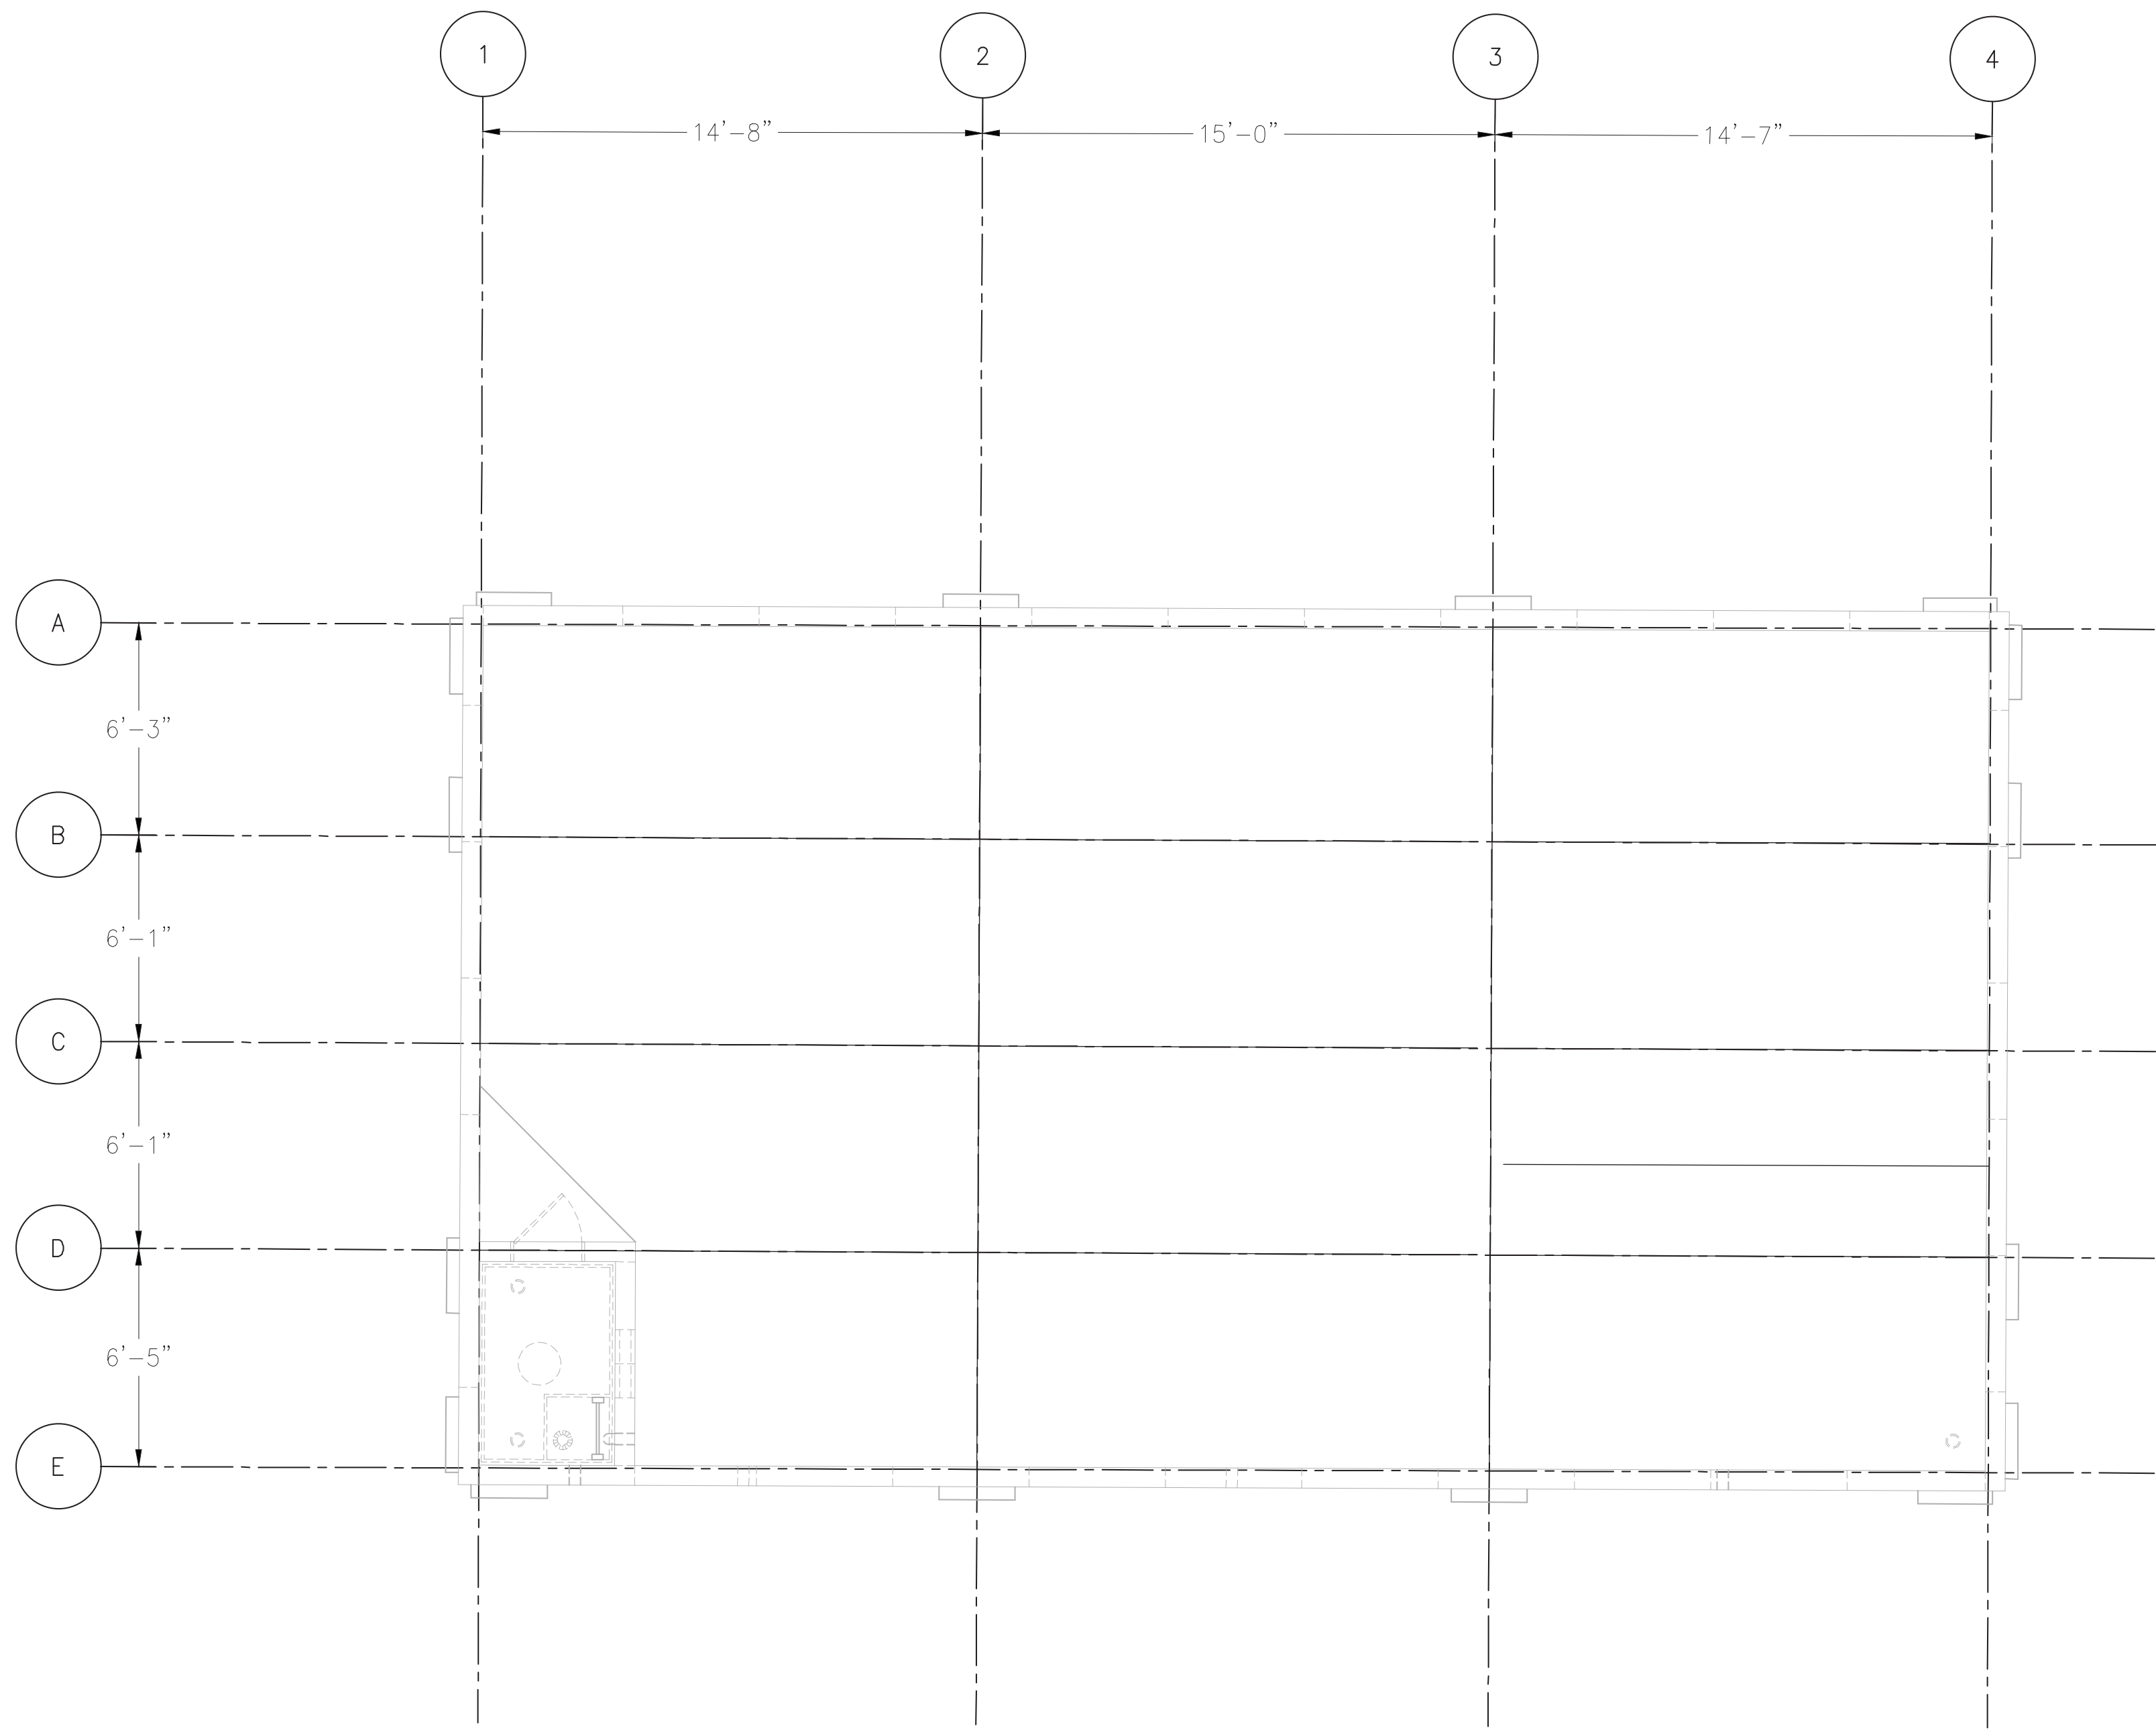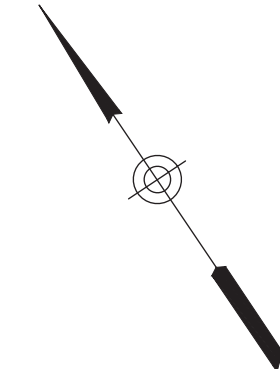

ROOF FRAMING PLAN  
1/4" = 1'-0"

NOTES:  
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.  
WORK ON THIS DRAWING:  
• NONE.

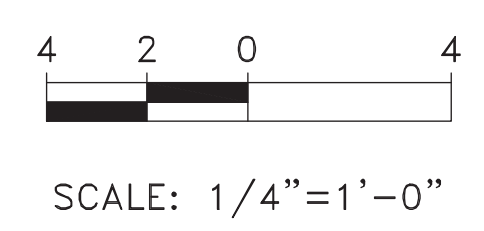

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\688125\17AN-S405.DWG


DATE PRINTED: 10/19/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
REHABILITATION  
**STRUCTURAL**  
BUILDING ELEVATIONS

SCALE:	AS NOTED	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	WBT
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S406</b>	COMPUTER FILE NO.:	17AN-S406
DWG. NO.:	7	OF	14
SHT. NO.:	398	OF	452
ARCHIVE NO.:		REV. NO.:	


DATE PRINTED: 10/19/2025  
STATUS: 50% SUBMISSION

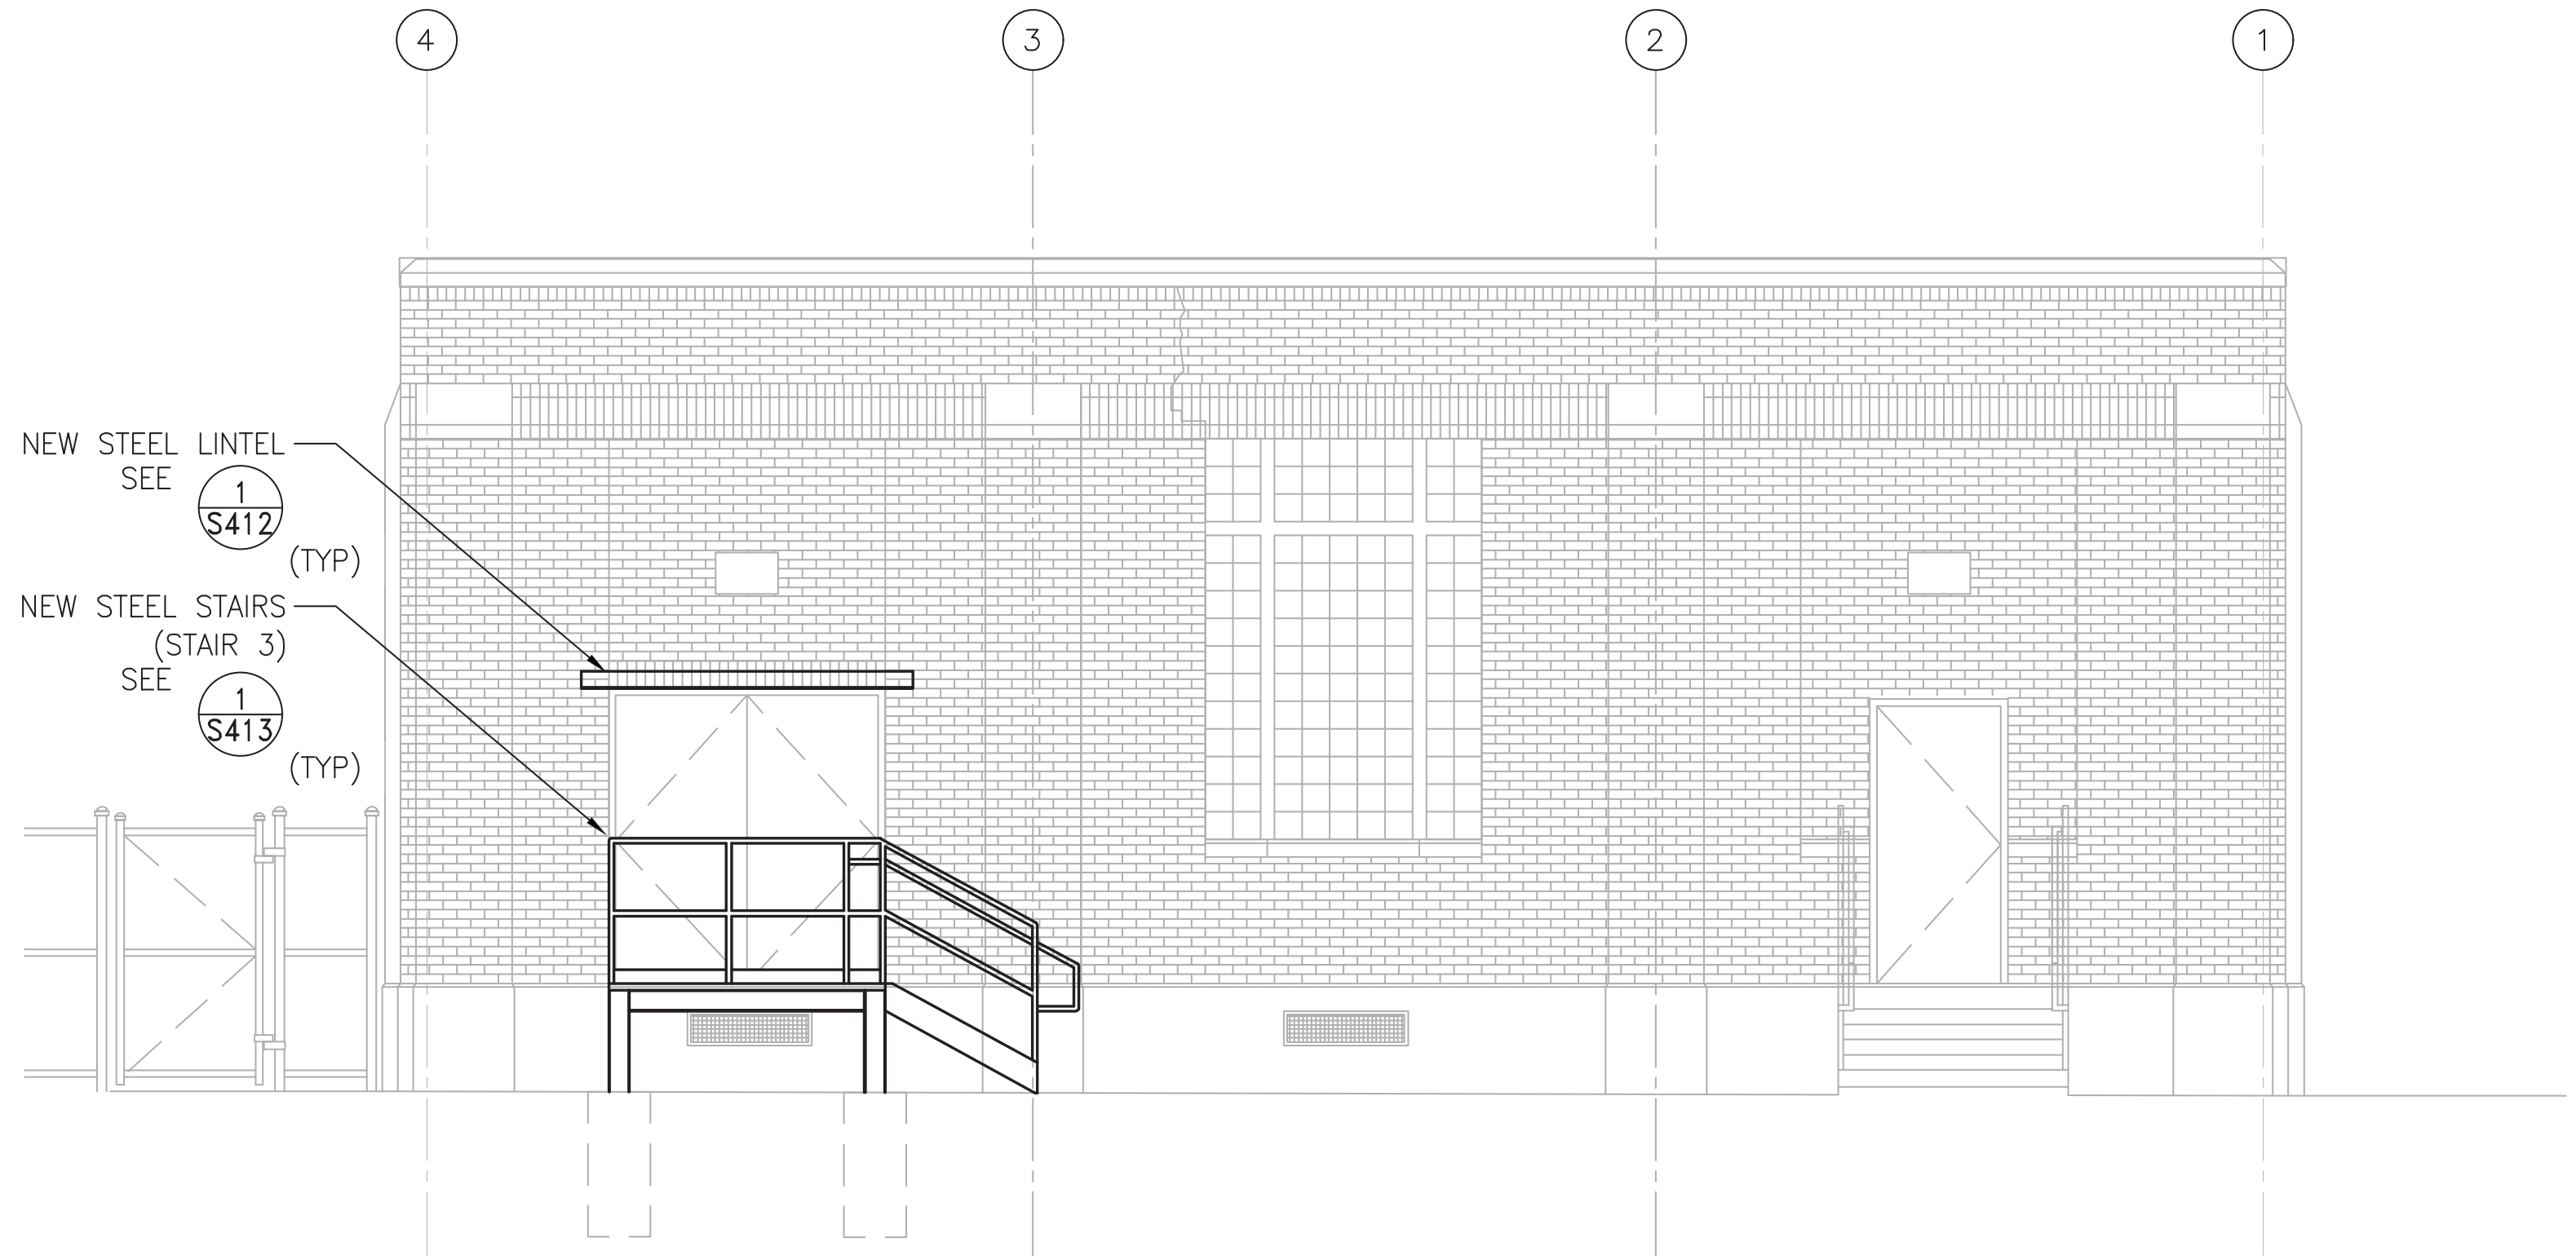


**1 NORTH EXTERIOR ELEVATION**  
S406 SCALE: 1/4"=1'-0"

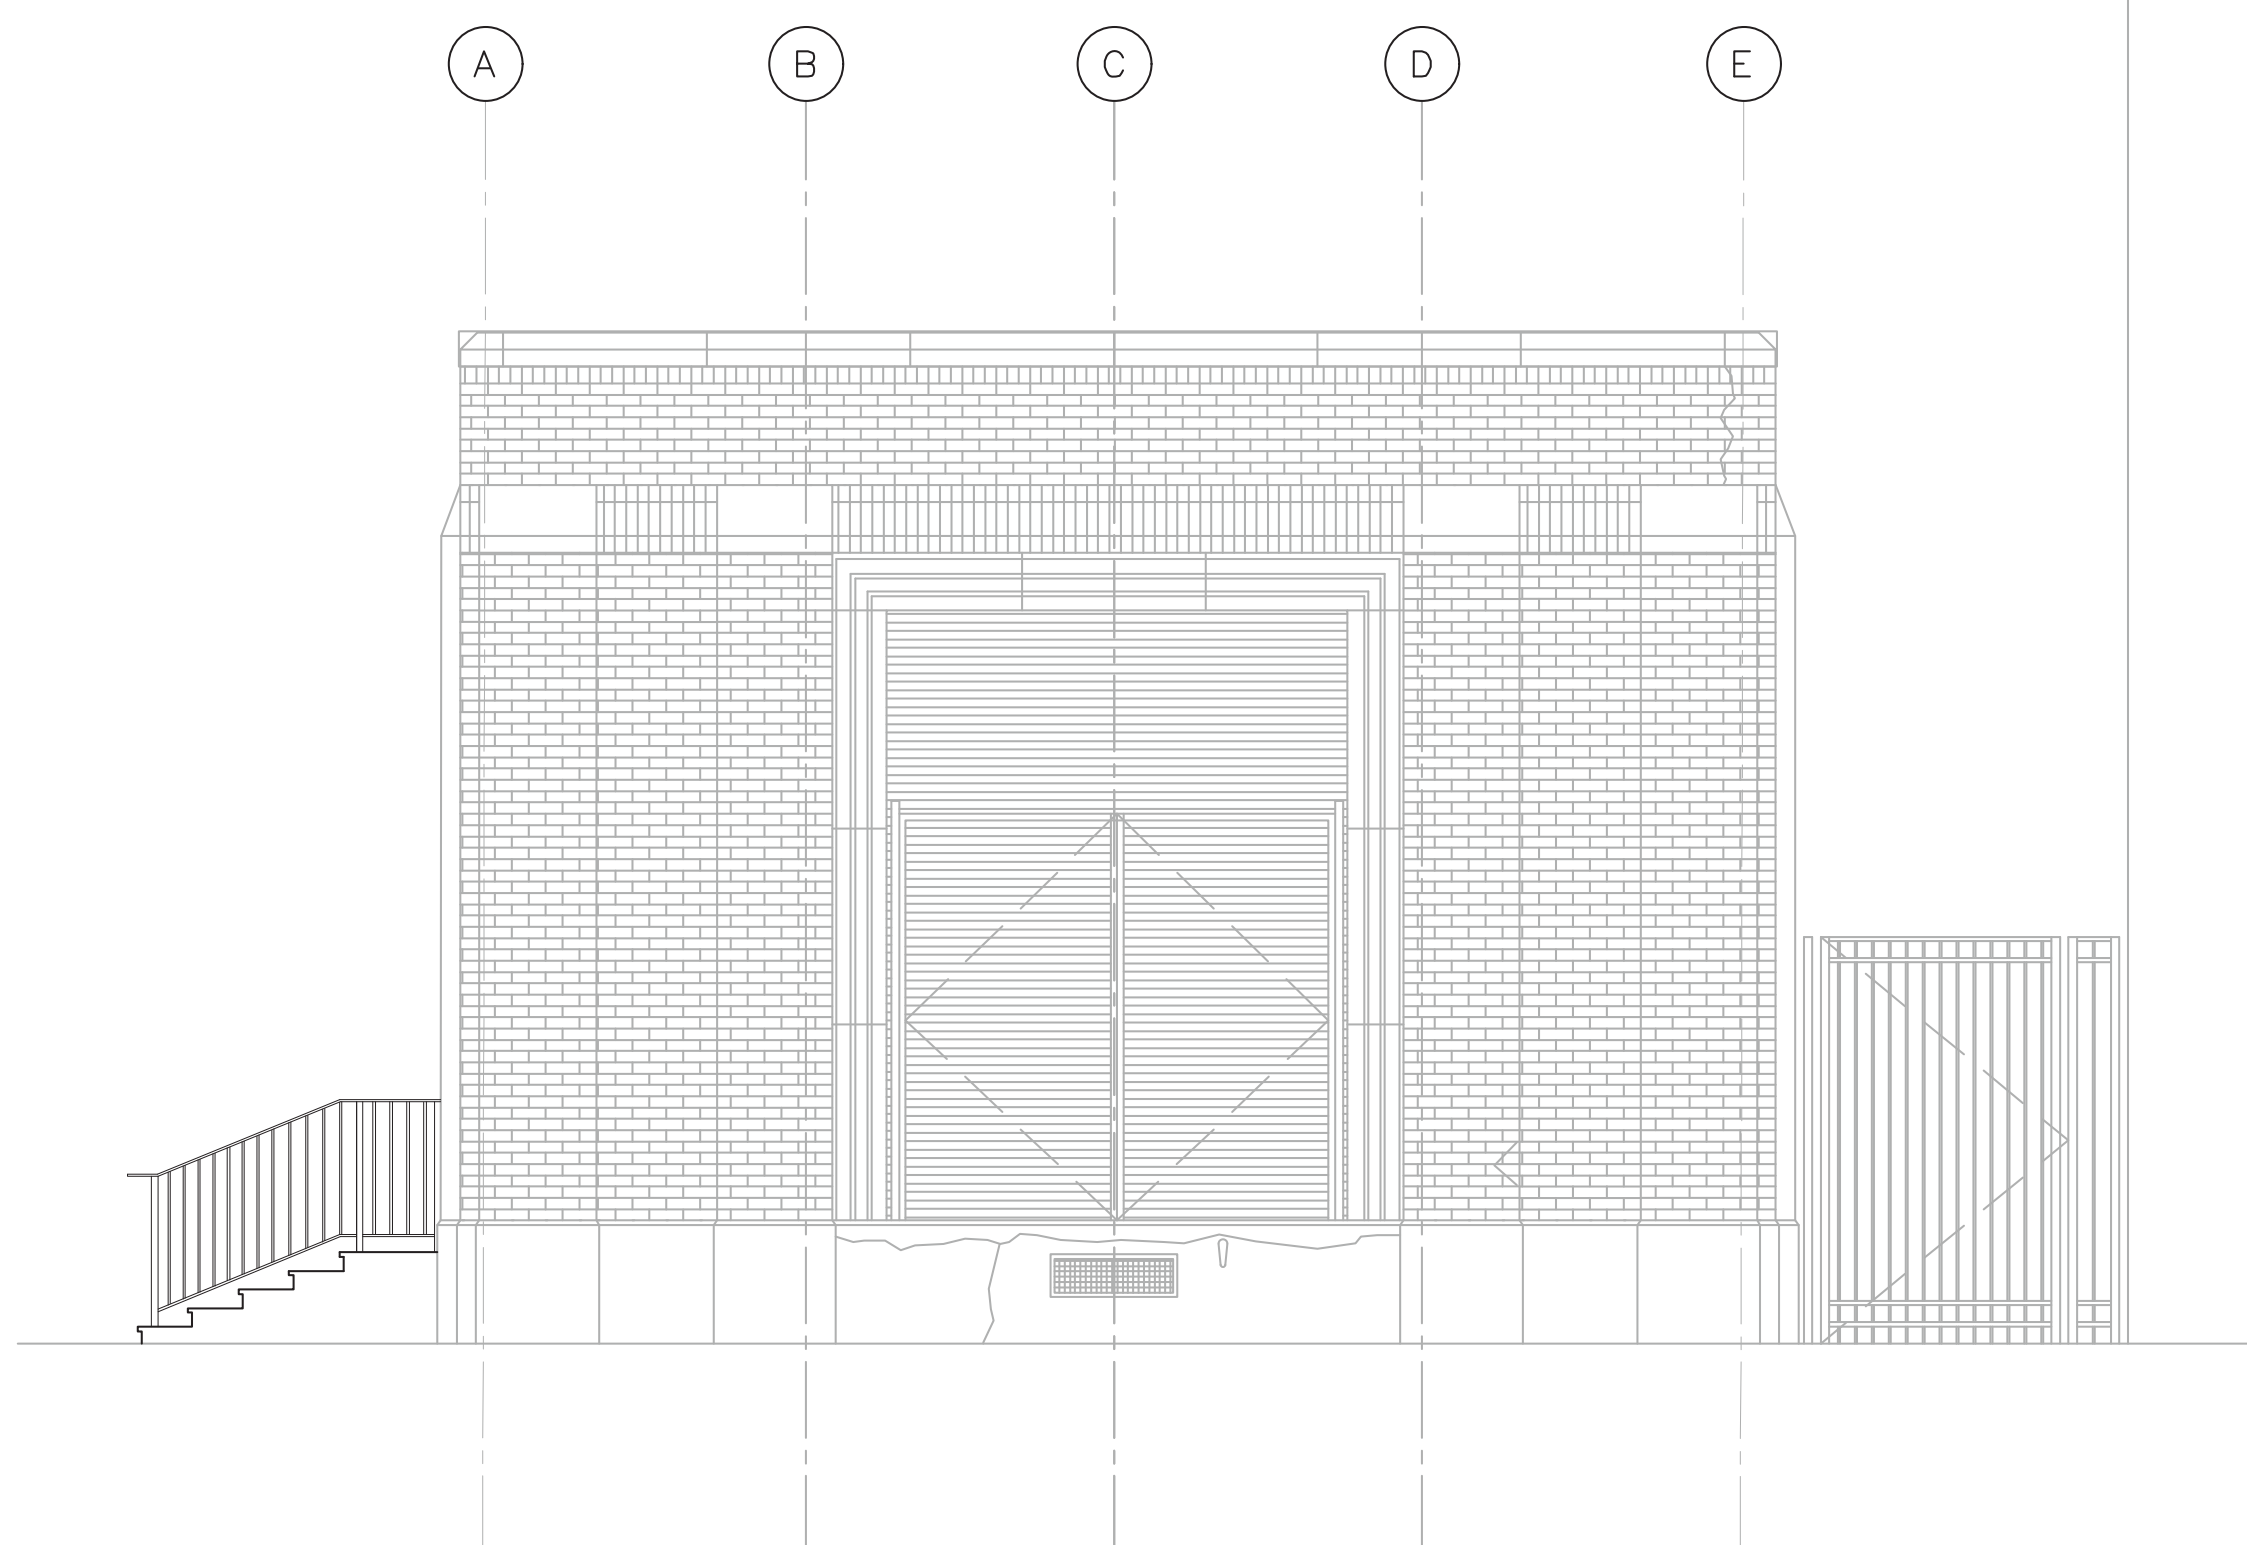

**2 WEST EXTERIOR ELEVATION**  
S406 SCALE: 1/4"=1'-0"

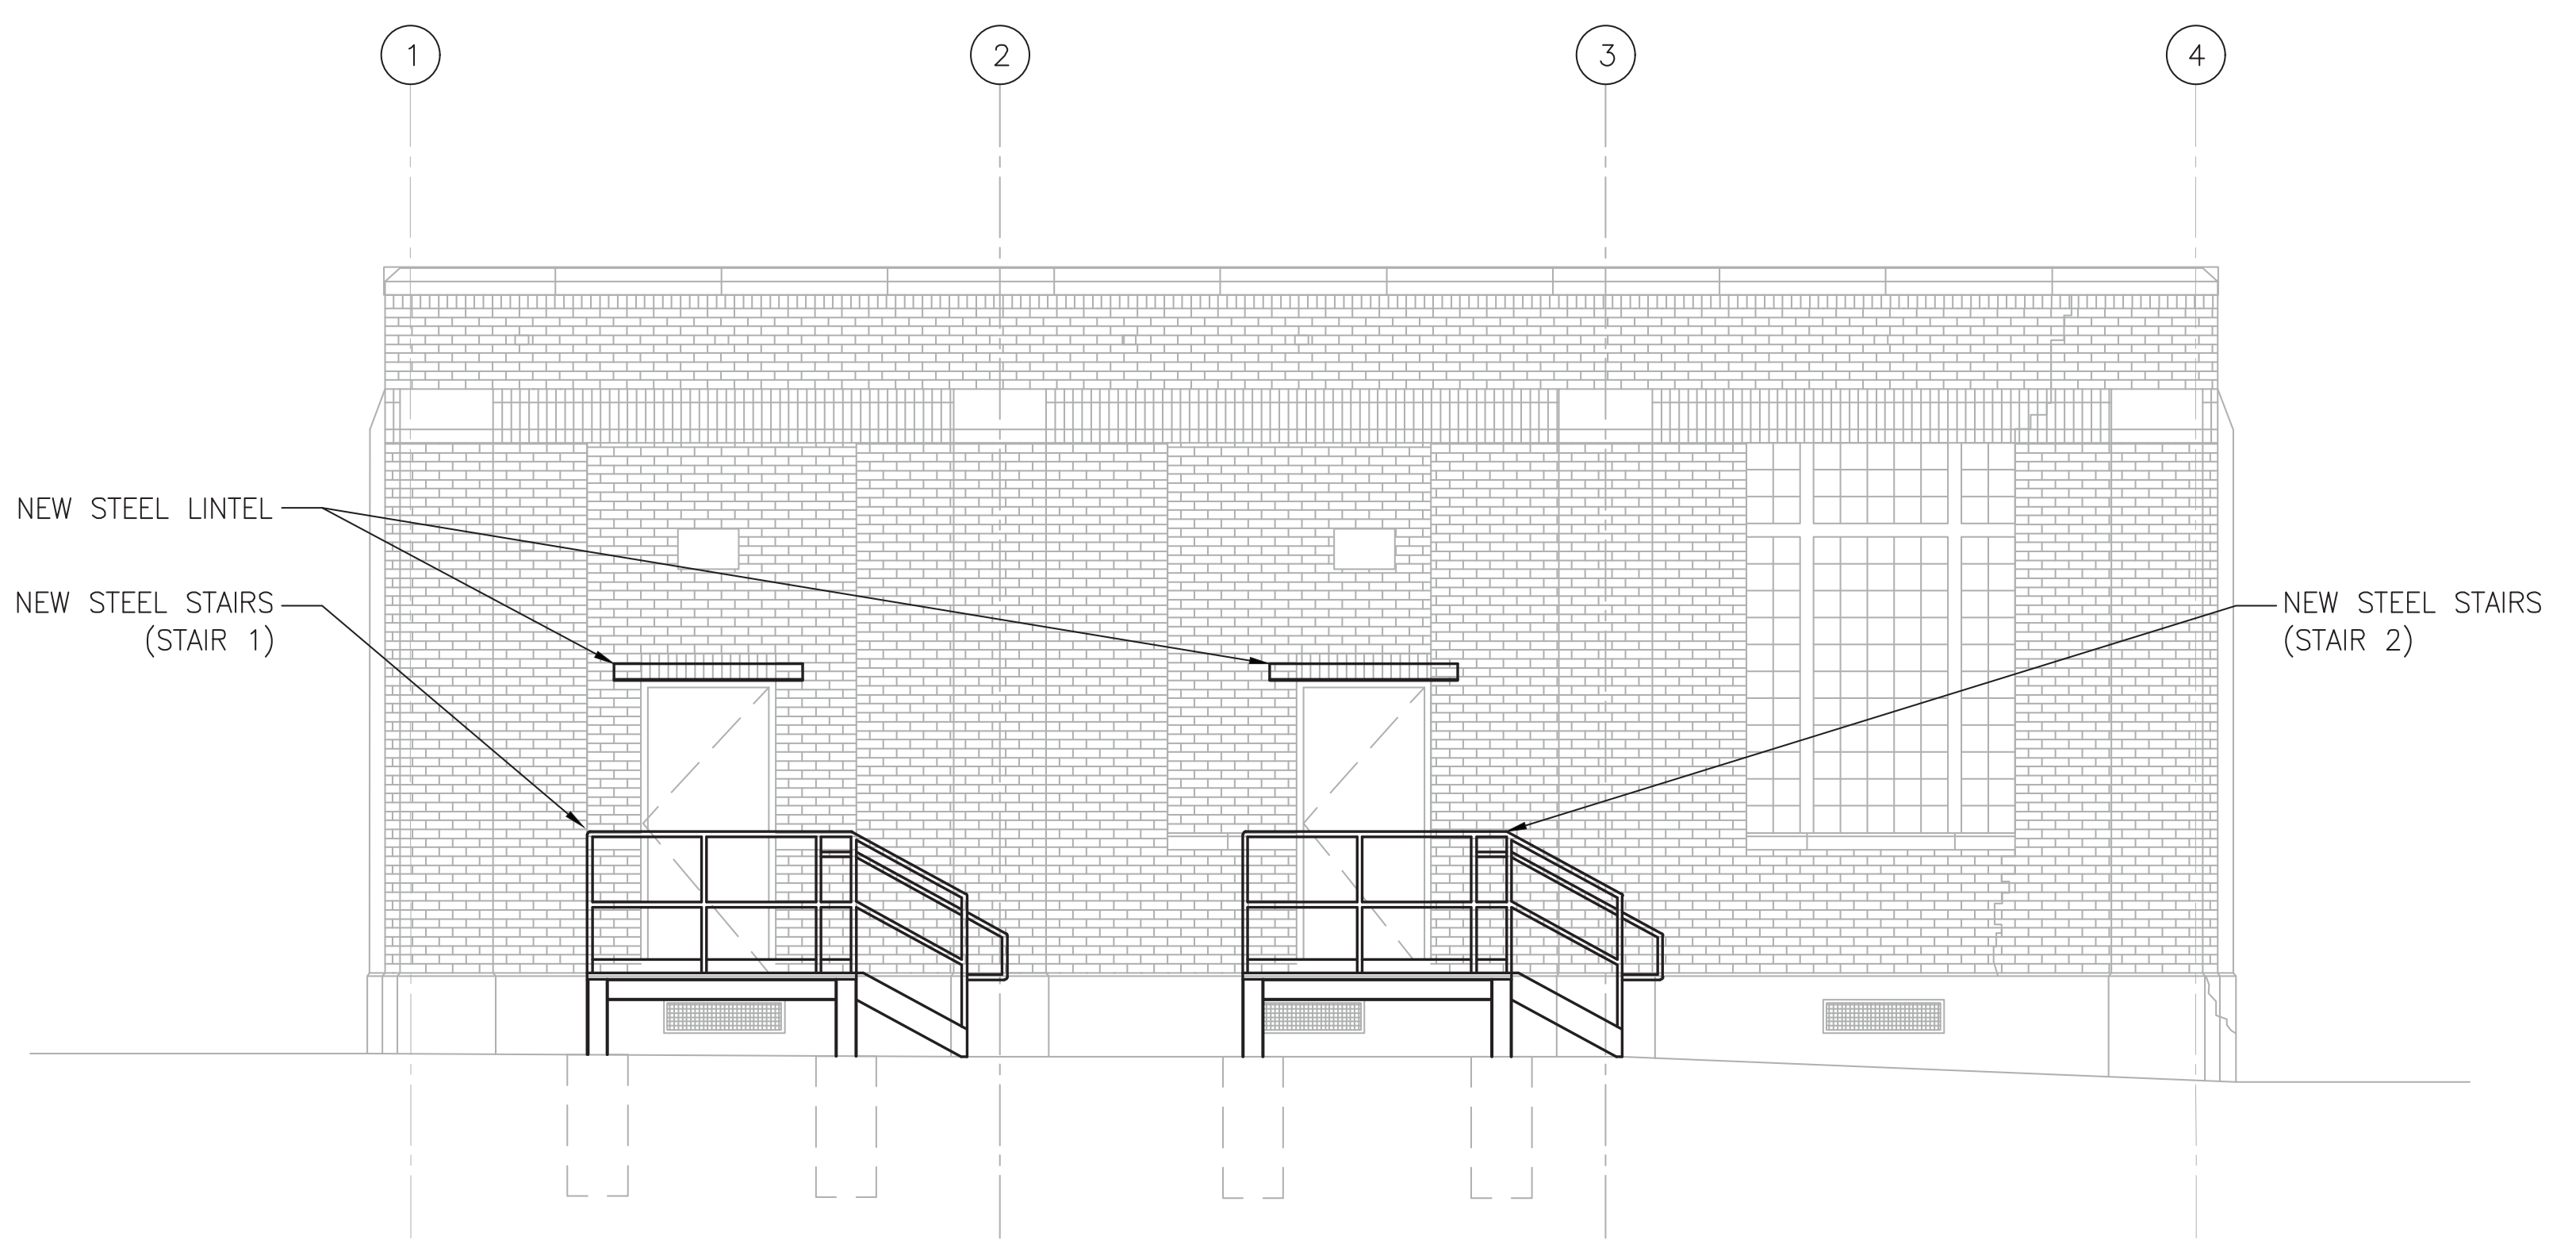


**3 SOUTH EXTERIOR ELEVATION**  
S406 SCALE: 1/4"=1'-0"

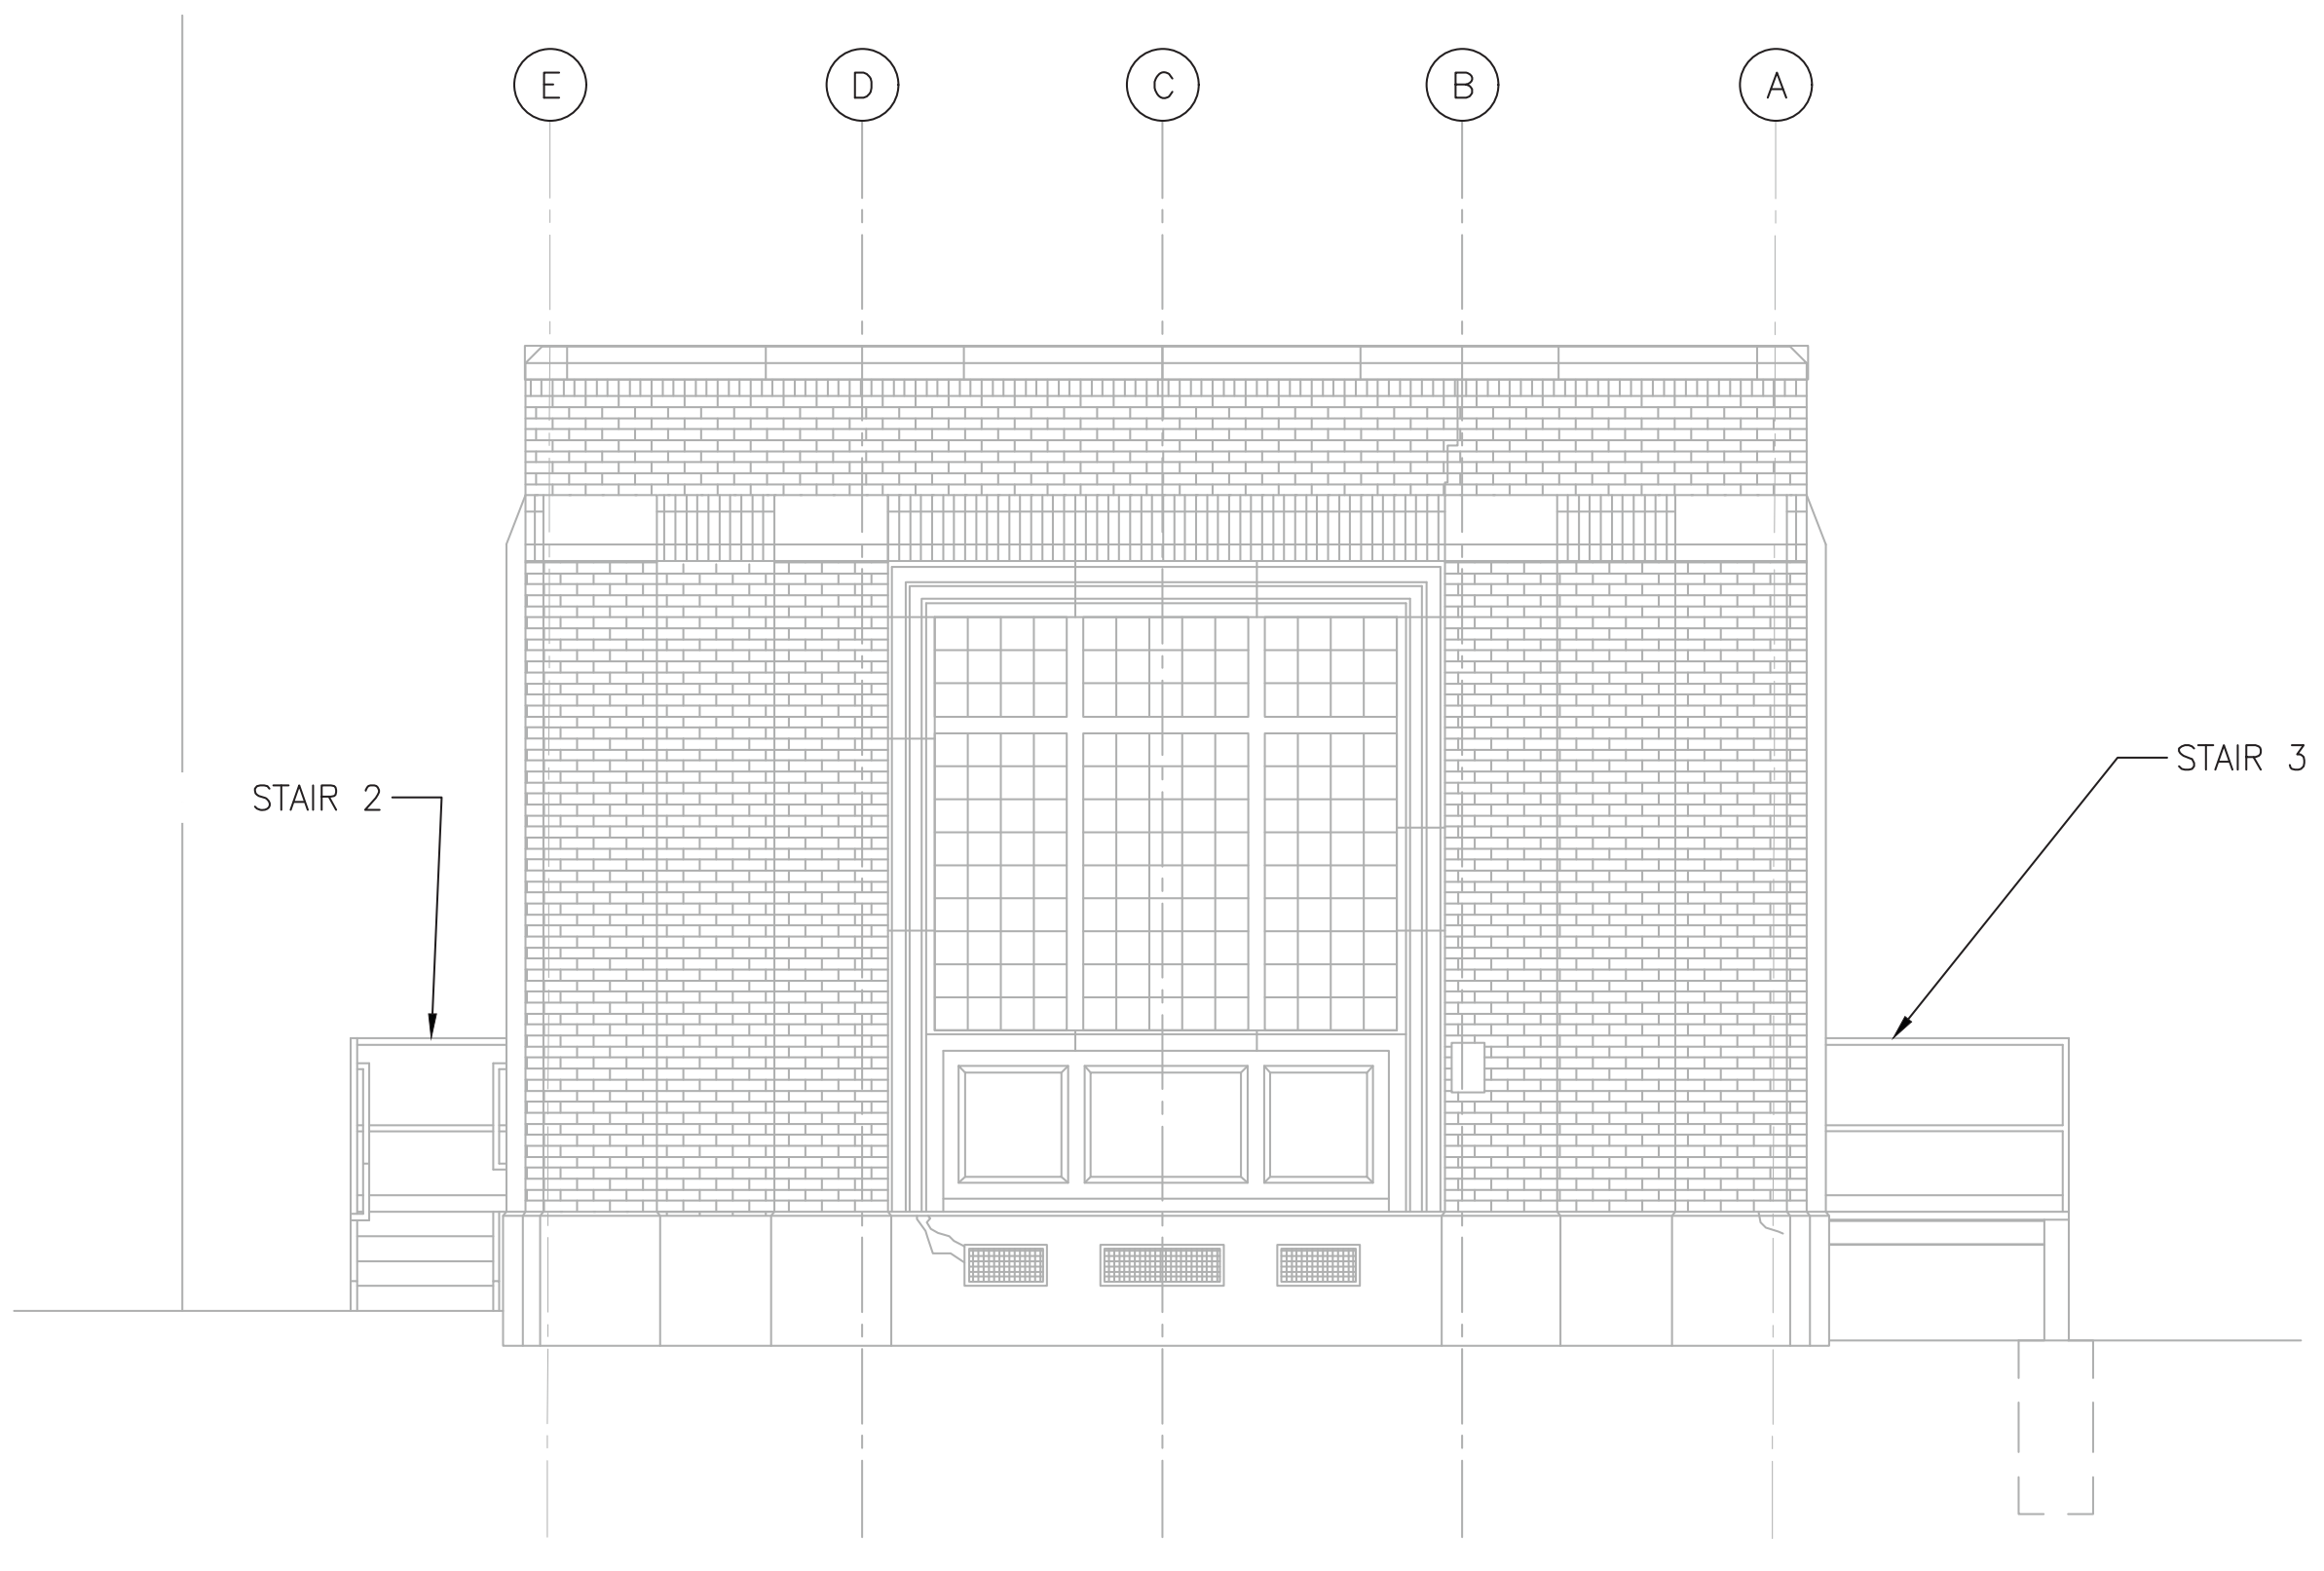

**4 EAST EXTERIOR ELEVATION**  
S406 SCALE: 1/4"=1'-0"

- NOTES:
- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.
- WORK ON THIS DRAWING:
- STEEL LINTEL REPAIR.
  - NEW STEEL STAIRS.
  - NEW STEEL LINTEL AT NEW WALL PENETRATIONS.
  - NEW CONCRETE FOUNDATIONS FOR NEW STAIRS.

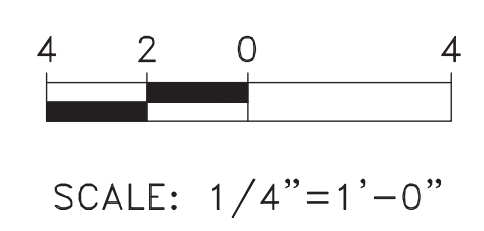


**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\PI\WORKING\PTTD\689125\17AN-S406.DWG


REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**REHABILITATION**  
**STRUCTURAL**  
CONCRETE REPAIR DETAILS - SHEET 1


SCALE:	AS NOTED	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	SEB
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S407</b>		
DWG. NO.:	8	OF	14
SHT. NO.:	399	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-S407	REV. NO.:	-

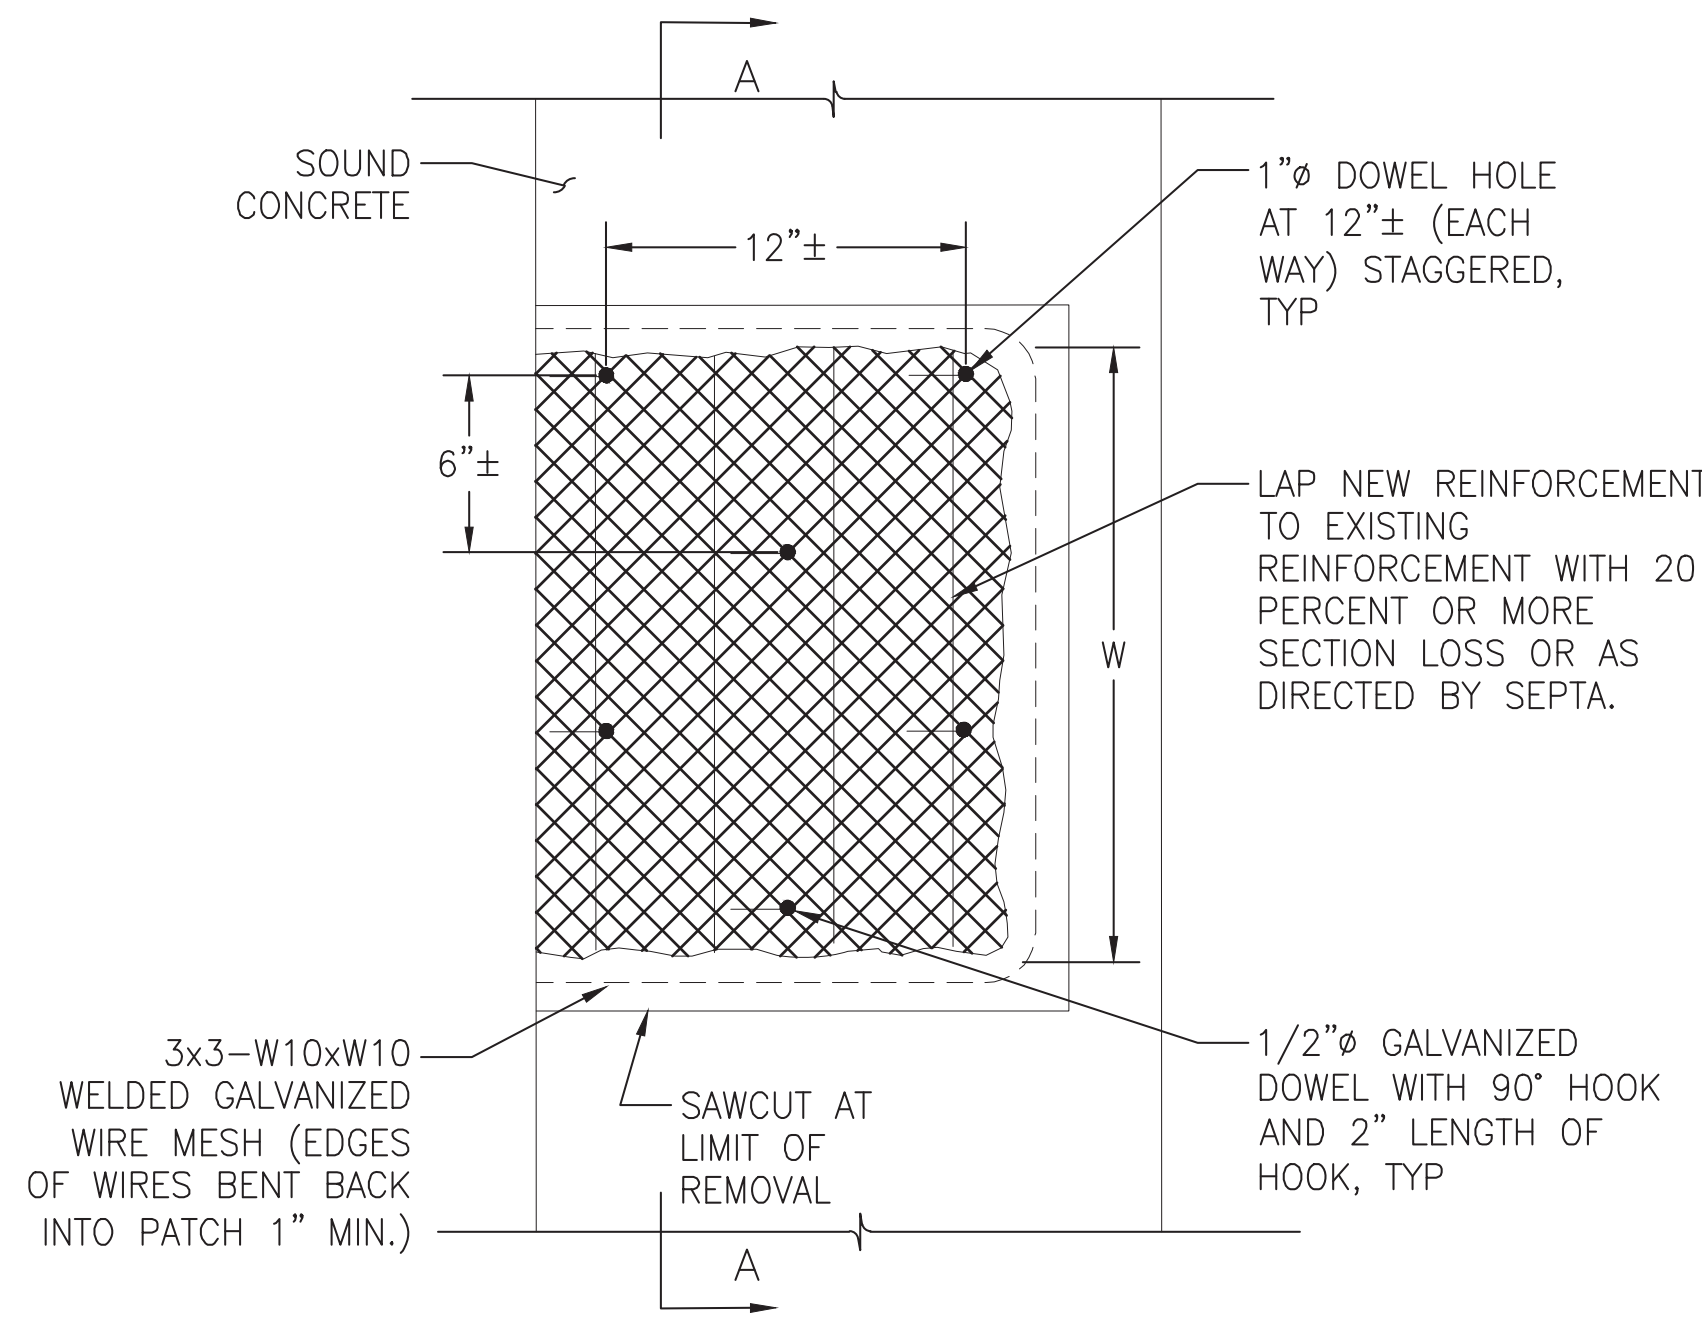


ELEVATION VIEW

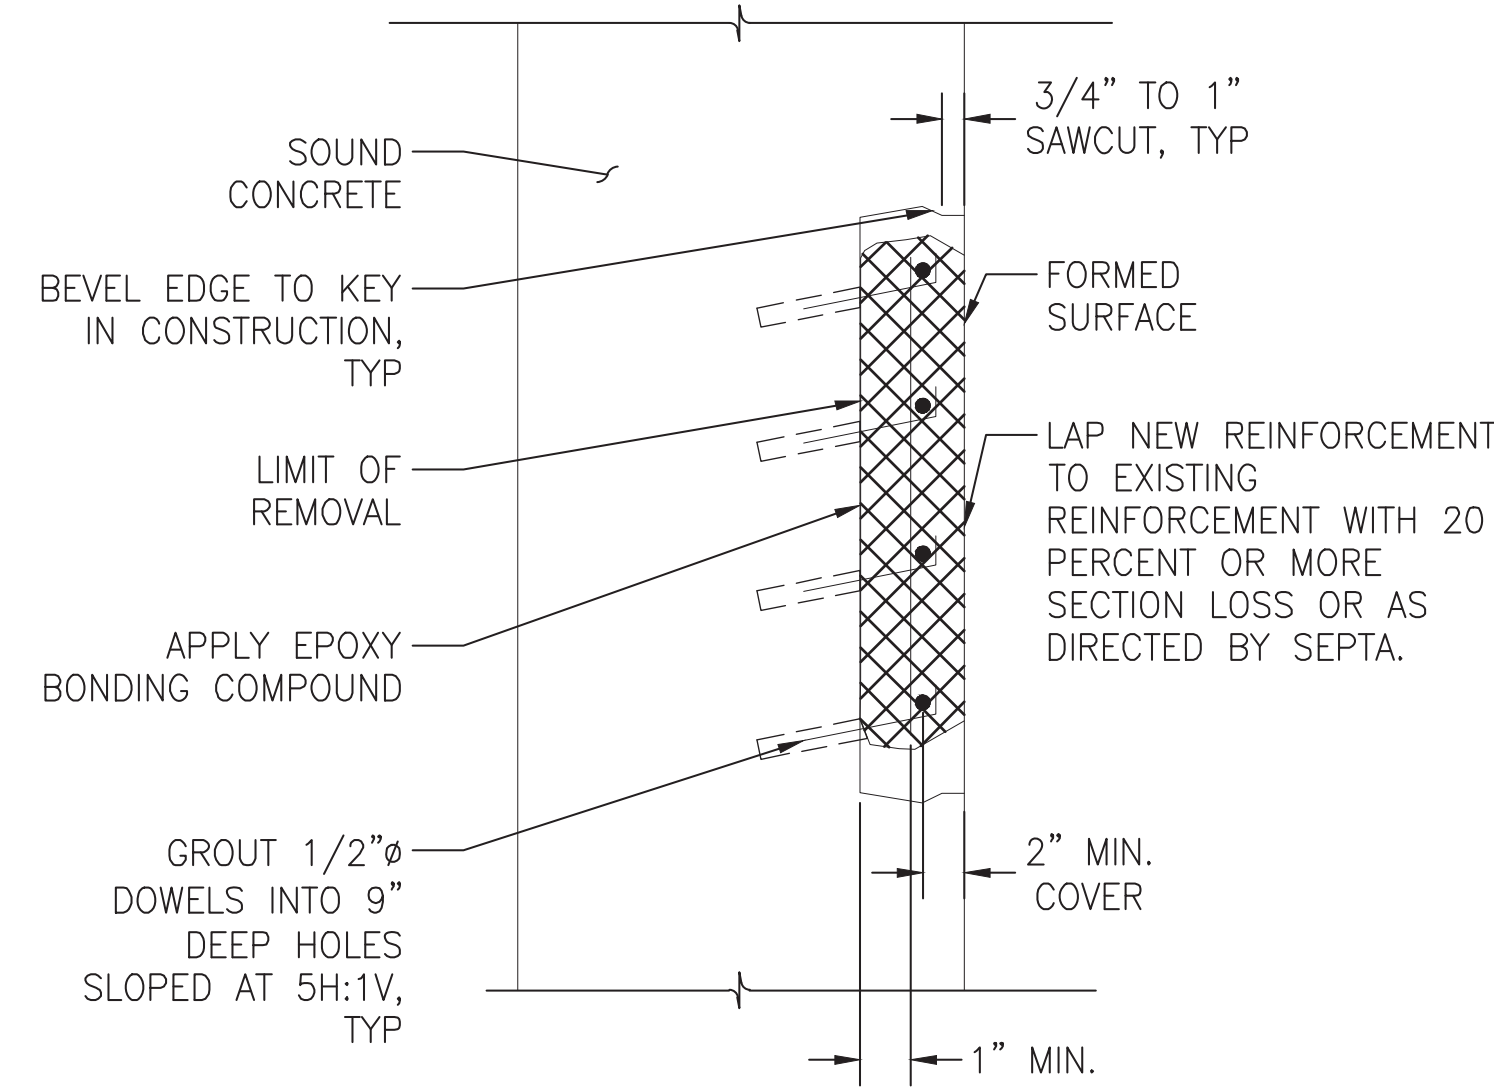

SECTION A-A  
NEW REINFORCEMENT

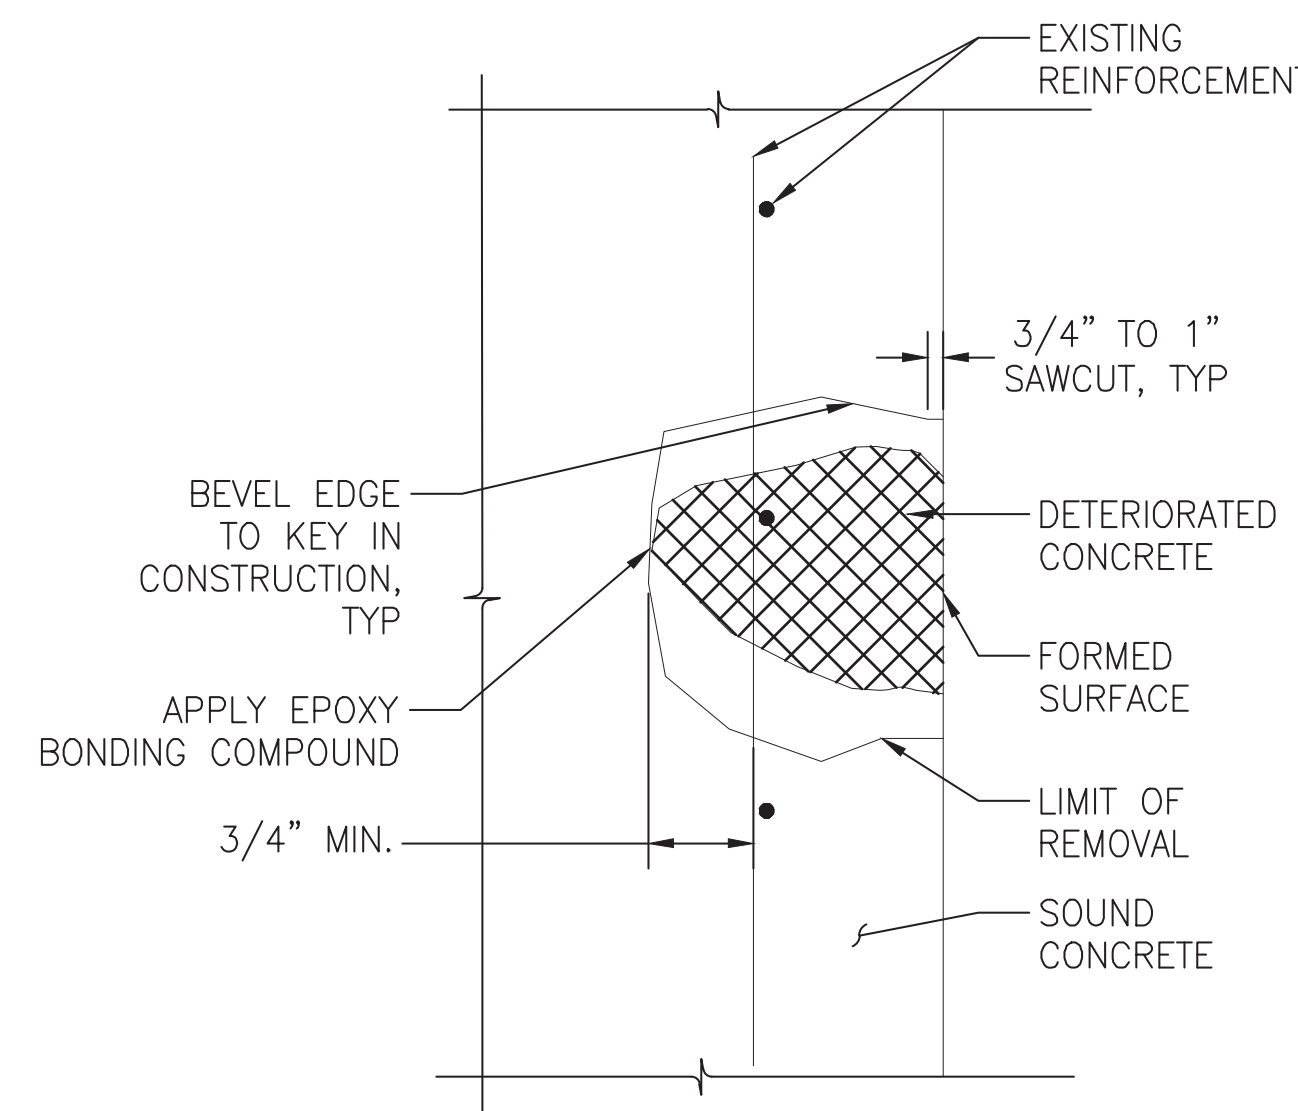

SECTION A-A  
EXISTING REINFORCEMENT

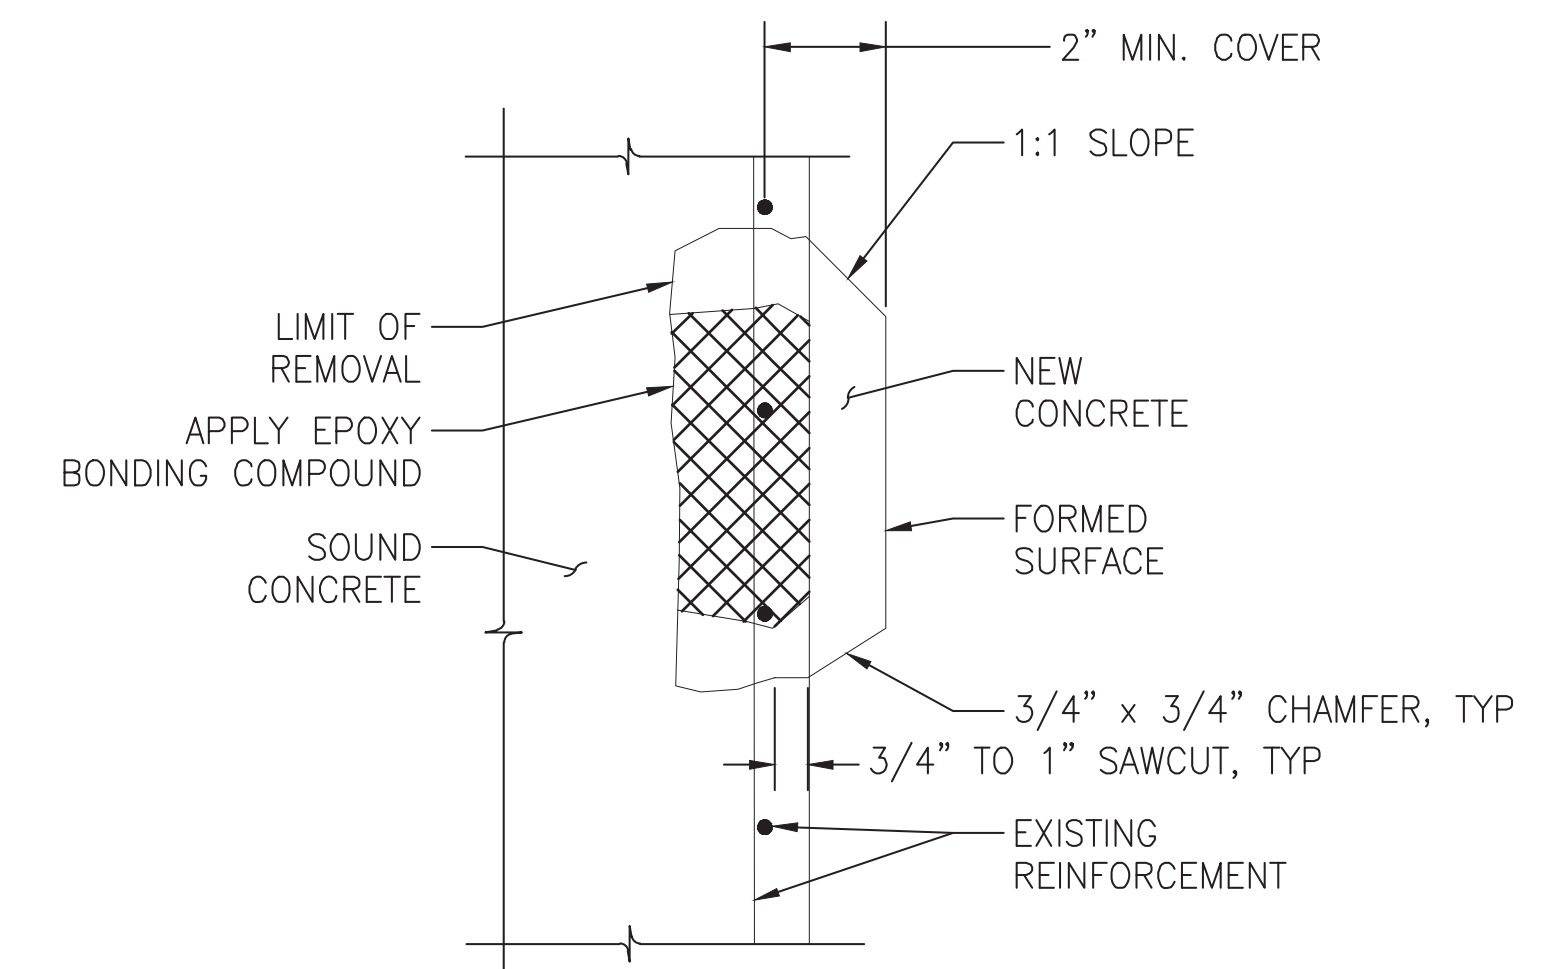

SECTION A-A  
BLISTER DETAIL

**1** CONCRETE REPAIR TYPE 2  
SCALE: N.T.S.

NOTE:

REPAIR TYPE 2 IS USED WHEN DEPTH OF DETERIORATED CONCRETE IS GREATER THAN 3/4" AND EXISTING REINFORCEMENT SPACED ≤ 12" ON CENTERS. OTHERWISE USE REPAIR TYPE 2A.

NOTE:

CONCRETE REPAIR TYPE 2 DETAIL FOR AREAS WITH EXISTING REINFORCEMENT HAVING LESS THAN 2" OF COVER.


REINFORCED CONCRETE REPAIR TYPE 2 NOTES:

- SQUARE OFF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MINIMUM TO 1" MAXIMUM BUT NOT TO THE DEPTH OF THE REINFORCEMENT STEEL. BACK BEVEL EDGE BEYOND SAWCUT.
- USE HAND TOOLS TO REMOVE ALL LOOSE AND DELAMINATED CONCRETE THAT PROVIDES A SOUND BOND BETWEEN EXISTING CONCRETE AND NEW CONCRETE. PNEUMATIC HAMMERS WITH IMPACT RATINGS OF 3 FT-LBS OR LESS MAY BE USED IF REQUIRED.
- IF DETERIORATED CONCRETE EXTENDS BEYOND THE PRIMARY REINFORCEMENT, REMOVE THE CONCRETE TO AT LEAST 3/4" BEHIND THE REINFORCEMENT.
- APPLY AN EPOXY BONDING COMPOUND BETWEEN THE EXISTING AND THE NEW CLASS A CEMENT CONCRETE.
- "W" REPRESENTS LEAST DIMENSION OF DETERIORATED CONCRETE.
- USE DOWELS ONLY WHEN "W" DIMENSION OF DETERIORATED CONCRETE IS GREATER THAN 2'-0" AND NEW OR EXISTING REINFORCEMENT CANNOT ADEQUATELY BE DEVELOPED BY LAPPING WITH EXISTING REINFORCEMENT.
- USE A PACHOMETER TO LOCATE EXISTING REINFORCEMENT WHEN DRILLING DOWEL HOLES TO AVOID DRILLING THRU EXISTING BARS.
- AN APPROVED EPOXY ANCHORING SYSTEM IN 90° HOLES MAY REPLACE GROUT IN SLOPED HOLES. USE A 6" MINIMUM EMBEDMENT AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- A #4 DEFORMED REINFORCEMENT BENT "L" BAR MAY REPLACE THE 1/2" DIAMETER DOWEL HOOK.
- ALTERNATE WIRE MESH MAY BE SUBSTITUTED FOR 3x3-W10xW10, PROVIDED WIRE SPACING DOES NOT EXCEED 4" AND AN EQUIVALENT STEEL AREA IS PROVIDED. NEW REINFORCEMENT BARS MAY BE OMITTED IF WIRE MESH STEEL AREA EXCEEDS EXISTING REINFORCEMENT.
- CLEAN EXISTING REINFORCEMENT BY MECHANICAL MEANS.
- LAP EQUIVALENT NEW REINFORCEMENT TO THE EXISTING REINFORCEMENT AS DIRECTED.
- REINFORCEMENT BARS TO BE GALVANIZED.


NOTES:

1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.

WORK ON THIS DRAWING:  
• CONCRETE REPAIRS.

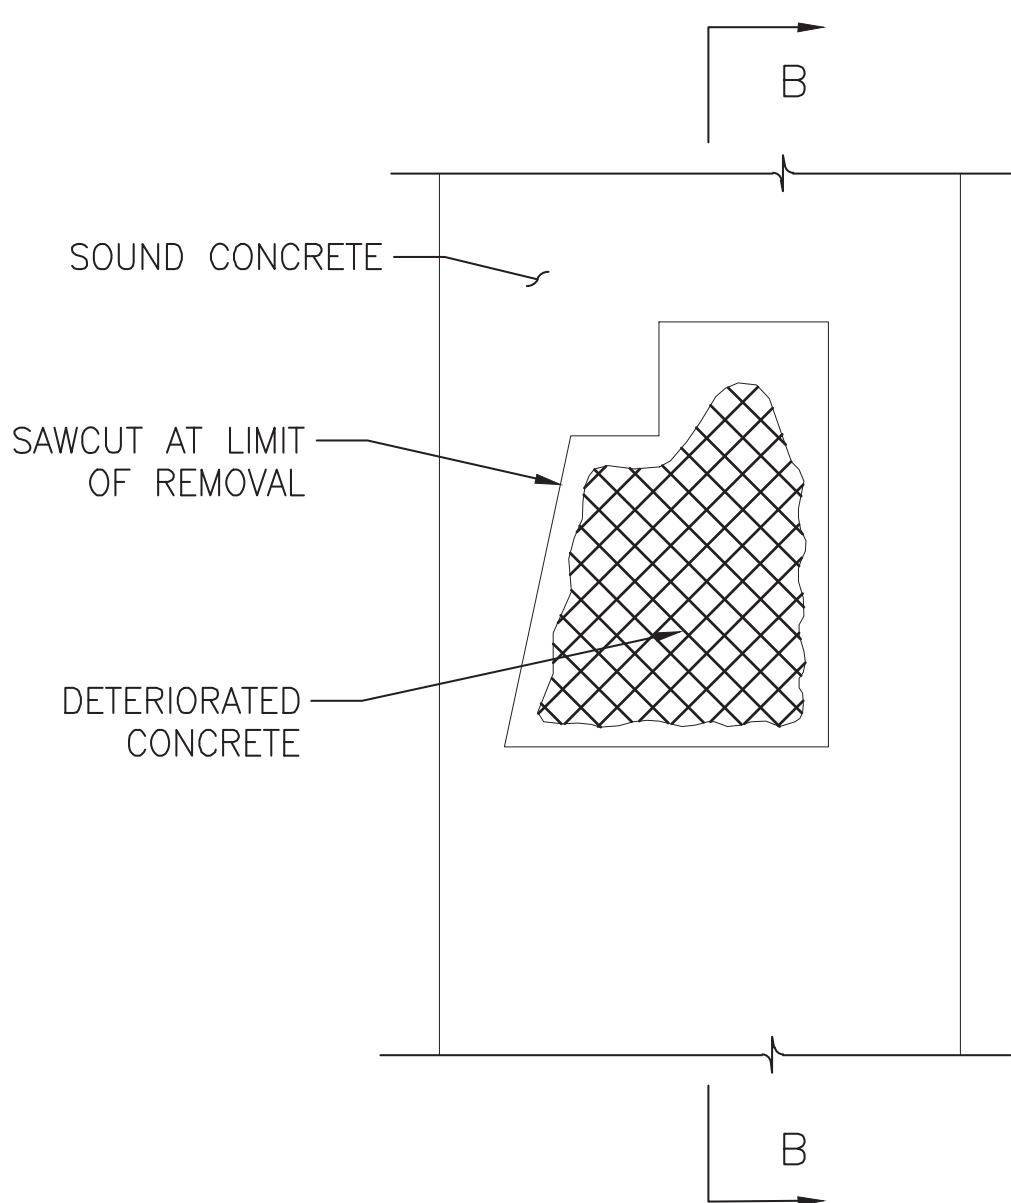

ELEVATION VIEW

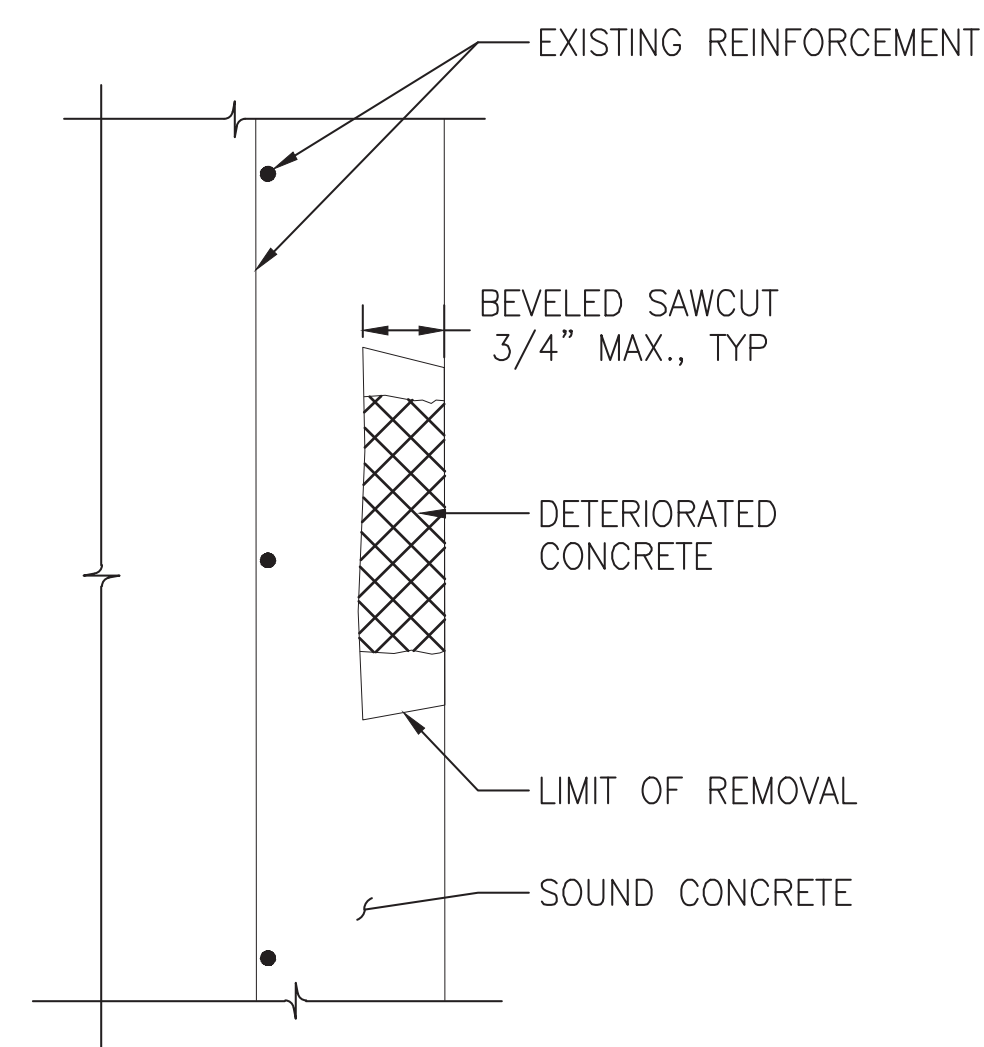

SECTION B-B

**2** CONCRETE REPAIR TYPE 1  
SCALE: N.T.S.

NOTE:

REPAIR TYPE 1 IS USED WHEN DEPTH OF DETERIORATED CONCRETE IS LESS THAN EQUAL TO 3/4".

REINFORCED CONCRETE REPAIR TYPE 1 NOTES:

- SQUARE OFF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MAXIMUM.
- REMOVE ALL LOOSE AND DELAMINATED CONCRETE TO PROVIDE A SOUND BOND BETWEEN EXISTING CONCRETE AND PATCHING.
- APPLY A RAPID HARDENING CONCRETE PATCHING MATERIAL FROM AN APPROVED MANUFACTURER AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.

LEGEND

REMOVE DETERIORATED CONCRETE




50% SUBMISSION  
NOT FOR CONSTRUCTION

REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
CONCRETE REPAIR DETAILS - SHEET 2

SCALE: <b>AS NOTED</b>	SCALE FACTOR: -
DATE: <b>10/16/2017</b>	DRAWN BY: <b>SEB</b>
WORK ORDER NO.: <b>276496</b>	CHECKED BY: <b>JWA</b>
SHEET NUMBER: <b>S408</b>	
DWG. NO.: <b>9</b> of <b>14</b>	SHT. NO.: <b>400</b> of <b>452</b>
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: <b>17AN-S408</b>	REV. NO.:

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

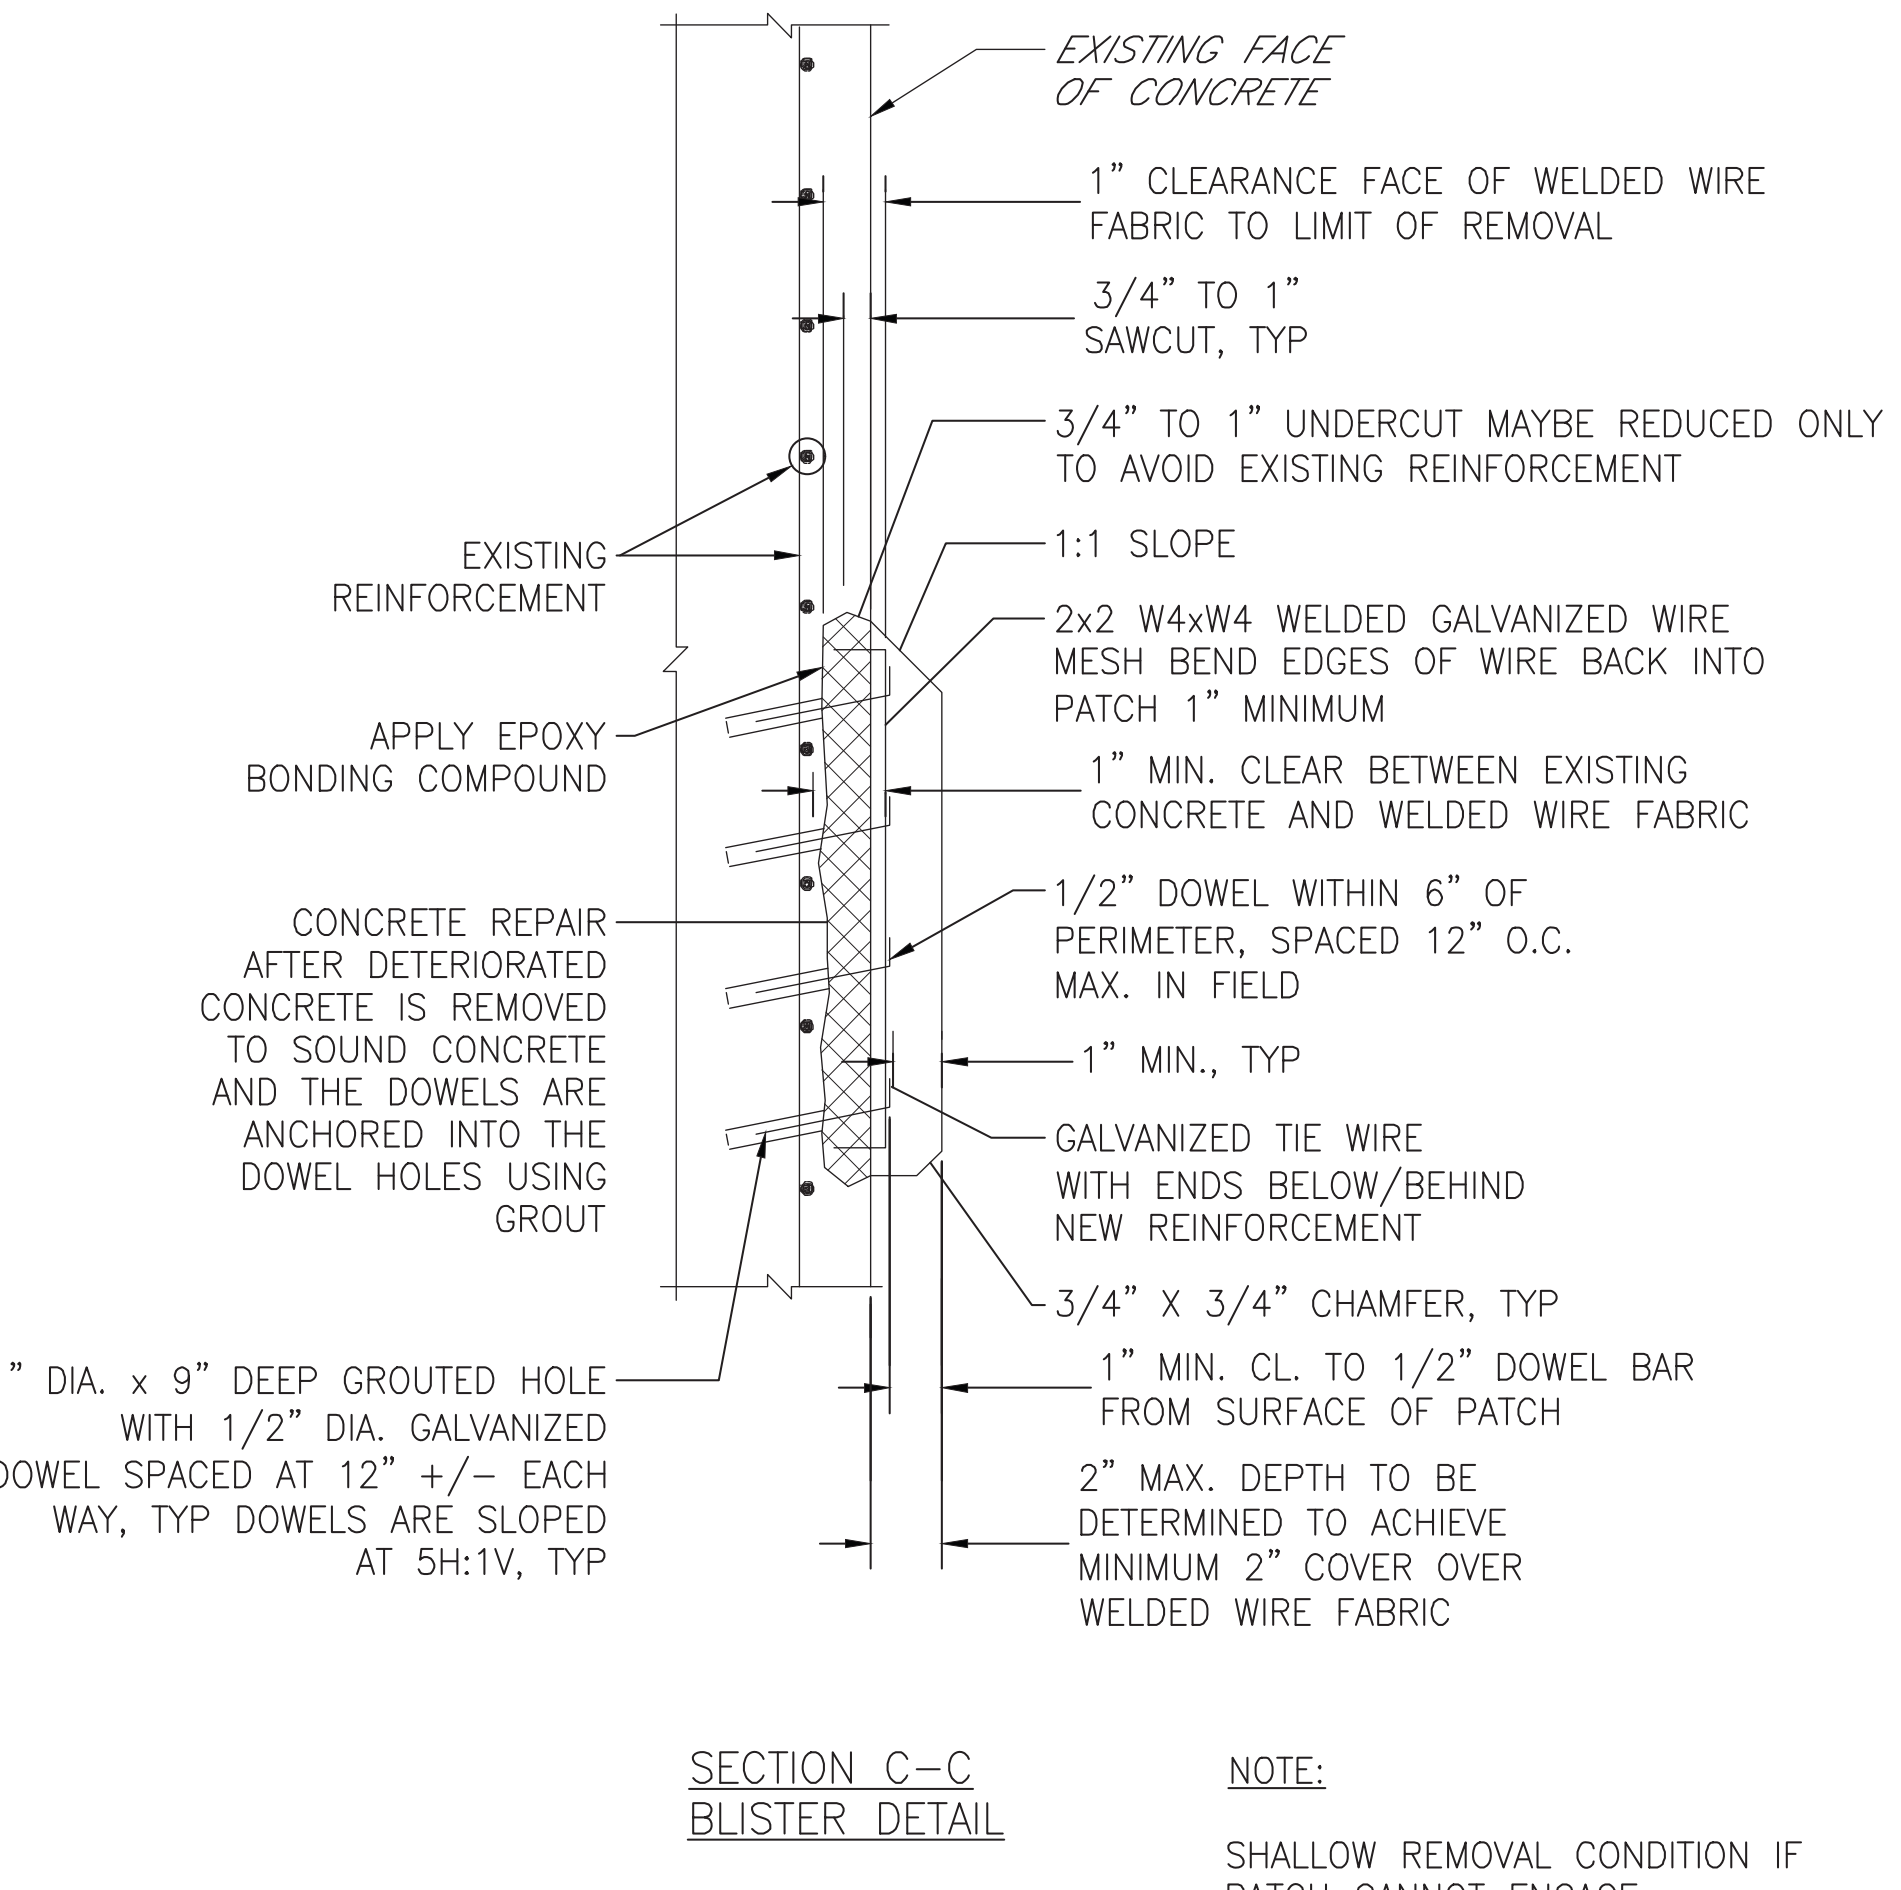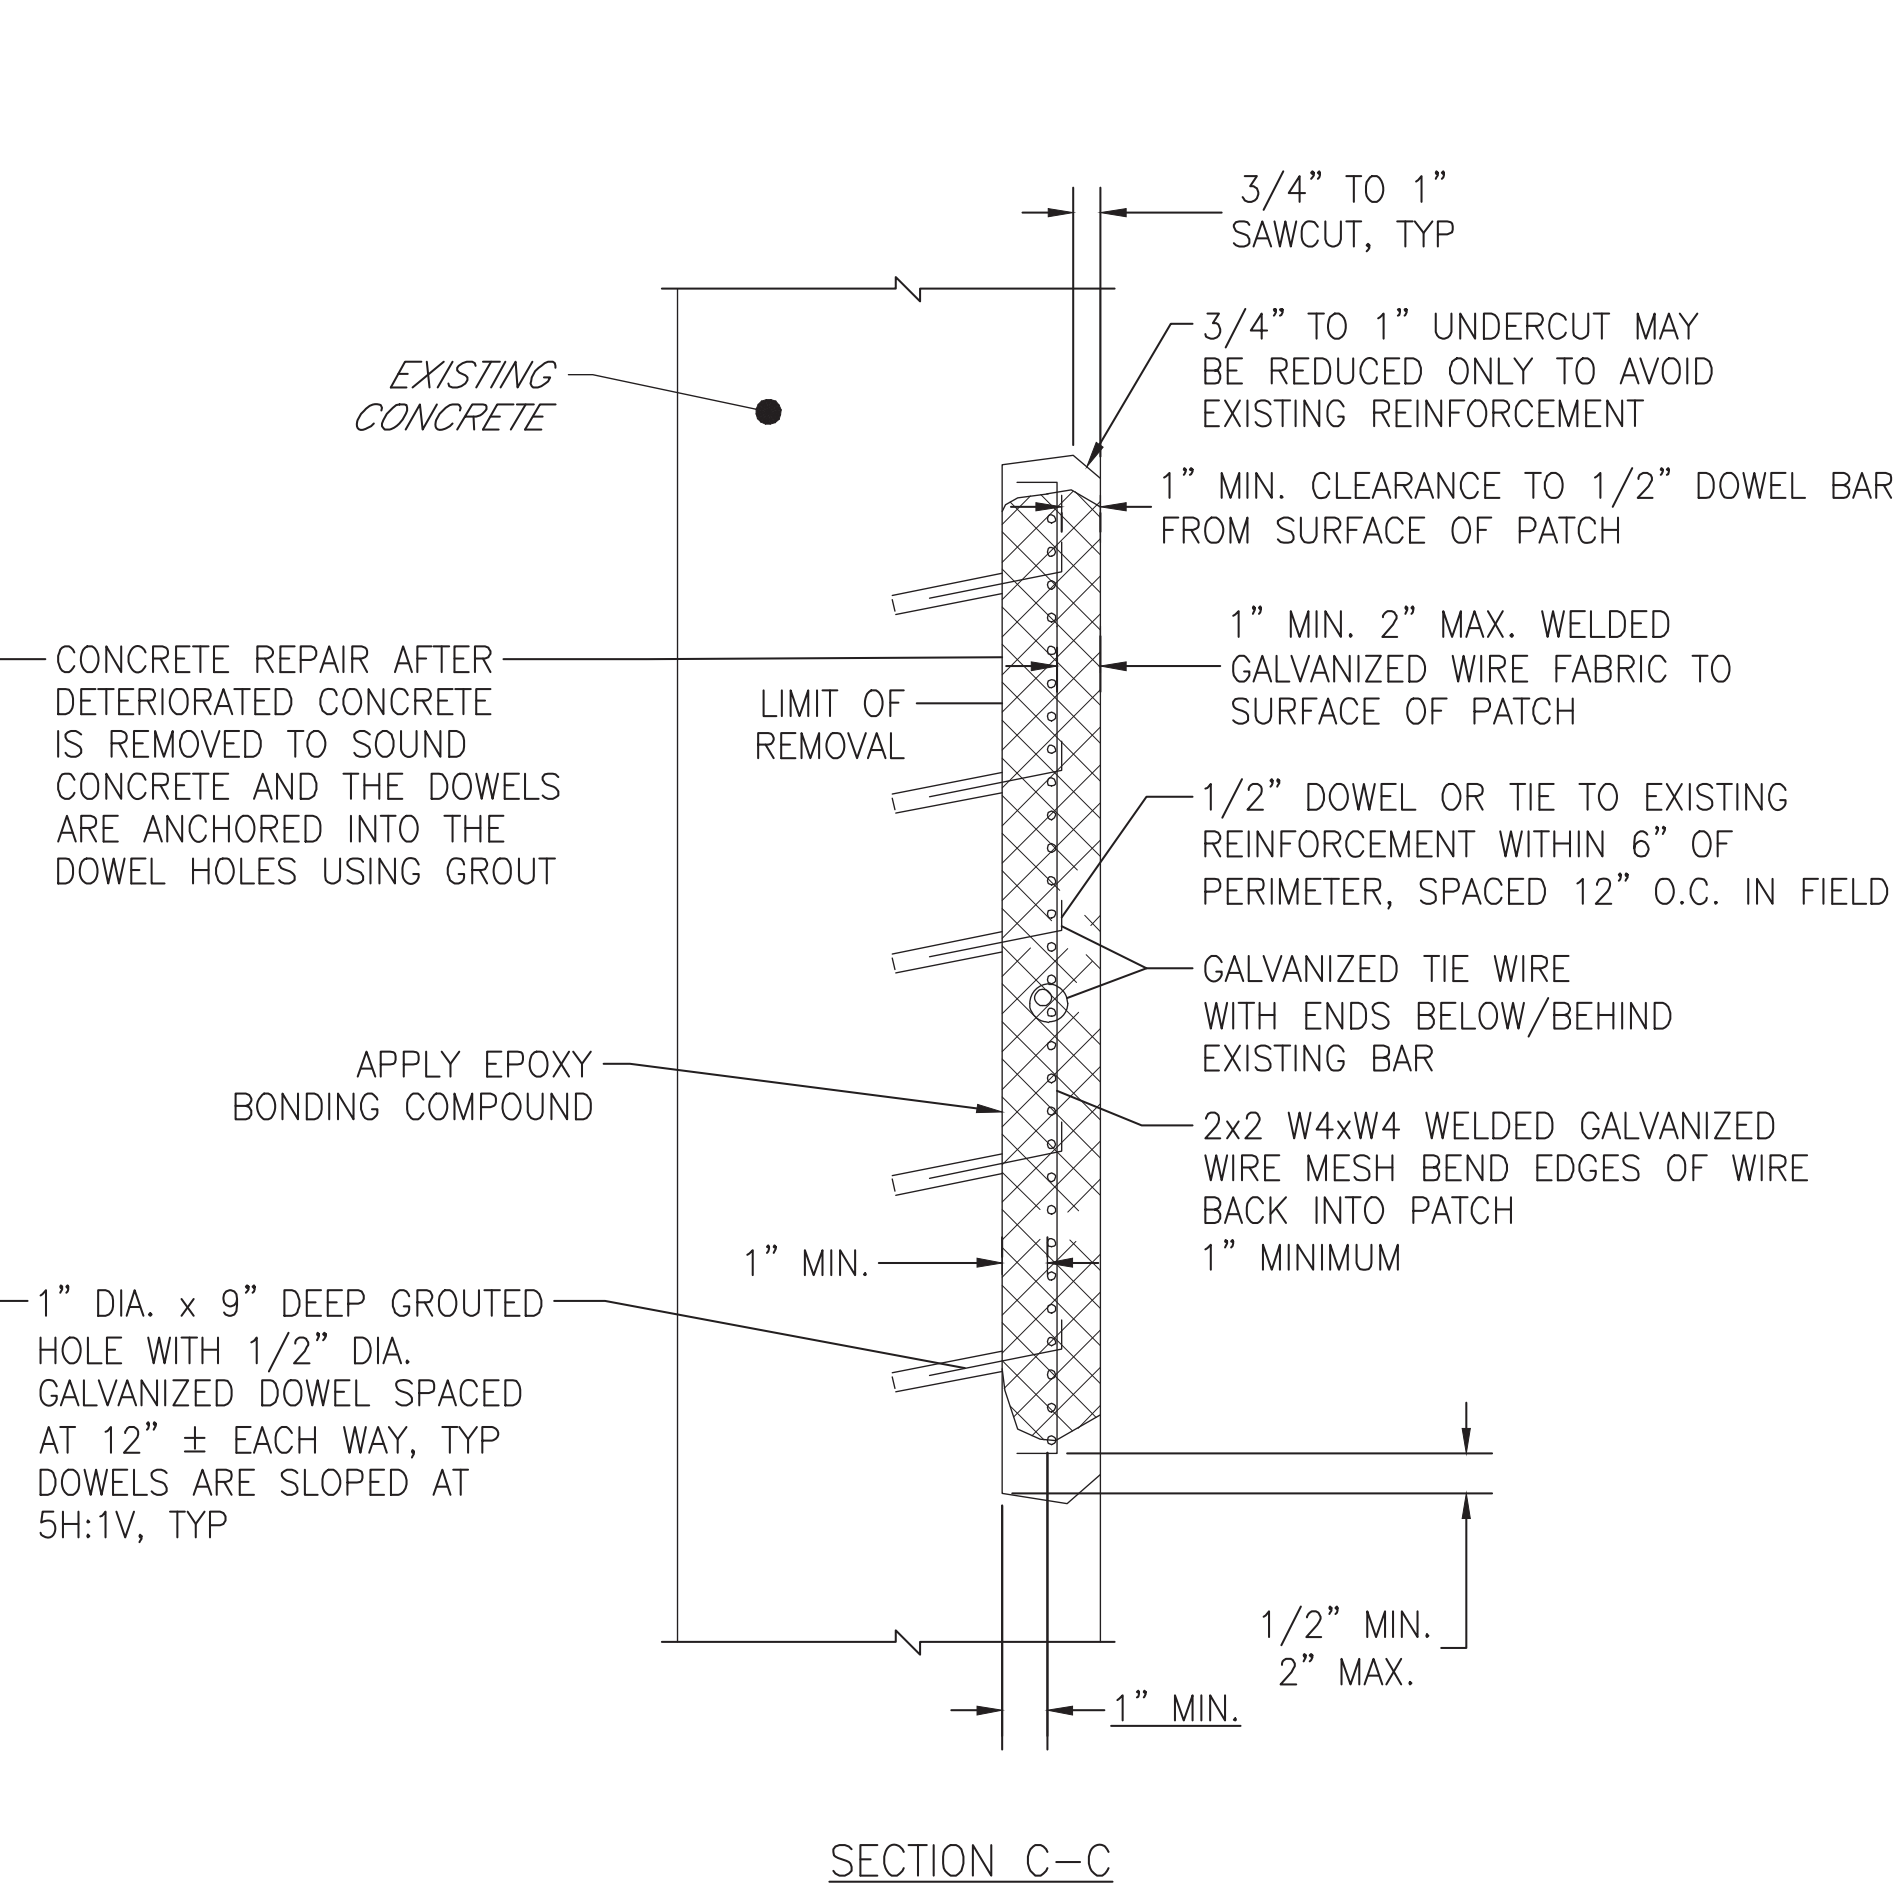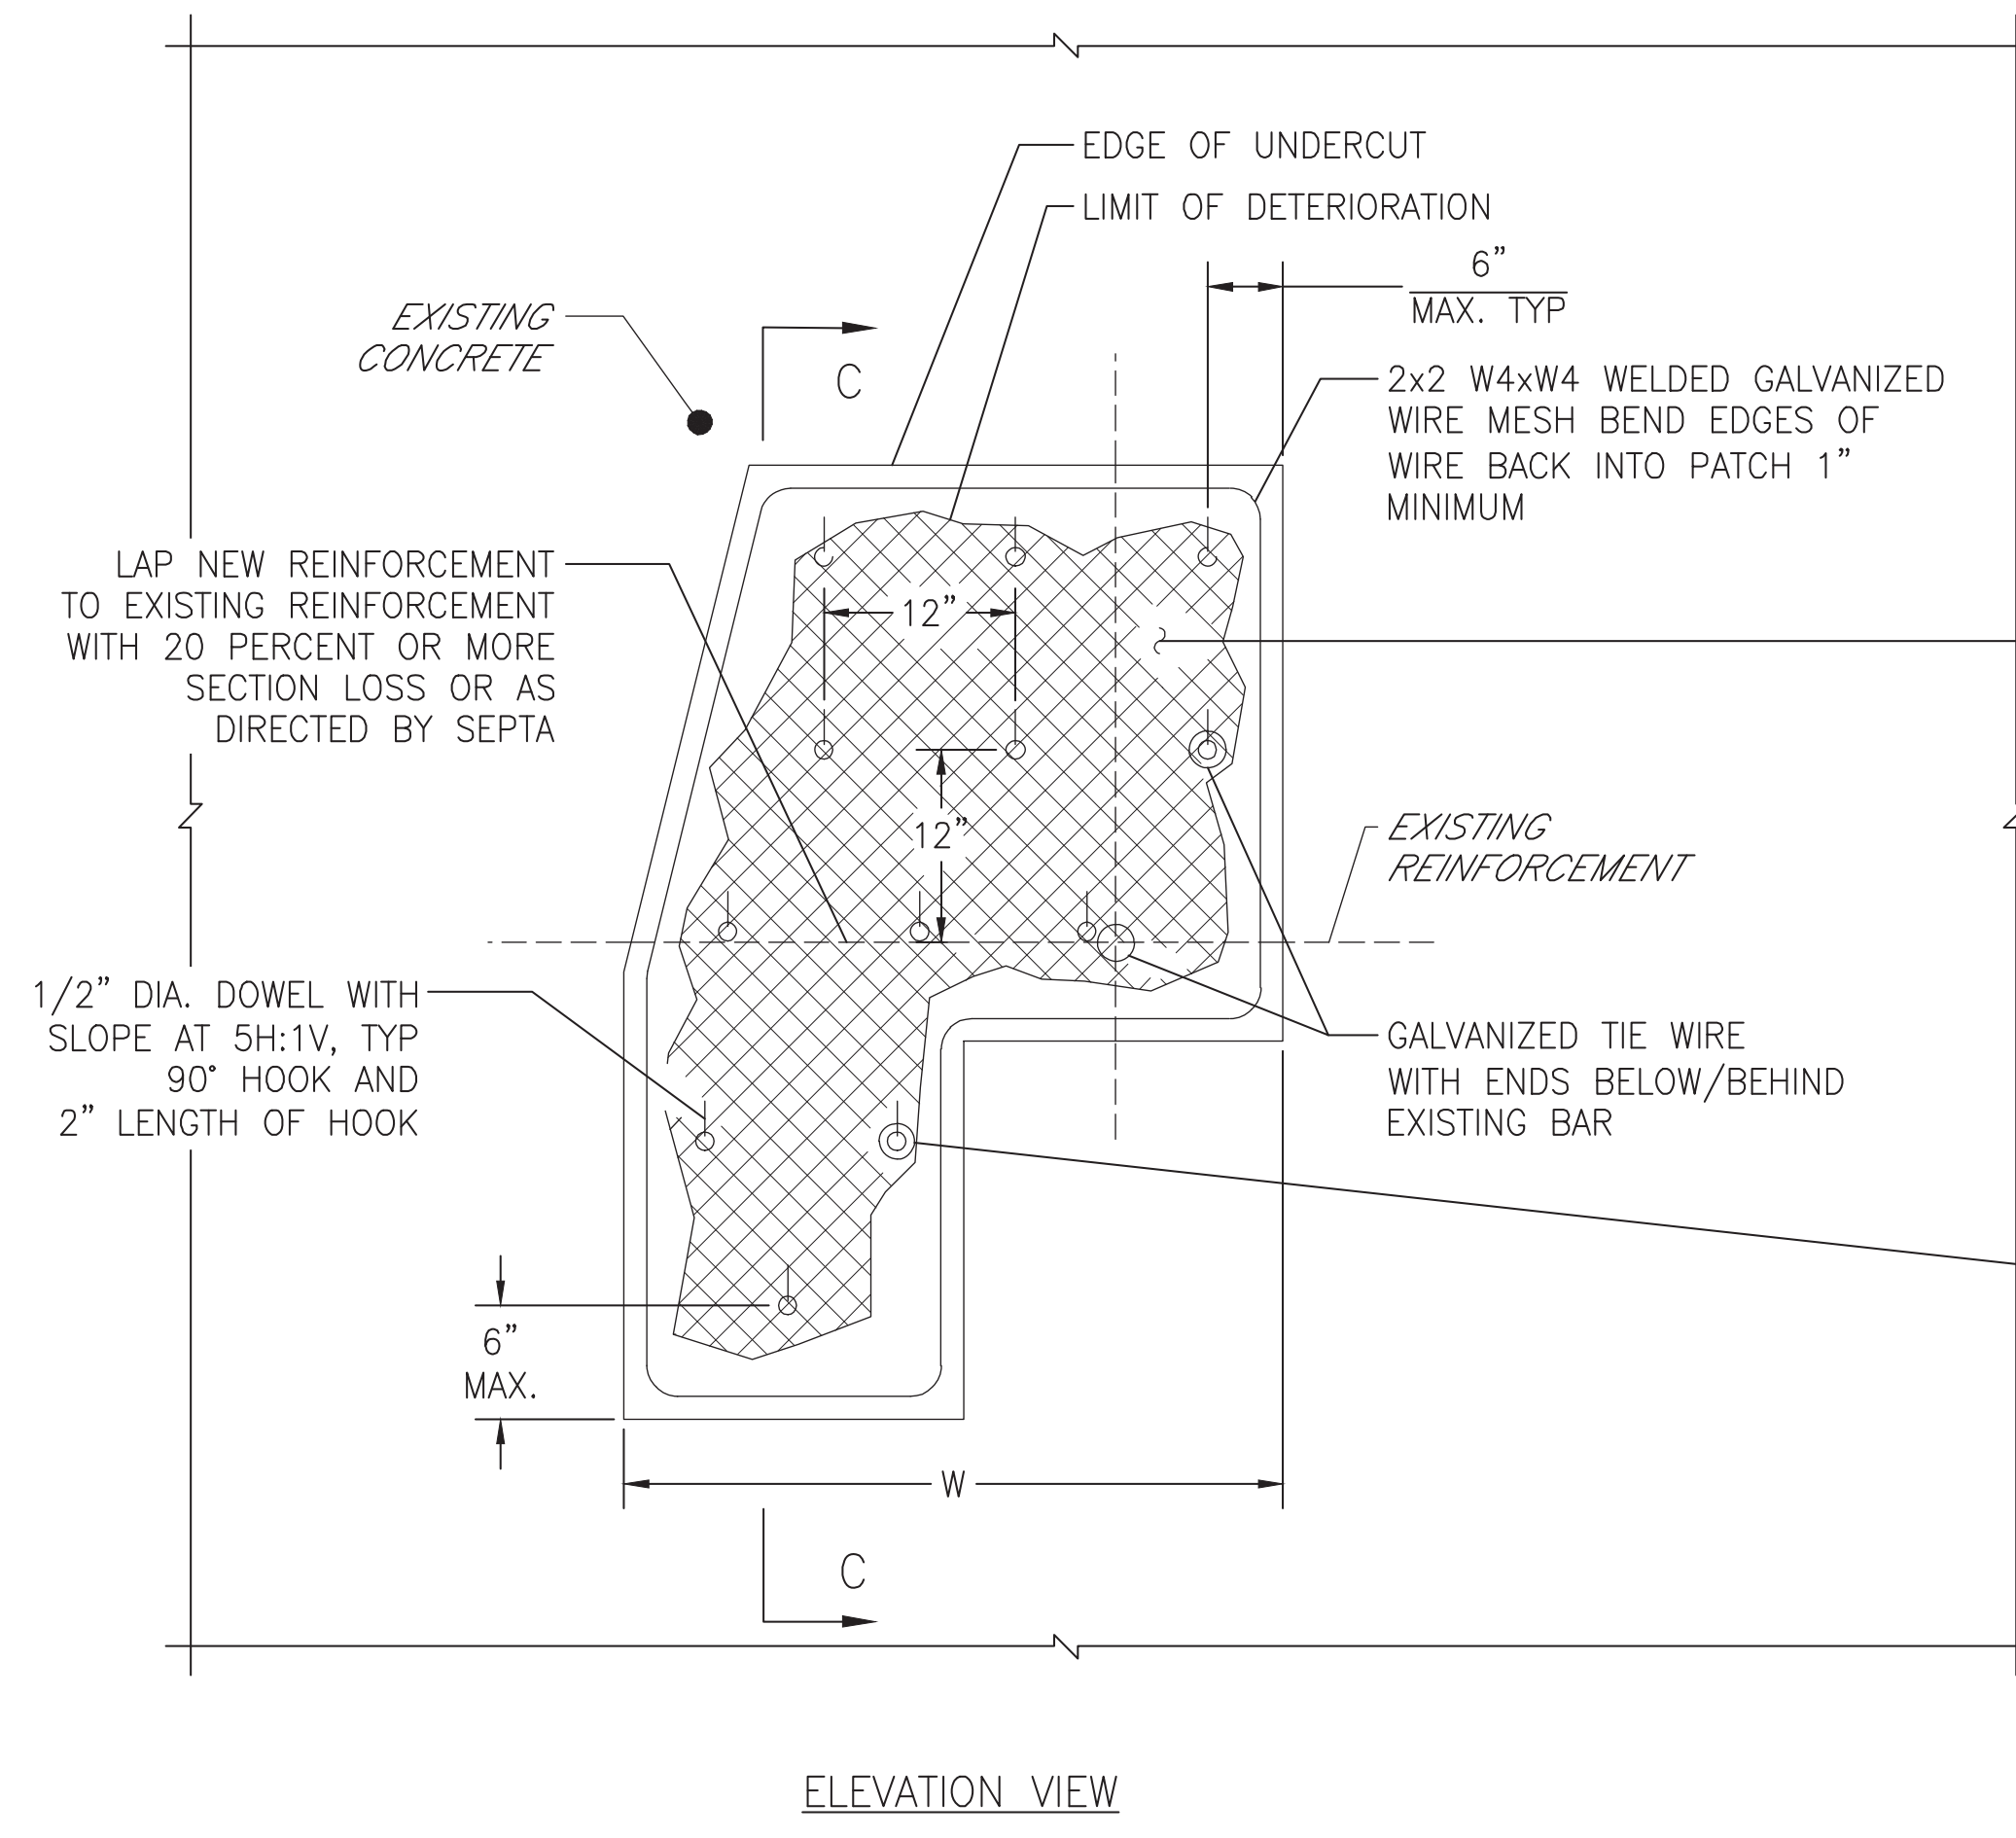

**1 CONCRETE REPAIR TYPE 2A**  
S408 SCALE: N.T.S.

**LEGEND**

- REMOVE DETERIORATED CONCRETE.

**REINFORCED CONCRETE REPAIR TYPE 2A NOTES:**

- REPAIR TYPE 2A IS USED WHEN DEPTH OF DETERIORATION IS GREATER THAN 3/4" AND EXISTING REINFORCEMENT IS SPACED GREATER THAN 12" ON CENTER.
- PROVIDE GALVANIZED WIRE TIE TO CONNECT EXISTING REINFORCEMENT AND GALVANIZED 2x2 W4xW4 WELDED WIRE MESH ALONG THE PERIMETER OF THE REMOVAL AREA AT A MAXIMUM SPACING OF 6" FROM THE EDGE OF THE REMOVAL. PROVIDE TIES AT 12" SPACING IN BOTH HORIZONTAL AND VERTICAL DIRECTIONS ALONG THE PERIMETER AND WITHIN THE AREA OF REMOVAL. IF EXISTING REINFORCEMENT IS SPACED AT GREATER THAN 12" SPACING OR NOT LOCATED TO PROVIDE TIE LOCATIONS AS LISTED ABOVE, PROVIDE 1/2" GROUTED DOWELS AS SHOWN ON THE DRAWING TO PROVIDE THE LOCATIONS AT THE SAME SPACINGS.
- USE ONLY AN APPROVED POLYMER MODIFIED AND SPECIAL CEMENTS, MORTARS AND CONCRETES AS LISTED IN THE SPECIFICATIONS.
- SQUARE OF DETERIORATED CONCRETE TO SOUND CONCRETE WITH A SAWCUT OF 3/4" MINIMUM TO 1" MAXIMUM BUT NOT TO THE DEPTH OF THE REINFORCEMENT STEEL BACK BEVEL EDGE BEYOND SAWCUT.
- USE HAND TOOLS TO REMOVE ALL LOOSE AND DELAMINATED CONCRETE TO PROVIDE A SOUND BOND BETWEEN EXISTING CONCRETE AND NEW CONCRETE. PNEUMATIC HAMMER WITH IMPACT RATINGS OF 3 FT-LBS OR LESS MAY BE USED IF REQUIRED.
- IF DETERIORATED CONCRETE EXTENDS BEYOND THE PRIMARY REINFORCEMENT, REMOVE THE CONCRETE TO AT LEAST 1" BEHIND THE REINFORCEMENT.
- APPLY AN EPOXY BONDING COMPOUND BETWEEN THE EXISTING AND THE NEW 4000 PSI CONCRETE.
- "W" REPRESENTS LEAST DIMENSION OF DETERIORATED CONCRETE.
- USE DOWELS ONLY WHEN "W" DIMENSION OF DETERIORATED CONCRETE IS GREATER THAN 2'-0" AND NEW OR EXISTING REINFORCEMENT CANNOT ADEQUATELY BE DEVELOPED BY LAPPING WITH EXISTING REINFORCEMENT.
- USE A PACHOMETER TO LOCATE EXISTING REINFORCEMENT WHEN DRILLING DOWEL HOLES TO AVOID DRILLING THRU EXISTING BARS.
- AN APPROVED EPOXY ANCHORING SYSTEM IN 90° HOLES MAY REPLACE GROUT IN SLOPED HOLES. USE A 6" MINIMUM EMBEDMENT AND IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
- A #4 DEFORMED GALVANIZED REINFORCEMENT BENT "L" BAR MAY REPLACE THE 1/2" DIAMETER DOWEL HOOK.
- ALTERNATIVE WIRE MESH MAY BE SUBSTITUTED FOR 2x2-W4xW4, PROVIDED WIRE SPACING DOES NOT EXCEED 4", AND AN EQUIVALENT STEEL AREA IS PROVIDED. NEW REINFORCEMENT BARS MAY BE OMITTED IF WIRE MESH STEEL EXCEEDS EXISTING REINFORCEMENT.
- CLEAN EXISTING REINFORCEMENT BY MECHANICAL MEANS AND APPLY EPOXY COATING.
- LAP EQUIVALENT NEW REINFORCEMENT TO THE EXISTING REINFORCEMENT AS DIRECTED.
- EXISTING AND NEW REINFORCEMENT BARS AND WELDED WIRE MESH TO BE GALVANIZED.

NOTES:  
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.

WORK ON THIS DRAWING:  
• CONCRETE REPAIRS.

C:\PIWORKING\PTTD\689125\17AN-S408.DWG

DATE PRINTED: 10/19/2025

STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD



**CASTOR**  
ROUTE 69 TROLLEY LINE  
**REHABILITATION**  
**STRUCTURAL**  
CONCRETE REPAIR DETAILS - SHEET 3

SCALE:	AS NOTED	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	JSB
WORK ORDER NO.:	276496	CHECKED BY:	JVA
SHEET NUMBER:	<b>S409</b>		
DWG. NO.:	10	OF	14
SHT. NO.:	401	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-S409	REV. NO.:	-

STATUS: 50% SUBMISSION

DATE PRINTED: 10/19/2025

(FOR VERTICAL SURFACES)

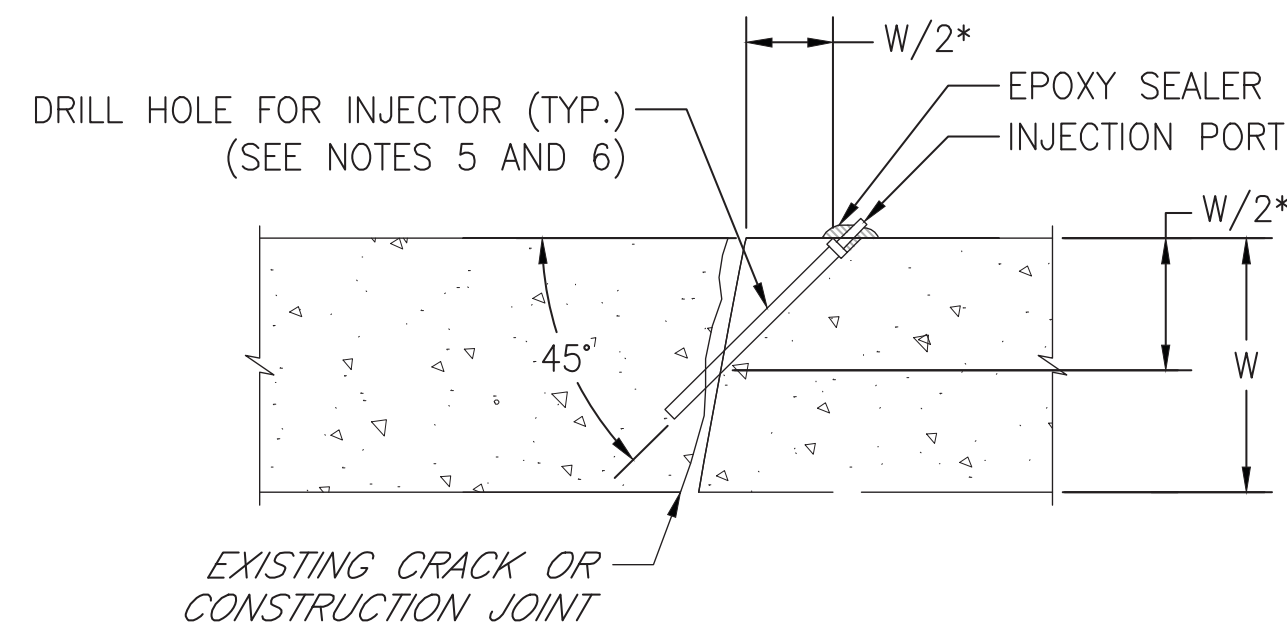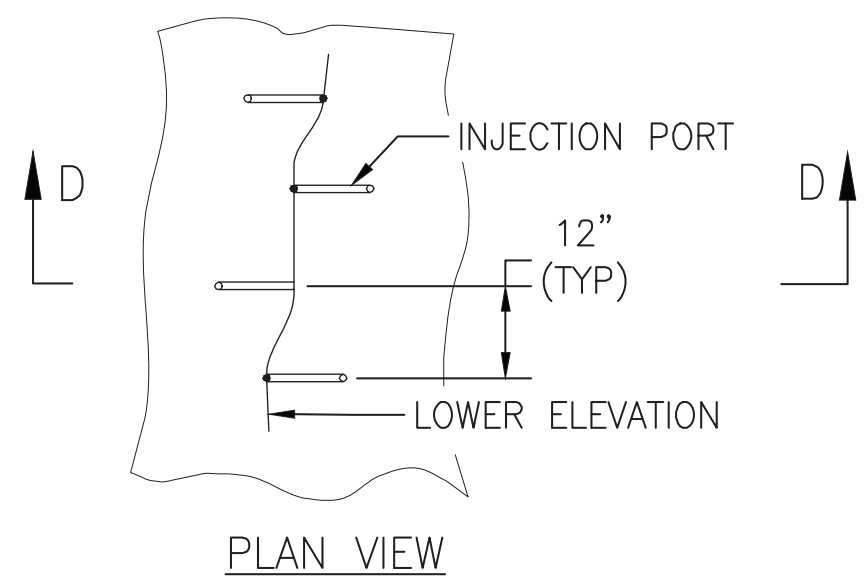


SECTION D-D

1 TYPE 3 CRACK INJECTION REPAIR DETAIL  
S409 SCALE: N.T.S.


CRACK INJECTION REPAIR NOTES:

1. IN THE PRESENCE OF THE SEPTA PROJECT MANAGER, INSPECT AND DOCUMENT CONCRETE SURFACES FOR EXTENT, TYPE AND LOCATION OF CONCRETE CRACK REPAIRS.
2. THIS DETAIL APPLIES AT ALL VISIBLE ACTIVE (I.E. SHOWING EVIDENCE OF SEEPAGE OR LEAKAGE) AND INACTIVE CRACKS IN OVERHEAD SLABS AND VERTICAL WALL SURFACES AND AT ALL ACTIVE CONSTRUCTION JOINTS.
3. DIMENSIONS SHOWN WITH AN ASTERISK (\*) SHALL BE ADJUSTED AS REQUIRED TO PREVENT DAMAGE TO EXISTING REINFORCING BARS.
4. DRILL HOLE SIZE SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
5. INSTALL INJECTION PORTS, SEAL AND PRESSURE INJECT EPOXY RESIN OR HYDROPHILIC POLYURETHANE RESIN AT EACH HOLE LOCATION IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS.
6. REMOVE INJECTION PORTS, SEAL AND FILL HOLE WITH DRYPACK MORTAR AFTER PRESSURE INJECTION WORK IS COMPLETE.
7. PRIOR TO COMMENCEMENT OF WORK, ENGAGE THE MANUFACTURER'S FACTORY-AUTHORIZED TECHNICAL REPRESENTATIVE FOR CONSULTATION ON-SITE PROJECT INSPECTION, AND TECHNICAL TRAINING ON THE FIRST DAY OF THE WORK AND AT THE REQUEST OF THE SEPTA PROJECT MANAGER.
8. REFER TO SPECIFICATION SECTION 03930 "CONCRETE REPAIR" FOR FURTHER INFORMATION.

(FOR CRACKS UP TO 1/8" WIDE, HORIZONTAL SURFACES)

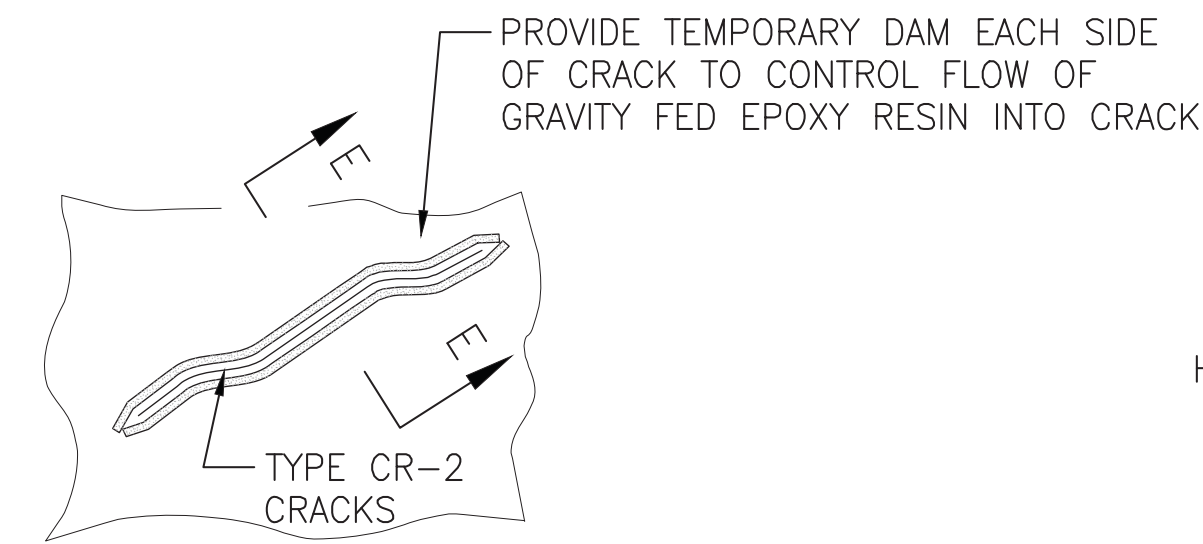


PLAN VIEW

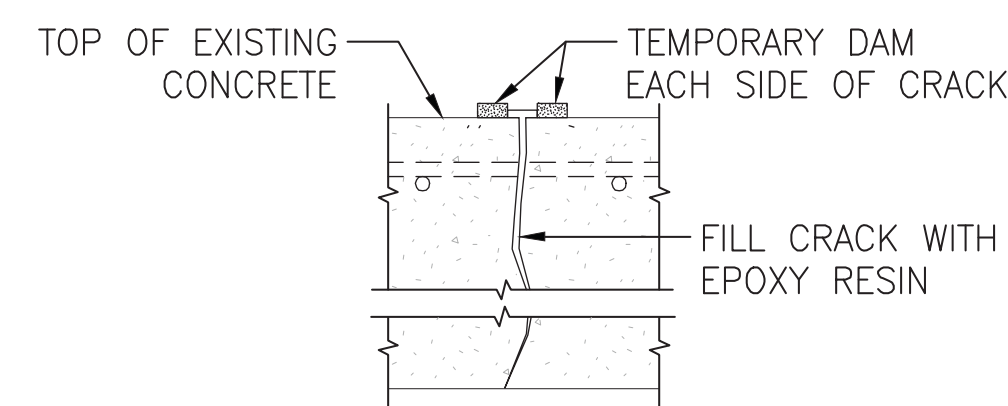


SECTION E-E

2 TYPE 4 GRAVITY CRACK REPAIR DETAIL  
S409 SCALE: N.T.S.

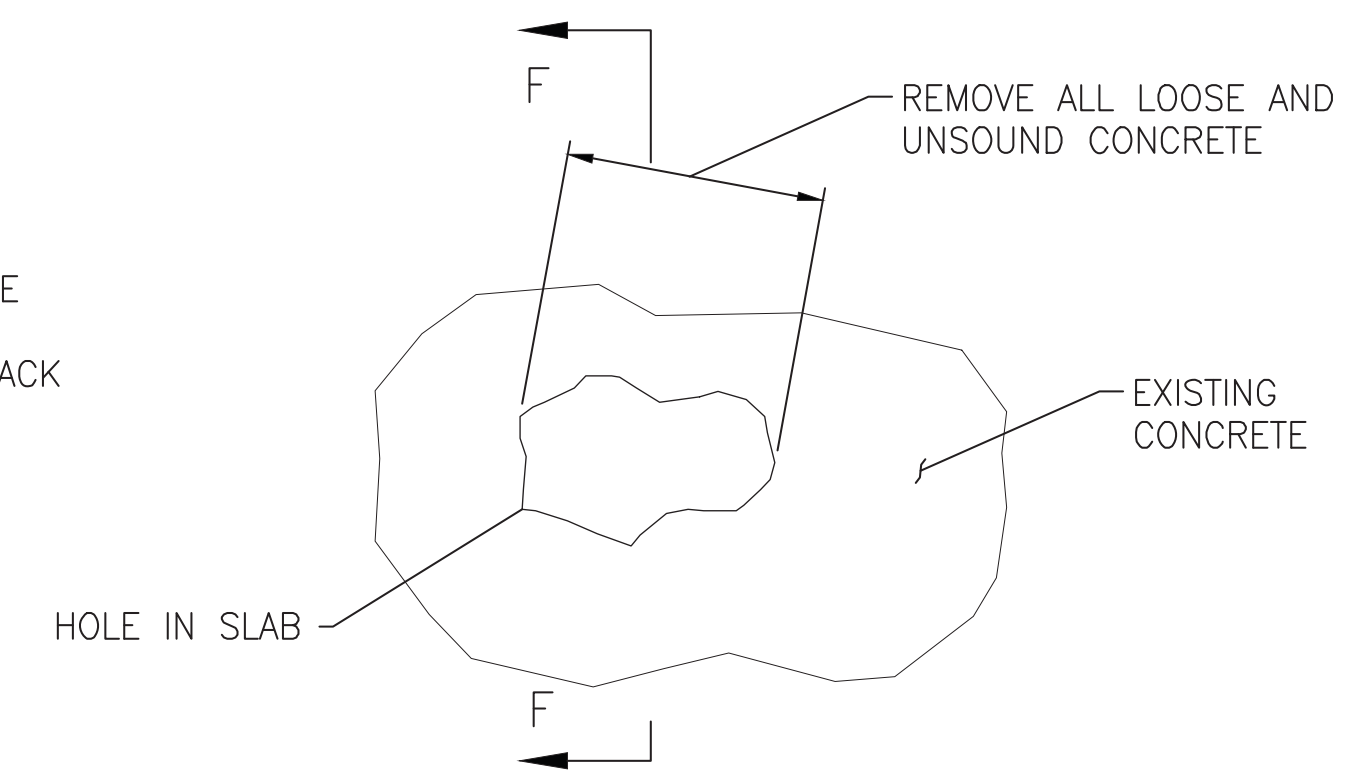

PLAN VIEW

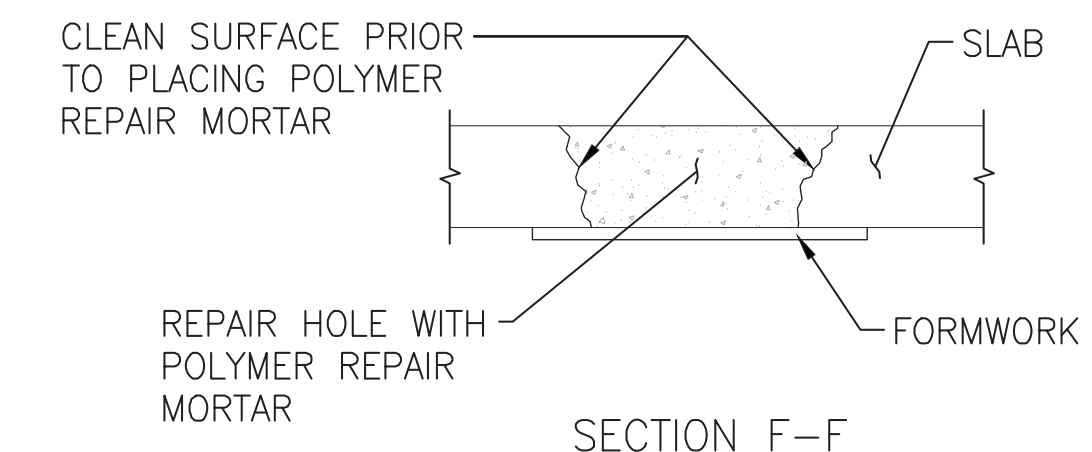


SECTION F-F


3 TYPE 5 CONCRETE HOLE REPAIR DETAIL  
S409 SCALE: N.T.S.

NOTE:

IF THE HOLE EXCEEDS 12" IN ANY DIRECTION DOWEL #5 BARS INTO EXISTING SLAB IN THAT DIRECTION

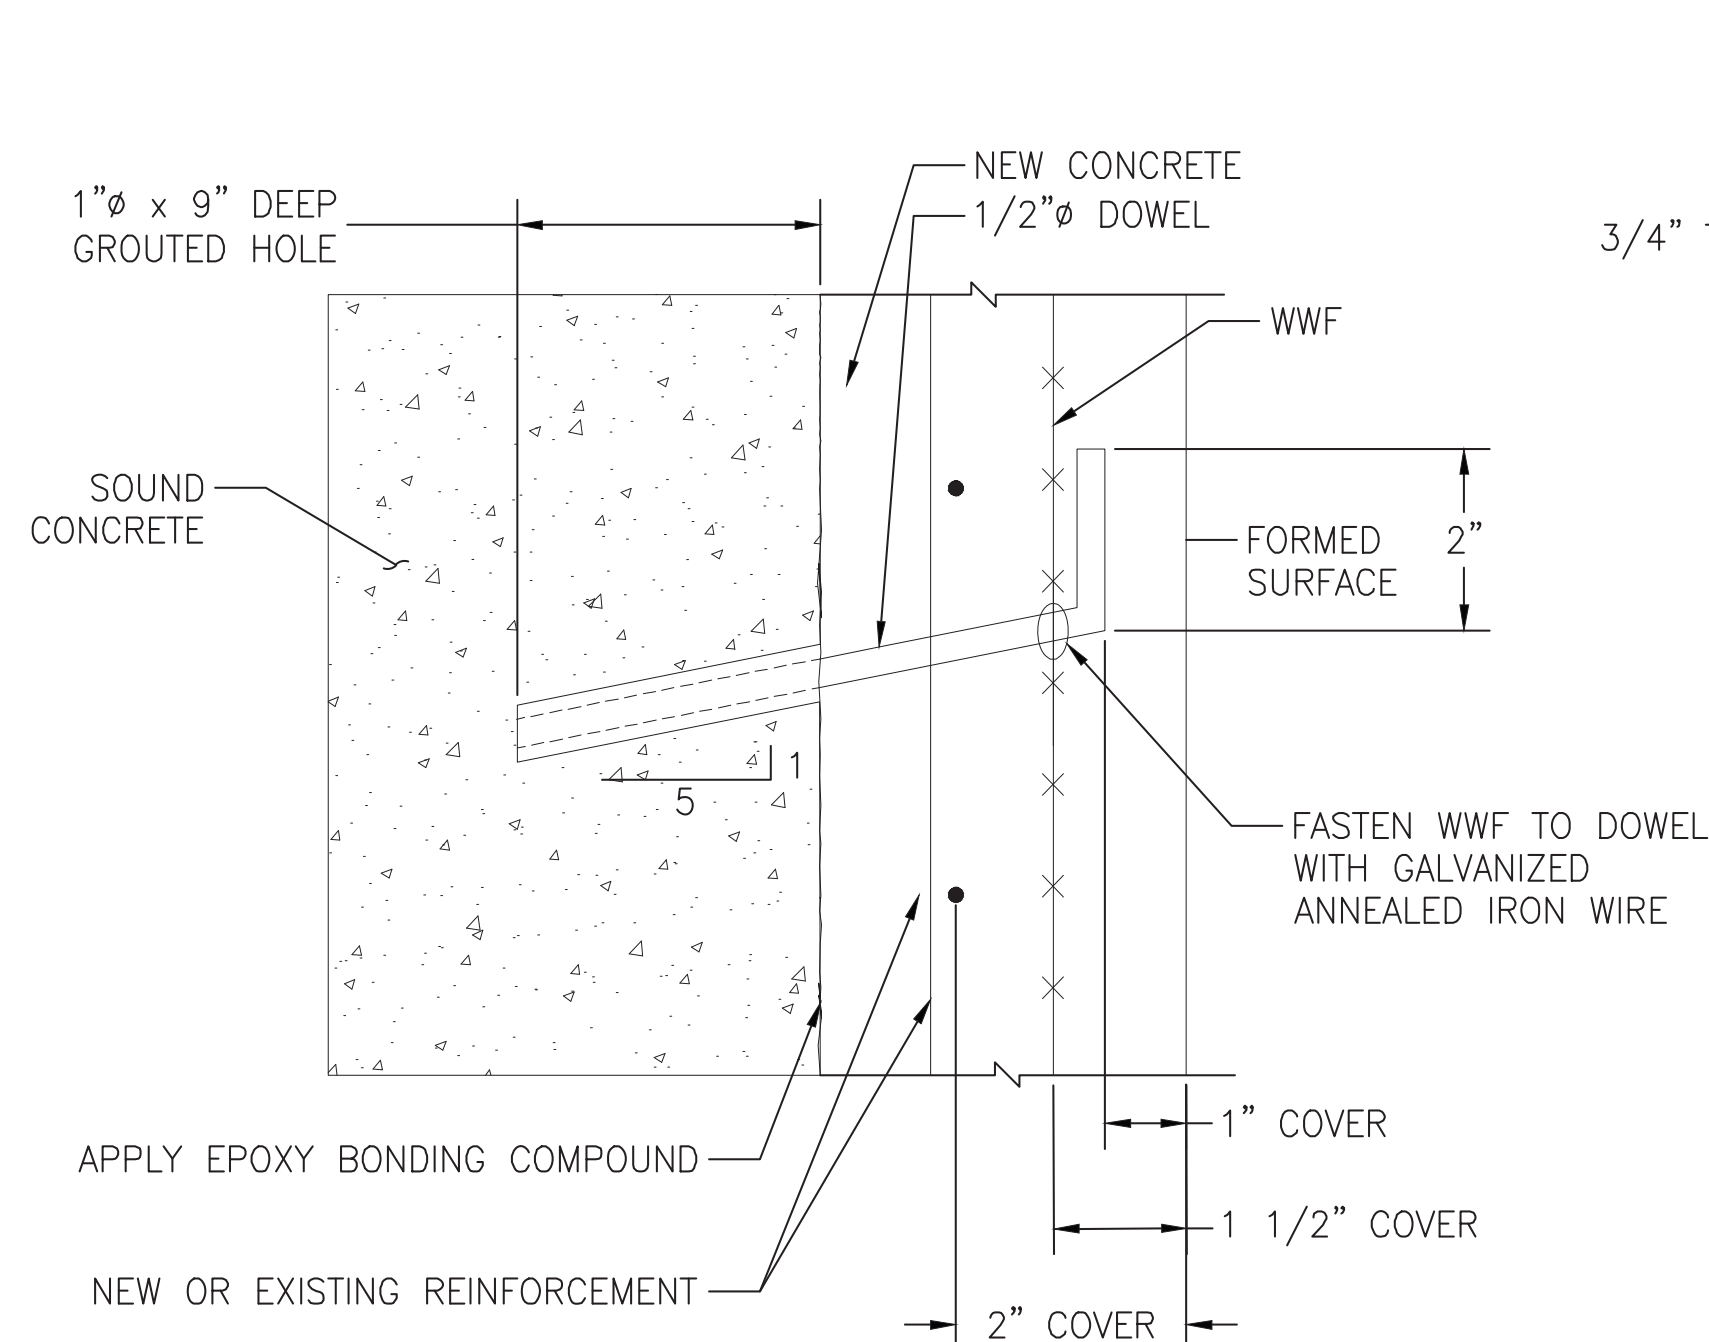

4 TYPICAL DOWEL DETAIL  
S409 SCALE: N.T.S.

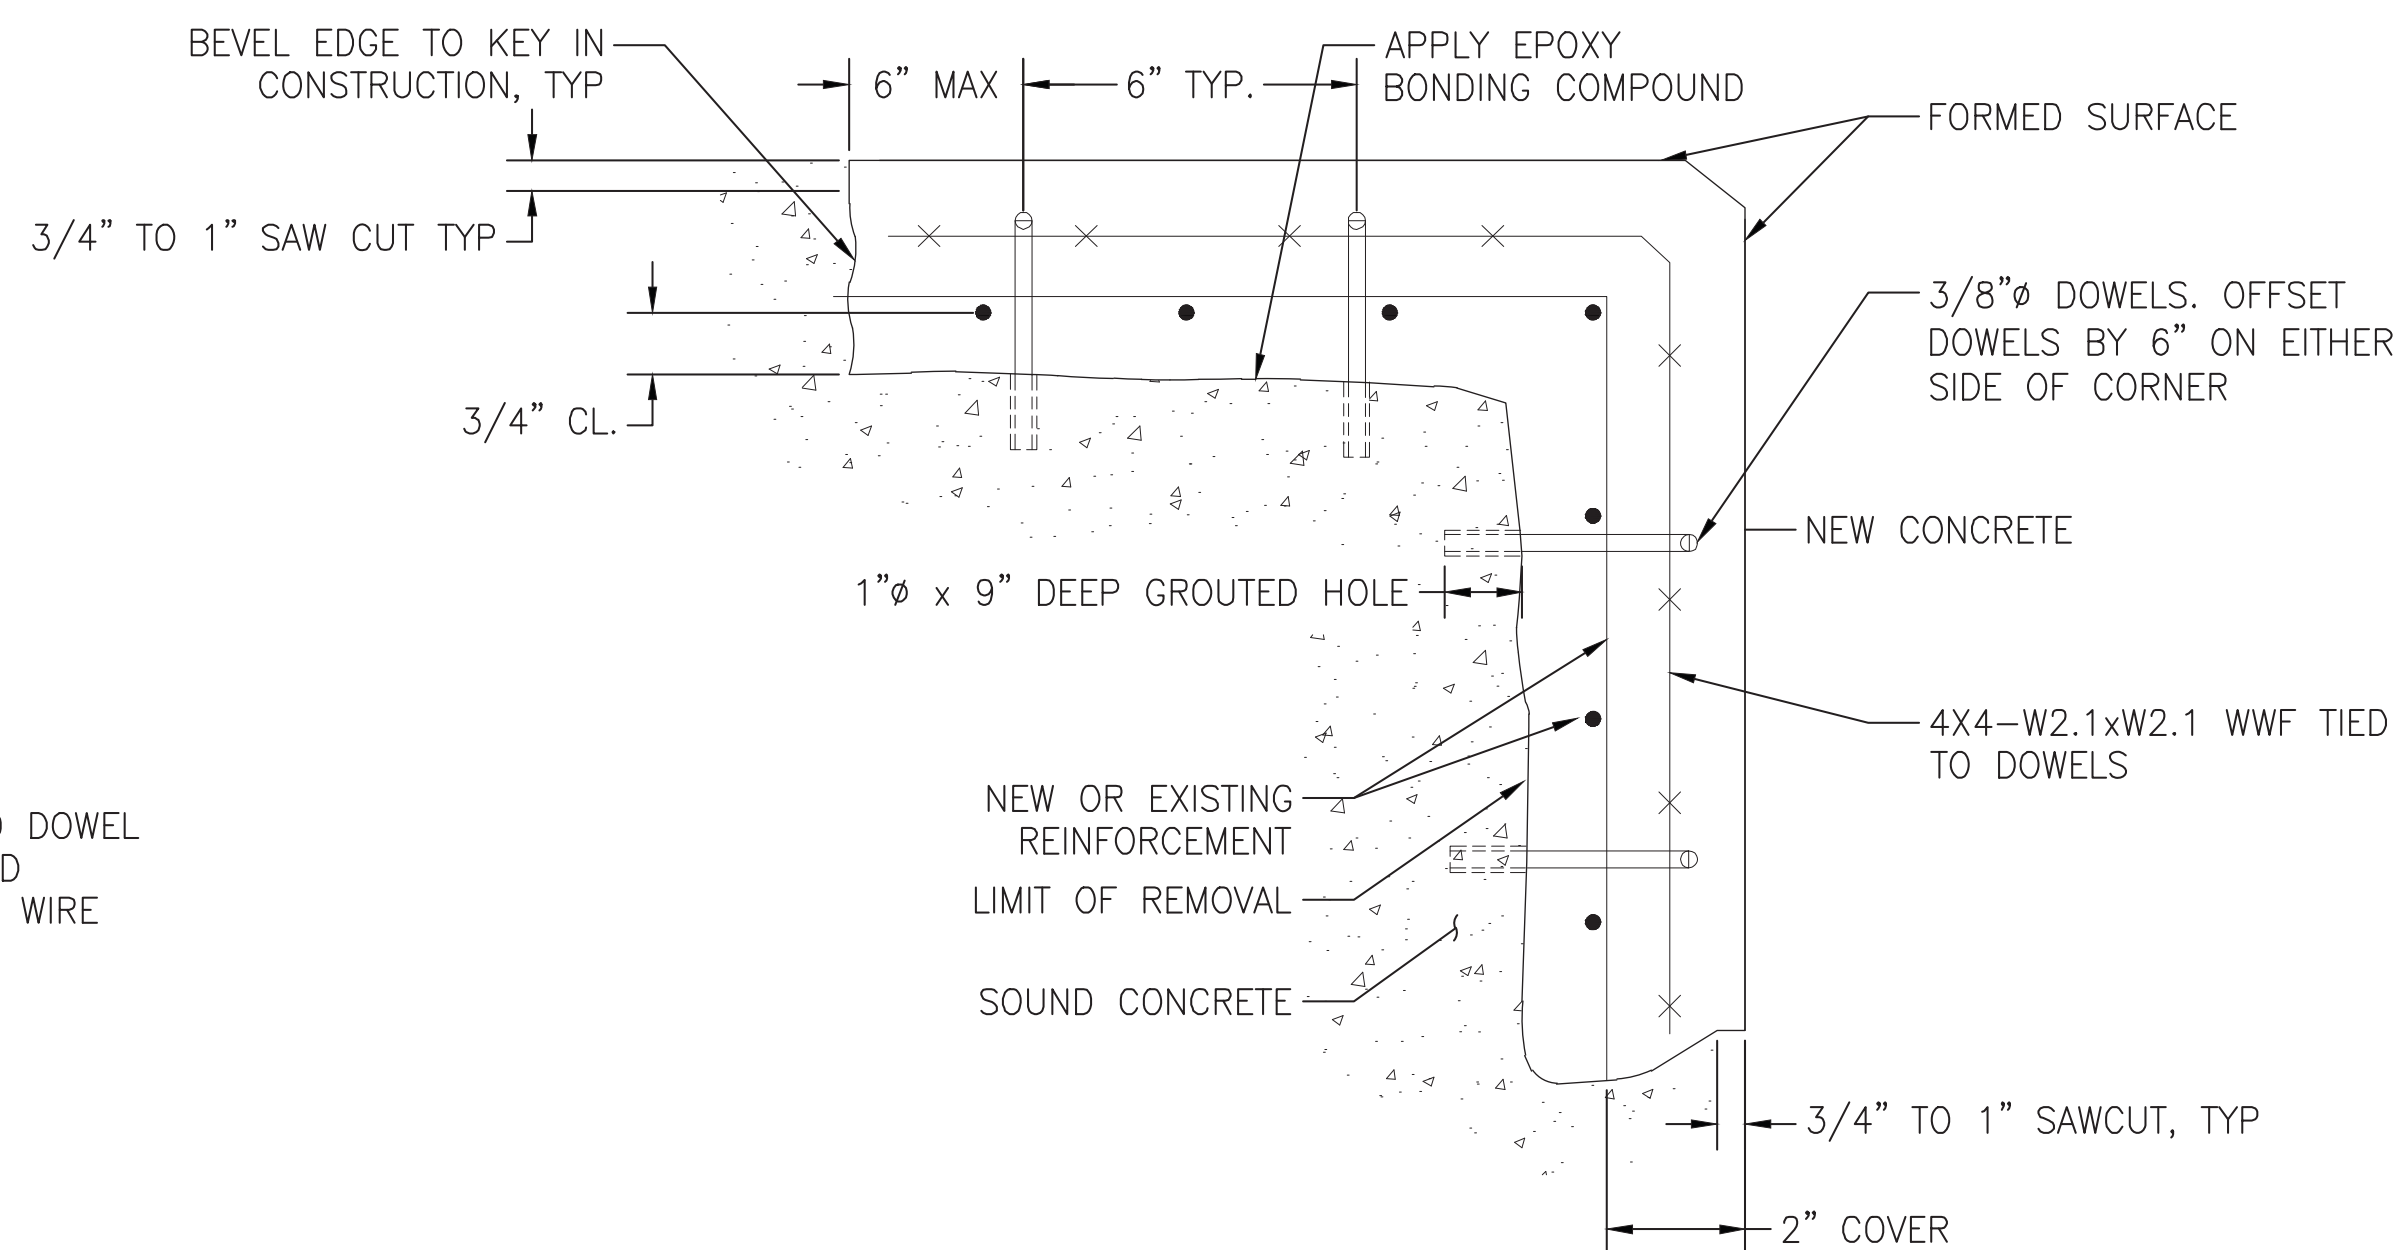


5 TYPICAL CORNER REPAIR DETAIL  
S409 SCALE: N.T.S.

NOTES:

1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.


WORK ON THIS DRAWING:  
• CONCRETE REPAIRS.

50% SUBMISSION  
NOT FOR CONSTRUCTION

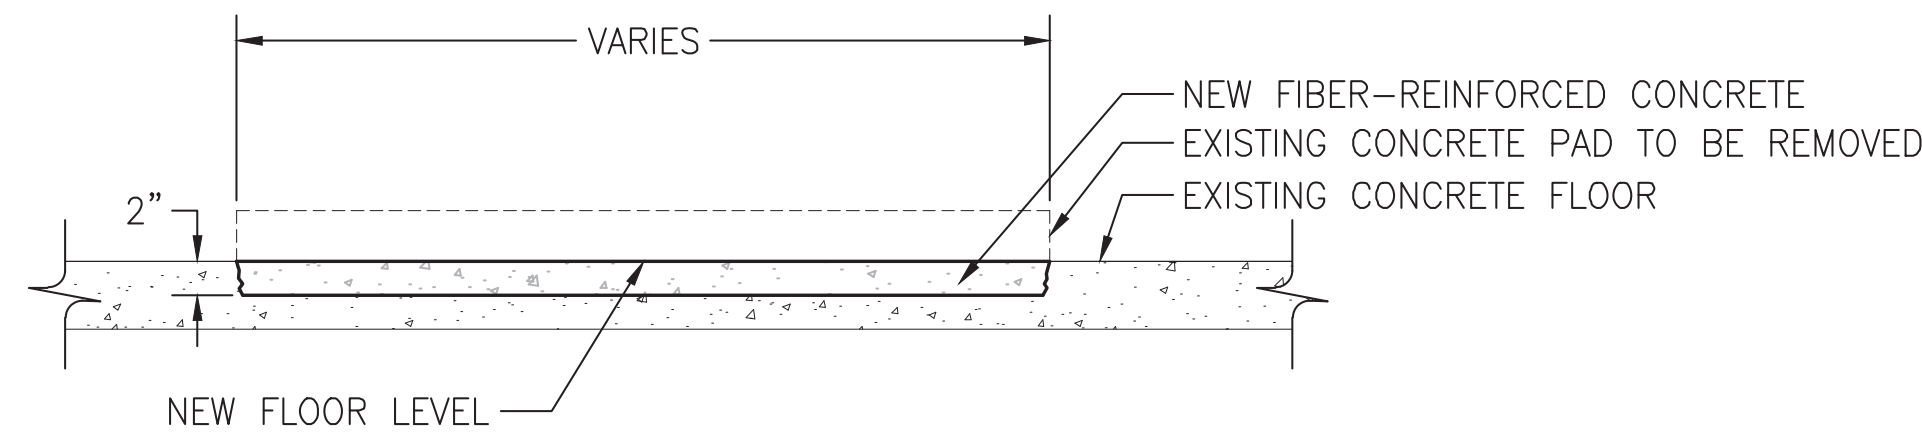


REMOVE EXISTING CONCRETE PAD TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. POUR NEW FIBER REINFORCED CONCRETE TO LEVEL FLOOR.

**1 INTERIOR CONCRETE PAD REMOVAL**  
S410 SCALE: N.T.S.

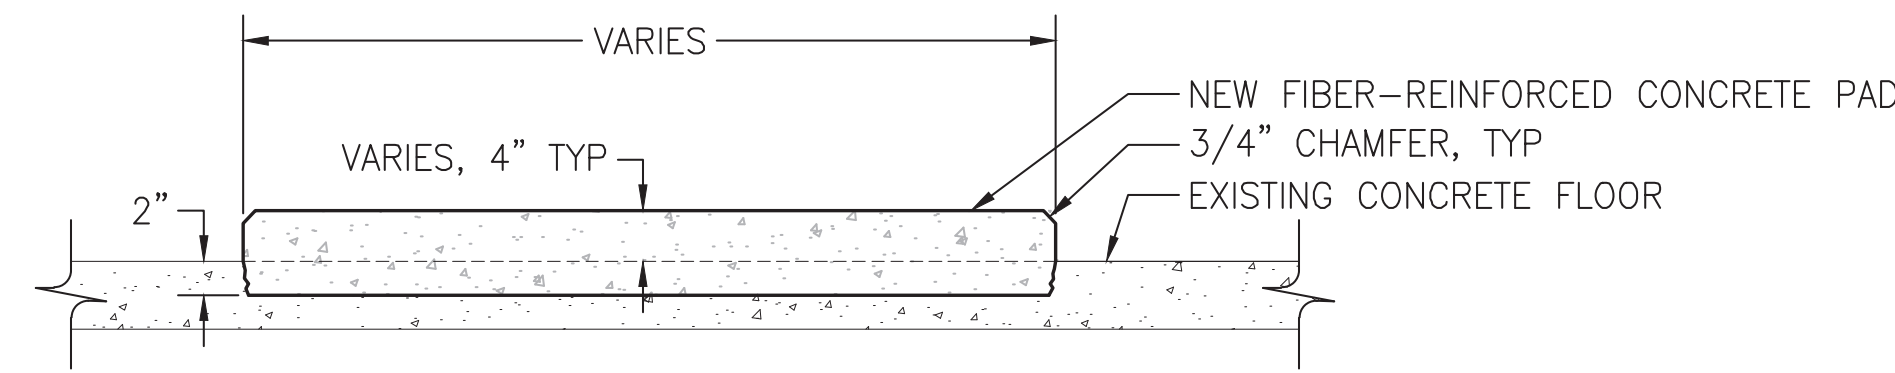


REMOVE EXISTING CONCRETE SLAB TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. SET FORM. POUR NEW FIBER REINFORCED CONCRETE TO NEW PAD LEVEL.

**2 NEW INTERIOR CONCRETE PAD**  
S410 SCALE: N.T.S.

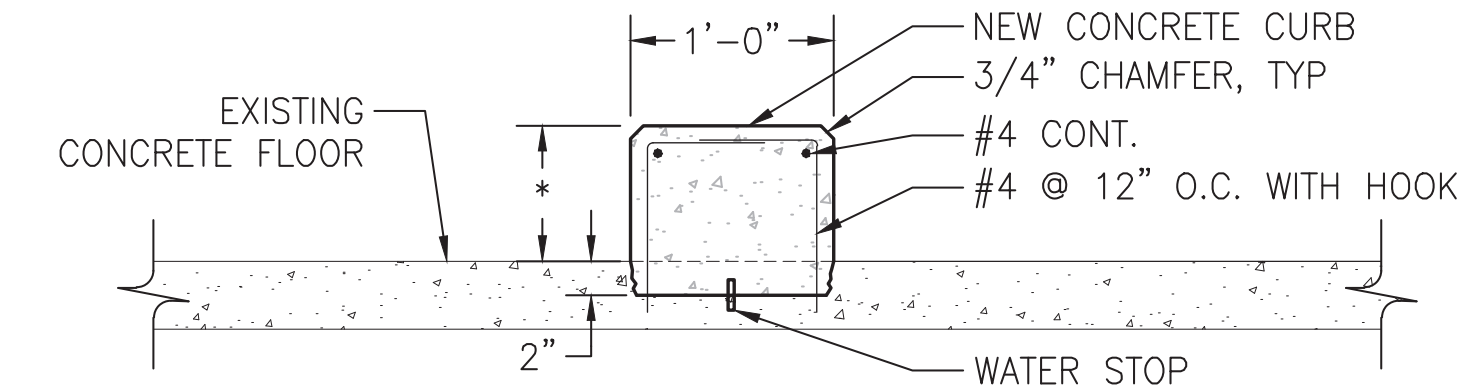

REMOVE EXISTING CONCRETE SLAB TO A POINT 2" BELOW ADJACENT FLOOR. CLEAN AND PREPARE CONCRETE. SET FORM. POUR NEW CONCRETE CURB.

**3 NEW INTERIOR CONCRETE CURB**  
S410 SCALE: N.T.S.

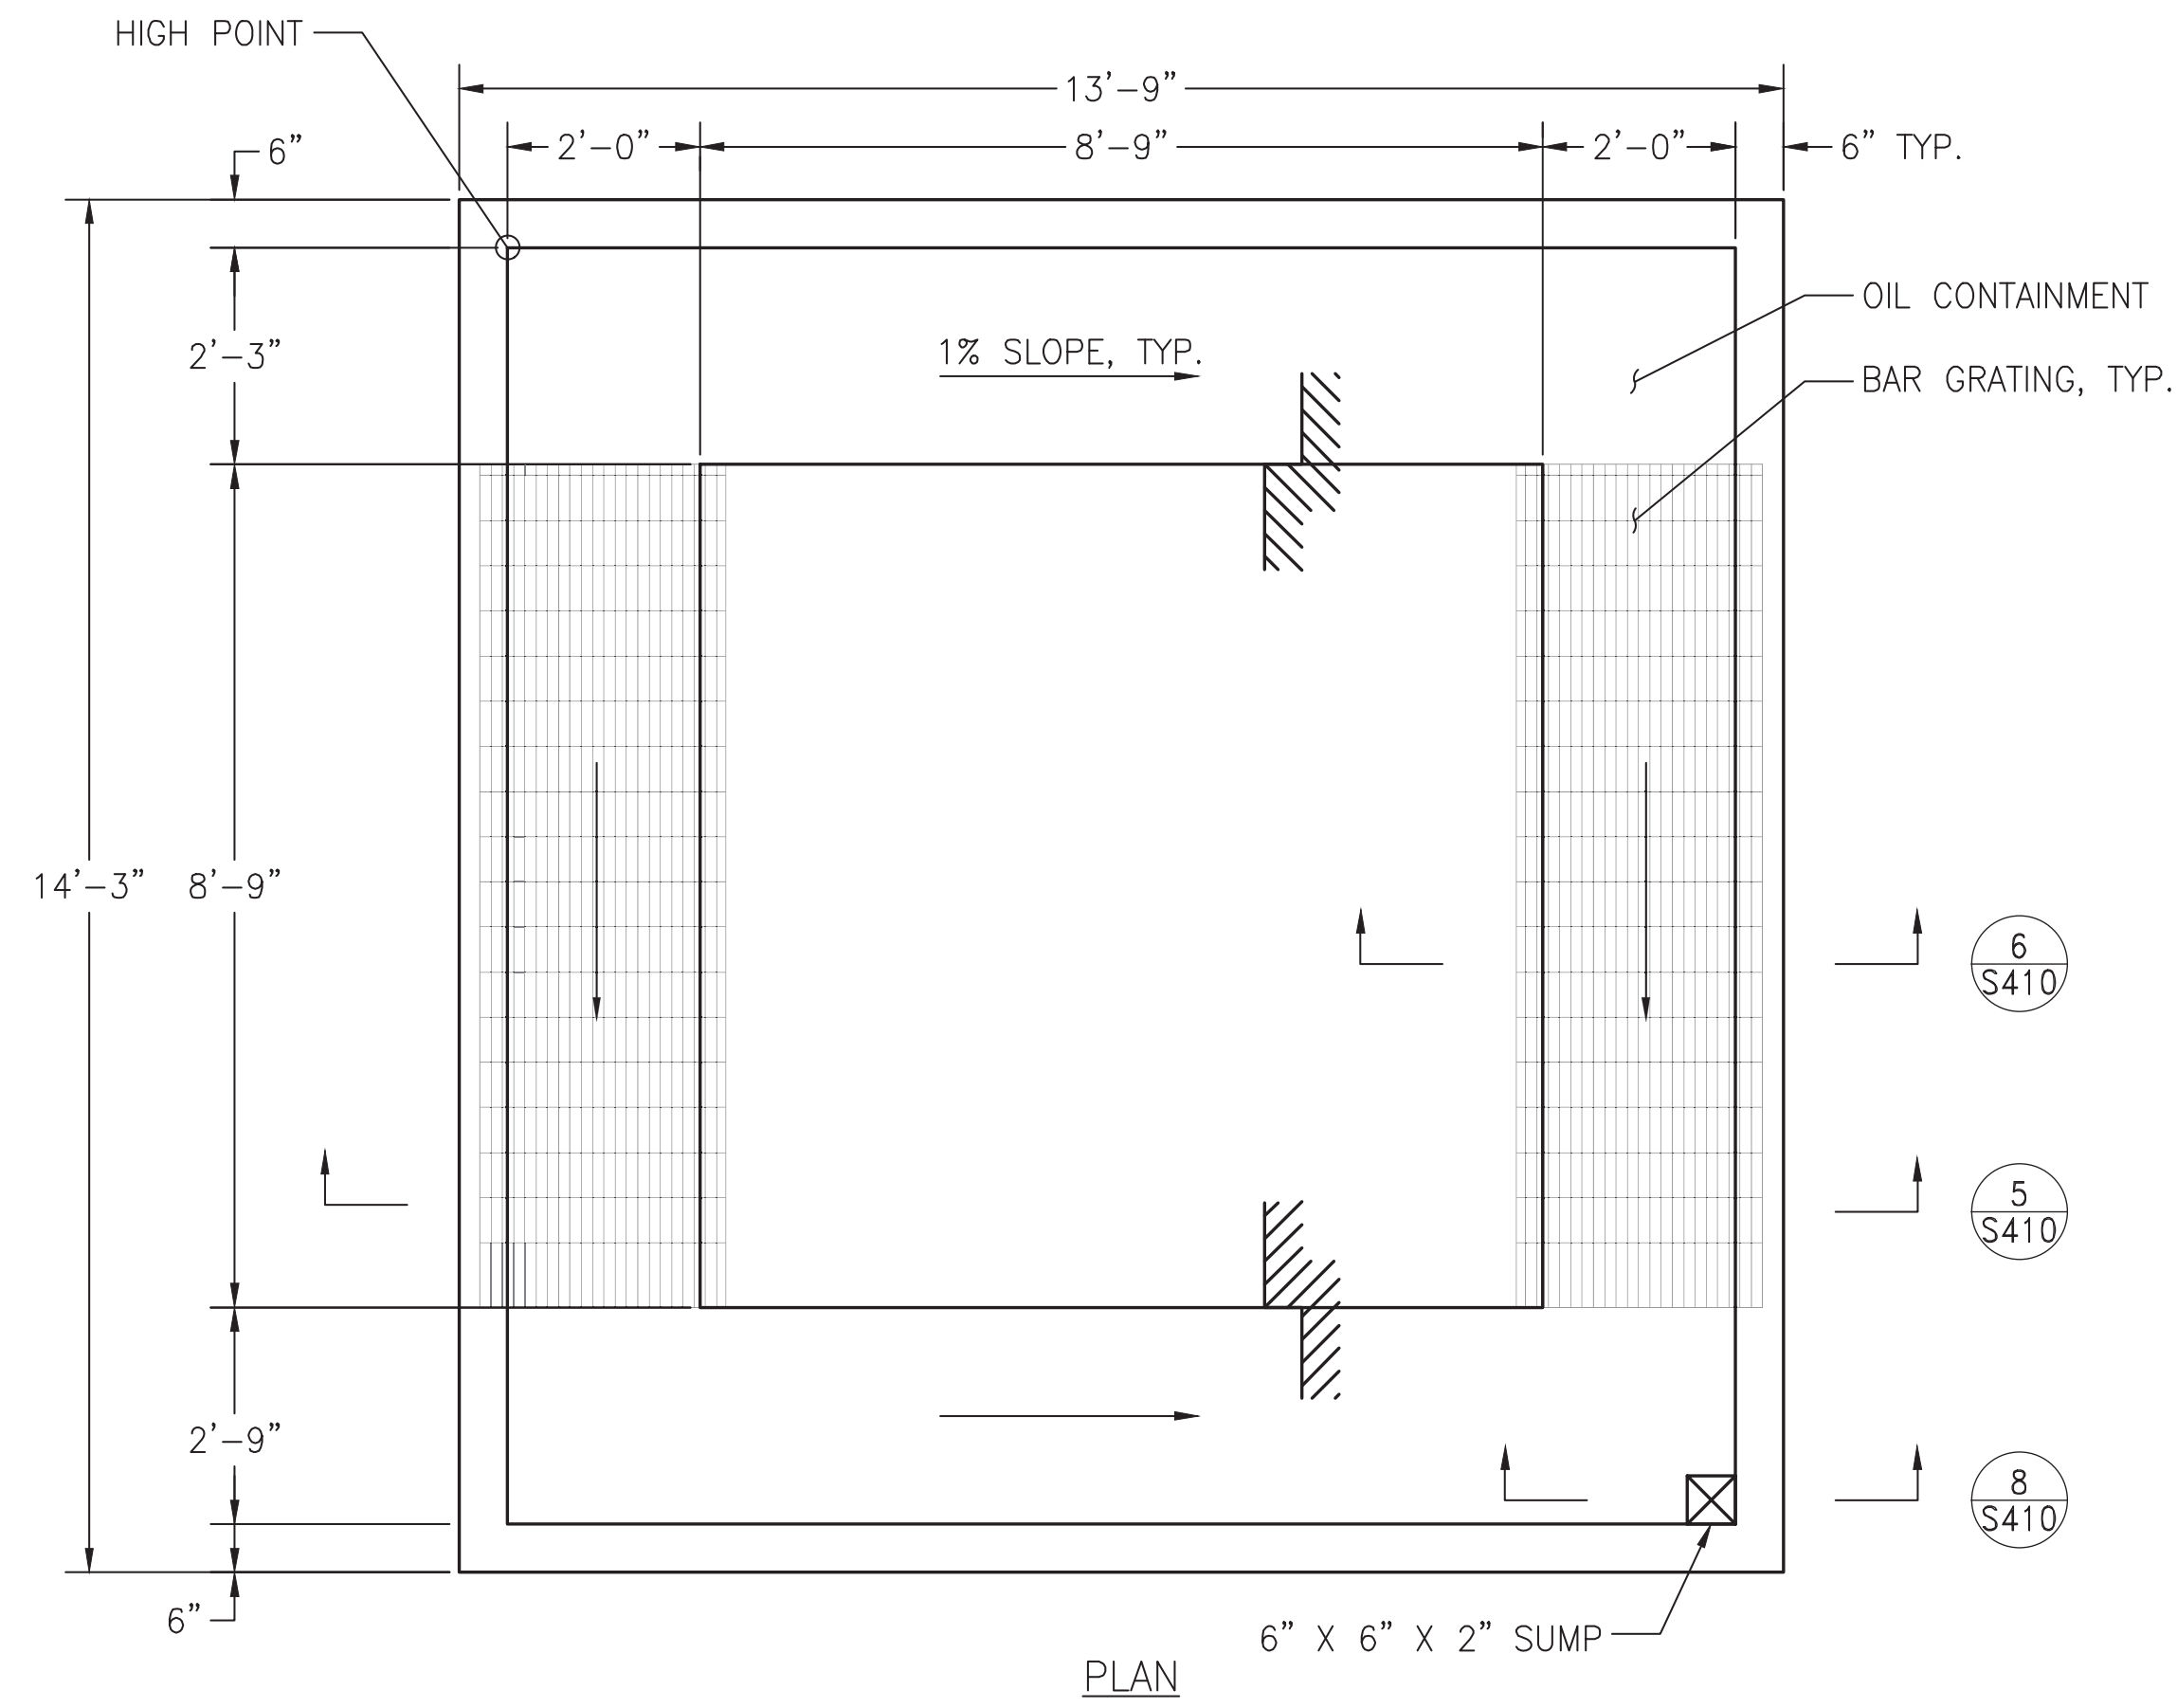

NOTE:

- FOUNDATION DIMENSIONS TO BE ±6" LARGER THAN THE EQUIPMENT FOOTPRINT.
- THE CONTRACTOR TO HAVE DESIGN REVIEWED BY RECTIFIER TRANSFORMER SUPPLIER.
- FOUNDATION HEIGHT ABOVE FINISHED GRADE TO PROVIDE THE LOWEST ENERGIZED PART OF THE RECTIFIER TRANSFORMER SHALL BE LEAST 9 FEET ABOVE FINISHED GRADE.


**4 RECTIFIER TRANSFORMER FOUNDATION TYPE 316-ODE**  
S410 SCALE: 1/2"=1'-0"

NOTES:


- FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.
- EPOXY COATINGS SHALL BE APPLIED TO OIL CONTAINMENT SURFACES IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. CONTRACTOR SHALL SUBMIT EPOXY COATING PRODUCT DATA FOR APPROVAL BEFORE START WORK

WORK ON THIS DRAWING:


- REMOVAL OF EXISTING INTERIOR CONCRETE EQUIPMENT PADS.
- NEW INTERIOR CONCRETE EQUIPMENT PADS IN EXISTING SLAB.
- NEW CONCRETE CURB IN EXISTING SLAB.
- NEW FOUNDATION FOR NEW RECTIFIER TRANSFORMER.

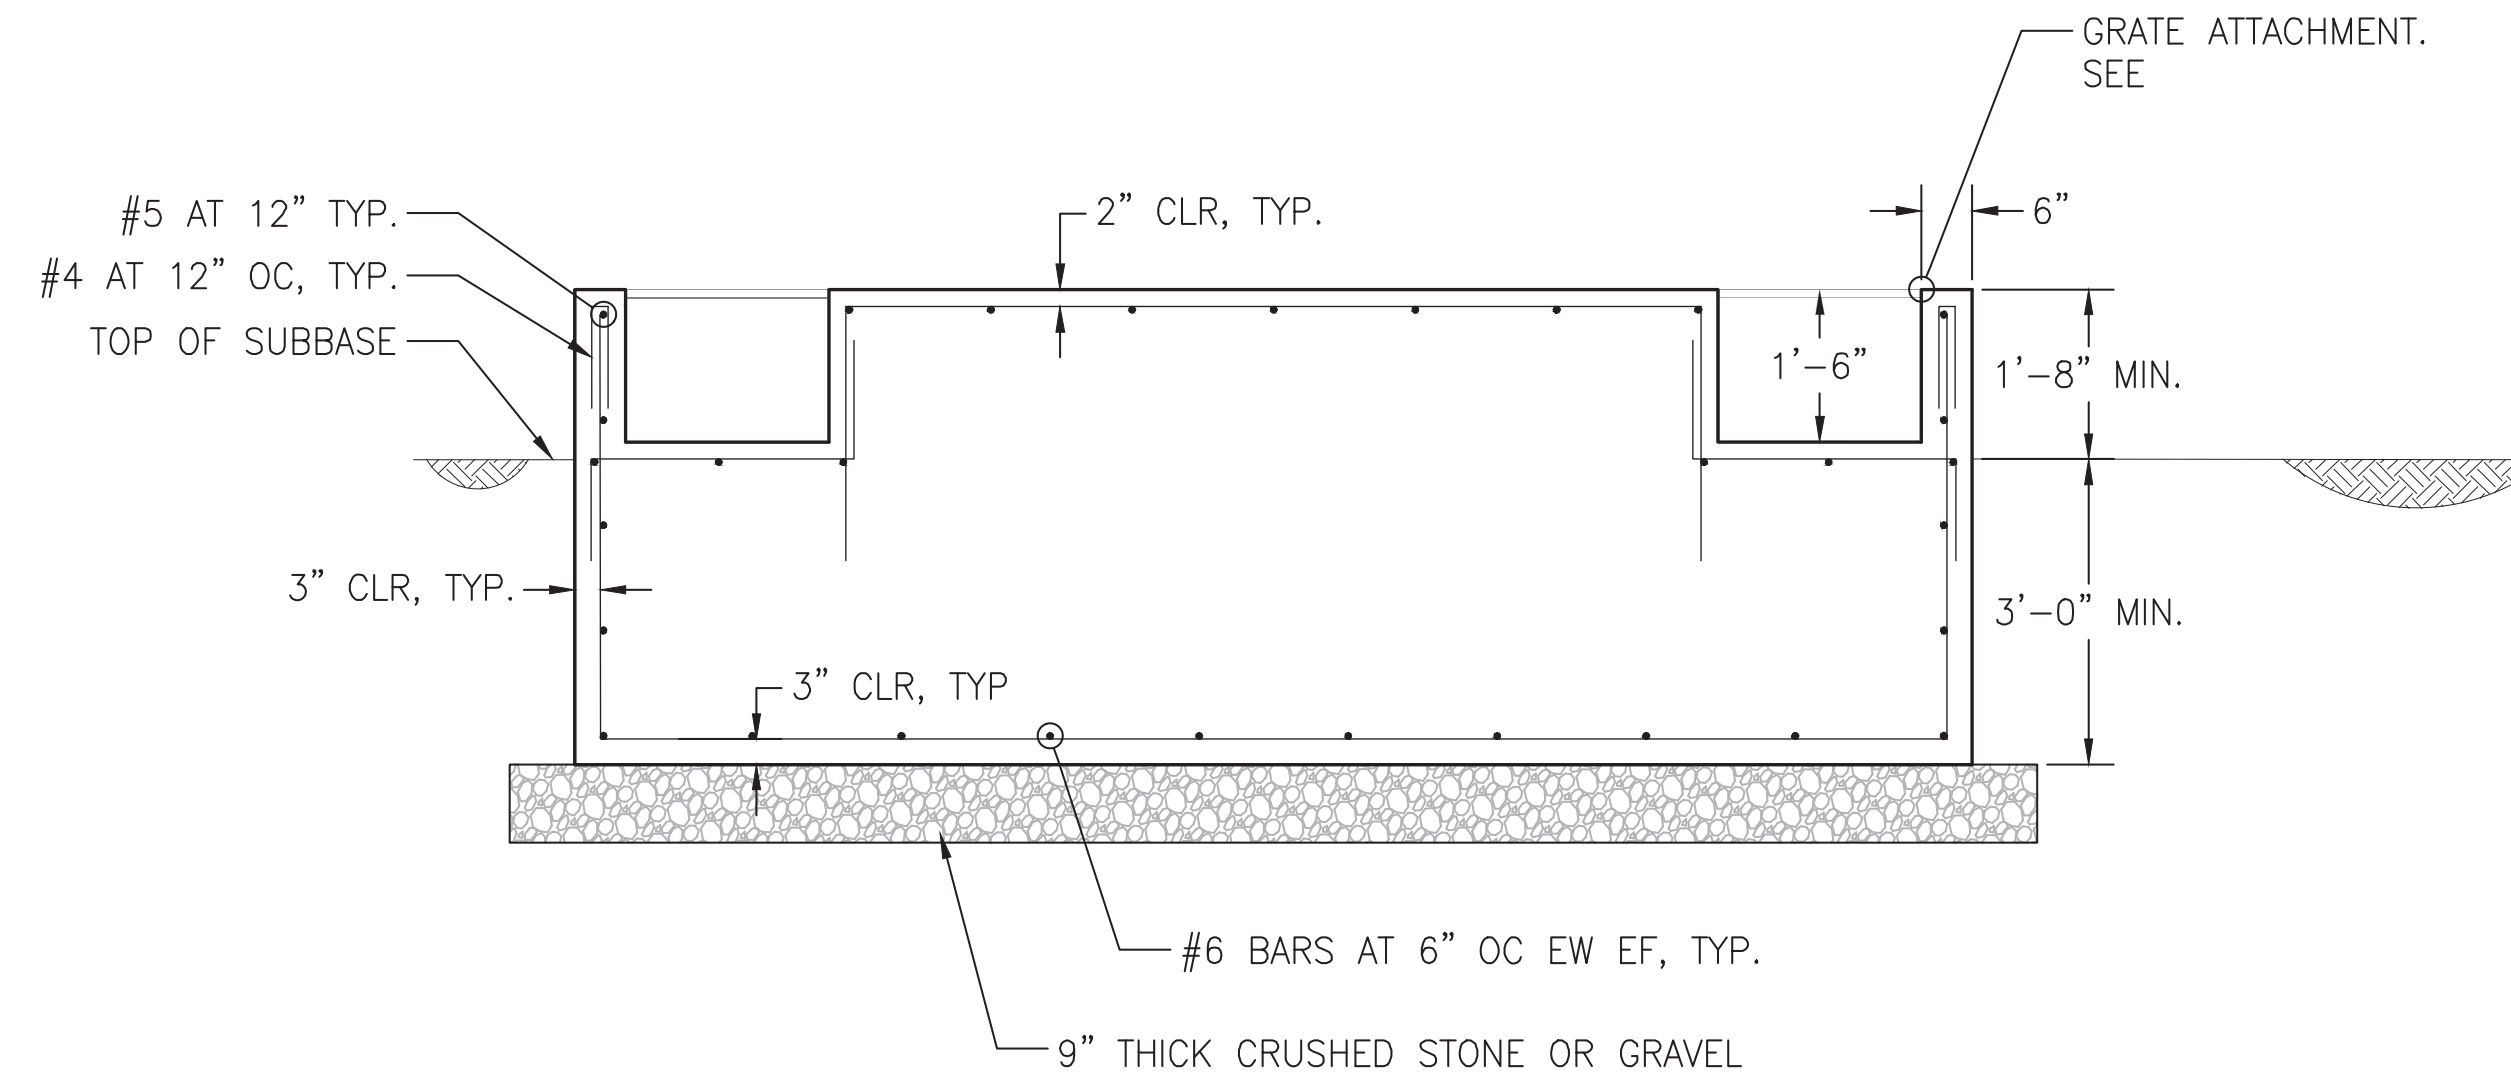


**5 RECTIFIER TRANSFORMER FOUNDATION TYPE 316-ODE**  
S410 SCALE: 1/2"=1'-0"

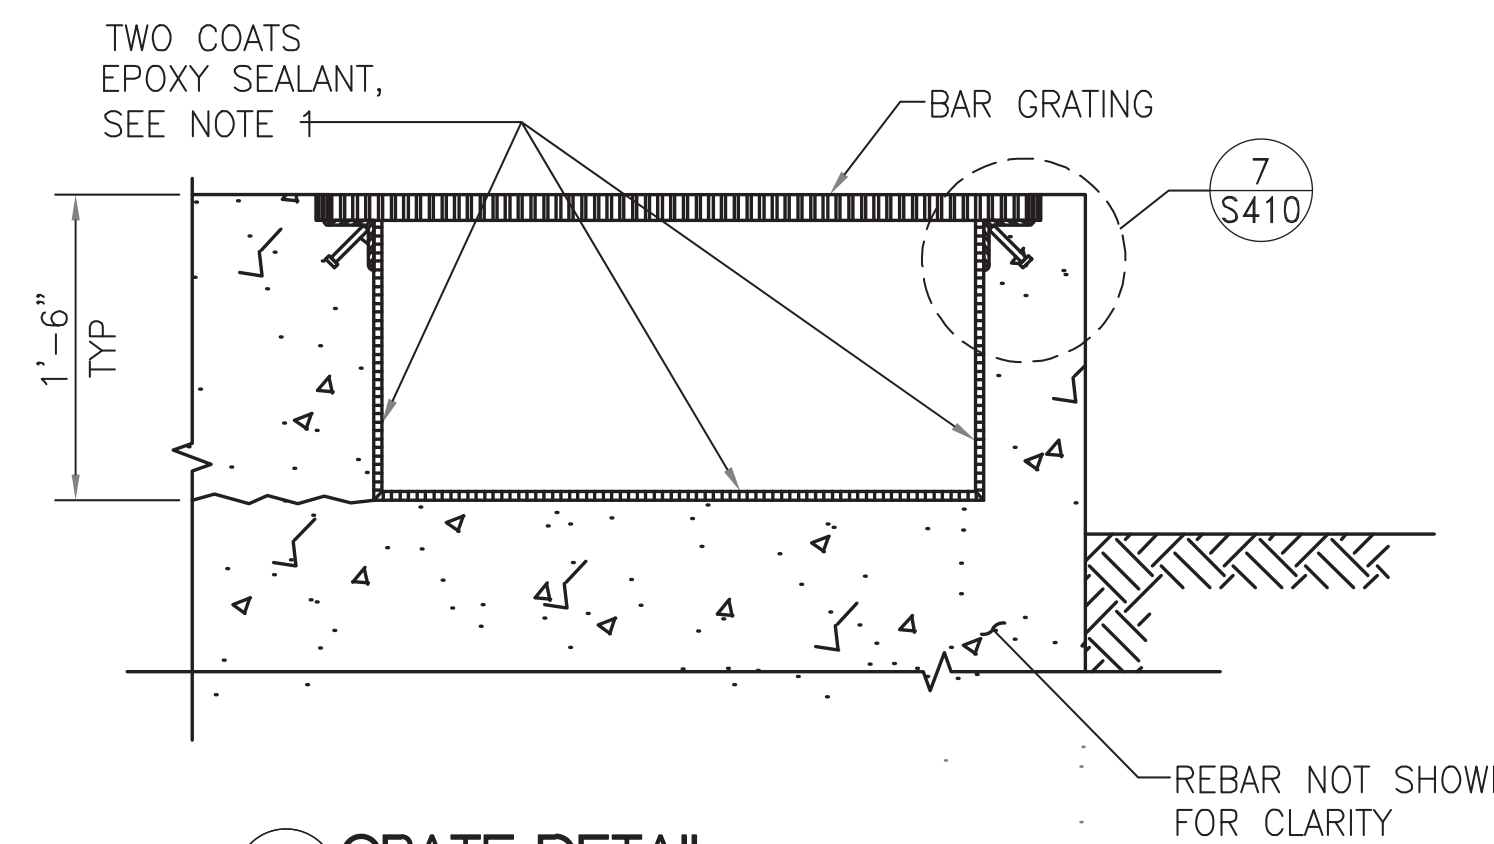

**6 GRATE DETAIL**  
S410 SCALE: 1"=1'-0"

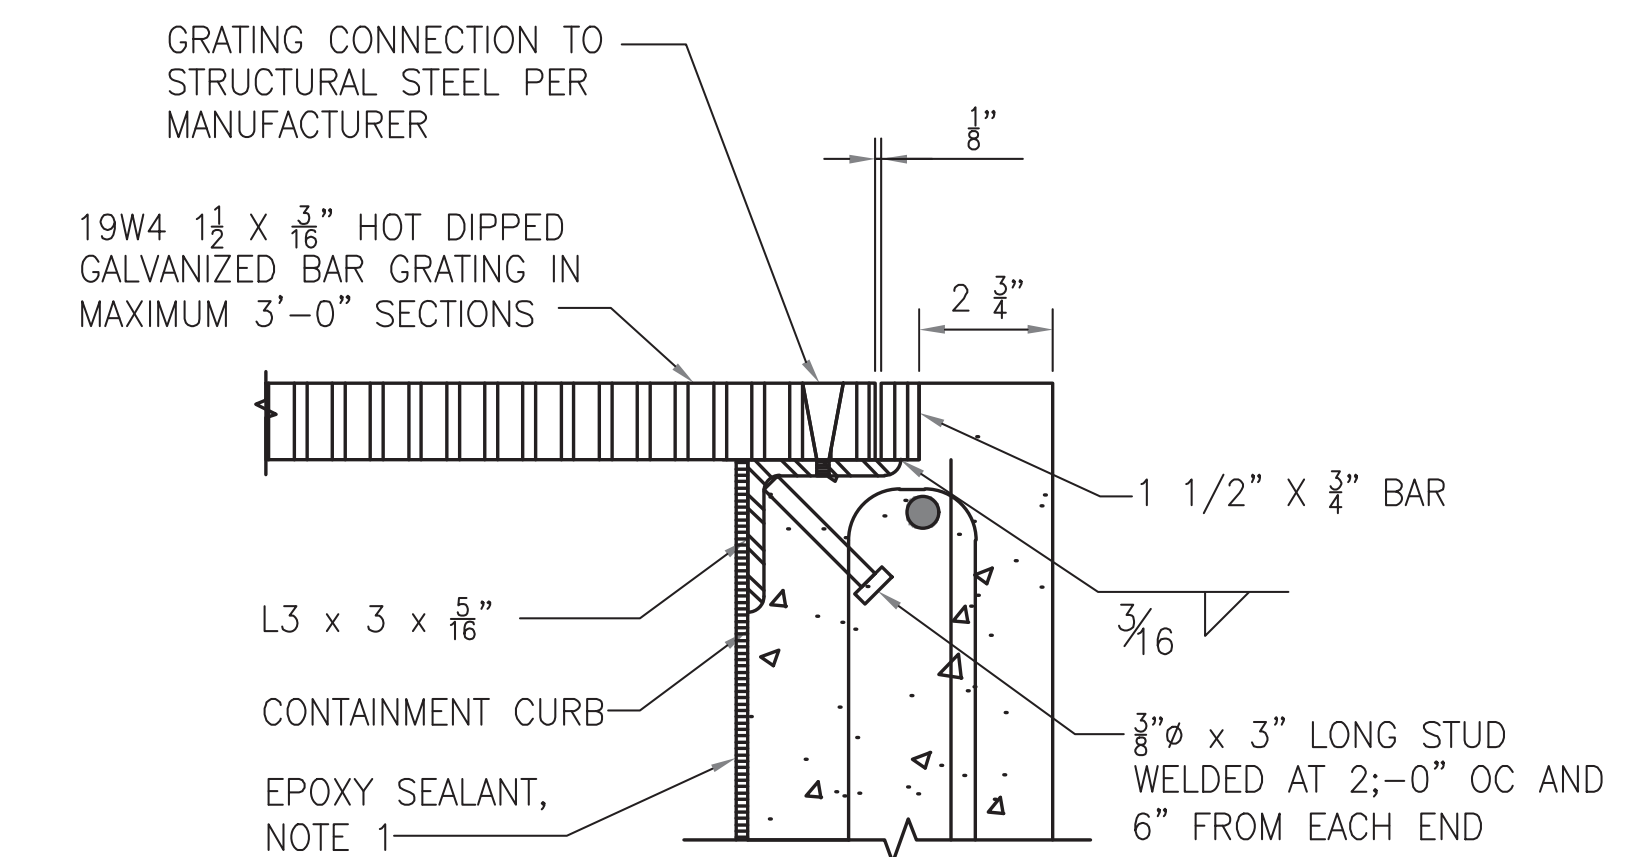

**7 GRATE CONNECTION DETAIL**  
S410 SCALE: 3"=1'-0"

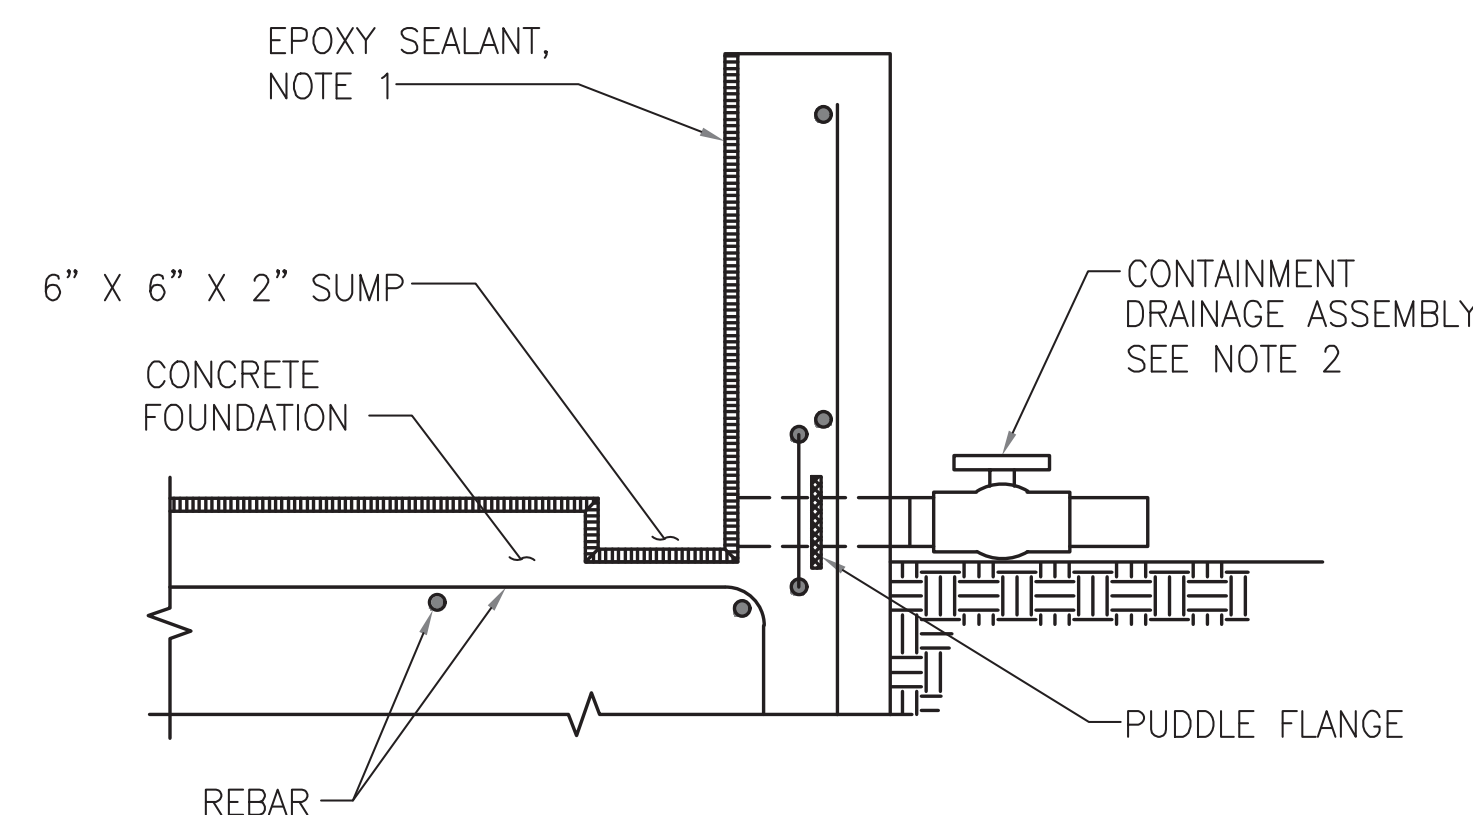

**8 SUMP DETAIL**  
S410 SCALE: 1 1/2"=1'-0"



50% SUBMISSION  
NOT FOR CONSTRUCTION

CHIEF ENGINEER - EM&C
CHIEF ENGINEERING OFFICER - S&C
CHIEF RAIL TRANSIT OFFICER
SYSTEM SAFETY
DIRECTOR OF ENGINEERING - S&C
MANAGER - ARCHITECTURAL ENGINEERING
PROJECT MANAGER

**HDR**  
HDR Engineering, Inc.  
Philadelphia, PA  
**MELDRA DESIGN**  
Civil, Water Resources, and Structural Engineering  
259 MORGAN STREET  
PHOENIXVILLE, PA 19340  
(610) 933-0123

REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**REHABILITATION**  
**STRUCTURAL**  
FOUNDATION DETAILS - SHEET 1




SCALE: AS NOTED  
SCALE FACTOR: -  
DATE: 10/16/2017  
DRAWN BY: SEB  
CHECKED BY: JWA  
WORK ORDER NO.: 276496  
SHEET NUMBER:

**S410**  
DWG. NO.: 11 OF 14  
SHT. NO.: 402 OF 452  
ARCHIVE NO.:  
COMPUTER FILE NO.: 17AN-S410  
REV. NO.:

REV	DATE	DESCRIPTION	BY	CK'D	AP'D


**CASTOR**  
 ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
 FOUNDATION DETAILS - SHEET 2

SCALE:	AS NOTED	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	SEB
WORK ORDER NO.:	276496	CHECKED BY:	JWA
SHEET NUMBER:	<b>S411</b>		
DWG. NO.:	12	OF	14
SHT. NO.:	403	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-S411	REV. NO.:	-

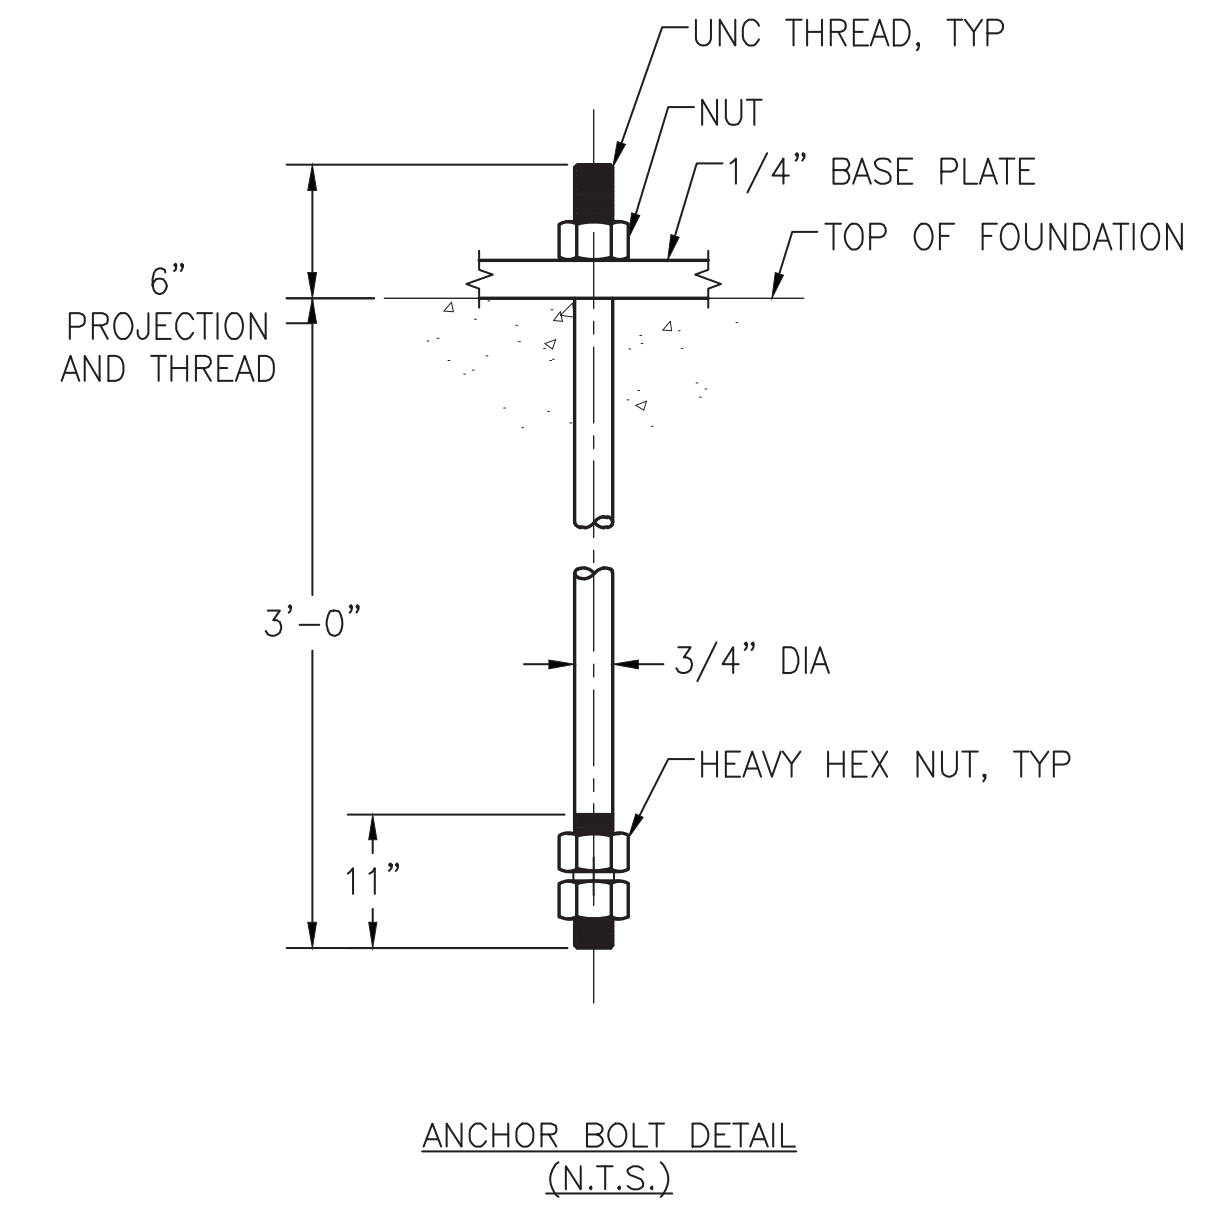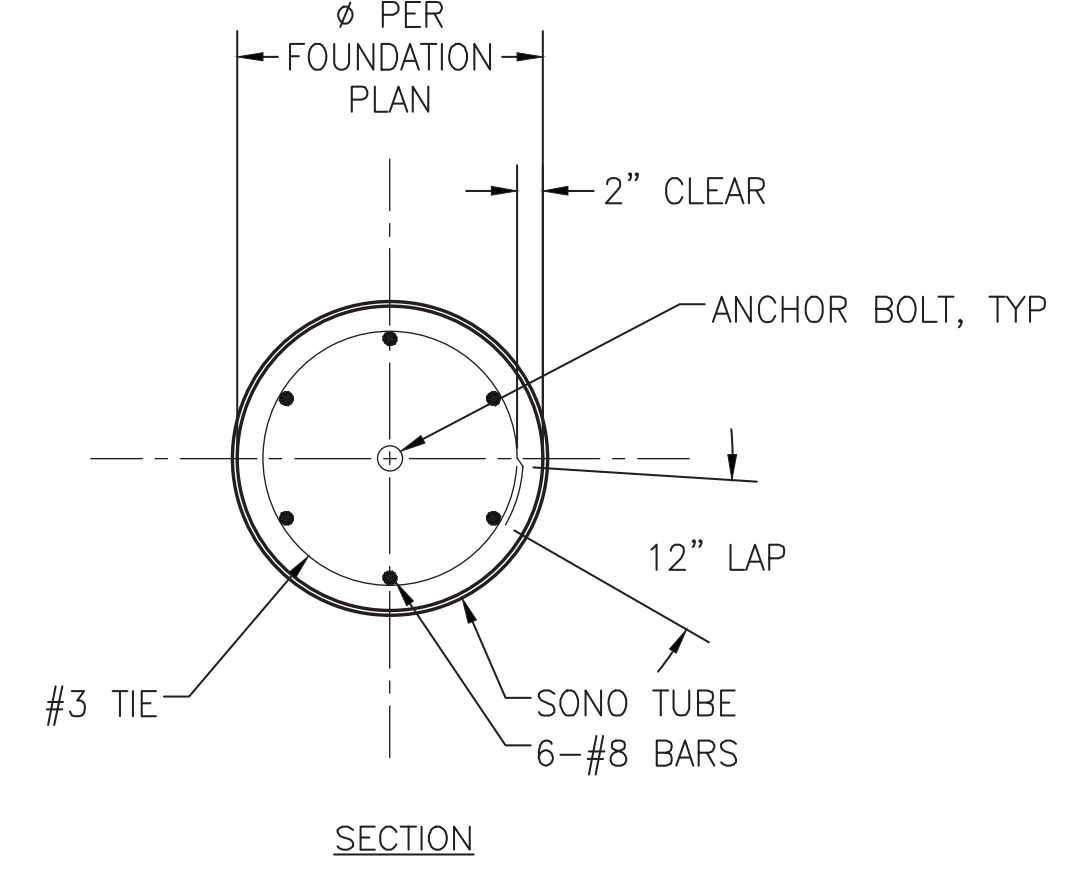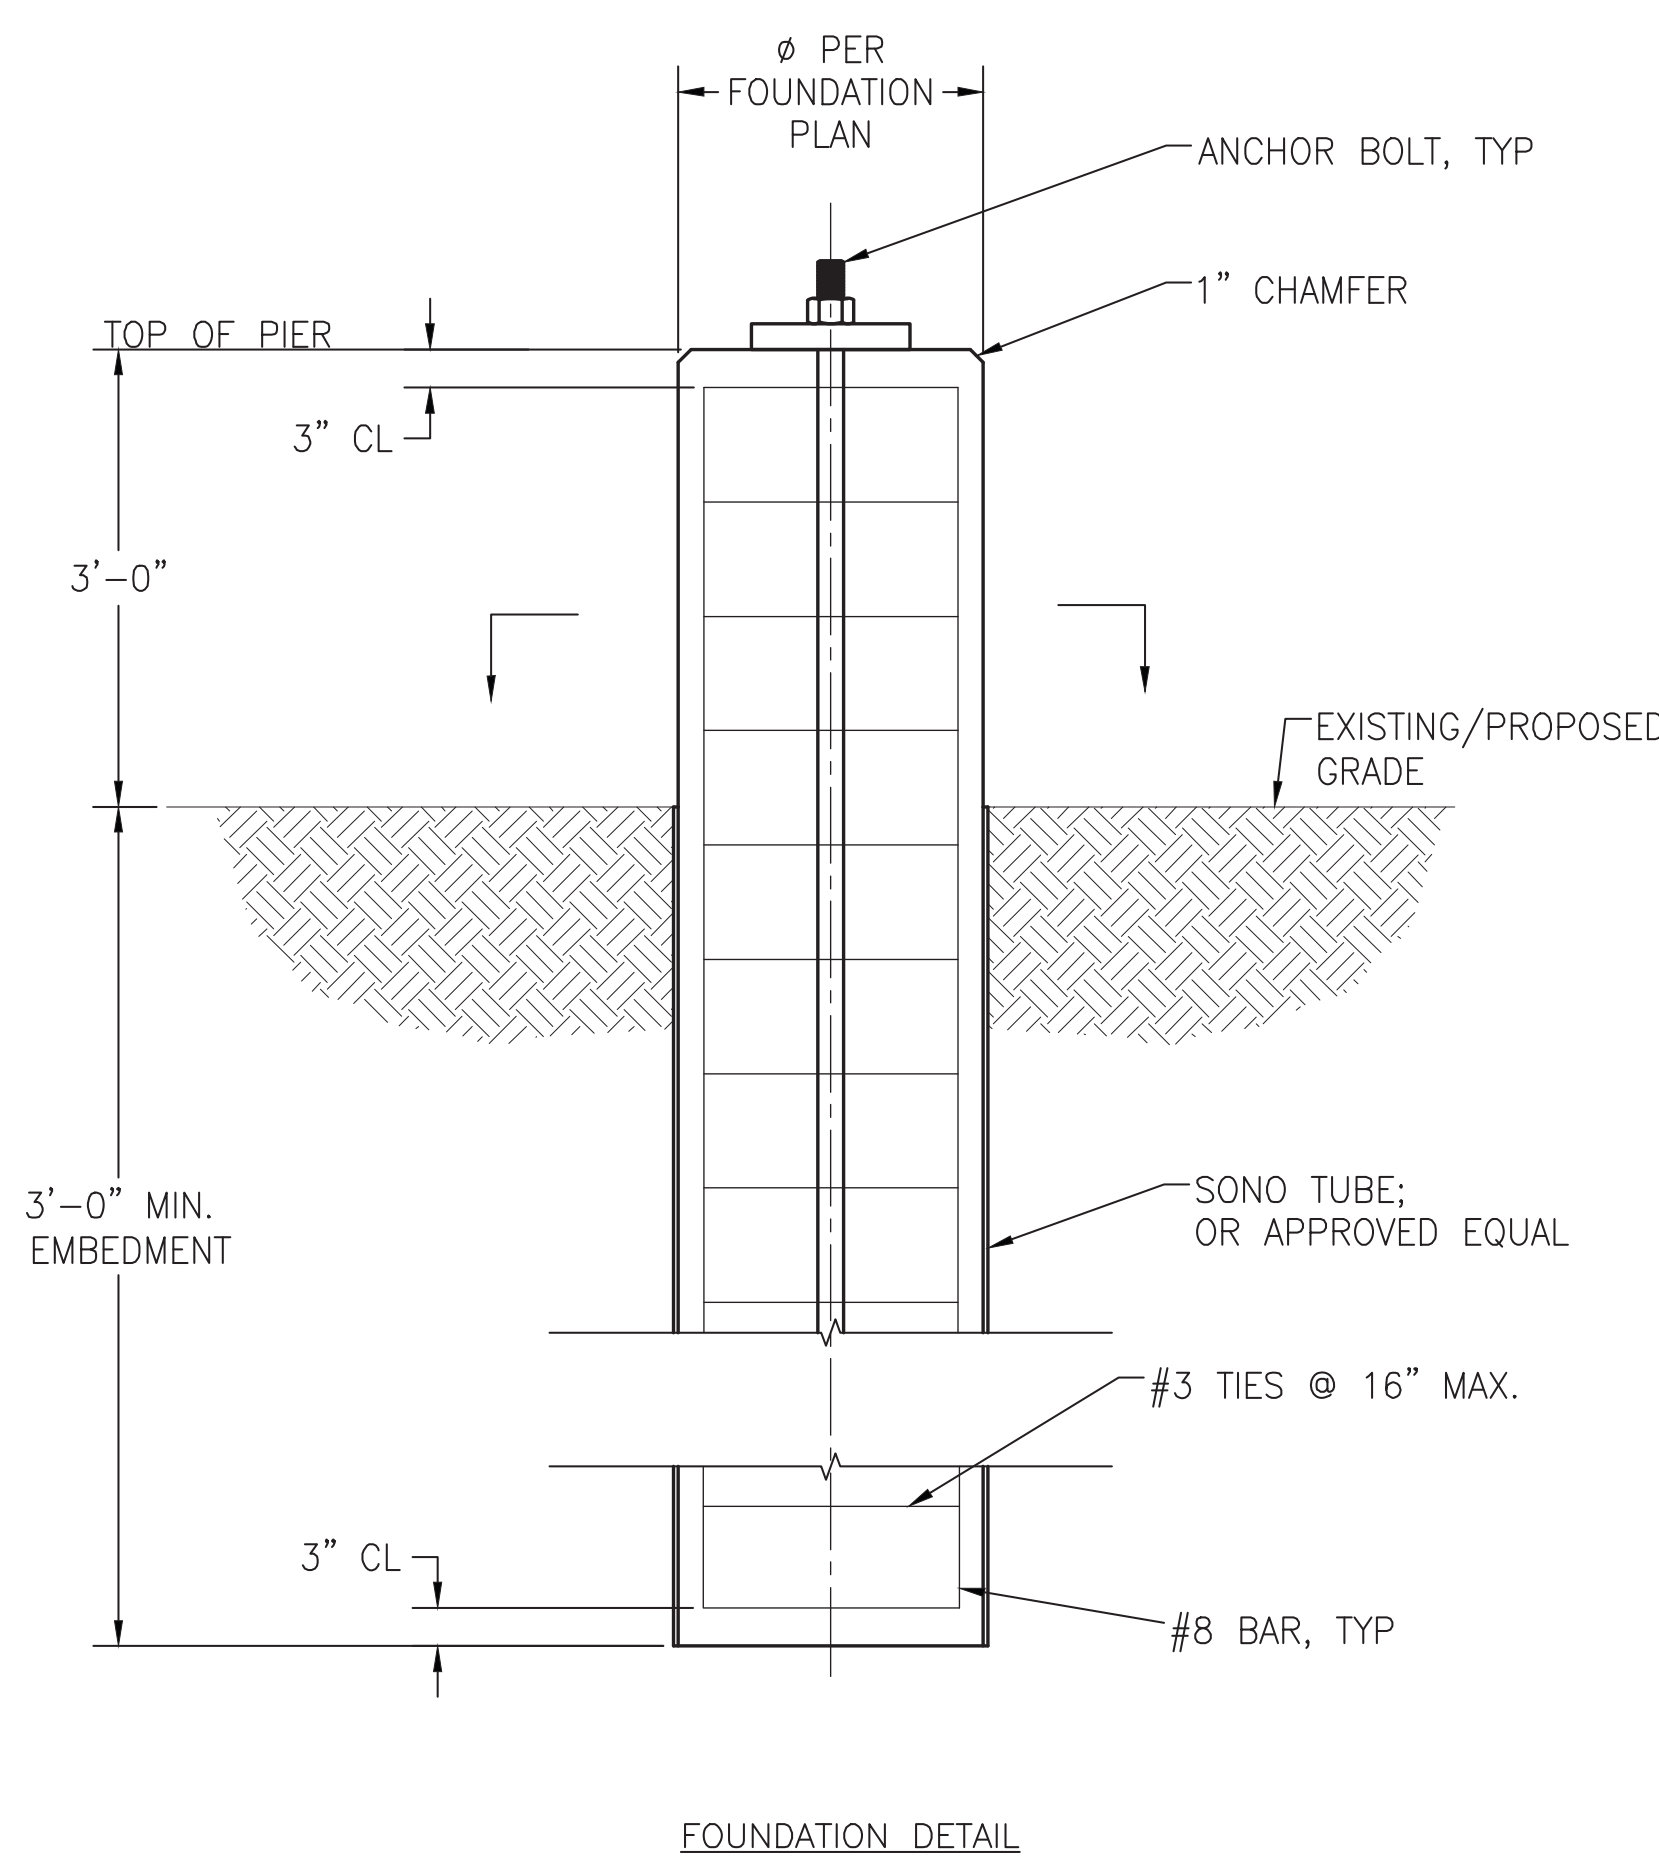

**FOUNDATION TYPE 316 MOD-S**  
 SCALE: 3/4" = 1'-0"

NOTES:  
 1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.  
 WORK ON THIS DRAWING:  
 • NEW CONCRETE PIER FOUNDATIONS FOR NEW EXTERIOR STAIRS.

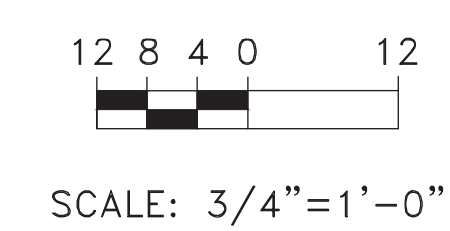


**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\6889125\17AN-S411.DWG


DATE PRINTED: 10/19/2025 STATUS: 50% SUBMISSION



REV	DATE	DESCRIPTION	BY	CK'D	AP'D

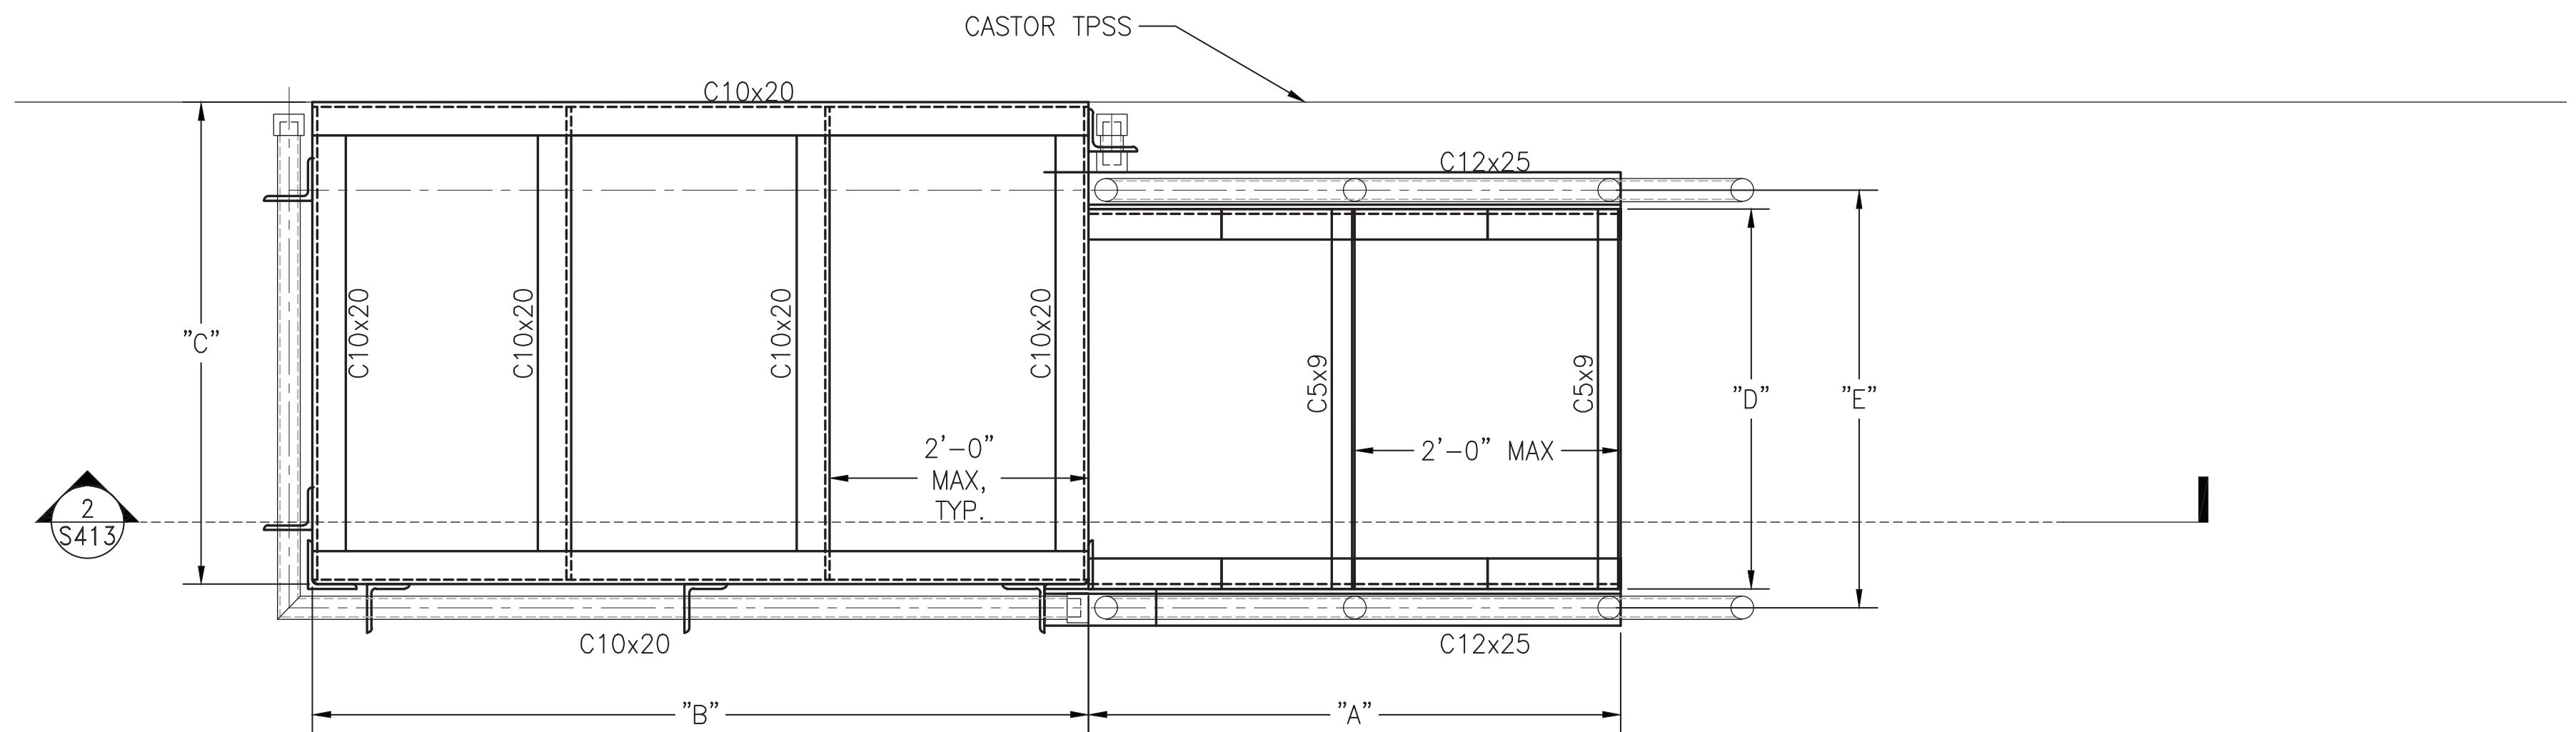

**1 METAL STAIRS - PLAN**  
S413 SCALE: 1"=1'-0"

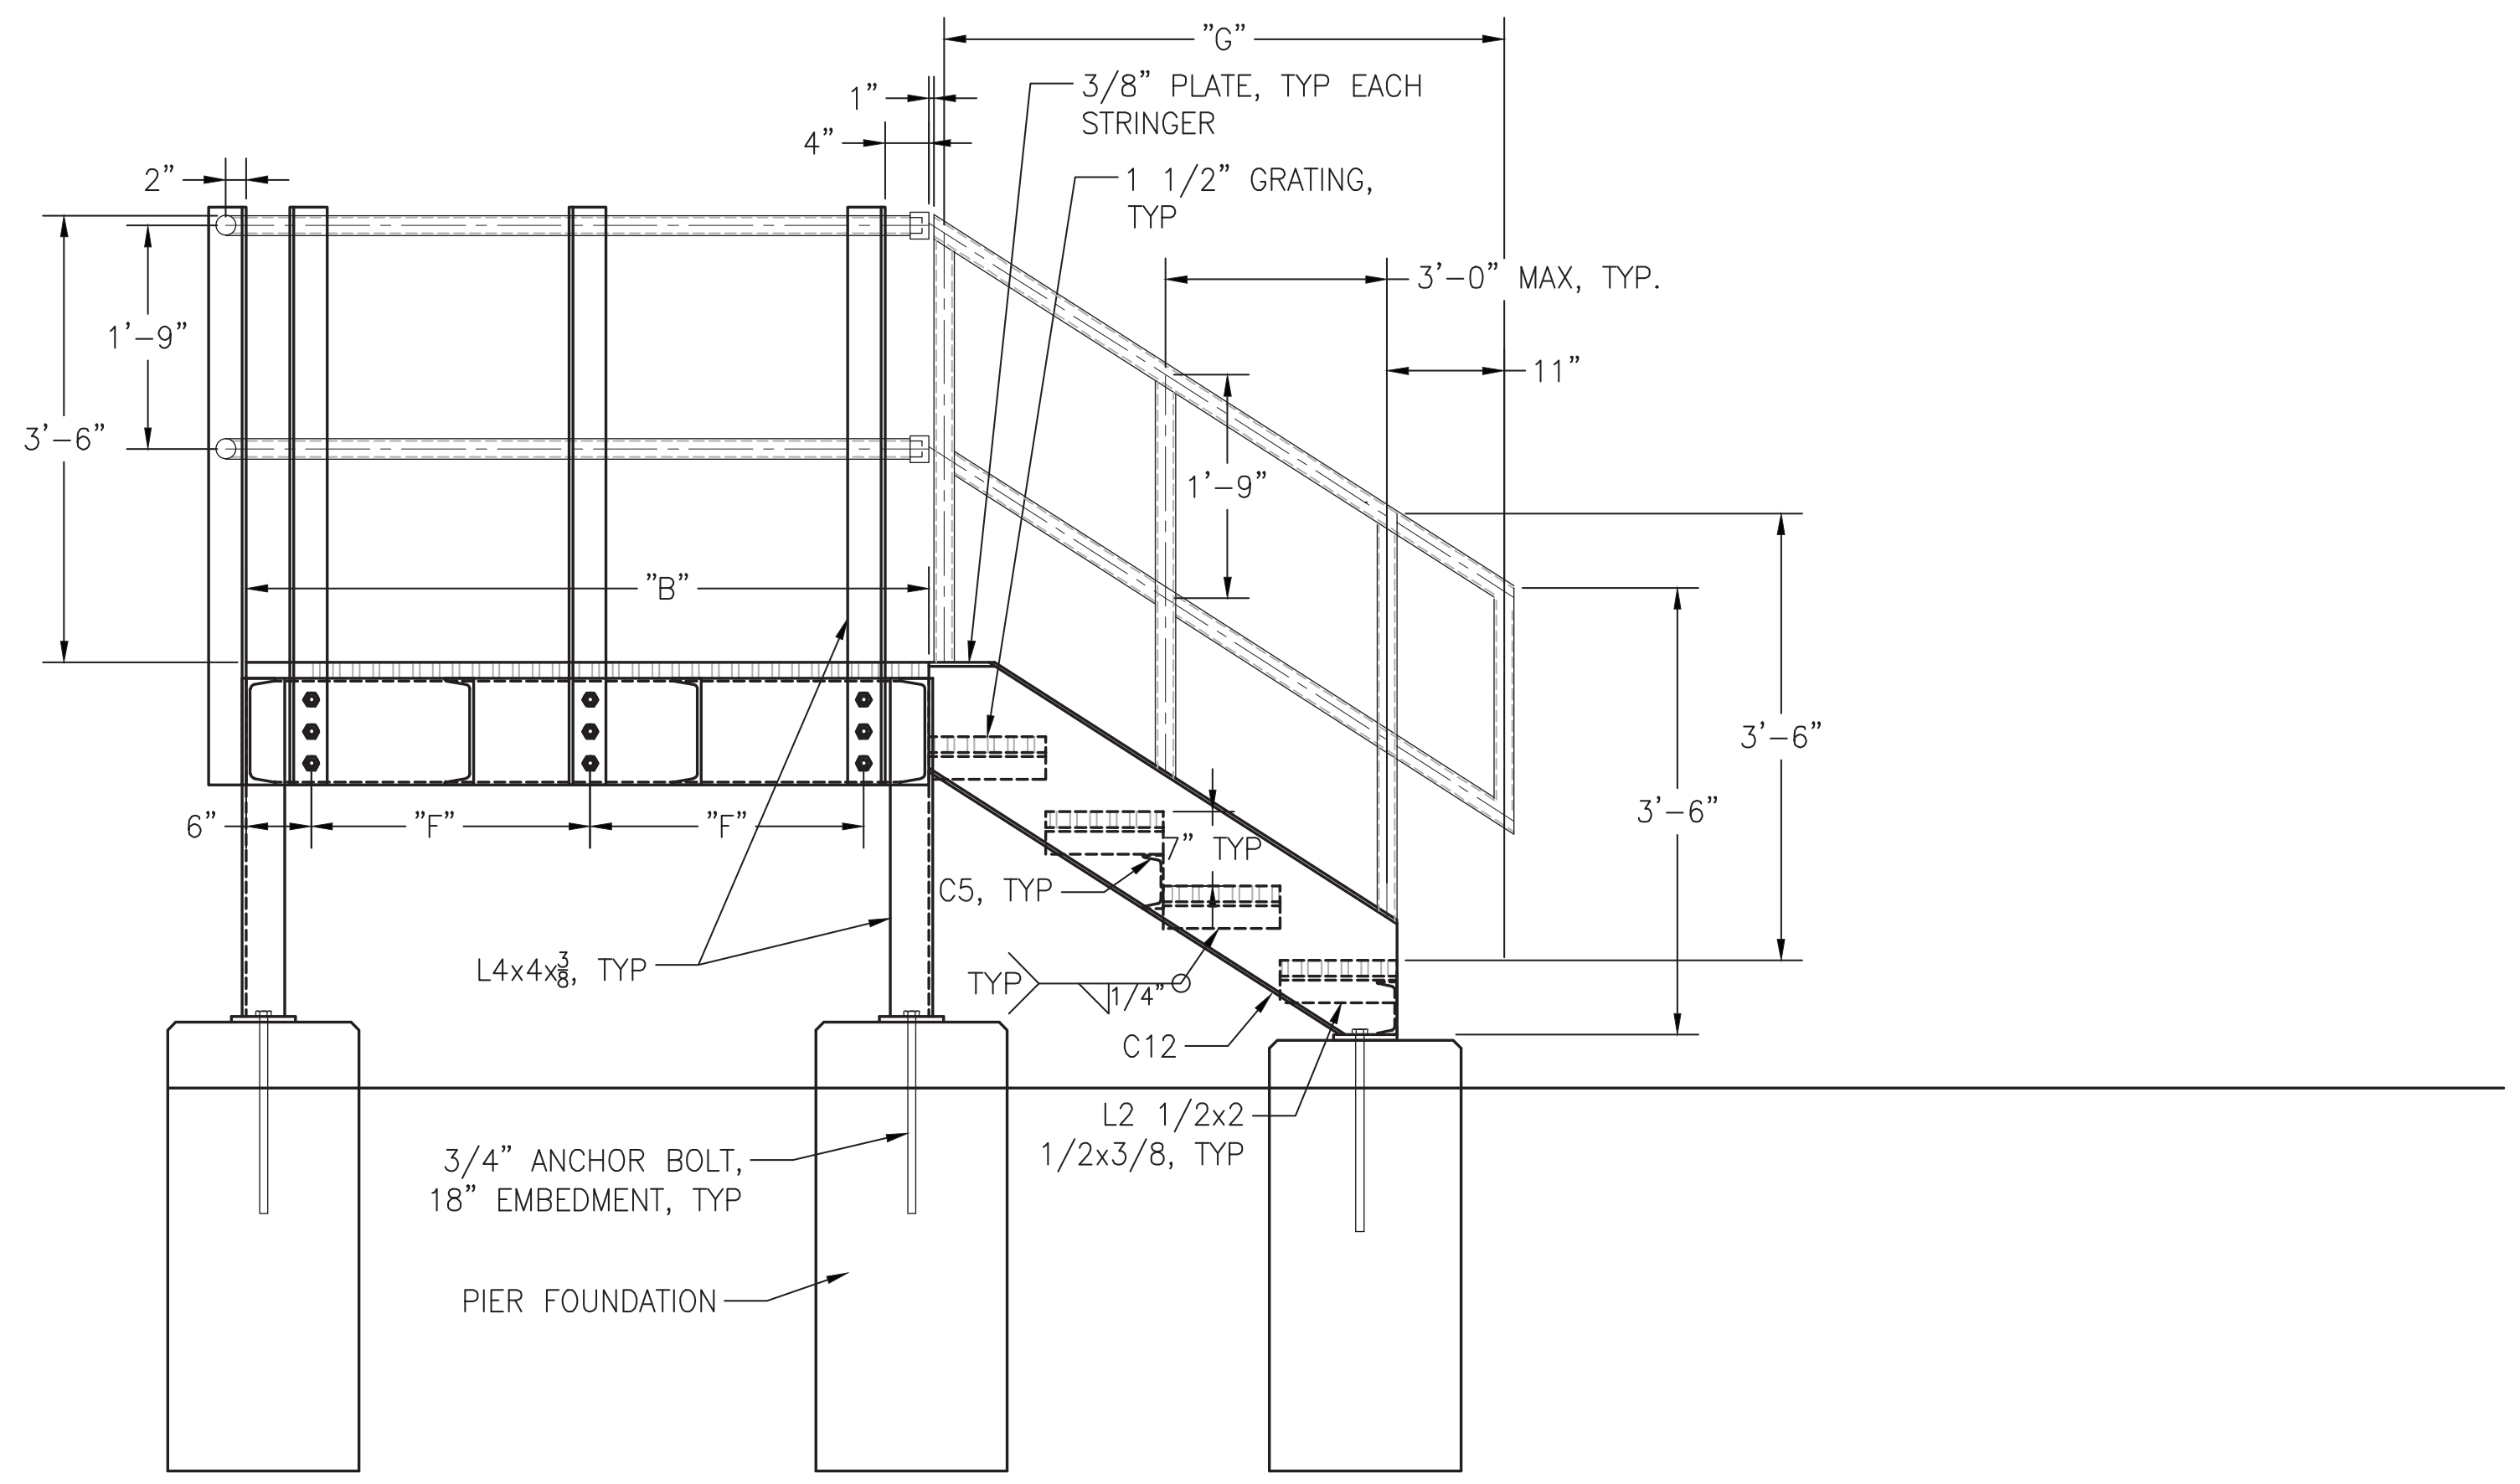


**2 METAL STAIRS - SECTION**  
S413 SCALE: 3/4"=1'-0"


DIMENSION	CASTOR TPSS STAIR DIMENSIONS		
	1	2	3
"A"	3'-8"	3'-8"	3'-8"
"B"	5'-4"	5'-4"	6'-10"
"C"	3'-4"	3'-4"	5'-6"
"D"	2'-7"	2'-7"	2'-7"
"E"	2'-11"	2'-11"	2'-11"
"F"	2'-2"	2'-2"	2'-11"
"G"	4'-5"	4'-5"	4'-5"

NOTE: STAIR 1 SHOWN. STAIR 2 AND 3 STAIRS SIMILAR.

NOTES:  
1. FOR GENERAL STRUCTURAL NOTES SEE DRAWING S400.  
WORK ON THIS DRAWING:  
• NEW STEEL STAIRS.

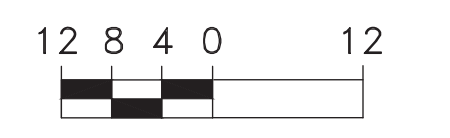

SCALE: 3/4"=1'-0"



1 INCH

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**STRUCTURAL**  
BUILDING DETAILS - SHEET 2

SCALE: AS NOTED	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: WBT
WORK ORDER NO.: 276496	CHECKED BY: JWA
SHEET NUMBER: <b>S413</b>	
DWG. NO.: 14 OF 14	
SHT. NO.: 405 OF 452	
ARCHIVE NO.:	
COMPUTER FILE NO.: 17AN-S413	REV. NO.: -

C:\P\WORKING\PTTD\689125\17AN-S413.DWG

DATE PRINTED: 10/19/2025

STATUS: 50% SUBMISSION



NO.	DATE	DESCRIPTION	BY	CHKD	APPD


**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**MECHANICAL**  
DEMOLITION FLOOR PLAN

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: DWP CHECKED BY: DJM
WORK ORDER NO: 276496	SHEET NUMBER: <b>M401</b>
DWG. NO.: 2 OF 6	SHT. NO.: 407 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-M401	REV. NO.:


**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

- GENERAL NOTES:**
- REFER TO DRAWING M400 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
  - REFER TO DRAWING M404 FOR SCHEDULES.
  - REFER TO DRAWING M405 FOR DETAILS.

- KEYED NOTES:**
- REFER TO DRAWING M403 FOR ENLARGED PLUMBING DEMOLITION.
  - THE CONTRACTOR SHALL LOCATE ALL COMPRESSED AIR PIPING THROUGH OUT THE BUILDING AND REMOVE IT ALONG WITH THE AIR COMPRESSOR AND ALL APPURTENANCES.
  - REMOVE HEATER AND ALL APPURTENANCES.
  - REMOVE THE EXHAUST FAN AND ALL APPURTENANCES.
  - THOROUGHLY CLEAN THE UNDERGROUND SANITARY PIPING PRIOR TO CONNECTING NEW PIPES.
  - REMOVE THE DRAIN FROM THE TRANSFORMER. FLUSH THE UNDERGROUND SANITARY PIPING. REMOVE ALL EXPOSED SANITARY PIPING AND CAP PIPING AT FLOOR.
  - DISCONNECT THE DOMESTIC WATER CONNECTION TO THE TRANSFORMER. REMOVE ALL EXPOSED DOMESTIC WATER PIPING AND CAP PIPING AT FLOOR.
  - REMOVE THE HOSE BIBB AND PATCH THE WALL OPENING TO MATCH EXISTING.
  - THE CONTRACTOR SHALL LOCATE AND REMOVE THE DRAIN FROM THE RECTIFIER. FLUSH THE UNDERGROUND SANITARY PIPING. REMOVE ALL EXPOSED SANITARY PIPING AND CAP PIPING AT FLOOR.
  - THE CONTRACTOR SHALL LOCATE AND DISCONNECT THE DOMESTIC WATER CONNECTION TO THE RECTIFIER. REMOVE ALL EXPOSED DOMESTIC WATER PIPING AND CAP PIPING AT FLOOR.

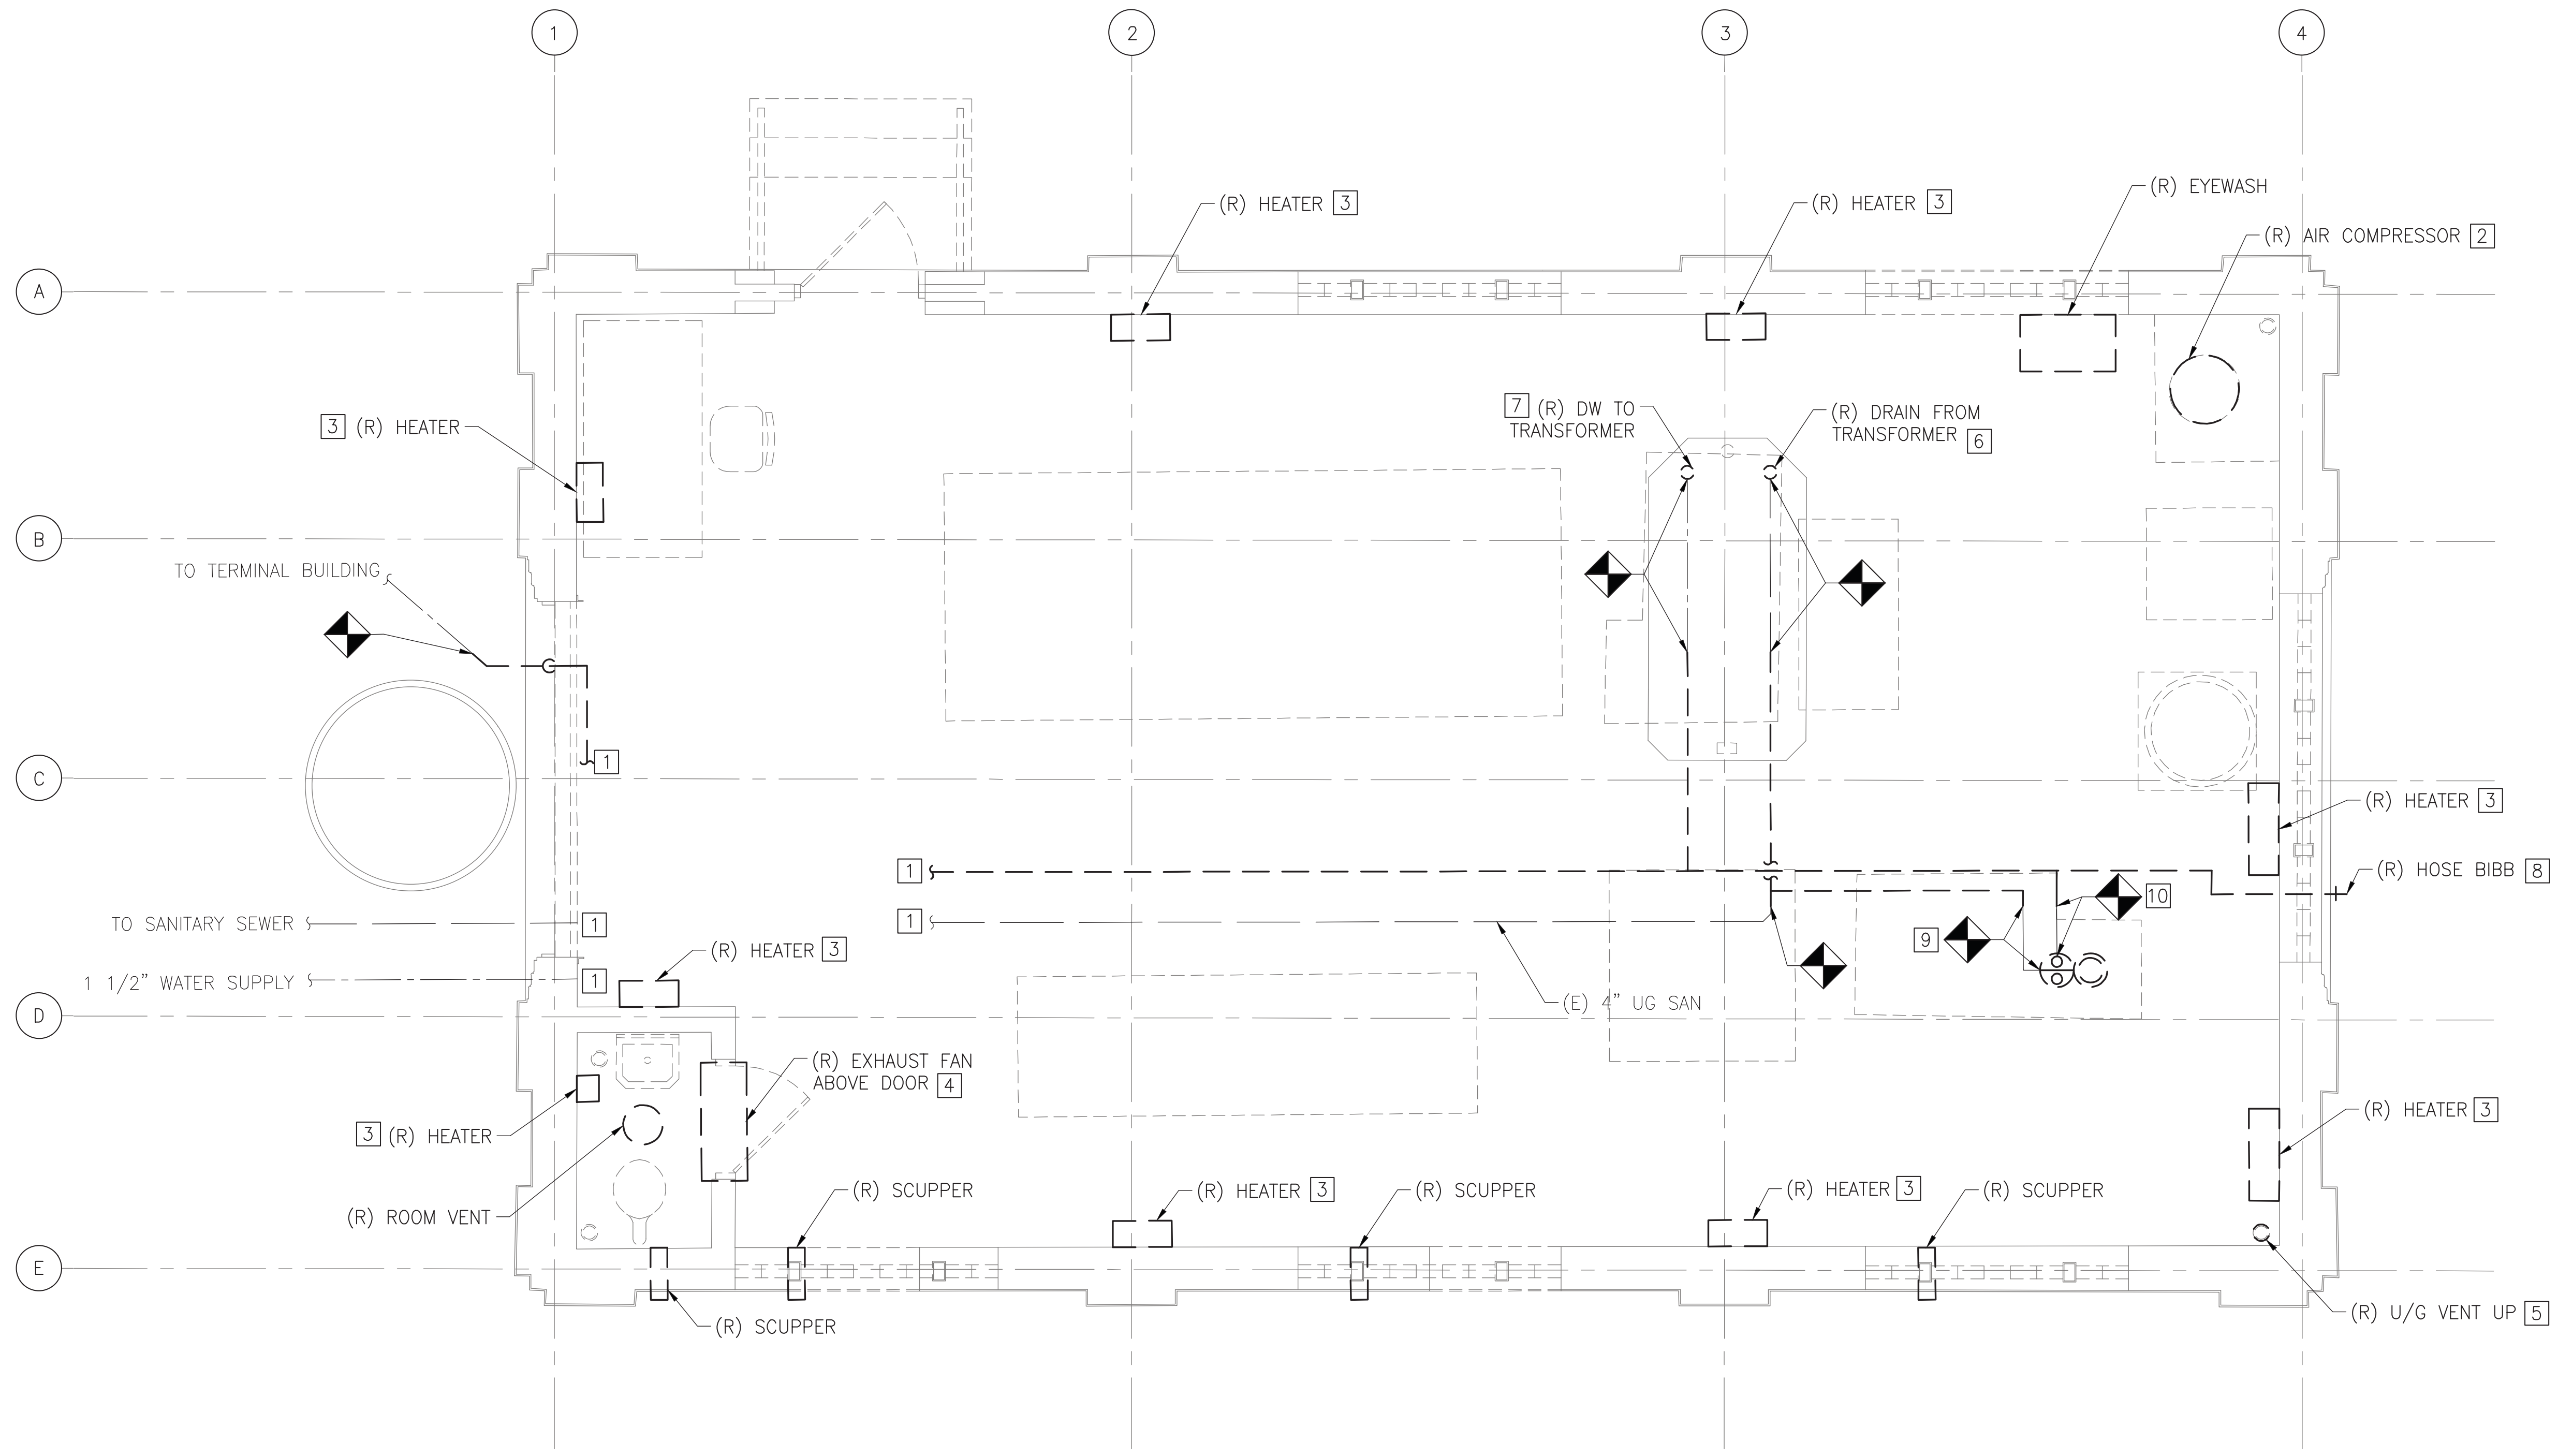

**1**  
**M401** DEMOLITION SUBSTATION FLOOR PLAN  
SCALE: 3/8" = 1'-0"

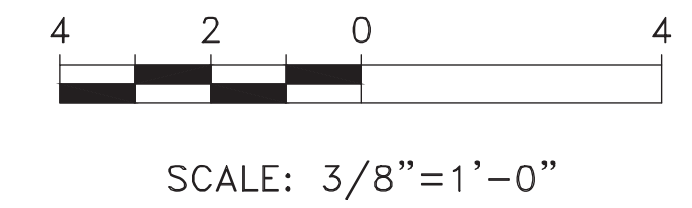

C:\PI\WORKING\PTTD\68918\17AN\M401.DWG

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**MECHANICAL**  
PROPOSED FLOOR PLAN


SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: DWP
WORK ORDER NO.: 276496	CHECKED BY: DM
SHEET NUMBER: <b>M402</b>	
DWG. NO.: 3 OF 6	SHT. NO.: 408 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-M402	REV. NO.:

**GENERAL NOTES:**


- REFER TO DRAWING M400 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
- REFER TO DRAWING M404 FOR SCHEDULES.
- REFER TO DRAWING M405 FOR DETAILS.
- THE CONTRACTOR TO DESIGN A HYDROGEN DETECTION SYSTEM FOR TPSS BUILDING.

**KEYED NOTES:**

- REFER TO DRAWING M403 FOR ENLARGED PLUMBING NEW WORK.
- CAP ALL UNDERGROUND DOMESTIC WATER PIPING AND SANITARY PIPING AT LOCATIONS SHOWN AFTER REMOVING THE TRANSFORMER AND THE RECTIFIER.
- PROVIDE DUCTWORK FROM THE EXHAUST FAN TO THE EXISTING ROOF VENT OPENING AND PROVIDE NEW VENT CAP ON ROOF.
- MOUNT THE ENERGY RECOVERY VENTILATOR FROM THE STRUCTURAL BEAM.
- PROVIDE ROOF OPENING FOR THE EXHAUST DUCT FROM THE ERV AND PROVIDE NEW VENT CAP ON ROOF.
- PROVIDE NEW WALL OPENING FOR THE OUTDOOR AIR INTAKE LOUVER.
- MOUNT THE CONDENSER ON THE EXTERIOR WALL WITH THE MANUFACTURER'S RECOMMENDED MOUNTING ACCESSORIES.
- CLEAN THE ENTIRE UNDERGROUND SANITARY PRIOR TO CAPPING THE OPENINGS.

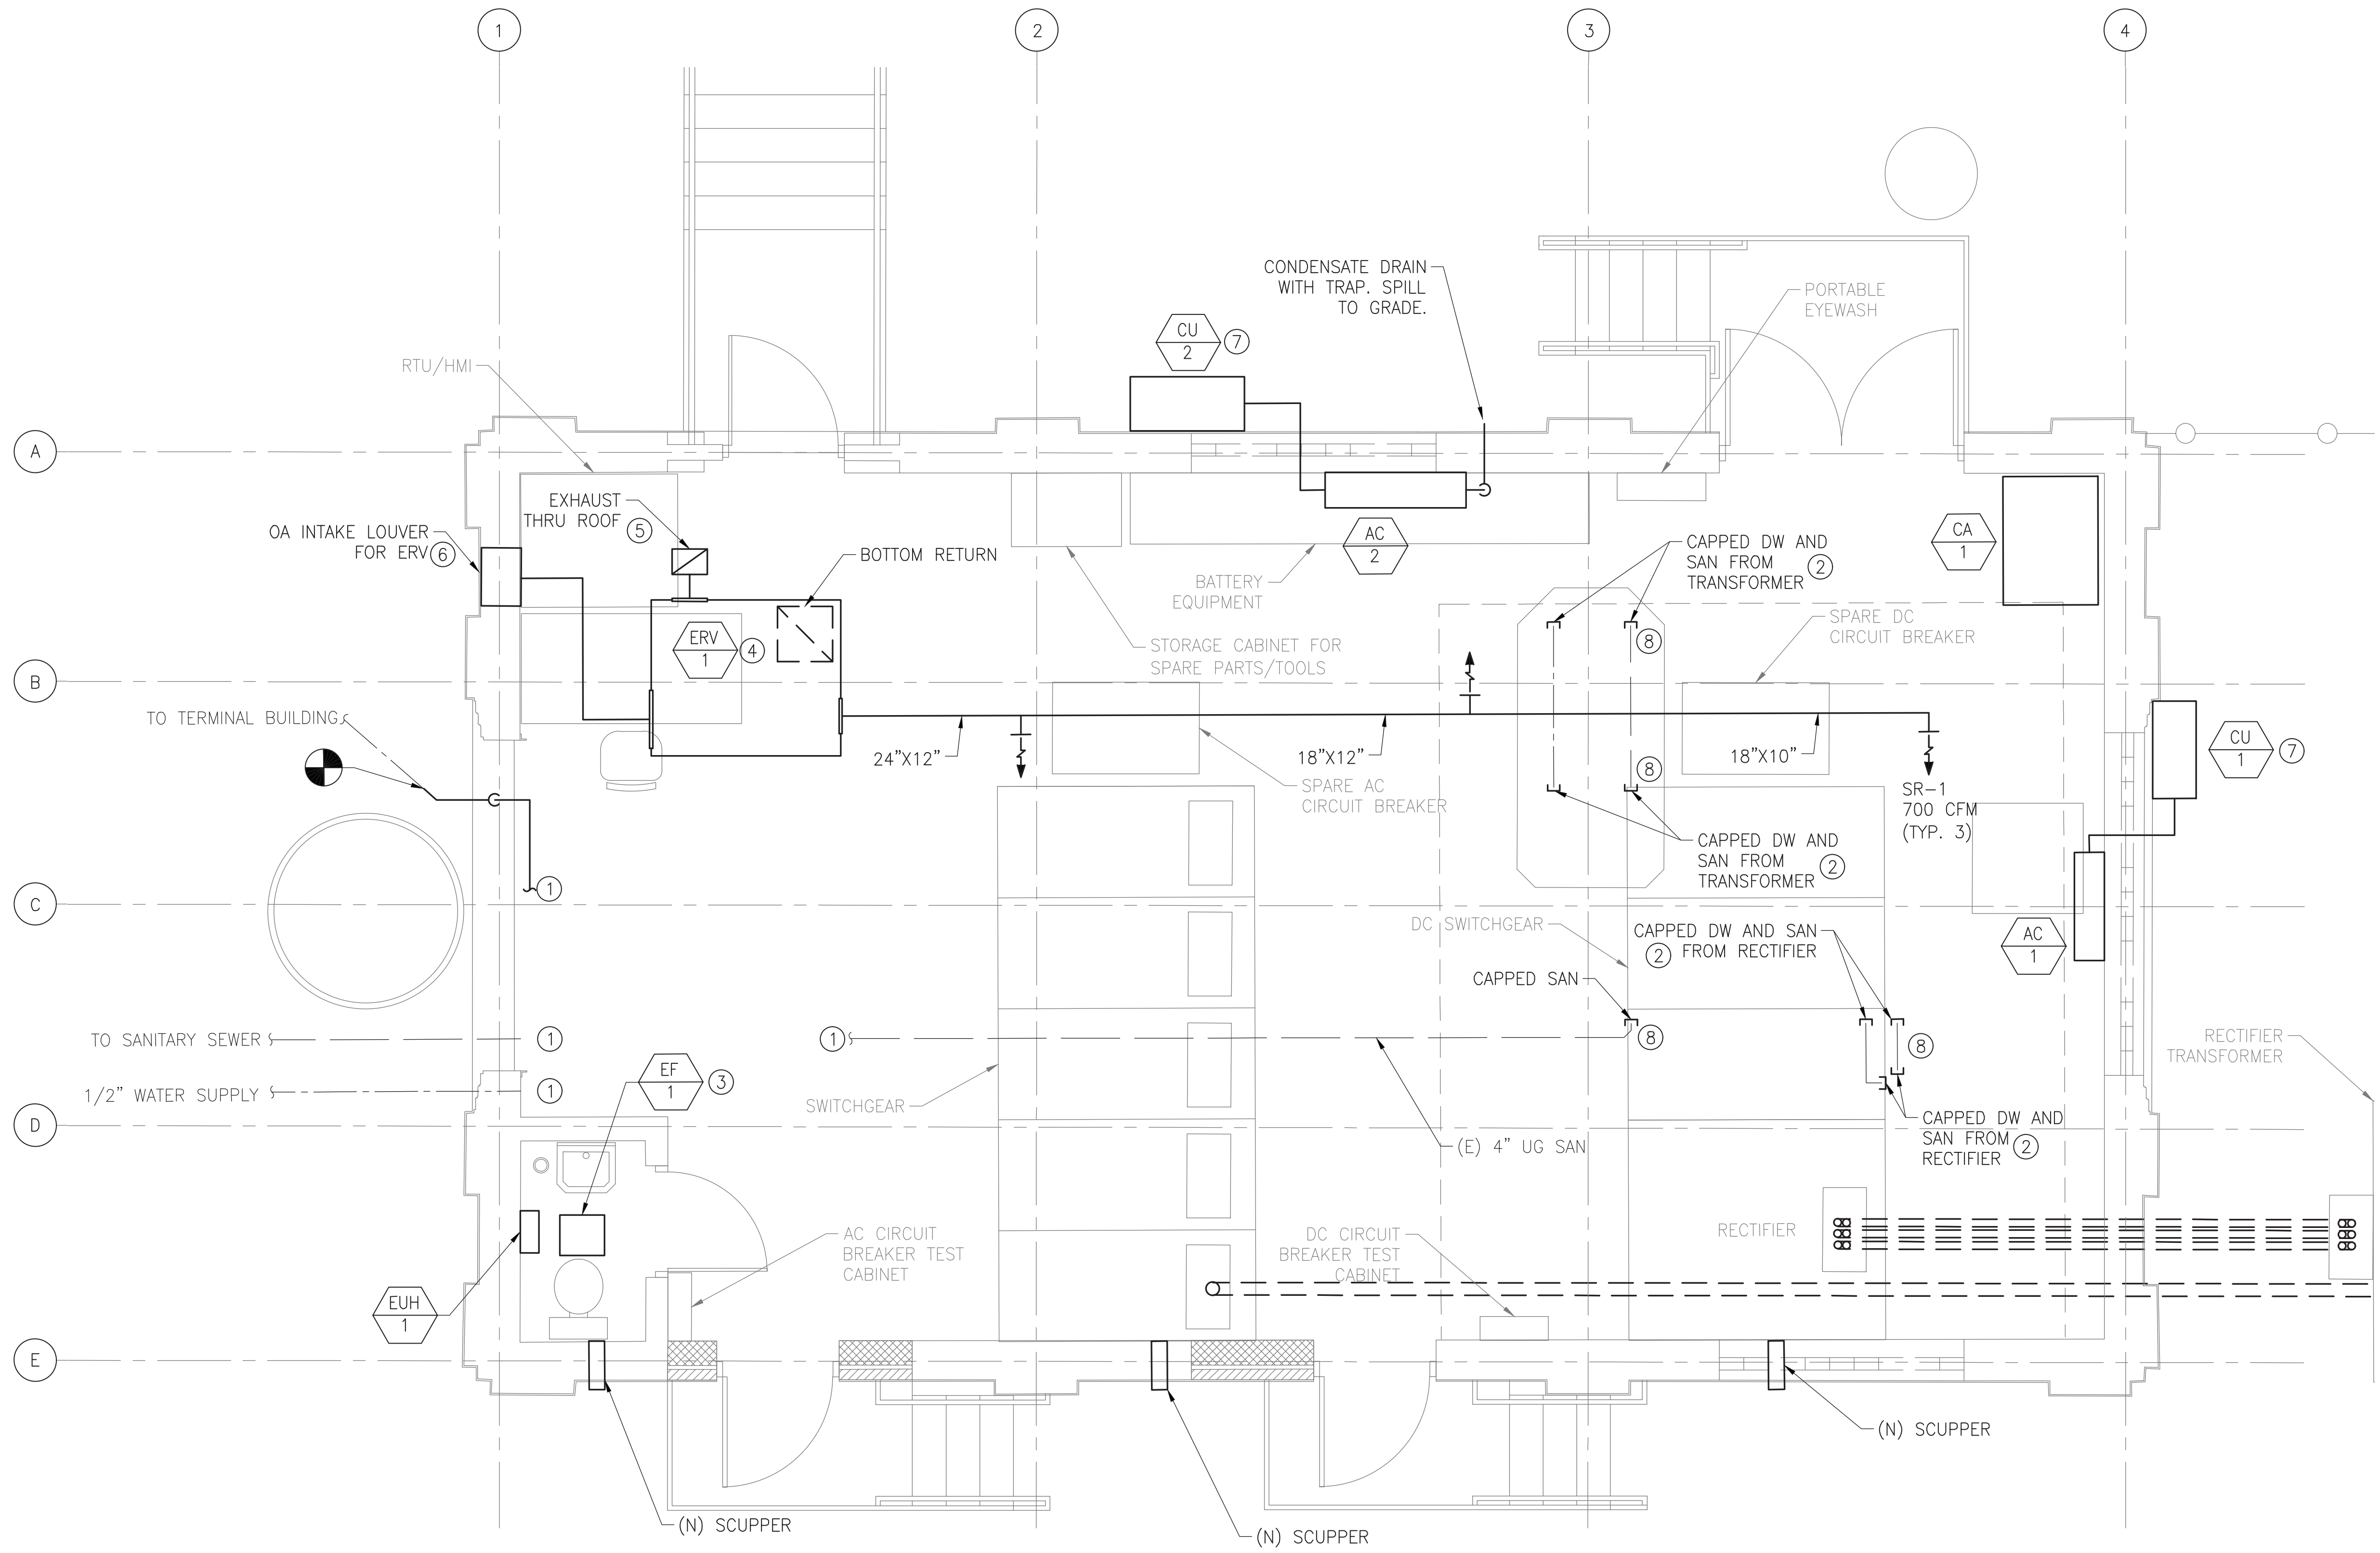

**1**  
**M402** PROPOSED FLOOR PLAN  
SCALE: 3/8" = 1'-0"

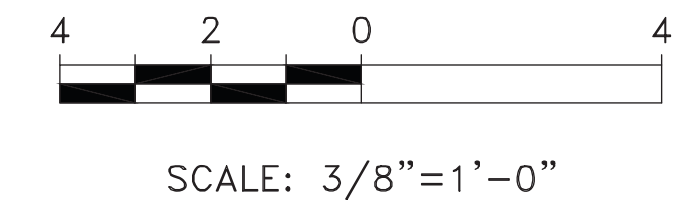

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\PI\WORKING\PTTD\68918\17AN\M402.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR ROUTE 59 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION MECHANICAL ENLARGED PLAN**

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: DWP
WORK ORDER NO: 276496	CHECKED BY: DM
SHEET NUMBER: <b>M403</b>	
DWG. NO: 4 OF 6	SHT. NO: 409 OF 452
ARCHIVE NO:	REV. NO:
COMPUTER FILE NO: 17AN-M403	REV. NO:

**GENERAL NOTES:**


1. REFER TO DRAWING M400 FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS.
2. REFER TO DRAWING M404 FOR SCHEDULES.
3. REFER TO DRAWING M405 FOR DETAILS.

**DEMOLITION KEYED NOTES:**


- 1 REMOVE THE ROOF DRAINS AND FULL LENGTH OF CONNECTED GALVANIZED STEEL RAIN LEADERS.
- 2 REMOVE ALL PLUMBING FIXTURES. ALL EXPOSED SANITARY AND DOMESTIC PIPING SHALL BE REMOVED. ALL DOMESTIC WATER PIPING BELOW FLOOR SHALL BE CAPPED AT THE FLOOR LEVEL OR REMOVED IF POSSIBLE. ANY DAMAGE TO THE FLOOR SHALL BE PATCHED TO MATCH EXISTING.
- 3 THOROUGHLY CLEAN ALL THE UNDERGROUND SANITARY PIPING AFTER REMOVING ALL THE EXISTING PIPING AND PLUMBING FIXTURES.
- 4 REFER TO DRAWING M401 FOR CONTINUATION.

**NEW WORK KEYED NOTES:**


- 1 REFER TO DRAWING M402 FOR CONTINUATION.
- 2 CAP ALL UNDERGROUND DOMESTIC WATER PIPING AT LOCATIONS SHOWN.
- 3 CLEAN THE UNDERGROUND TUNNEL DRAIN SANITARY PIPING. REPLACE THE TUNNEL DRAIN GRATE WITH SIMILAR MODEL AS EXISTING.

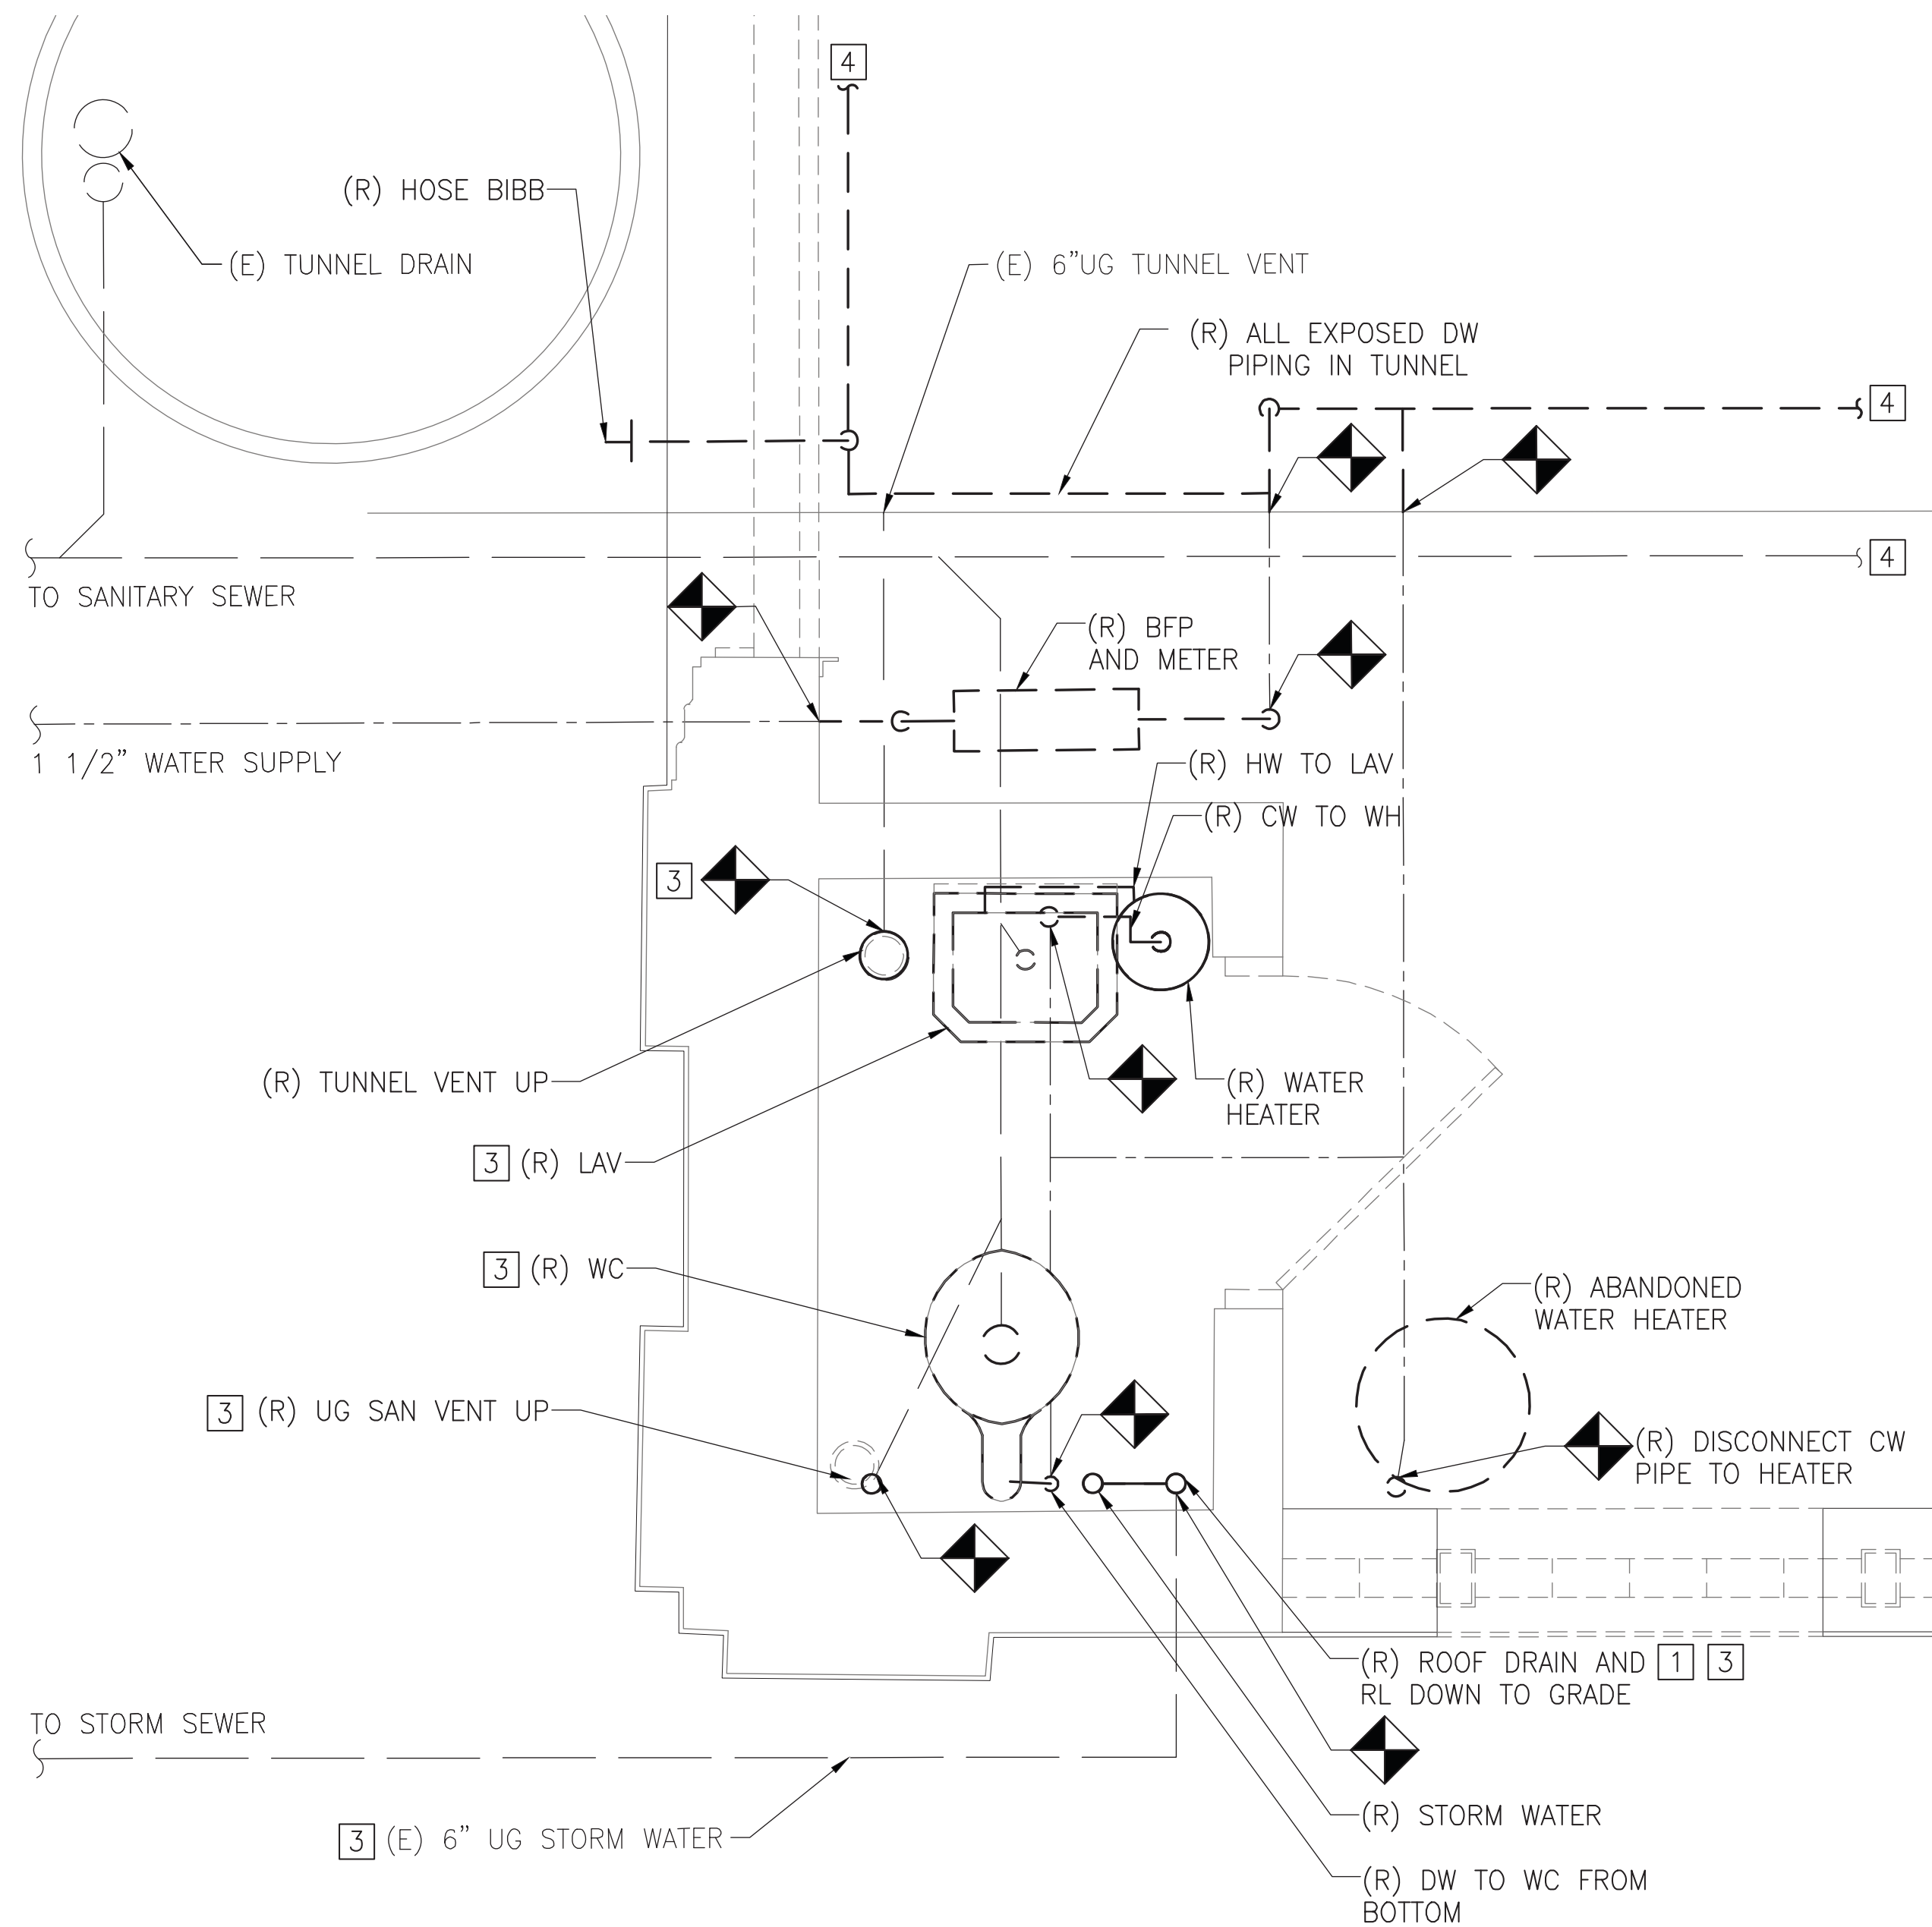

**1 ENLARGED DEMOLITION PLAN**  
SCALE: 3/4" = 1'-0"

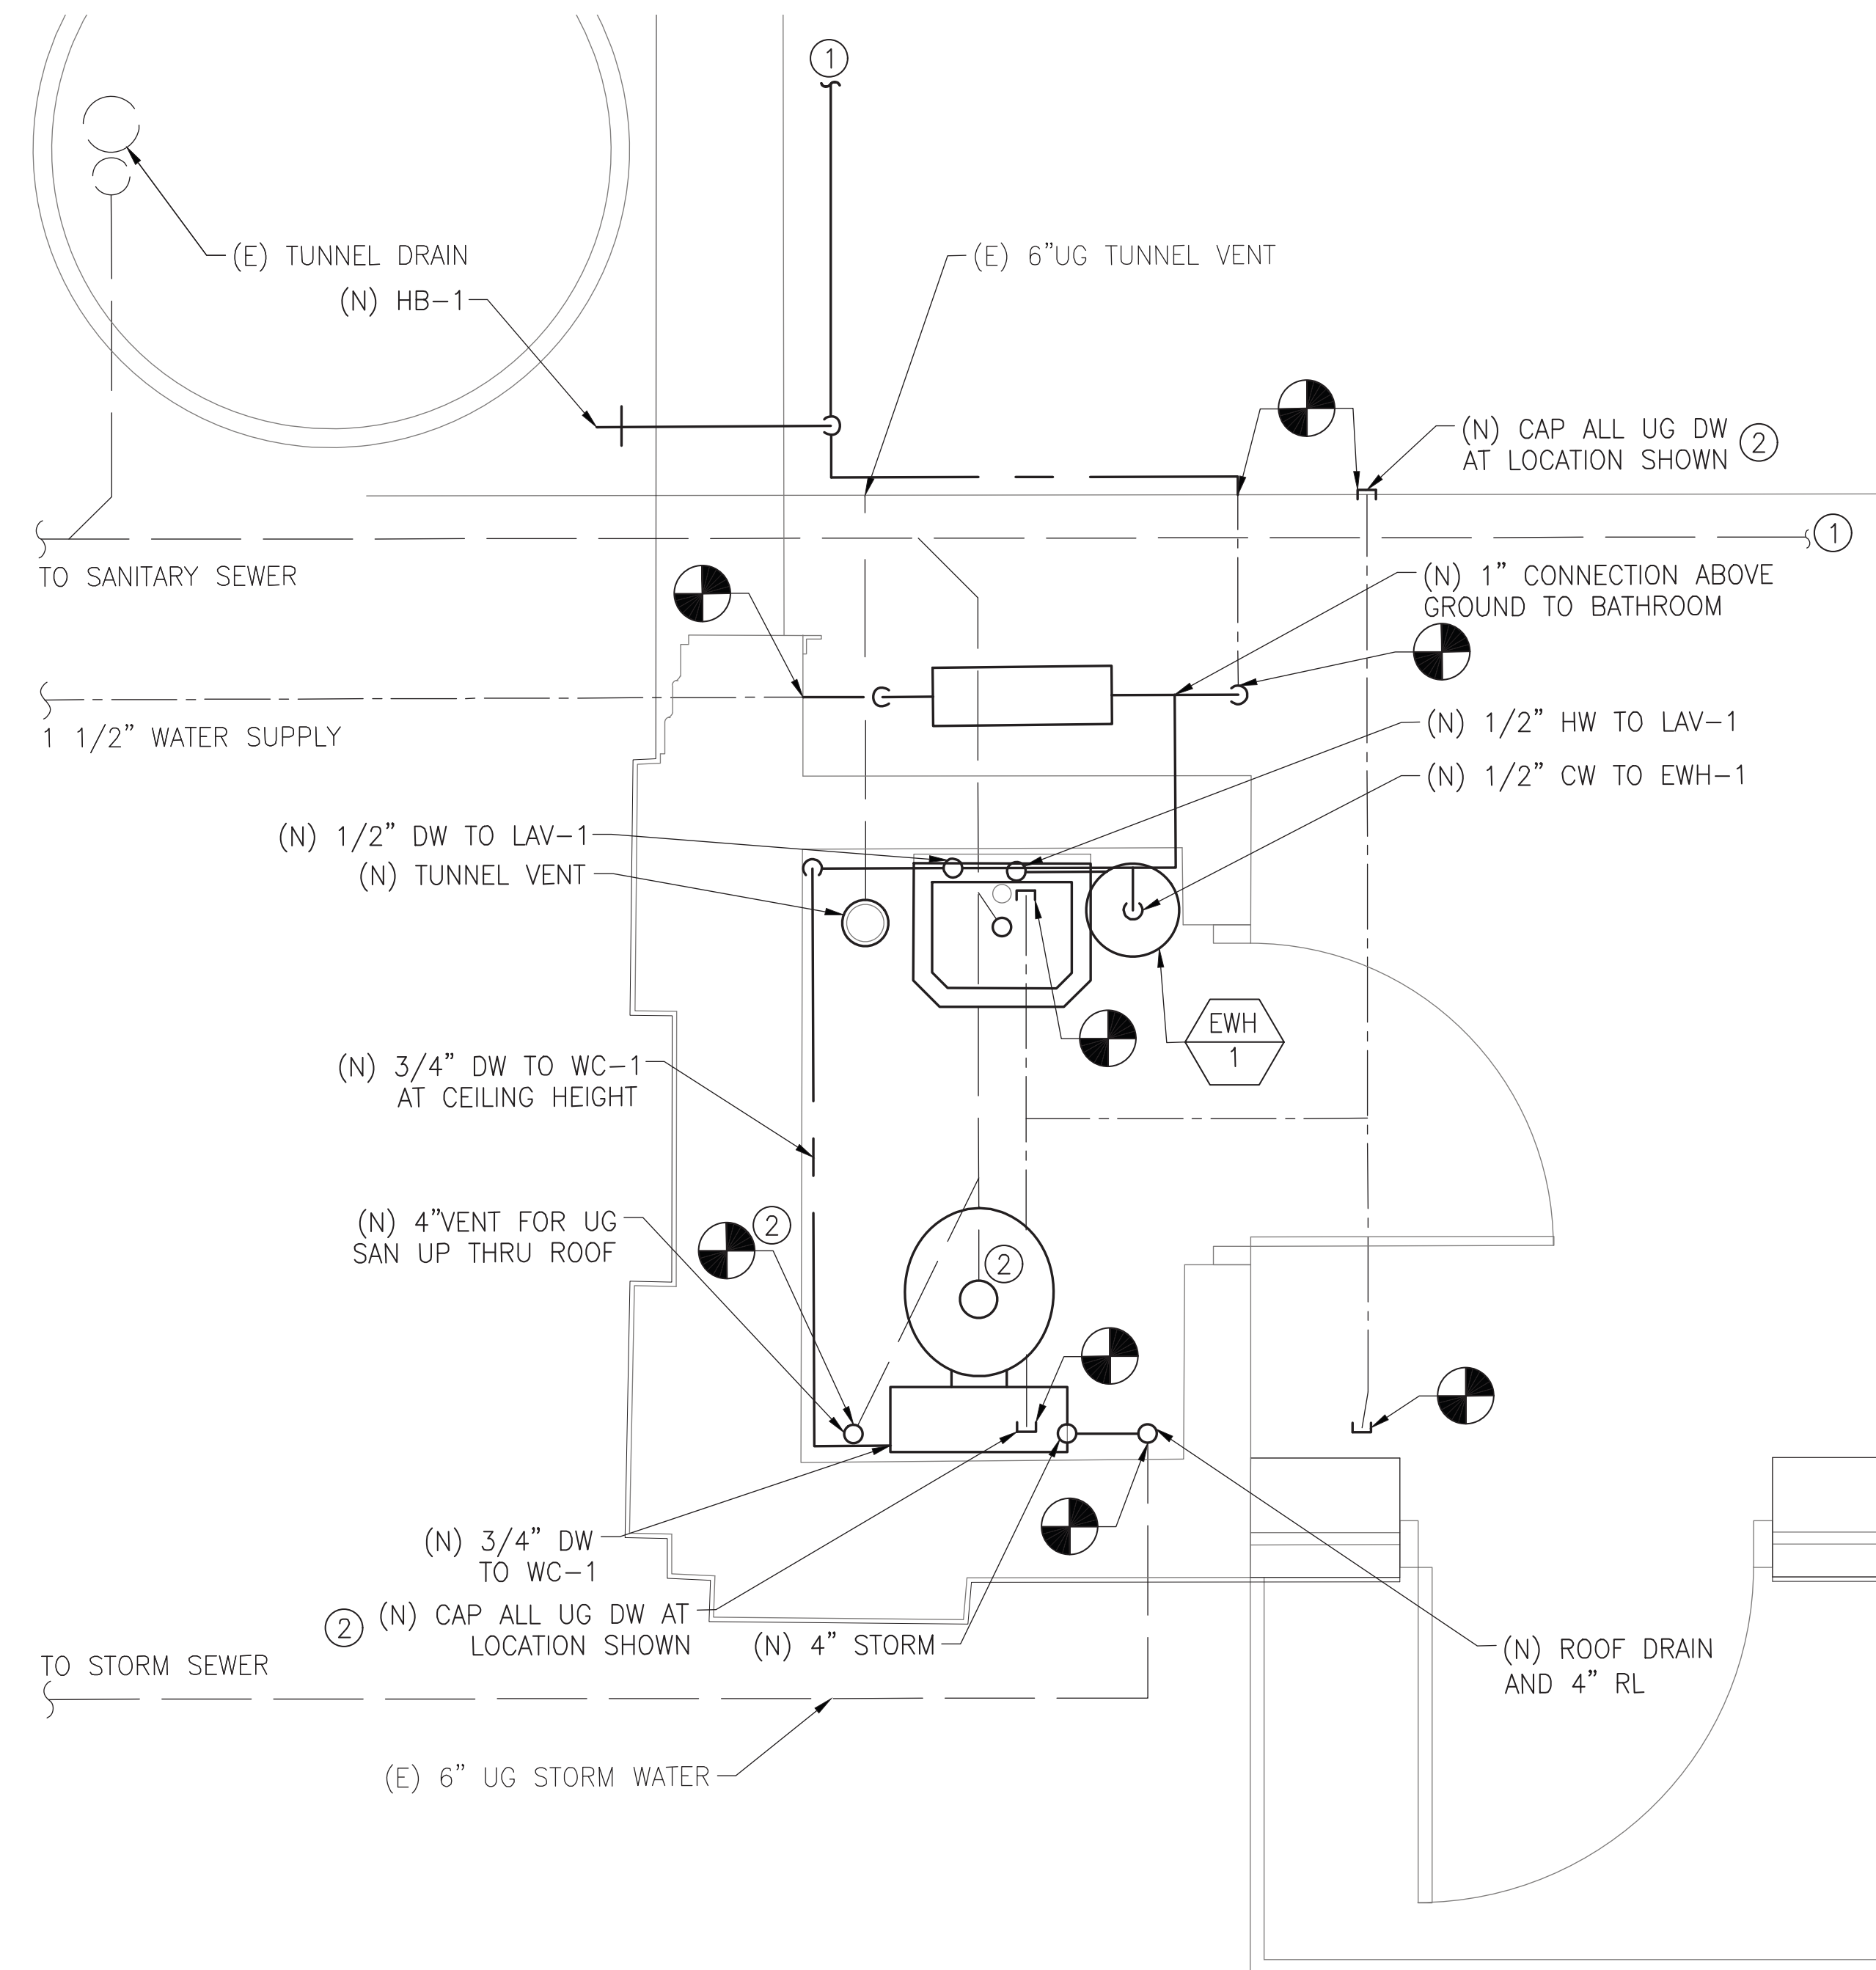

**2 ENLARGED PROPOSED PLAN**  
SCALE: 3/4" = 1'-0"



SCALE: 3/4" = 1'-0"

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

C:\PI\WORKING\PI\TD\68918\17AN\M403.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

ENERGY RECOVERY VENTILATOR		FRESH AIR	EXHAUST	SUPPLY FAN			EXHAUST FAN			WHEEL	ENERGY RECOVERY WHEEL DATA - COOLING					ENERGY RECOVERY WHEEL DATA - HEATING			ELECTRICAL DATA			MAXIMUM DIMENSIONS	MAXIMUM	BASIS OF DESIGN		REMARKS
TAG	LOCATION	CFM	CFM	EXT. SP. (IN WC)	QTY	FAN HP EACH	EXT. SP. (IN WC)	QTY	FAN HP EACH	MOTOR HP	EAT DB (F)	EAT WB (F)	LAT DB (F)	LAT WB (F)	EFFECTIVENESS (%)	EAT DB (F)	LAT DB (F)	EFFECTIVENESS (%)	V/Ø/HZ	MCA	MOCP	L x W x H (IN)	WEIGHT (LBS)	MANUFACTURER	MODEL	
ERV-1	SUBSTATION FLOOR	2100	2100	0.5	1	2	0.5	1	2	1/20	93.2	78.3	80.4	68.7	66.1	12.6	52.8	66.1	208/3/60	-	-	62X51X34	732	GREENHECK	ERV-20-15H	SEE NOTES

NOTES:

- PROVIDE CEILING MOUNTING BRACKETS. INTERLOCK THE ENERGY RECOVERY VENTILATOR AND THE SPLIT UNITS TO OPERATE IN UNISON VIA A SINGLE THERMOSTAT.
- REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.

GRILLE/REGISTER/DIFFUSER SCHEDULE									
TAG	DESCRIPTION	FRAME TYPE	CFM RANGE	AIR DEVICE SIZE	NECK SIZE	FACE SIZE	FINISH	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
SR-1	SUPPLY REGISTER	DUCT MOUNTED	700	-	18 X 10	22 X 14	WHITE	TITUS MOD# 301FL	

SPLIT SYSTEM SCHEDULE											
TAG	AREA SERVED	TOTAL COOLING CAPACITY (MBH)	TOTAL HEATING CAPACITY (MBH)	SEER	REFRIGERANT	ELECTRICAL				MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
						OUTDOOR MCA	INDOOR MCA	BREAKER SIZE (A)	V/Ø/HZ		
AC-1	SUBSTATION FLOOR	18	22	18.5	R410A	11	1	15	208/1/60	mitsubishi mod# PKA-A18HA7 FOR INDOOR AND MOD# PUZ-A18NKA7 FOR OUTDOOR	SEE NOTES
AC-2	SUBSTATION FLOOR	24	28	21.4	R410A	19	1	25	208/1/60	mitsubishi mod# PKA-A24KA7 FOR INDOOR AND MOD# PUZ-A24NHA7 FOR OUTDOOR	SEE NOTES

NOTES:

- CONTROL SPLIT HEAT PUMP UNIT AND ENERGY RECOVERY VENTILATOR WITH A SINGLE THERMOSTAT USING A PROGRAMMABLE CONTROLLER.

PLUMBING SCHEDULE						
TAG	DESCRIPTION	FIXTURE CONNECTION SIZE (IN)				MANUFACTURER & MODEL NO. (BASIS OF DESIGN)
		CW	HW	SAN	V	
WC-1	WATER CLOSET	1	-	3	2	AMERICAN STANDARD CADET FLOWISE MODEL 2462.100. VITREOUS CHINA, HIGH EFFICIENCY 1.1 GPF ULTRA-LOW CONSUMPTION, ELONGATED BOWL. PROVIDE AMERICAN STANDARD SEAT MODEL 5324.019.
LAV-1	LAVATORY	1/2	1/2	1 1/4	1 1/4	AMERICAN STANDARD LUCERNE WALL-HUNG (ADA) LAVATORY MODEL 0356.421, WALL MOUNTED SINGLE HOLE. 1 1/4" P-TRAP WITH GRID DRAIN 1/2" SUPPLIES WITH STOPS. PROVIDE AMERICAN STANDARD MODEL 1480100 FAUCET WITH A WATTS MODEL LFL1170-M2 MIXING VALVE. PROVIDE S-TRAP ASSEMBLY.
RD-1	ROOF DRAIN	-	-	4	-	JAY R. SMITH MODEL NUMBER 1005 WITH 15 1/4" LOW PROFILE CAST IRON DOME.

ELECTRIC WATER HEATER SCHEDULE				
TAG	AREA SERVED	ELECTRICAL		MANUFACTURER & MODEL NO. (BASIS OF DESIGN)
		V/Ø/HZ		
EWH-1	TOILET ROOM	120/1/60		BRADFORD WHITE MODEL M1-2U6SS WITH 7 GPH RECOVERY.

EXHAUST FAN SCHEDULE								
TAG	CFM	SP (IN.WC)	WATTS	FAN RPM	V/Ø/HZ	MOUNT	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
EF-1	75	0	18	700	120/1/60	CEILING	GREENHECK MD#SP-A50	

UNIT HEATER SCHEDULE							
TAG	BTU	CFM	POWER (KW)	AMPS	V/Ø/HZ	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
EUH-1	1706	100	0.5	4.2	120/1/60	QMARK MOD# CWH1101DSF	SEE NOTES

NOTES:

- REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.

AIR COMPRESSOR SCHEDULE							
TAG	CAPACITY (GAL.)	MAX PSI	CFM@ 90PSI	HP	V/Ø/HZ	MANUFACTURER & MODEL NO. (BASIS OF DESIGN)	REMARKS
CA-1	80	140	16	5	208/1/60	CAMPBELL HAUSFELD MODEL TQ3104	SEE NOTES

NOTES:

- REFER TO DRAWINGS FOR THE LOCATION AND QUANTITY.

CHEF ENGINEER-EMBC  
 CHEF ENGINEERING OFFICER-EMBC  
 CHEF RAIL TRANSIT OFFICER  
 SYSTEM SAFETY  
 DIRECTOR OF ENGINEERING-EMBC  
 MANAGER-ARCHITECTURE ENGINEERING

PROJECT MANAGER

HDR  
 HDR Engineering, Inc.  
 Philadelphia, PA

ARORA  
 ARCHITECTURE  
 100 MARKET STREET  
 PHILADELPHIA, PA 19107  
 PHILADELPHIA, PA 19107

REV	DATE	DESCRIPTION	BY	CHKD	APPD

CASTOR  
 ROUTE 59 TROLLEY LINE  
 TRACTION POWER SUBSTATION  
 REHABILITATION  
 MECHANICAL  
 SCHEDULES


SCALE: AS SHOWN  
 SCALE FACTOR: 1:1  
 DATE: 10/16/2017  
 DRAWN BY: DNP  
 CHECKED BY: DJM  
 WORK ORDER NO.: 276496  
 SHEET NUMBER: M404  
 DWG. NO.: 5 OF 6  
 SHT. NO.: 410 OF 452  
 ARCHIVE NO.:  
 COMPUTER FILE NO.: 17AN-M404  
 REV. NO.: ---

50% SUBMISSION  
 NOT FOR CONSTRUCTION


C:\PIWORKING\PI\168918\17AN-M404.DWG

DATE PRINTED: 10/21/2025  
 STATUS: 50% SUBMISSION


REV	DATE	DESCRIPTION	BY	CHKD	APPD

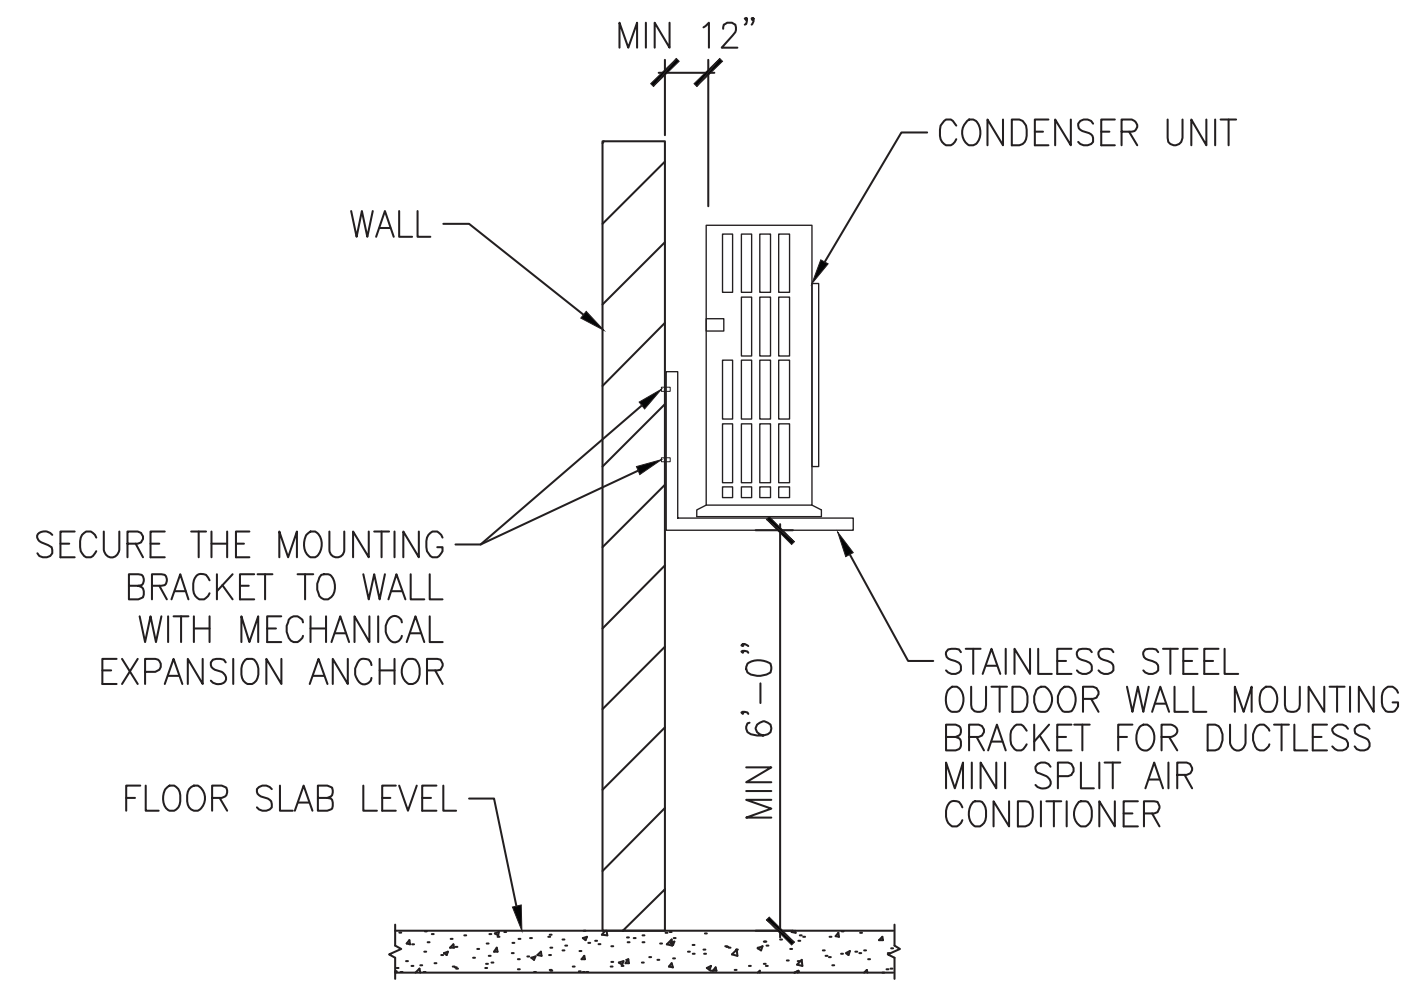


1 CONDENSER WALL MOUNTING DETAIL  
SCALE: NO SCALE

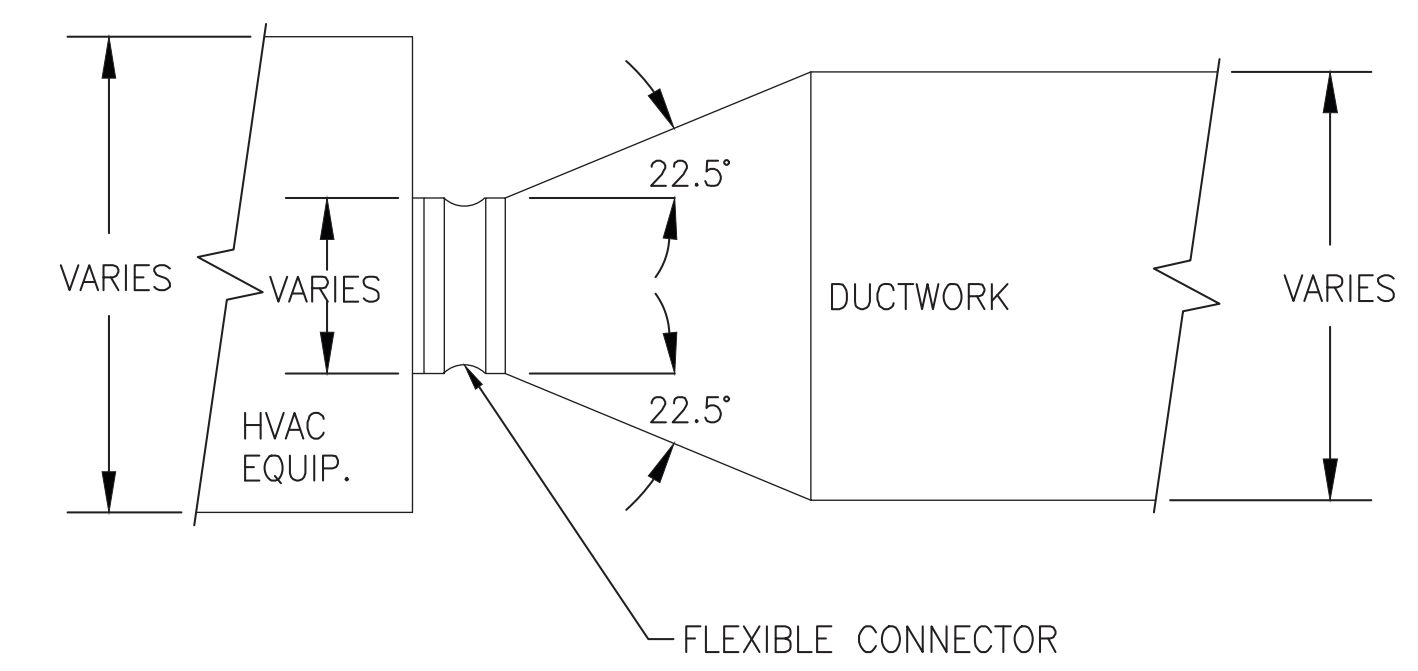

2 TYPICAL SUPPLY DUCT TRANSITION  
SCALE: NO SCALE

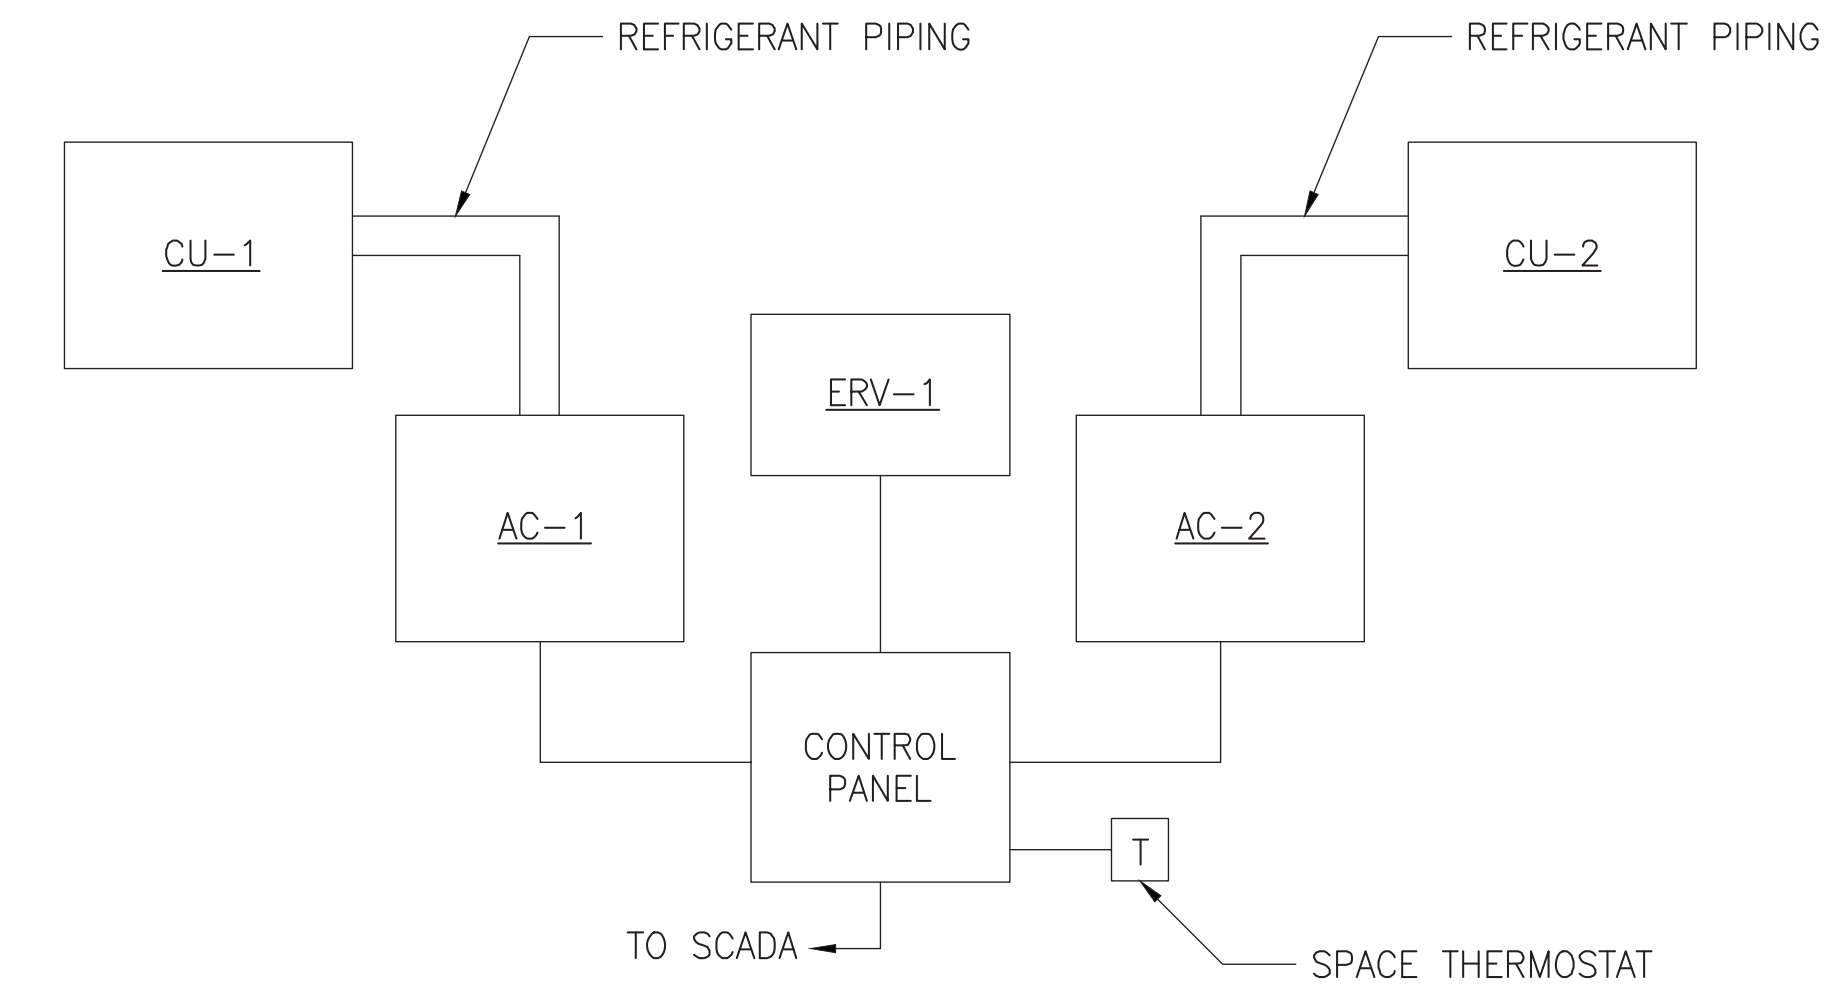

3 SUBSTATION FLOOR CONTROL DIAGRAM  
SCALE: NO SCALE

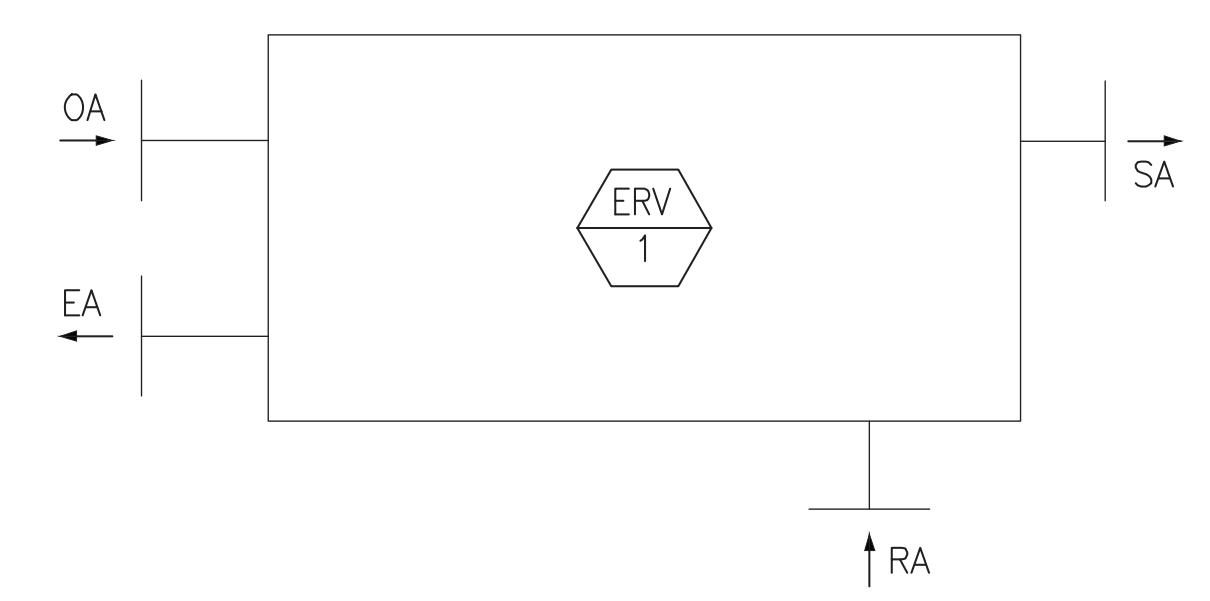

4 ERV DUCT CONNECTION-ELEVATION  
SCALE: NO SCALE

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**MECHANICAL**  
MISCELLANEOUS DETAILS

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	10/16/2017	DRAWN BY:	DJP
		CHECKED BY:	DM
WORK ORDER NO.:	276496		
SHEET NUMBER:	<b>M405</b>		
DWG. NO.:	6	OF	6
SHT. NO.:	411	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-M405		
REV. NO.:	---		

50% SUBMISSION  
NOT FOR CONSTRUCTION



**DEMOLITION SCOPE OF WORK:**



- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY OF CIRCUITRY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING TRANSFORMER AND ASSOCIATED CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING PANELS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- D. DEMOLITION OF EXISTING DISCONNECT SWITCHES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- E. DEMOLITION OF EXISTING BATTERY CHARGERS AND ASSOCIATED CONDUIT AND CIRCUITRY.
- F. DEMOLITION OF EXISTING BATTERIES AND ASSOCIATED CONDUIT AND CIRCUITRY.
- G. DEMOLITION OF EXISTING CONDUIT AND CIRCUITRY TO MECHANICAL ITEMS.
- H. DEMOLITION OF EXISTING RECEPTACLES AND ASSOCIATED CONDUIT AND CIRCUITRY.

**GENERAL NOTES:**

- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E400.
- 2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
- 3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
- 4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
- 5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
- 6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
- 7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
- 8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.
- 9. COORDINATE WORK CONCERNING EXISTING EQUIPMENT AND SERVICES IN THE BUILDING. COORDINATE REQUIRED POWER INTERRUPTIONS WITH SEPTA PER DIVISION 1 SPECIFICATIONS.
- 10. EQUIPMENT, PANELS OR DISCONNECT SWITCHES INDICATED TO BE REMOVED SHALL INCLUDE THE REMOVAL OF ALL CONDUCTORS, INCLUDING CONDUIT AND WIRING, AND SHALL BE REMOVED BACK TO SOURCE.
- 11. THE DEMOLITION OF THE EXISTING FIRE ALARM SYSTEM WILL NOT COMMENCE UNTIL THE NEW FIRE ALARM SYSTEM IS FULLY INSTALLED AND ACCEPTED BY THE AUTHORITY HAVING JURISDICTION AND SEPTA.

**KEYED NOTES:**

- 1 DE-ENERGIZE AND REMOVE 240/120V 1Ø PANEL.
- 2 EXISTING PECO UTILITY METER TO REMAIN.
- 3 DE-ENERGIZE AND REMOVE POWER TO FIRE ALARM CONTROL PANEL.
- 4 DE-ENERGIZE AND REMOVE 1 PHASE 5KVA TRANSFORMERS AND FUSED DISCONNECT SWITCH.
- 5 DE-ENERGIZE AND REMOVE EXHAUST FAN CIRCUIT.
- 6 DE-ENERGIZE AND REMOVE AIR COMPRESSOR CIRCUIT.
- 7 DE-ENERGIZE AND REMOVE BATTERIES.
- 8 DE-ENERGIZE AND REMOVE BATTERY CHARGER.
- 9 DE-ENERGIZE AND REMOVE DC DISCONNECT SWITCH.
- 10 DE-ENERGIZE AND REMOVE BATTERY TRANSFER PANEL.
- 11 DE-ENERGIZE AND REMOVE BATTERY DISCONNECT SWITCH.
- 12 DE-ENERGIZE AND REMOVE WATER HEATER CIRCUIT.
- 13 DE-ENERGIZE AND REMOVE ELECTRIC WALL HEATER CIRCUIT.
- 14 DE-ENERGIZE AND REMOVE DROPPING RESISTORS.

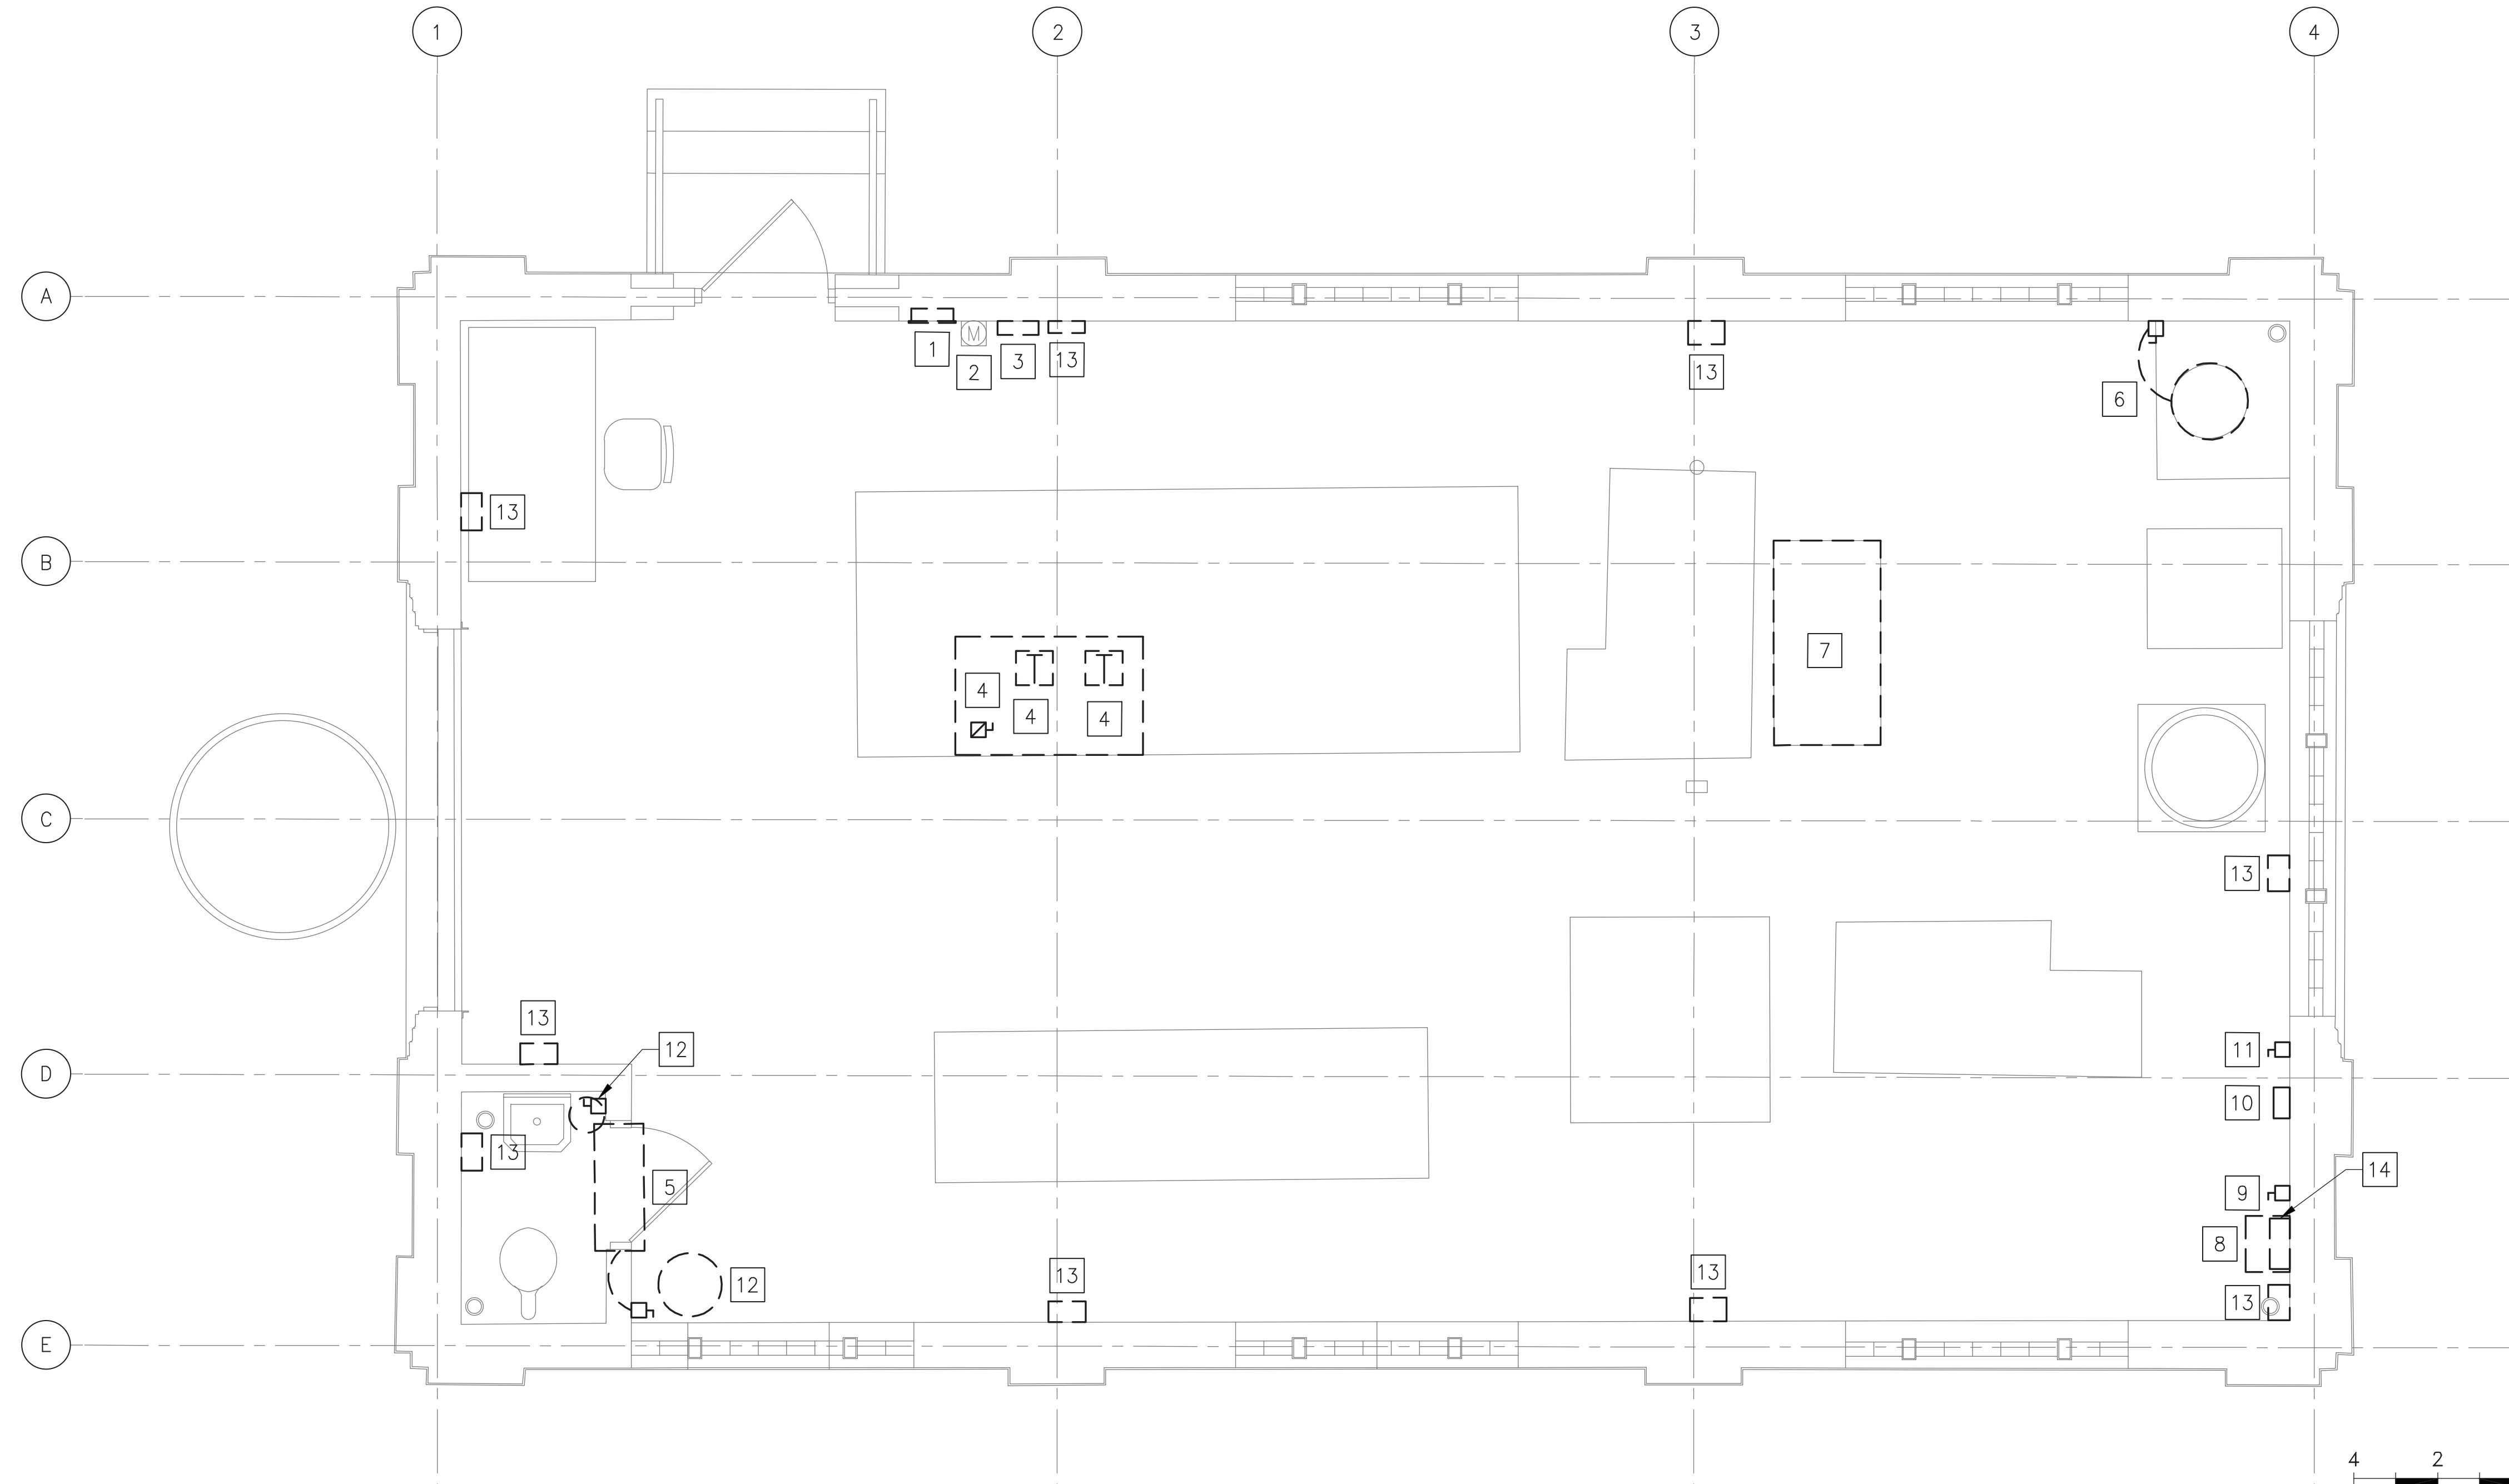

SCALE: 3/8"=1'-0"

**1 E401** ELECTRICAL DEMOLITION POWER  
SCALE: 3/8"=1'-0"

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

**SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY**  
EM&C DIVISION  
1234 MARKET ST., 13TH FL., PHILADELPHIA, PA 19107

\_\_\_\_\_  
CHIEF ENGINEER-EM&C

\_\_\_\_\_  
CHIEF ENGINEERING OFFICERS-EM&C

\_\_\_\_\_  
CHIEF RAIL TRANSIT OFFICER

\_\_\_\_\_  
SYSTEM SAFETY

\_\_\_\_\_  
DIRECTOR OF ENGINEERING-EM&C

\_\_\_\_\_  
MANAGER-ARCHITECTURE ENGINEERING

\_\_\_\_\_  
PROJECT MANAGER

**HDR**  
HDR Engineering, Inc.  
Philadelphia, PA

**ARORA**  
ARCHITECTURE  
1100 MARKET STREET  
PHILADELPHIA, PA 19107

REV	DATE	DESCRIPTION

**CASTOR**  
ROUTE 69 TROLLEY LINE  
TRACTION POWER SUBSTATION  
REHABILITATION  
ELECTRICAL  
DEMOLITION POWER FLOOR PLAN

SCALE: AS SHOWN SCALE FACTOR: 1:1  
DATE: 10/16/2017 DRAWN BY: PFG  
WORK ORDER NO.: 276496 CHECKED BY: PFG  
SHEET NUMBER: **E401**  
DWG. NO.: 2 OF 9  
SHT. NO.: 413 OF 452  
ARCHIVE NO.:  
COMPUTER FILE NO.: 17AN-E401  
REV. NO.: ---

C:\P\WORKING\PTTD\16891117AN-E401.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

**DEMOLITION SCOPE OF WORK:**


- A. REFER TO DEMOLITION DRAWINGS FOR LIMITS OF DEMOLITION. COORDINATE DISPOSAL OF EQUIPMENT WITH SEPTA. STAGING OF ITEMS FOR DEMOLITION SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY OF CIRCUITRY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. DEMOLITION OF EXISTING INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.
- C. DEMOLITION OF EXISTING EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CONDUIT AND CIRCUITRY.

**GENERAL NOTES:**

1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E400.
2. DEMOLITION PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
3. DISCUSS AND COORDINATE ALL UTILITY WORK WITH PECO PRIOR TO COMMENCING ANY UTILITY WORK.
4. OBTAIN AND ADHERE TO PECO'S INSTALLATION GUIDELINES.
5. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
6. CONTACT THE SEPTA PROJECT MANAGER IF ISSUES ARISE IN THE FIELD THAT MAY DISRUPT EXISTING SYSTEMS.
7. REMOVE ALL DEVICES, WIRING, JUNCTION BOXES AND ASSOCIATED APPURTENANCES WITHIN SCOPE OF DEMOLITION.
8. LEGALLY DISPOSE OF DEVICES INDICATED TO BE REMOVED. OFFER EQUIPMENT TO SEPTA AND DISPOSE OF THE EQUIPMENT THAT SEPTA DOES NOT WISH TO RETAIN.

**KEYED NOTES:**

- 1 DE-ENERGIZE AND REMOVE LIGHTING FIXTURES AND SWITCHES. REMOVE ALL WIRE AND CONDUIT BACK TO SOURCE.

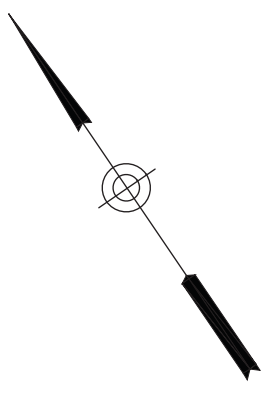


SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY  
EM&C DIVISION  
1234 MARKET ST., 13TH FL., PHILADELPHIA, PA 19107

CHIEF ENGINEER-EM&C  
CHIEF ENGINEERING OFFICERS-EM&C  
CHIEF RAIL TRANSIT OFFICER  
SYSTEM SAFETY  
DIRECTOR OF ENGINEERING-EM&C  
MANAGER-ARCHITECTURE  
PROJECT MANAGER

**HDR**  
HDR Engineering, Inc.  
Philadelphia, PA

**ARORA**  
ARCHITECTS  
1100 MARKET STREET  
PHILADELPHIA, PA 19107

REV	DATE	DESCRIPTION	BY	CKD	APD

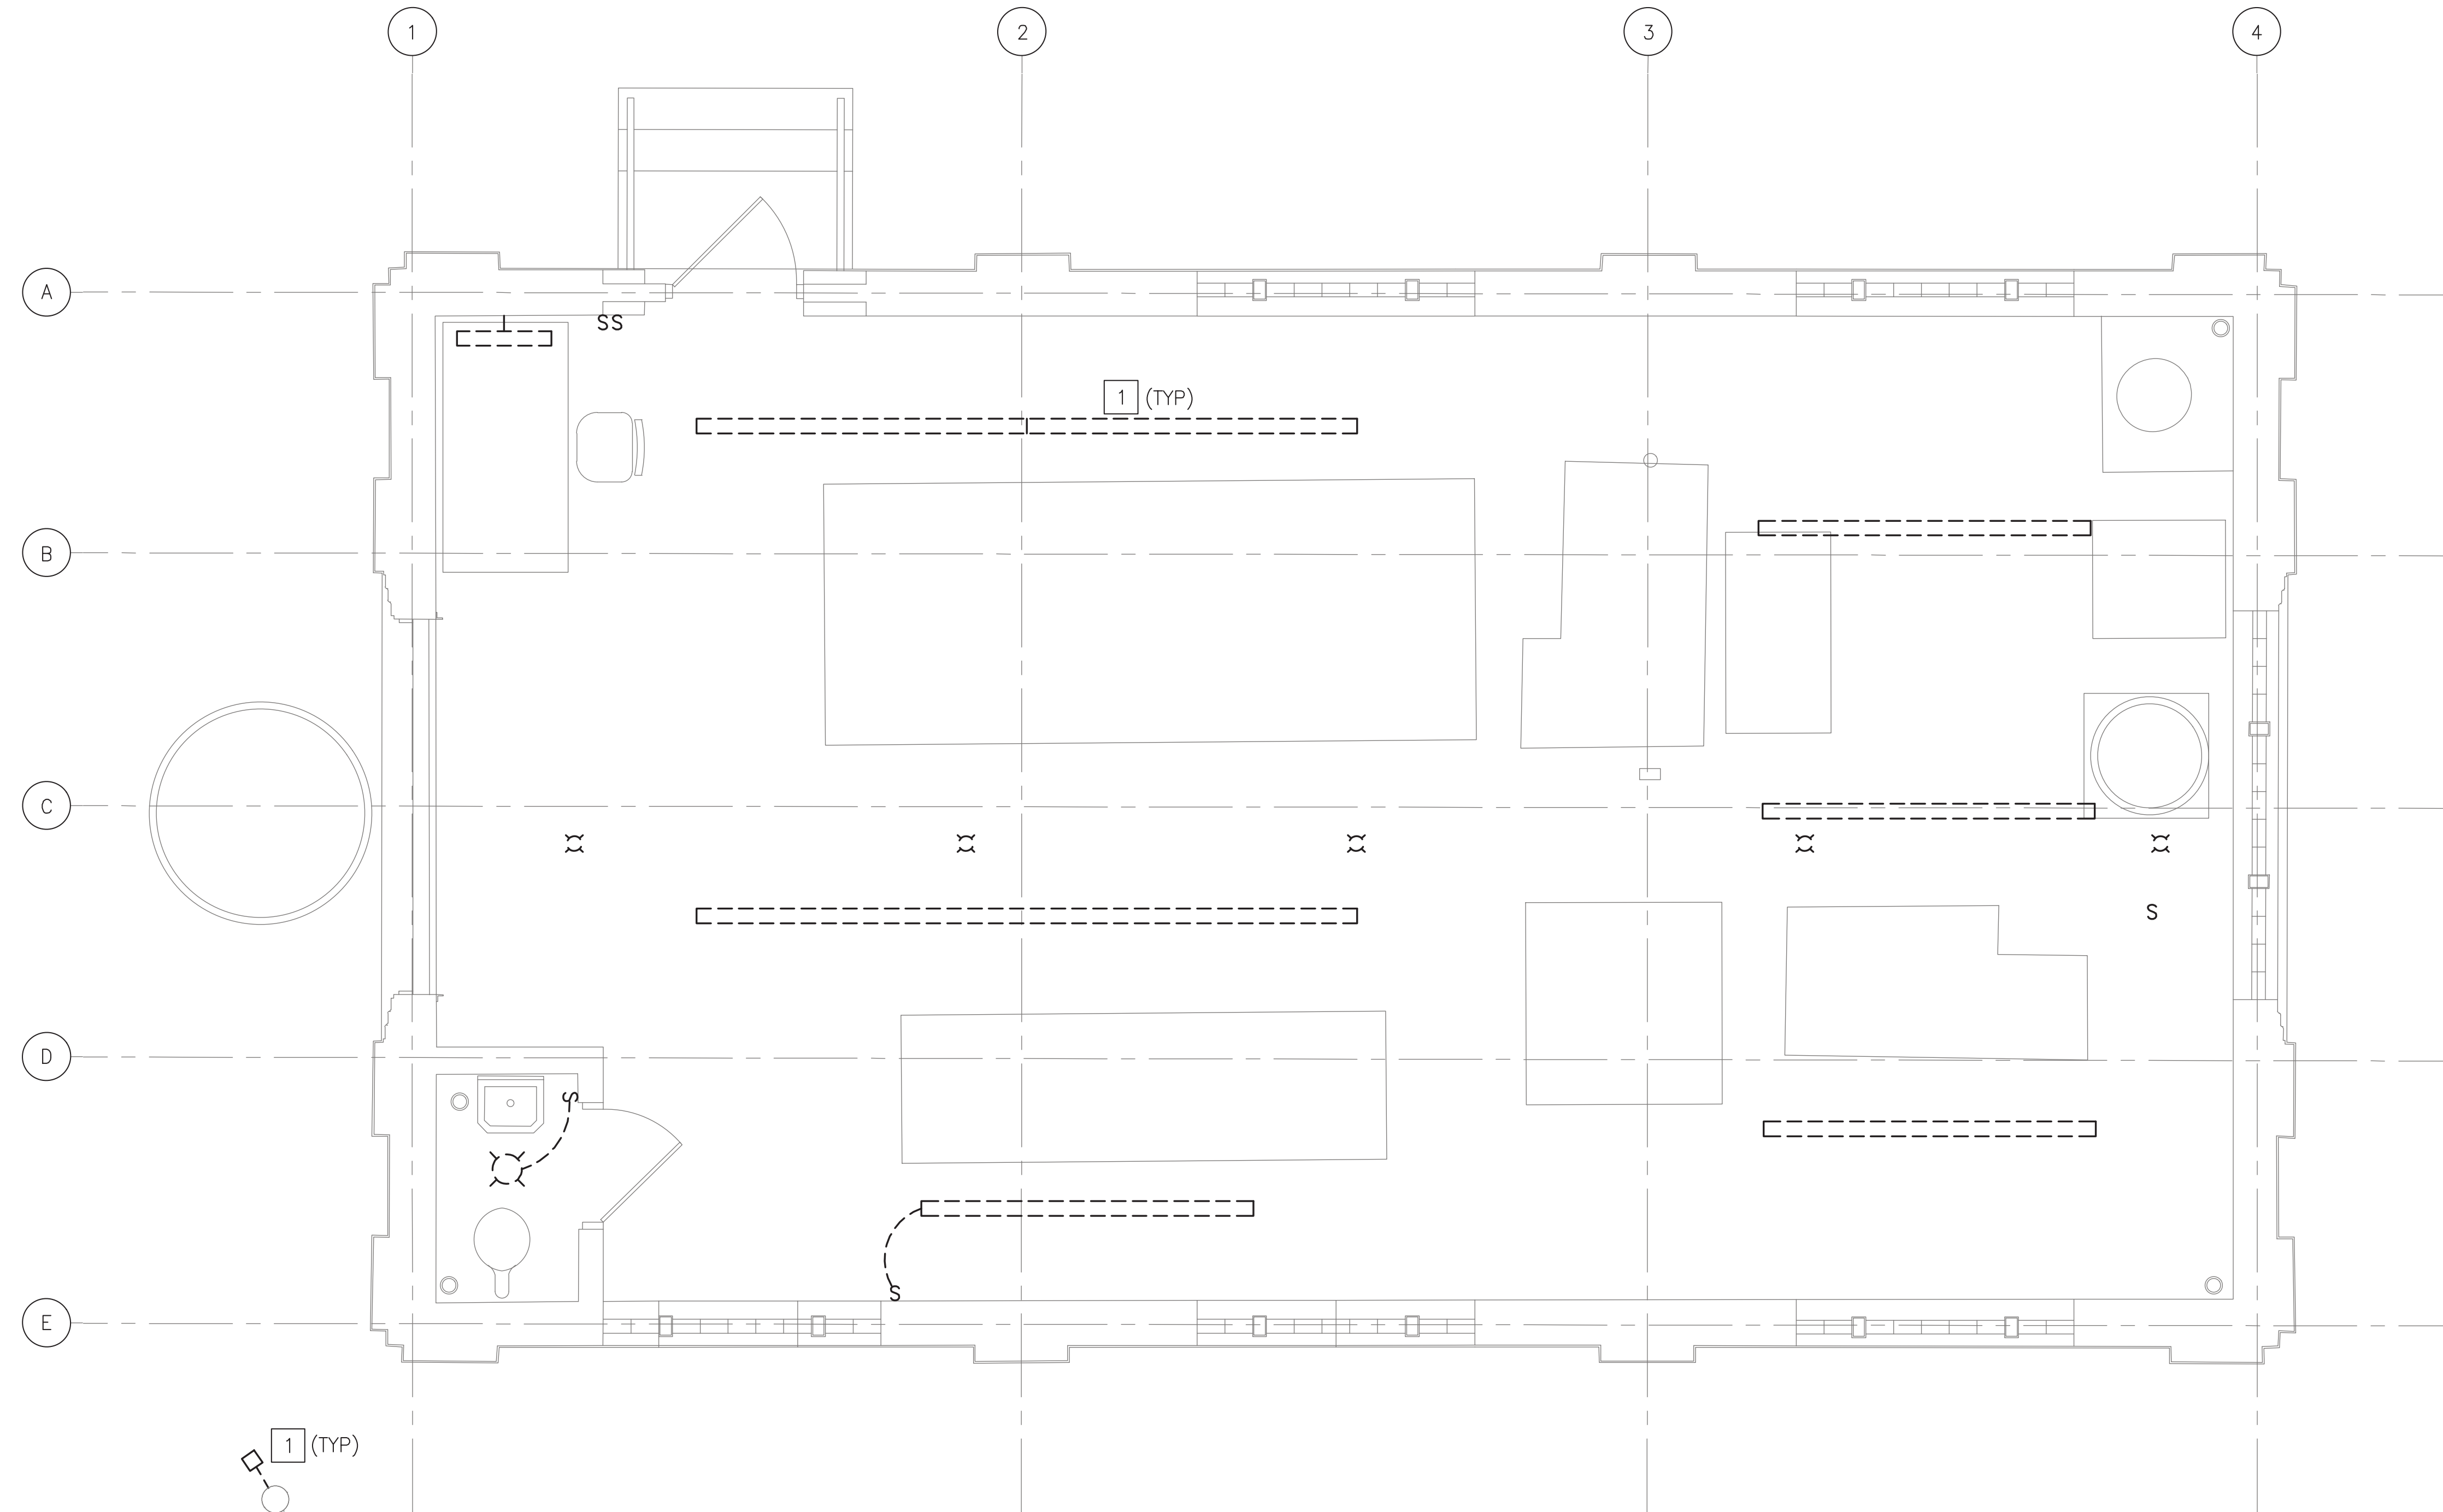

**1**  
**E402** ELECTRICAL DEMOLITION LIGHTING  
SCALE: 3/8"=1'-0"

4 2 0 4  
SCALE: 3/8"=1'-0"

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ELECTRICAL**  
DEMOLITION LIGHTING FLOOR PLAN

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: P&G
WORK ORDER NO. 276496	CHECKED BY: P&G
SHEET NUMBER <b>E402</b>	
DWG. NO. 3 OF 9	SHT. NO. 414 OF 452
COMPUTER FILE NO. 17AN-E402	REV. NO. ---

C:\P\WORKING\PTTD\16891117AN-E402.DWG

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

**PROPOSED SCOPE OF WORK:**



- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW TRANSFORMERS AND ASSOCIATED CIRCUITRY.
- C. NEW PANELS AND ASSOCIATED CIRCUITRY.
- D. NEW DISCONNECT SWITCHES AND ASSOCIATED CIRCUITRY.
- E. NEW TRANSFER SWITCHES AND ASSOCIATED CIRCUITRY.
- F. NEW BATTERY CHARGERS AND ASSOCIATED CIRCUITRY.
- G. NEW BATTERIES AND ASSOCIATED CIRCUITRY.
- H. NEW CIRCUITRY TO MECHANICAL ITEMS.
- I. NEW RECEPTACLES AND ASSOCIATED CIRCUITRY.

**GENERAL NOTES:**


- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E400.
- 2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
- 3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
- 4. EXISTING DISTRIBUTION GEAR SHALL REMAIN ENERGIZED UNTIL ALL NEW FEEDERS ARE READY FOR CUT OVER.
- 5. REFER TO PANEL SCHEDULES ON DRAWING E408 FOR ADDITIONAL REQUIREMENTS.
- 6. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES ALL NEW PANELS AFTER NEW WORK IS COMPLETE.
- 7. COORDINATE ALL CONNECTIONS TO MECHANICAL EQUIPMENT WITH TRADE CONTRACTOR PRIOR TO COMMENCING CIRCUITRY.
- 8. ALL INTERIOR RECEPTACLES SHALL BE GFCI TYPE AND MOUNTED AT 36" AFF UNLESS OTHERWISE INDICATED.
- 9. ALL EXTERIOR RECEPTACLE SHALL BE GFCI TYPE MOUNTED IN A WEATHERPROOF BOX AND MOUNTED AT 48" AFG UNLESS OTHERWISE INDICATED.

**KEYED NOTES:**

- ① FURNISH AND INSTALL PANELS. REFER TO PANEL SCHEDULES ON DRAWING E408.
- ② FURNISH AND INSTALL BATTERIES AND BATTERY RACK.
- ③ FURNISH AND INSTALL BATTERY FUSED DISCONNECT SWITCH.
- ④ FURNISH AND INSTALL 125V DC PANEL.
- ⑤ FURNISH AND INSTALL BATTERY CHARGER.
- ⑥ FURNISH AND INSTALL IN CRAWL SPACE BELOW.
- ⑦ AC-2 IS POWERED FROM CIRCUIT SUPPLYING CU-2.
- ⑧ AC-1 IS POWERED FROM CIRCUIT SUPPLYING CU-1.
- ⑨ FIBER OPTIC INTERCONNECTION CABINET. REFER TO COMMUNICATIONS WORKSCOPE.
- ⑩ FURNISH AND INSTALL SECONDARY 150A, 208V, 3Ø ENCLOSED CIRCUIT BREAKER.
- ⑪ FURNISH AND INSTALL DROPPING RESISTORS.
- ⑫ FURNISH AND INSTALL BATTERY TRANSFER PANEL.
- ⑬ FURNISH AND INSTALL 1P/20A 120V CIRCUIT TO FIRE ALARM CONTROL PANEL.
- ⑭ FURNISH AND INSTALL OVERHEAD DOOR AND CONTROLLER.

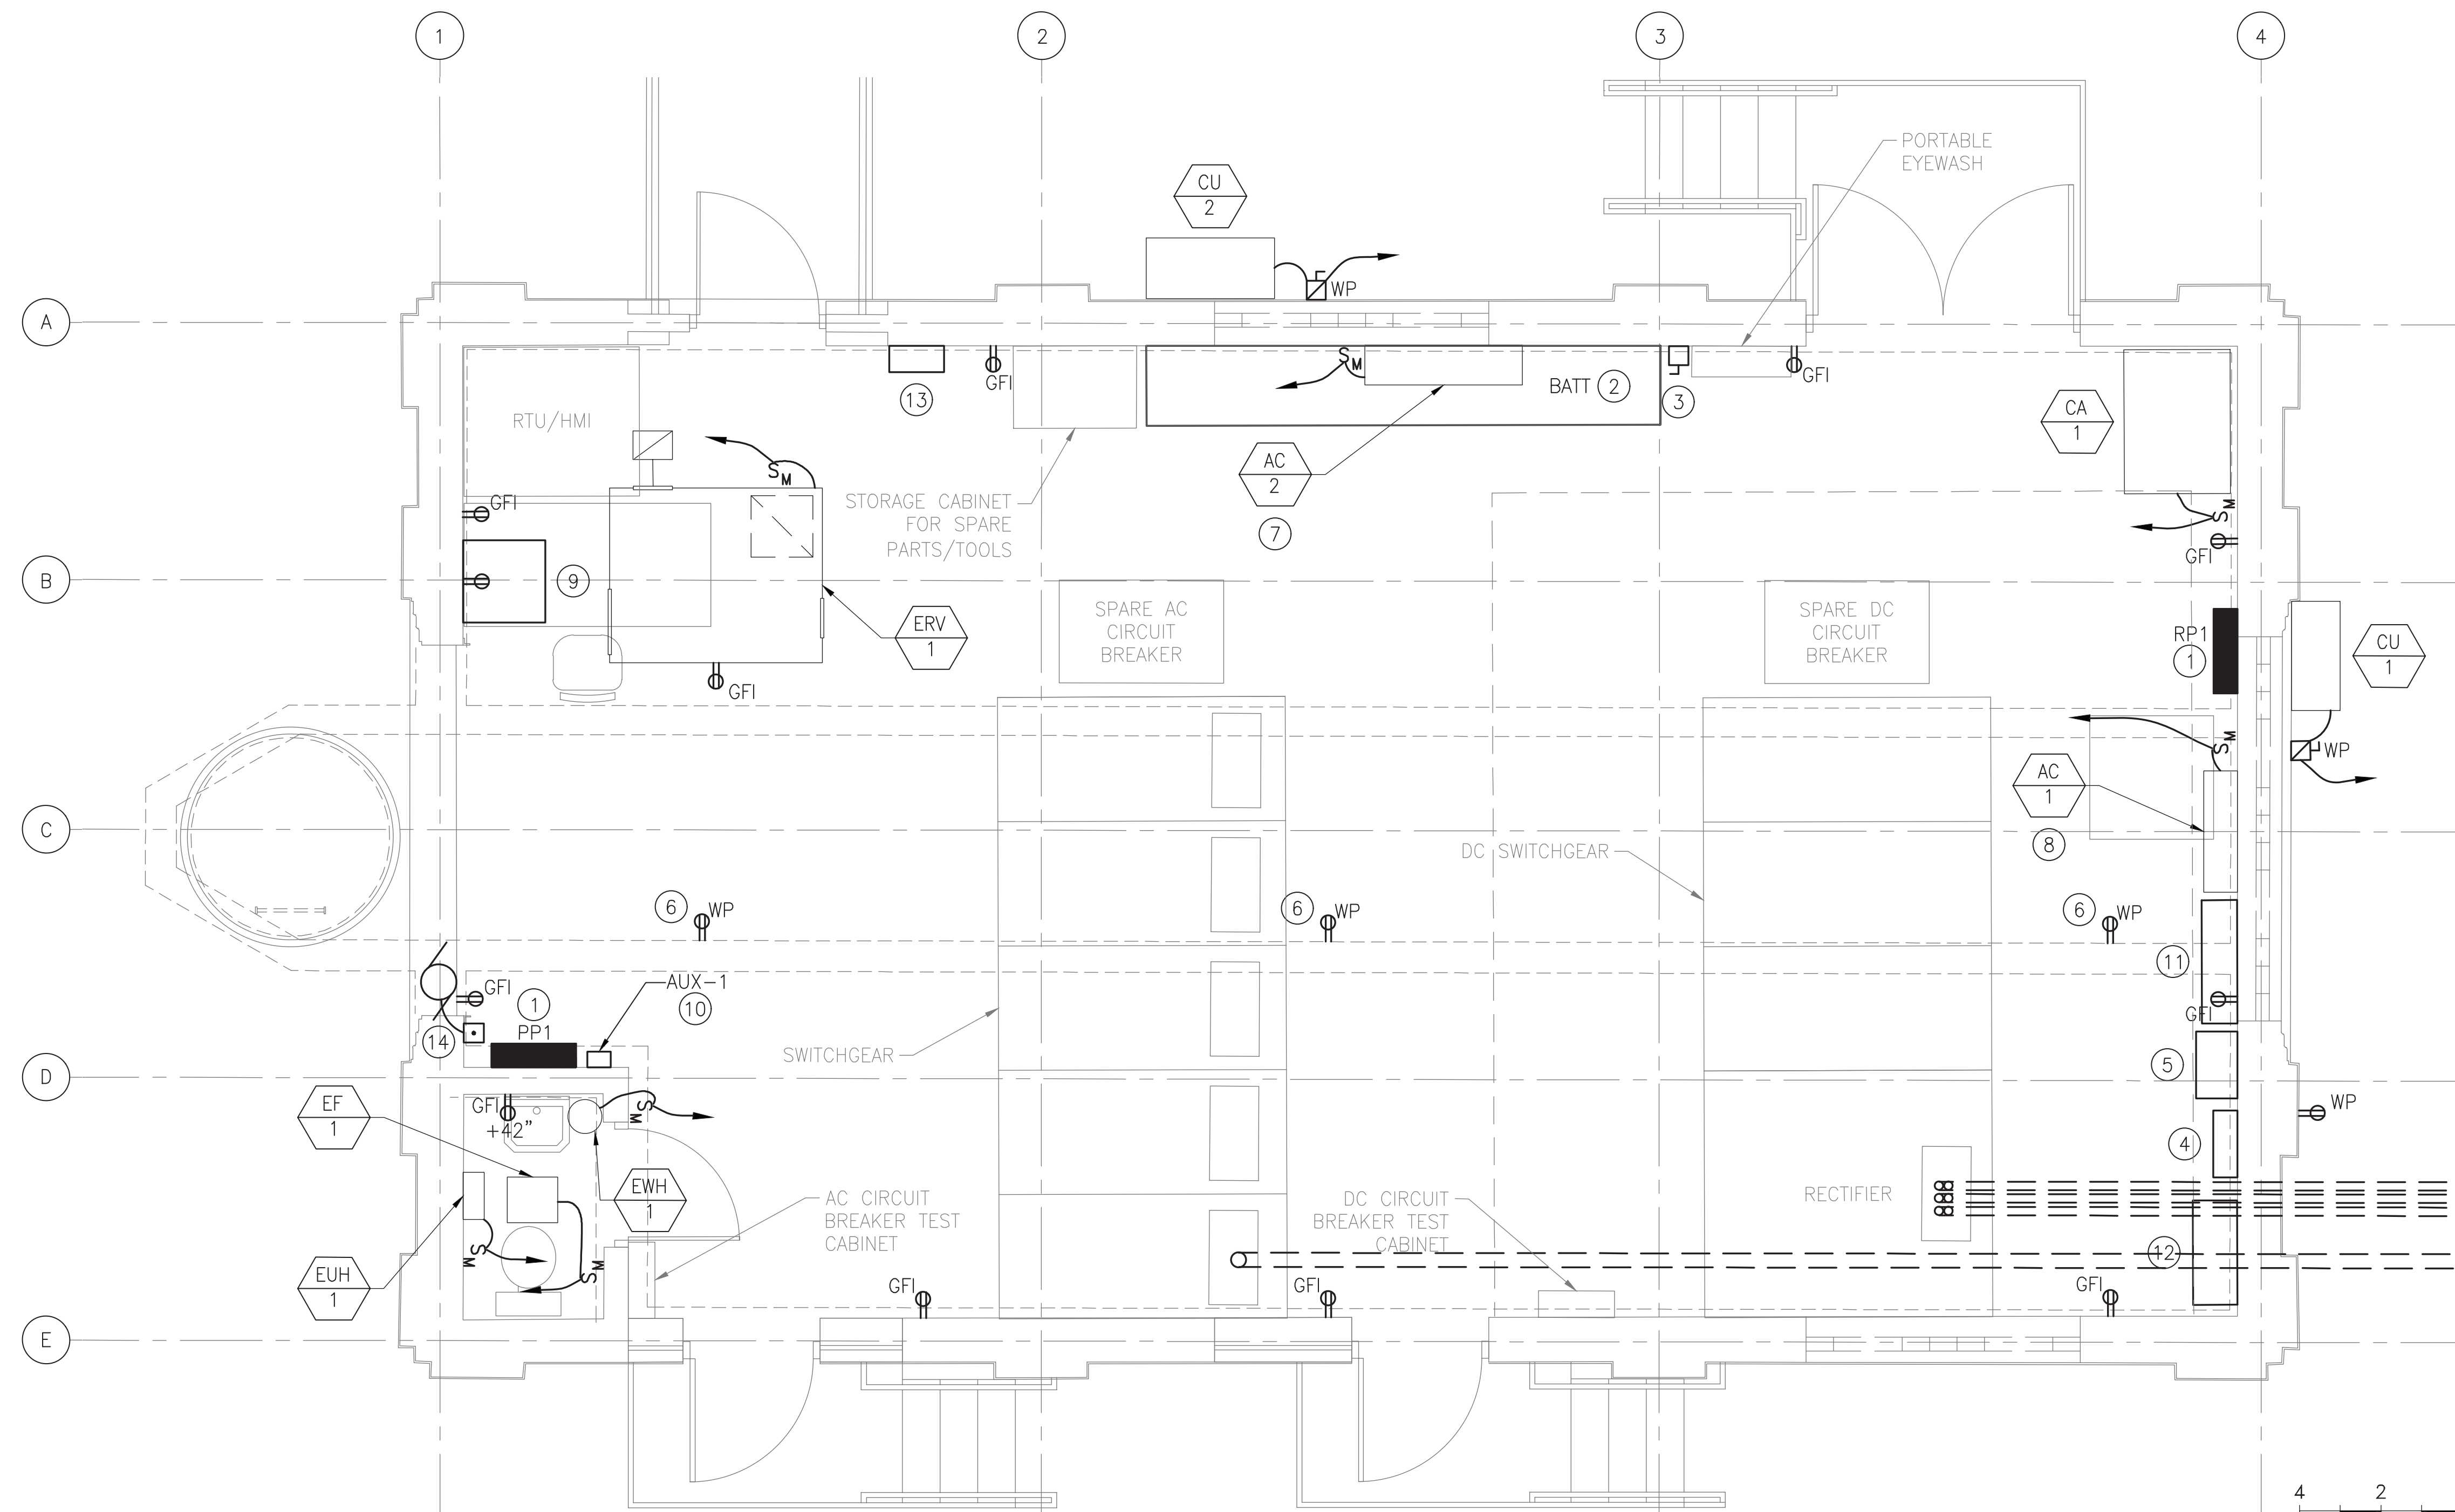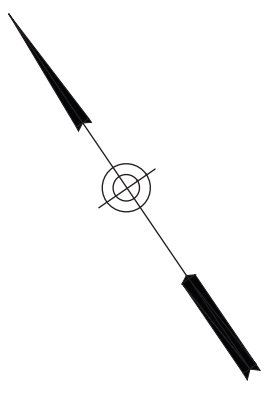

**1**  
**E403** ELECTRICAL PROPOSED POWER  
SCALE: 3/8"=1'-0"

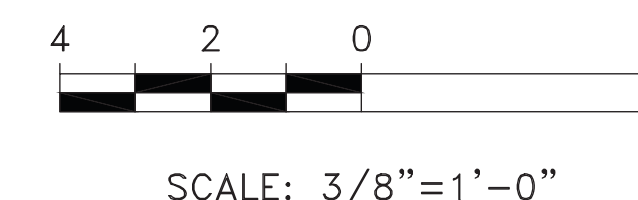

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**



CHIEF ENGINEER-EM&C  
CHIEF ENGINEERING OFFICER-EM&C  
CHIEF RAIL TRANSIT OFFICER  
SYSTEM SAFETY  
DIRECTOR OF ENGINEERING-EM&C  
MANAGER-ARCHITECTURE  
PROJECT MANAGER



REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
**ROUTE 59 TROLLEY LINE**  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ELECTRICAL**  
**PROPOSED POWER FLOOR PLAN**

SCALE: AS SHOWN  
SCALE FACTOR: 1:1  
DATE: 10/16/2017  
DRAWN BY: PGG  
CHECKED BY: PGG  
WORK ORDER NO.: 276496  
SHEET NUMBER: **E403**  
DWS NO.: 4 OF 9  
SHT NO.: 415 OF 452  
ARCHIVE NO.:  
COMPUTER FILE NO.: 17AN-E403  
REV. NO.:  
STATUS: 50% SUBMISSION

C:\P\WORKING\PTTD\16891117AN-E403.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

**PROPOSED SCOPE OF WORK:**

- A. REFER TO PROPOSED DRAWINGS FOR NEW WORK. STAGING OF NEW WORK SHALL BE COORDINATED WITH THE SEPTA PROJECT MANAGER TO ENSURE CONTINUITY AND ENSURING SEAMLESS OPERATIONS OF EQUIPMENT.
- B. NEW INTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.
- C. NEW EXTERIOR LIGHTING AND ASSOCIATED SWITCHING AND CIRCUITRY.

**GENERAL NOTES:**


- 1. FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E400.
- 2. PLAN IS DIAGRAMMATIC. FIELD VERIFY EXACT LOCATIONS AND DIMENSIONS.
- 3. THE CONTRACTOR SHALL NOT INTERRUPT EXISTING POWER DISTRIBUTION SYSTEMS.
- 4. REFER TO PANEL SCHEDULES ON DRAWING E408 FOR ADDITIONAL REQUIREMENTS.
- 5. PROVIDE COMPLETE AND ACCURATE CIRCUIT DIRECTORIES IN ALL PANELS AFTER NEW WORK IS COMPLETE.
- 6. REFER TO LUMINAIRE SCHEDULE ON DRAWING E407.

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ELECTRICAL**  
PROPOSED LIGHTING FLOOR PLAN

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: PJS
WORK ORDER NO. 276496	CHECKED BY: PJS
SHEET NUMBER: <b>E404</b>	
DWG. NO.: 5 OF 9	
SHT. NO.: 416 OF 452	
COMPUTER FILE NO.: 17AN-E404	REV. NO.:

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

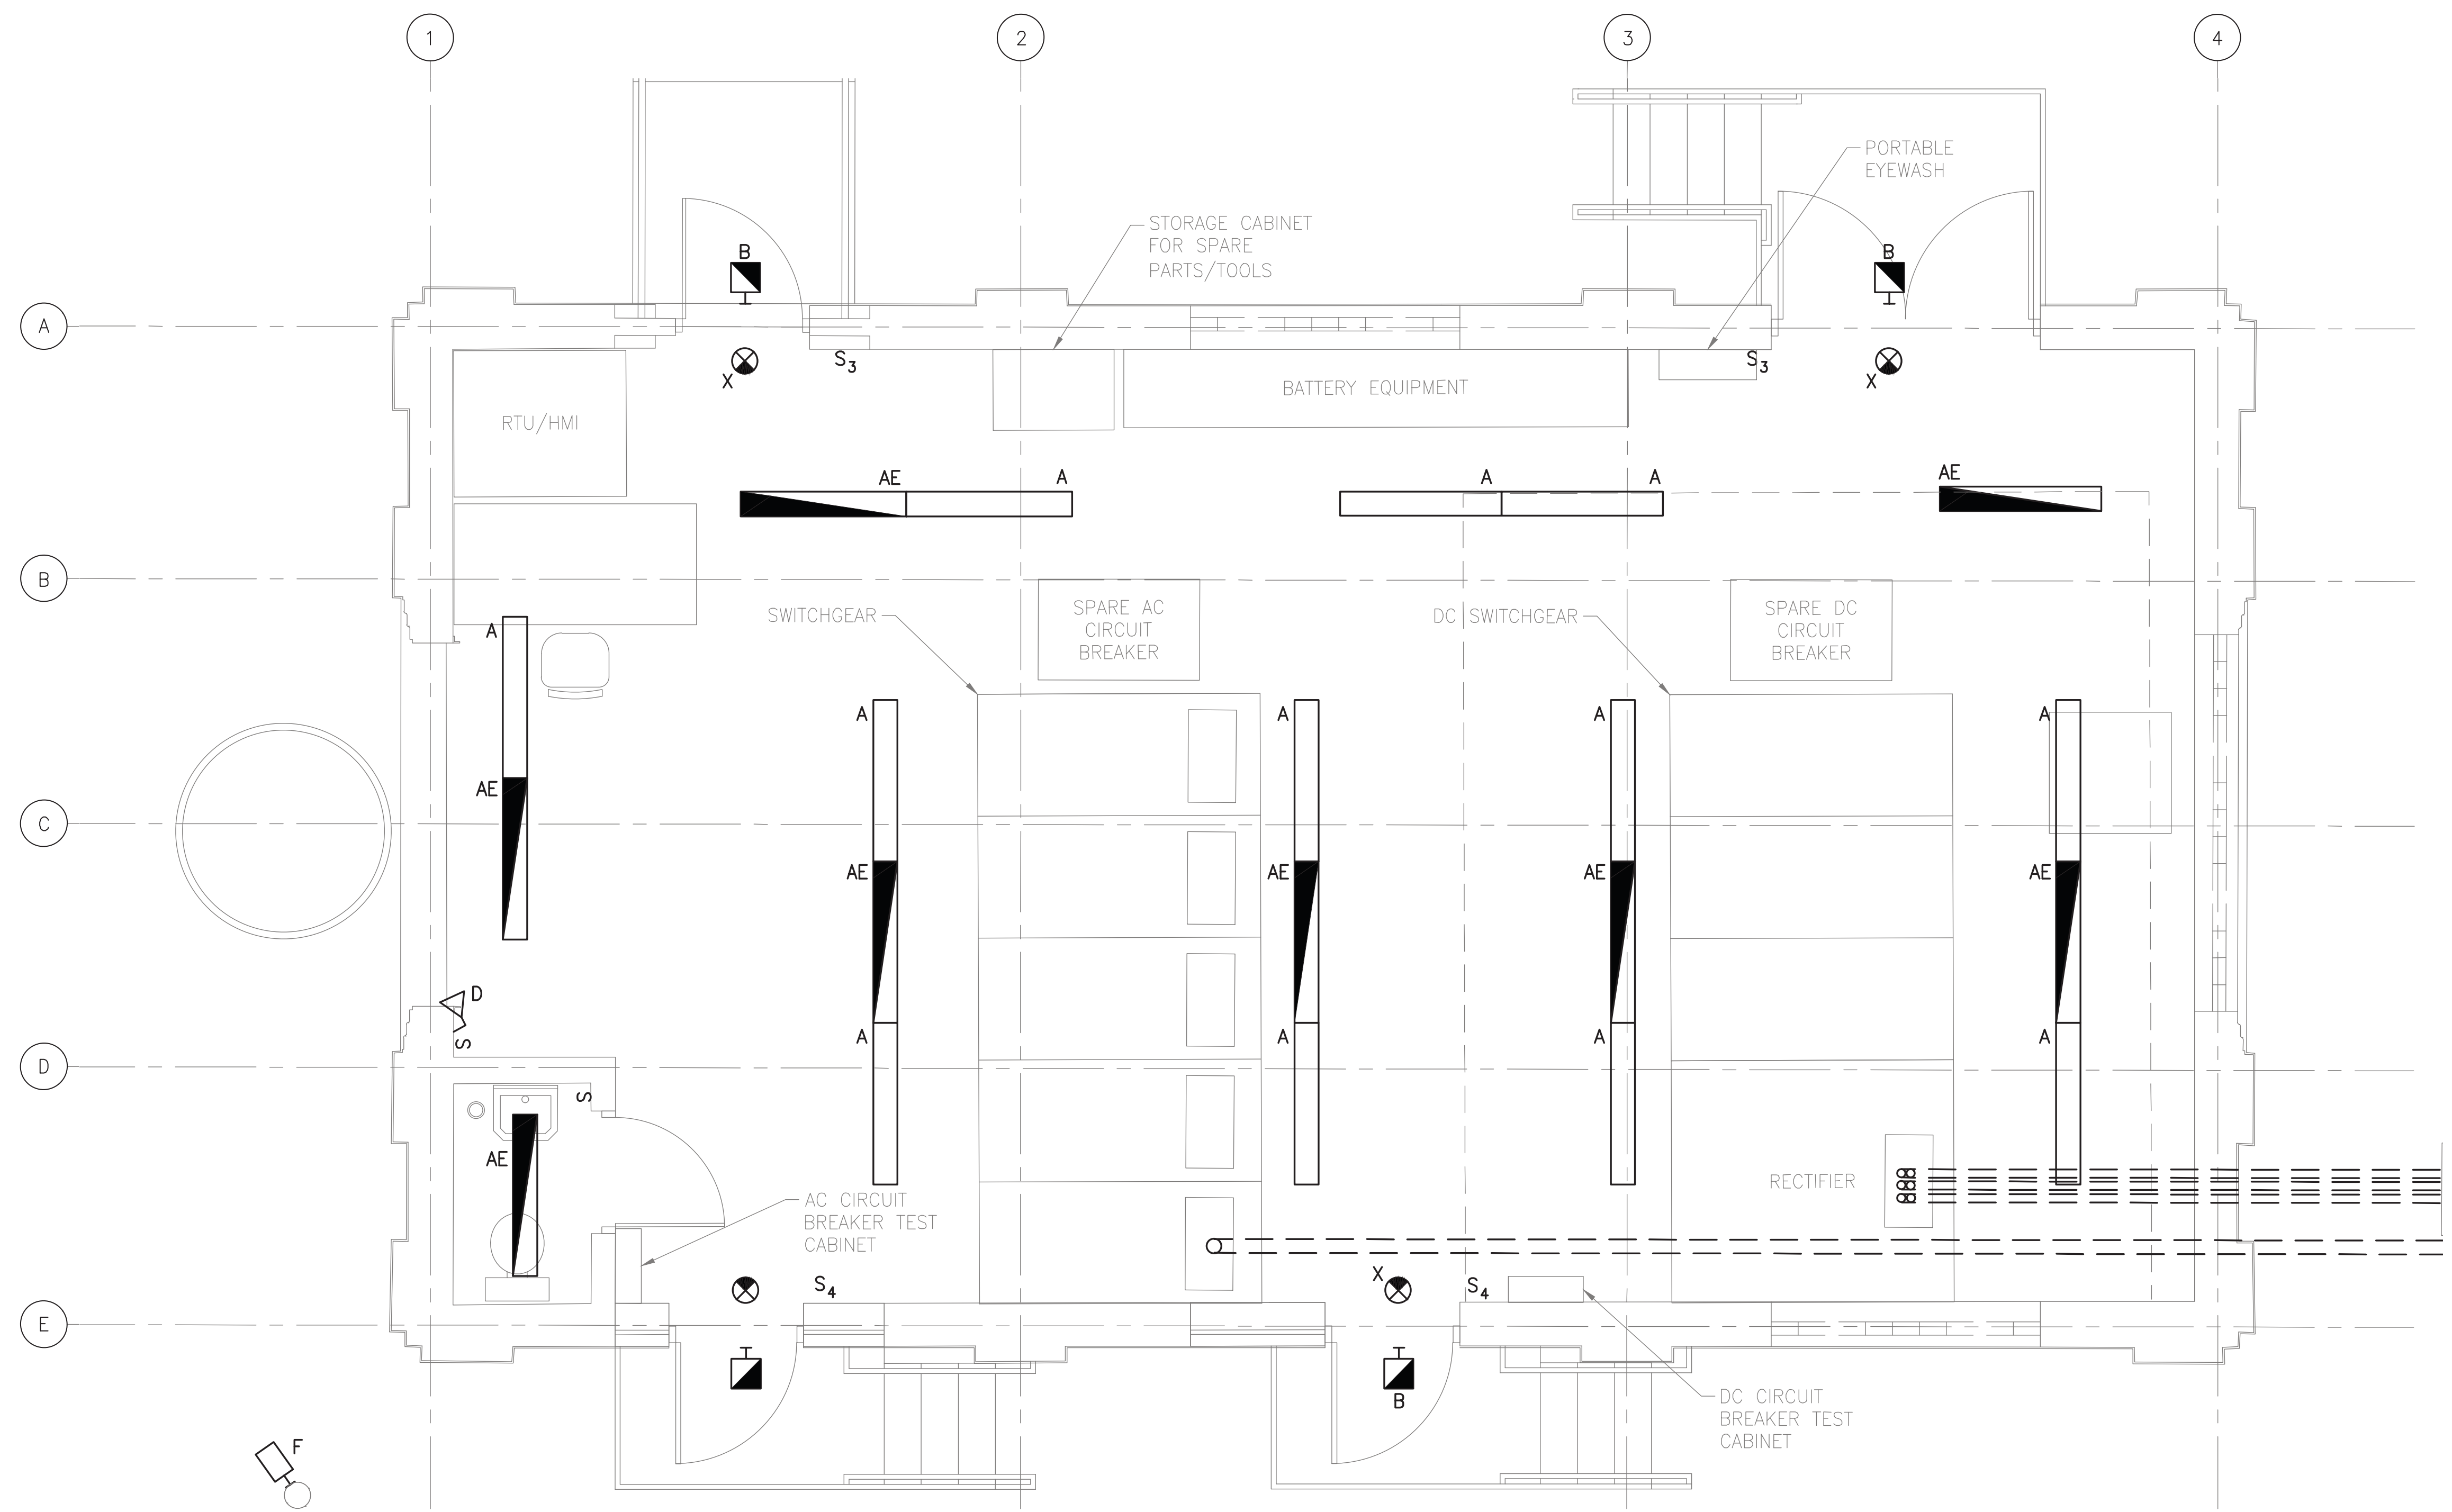

**1**  
**E404** ELECTRICAL PROPOSED LIGHTING  
SCALE: 3/8"=1'-0"

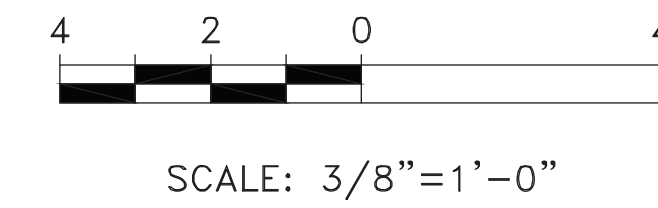


**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTTD\16891117AN-E404.DWG

C:\P\WORKING\PTTD\16891117AN-E405.DWG

**GENERAL NOTES:**

- FOR ELECTRICAL SYMBOLS AND ABBREVIATIONS REFER TO DRAWING E400.

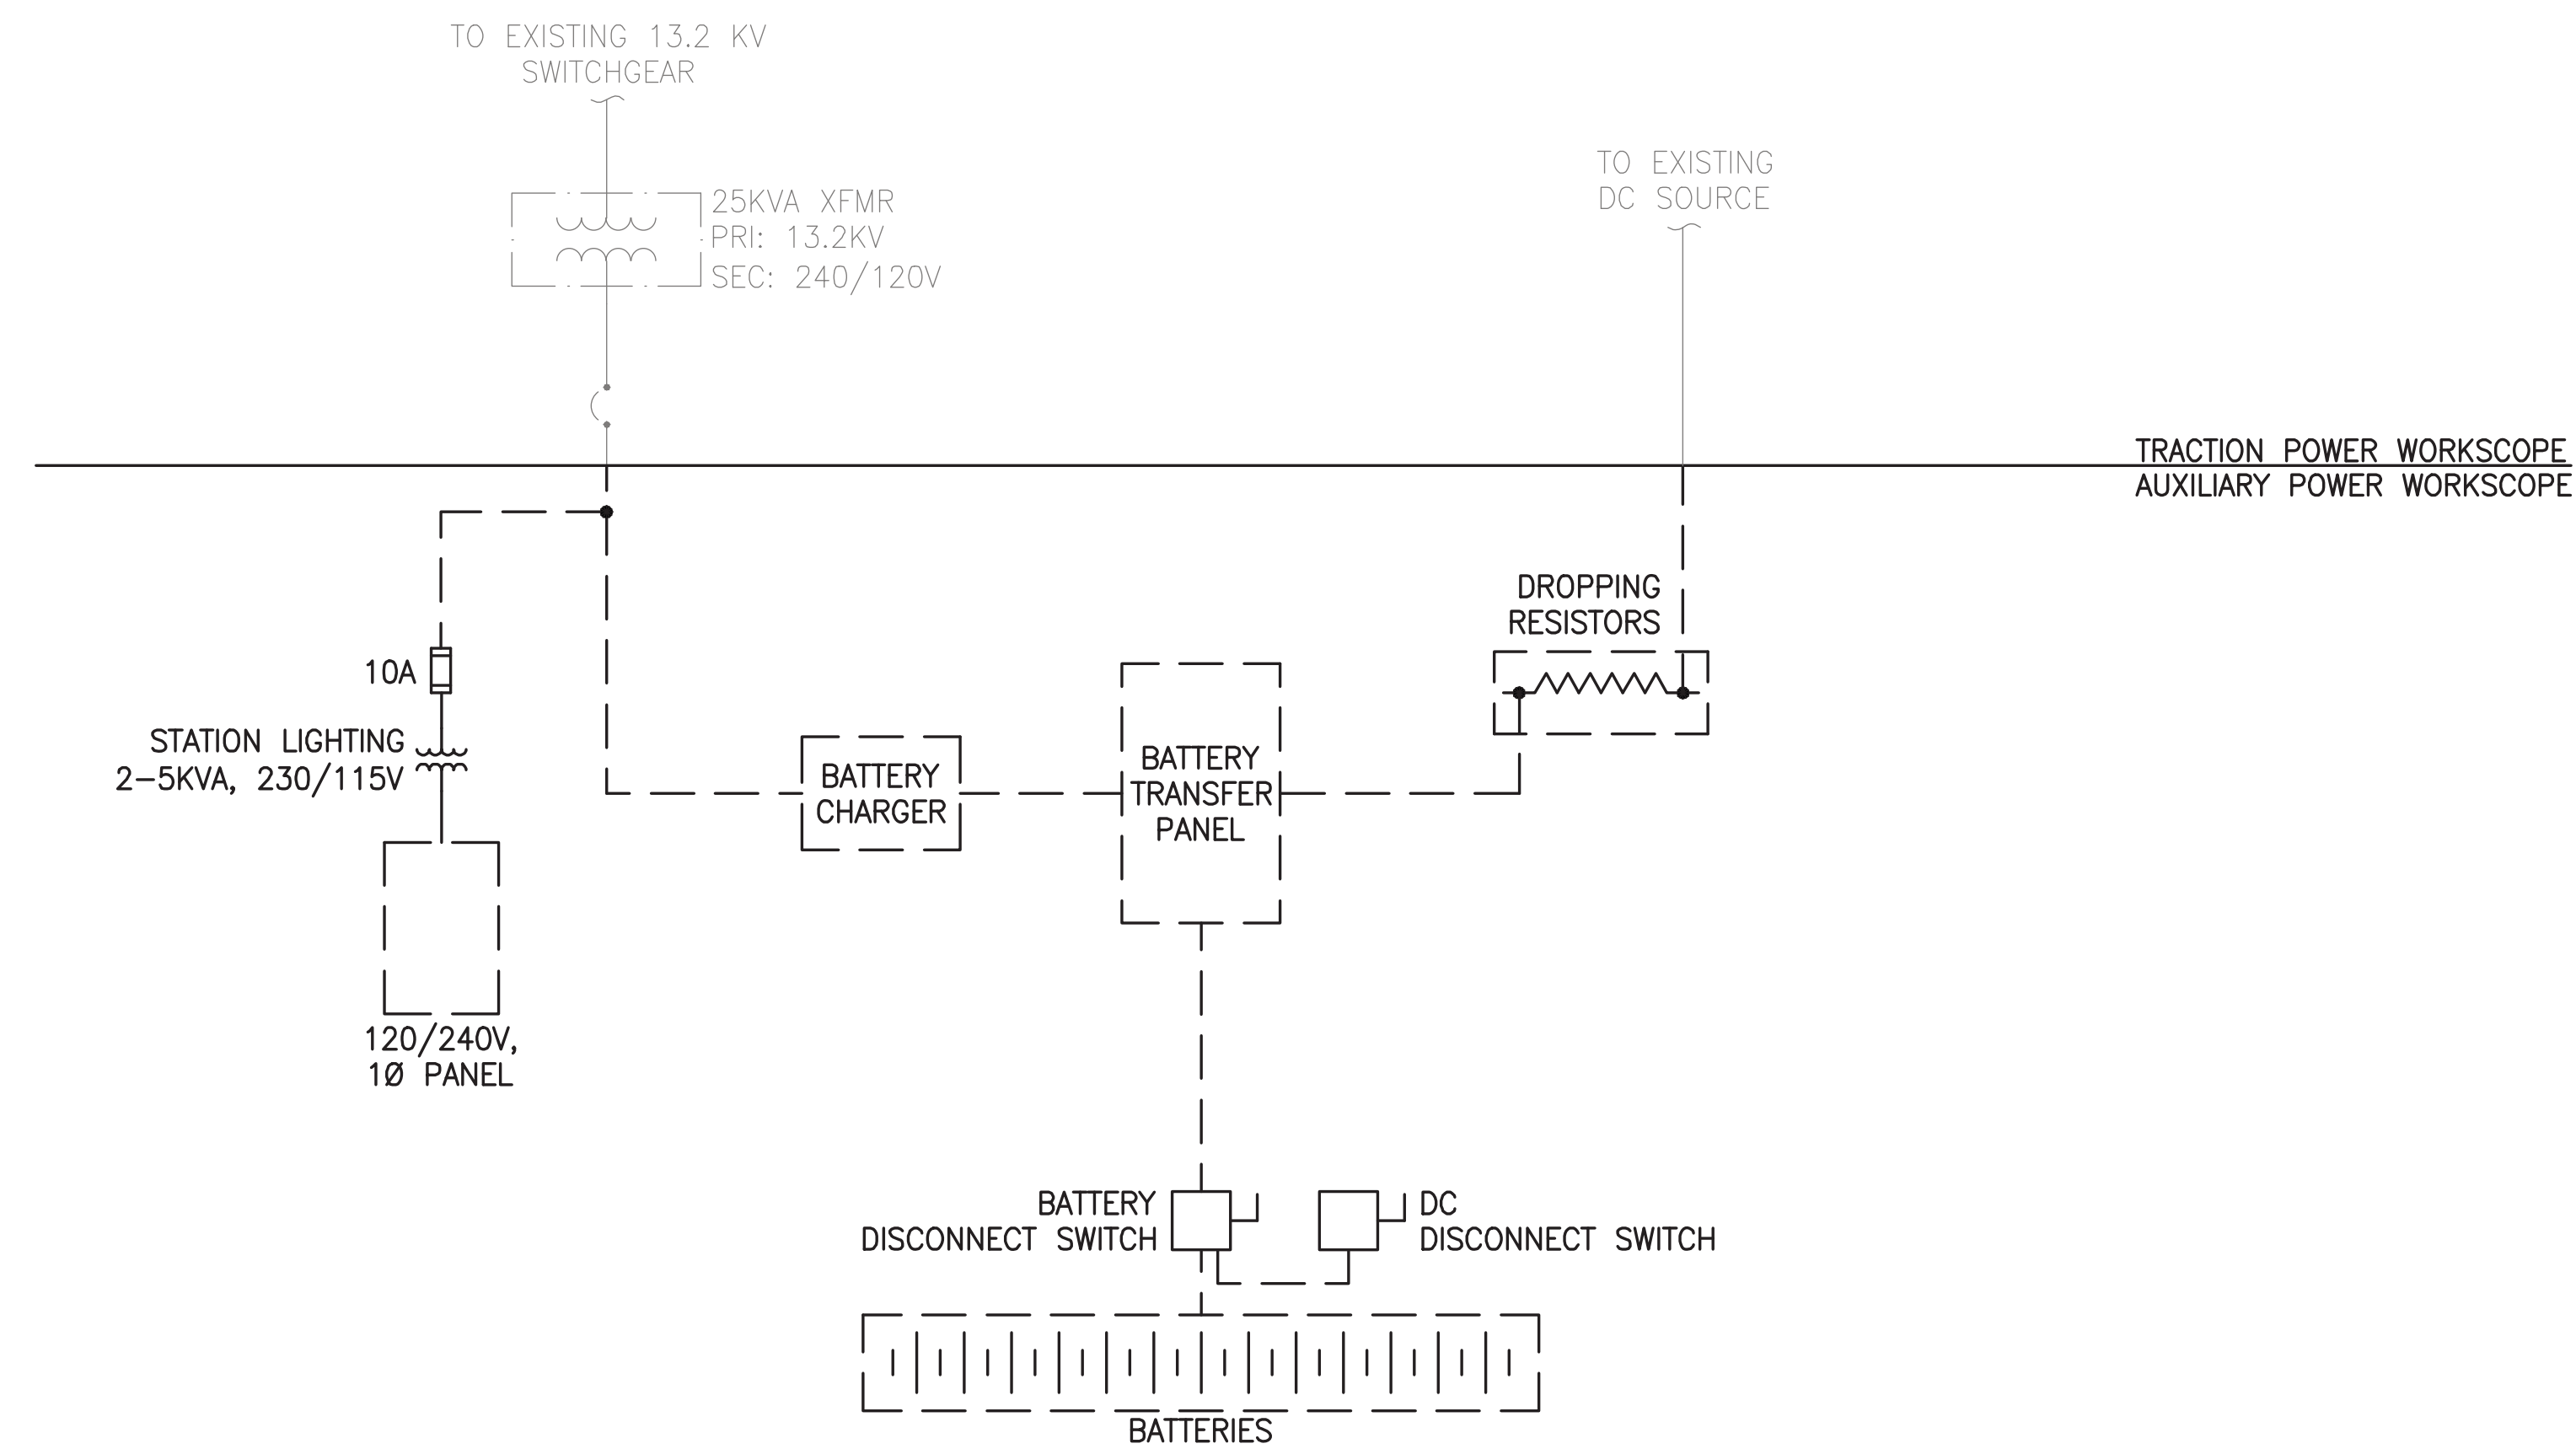

1  
E405 ELECTRICAL DEMOLITION SINGLE LINE DIAGRAM  
SCALE: NONE

**SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY EM&C DIVISION**  
1234 MARKET ST., 13TH FL., PHILADELPHIA, PA 19107

\_\_\_\_\_  
CHIEF ENGINEER-EM&C

\_\_\_\_\_  
CHIEF ENGINEERING OFFICER-EM&C

\_\_\_\_\_  
CHIEF RAIL TRANSIT OFFICER

\_\_\_\_\_  
SYSTEM SAFETY

\_\_\_\_\_  
DIRECTOR OF ENGINEERING-EM&C

\_\_\_\_\_  
MANAGER-ARCH/ENGINEERING

\_\_\_\_\_  
PROJECT MANAGER

**HDR**  
HDR Engineering, Inc.  
Philadelphia, PA

**ARORA**  
ARCHITECTURAL ENGINEERING  
1100 MARKET STREET  
PHILADELPHIA, PA 19107

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR ROUTE 59 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION ELECTRICAL DEMOLITION SINGLE LINE DIAGRAM**

SCALE: AS SHOWN	SCALE FACTOR: 1-1
DATE: 10/16/2017	DRAWN BY: PJD
WORK ORDER NO.: 276496	CHECKED BY: PJD
SHEET NUMBER: <b>E405</b>	
DWG. NO.: 6 OF 9	SHT. NO.: 417 OF 452
ARCHIVE NO.:	REV. NO.: 1
COMPUTER FILE NO.: 17AN-E405	

50% SUBMISSION  
NOT FOR CONSTRUCTION

DATE PRINTED: 10/21/2015  
STATUS: 50% SUBMISSION



C:\PI\WORKING\PTTD\16891117AN-E407.DWG



1234 MARKET ST, 13TH FL, PHILADELPHIA, PA 19107

CHEF ENGINEER-EM&C  
 CHEF ENGINEERING OFFICER-EM&C  
 CHEF RAIL TRANSIT OFFICER  
 SYSTEM SAFETY  
 DIRECTOR OF ENGINEERING-EM&C  
 MANAGER-ARCHITECTURE/ENGINEERING  
 PROJECT MANAGER



REV	DATE	DESCRIPTION	BY	CHKD	APPD

LUMINAIRE SCHEDULE								
TYPE	DESCRIPTION	MOUNTING	MANUFACTURER	CATALOG NO.	LAMP INFORMATION			
					TYPE	LAMP QTY	WATTS EACH	VOLTS
'A'	CEILING OR WALL MOUNTED ROUGH SERVICE FIXTURE 4000K, 80CRI, CLEAR POLYCARBONATE LENS, WIDE DISTRIBUTION, INJECTION MOLDED, IMPACT RESISTANT POLYCARBONATE HOUSING	CEILING OR WALL	LITHONIA	VAP-4000LM-PCL-WD-120-GZ10-40K-80CRI-QMB	LED	-	42	120
'AE'	CEILING OR WALL MOUNTED ROUGH SERVICE FIXTURE 4000K, 80CRI, CLEAR POLYCARBONATE LENS, WIDE DISTRIBUTION, INJECTION MOLDED, IMPACT RESISTANT POLYCARBONATE HOUSING, EMERGENCY BATTERY LED DRIVER	CEILING OR WALL	LITHONIA	VAP-4000LM-PCL-WD-120-GZ10-40K-80CRI-QMB-BZL722	LED	-	42	120
'B'	DIE-CAST ALUMINUM LED WALLPACK FIXTURE, 5000K, GLASS LENS WITH WIRE GUARD, TYPE 3 MEDIUM DISTRIBUTION, INTEGRAL PHOTOCCELL, BATTERY PACK	WALL	LITHONIA	TWH LED-20C-1000-50K-T3M-120-PE-TP-WG-DOBXD	LED	20	72	120
'D'	DOCK LIGHT	WALL	TBD	TBD	LED	1	ALL	120
'F'	POLE MOUNTED LED AREA LIGHT WITH ALUMINUM HOUSING AND ELECTRONIC DRIVER, 4000K	POLE (MATCH EXISTING)	LITHONIA	DSX1-LED	LED	1	138	120
'X'	THERMOPLASTIC EXIT SIGN, EMERGENCY OPERATION, NICKEL-CADMIUM BATTERY, UNIVERSAL MOUNTING KIT, SELF-DIAGNOSTICS, 90-MINUTE CAPACITY FOR EMERGENCY LAMPS	UNIVERSAL	LITHONIA	LQM S.W 3 R 120/277 EL N SD	LED	-	.92	120

**CASTOR**  
 ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**ELECTRICAL**  
 ELECTRICAL SCHEDULES

SCALE:	AS SHOWN	SCALE FACTOR:	1-1
DATE:	10/16/2017	DRAWN BY:	JEP
		CHECKED BY:	XX
WORK ORDER NO.:	276496		
SHEET NUMBER:	<b>E407</b>		
DWG. NO.:	8	OF	9
SHT. NO.:	419	OF	452
ARCHIVE NO.:	-		
COMPUTER FILE NO.:	17AN-E407	REV. NO.:	1

50% SUBMISSION  
 NOT FOR CONSTRUCTION

DATE PRINTED: 10/21/2025  
 STATUS: 50% SUBMISSION








C:\P\WORKING\PTTID\92493717AN-FA401.DWG

### GENERAL NOTES:

1. REFER TO DRAWING FA400 FOR NOTES, SYMBOLS & ABBREVIATIONS.
2. SEE FIRE ALARM DETAILS ON DRAWING FA403.

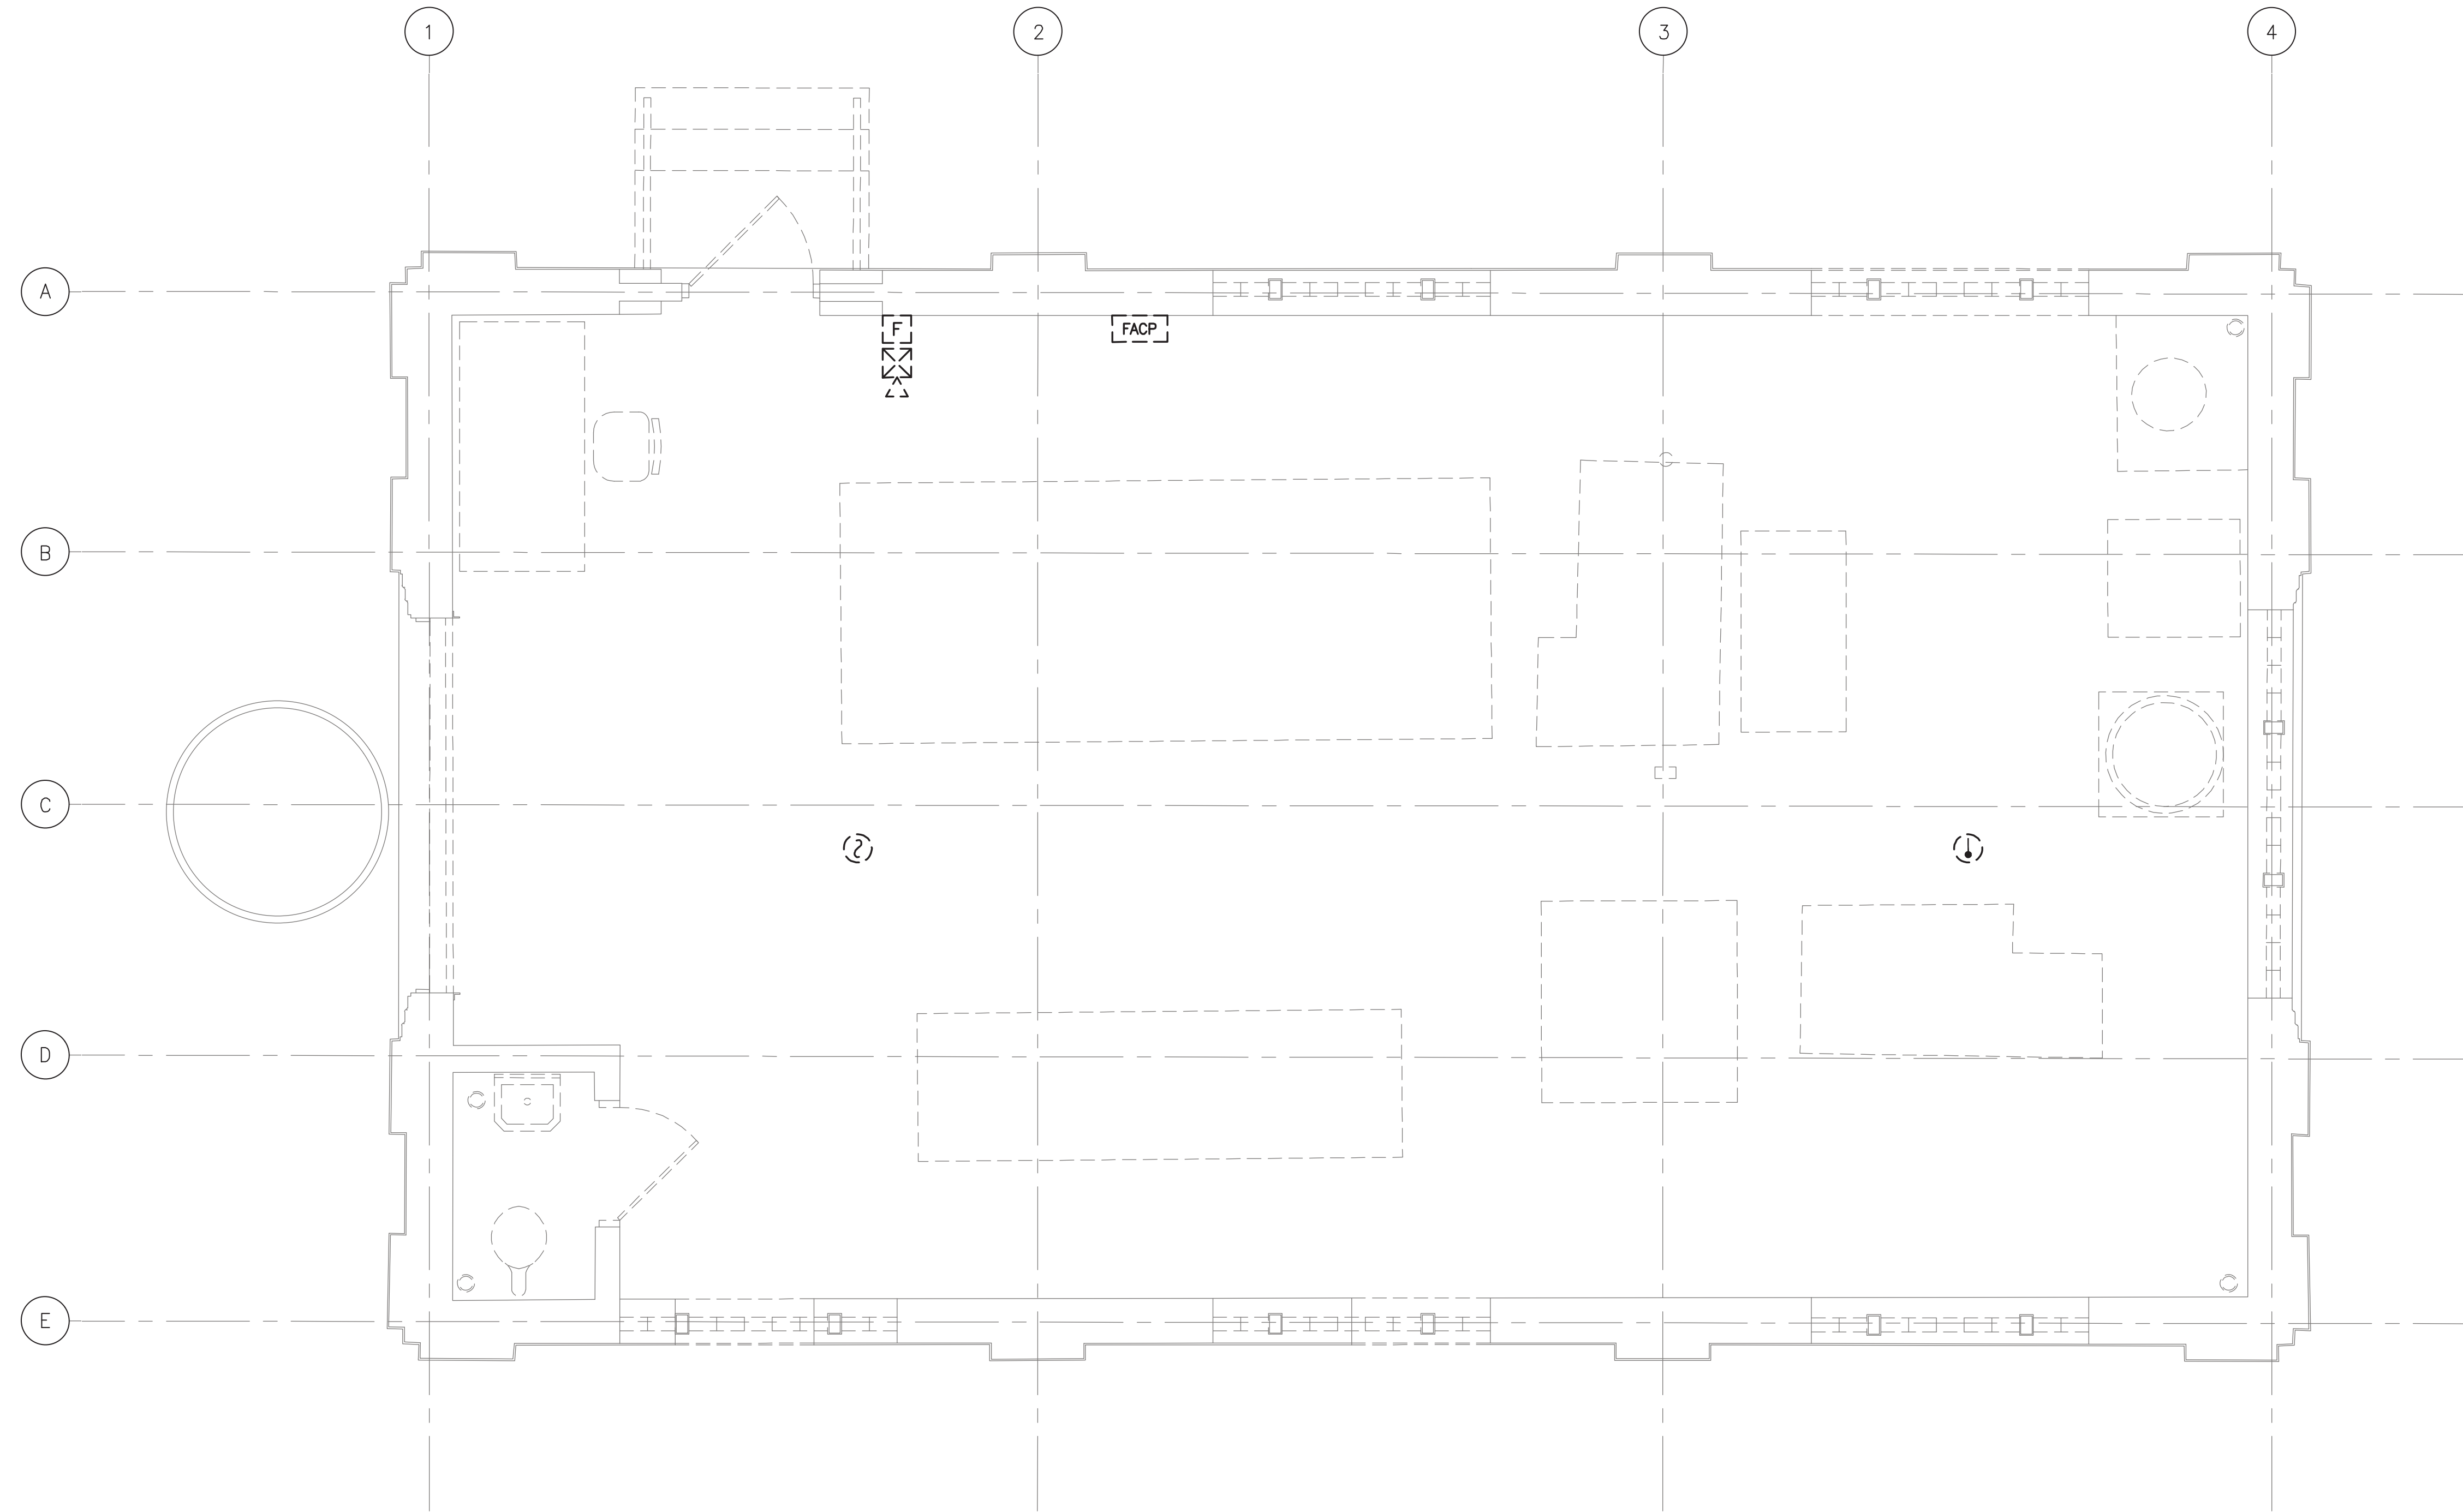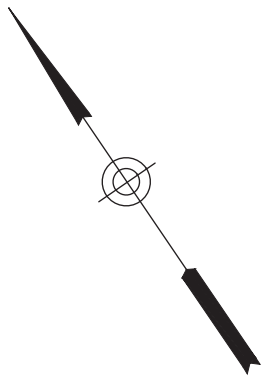

1 FIRE ALARM - DEMOLITION PLAN  
 FA401 SCALE: 3/8"=1'-0"



SCALE: 3/8"=1'-0"

**50% SUBMISSION  
 NOT FOR CONSTRUCTION**

SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY  
 EM&C DIVISION  
 1234 MARKET ST., 13TH FL., PHILADELPHIA, PA 19107

\_\_\_\_\_  
 CHIEF ENGINEER-EM&C  
 \_\_\_\_\_  
 CHIEF ENGINEERING OFFICER-EM&C  
 \_\_\_\_\_  
 CHIEF RAIL TRANSIT OFFICER  
 \_\_\_\_\_  
 SYSTEM SAFETY  
 \_\_\_\_\_  
 DIRECTOR OF ENGINEERING-EM&C  
 \_\_\_\_\_  
 MANAGER - ARCH/ENGINEERING  
 \_\_\_\_\_  
 PROJECT MANAGER

**HDR**  
 HDR Engineering, Inc.  
 Philadelphia, PA

**ARORA**  
 ARCHITECTS  
 1100 MARKET STREET, 12TH FLOOR  
 PHILADELPHIA, PA 19107

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
 ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**FIRE ALARM**  
 DEMOLITION FLOOR PLAN

SCALE: AS SHOWN SCALE FACTOR: 1:1  
 DATE: 10/16/2017 DRAWN BY: H&B  
 CHECKED BY: AS  
 WORK ORDER NO.: 276496  
 SHEET NUMBER:  
**FA401**  
 DWG NO.: 2 OF 4  
 SHT NO.: 422 OF 452  
 ARCHIVE NO.:  
 COMPUTER FILE NO.: 17AN-FA401  
 REV. NO.: ---

DATE PRINTED: 10/21/2025  
 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**FIRE ALARM**  
PROPOSED FLOOR PLAN


SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 4/2/2017	DRAWN BY: H&B
WORK ORDER NO.: 276496	CHECKED BY: AS
SHEET NUMBER: <b>FA402</b>	
DWG. NO.: 3 OF 4	SHT. NO.: 423 OF 452
COMPUTER FILE NO.: 17AN-FA402	REV. NO.: ---

**GENERAL NOTES:**


- REFER TO DRAWING FA400 FOR NOTES, SYMBOLS & ABBREVIATIONS.
- SEE FIRE ALARM DETAILS ON DRAWING FA403.

**KEYED NOTES:**


- SEPTA APPROVED FIRE ALARM CONTROL PANEL WITH BATTERY CABINET MOUNTED BELOW. PROVIDE THE APPROPRIATE "CM" MODULES FOR INTERFACING WITH SEPTA'S SCADA SYSTEM. TRADE SHALL COORDINATE THE INTERFACE CONNECTIONS BETWEEN THE FIRE ALARM MODULES AND THE APPROPRIATE SCADA CONNECTION POINTS.

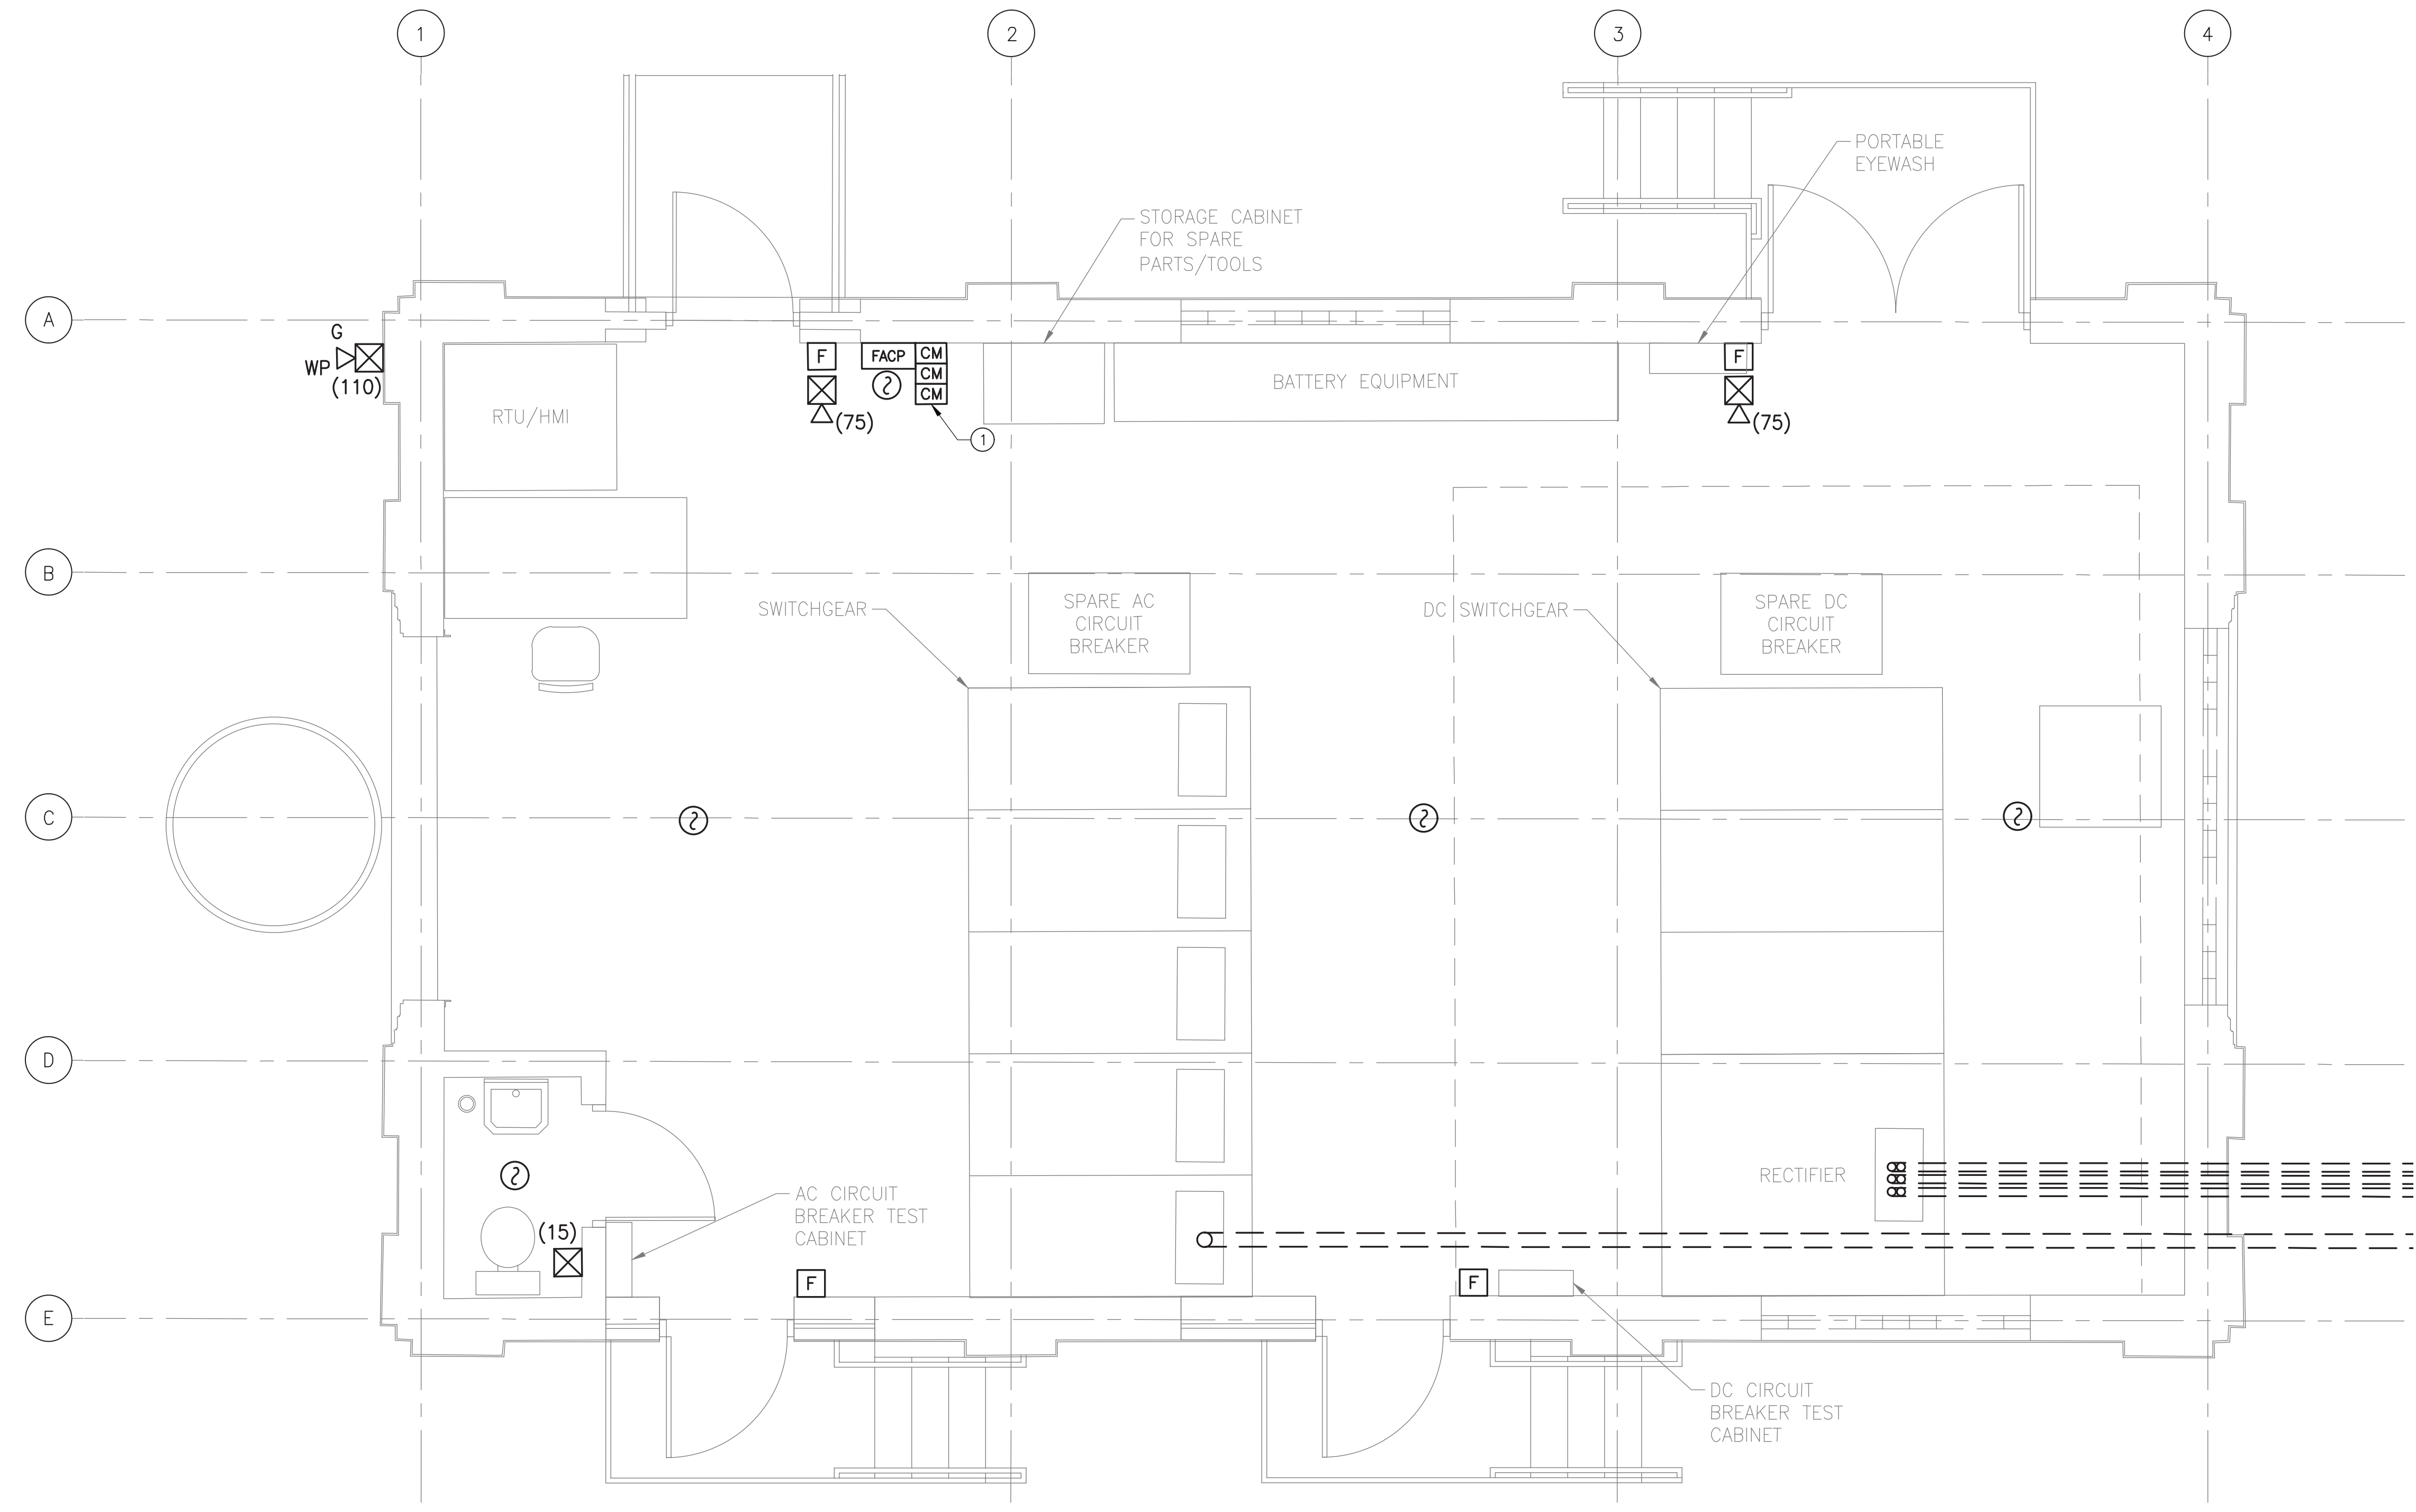

**1**  
**FA402** FIRE ALARM - PROPOSED PLAN  
SCALE: 3/8"=1'-0"

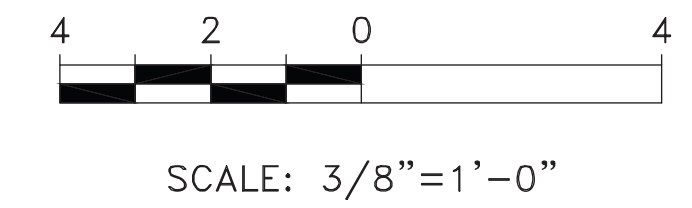


**30% SUBMISSION**  
**NOT FOR CONSTRUCTION**

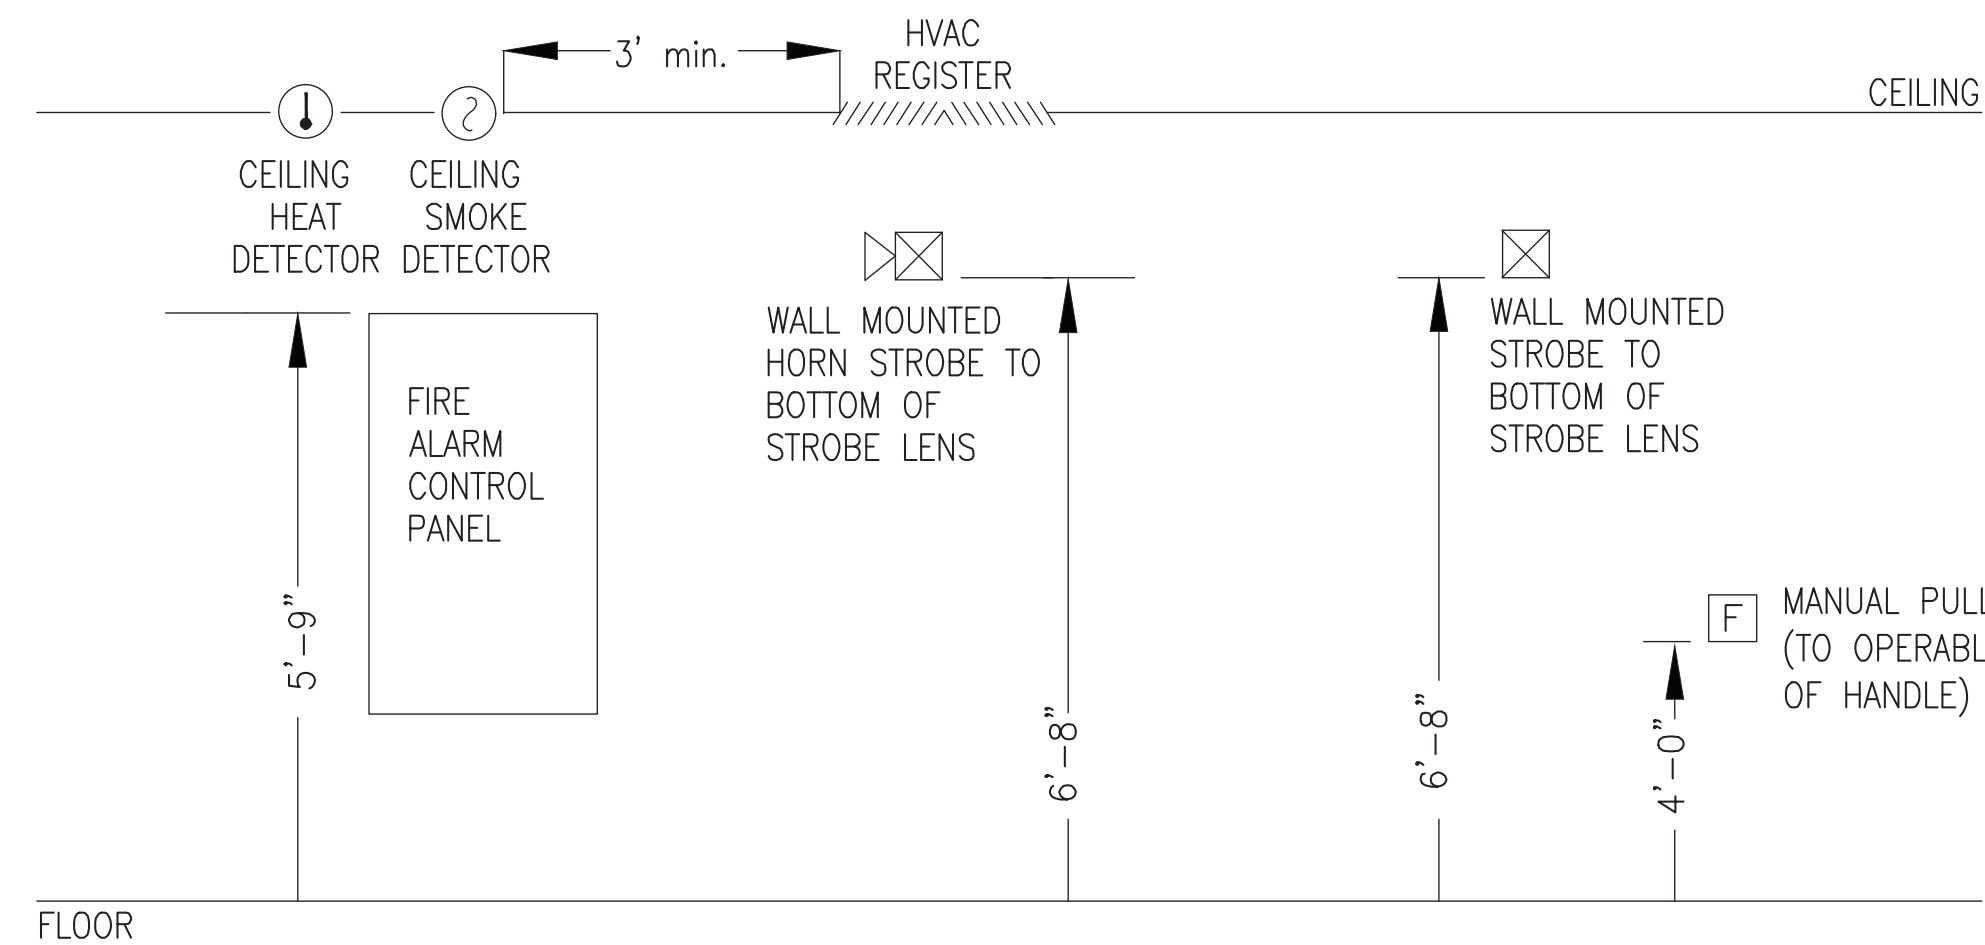


NOTE: COORDINATE WITH OTHER TRADE PLANS AND ELEVATIONS FOR SPECIFIC LOCATIONS OF FIRE ALARM DEVICES.


1 TYPICAL FIRE ALARM DEVICE AND EQUIPMENT MOUNTING HEIGHTS  
FA403 SCALE: NOT TO SCALE

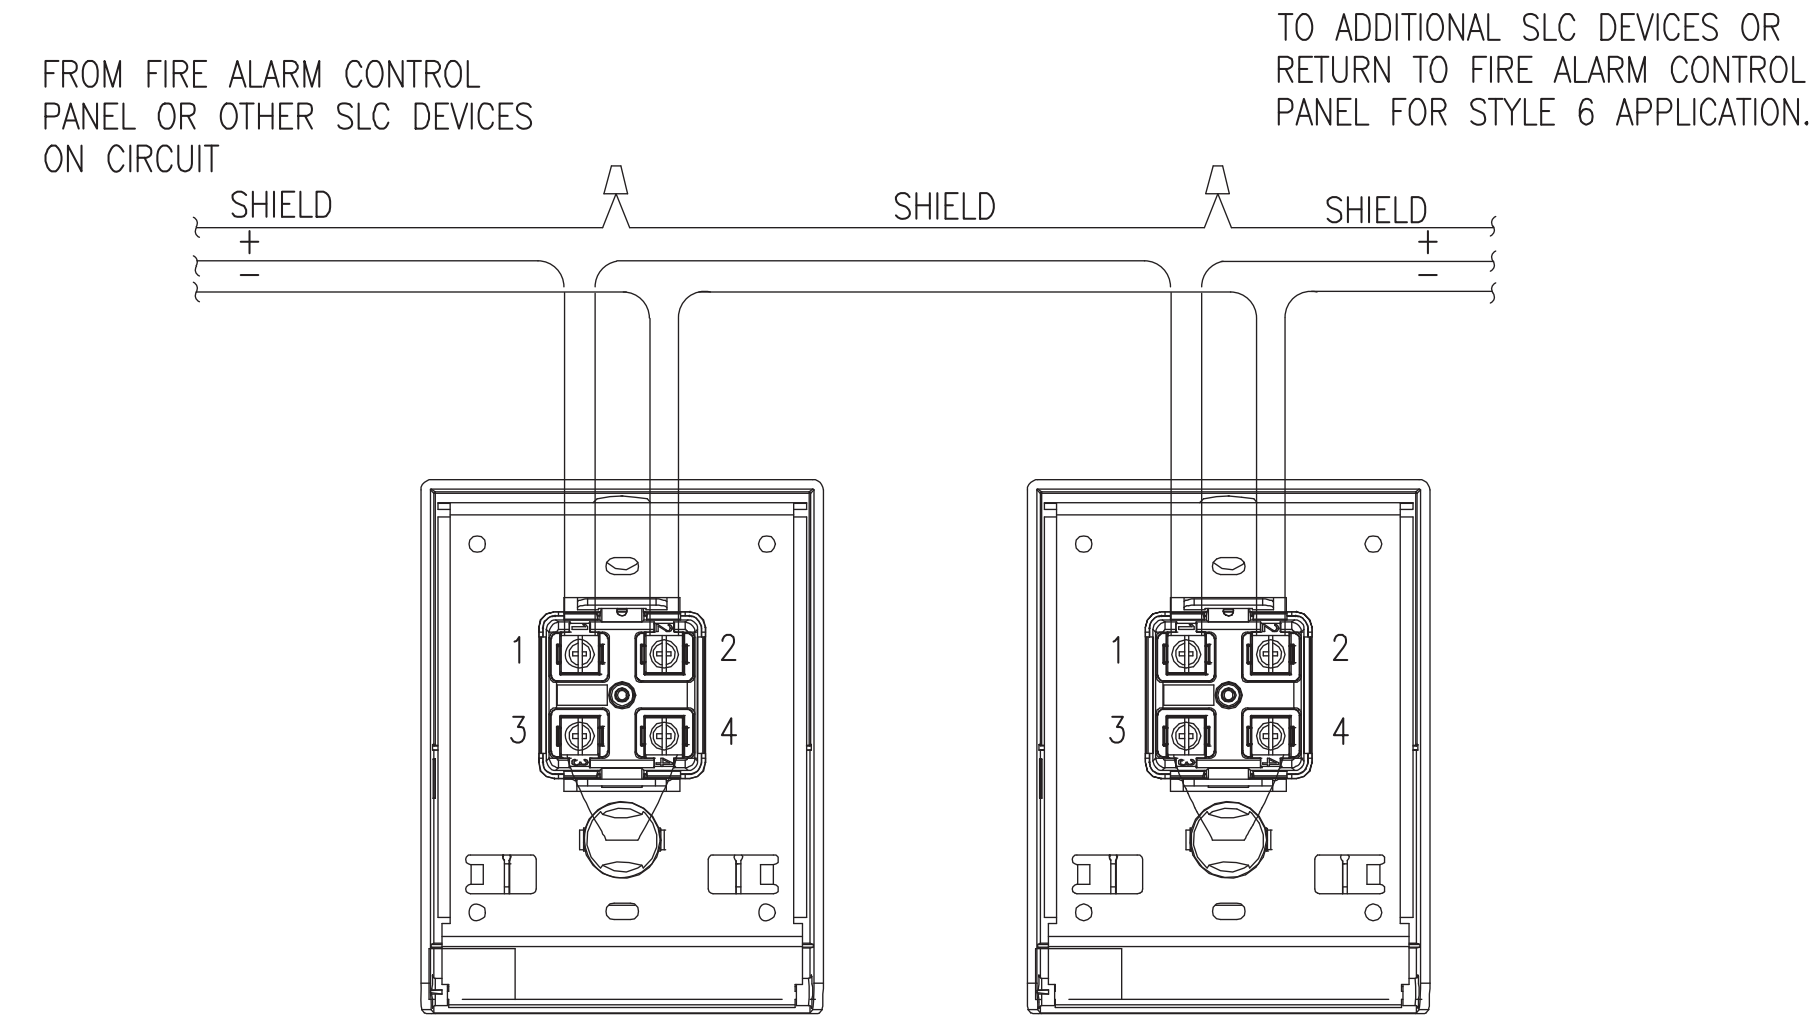


2 TYPICAL FIRE ALARM SLC MODULE DEVICE CIRCUITING AND CONNECTION  
FA403 SCALE: NOT TO SCALE

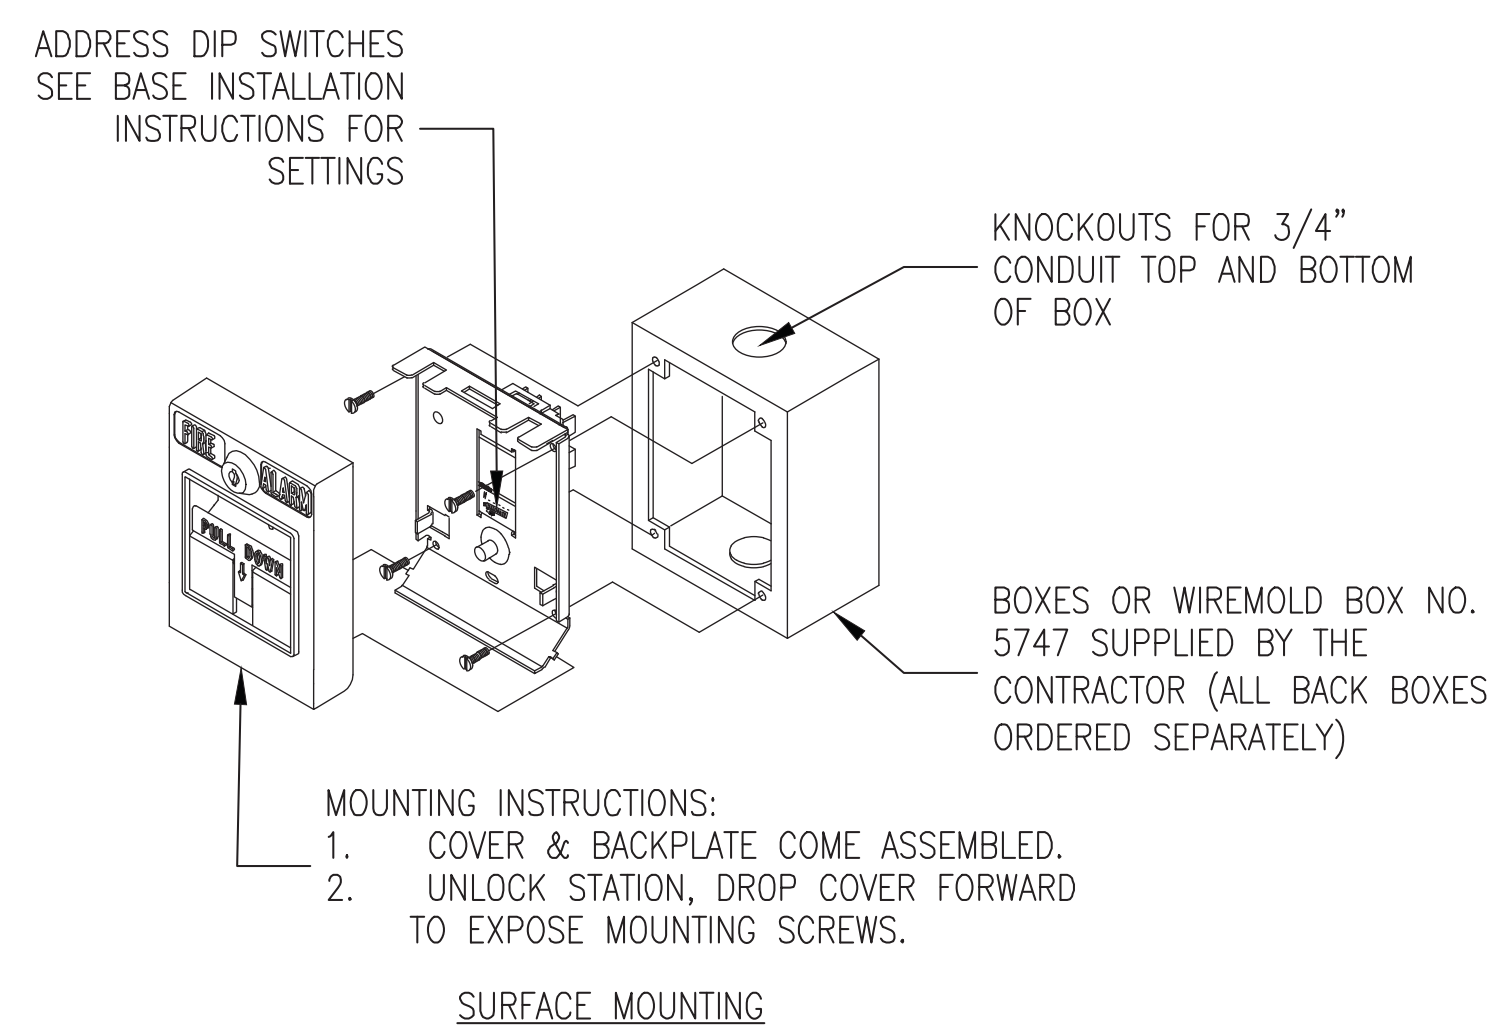


3 TYPICAL MANUAL PULL STATION MOUNTING  
FA403 SCALE: NOT TO SCALE

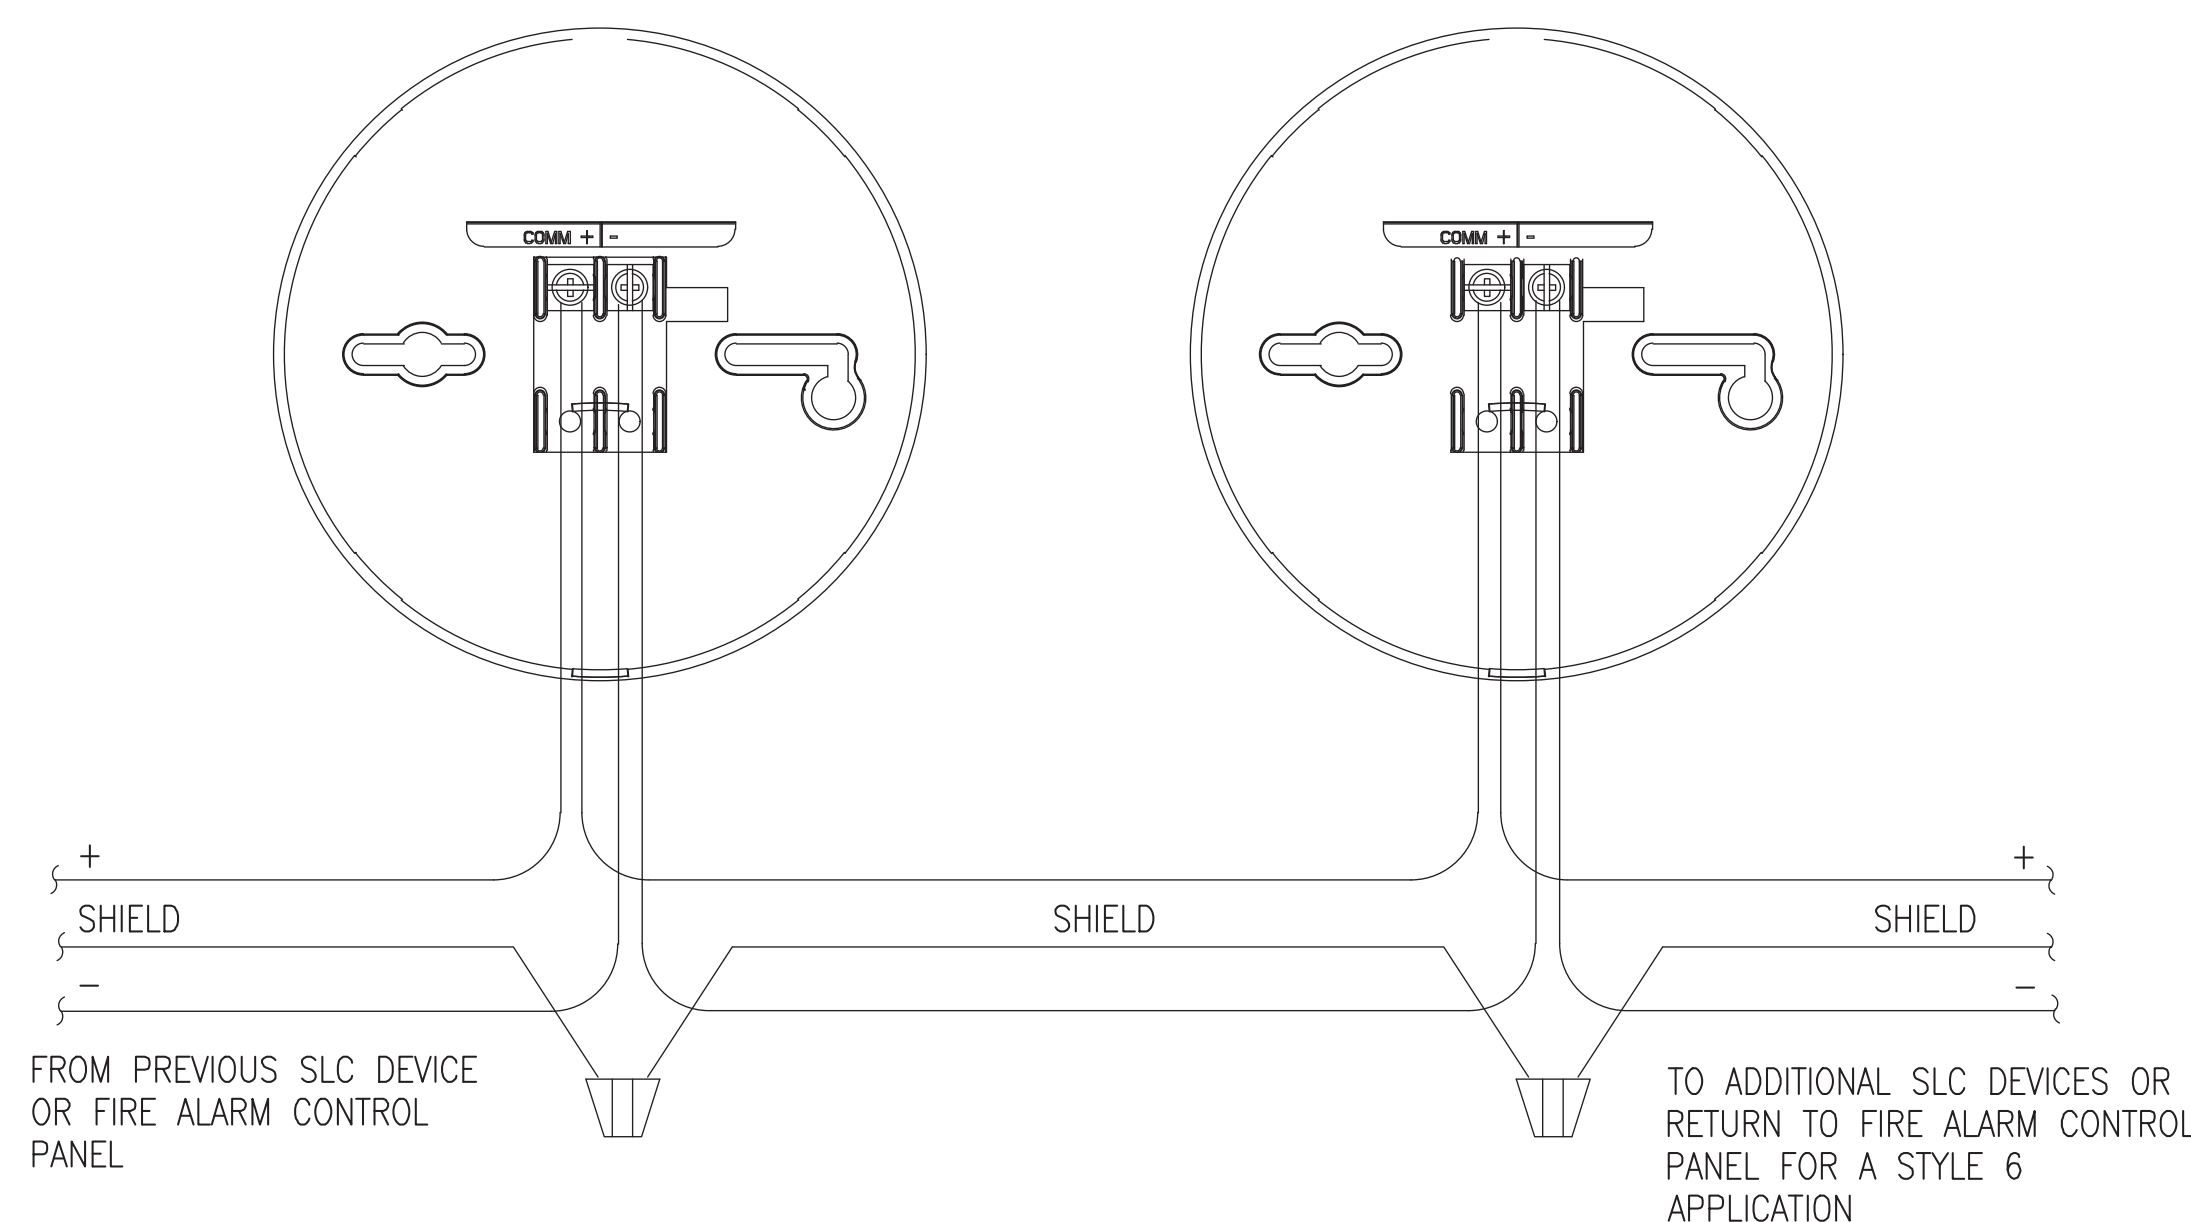


4 TYPICAL FIRE ALARM SLC SENSOR DEVICE CIRCUITING AND CONNECTION  
FA403 SCALE: NOT TO SCALE

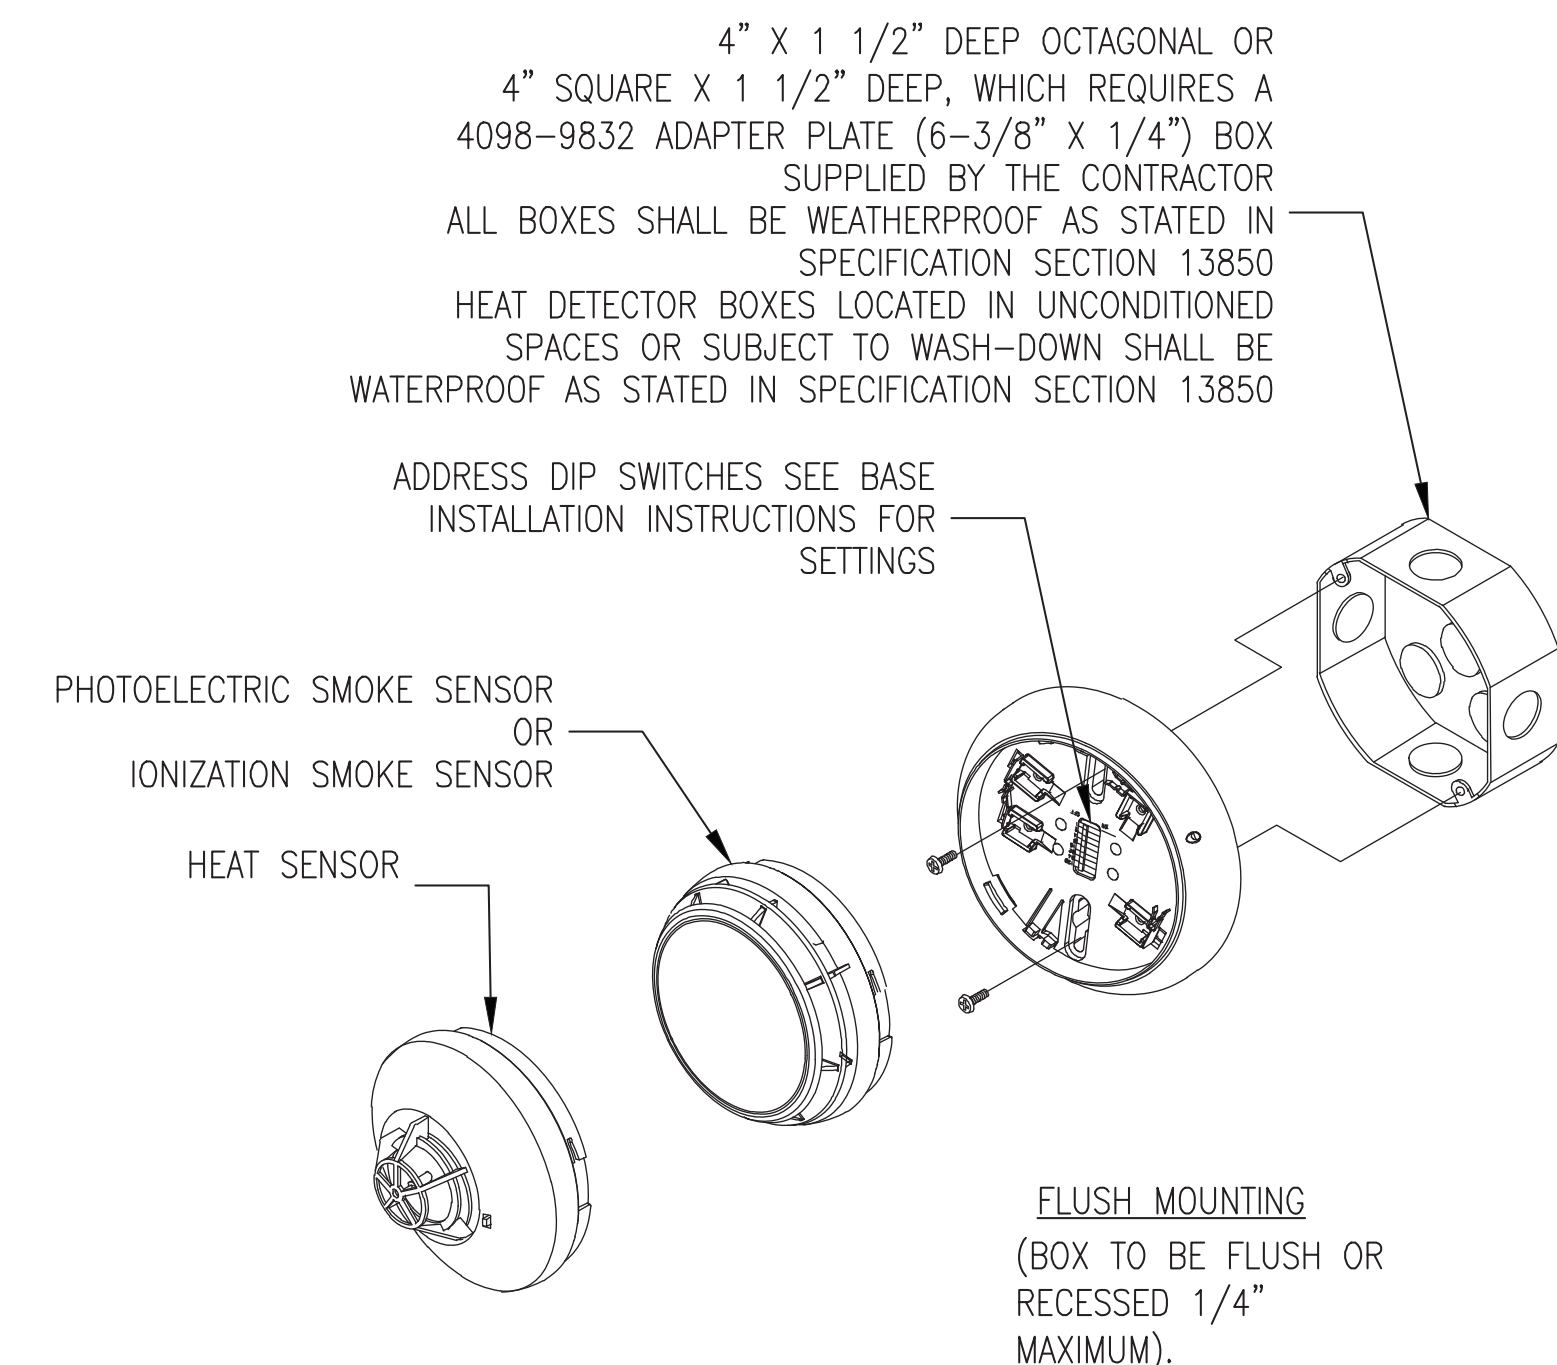

5 TYPICAL SMOKE OR HEAT DETECTOR MOUNTING  
FA403 SCALE: NOT TO SCALE

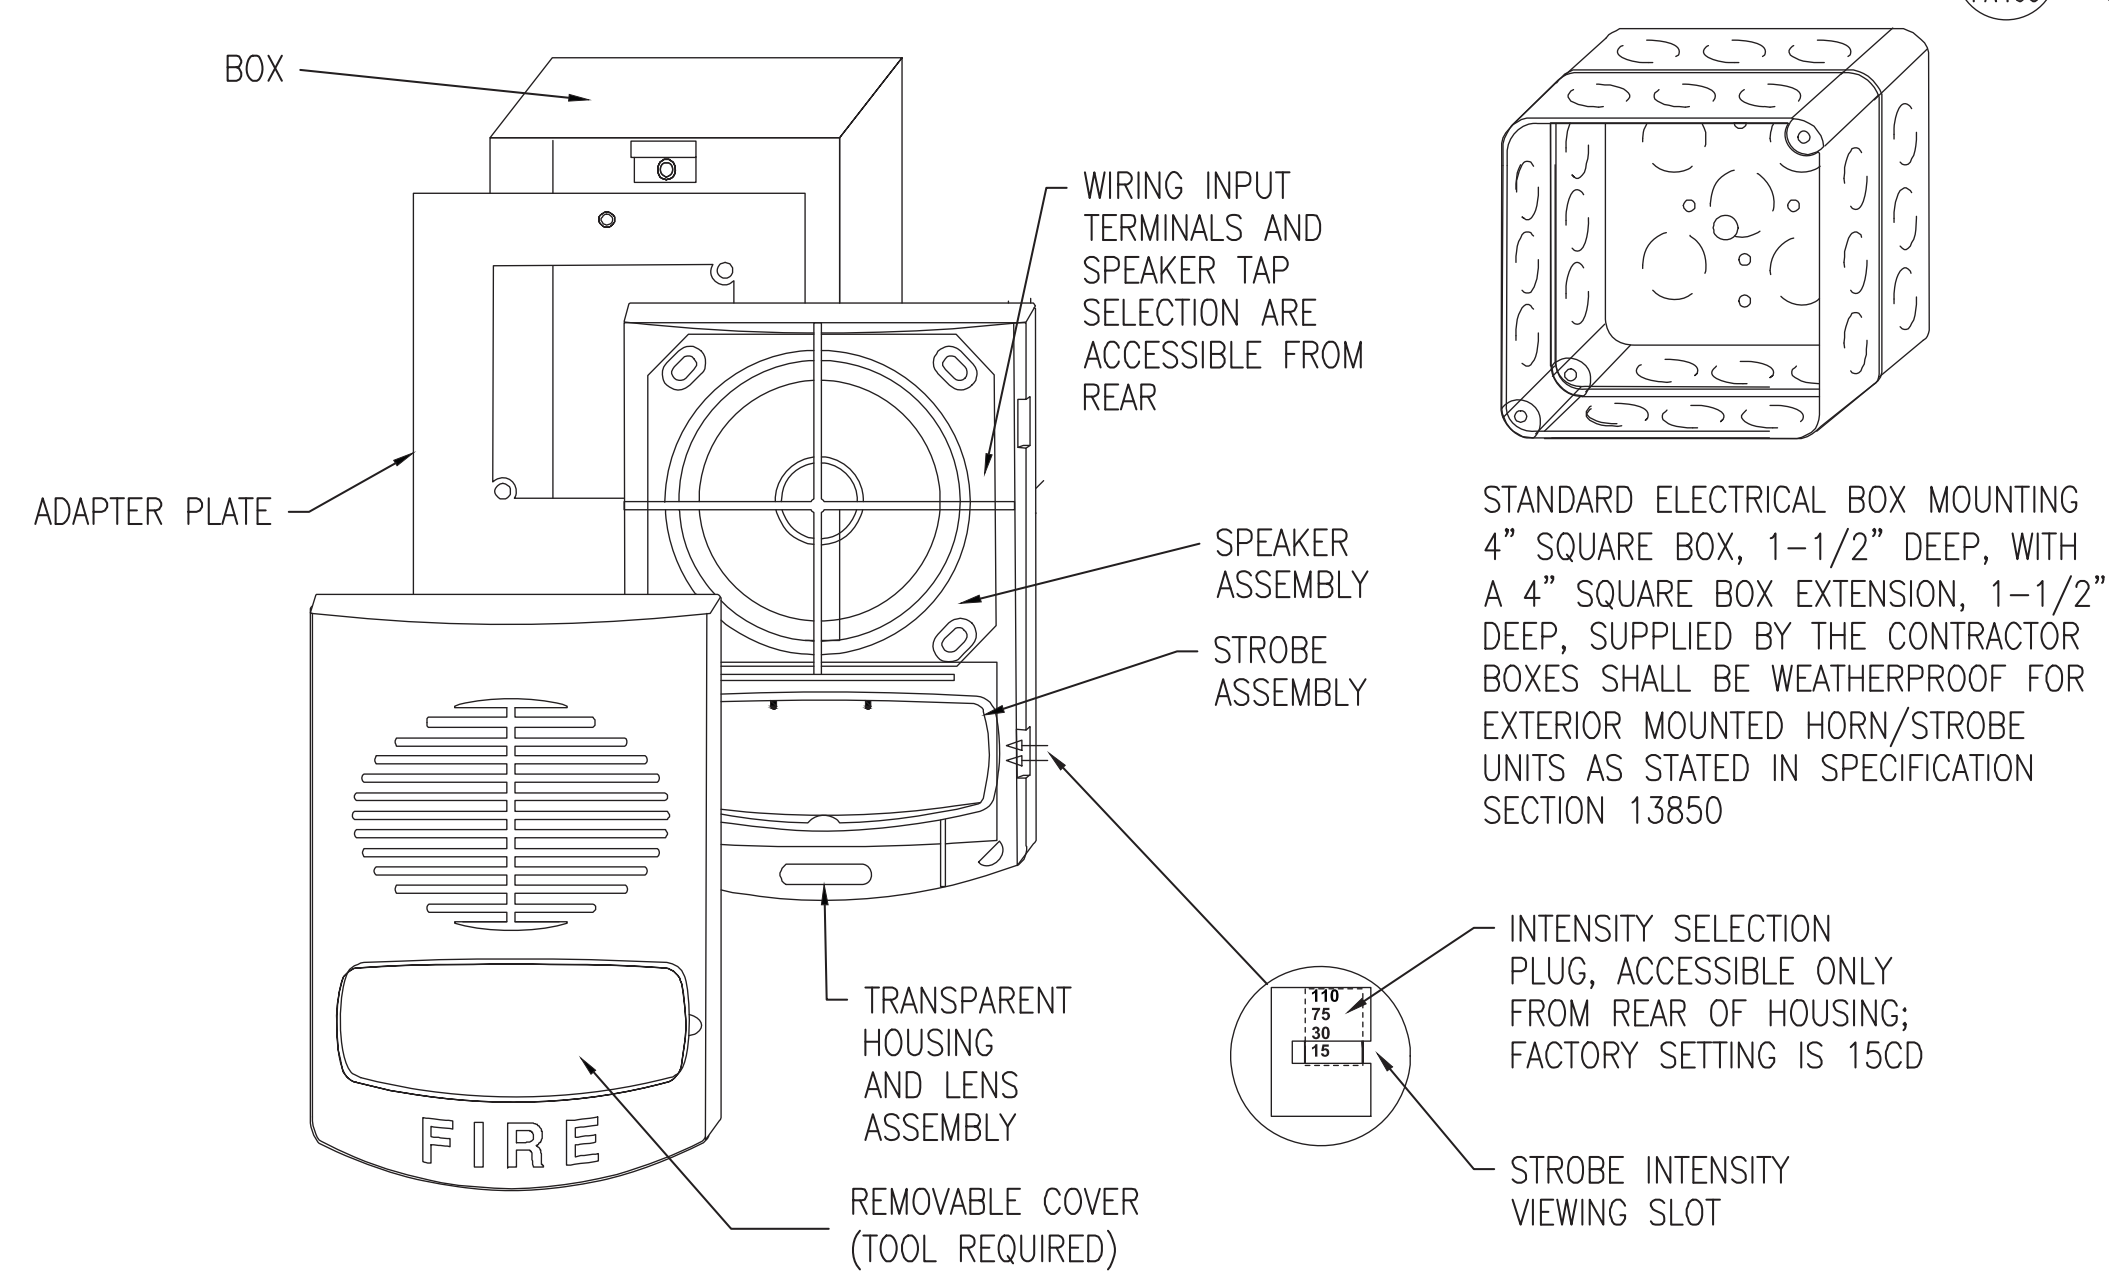

6 TYPICAL HORN/STROBE MOUNTING  
FA403 SCALE: NOT TO SCALE

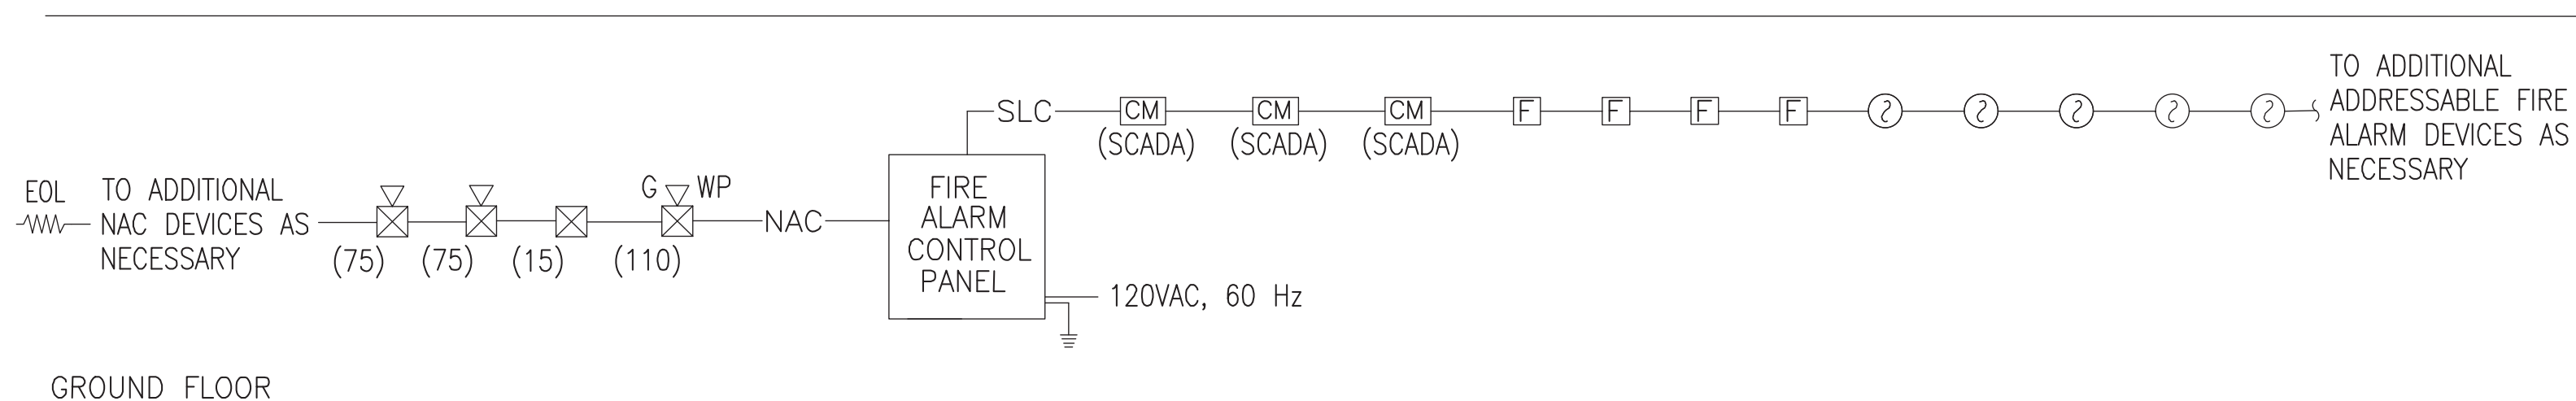

7 TYPICAL FIRE ALARM RISER DIAGRAM  
FA403 SCALE: NOT TO SCALE

**GENERAL NOTES:**

- EXISTING CONDITIONS SHOWN ARE BASED ON HISTORICAL DOCUMENTS, CIVIL SURVEYS AND SITE OBSERVATIONS. ALL DIMENSIONS AND CONDITIONS ARE TO BE VERIFIED IN THE FIELD.
- REFER TO DRAWING FA400 FOR NOTES, SYMBOLS & ABBREVIATIONS.

SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY  
EMBC DIVISION  
1234 MARKET ST., 13TH FL., PHILADELPHIA, PA 19107

CHIEF ENGINEER - EMBC  
CHIEF ENGINEERING OFFICERS - EMB  
CHIEF RAIL TRANSIT OFFICER  
SYSTEM SAFETY  
DIRECTOR OF ENGINEERING - EMB  
MANAGER - ARCHITECTURE  
PROJECT MANAGER

HDR  
HDR Engineering, Inc.  
Philadelphia, PA

ARORA  
ARCHITECTURE  
1100 MARKET STREET  
PHILADELPHIA, PA 19107

REV	DATE	DESCRIPTION	BY	CHKD	APPD

CASTOR  
ROUTE 69 TROLLEY LINE  
TRACTION POWER SUBSTATION  
REHABILITATION  
FIRE ALARM  
DETAILS

SCALE: AS SHOWN	SCALE FACTOR: 1-1
DATE: 10/16/2017	DRAWN BY: HMB
WORK ORDER NO. 276496	CHECKED BY: AS
SHEET NUMBER: <b>FA403</b>	
DWG. NO.: 4 OF 4	SHT. NO.: 424 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-FA403	REV. NO.:

50% SUBMISSION  
NOT FOR CONSTRUCTION

C:\P\WORKING\PI\10243371\AN-FA403.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

1 1M 1000 KCMIL DC POSITIVE CABLE  
 1MR 1000 KCMIL DC NEGATIVE RETURN CABLE  
 10GND NO. 10 AWG GROUND CONDUCTOR  
 2M 2000 KCMIL DC POSITIVE CABLE  
 2MR 2000 KCMIL DC NEGATIVE RETURN CABLE  
 2 NO. 6 2 NO. 6 AWG CONDUCTOR  
 2" 2 INCH CONDUIT

A A AMPERES  
 A-XD CURRENT TRANSDUCER  
 AC ALTERNATING CURRENT  
 AF AMPERES FRAME  
 AFF ABOVE FINISHED FLOOR  
 AIC AMPS INTERRUPTING CAPACITY  
 AL ALUMINUM  
 AM AMMETER  
 ANN ANNUNCIATOR  
 APPROX APPROXIMATE  
 AS AMMETER SWITCH  
 ASTM AMERICAN SOCIETY FOR TESTING AND MATERIALS  
 AT AMPERES TRIP  
 AUX AUXILIARY  
 AVE AVENUE  
 AWG AMERICAN WIRE GAUGE

B BDP BATTERY DISTRIBUTION PANEL  
 BKR BREAKER  
 BLDG BUILDING  
 BLK BLOCKED OR BLOCKAGE  
 BLVD BOULEVARD  
 BT BUS TIE CIRCUIT BREAKER

C C CONDUIT, CONTACTOR  
 CB CIRCUIT BREAKER  
 CF CLOSING FUSE  
 CI CAST IRON  
 CL CURB LINE  
 CKT CIRCUIT  
 CLF CURRENT LIMITING FUSE  
 COMP COMPRESSOR  
 CONC CONCRETE  
 CS CONTROL SWITCH  
 CST CONTROL TEST SWITCH  
 CT CURRENT TRANSFORMER  
 CX DC CURRENT TRANSFORMER

D DB DECIBELS  
 DC DIRECT CURRENT  
 DEPT DEPARTMENT  
 DET DETAIL  
 DIA DIAMETER  
 DIM DIMENSIONS  
 DISC DISCONNECT  
 DP DEEP  
 DWG DRAWING

E E EAST  
 EB EASTBOUND  
 EL, ELEV ELEVATION  
 EMG EMERGENCY  
 EMH ELECTRIC MANHOLE  
 EPR ETHYLENE PROPYLENE RUBBER  
 EQ EQUAL

E ER ELECTRICALLY RESET  
 EX EXISTING  
 F F-XD FREQUENCY TRANSDUCER  
 FDR FEEDER  
 FL FLOOR  
 FPP FIBER PATCH PANEL  
 FRE FIBER REINFORCED EPOXY (SEE RTRC)  
 FT FEET  
 FUT FUTURE

G G GREEN  
 GAL GALLON  
 GALV GALVANIZED  
 GIL GREEN INDICATING LIGHT  
 GND GROUND  
 GR GRADE  
 GRS GALVANIZED RIGID STEEL

H HMI HUMAN MACHINE INTERFACE  
 HORIZ HORIZONTAL  
 HR HAND RESET  
 HV HIGH VOLTAGE  
 HW HOT WATER  
 HZ HERTZ

I IB INBOUND  
 ID INSIDE DIAMETER, IDENTIFICATION  
 IED INTELLIGENT ELECTRONIC DEVICE  
 IN INCH  
 ISO ISOLATION  
 INST INSTANTANEOUS

J JB JUNCTION BOX  
 K KA KILO-AMPERES  
 KCMIL THOUSAND CIRCULAR MILS  
 KV KILO-VOLTS  
 KVA KILO-VOLT AMPERES  
 KW KILO-WATTS

L L LOCAL  
 LBS POUNDS  
 LC LOAD CENTER  
 LO LOCKOUT  
 LP LIGHTING POLE FIXTURE, LOW POINT  
 LS LIMIT SWITCH  
 LV LOW VOLTAGE

M MAX MAXIMUM  
 MAN, MNL MANUAL  
 MCB MAIN CIRCUIT BREAKER  
 MCM MILLION CIRCULAR MILLIMETERS  
 MFR-M MULTI-FUNCTION RELAY METERING  
 MH MANHOLE  
 MIN MINIMUM  
 MMFO MULTIMODE FIBER OPTIC CABLE  
 MPR MOTOR PROTECTION RELAY  
 MR MULTI-RATIO  
 MV MILLIVOLT

N N NORTH  
 NB NORTHBOUND  
 NC, N.C. NORMALLY CLOSED  
 NEG, N NEGATIVE  
 NEUT, N NEUTRAL  
 NIC NOT IN CONTRACT  
 NLTC NO LOAD TAP CHANGER  
 NO, N.O. NORMALLY OPEN  
 N.T.S. NOT TO SCALE

O OB OUTBOUND  
 OC ON-CENTER, OVERCURRENT  
 OCS OVERHEAD CATENARY SYSTEM  
 OD OUTSIDE DIAMETER  
 OOS OUT OF SERVICE

P PAC PROGRAMMABLE AUTOMATION CONTROLLER  
 PC PERSONAL COMPUTER  
 PECO PHILADELPHIA ELECTRIC COMPANY  
 PH,  $\phi$  PHASE  
 PL POSITIVE LOCAL, PLATE, PROPERTY LINE  
 PLC PROGRAMMABLE LOGIC CONTROLLER  
 POL POLARIZING  
 POS POSITIVE  
 PROP PROPERTY  
 PRT PHILADELPHIA RAPID TRANSIT  
 PT POTENTIAL TRANSFORMER  
 PTS POTENTIAL TRANSFORMERS  
 PVC POLY VINYL CHLORIDE  
 PWR POWER

Q QTY QUANTITY  
 R R RETURN NEGATIVE CABLE, RED  
 REC RECEPTACLE  
 RECT RECTIFIER  
 REQ'D REQUIRED  
 RES RESISTOR  
 RGS RIGID GALVANIZED STEEL  
 RIL RED LIGHT INDICATION  
 RM ROOM  
 RMC RIGID METAL CONDUIT  
 ROW RIGHT OF WAY  
 RTRC REINFORCED THERMOSETTING RESIN CONDUIT  
 RTU REMOTE TERMINAL UNIT

S S SECTION, SOUTH, SUPERVISORY  
 SA SURGE ARRESTOR  
 SB SOUTHBOUND  
 SC SHORT CIRCUIT, SURGE CAPACITOR  
 SCADA SUPERVISORY CONTROL AND DATA ACQUISITION  
 SE STORED ENERGY  
 SEC SECOND  
 SEPTA SOUTHEASTERN PENNSYLVANIA TRANSPORTATION AUTHORITY  
 SS SUBSTATION  
 ST STREET  
 STA STATIONING  
 STD STANDARD

S SUPL OVERHEAD SUPPLEMENTARY CABLE  
 SUPV SUPERVISORY  
 SVC SERVICE  
 SW SWITCH  
 SWGR SWITCHGEAR

T T TRANSFORMER  
 TEMP TEMPERATURE  
 TF TRIPPING FUSE  
 THK THICK  
 TK TRACK  
 TOT TOTALIZER  
 TP TRACTION POWER  
 TPSS TRACTION POWER SUBSTATION  
 TRANSF TRANSFER  
 TS TEST SWITCH  
 TW TROLLEY WIRE  
 TYP TYPICAL

U U/G UNDERGROUND  
 UON UNLESS OTHERWISE NOTED


V V VOLTS OR VOLTAGE  
 V-XD VOLTAGE TRANSDUCER  
 VA VALVE, VOLT-AMPERE  
 VAR VOLT-AMPERE REACTIVE  
 VM VOLTMETER  
 VS VOLTMETER SWITCH

W W WEST, WIRE, WHITE  
 W/ WITH  
 W-XD WATTAGE TRANSDUCER  
 WB WESTBOUND  
 WH WATT-HOUR METER  
 WLI WHITE LIGHT INDICATION  
 WP WATERPROOF

X XD TRANSDUCER  
 XFMR TRANSFORMER

Y YEL YELLOW

Z ZL ZIP LINE, POLY PULL LINE

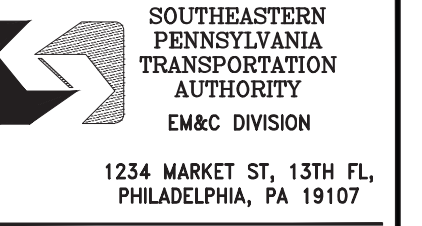

CHIEF ENGINEER - EM&C  
 CHIEF ENGINEERING OFFICER - BAS  
 CHIEF RAIL TRANSIT OFFICER  
 SYSTEM SAFETY  
 DIRECTOR OF ENGINEERING - BAS  
 MANAGER - ARCH/ENGINEERING  
 PROJECT MANAGER



REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
 ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
 ABBREVIATIONS

SCALE: NTS  
 SCALE FACTOR: -  
 DATE: 10/16/2017  
 DRAWN BY: YL  
 CHECKED BY: BH  
 WORK ORDER NO.: 276496  
 SHEET NUMBER: **TP400**  
 DWG. NO.: 1 of 22  
 SH. NO.: 426 of 452  
 ARCHIVE NO.:  
 COMPUTER FILE NO.: 17AN-TP400  
 REV. NO.: -

**50% SUBMISSION  
 NOT FOR CONSTRUCTION**





\_\_\_\_\_  
CHIEF ENGINEER - ENG  
\_\_\_\_\_  
CHIEF ENGINEERING OFFICER - BAS  
\_\_\_\_\_  
CHIEF RAIL TRANSIT OFFICER  
\_\_\_\_\_  
SYSTEM SAFETY  
\_\_\_\_\_  
DIRECTOR OF ENGINEERING - BAS  
\_\_\_\_\_  
MANAGER - ARCH/ENGINEERING  
\_\_\_\_\_  
PROJECT MANAGER

REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR  
ROUTE 59 TROLLEY LINE  
TRACTION POWER SUBSTATION  
REHABILITATION  
TRACTION POWER  
LEGENDS & SYMBOLS**

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: ARG
WORK ORDER NO.:	CHECKED BY: BH
SHEET NUMBER: <b>TP401</b>	
DWG. NO. 2 of 22	
SHT. NO. 427 of 452	
ARCHIVE NO.:	
COMPUTER FILE NO.:	REV. NO.:
17AN-TP401	-


**50% SUBMISSION  
NOT FOR CONSTRUCTION**

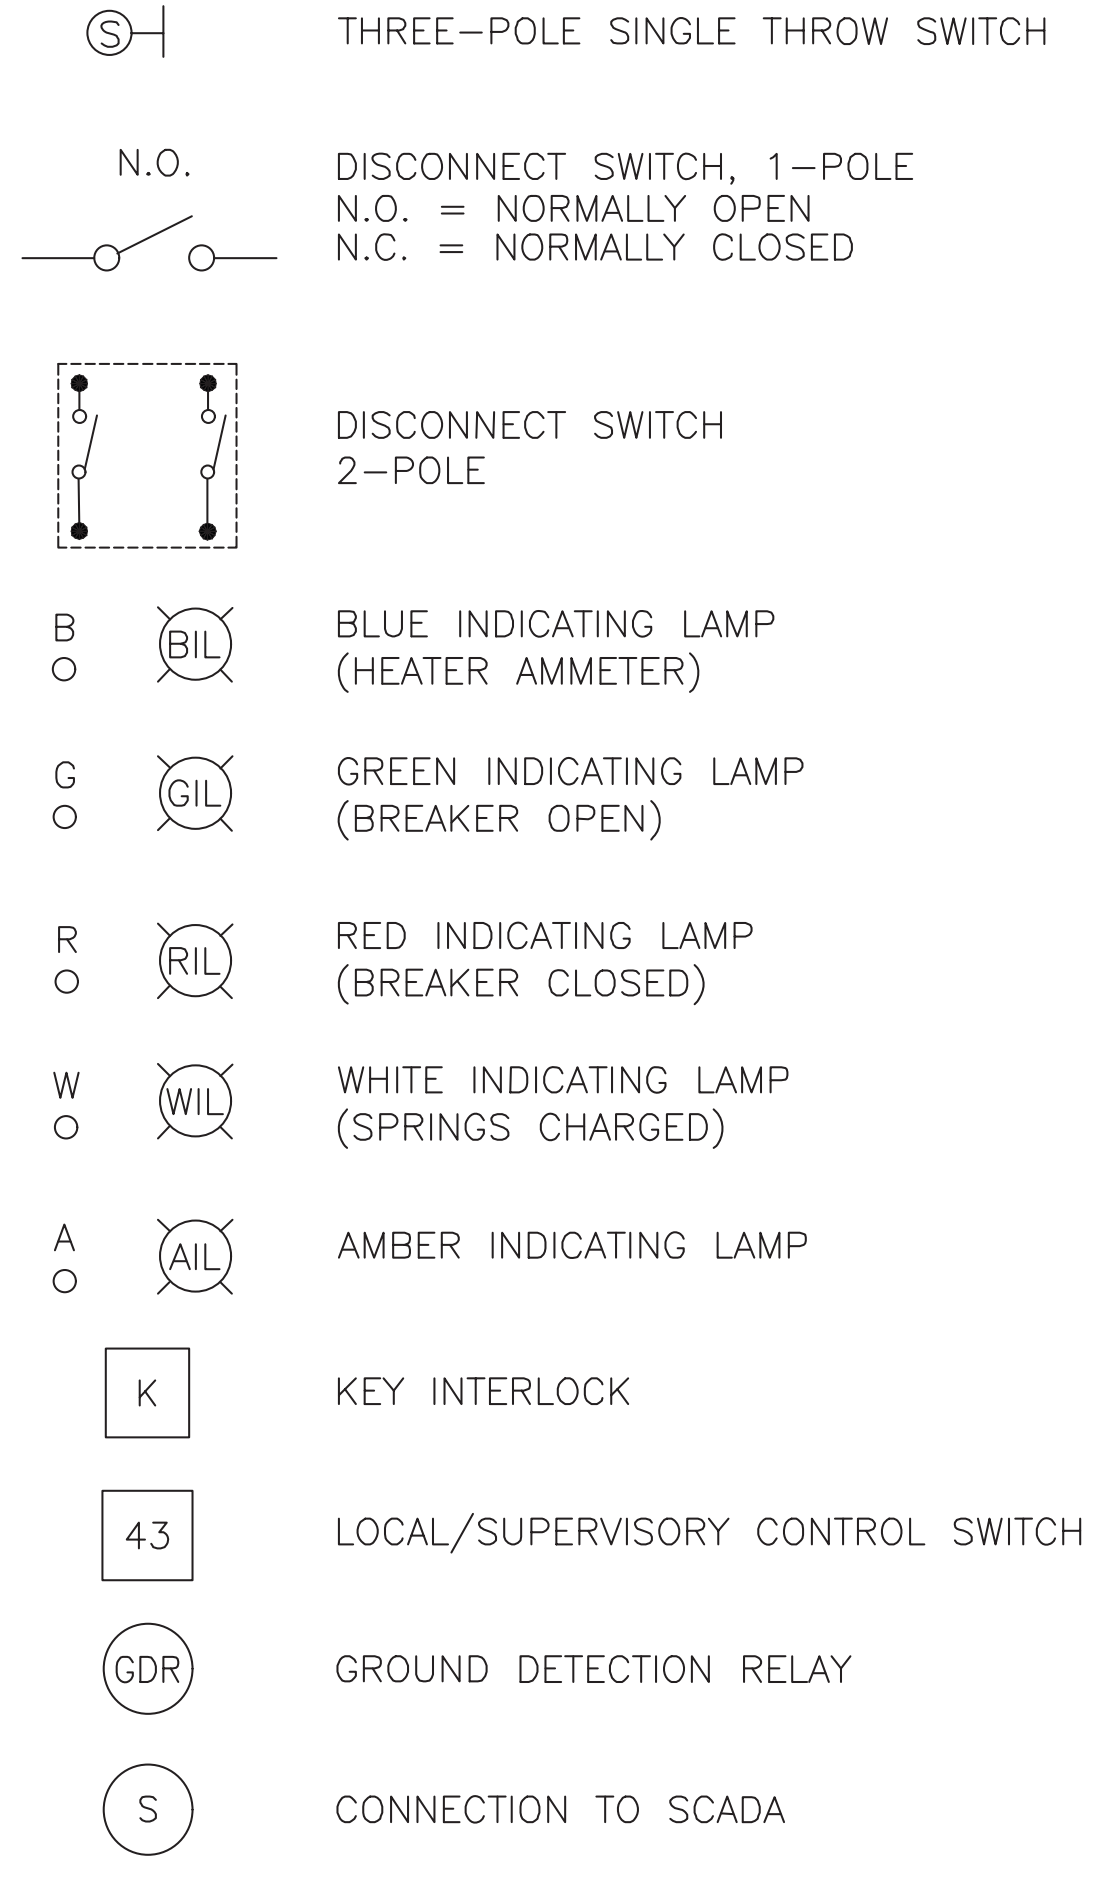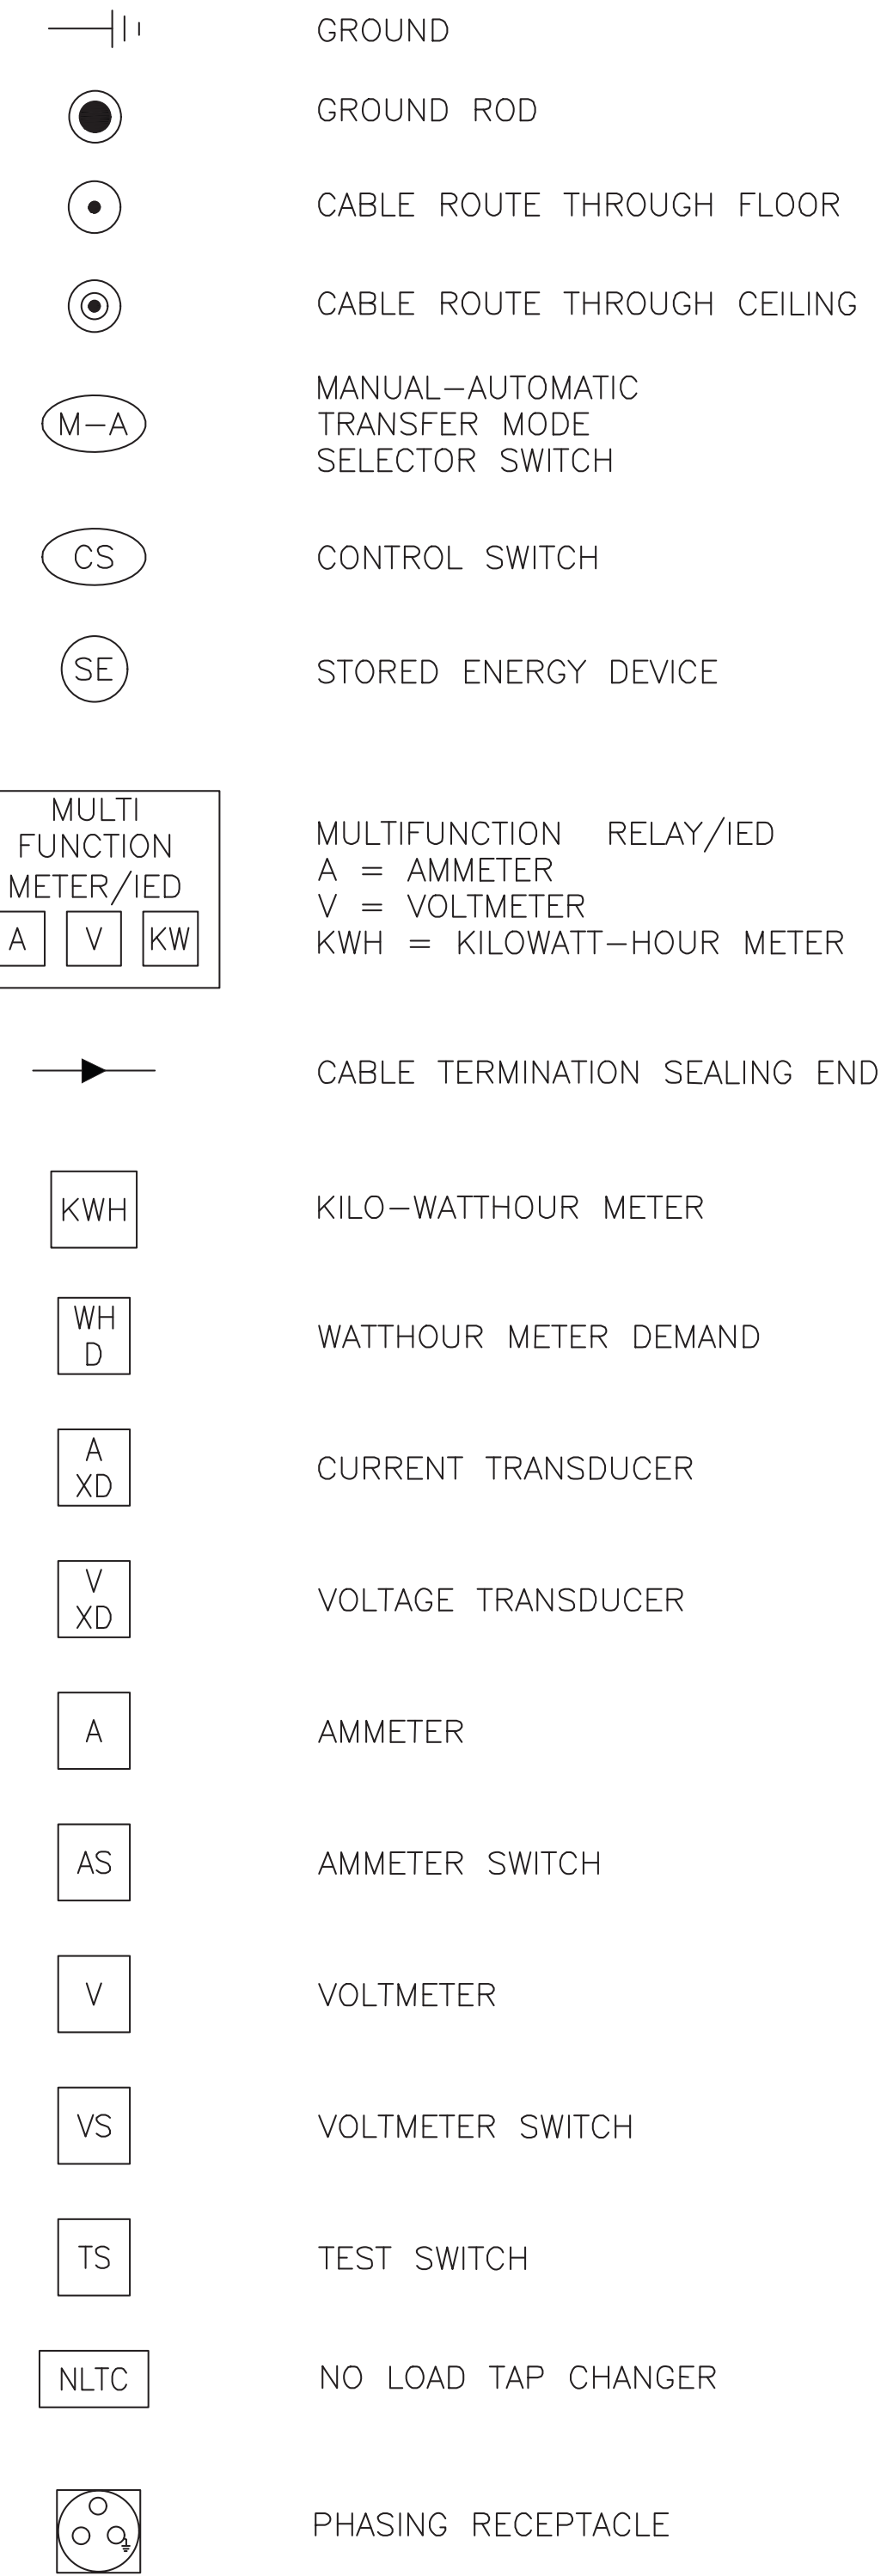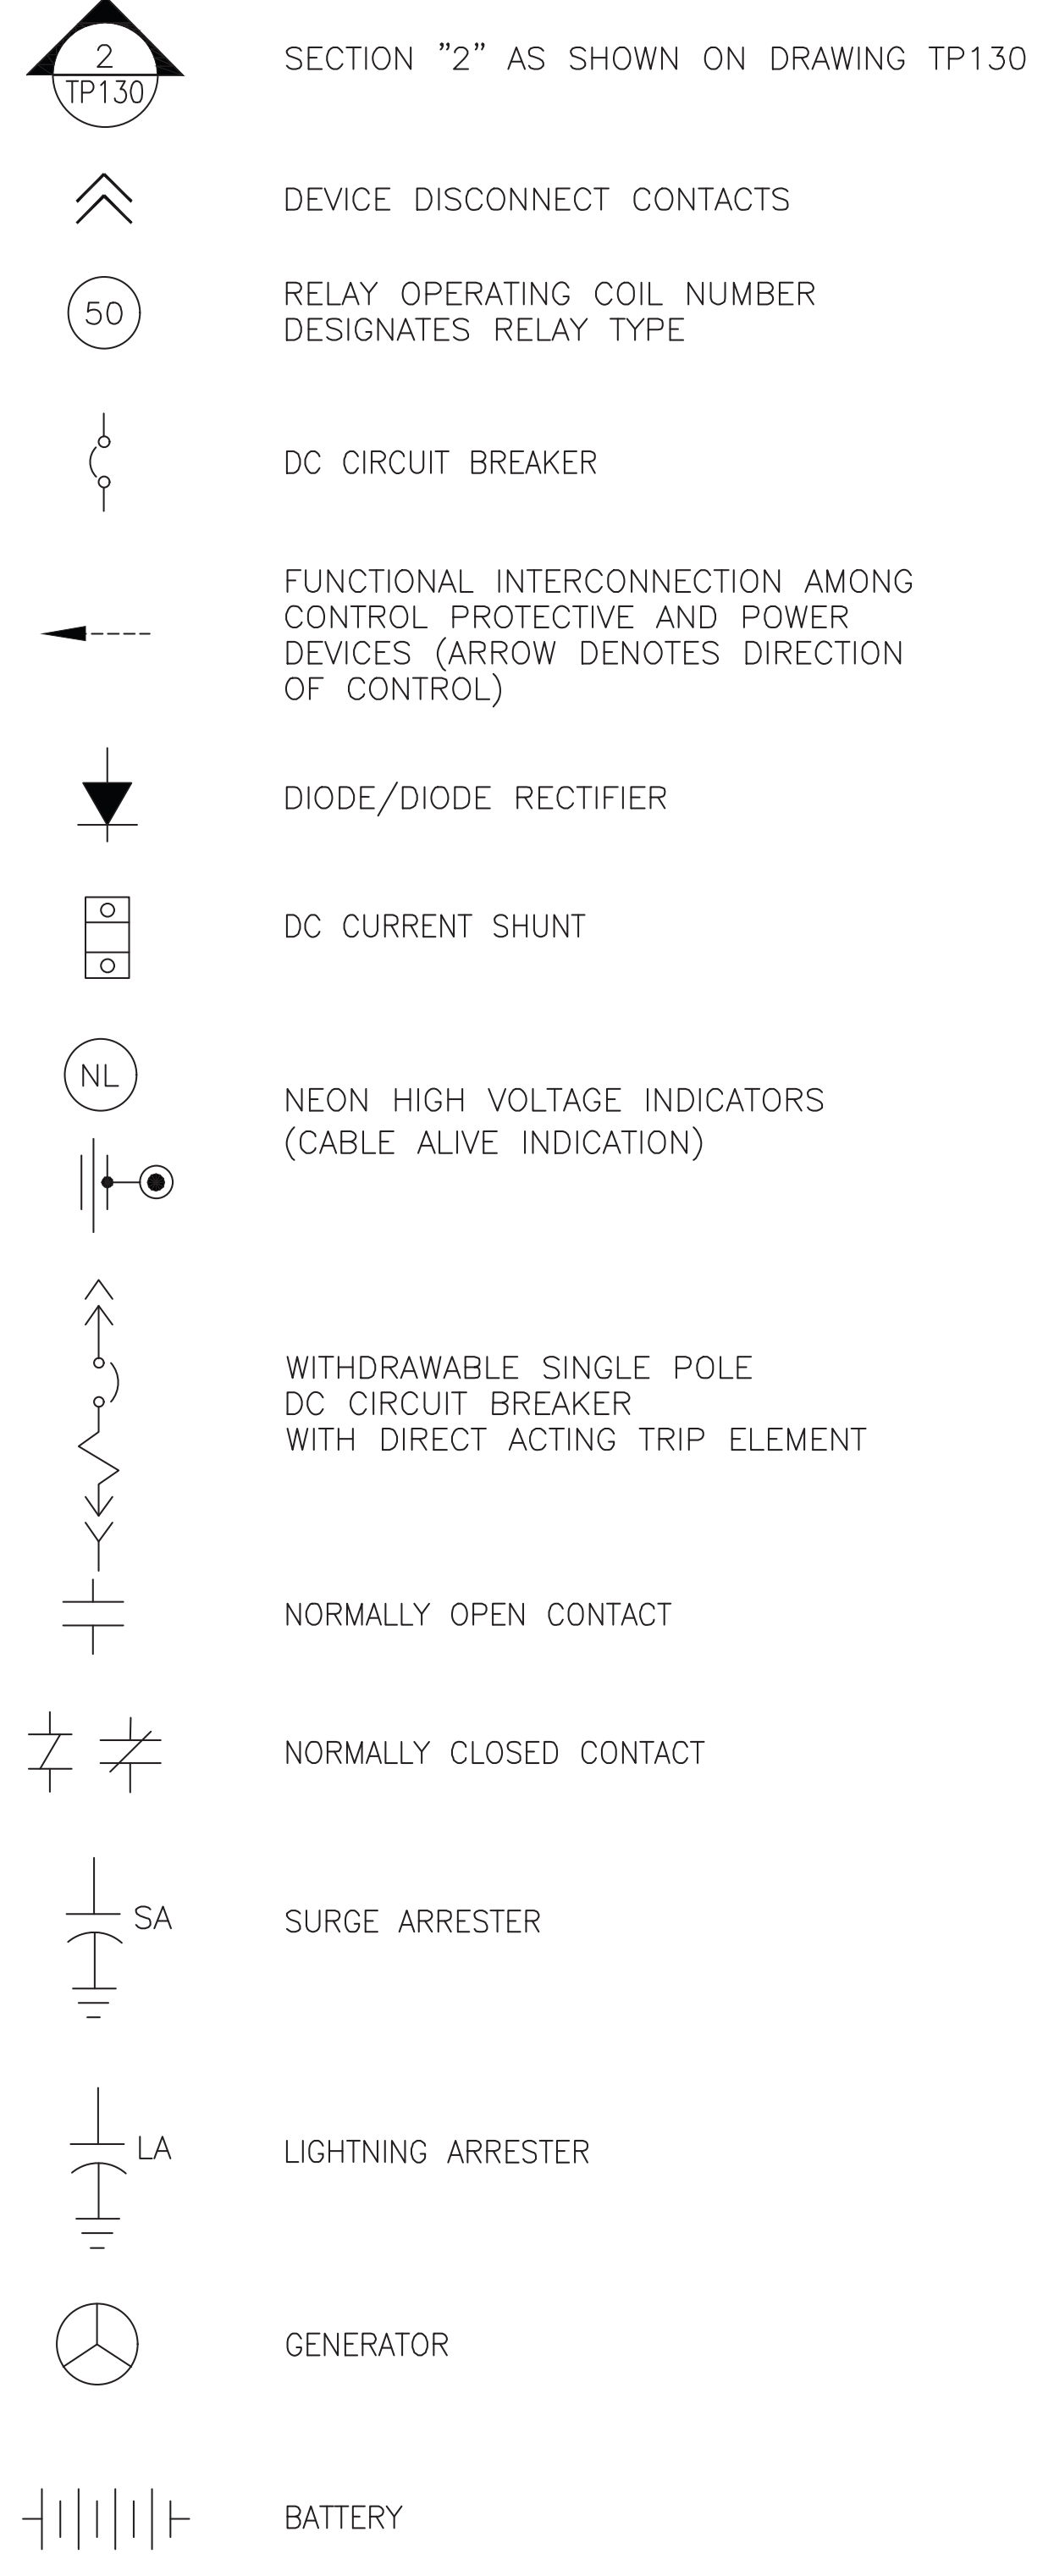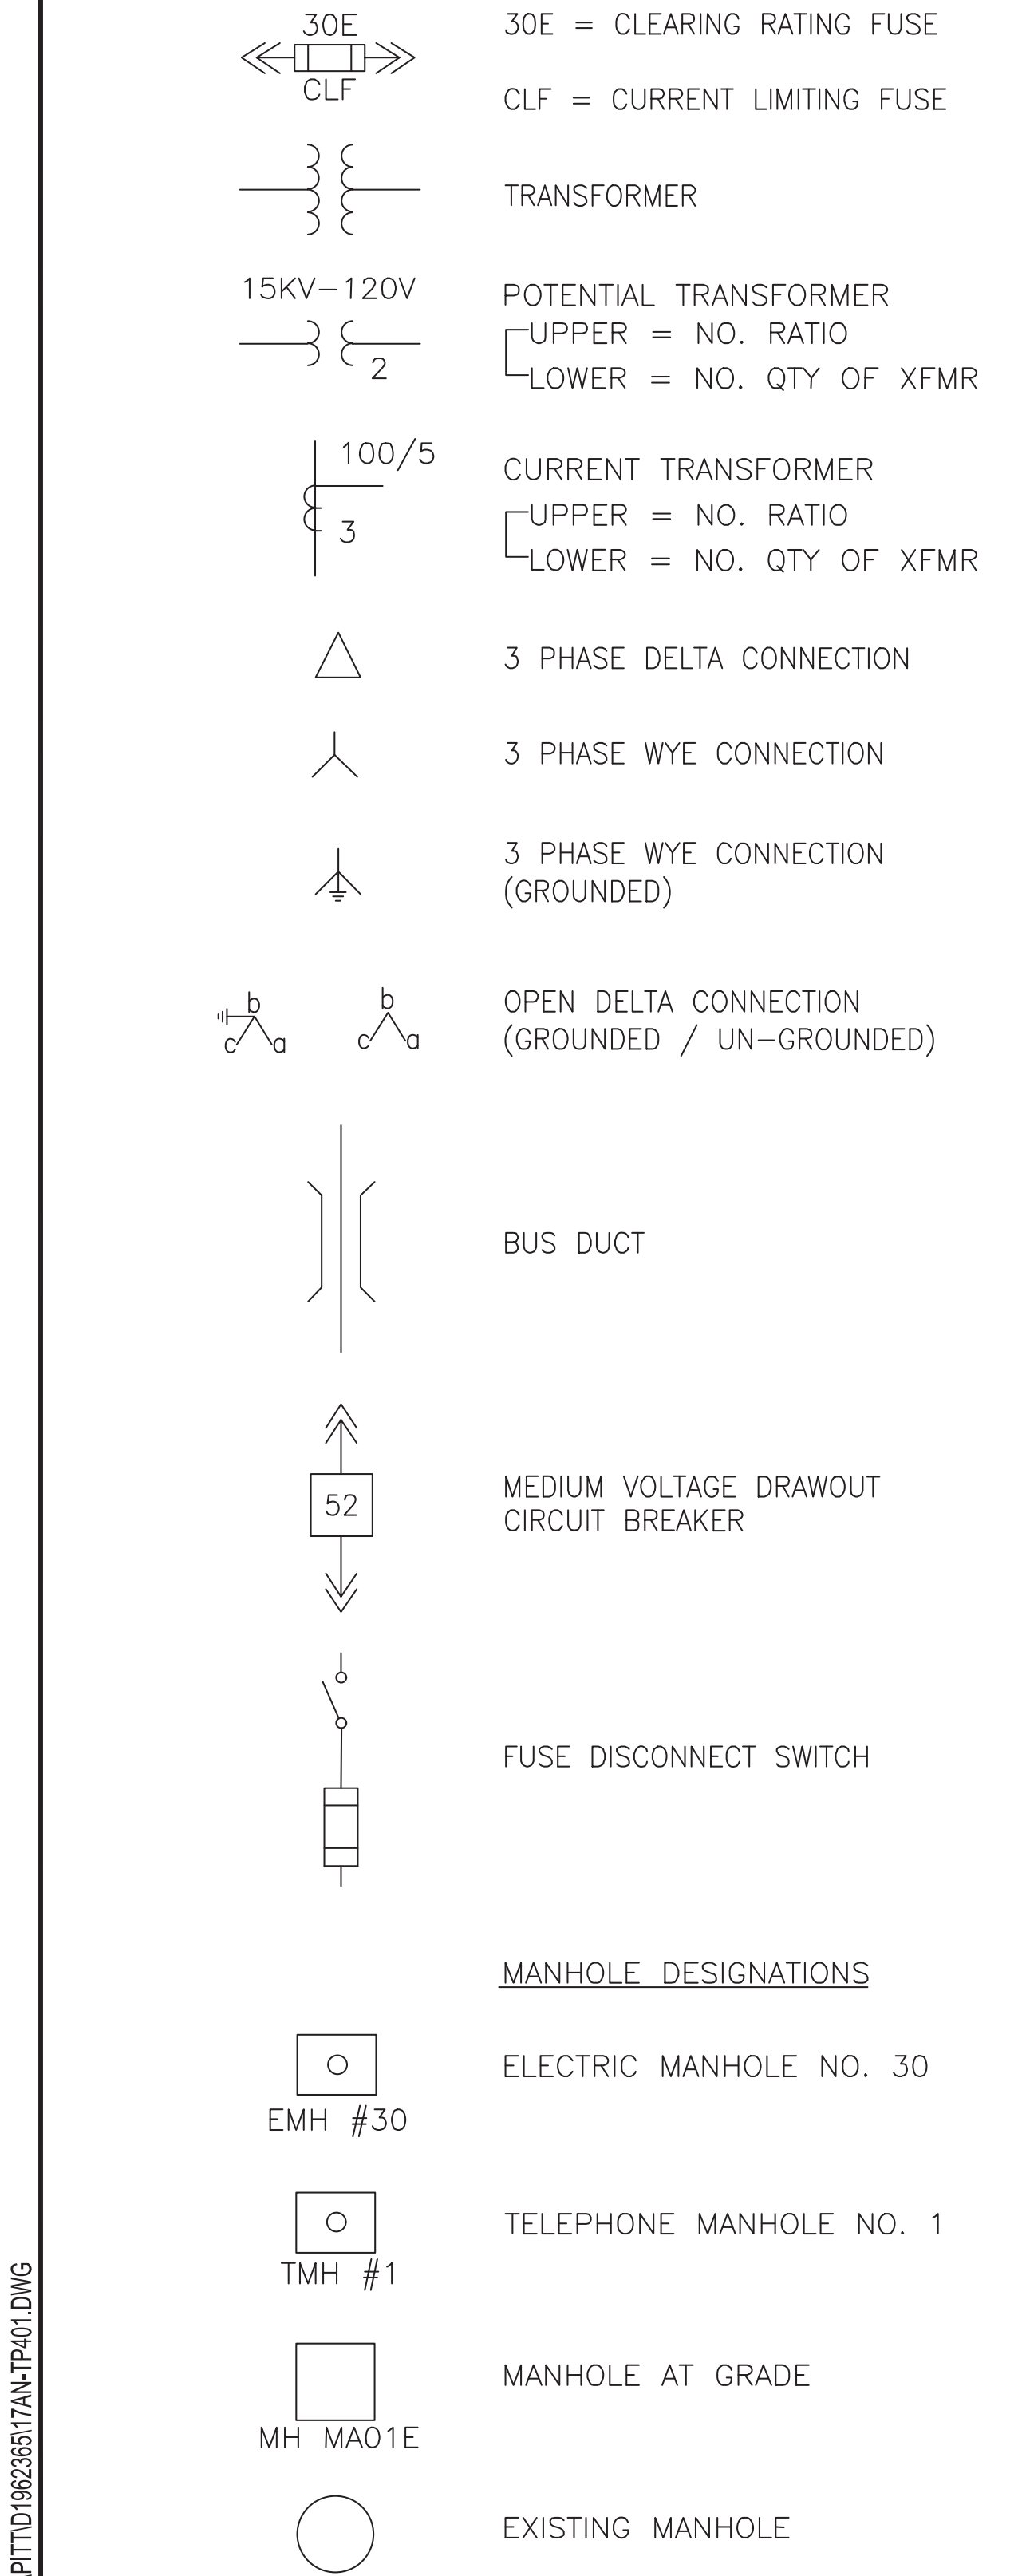

C:\P\WORKING\PTTID\168236517AN-TP402.DWG

DEVICE	DESCRIPTION
01	AC CIRCUIT BREAKER LOCAL CONTROL SWITCH
01-R	RECTIFIER 15KV AC CIRCUIT BREAKER REMOTE CONTROL SWITCH
04	RECTIFIER MASTER CONTROL RELAY
11	MULTI-FUNCTION RELAY - HEALTHY / FAILED
25	SYNCHRONISM CHECK RELAY
26RA	RECTIFIER HEAT SINK OVER-TEMPERATURE STAGE 1 - ALARM
26RX	AUXILIARY RELAY FOR DEVICE 26R
26RT	RECTIFIER HEAT SINK OVER-TEMPERATURE STAGE 2 - TRIP
26RHX	AUXILIARY RELAY FOR DEVICE 26RH
26A	TRANSFORMER OIL OVER-TEMPERATURE STAGE 1 - ALARM
26T	TRANSFORMER OIL OVER-TEMPERATURE STAGE 2 - TRIP
27	UNDERVOLTAGE RELAY
27A	LOSS OF DC AUXILIARY SUPPLY - ALARM
27T	LOSS OF DC AUXILIARY SUPPLY - TRIP
30	ANNUNCIATOR RELAY
32	RECTIFIER MAIN DC CIRCUIT BREAKER DIRECTIONAL INST O.C. TRIP DEVICE (REVERSE CURRENT)
33R	RECTIFIER COMPARTMENT DOOR SAFETY INTERLOCK
43 L/S	CONTROL MODE SELECTOR SWITCH
47	PHASE SEQUENCE RELAY
48	RECTIFIER INCOMPLETE SEQUENCE
49A	TRANSFORMER WINDING OVER-TEMPERATURE STAGE 1 - ALARM
49T	TRANSFORMER WINDING OVER-TEMPERATURE STAGE 2 - TRIP & LOCKOUT
50/51	INSTANTANEOUS AND TIME OVER-CURRENT - PHASE
50N/51N	INSTANTANEOUS AND TIME OVER-CURRENT - GROUND
51	TIME OVERCURRENT RELAY - PHASE
51C	TIME OVERCURRENT RELAY - CABLE OVERLOAD
51N	TIME OVERCURRENT RELAY - GROUND
51R	TIME OVERCURRENT RELAY - RECTIFIER OVERLOAD
52	AC CIRCUIT BREAKER
52-BT	AC CIRCUIT BREAKER - BUS TIE
52-F	AC CIRCUIT BREAKER - FEEDER
52-L	AC CIRCUIT BREAKER - INCOMING LINE
52-T	AC CIRCUIT BREAKER - RECTIFIER
58A	RECTIFICATION FAILURE RELAY - ALARM
58T	RECTIFICATION FAILURE RELAY - TRIP
63A	RAPID PRESSURE RISE DEVICE - ALARM
63T	RAPID PRESSURE RISE DEVICE - TRIP & LOCKOUT
64P	RECTIFIER GROUND RELAY - STRUCTURE HOT (TRIP)
64N	RECTIFIER GROUND RELAY - STRUCTURE GROUNDED (ALARM)
67	DIRECTIONAL OVERCURRENT RELAY - PHASE
67N	DIRECTIONAL OVERCURRENT RELAY - GROUND
69	PERMISSIVE CONTROL DEVICE

DEVICE	DESCRIPTION
71A	TRANSFORMER LOW OIL LEVEL - ALARM
71T	TRANSFORMER LOW OIL LEVEL - TRIP
72-R	DC CIRCUIT BREAKER - RECTIFIER MAIN DC
74	ALARM RELAY
86	LOCKOUT RELAY
86B	LOCKOUT RELAY - BUS DIFFERENTIAL
86X	LOCKOUT RELAY - RECTIFIER CONDITIONAL
84	BLOWN FUSE INDICATION
87B	DIFFERENTIAL RELAY - BUS ZONE
89	LOAD INTERRUPTER SWITCH
89N	RECTIFIER NEGATIVE LEAD DISCONNECT SWITCH
94	TRIPPING RELAY
98	RECTIFIER LOSS OF DIODE
99	RECTIFIER LOSS OF DIODE
101	DC CIRCUIT BREAKER - LOCAL CONTROL (TRIP/CLOSE) SWITCH
111	MULTI-FUNCTION RELAY - HEALTHY / FAILED
143	DC CIRCUIT BREAKER - CONTROL MODE SELECTOR (LOCAL/REMOTE/HMI) SWITCH
150F	DC TRACTION FEEDER - RATE OF RISE RELAY
164S	DC SWITCHGEAR - GROUND RELAY - STRUCTURE HOT (TRIP)
164SX	DC SWITCHGEAR - GROUND RELAY - STRUCTURE GROUNDED (ALARM)
169	DC TRACTION FEEDER - PERMISSIVE SETUP RELAY
172	DC TRACTION FEEDER CIRCUIT BREAKER
176	DC FEEDER CIRCUIT BREAKER - INSTANTANEOUS SERIES TRIP (DIRECT ACTING)
176F	DC FEEDER CIRCUIT BREAKER- INSTANTANEOUS OVERCURRENT RELAY
201C	SUPERVISORY INTERPOSING RELAY - CLOSE
201T	SUPERVISORY INTERPOSING RELAY - TRIP
GDR	GROUND DETECTION RELAY

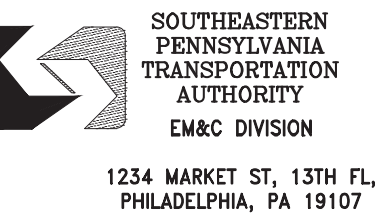

CHIEF ENGINEER-EM&C  
 CHIEF ENGINEERING OFFICERS-EM&C  
 CHIEF RAIL TRANSIT OFFICER  
 SYSTEM SAFETY  
 DIRECTOR OF ENGINEERING-EM&C  
 MANAGER-ARCHITECTURE/ENGINEERING  
 PROJECT MANAGER



REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR ROUTE 69 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION TRACTION POWER DEVICE TABLES**

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: YL CHECKED BY: BK
WORK ORDER NO: 276496	SHEET NUMBER TP402
DWG NO.: 3 OF 22	SHT NO.: 428 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP402	REV. NO.:

**50% SUBMISSION  
NOT FOR CONSTRUCTION**


DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
EXISTING/PROPOSED SUBSTATION SITE PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	MB
WORK ORDER NO.:	276496	CHECKED BY:	BEZ
SHEET NUMBER:	<b>TP405</b>		
DWG. NO.:	4	OF	22
SHT. NO.:	429	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-TP405	REV. NO.:	-

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

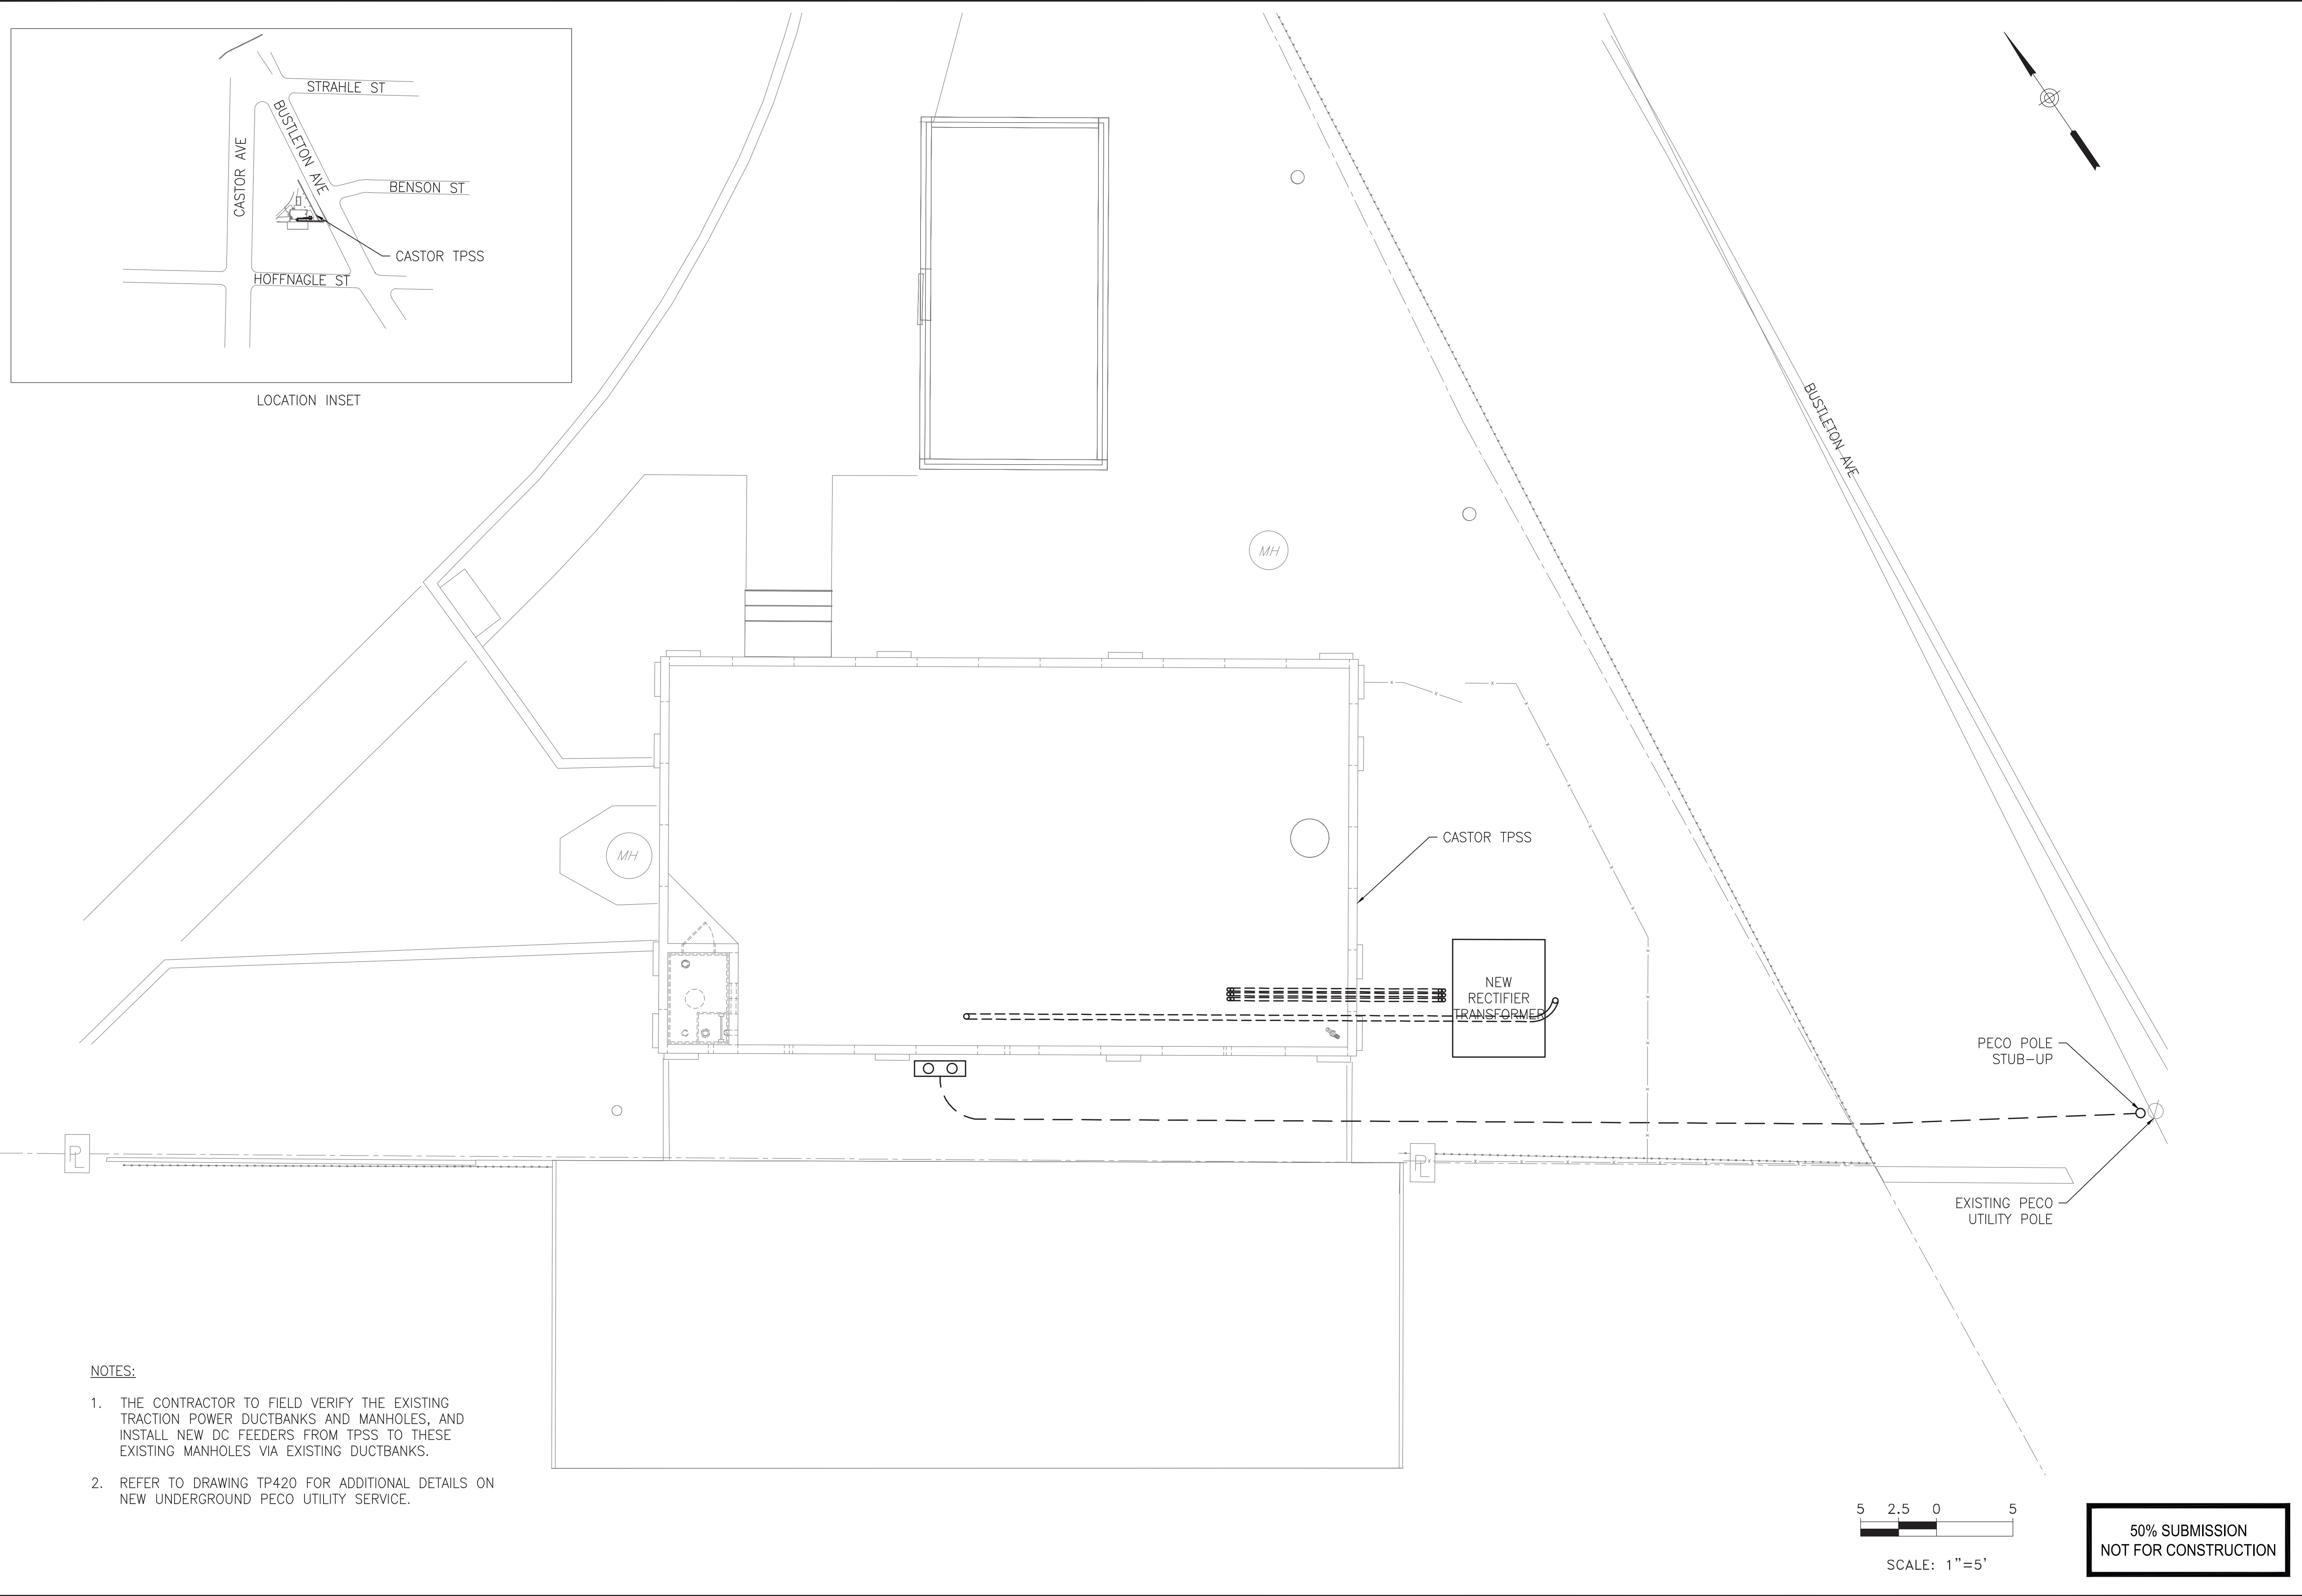

- NOTES:**
1. THE CONTRACTOR TO FIELD VERIFY THE EXISTING TRACTION POWER DUCTBANKS AND MANHOLES, AND INSTALL NEW DC FEEDERS FROM TPSS TO THESE EXISTING MANHOLES VIA EXISTING DUCTBANKS.
  2. REFER TO DRAWING TP420 FOR ADDITIONAL DETAILS ON NEW UNDERGROUND PECO UTILITY SERVICE.


C:\P\WORKING\PI\17\AN\TP405.DWG

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
EXISTING SINGLE LINE DIAGRAM

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: DMH CHECKED BY: BEZ
WORK ORDER NO. 276496	SHEET NUMBER 276496
<b>TP406</b>	
DWG. NO.: 5	OF 22
SHT. NO.: 430	OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP406	REV. NO.:

- NOTES:**
- REFER TO DRAWING TP401 FOR LEGENDS AND SYMBOLS.
  - DEMOLISH EXISTING DC POSITIVE AND NEGATIVE CABLES OUT TO THE EXISTING CATENARY STRUCTURE.

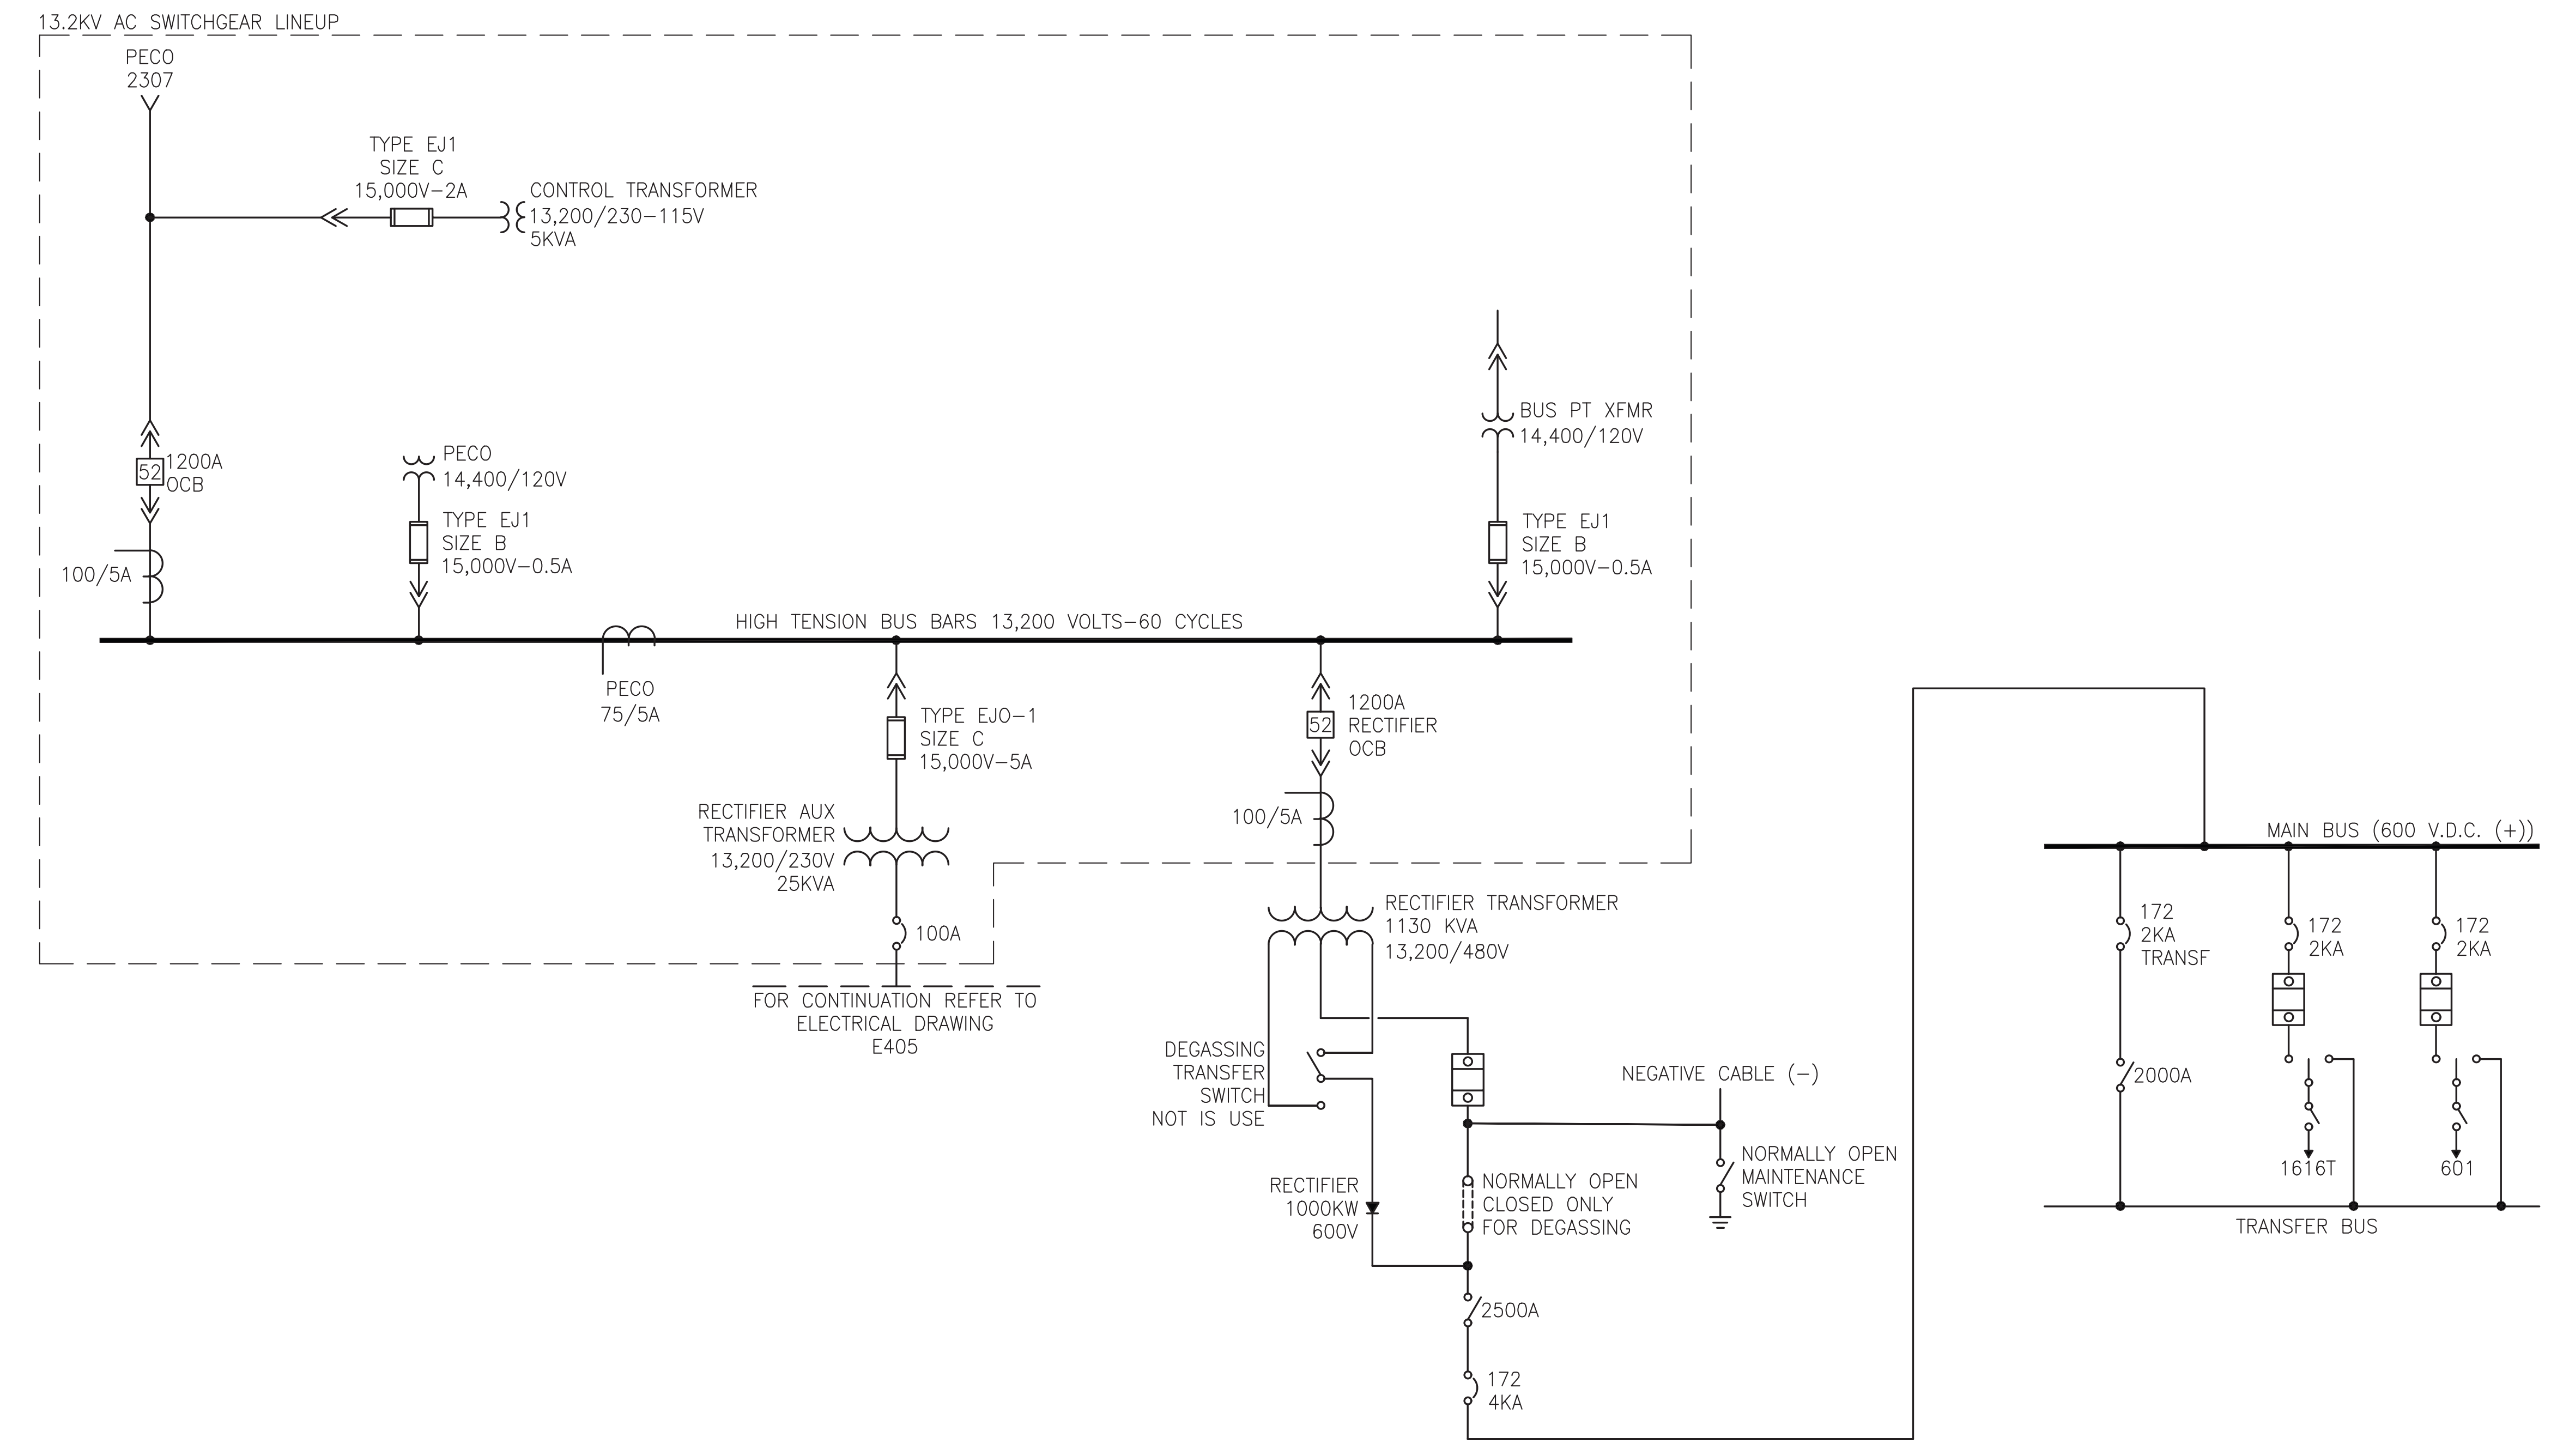


50% SUBMISSION  
NOT FOR CONSTRUCTION

CHIEF ENGINEER - EMC
CHIEF ENGINEERING OFFICER - E&M
CHIEF RAIL TRANSIT OFFICER
SYSTEM SAFETY
DIRECTOR OF ENGINEERING - S&B
MANAGER - ARCHITECTURE ENGINEERING
PROJECT MANAGER

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
EXISTING EQUIPMENT PLAN

SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: YL
WORK ORDER NO. 276496	CHECKED BY: BH
SHEET NUMBER	TP407
DWG. NO.: 6 OF 22	SHT. NO.: 431 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP407	REV. NO.:

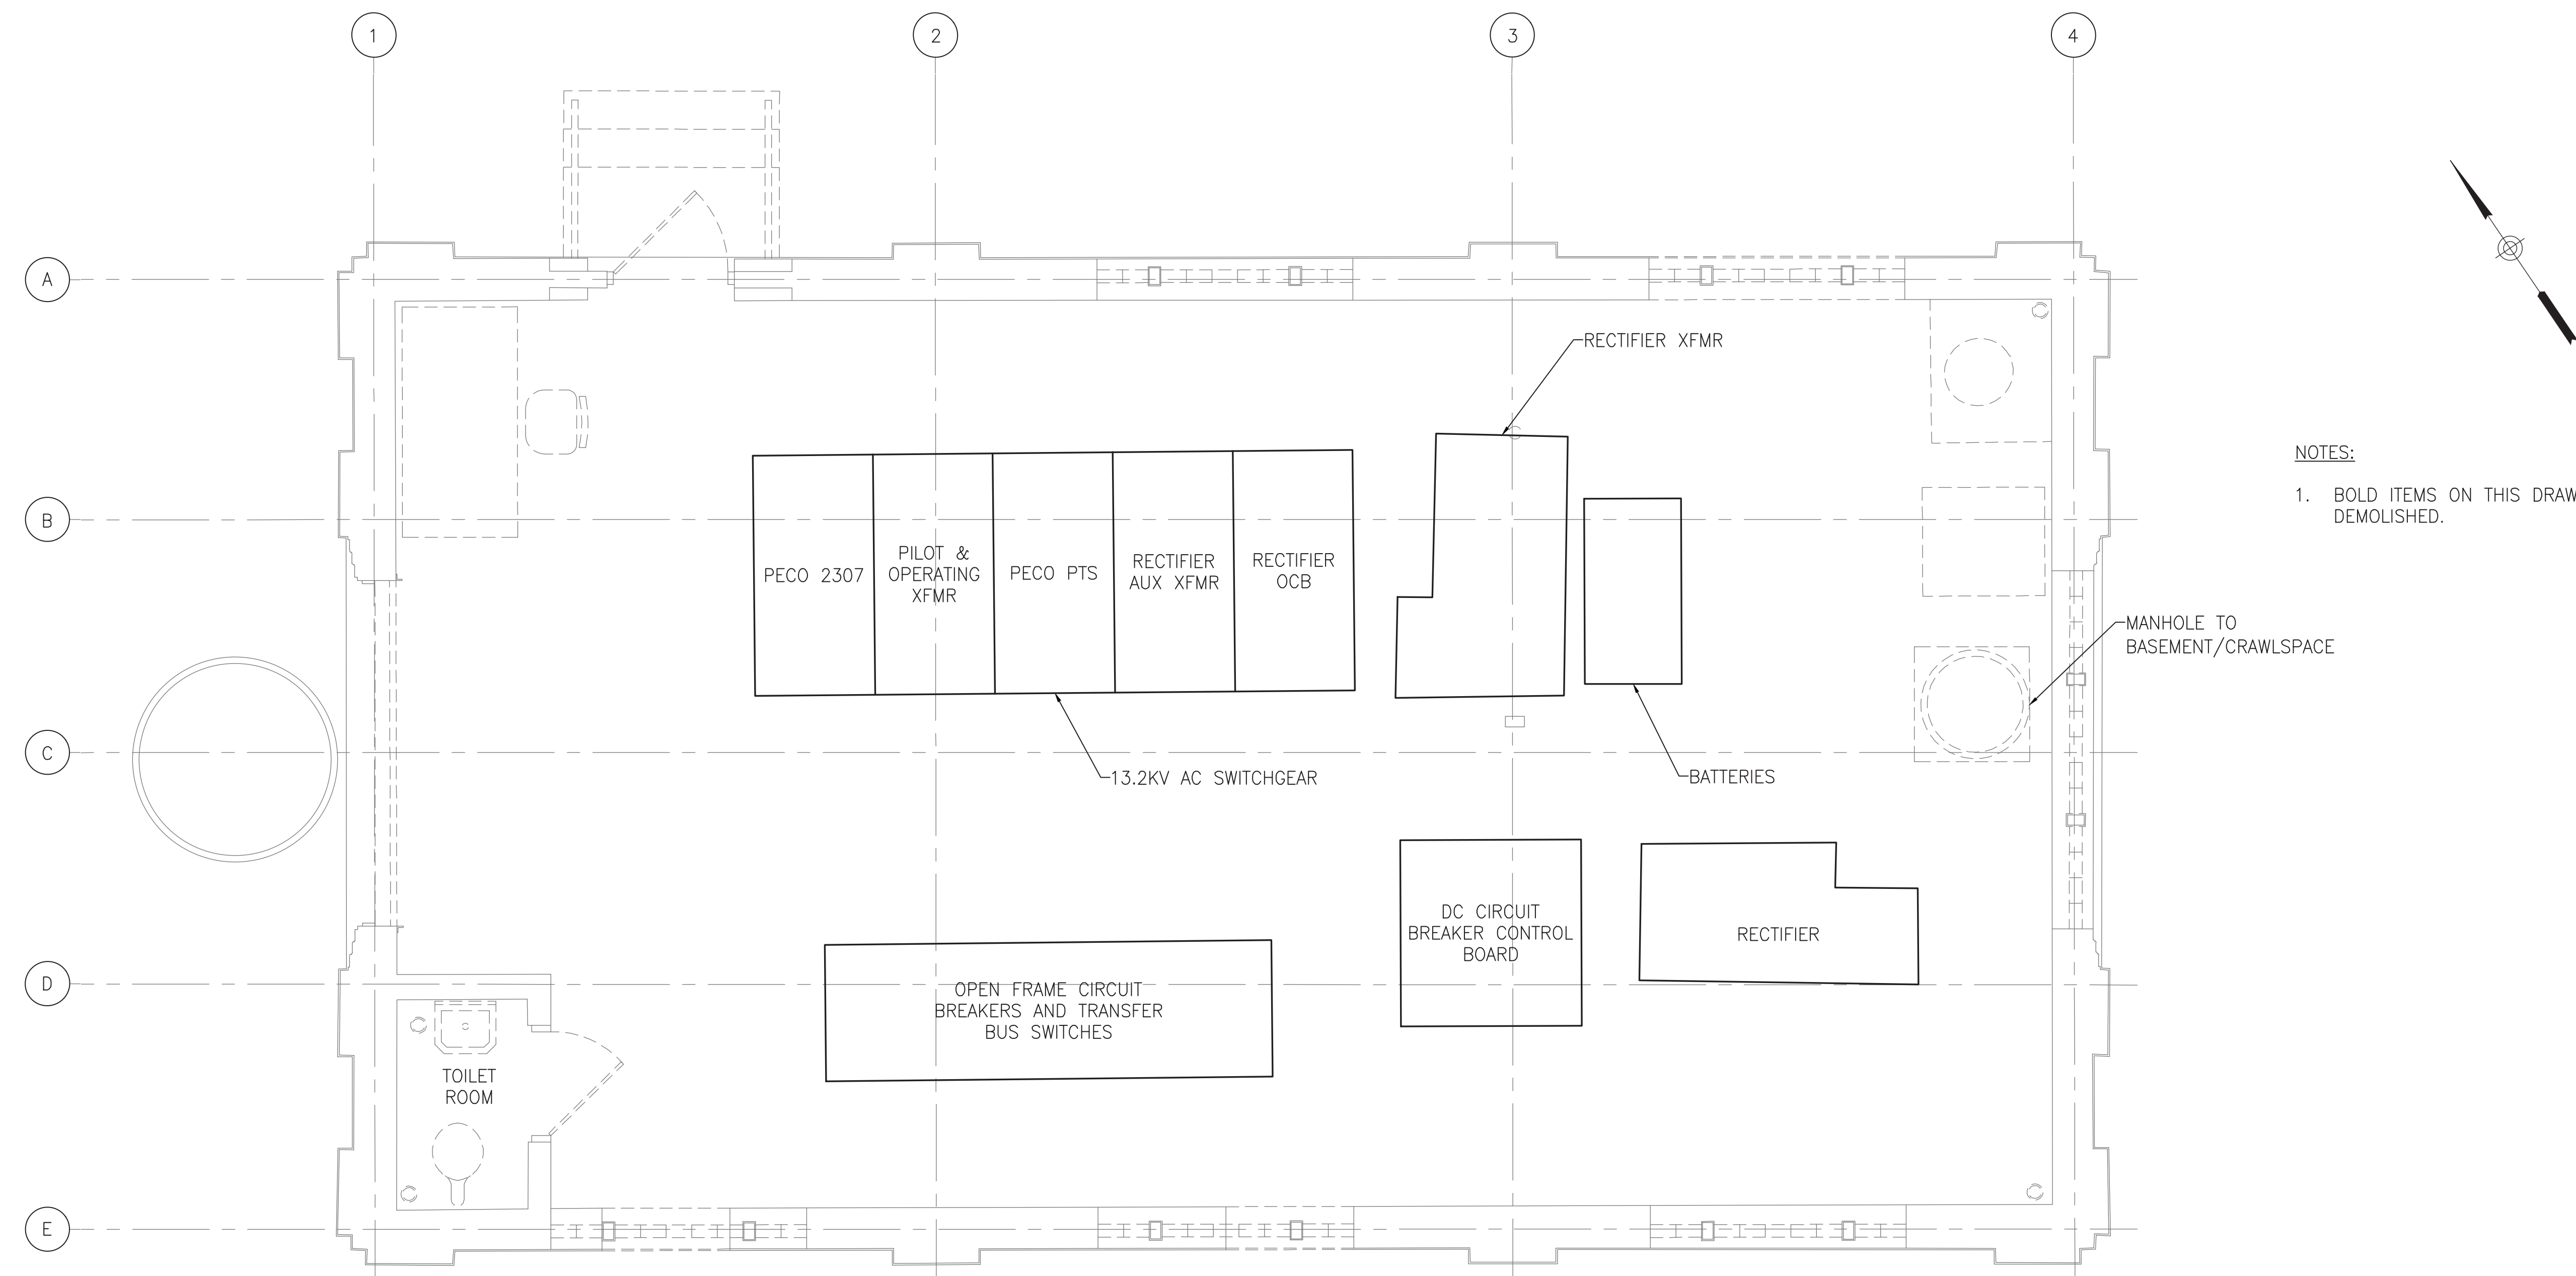


NOTES:  
1. BOLD ITEMS ON THIS DRAWING TO BE DEMOLISHED.

**1** EXISTING FIRST FLOOR EQUIPMENT PLAN  
TP407 SCALE: 3/8" = 1'-0"

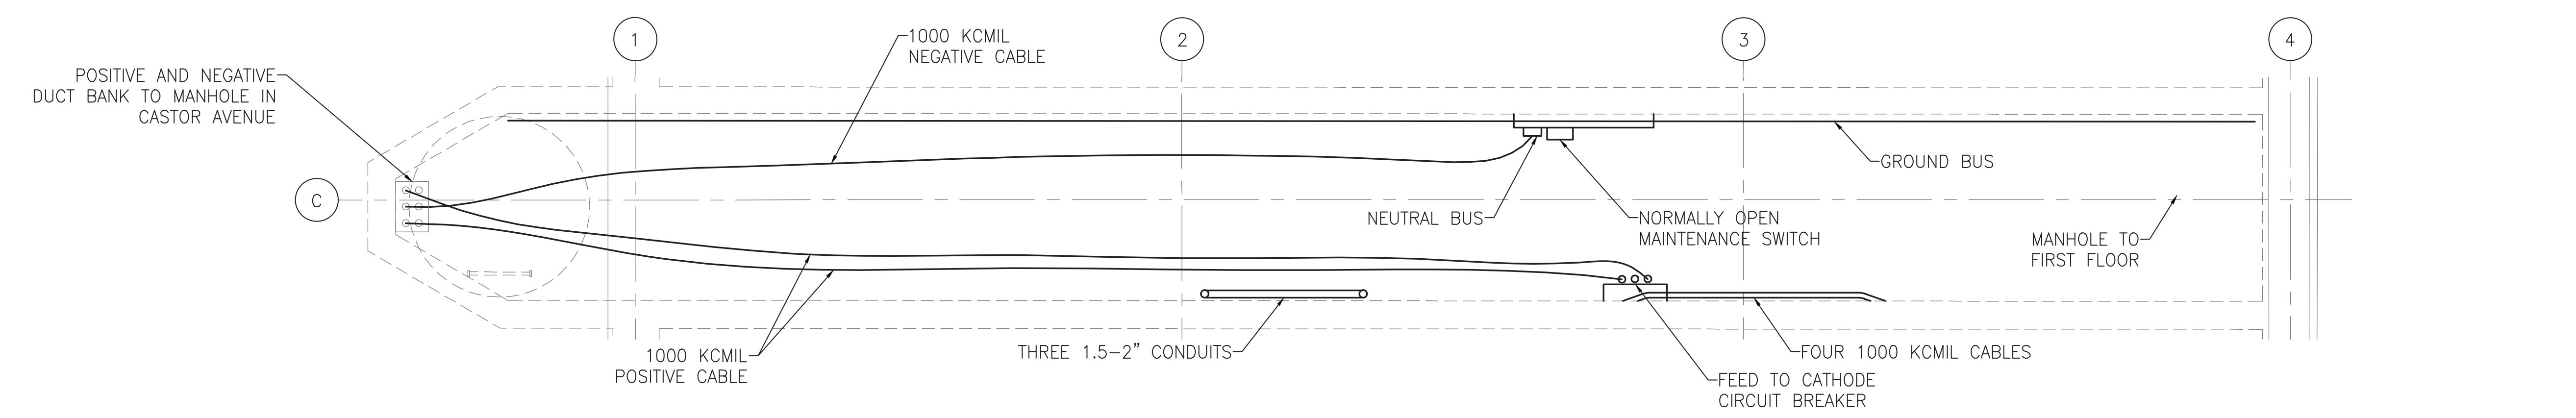

**2** EXISTING BASEMENT/CRAWLSPACE/TUNNEL EQUIPMENT PLAN  
TP407 SCALE: 3/8" = 1'-0"

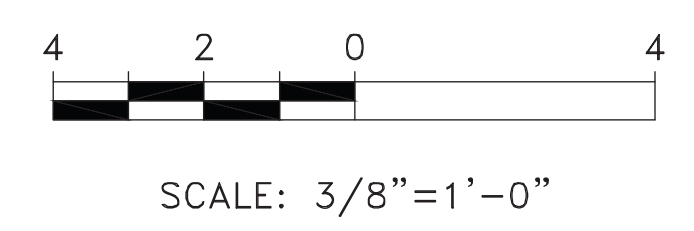

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PI\1D\66236517AN-TP407.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
PROPOSED SINGLE LINE DIAGRAM

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: DMH CHECKED BY: BEZ
WORK ORDER NO. 276496	
SHEET NUMBER <b>TP409</b>	
DWG. NO.: 7 OF 22	SHT. NO.: 432 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP409	

50% SUBMISSION  
NOT FOR CONSTRUCTION

NOTES:

- EQUIPMENT SHOWN IS NEW.
- THE CONTRACTOR TO DETERMINE RATING OF RECTIFIER OUTPUT VOLTAGE.
- REFER TO DRAWING TP401 FOR LEGENDS AND SYMBOLS AND DRAWING TP402 FOR DEVICE TABLE.
- REFER TO DRAWINGS TP410 THRU TP412 FOR STAGING PLANS.
- REPLACE DC POSITIVE AND NEGATIVE CABLES TO THE EXISTING CATENARY STRUCTURE.
- PROVIDE SPARE DRAWOUT CIRCUIT BREAKERS ALONG WITH MANUFACTURER SUPPLIED REUSABLE DUST COVERS. LOCATE IN ROOM PER DRAWING TP420.

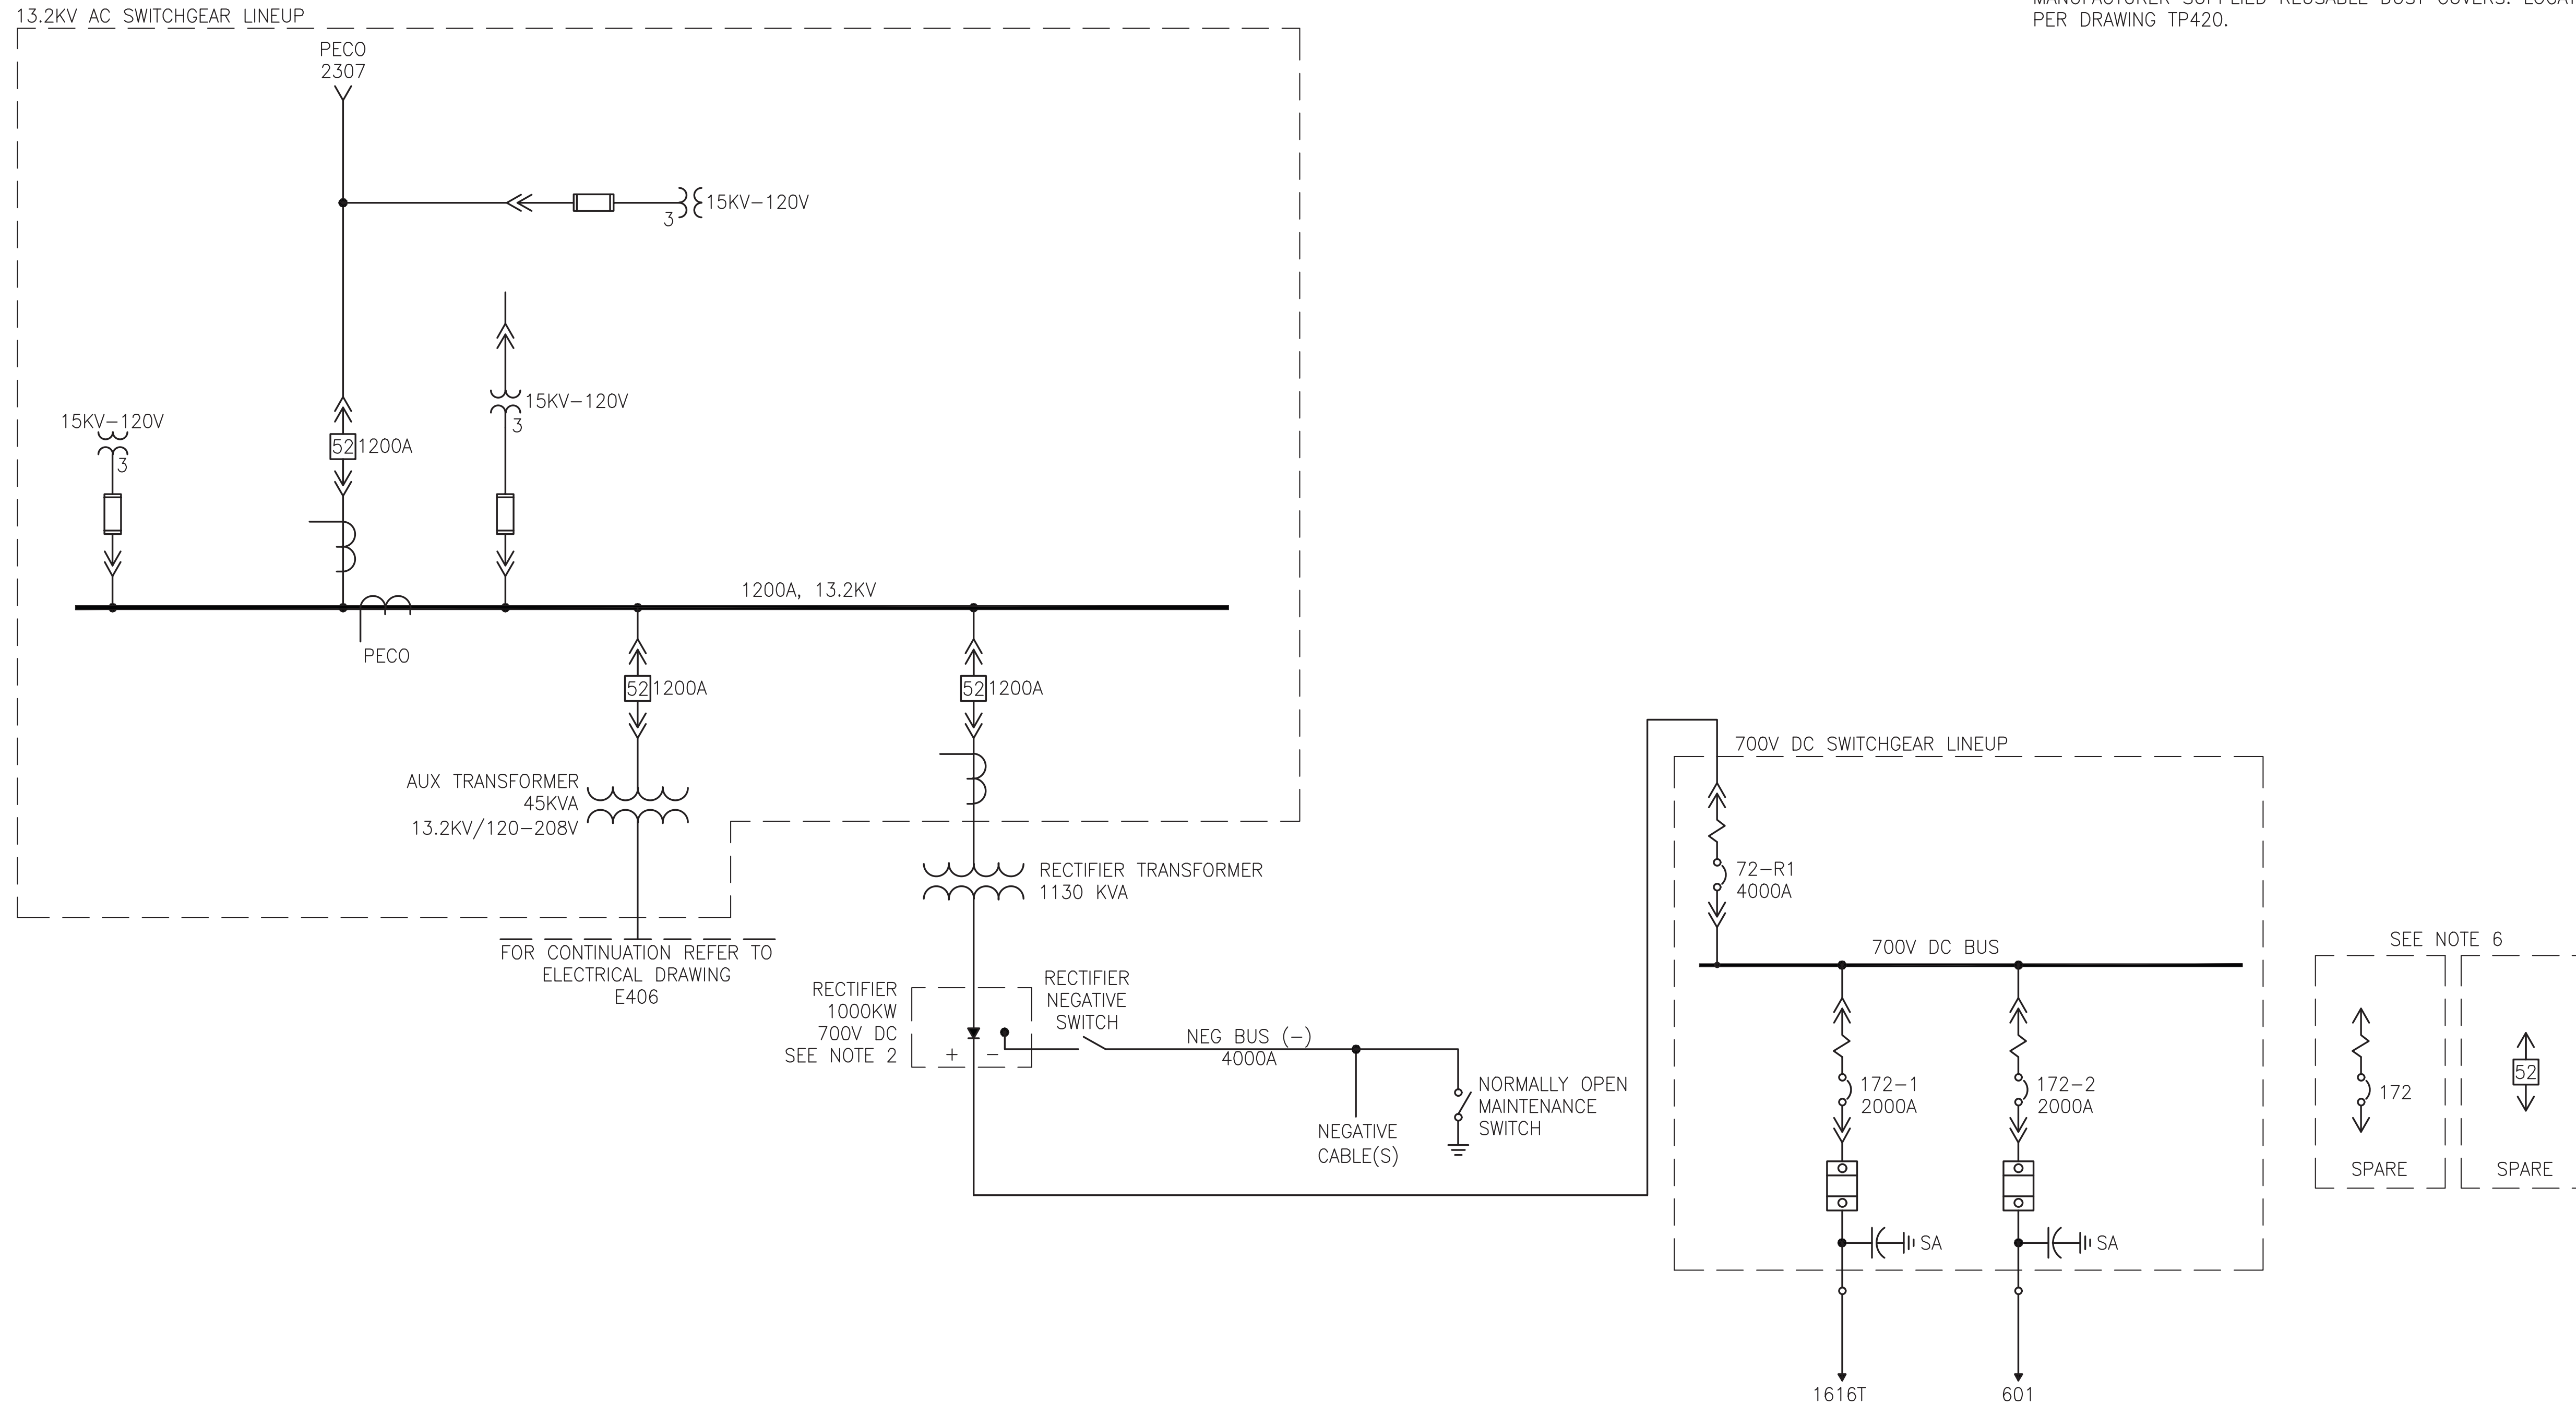

C:\P\WORKING\PI\1D\66236517AN-TP410.DWG



1234 MARKET ST., 13TH FL.  
PHILADELPHIA, PA 19107

CHIEF ENGINEER-EM&C  
CHIEF ENGINEERING OFFICER-EM&C  
CHIEF RAIL TRANSFER OFFICER  
SYSTEM SAFETY  
DIRECTOR OF ENGINEERING-EM&C  
MANAGER-ARCH/ENGINEERING  
PROJECT MANAGER



REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
STAGING ACTIVITIES & NOTES

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: ARG CHECKED BY: VS
WORK ORDER NO. 276496	
SHEET NUMBER <b>TP410</b>	
DWG. NO.: 8	OF 22
SHT. NO.: 433	OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP410	REV. NO.:

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

**NOTES:**  
1. REMOVE INDICATES REMOVAL AND PROPER DISPOSAL OF EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS THROUGHOUT CONTRACT.

OUTAGE TYPES:	STAGING ACTIVITIES:
BECAUSE THERE IS ONLY ONE RECTIFIER-TRANSFORMER SET, THE WHOLE TPSS WILL HAVE TO BE SHUT OFF WHEN EQUIPMENT REPLACEMENT TAKES PLACE. DURING THIS OUTAGE THE TROLLEY BUS OPERATION WILL CONTINUE BY EITHER EXTENDING ELECTRICAL FEED FROM GRISSON TPSS OR BY DIESEL OPERATION.	<u>STAGE 1</u> (DRAWINGS TP411 THRU TP412): A. WITHOUT POWER SHUTDOWN: 1. INSTALL NEW FENCE AND GATE FOR NEW RECTIFIER TRANSFORMER OUTSIDE OF THE TPSS. 2. INSTALL NEW LIQUID FILLED RECTIFIER TRANSFORMER OUTSIDE OF THE TPSS. INSTALL CONCRETE PAD FOR THE TRANSFORMER AND SPILLED OIL CONTAINMENT SYSTEM. INSTALL DUCTS FOR PRIMARY AND SECONDARY TRANSFORMER CONNECTIONS. INSTALL DUCT FOR RELAY PROTECTION AND MONITORING CIRCUITS. 3. LAY THE NEW UNDERGROUND 13.2KV FEEDERS FROM PECO STUB-UP. B. WITH COMPLETE POWER SHUTDOWN: 1. REMOVE EXISTING RECTIFIER TRANSFORMER, RECTIFIER UNIT, AUXILIARY TRANSFORMER, 13.2KV AC SWITCHGEAR, DC CIRCUIT BREAKERS, TRANSFER BUS SWITCHES, BATTERIES, AND DC CIRCUIT BREAKER CONTROL BOARD. 2. MAKE THE STRUCTURAL MODIFICATIONS AND OTHER BUILDING REPAIRS. 3. INSTALL NEW RECTIFIER UNIT, AUXILIARY TRANSFORMER, 13.2KV AC SWITCHGEAR, 700V DC SWITCHGEAR, BATTERIES AND RTU/HMI CABINET. 4. MAKE CONNECTIONS OF 13.2 KV AC INCOMING LINE FROM PECO TO NEW MV SWITCHGEAR. CONNECT MV BREAKER WITH THE RECTIFIER TRANSFORMER, AND FROM RECTIFIER TRANSFORMER SECONDARY TO THE RECTIFIER UNIT. 5. MAKE CONNECTION FROM RECTIFIER TO 700V DC SWITCHGEAR AND NEGATIVE SWITCHBOARD. 6. MAKE CONNECTIONS OF THE DC NETWORK; REPLACING DC POSITIVE AND NEGATIVE FEEDER TERMINATION POINTS ON THE EXISTING CATENARY STRUCTURE. 7. COMMISSION THE SYSTEM.
STAGING NOTES:	
1. WORKERS CANNOT WORK WITHIN 15 FEET OF ENERGIZED CONDUCTORS UNLESS A PROTECTIVE BARRIER IS IN PLACE 2. STAGING DRAWINGS ARE INTENDED TO COMPLEMENT THIS DRAWING SET. ALL WORK IS NOT NECESSARILY DISCUSSED IN STAGING PLANS. THE CONTRACTOR IS RESPONSIBLE FOR ALL WORK SHOWN ON THE DRAWINGS AND SPECIFICATIONS. 3. SURFACE PREPARATION AND PAINTING CAN BE PERFORMED AT ANY TIME UNLESS ELECTRICAL CLEARANCES REQUIRE OUTAGES. THE CONTRACTOR SHALL SUBMIT A PAINTING PLAN TO SEPTA FOR APPROVAL PRIOR TO SCHEDULING WORK. IN GENERAL, PAINTING IN THE VICINITY OF ELECTRICAL EQUIPMENT MUST BE COORDINATED WITH PLANNED ACTIVITIES IN AND AROUND THESE ITEMS. IT IS ANTICIPATED THAT "RUSH TO RUSH" AND WEEKEND OUTAGES WILL BE USED REGULARLY FOR PAINTING ACTIVITIES. IT IS SEPTA'S INTENT THAT PAINTING AROUND AND ABOVE EQUIPMENT SHALL TAKE PLACE PRIOR TO EQUIPMENT REPLACEMENT. 4. THE CONTRACTOR IS ENCOURAGED TO MODIFY OUTAGE SCHEDULE TO OPTIMIZE WORK. ANY REVISIONS MUST BE APPROVED BY SEPTA.	


DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
STAGE 1 SINGLE LINE DIAGRAM

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: DMH
WORK ORDER NO.: 276496	CHECKED BY: BEZ
SHEET NUMBER <b>TP411</b>	
DWG. NO.: 9	OF 22
SHT. NO.: 434	OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP411	REV. NO.:

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

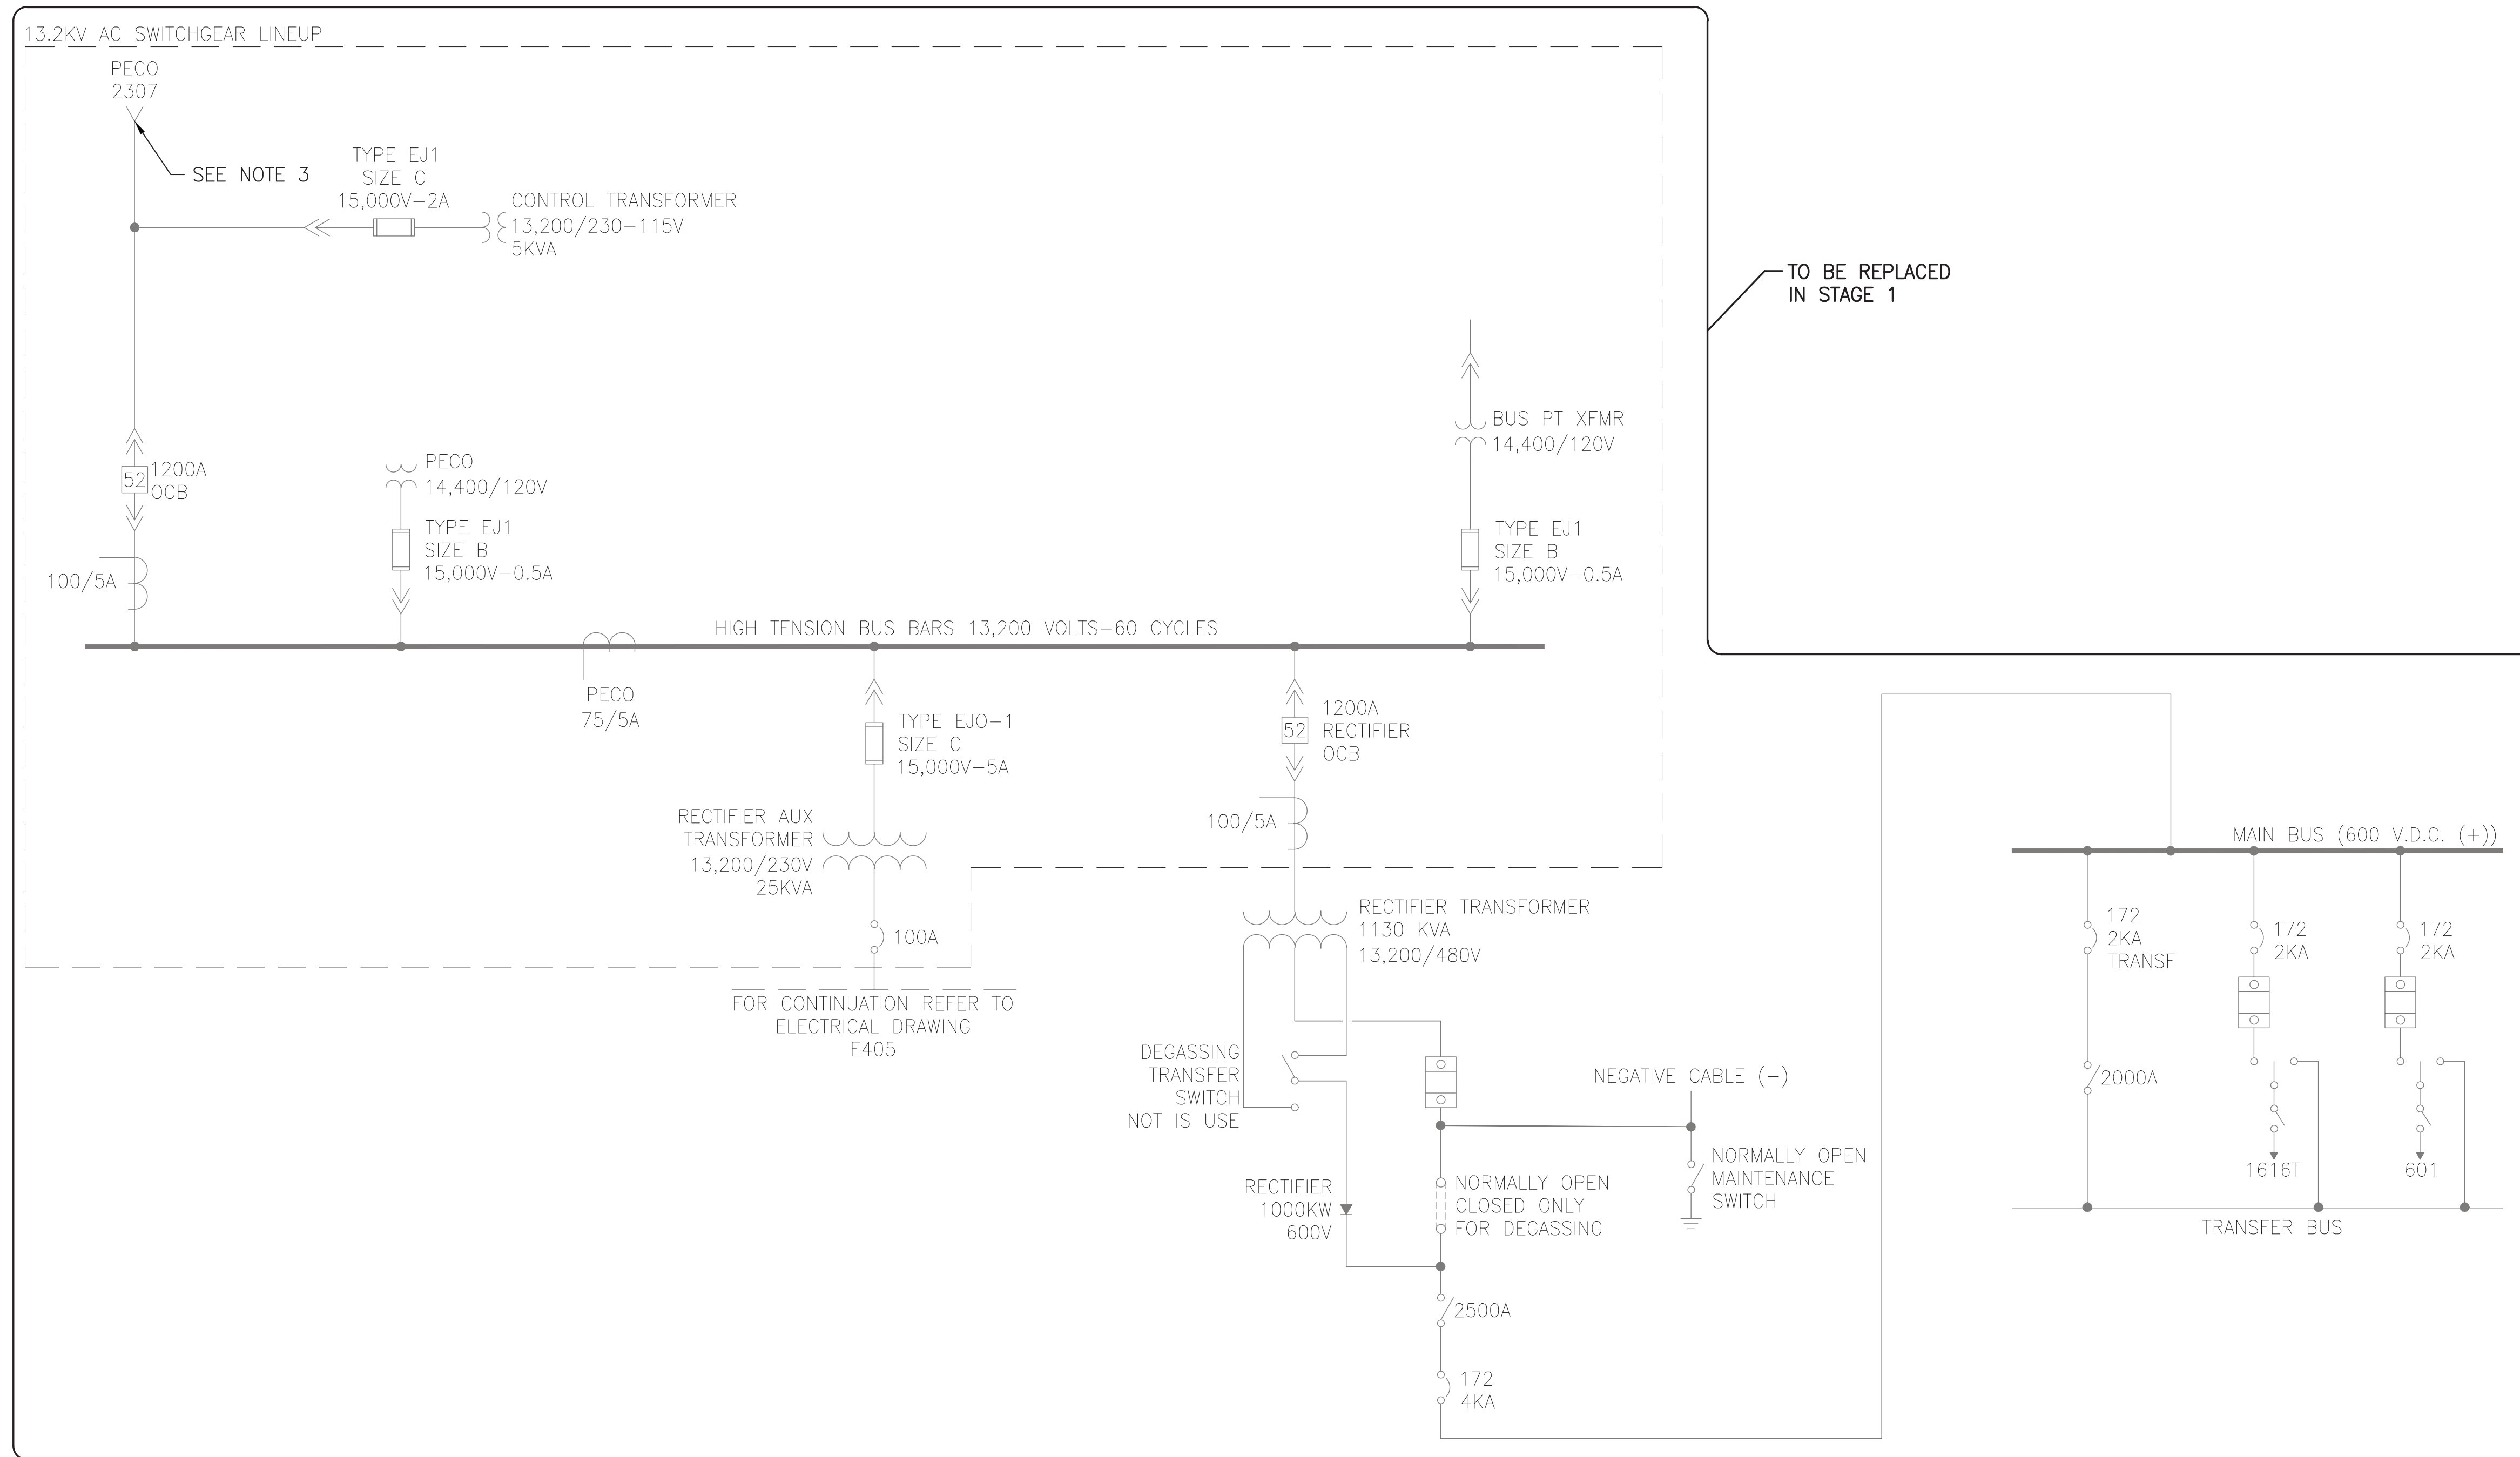

**NOTES:**

1. BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 1.
2. GRAYSCALE ITEMS ON THIS DRAWINGS TO BE DE-ENERGIZED DURING STAGE 1.
3. DISCONNECT PECO 2307 FEEDER FROM EXISTING 13.2KV AC SWITCHGEAR AND RECONNECT PECO 2307 FEEDER TO NEW 13.2KV AC SWITCHGEAR.
4. REFER TO DRAWING TP401 FOR LEGENDS AND SYMBOLS AND DRAWING TP402 FOR DEVICE TABLES.
5. REFER TO DRAWING TP410 FOR OVERALL STAGING PLAN.

C:\P\WORKING\PTID\062355\17AN-TP411.DWG


DATE PRINTED: 10/21/2015

STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD


**CASTOR ROUTE 59 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION TRACTION POWER STAGE 1 EQUIPMENT PLAN**

SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: YL
WORK ORDER NO.: 276496	CHECKED BY: BH
SHEET NUMBER: <b>TP412</b>	
DWG. NO.: 10 OF 22	SHT. NO.: 435 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP412	REV. NO.:

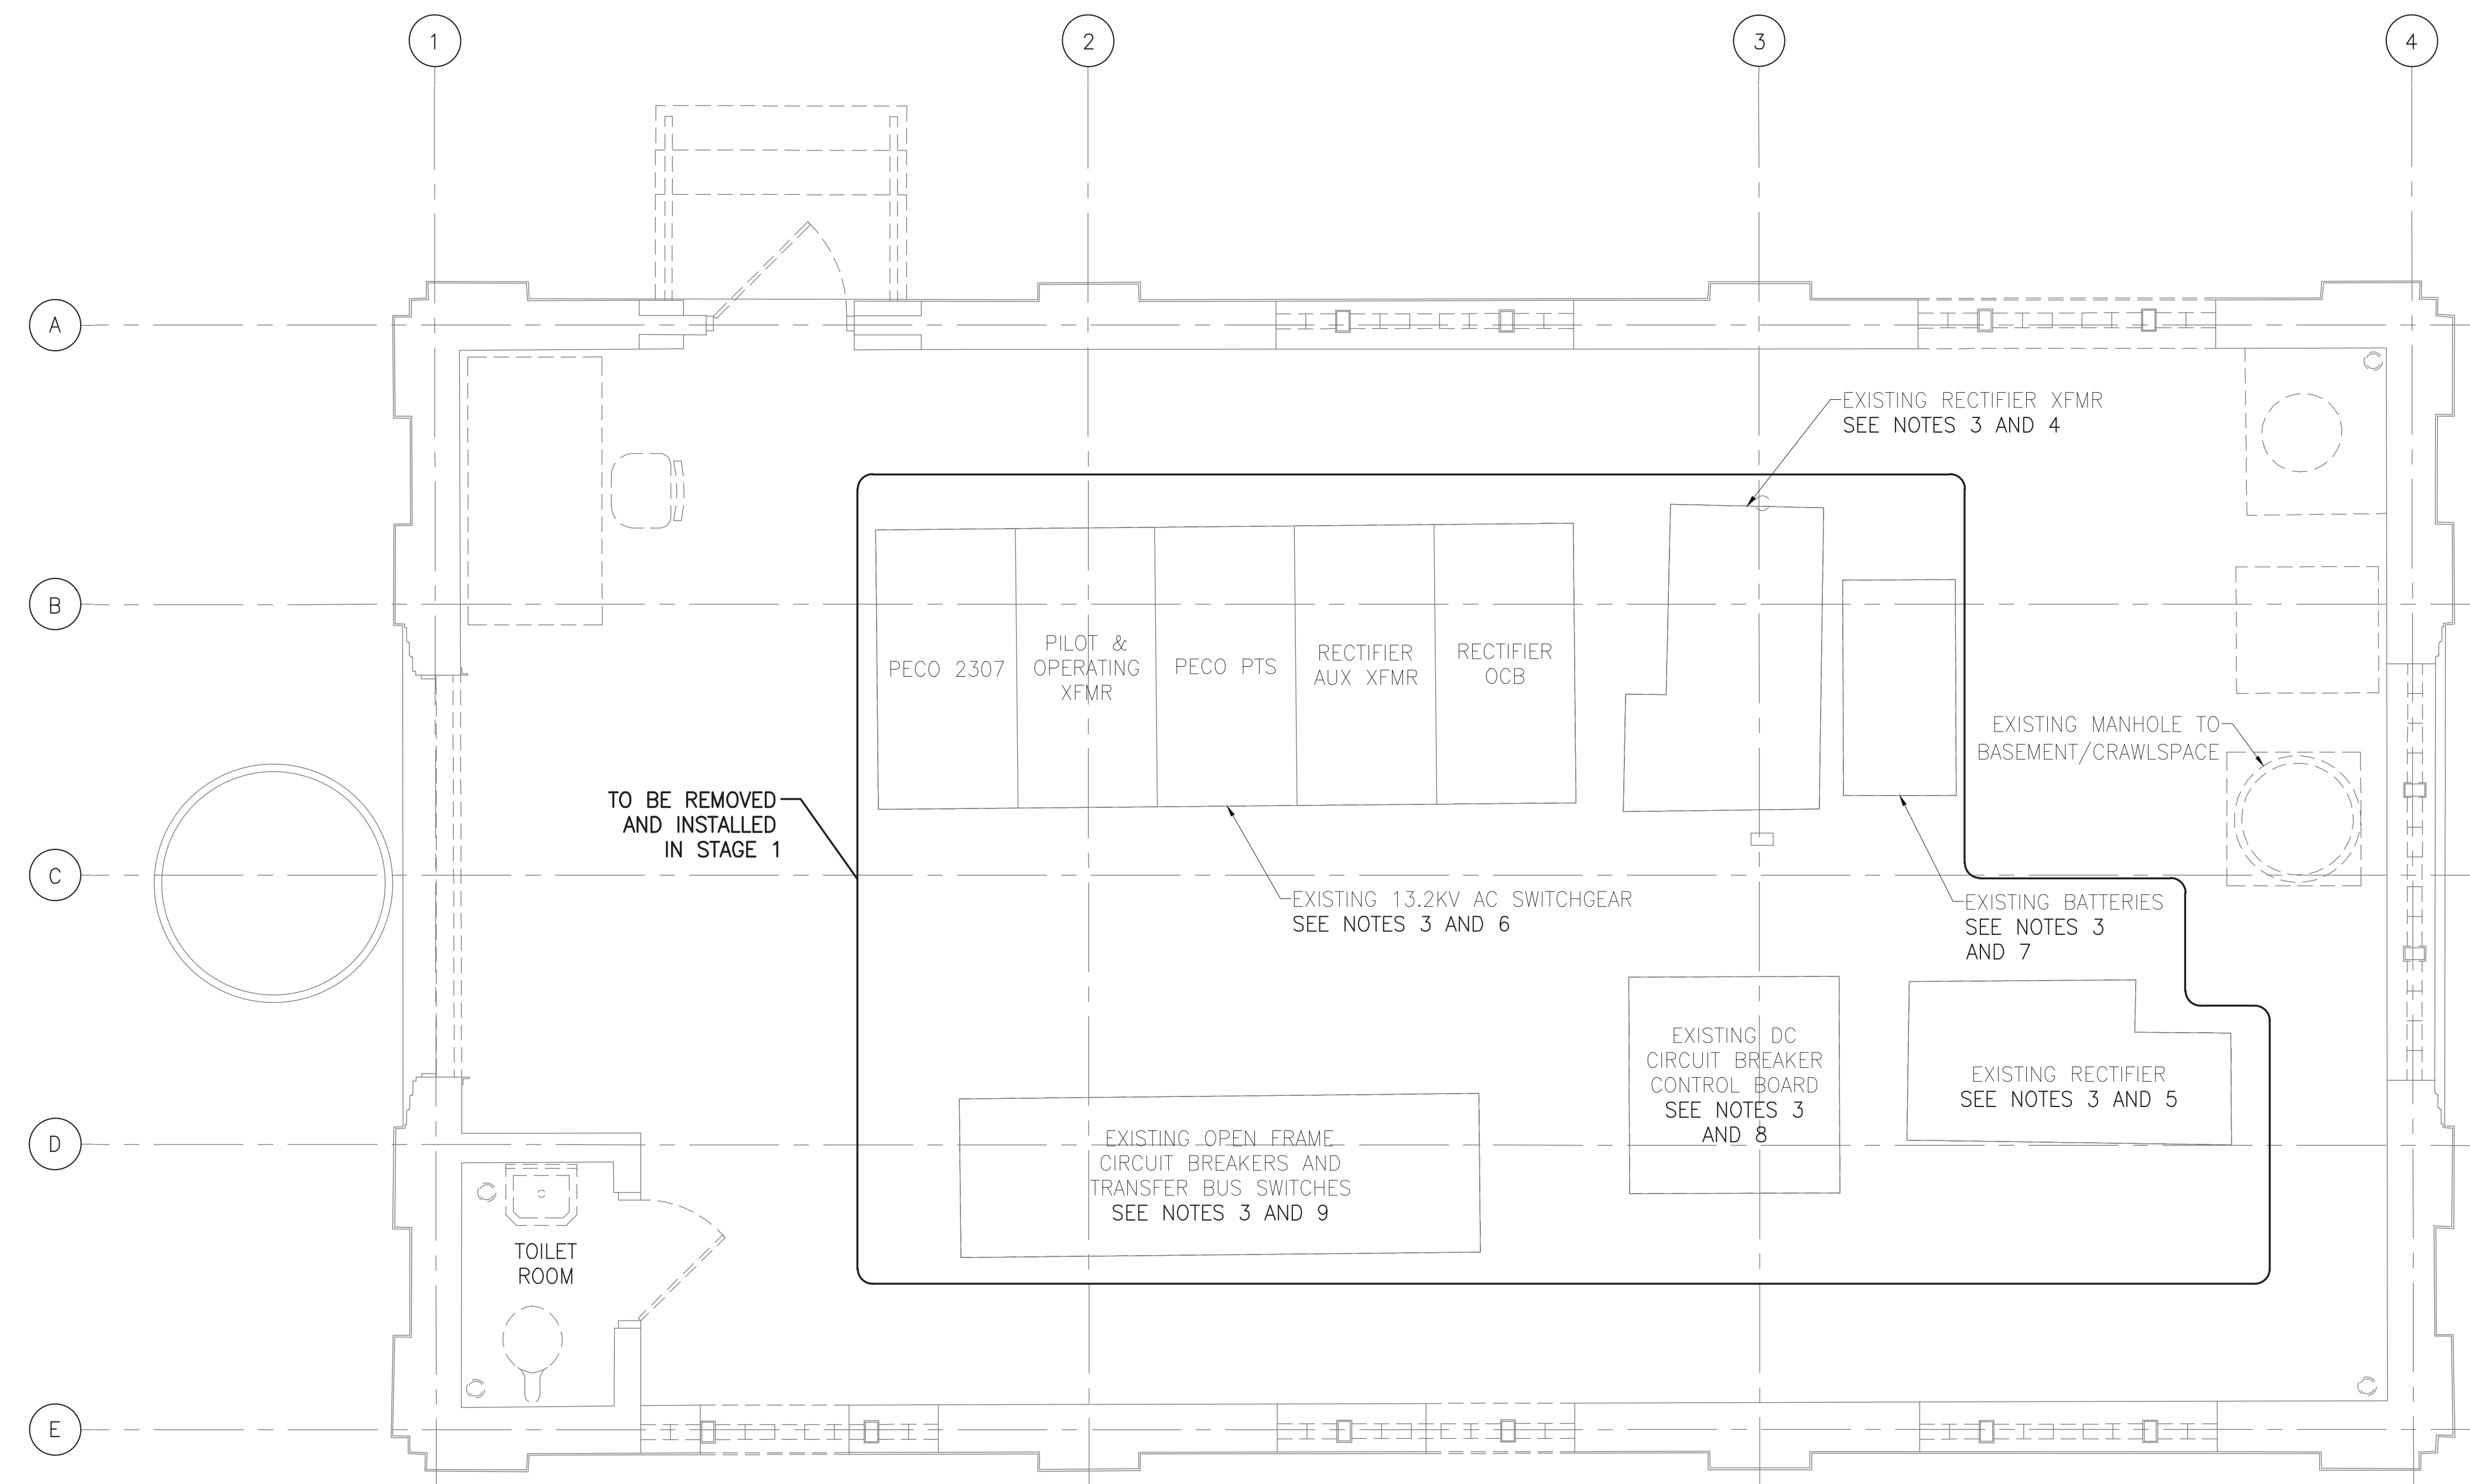


**1 STAGE 1 FIRST FLOOR EQUIPMENT PLAN**  
TP412 SCALE: 3/8" = 1'-0"

- NOTES:**
- GRAYSCALE ITEMS ON THIS DRAWING TO BE DE-ENERGIZED DURING STAGE 1.
  - BOLD ITEMS ON THIS DRAWING TO BE ENERGIZED DURING STAGE 1.
  - REMOVE EQUIPMENT AFTER SEPTA HAS SALVAGED PARTS.
  - REMOVE EXISTING RECTIFIER TRANSFORMER. INSTALL NEW OUTDOOR RECTIFIER TRANSFORMER.
  - REMOVE EXISTING RECTIFIER UNIT. INSTALL NEW RECTIFIER UNIT.
  - REMOVE EXISTING 13.2KV AC SWITCHGEAR. INSTALL NEW 13.2KV AC SWITCHGEAR.
  - REMOVE EXISTING BATTERIES. INSTALL NEW BATTERIES.
  - REMOVE EXISTING DC CIRCUIT BREAKER CONTROL BOARD.
  - REMOVE EXISTING TRANSFER BUS SWITCHES AND OPEN FRAME CIRCUIT BREAKERS.
  - REMOVE EXISTING GROUND BUS. INSTALL NEW GROUND BUS.
  - REMOVE EXISTING NORMALLY OPEN DISCONNECT SWITCH. INSTALL NEW NORMALLY OPEN DISCONNECT SWITCH.
  - REMOVE EXISTING CABLES. INSTALL NEW CABLES TO MANHOLE IN CASTOR AVENUE (145').
  - REMOVE EXISTING FEED TO CATHODE CIRCUIT BREAKER. INSTALL NEW FEED TO CATHODE CIRCUIT BREAKER.
  - REMOVE EXISTING CONDUITS.
  - REMOVE EXISTING NEGATIVE BUS. INSTALL NEW NEGATIVE BUS.
  - REMOVE EXISTING CABLES.
  - REFER TO DRAWING TP410 FOR OVERALL STAGING PLAN.
  - REMOVE EXISTING INSULATED FLOOR COVERING. PROVIDE NEW INSULATED FLOOR COVERING CONFORMING TO THE SPECIFICATIONS.

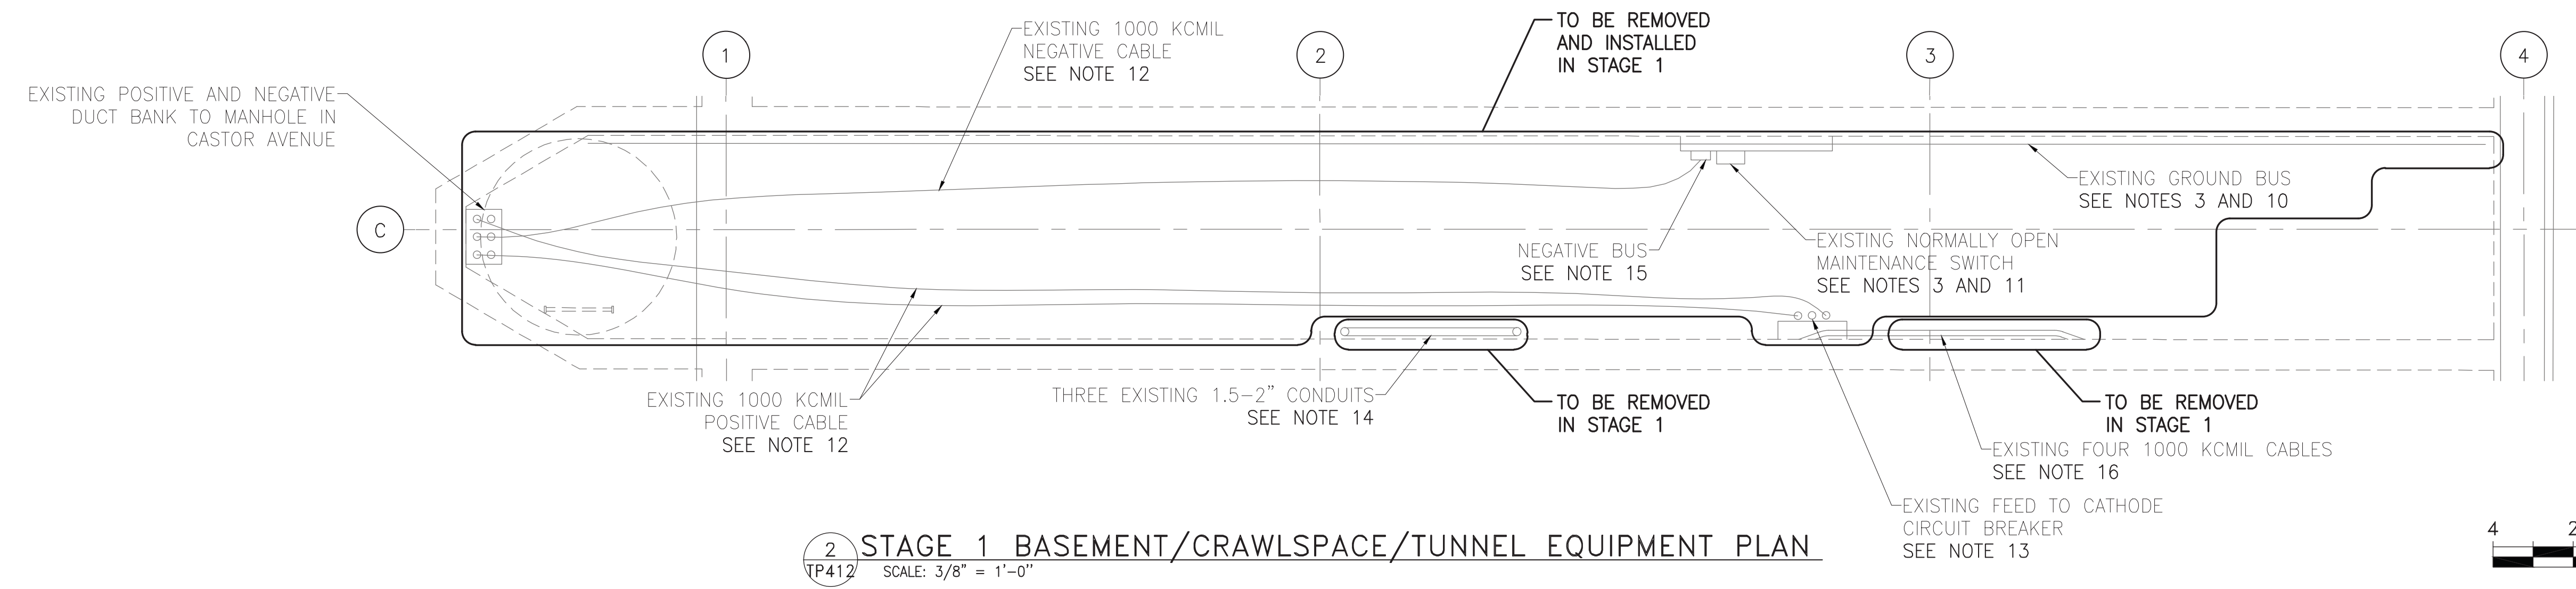

**2 STAGE 1 BASEMENT/CRAWLSPACE/TUNNEL EQUIPMENT PLAN**  
TP412 SCALE: 3/8" = 1'-0"

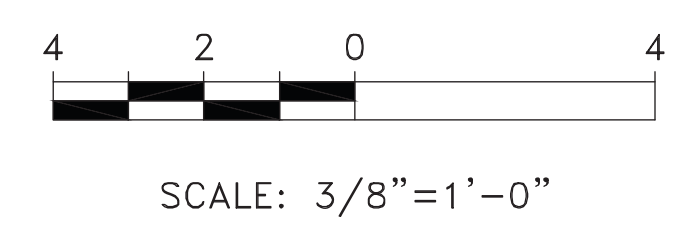

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

C:\PWORKING\PIITD\166236517AN-TP412.DWG



DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

CHIEF ENGINEER - EM&C
CHIEF ENGINEERING OFFICER - EM&C
CHIEF RAIL TRANSIT OFFICER
SYSTEM SAFETY
DIRECTOR OF ENGINEERING - EM&C
MANAGER - ARCHITECTURAL ENGINEERING
PROJECT MANAGER


REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR ROUTE 69 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION TRACTION POWER PROPOSED EQUIPMENT PLAN**

SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: YL
WORK ORDER NO: 276496	CHECKED BY: BH
SHEET NUMBER: TP420	REV. NO: -
DWG. NO: 11 OF 22	REV. NO: -
SHT. NO: 436 OF 452	REV. NO: -
ARCHIVE NO: -	REV. NO: -
COMPUTER FILE NO: 17AN-TP420	REV. NO: -

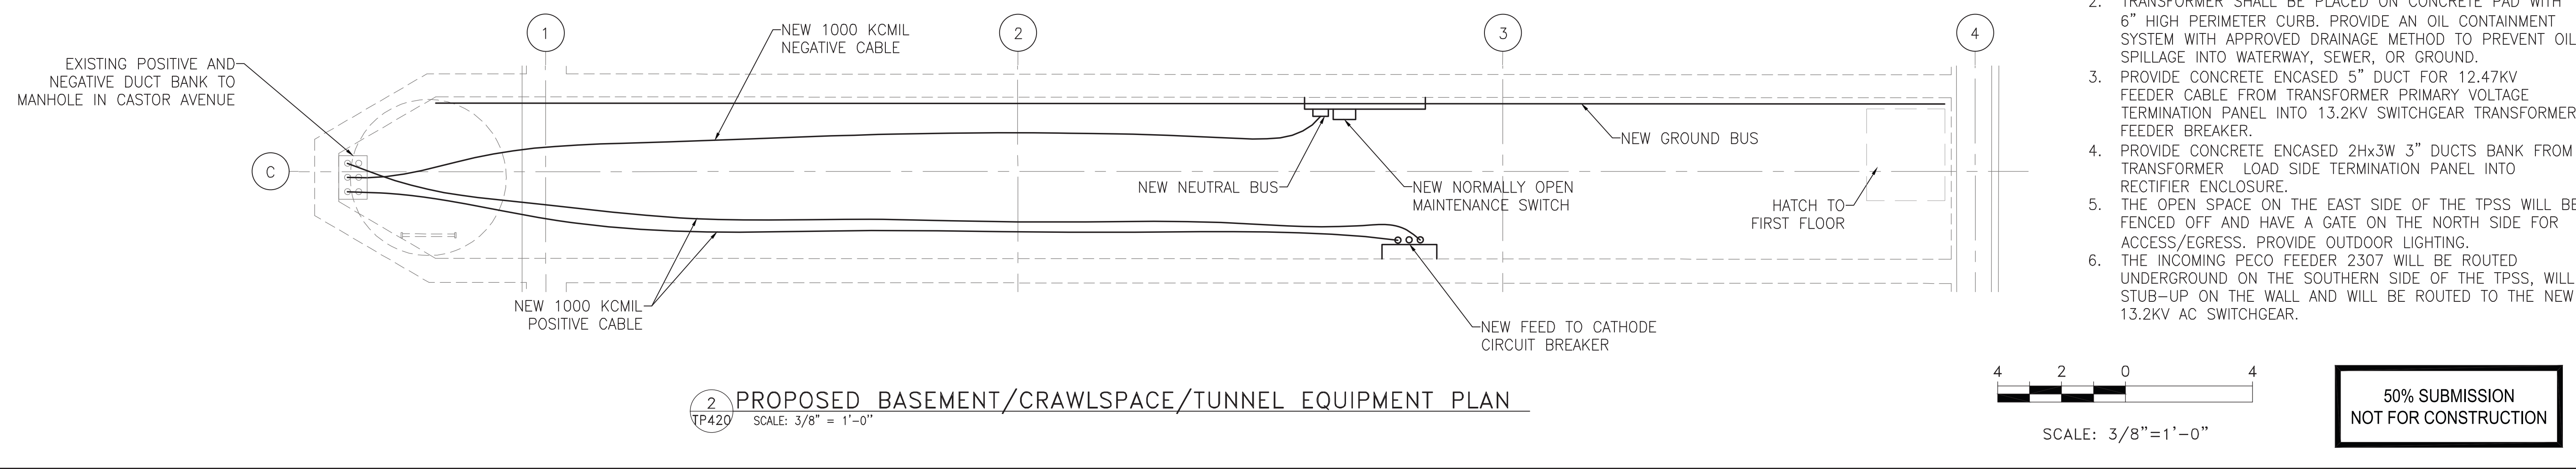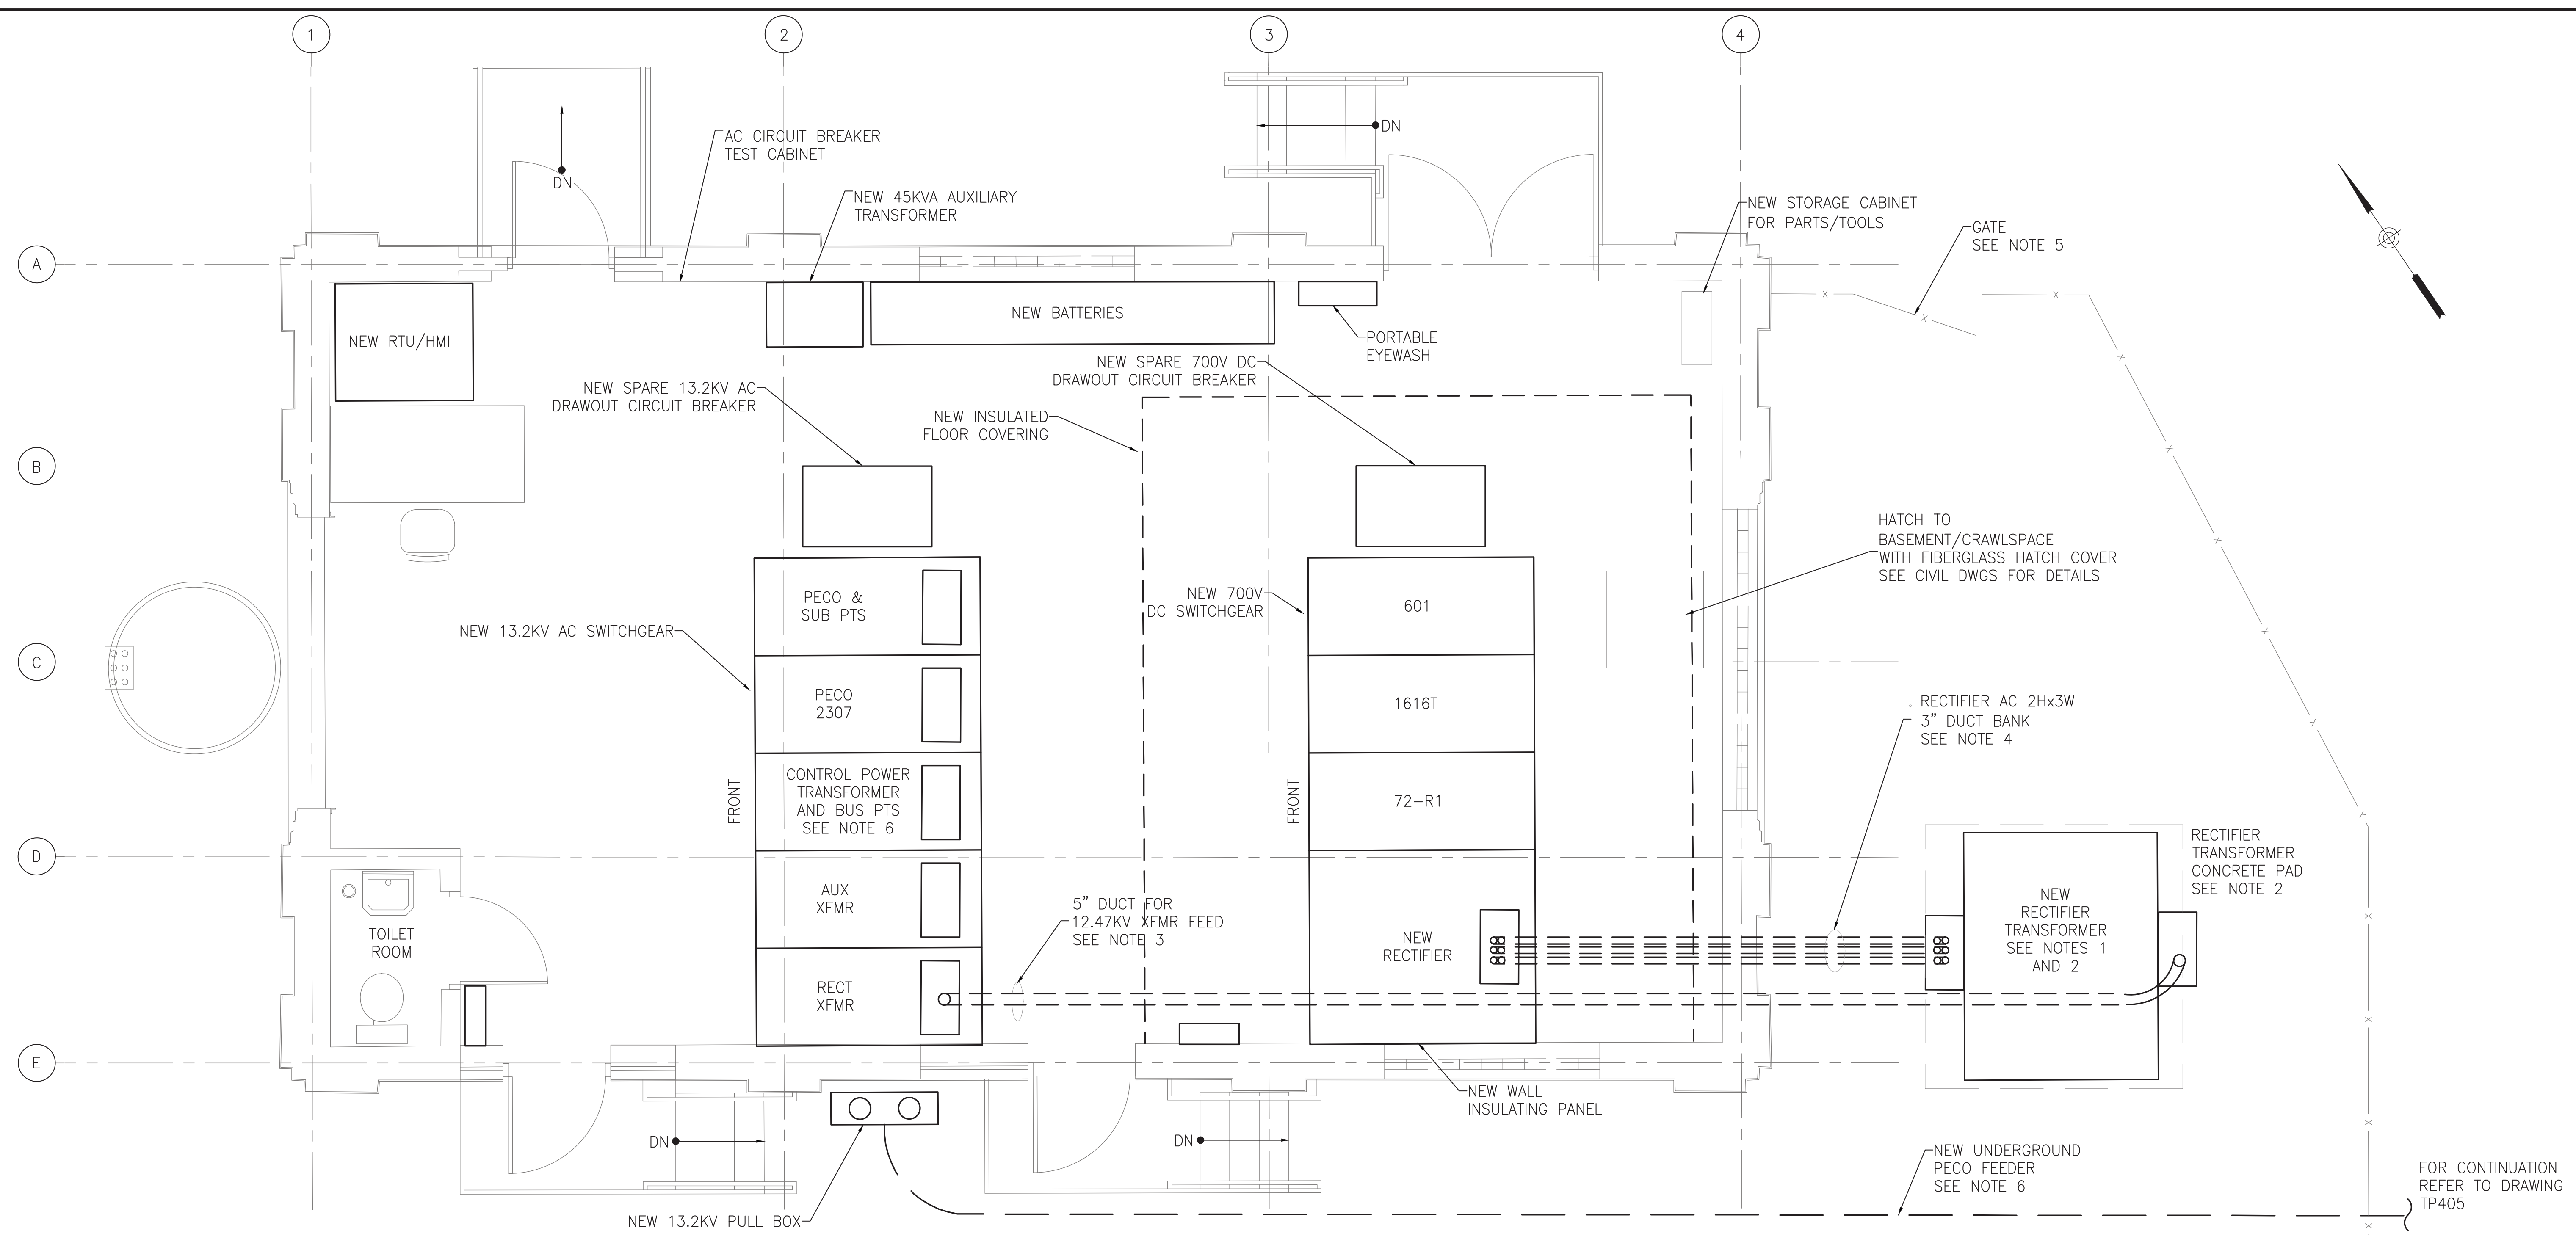

- NOTES:**
1. INSTALLED LIQUID FILLED RECTIFIER TRANSFORMER OUTSIDE THE EAST WALL OF THE TPSS, MAINTAINING A CLEARANCE OF 4 FEET.
  2. TRANSFORMER SHALL BE PLACED ON CONCRETE PAD WITH 6" HIGH PERIMETER CURB. PROVIDE AN OIL CONTAINMENT SYSTEM WITH APPROVED DRAINAGE METHOD TO PREVENT OIL SPILLAGE INTO WATERWAY, SEWER, OR GROUND.
  3. PROVIDE CONCRETE ENCASED 5" DUCT FOR 12.47KV FEEDER CABLE FROM TRANSFORMER PRIMARY VOLTAGE TERMINATION PANEL INTO 13.2KV SWITCHGEAR TRANSFORMER FEEDER BREAKER.
  4. PROVIDE CONCRETE ENCASED 2Hx3W 3" DUCTS BANK FROM TRANSFORMER LOAD SIDE TERMINATION PANEL INTO RECTIFIER ENCLOSURE.
  5. THE OPEN SPACE ON THE EAST SIDE OF THE TPSS WILL BE FENCED OFF AND HAVE A GATE ON THE NORTH SIDE FOR ACCESS/EGRESS. PROVIDE OUTDOOR LIGHTING.
  6. THE INCOMING PECO FEEDER 2307 WILL BE ROUTED UNDERGROUND ON THE SOUTHERN SIDE OF THE TPSS, WILL STUB-UP ON THE WALL AND WILL BE ROUTED TO THE NEW 13.2KV AC SWITCHGEAR.

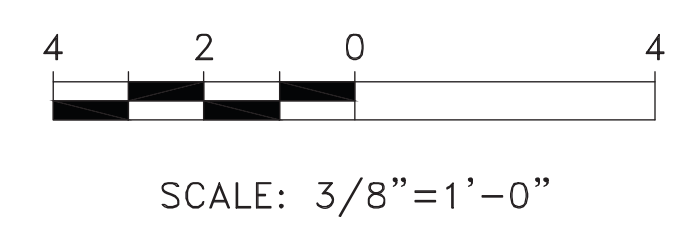

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

DATE PRINTED: 10/21/2025 STATUS: 50% SUBMISSION

C:\P\WORKING\PTTD\166236517AN-TP420.DWG

REV	DATE	DESCRIPTION	BY	CKD	APD

DATE PRINTED: 10/21/2025


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
PROPOSED EQUIPMENT ELEVATIONS

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: ARG CHECKED BY: BEZ
WORK ORDER NO. 276496	SHEET NUMBER <b>TP426</b>
DWG. NO.: 12 OF 22	SHT. NO.: 437 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP426	REV. NO.:


50% SUBMISSION  
NOT FOR CONSTRUCTION

**NOTES:**

- FOR DETAIL REQUIREMENTS, SEE CONTRACT SPECIFICATIONS.
- ALL DIMENSIONS AND LAYOUT SHOWN ARE TYPICAL ONLY AND WILL VARY BY MANUFACTURER.
- REFER TO DRAWING TP420 FOR FINAL EQUIPMENT LAYOUT PLAN.

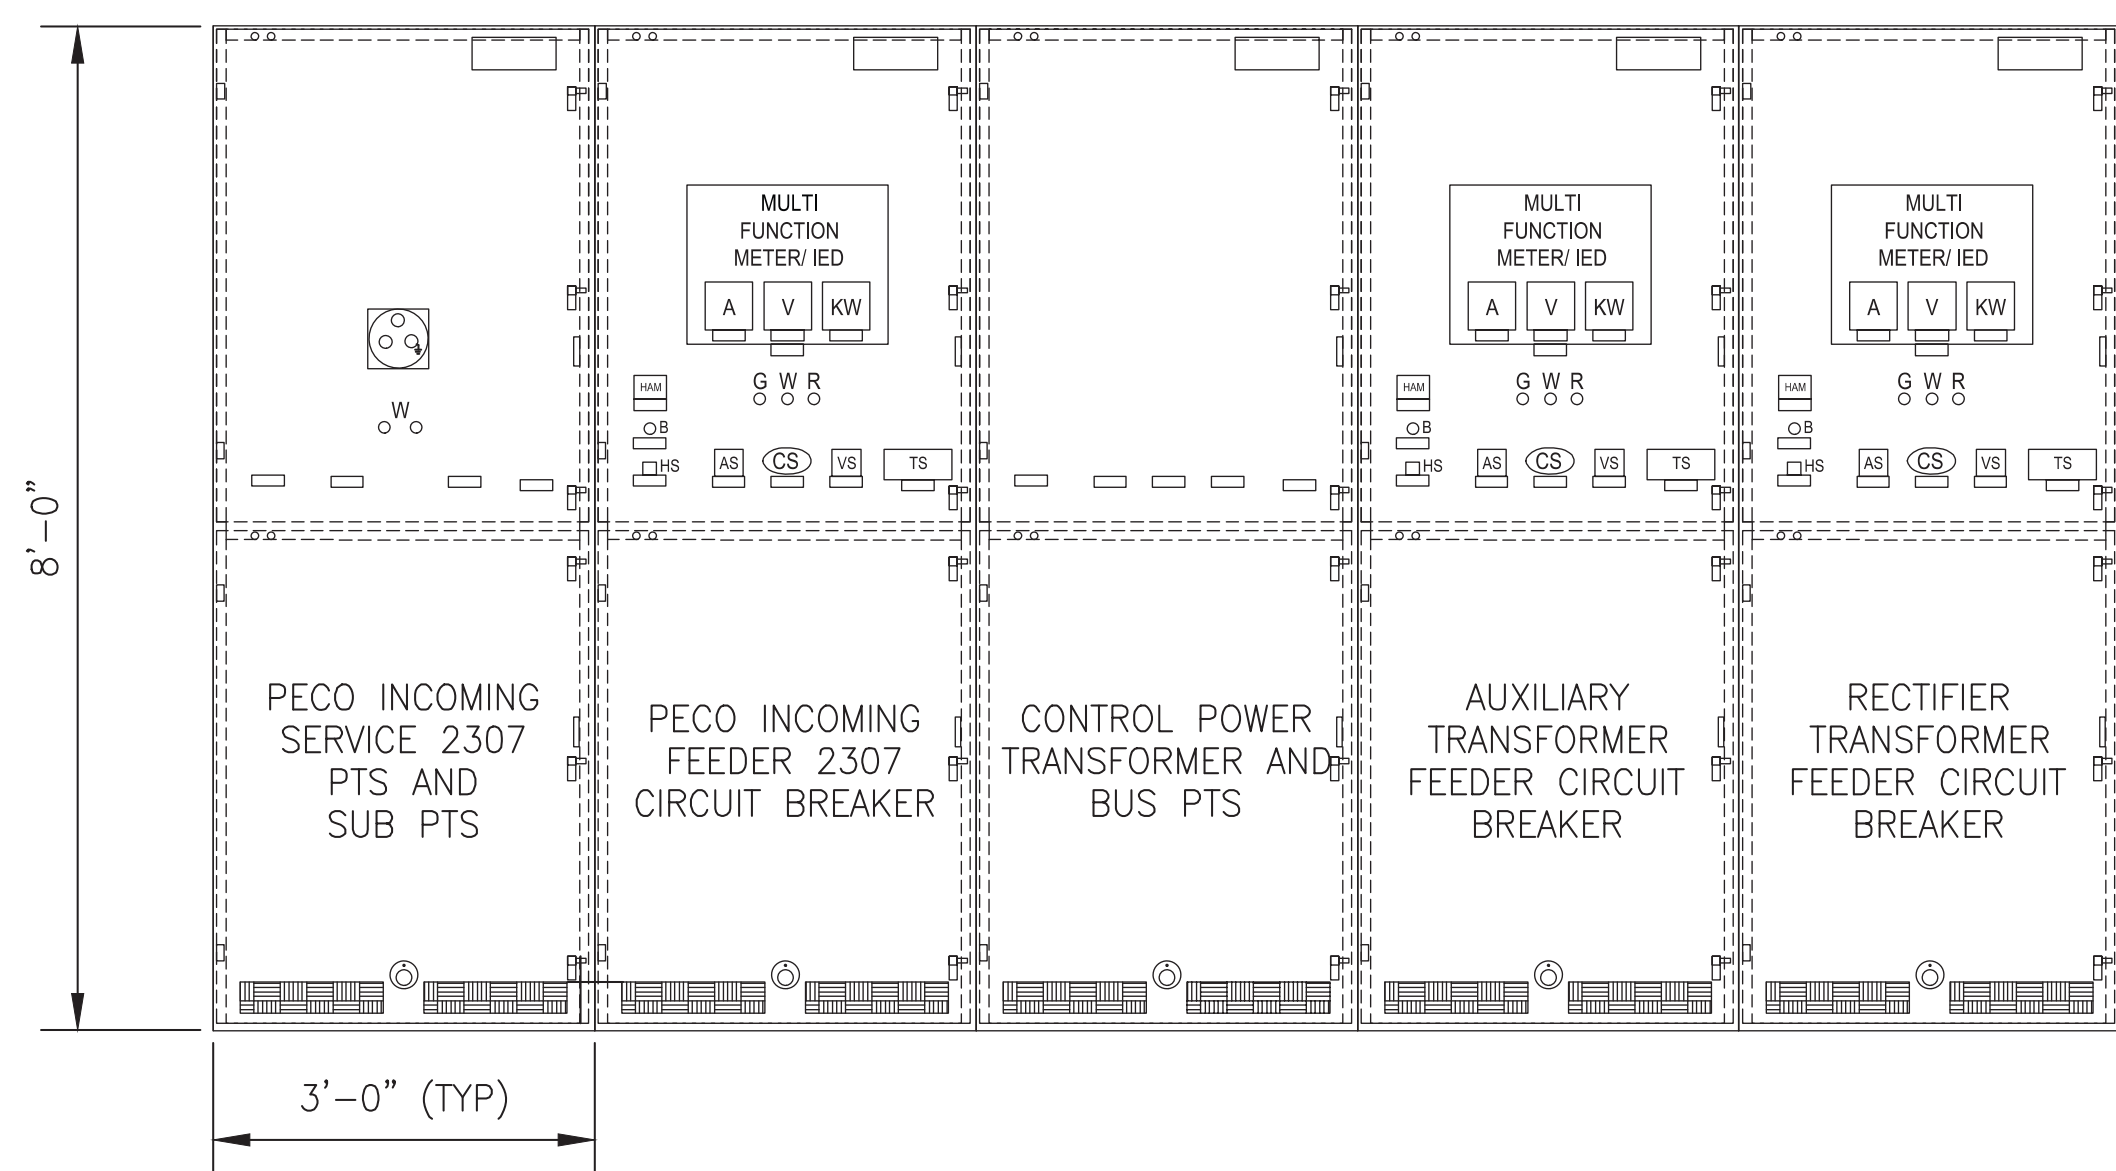

1 13.2KV AC SWITCHGEAR - FRONT VIEW  
TP426 SCALE: N.T.S.

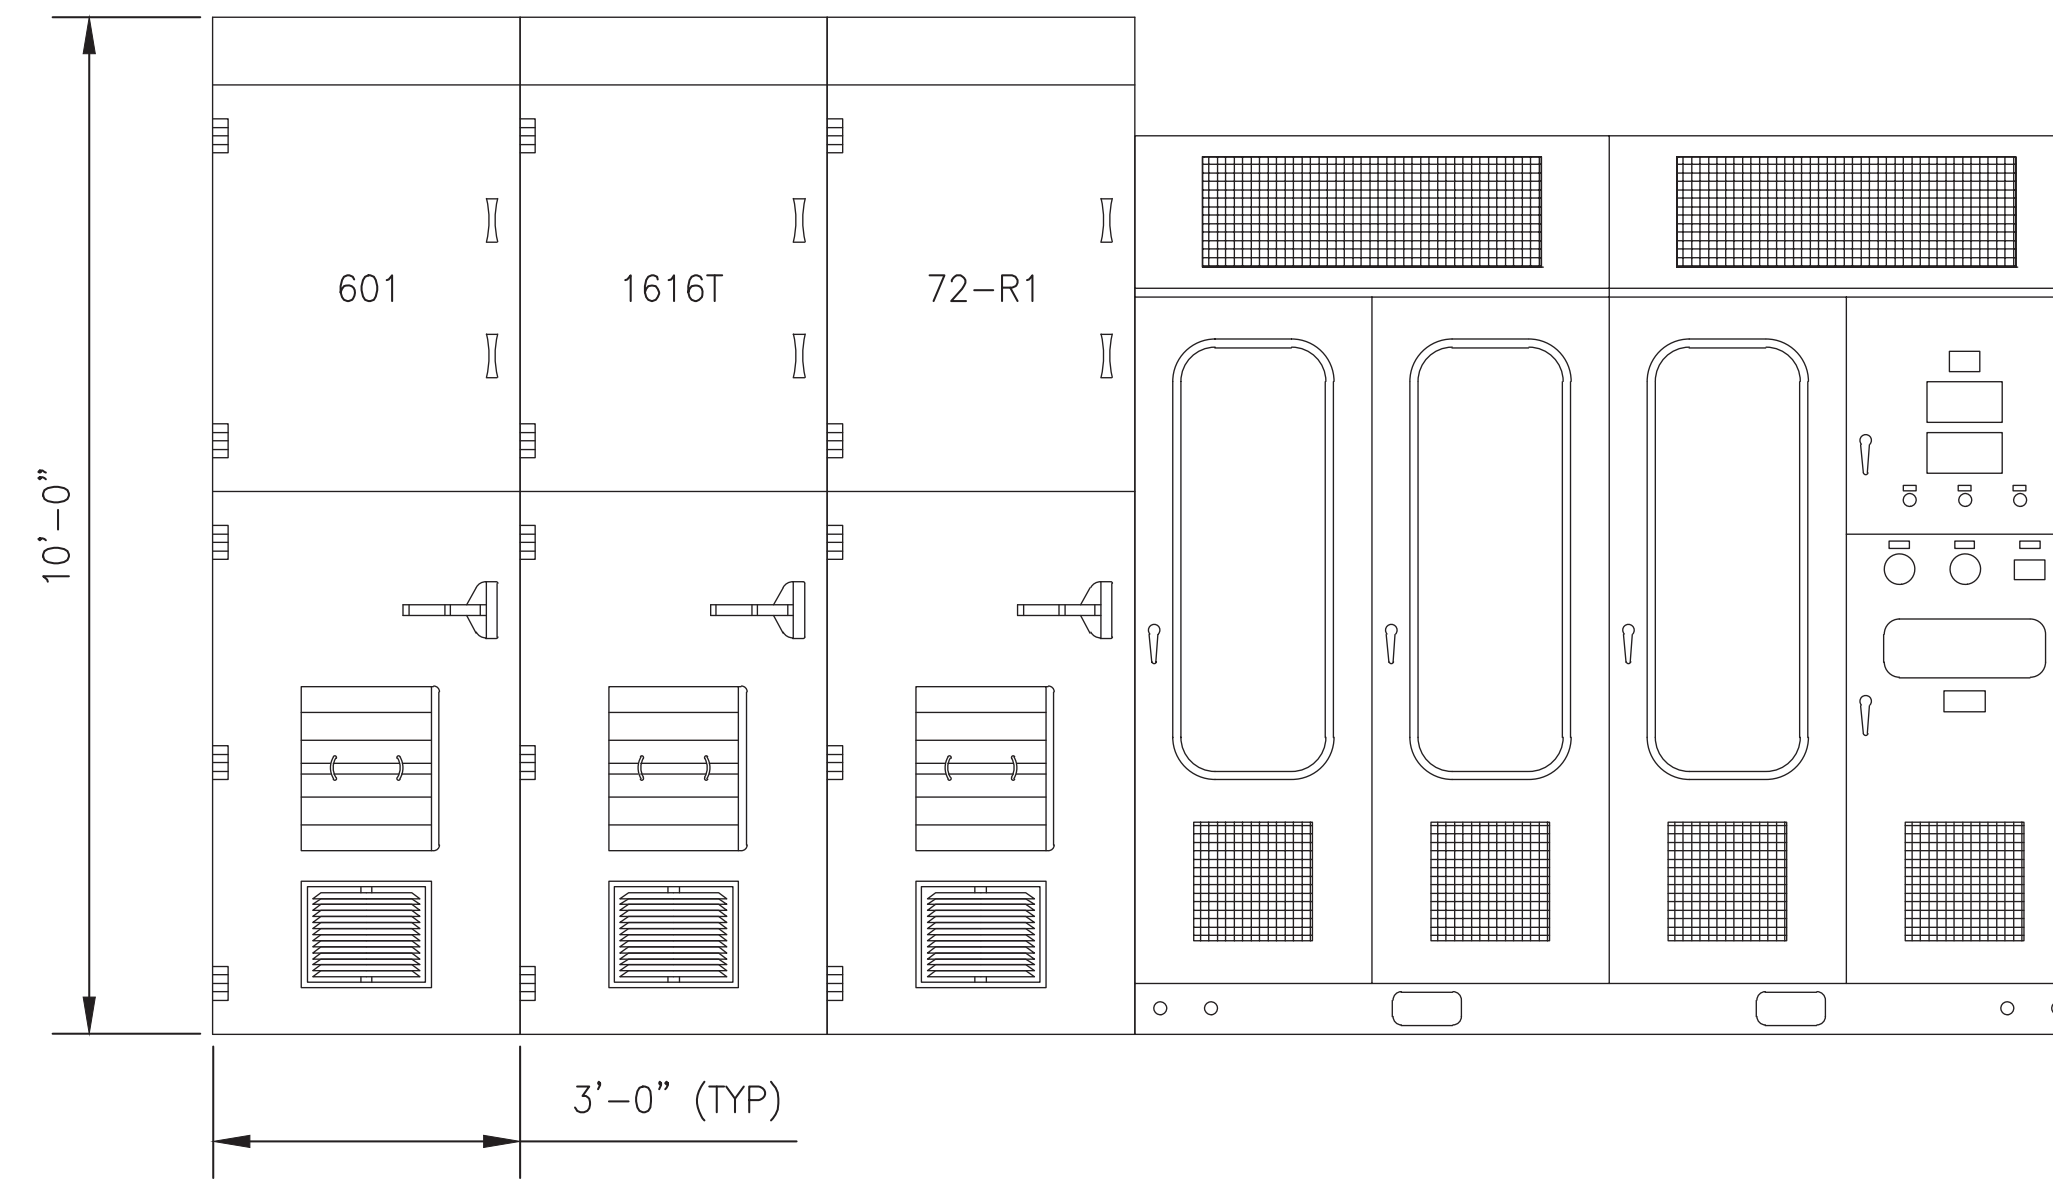

2 700V DC SWITCHGEAR AND 700V DC RECTIFIER - FRONT VIEW  
TP426 SCALE: N.T.S.


CHEF ENGINEER-EM&C
CHEF ENGINEERING OFFICER-EM&C
CHEF RAIL TRANSIT OFFICER
SYSTEM SAFETY
DIRECTOR OF ENGINEERING-EM&C
MANAGER-ARCHITECTURE/ENGINEERING
PROJECT MANAGER

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
13.2 KV CABLE & DUCT PLAN

SCALE	AS SHOWN	SCALE FACTOR	-
DATE	10/16/2017	DRAWN BY	YL
WORK ORDER NO.	276496	CHECKED BY	BH
SHEET NUMBER	<b>TP432</b>		
DWG. NO.	13	OF	22
SHT. NO.	438	OF	452
ARCHIVE NO.			
COMPUTER FILE NO.	17AN-TP432	REV. NO.	-

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

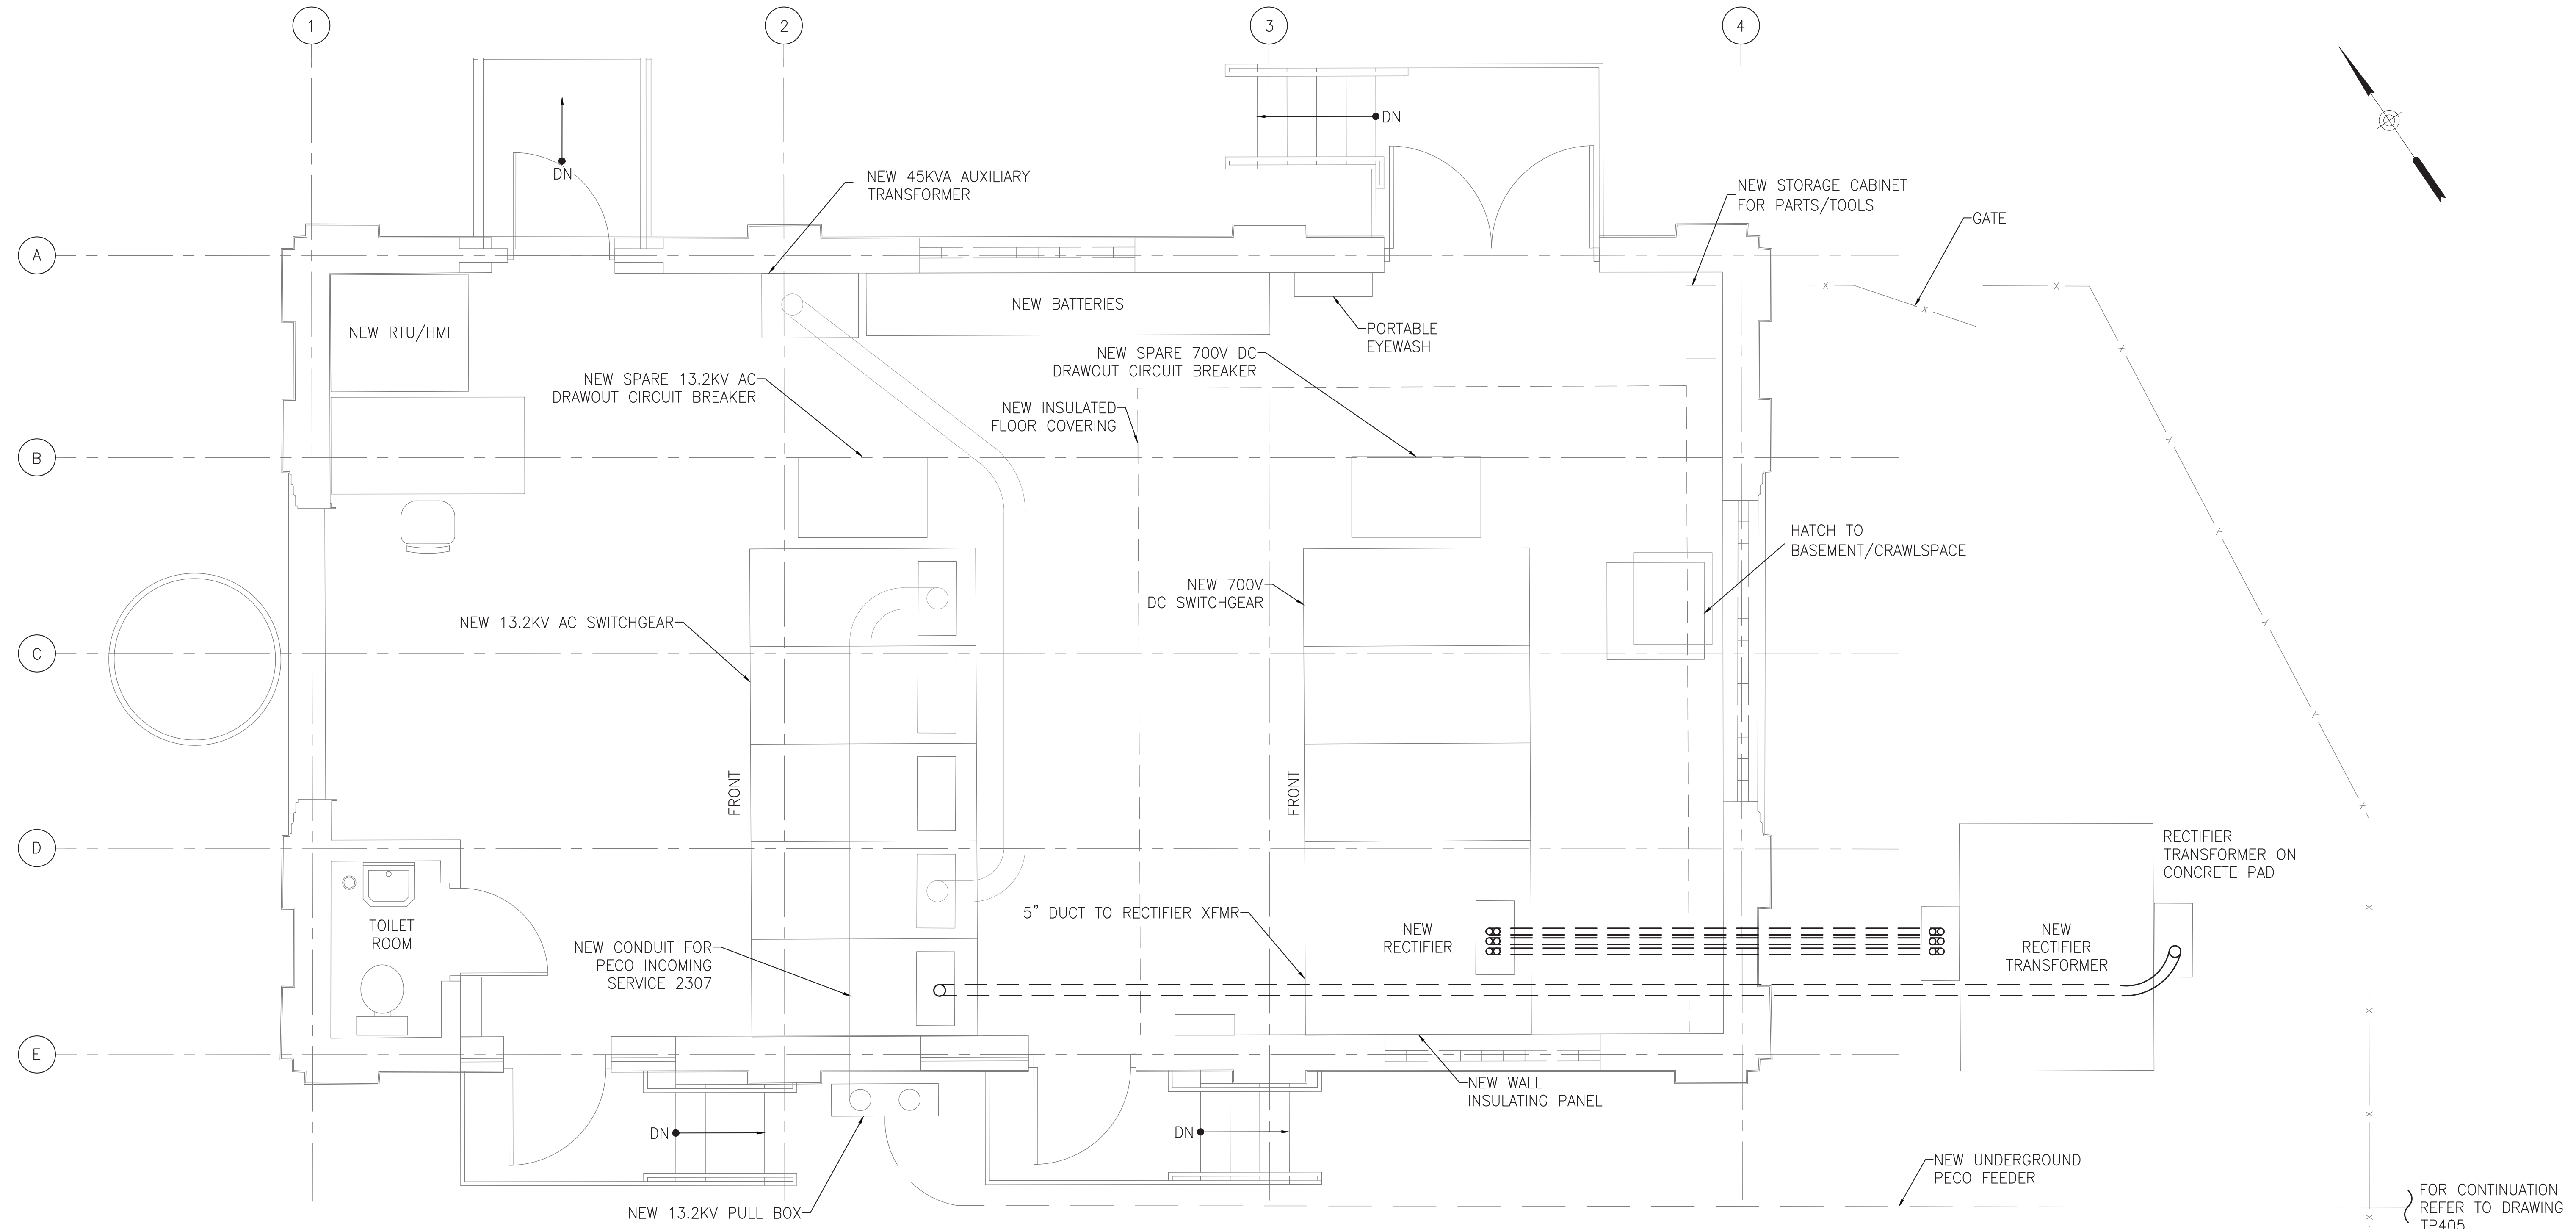

- NOTES:**
- EXACT LOCATION, SUPPORT AND SPACING OF CONDUITS TO BE DETERMINED BY FIELD CONDITIONS.
  - REFER TO DRAWING TP420 FOR FINAL EQUIPMENT LAYOUT PLAN.

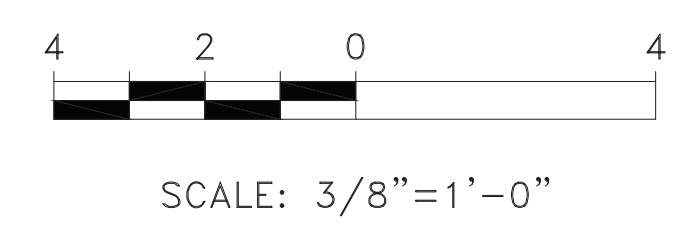

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**





C:\PWORKING\PTITD\1682355\17AN-TP432.DWG

REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
BATTERY & CONTROL DIAGRAM

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	DMV
WORK ORDER NO.:	276496	CHECKED BY:	BH
SHEET NUMBER:	<b>TP434</b>		
DWG. NO.:	14	OF	22
SHT. NO.:	439	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-TP434	REV. NO.:	-

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

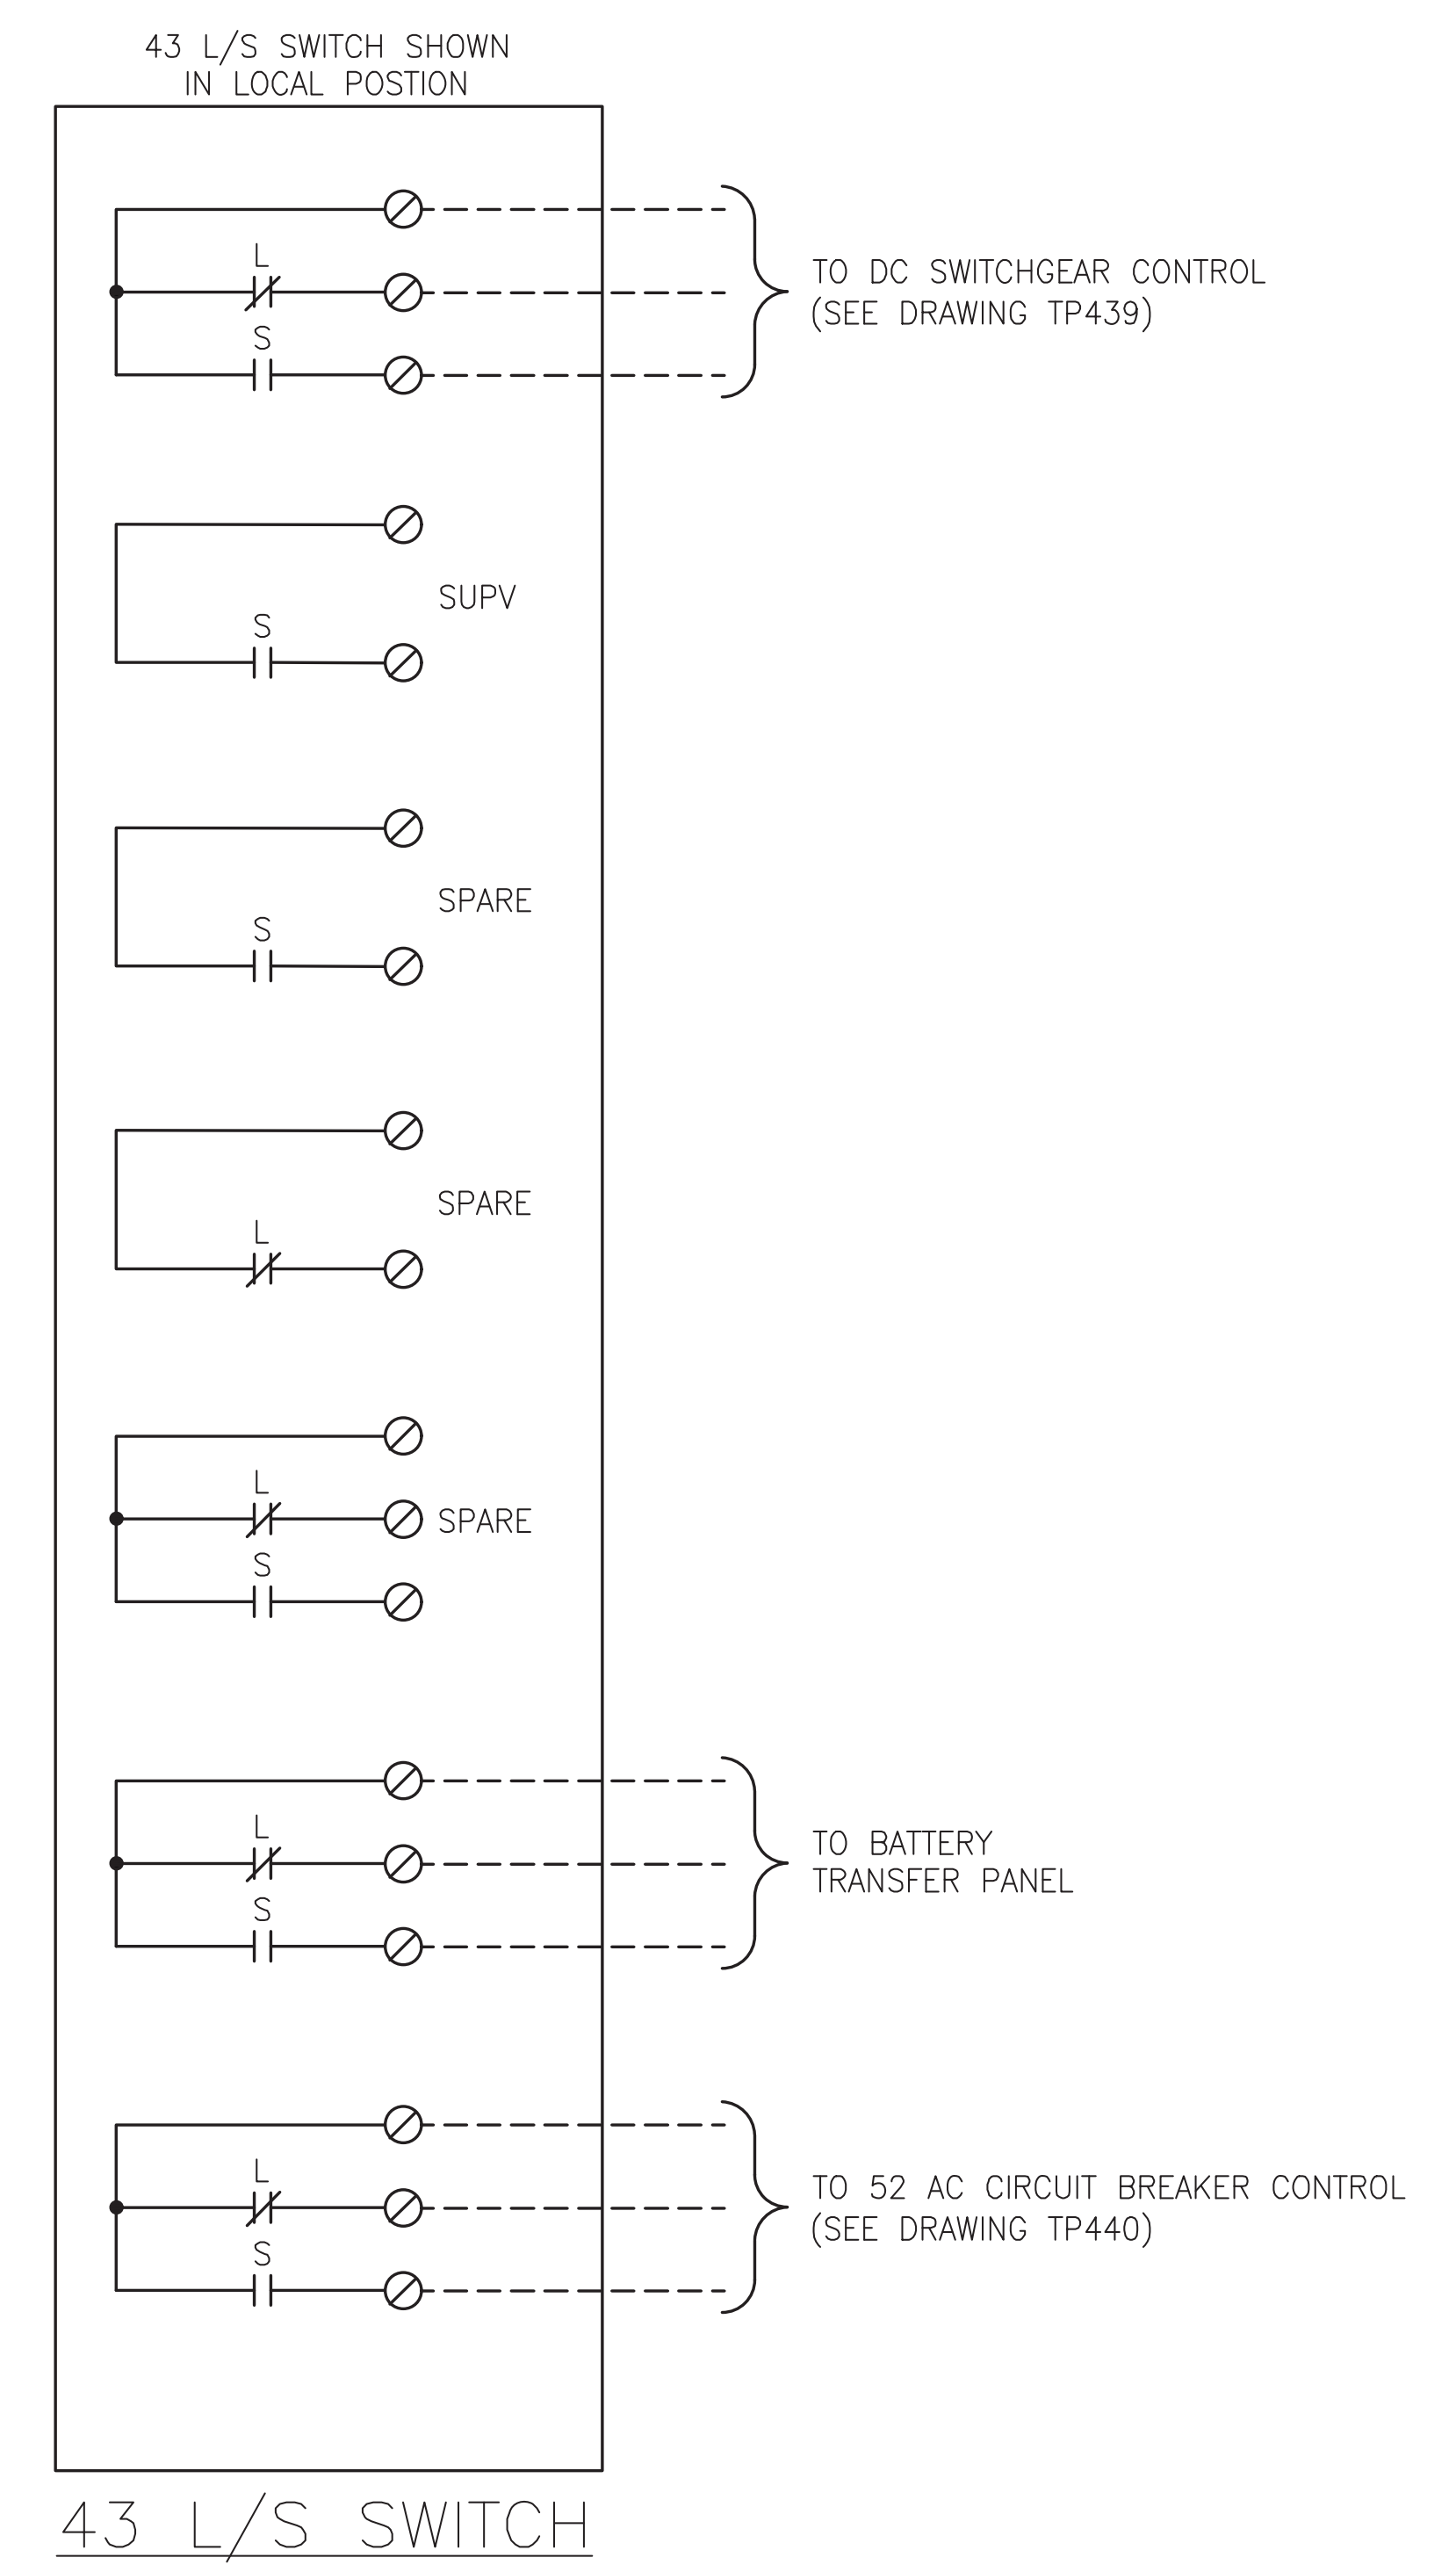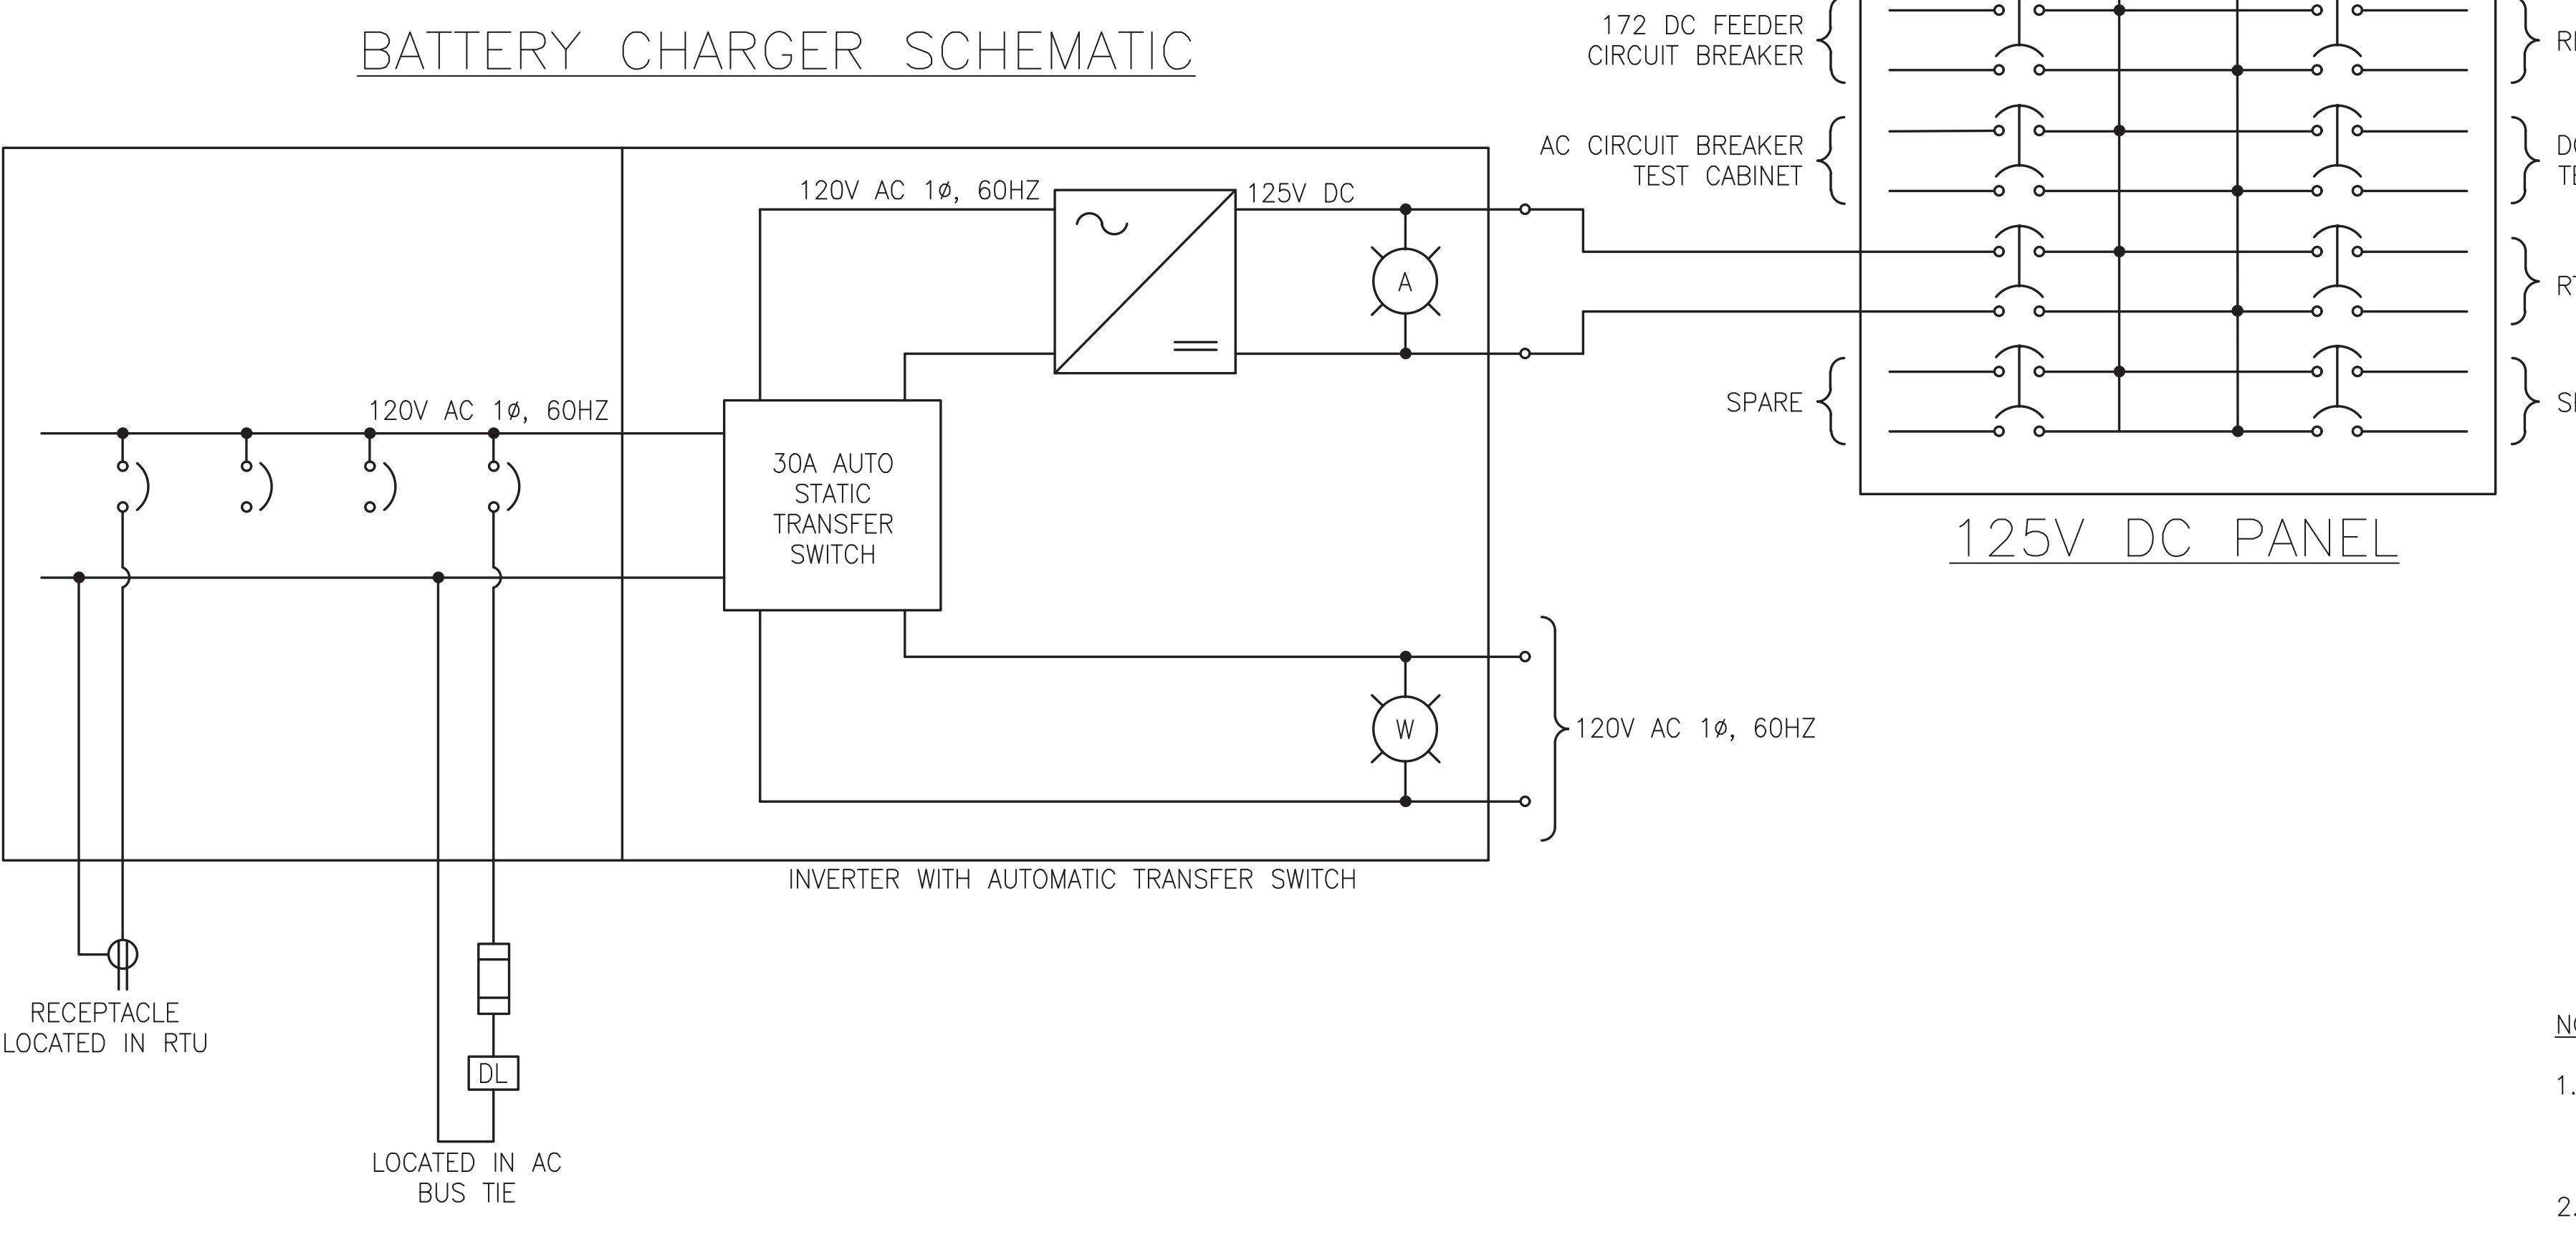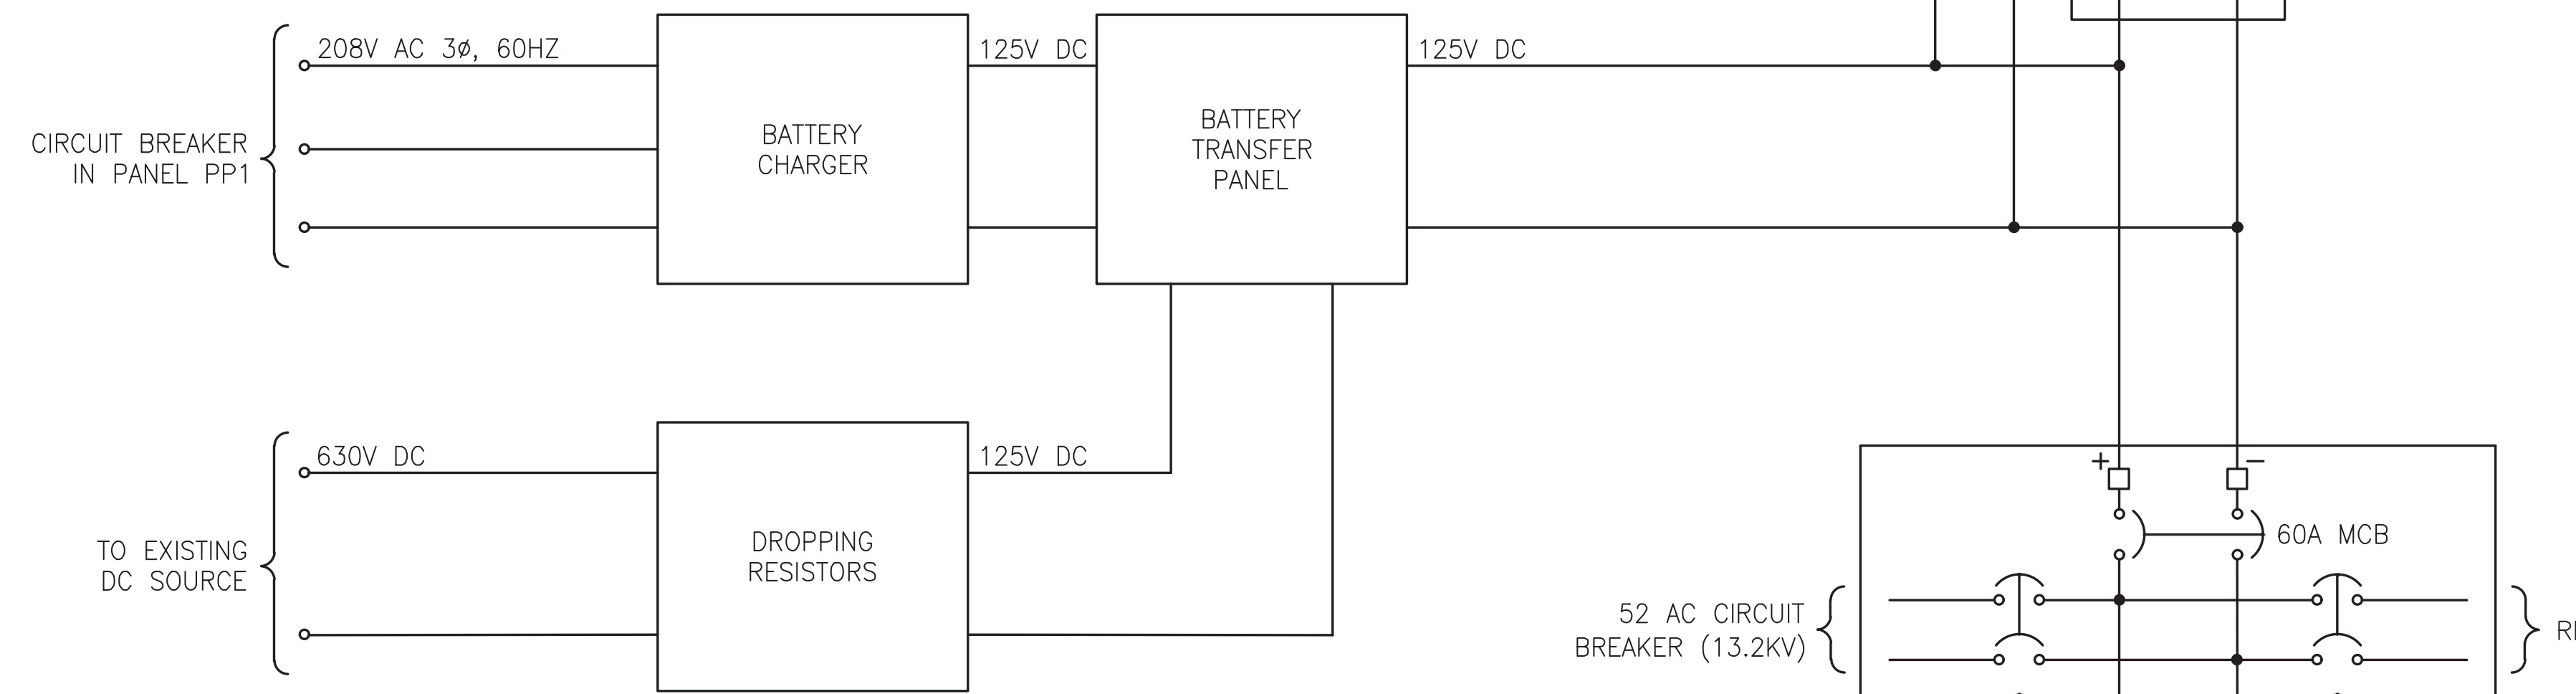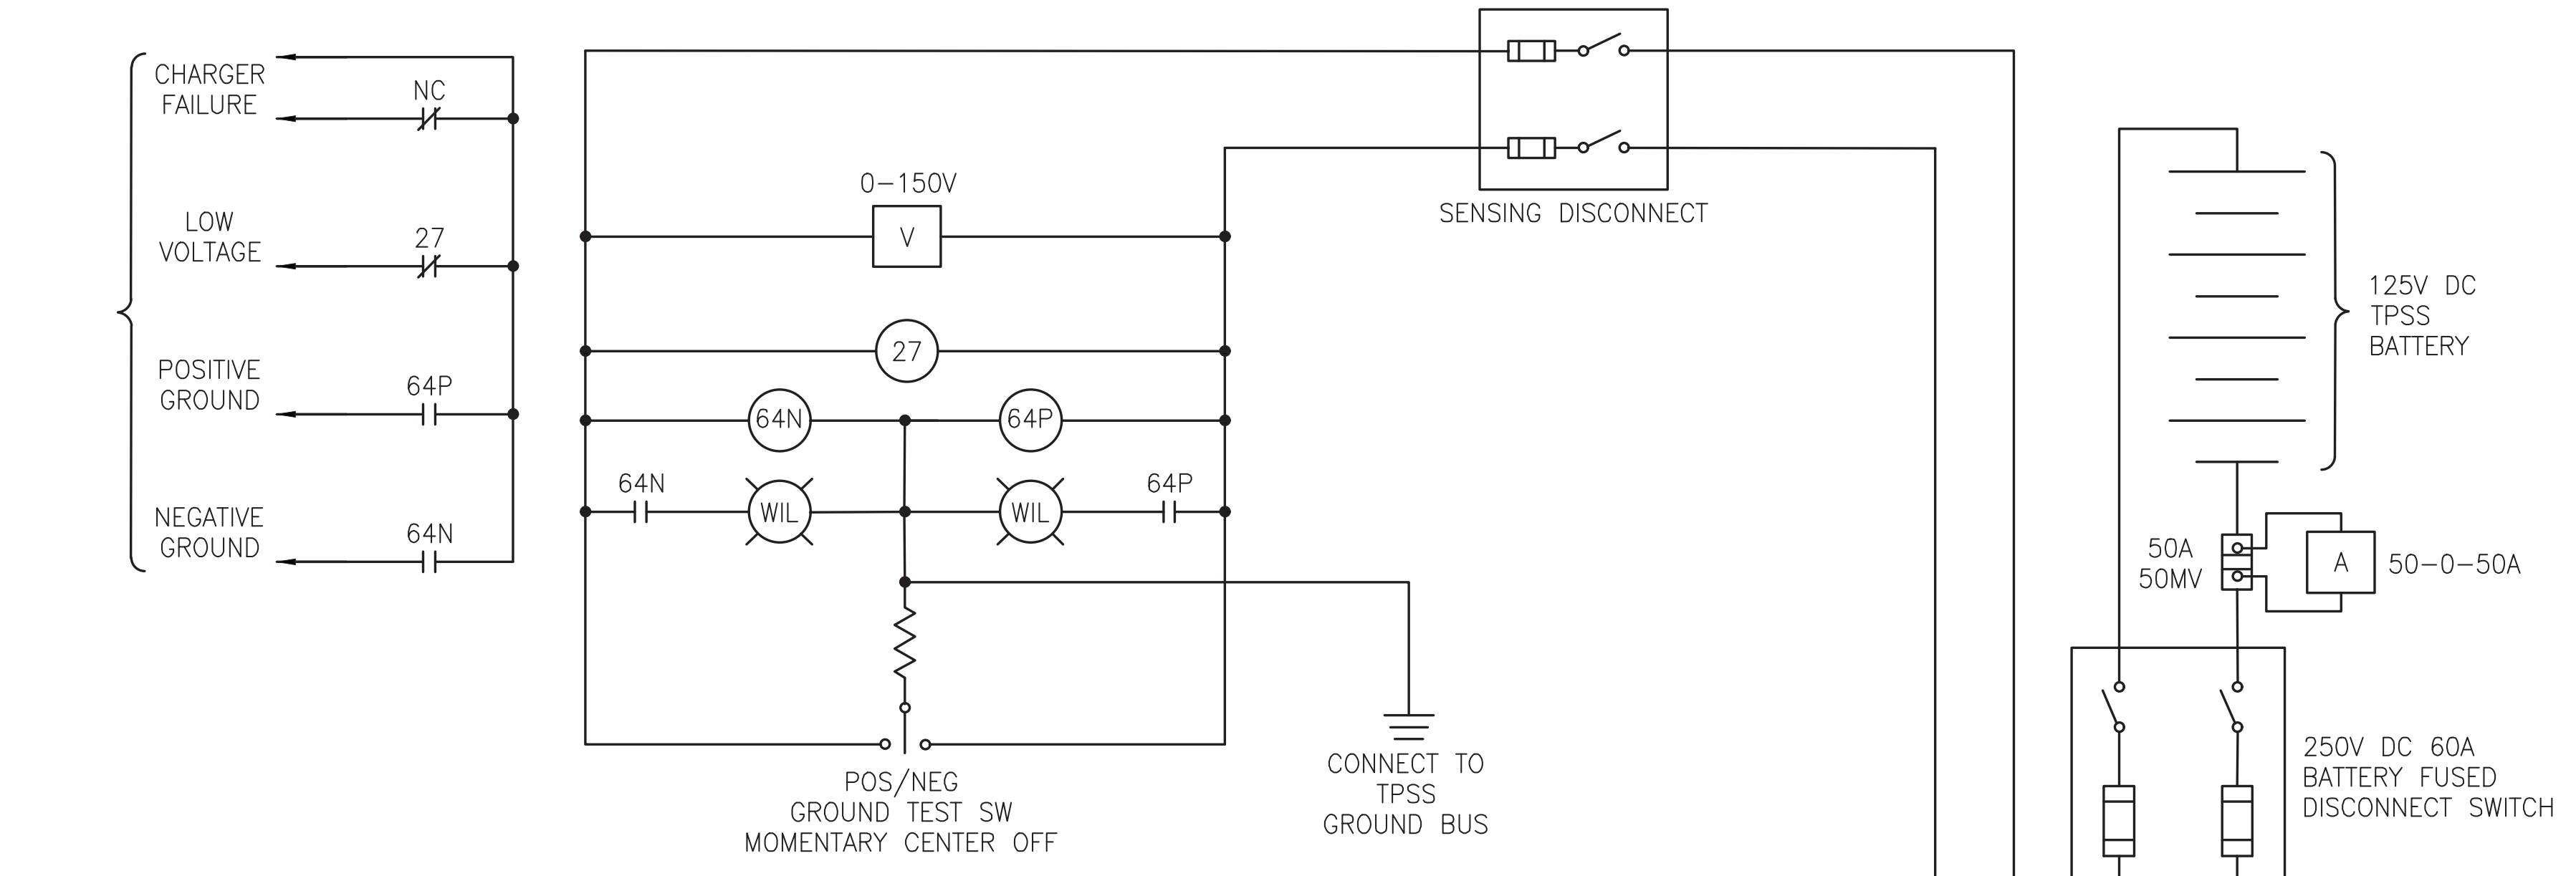


- NOTES:**
- THIS IS A TYPICAL BATTERY AND CONTROL CABLE PLAN. THE CONTRACTOR SHALL DEVELOP THE DESIGN TO 100 PERCENT BASED ON SITE CONDITIONS.
  - THE DESIGN SHALL CONFORM TO STANDARD OPERATING PROCEDURES OF SEPTA DURING NORMAL AND EMERGENCY SITUATIONS.

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**


C:\P\WORKING\PTTD\06235517AN-TP434.DWG

C:\P\WORKING\PT\1062355\17AN-TP437.DWG

PECO 2307  
13.2KV, 3PH, 3W, 60HZ

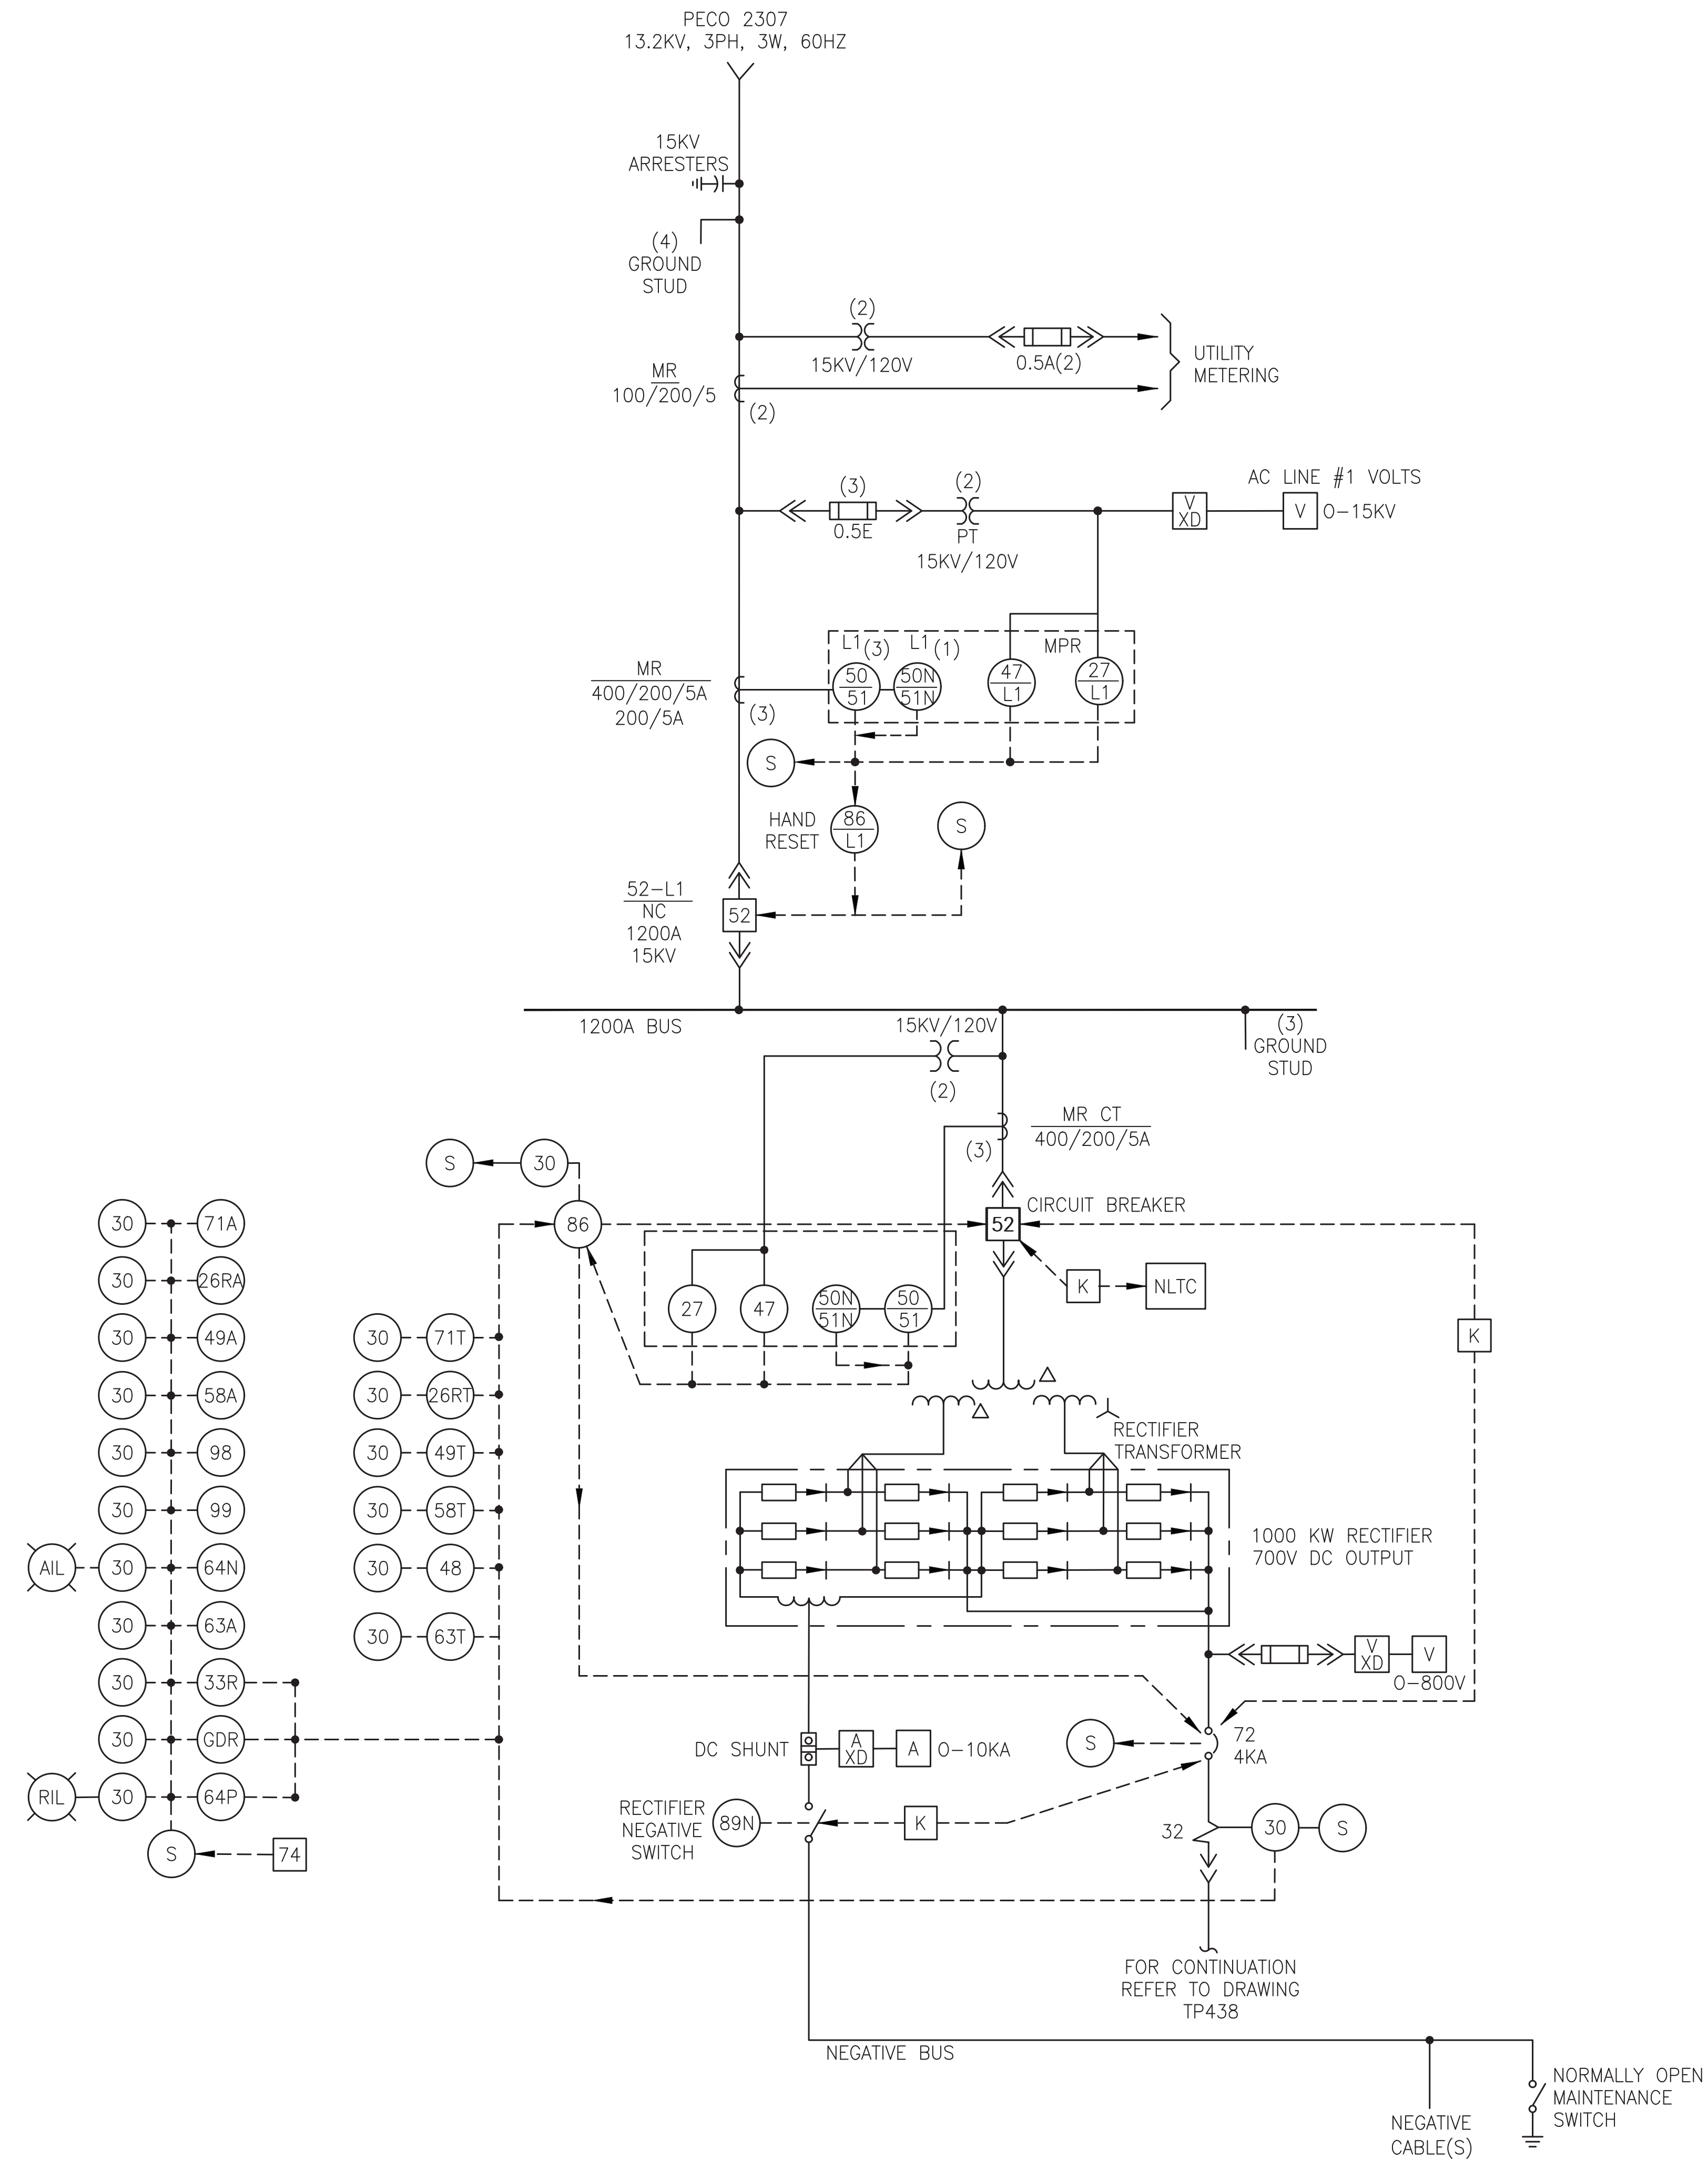

- NOTES:
- REFER TO DRAWING TP401 AND DRAWING TP402 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
  - SEE DRAWING TP438 FOR DC SWITCHGEAR PROTECTION & RELAY SINGLE LINE DIAGRAM.

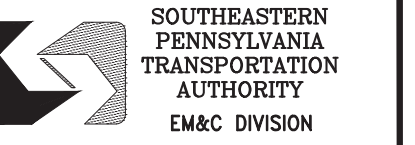

1234 MARKET ST., 15TH FL.  
PHILADELPHIA, PA 19107

CHEF ENGINEER-EM&C  
 CHEF ENGINEERING OFFICER-EM&C  
 CHEF RAIL TRANSIT OFFICER  
 SYSTEM SAFETY  
 DIRECTOR OF ENGINEERING-EM&C  
 MANAGER-ARCHITECTURE ENGINEERING  
 PROJECT MANAGER



REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
 ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
 PROPOSED PROTECTION & RELAY FULL LINE DIAGRAM - 1

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	DMH
WORK ORDER NO.:	276496	CHECKED BY:	BH
SHEET NUMBER:	<b>TP437</b>	COMPUTER FILE NO.:	17AN-TP437
DWG. NO.:	15	OF	22
SHT. NO.:	440	OF	452
ARCHIVE NO.:		REV. NO.:	

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**


DATE PRINTED: 10/21/2025  
 STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
PROTECTION & RELAY SINGLE LINE DIAGRAM - SHEET 2

SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: DMM CHECKED BY: BK
WORK ORDER NO: 276496	
SHEET NUMBER <b>TP438</b>	
DWG. NO.: 16 OF 22	SHT. NO.: 441 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP438	REV. NO.:

- NOTES:
- REFER TO DRAWING TP401 AND DRAWING TP402 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
  - SEE DRAWING TP437 FOR AC SWITCHGEAR PROTECTION & RELAY SINGLE LINE DIAGRAM.

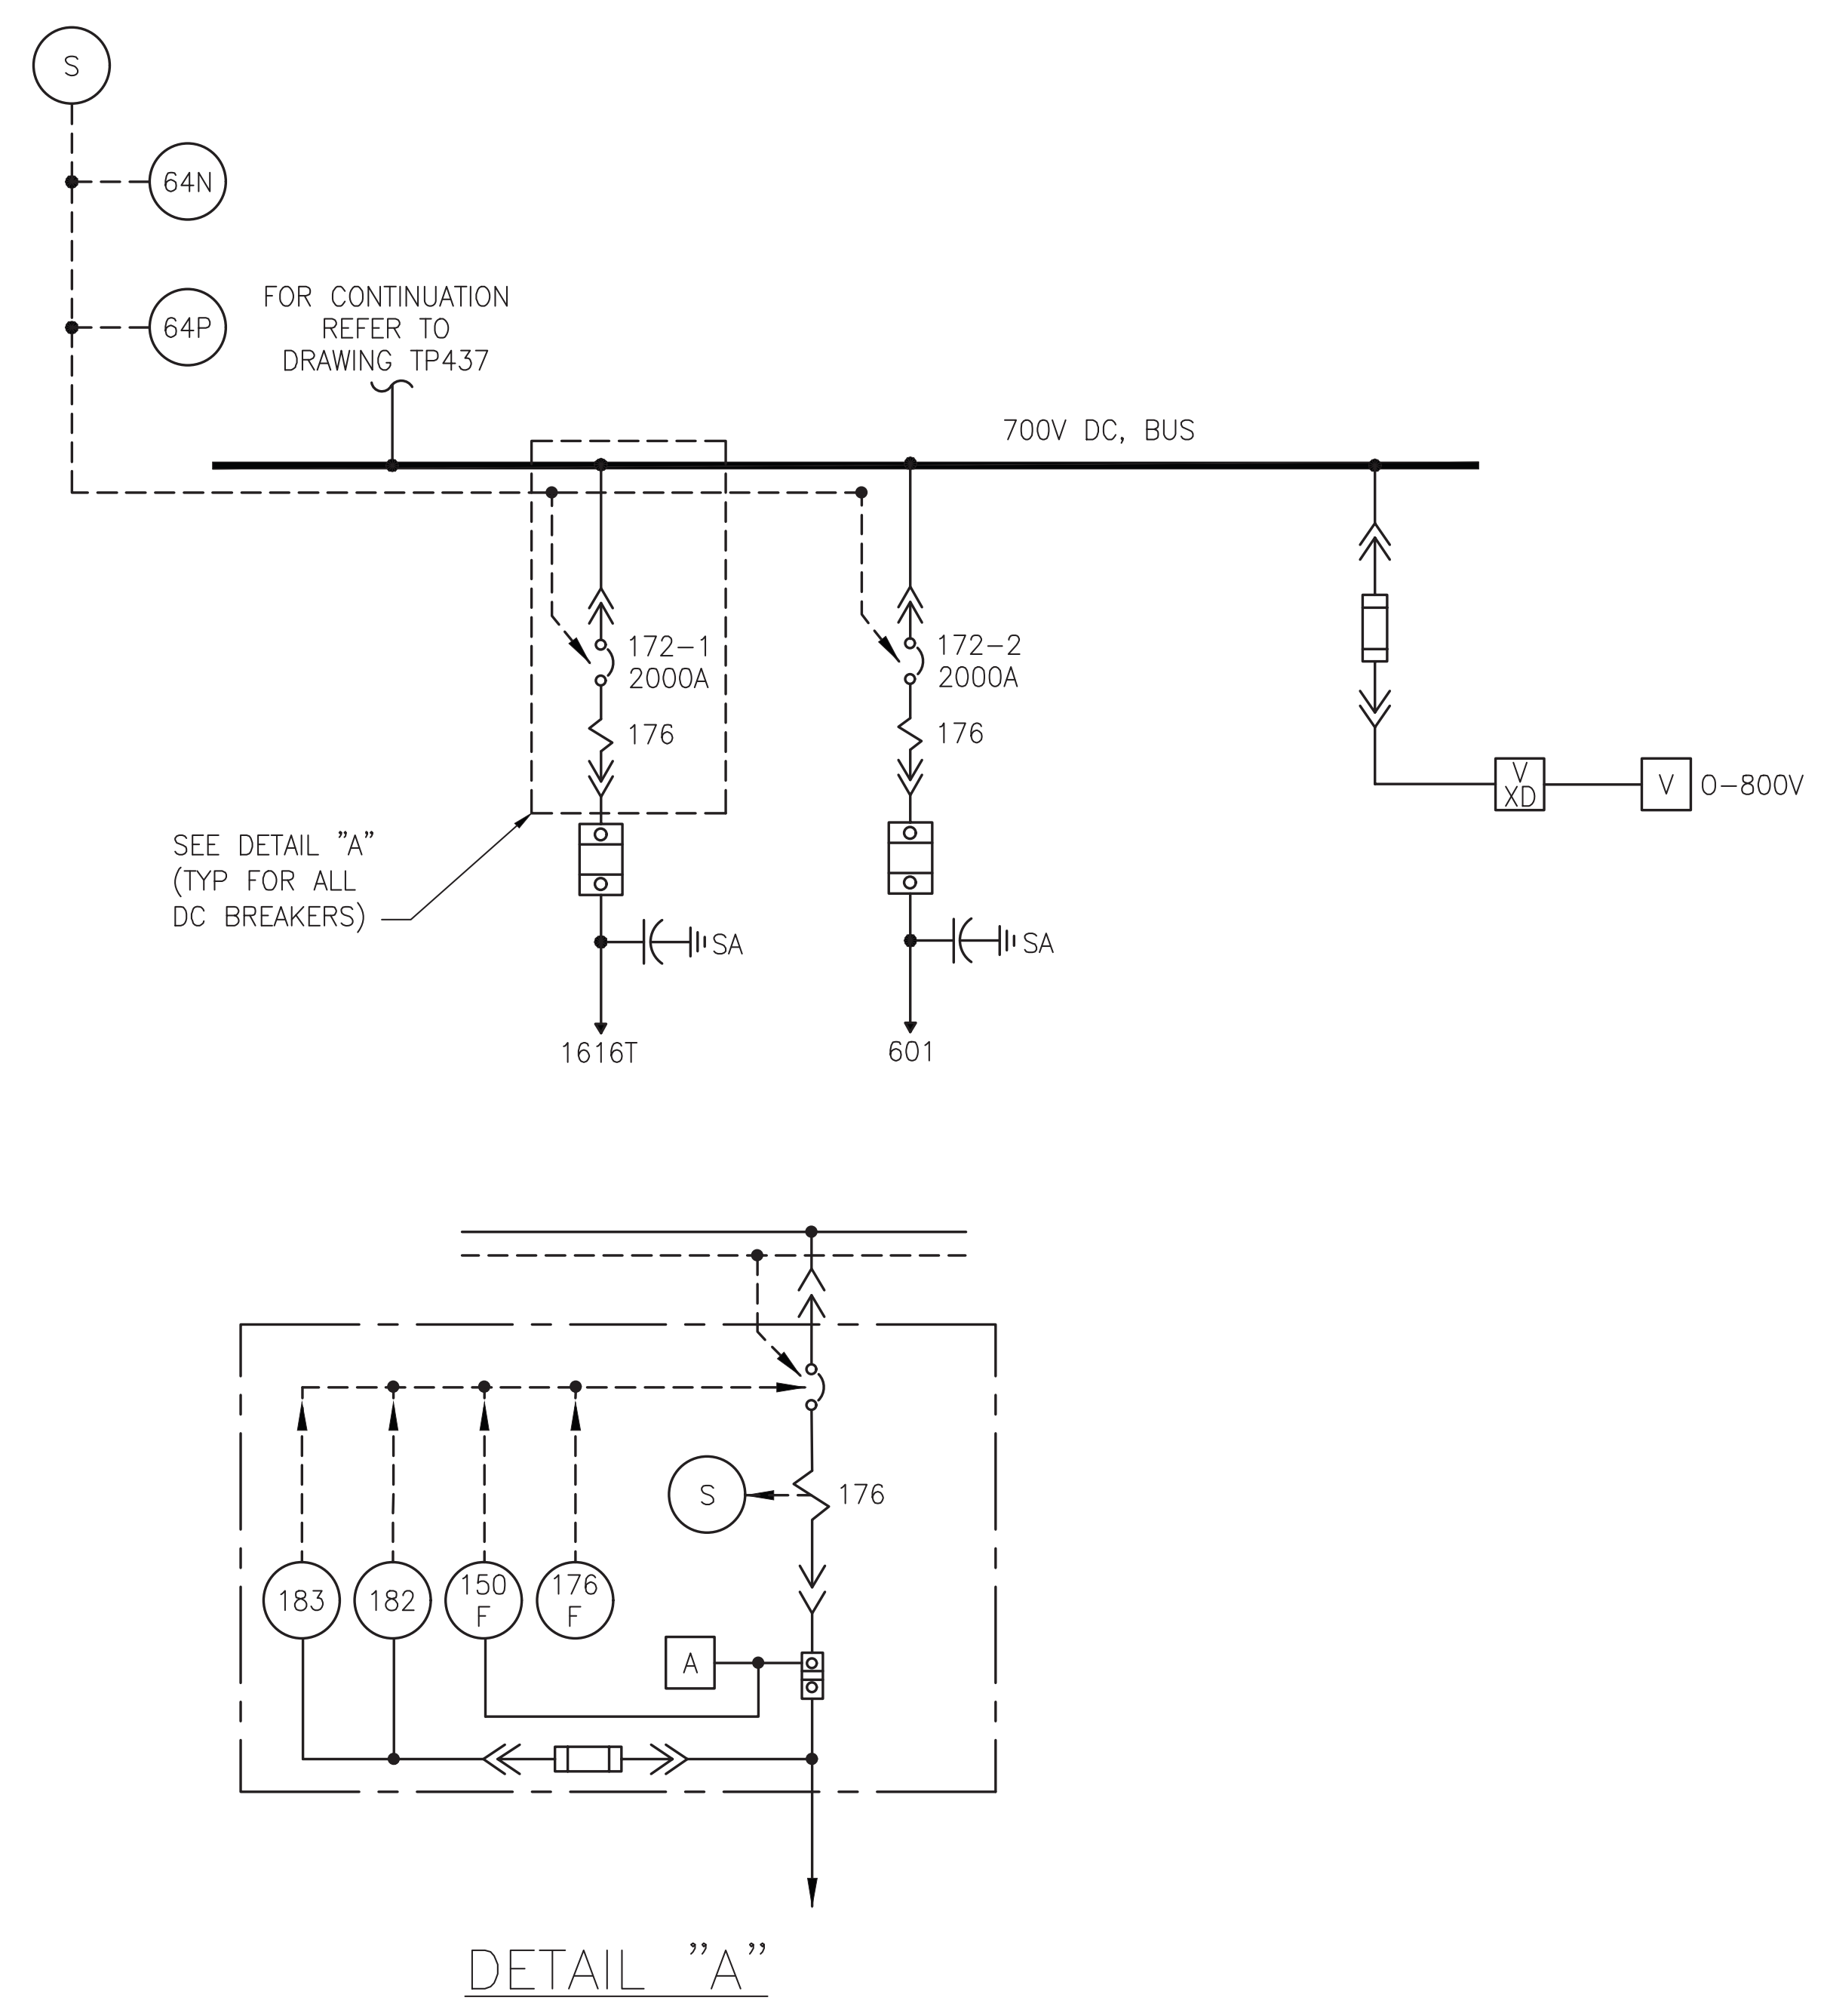


50% SUBMISSION  
NOT FOR CONSTRUCTION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
 ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
 CIRCUIT BREAKER CONTROL DIAGRAMS - TYPICAL



SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	DMR
WORK ORDER NO.:	276496	CHECKED BY:	BK
SHEET NUMBER:	<b>TP439</b>		
DWG. NO.:	17	OF	22
SHT. NO.:	442	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-TP439	REV. NO.:	-

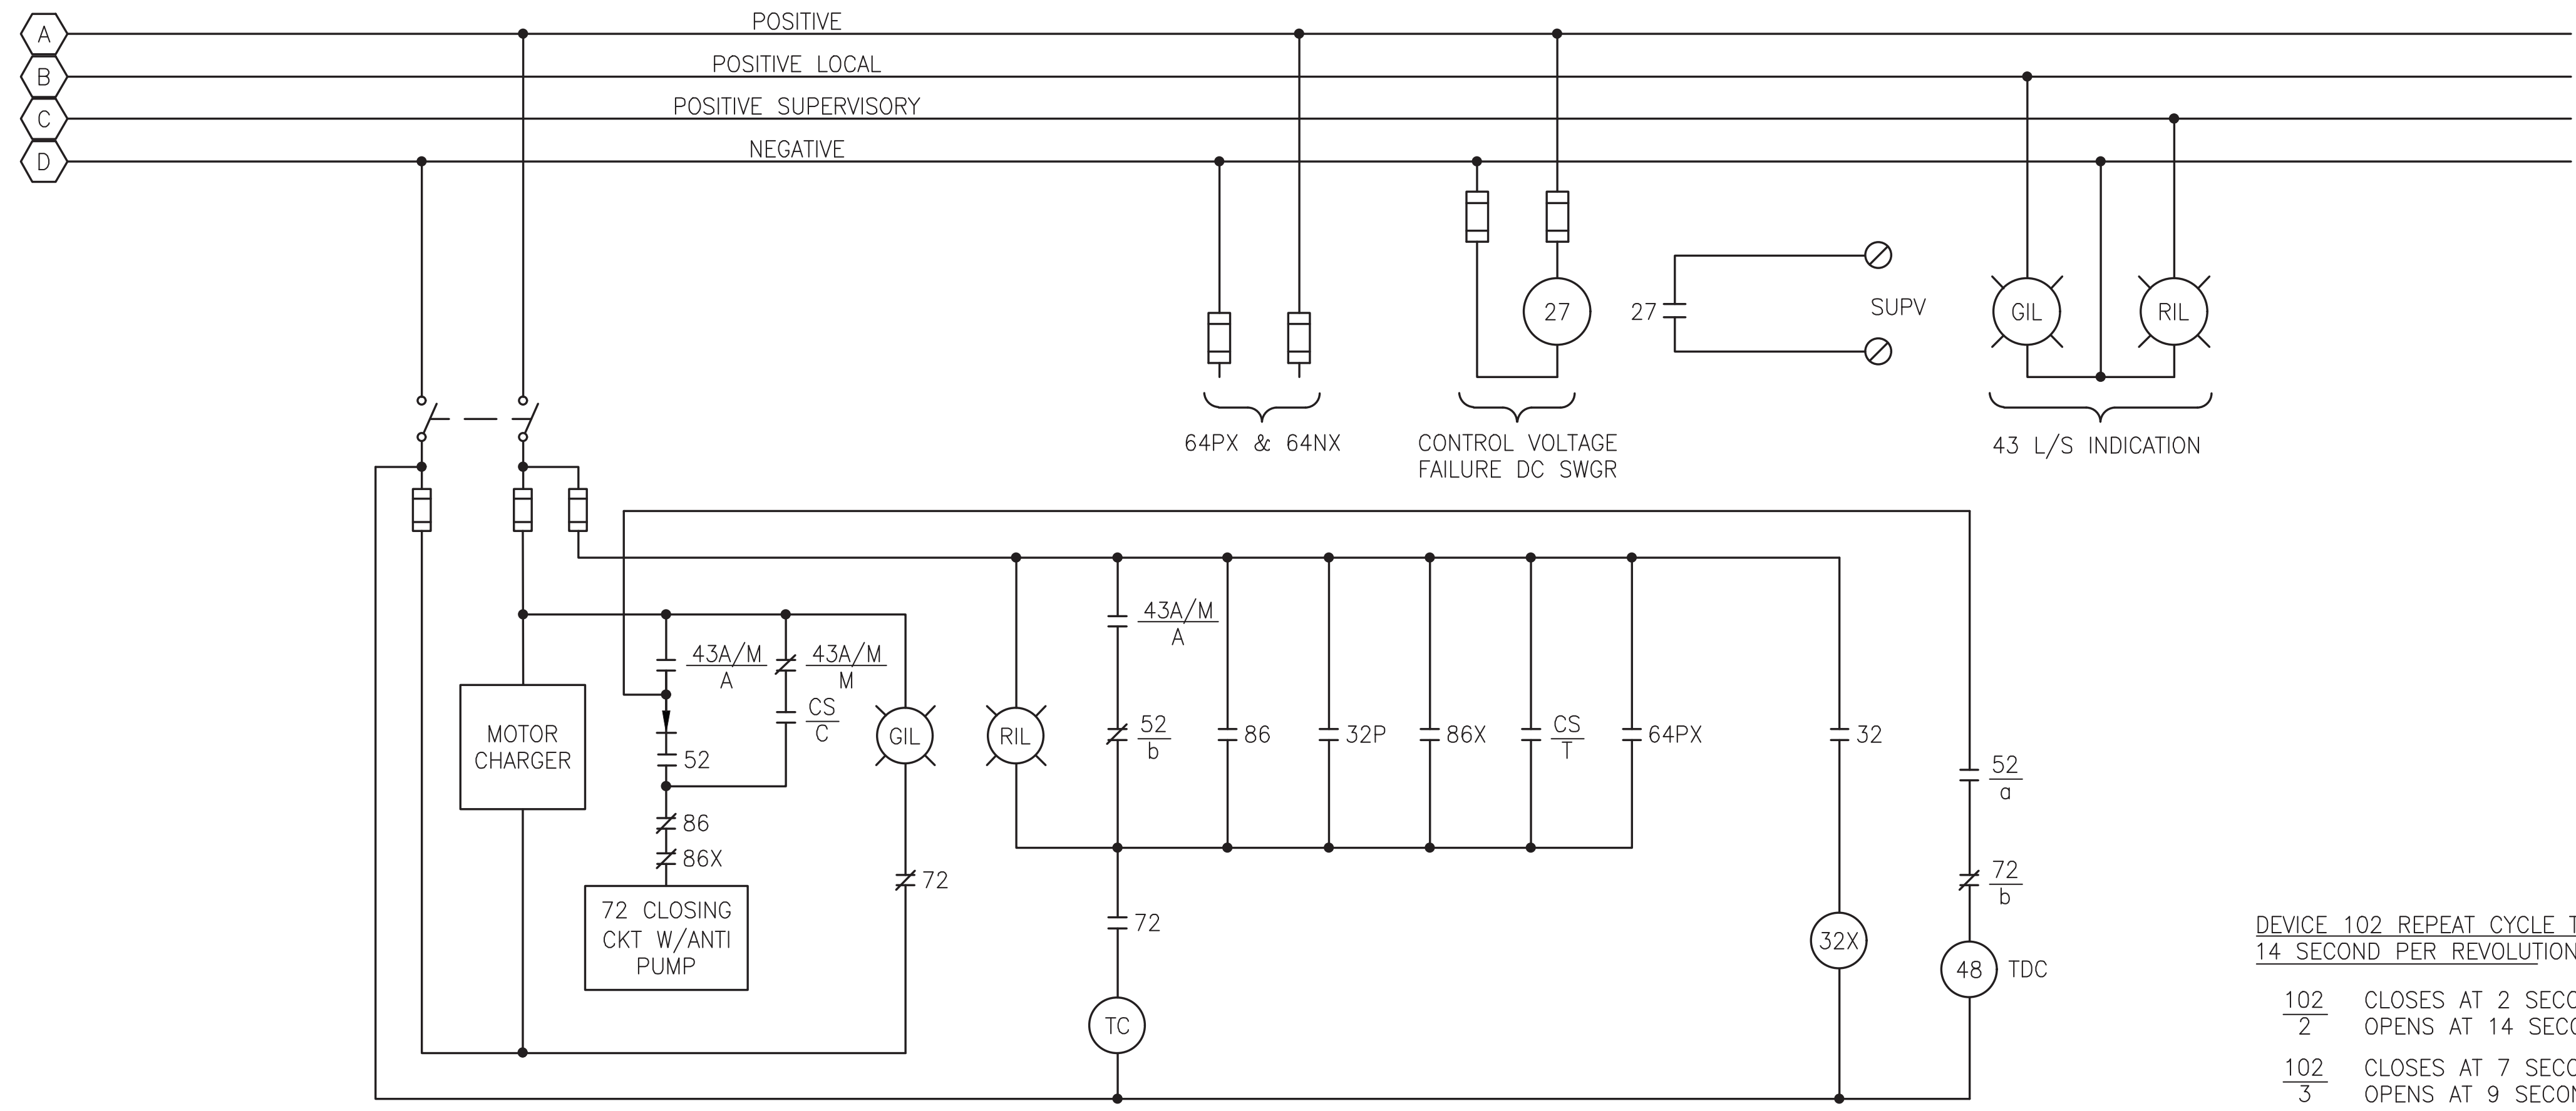


**1** 72 CATHODE CIRCUIT BREAKER  
 TP439

DEVICE 102 REPEAT CYCLE TIME  
 14 SECOND PER REVOLUTION

102/2	CLOSES AT 2 SECONDS OPENS AT 14 SECONDS
102/3	CLOSES AT 7 SECONDS OPENS AT 9 SECONDS
102/1	CLOSES AT 8.75 SECONDS OPENS AT 9.75 SECONDS
102/4	CLOSES AT 2 SECONDS OPENS AT 12 SECONDS

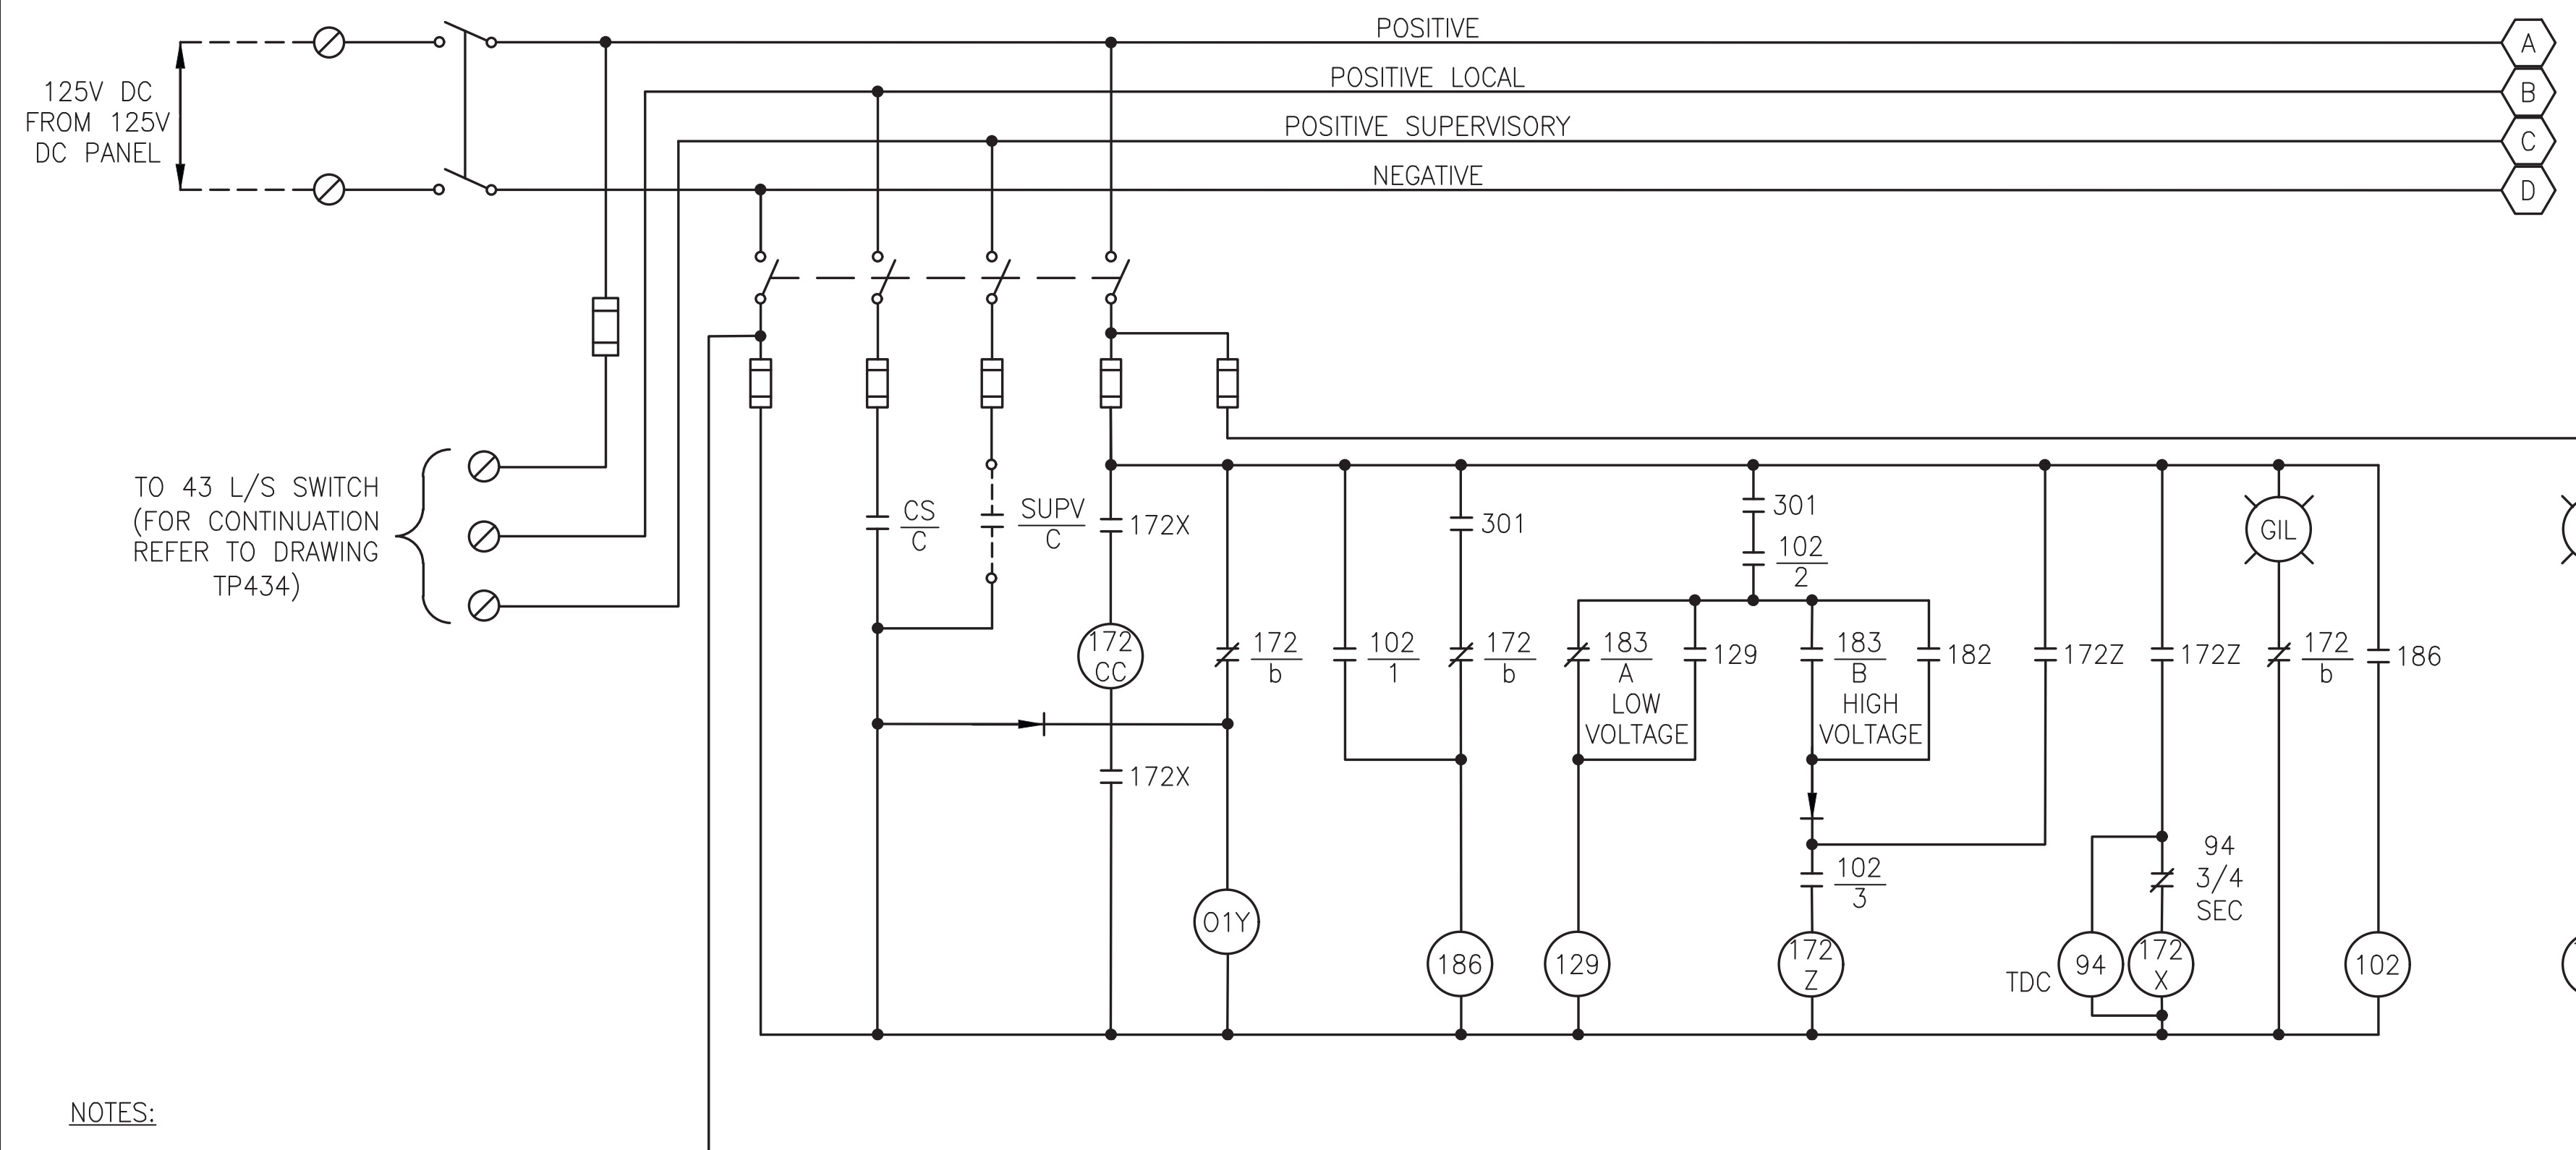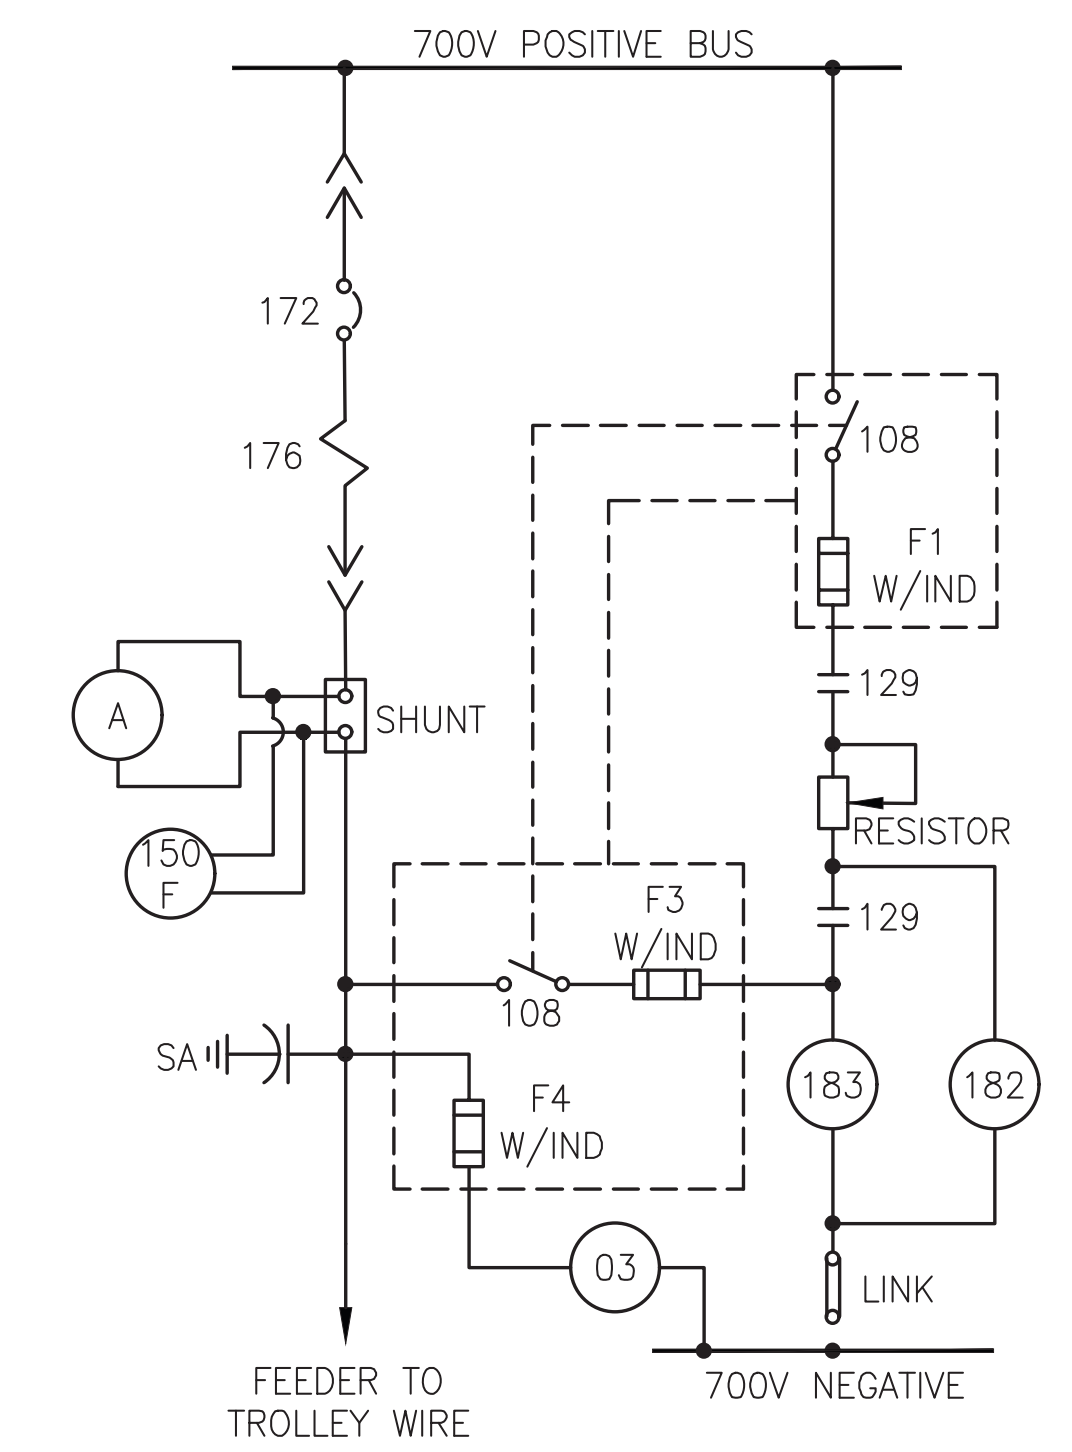

**2** 172 DC FEEDER CIRCUIT BREAKER  
 TP439

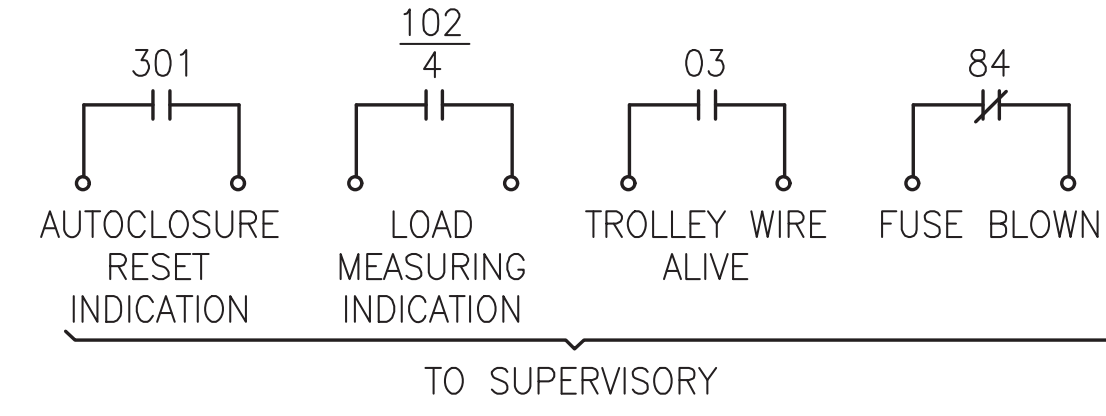

- NOTES:
- REFER TO DRAWING TP401 AND DRAWING TP402 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
  - THESE ARE TYPICAL CONTROL DIAGRAMS. THE CONTRACTOR SHALL DEVELOP THE DESIGN TO 100 PERCENT BASED ON SITE CONDITIONS.
  - THE CONTRACTOR SHALL ESTABLISH CURRENT TRANSFORMER AND POTENTIAL TRANSFORMER RATIOS TO MEET THE PROTECTIVE RELAYING REQUIREMENTS.

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**


C:\P\WORKING\PTTID\9623517AN\TP439.DWG

DATE PRINTED: 10/21/2025 STATUS: 90% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
DC RECTIFIER CONTROL SCHEMATIC

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: DMH CHECKED BY: BK
WORK ORDER NO.: 276496	SHEET NUMBER: <b>TP440</b>
DWG. NO.: 18 OF 22	SHT. NO.: 443 OF 452
COMPUTER FILE NO.: 17AN-TP440	REV. NO.: -

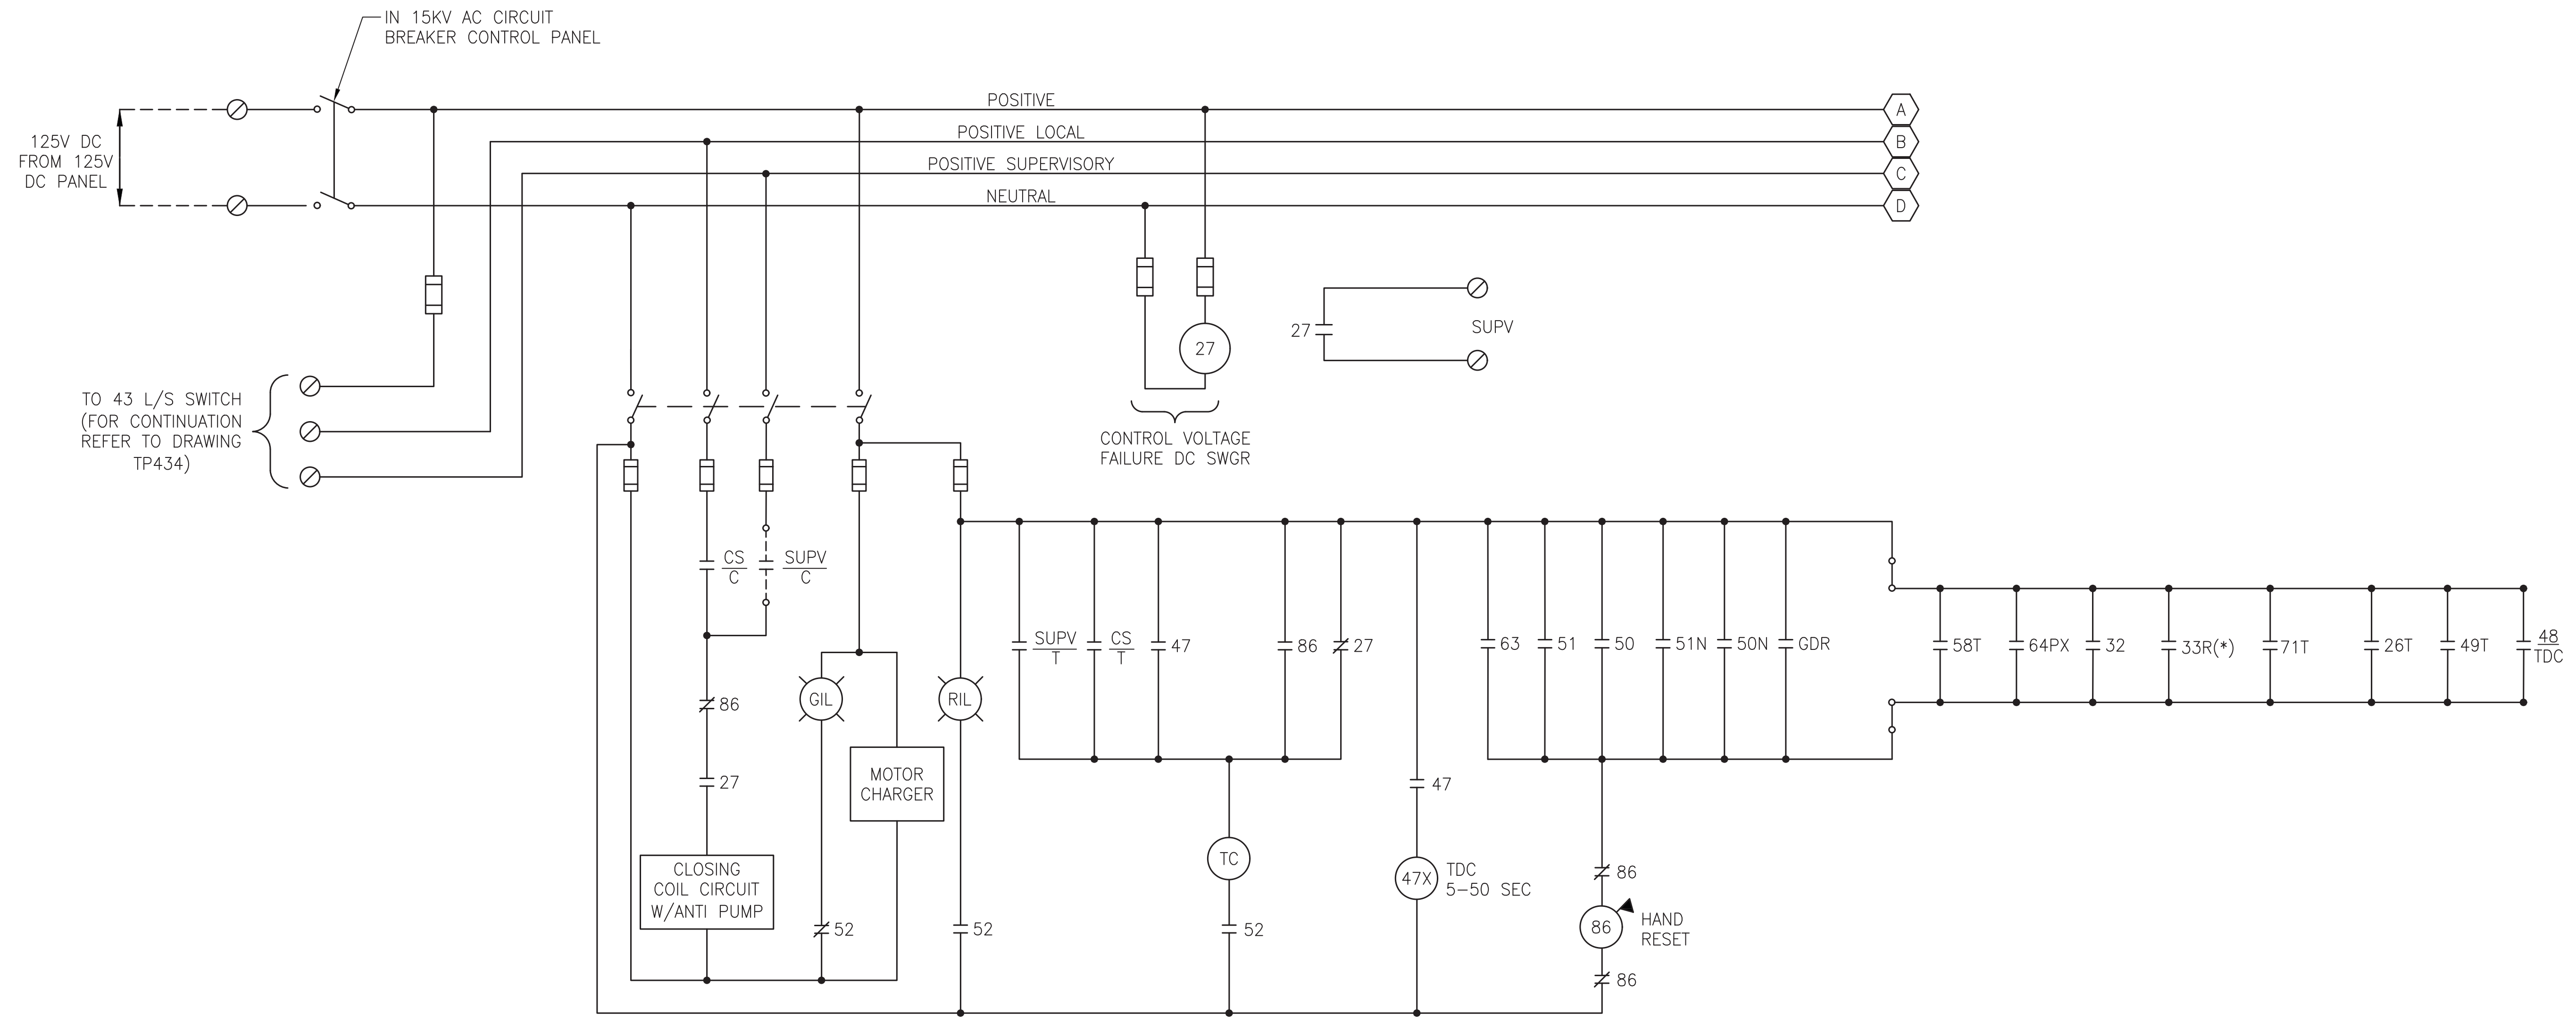

\* NUMBER OF DEVICES TO BE DETERMINED BY THE MANUFACTURER

**1 52 AC CIRCUIT BREAKER CONTROL**  
TP440

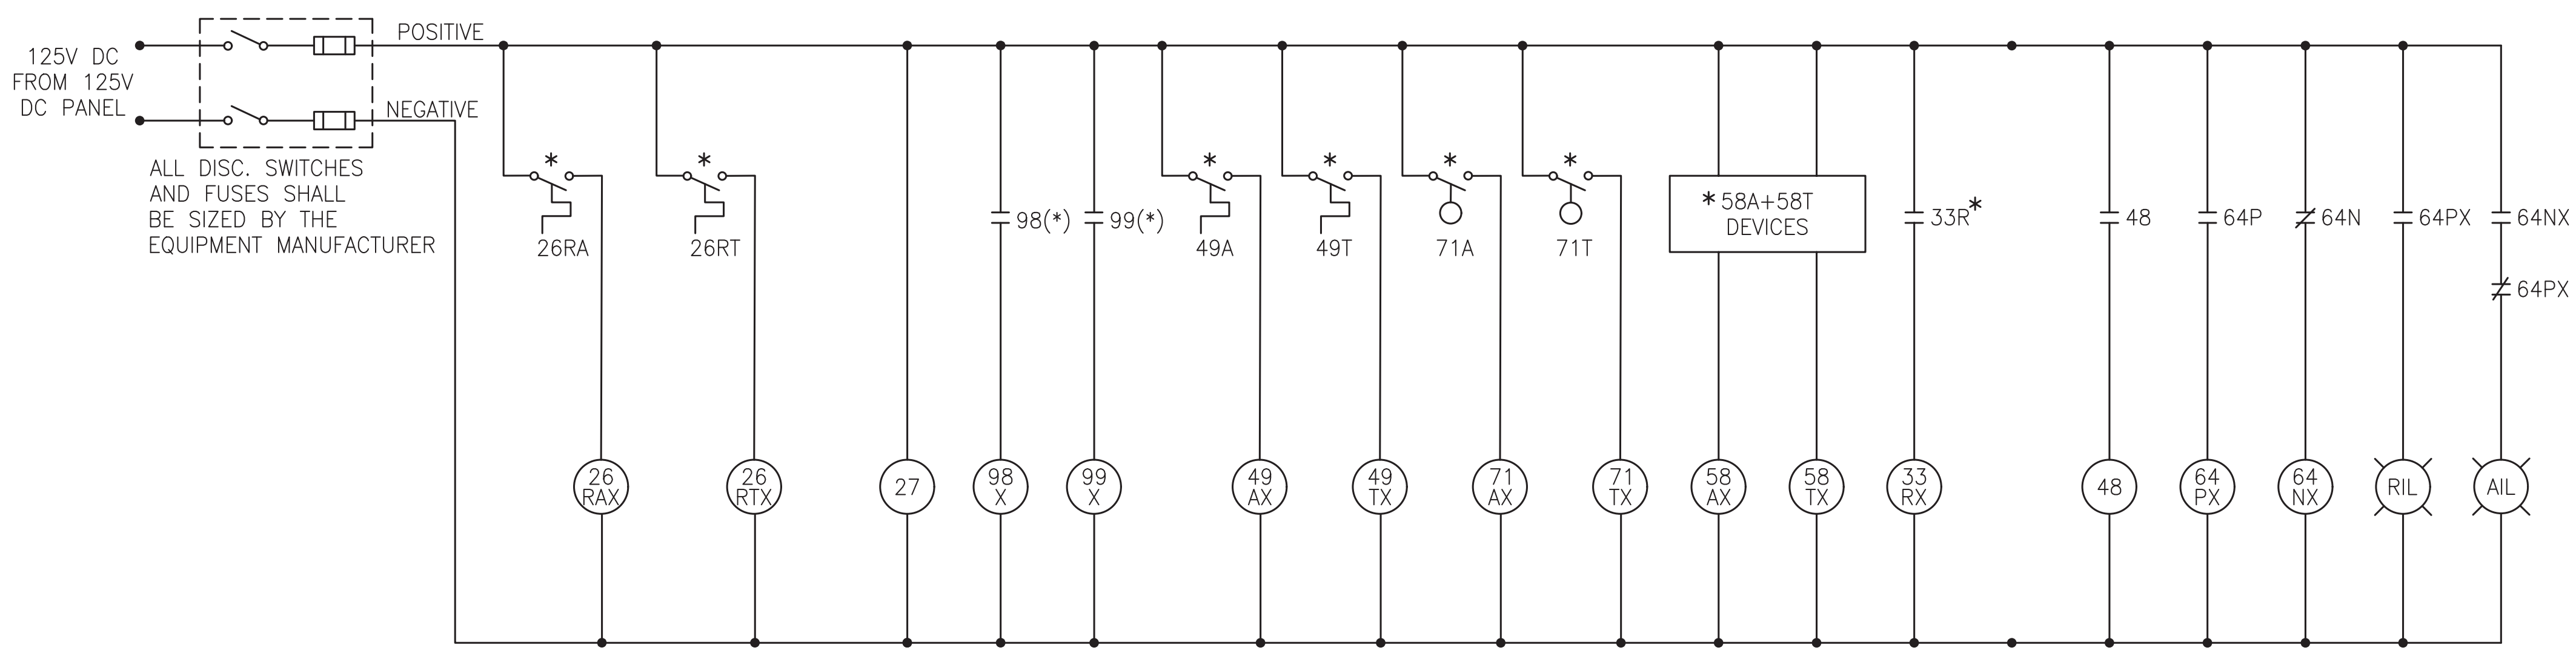

\* NUMBER OF DEVICES TO BE DETERMINED BY THE MANUFACTURER

**2 RECTIFIER CONTROL**  
TP440

**NOTES:**

- REFER TO DRAWING TP401 AND DRAWING TP402 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
- THESE ARE TYPICAL CONTROL DIAGRAMS. THE CONTRACTOR SHALL DEVELOP THE DESIGN TO 100 PERCENT BASED ON SITE CONDITIONS.
- THE CONTRACTOR SHALL ESTABLISH CURRENT TRANSFORMER AND POTENTIAL TRANSFORMER RATIOS TO MEET THE PROTECTIVE RELAYING REQUIREMENTS AND SHALL COORDINATE RELAYING WITH THE UTILITY COMPANY.
- REFER TO DRAWING TP439 FOR ADDITIONAL CONTROL DIAGRAMS.


**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTID\16826517AN-TP440.DWG

DATE PRINTED: 10/21/2025

STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD

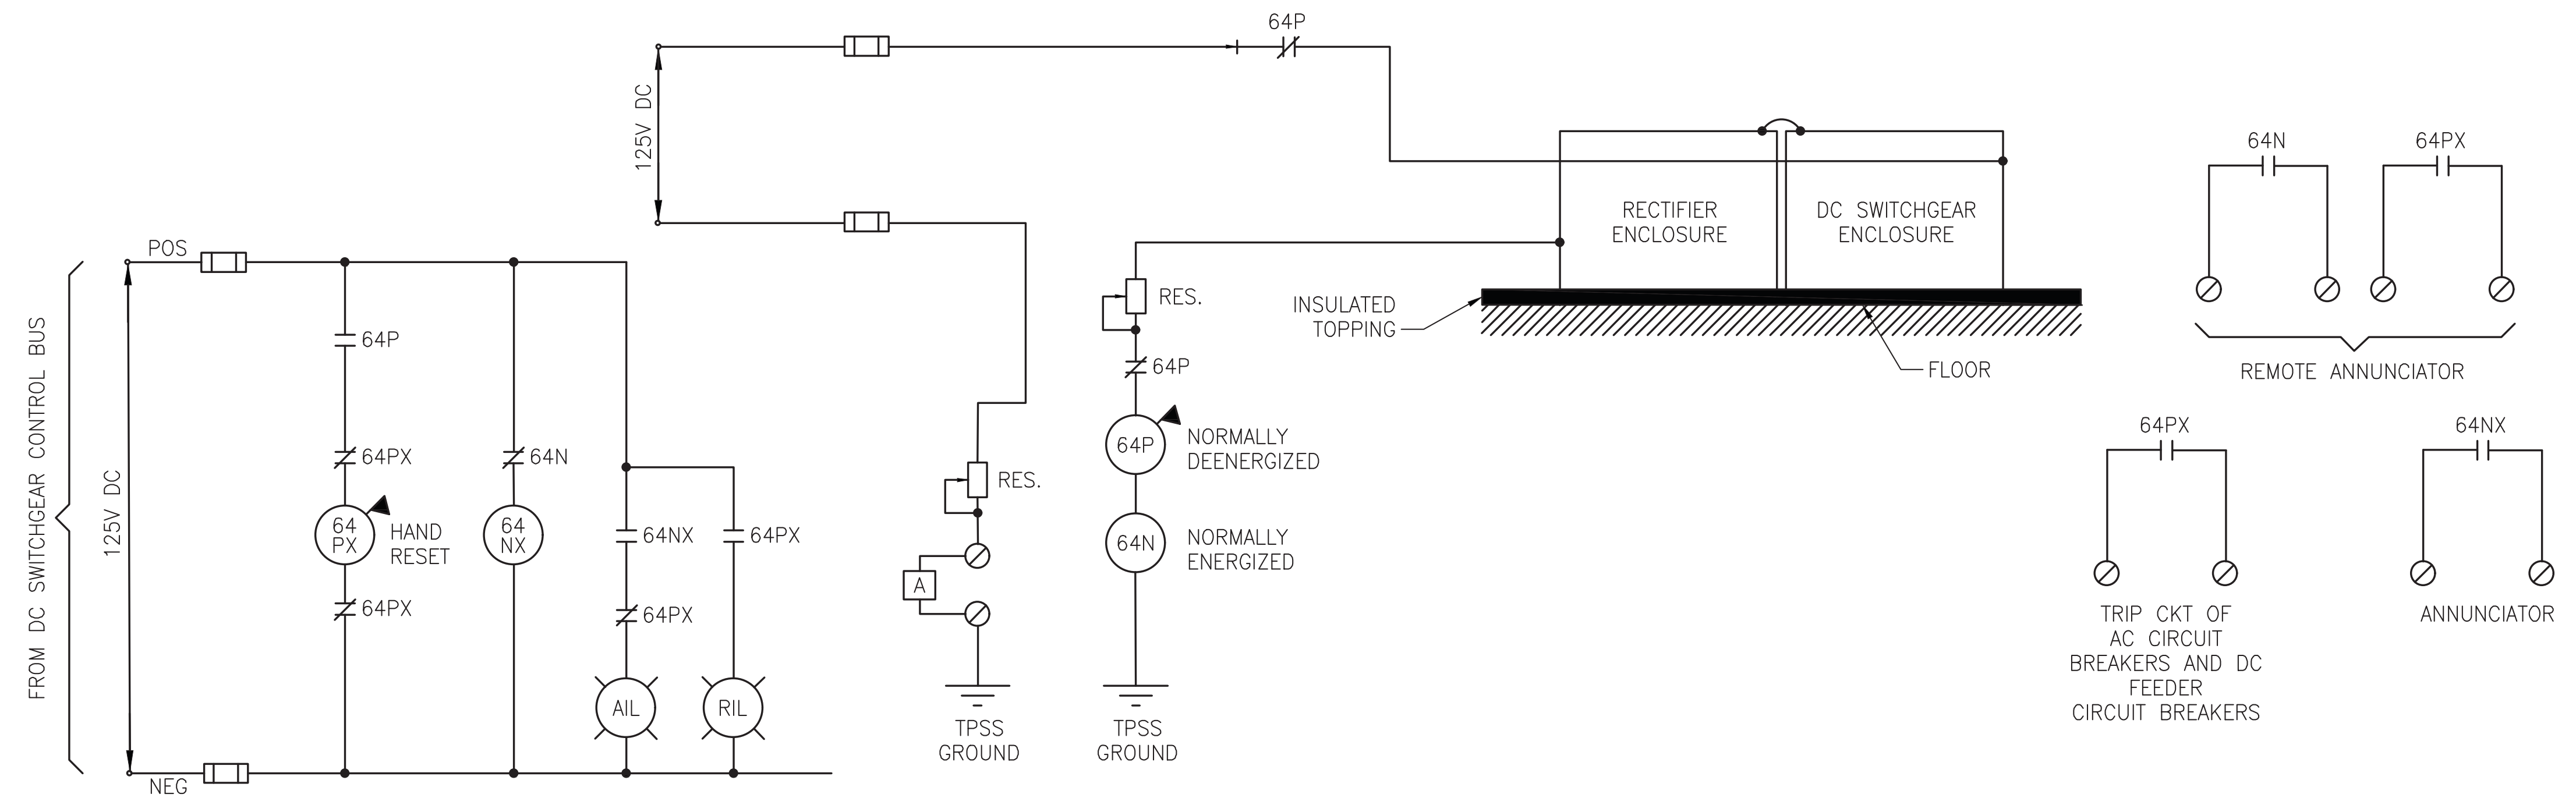

1 RECTIFIER AND DC SWITCHGEAR POTENTIAL MONITORING CIRCUIT (TYPICAL)  
TP441

NOTES:

- REFER TO DRAWING TP401 AND DRAWING TP402 FOR SYMBOLS, LEGENDS AND DEVICE NUMBERS.
- THIS IS A TYPICAL DC GROUND FAULT PROTECTION SCHEME. THE CONTRACTOR SHALL DEVELOP THE DESIGN TO 100 PERCENT BASED ON SITE CONDITIONS.

50% SUBMISSION  
NOT FOR CONSTRUCTION

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
DC GROUND FAULT PROTECTION SCHEME

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: DMH CHECKED BY: BH
WORK ORDER NO: 276496	
SHEET NUMBER <b>TP441</b>	
DWG. NO.: 19 OF 22	SHT. NO.: 444 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-TP441	

BUS POTENTIAL TRANSFORMER SCADA POINTS		
DEVICE	STATUS INDICATION	POINT NUMBER
TELEMETRY POINTS		
15KV BUS 1	VOLTAGE	1
15KV BUS 2	VOLTAGE	2
SPARE	-	3
SPARE	-	4

RECTIFIER TRANSFORMER SCADA POINTS		
TOTAL RECTIFIER TRANSFORMERS = 1		
DEVICE	STATUS INDICATION	POINT NUMBER
TEMPERATURE (49T)	ALARM-T1	1
	TRIP-T2	2
LOW LIQUID LEVEL (71T)	ALARM-T1	3
	TRIP-T2	4
RAPID PRESSURE RISE (63T)	ALARM-T1	5
	TRIP-T2	6
REFLECTIVE FAILURE (58T)		7
TELEMETRY POINTS		
VOLTAGE	VOLTAGE	1

15KV CIRCUIT BREAKER SCADA POINTS		
TOTAL 15KV AC CIRCUIT BREAKERS (FOR 13.2KV) = 3		
DEVICE	STATUS INDICATION	POINT NUMBER
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
BREAKER FAILURE RELAY (50BF)	OPERATED	3
	FAILURE	4
UNDER VOLTAGE RELAY (27)	TRIPPED	5
	SET	6
PHASE BALANCE RELAY (47)	TRIPPED	7
	SET	8
OVERCURRENT RELAY (50/51)	OPERATED	9
	FAILURE	10
LOCAL/REMOTE SWITCH	LOCAL	11
	REMOTE	12
BREAKER TRIP	TRIPPER	13
		14
BREAKER READY	READY	14
	-	15
BREAKER WATCHDOG	WATCHDOG	16
	-	17
RESERVED	N.O.	18
	N.C.	19
RESERVED	N.O.	20
	N.C.	21
RESERVED	N.O.	22
	N.C.	23
CONTROL POINTS		
CIRCUIT BREAKER	OPEN	1
	CLOSE	2
RESERVED	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1

INCOMING CIRCUIT BREAKER SCADA POINTS		
15KV LINE: PECO 2307 TOTAL CIRCUIT BREAKERS = 1		
DEVICE	STATUS INDICATION	POINT NUMBER
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
CONTROL POINTS		
CIRCUIT BREAKER	OPENED	1
	CLOSED	2
RESERVED	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1
RESERVED	-	2
VOLTMETER (VM)	VOLTS	3

RECTIFIER SCADA POINTS		
TOTAL RECTIFIERS = 1		
DEVICE	STATUS INDICATION	POINT NUMBER
RECTIFIER OVERCURRENT (26T)	OPERATED	1
	FAILURE	2
POSITION SWITCH (33R)	OPERATED	3
	FAILURE	4
RECTIFIER LOSS OF DIODE (98)	OPERATED	5
	FAILURE	6
RECTIFIER LOSS OF DIODE (99)	OPERATED	7
	FAILURE	8
RECTIFIER GROUND NEUTRAL (64N)	OPERATED	9
	FAILURE	10
RECTIFIER PHASING COMPARISON (64P)	OPERATED	11
	FAILURE	12

AUXILIARY TRANSFORMER SCADA POINTS		
TOTAL TRANSFORMERS = 1		
DEVICE	STATUS INDICATION	POINT NUMBER
TEMPERATURE (49T)	ALARM-T1	1
	TRIP-T2	2
REFLECTIVE FAILURE (58T)	-	3
CONTROL POINTS		
NONE		
TELEMETRY POINTS		
NONE		

FIRE ALARM PANEL		
DEVICE	STATUS INDICATION	POINT NUMBER
FIRE ALARM	ON	1
FACP STATUS	TROUBLE	2

INTRUSION PANEL		
DEVICE	STATUS INDICATION	POINT NUMBER
INTRUSION ALARM	ON	1
INTRUSION PANEL STATUS	TROUBLE	2
CONTROL POINTS		
INTRUSION ALARM	ARM	3
INTRUSION ALARM	DISARM	4

BATTERY SYSTEM		
DEVICE	STATUS INDICATION	POINT NUMBER
DEVICE	OPENED	1
	CLOSED	2
BATTERY STATUS	ENABLED	3
	DISABLED	4
BATTERY VOLTAGE	NORMAL	5
	LOW	6
CONTROL POWER	AC POWER	7
	NO AC POWER	8
MAINTENANCE	OVERVOLTAGE	9
	UNDERVOLTAGE	10
GAS DETECTION ALARM	NORMAL	11
	ALARM	12
CONTROL POINTS		
NONE		
TELEMETRY POINTS		
NONE		

DC SWITCHGEAR SCADA POINTS		
TOTAL CATHODE BREAKERS = 1 TOTAL DC FEEDER BREAKERS = 2		
DEVICE	STATUS INDICATION	POINT NUMBER
CATHODE BREAKER	OPENED	1
	CLOSED	2
CATHODE BREAKER DIRECTIONAL POWER RELAY	OPERATED	3
	FAILURE	4
DC FEEDER BREAKER	OPEN	5
	CLOSED	6
DC FEEDER BREAKER OVER CURRENT RELAY	150	7
DC FEEDER BREAKER OVER VOLTAGE RELAY	176	8
CONTROL POINTS		
CATHODE BREAKER	OPEN	1
	CLOSE	2
DC FEEDER BREAKER	-	3
	-	4
TELEMETRY POINTS		
AMMETER (AM)	CURRENT	1

BATTERY TRANSFER PANEL		
DEVICE	STATUS INDICATION	POINT NUMBER
CONTACTOR #1	OPENED	1
	CLOSED	2
CONTACTOR #2	OPENED	3
	CLOSED	4
CONTROL POINTS		
CONTACTOR #1	OPEN	1
	CLOSE	2
CONTACTOR #2	OPEN	3
	CLOSE	4
TELEMETRY POINTS		
NONE		

- NOTES:
- THERE IS ONLY ONE LOCAL/REMOTE SELECTOR SWITCH.
  - THIS SCADA POINTS LIST IS FOR GUIDANCE ONLY. THE CONTRACTOR IS TO DEVELOP A FINAL POINT COUNT AS PART OF THE FINAL DESIGN AND ANY SEPTA SPECIFIC ADDITIONS AT THIS LOCATION.

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

CHIEF ENGINEER-EMBC
CHIEF ENGINEERING OFFICER-EMBC
CHIEF RAIL TRANSFER OFFICER
SYSTEM SAFETY
DIRECTOR OF ENGINEERING-EMBC
MANAGER-ARCH ENGINEERING
PROJECT MANAGER

**HDR**  
HDR Engineering, Inc.  
Philadelphia, PA

REV	DATE	DESCRIPTION	BY	CHKD	APD

**CASTOR**  
ROUTE 69 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
SCADA POINTS LIST


SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: MB
WORK ORDER NO: 276496	CHECKED BY: VS
SHEET NUMBER: 276496	
<b>TP442</b>	
DWG. NO.: 20 OF 22	
SHT. NO.: 445 OF 452	
ARCHIVE NO.:	
COMPUTER FILE NO.: 17AN-TP442	REV. NO.:

REV	DATE	DESCRIPTION	BY	CKD	APD


**CASTOR ROUTE 59 TROLLEY LINE TRACTION POWER SUBSTATION REHABILITATION TRACTION POWER GROUNDING PLAN**

SCALE: AS SHOWN	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: YL
WORK ORDER NO: 276496	CHECKED BY: BK
SHEET NUMBER: TP445	
DWG. NO: 21 OF 22	
SHT. NO: 446 OF 452	
ARCHIVE NO:	
COMPUTER FILE NO: 17AN-TP445	REV. NO:

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

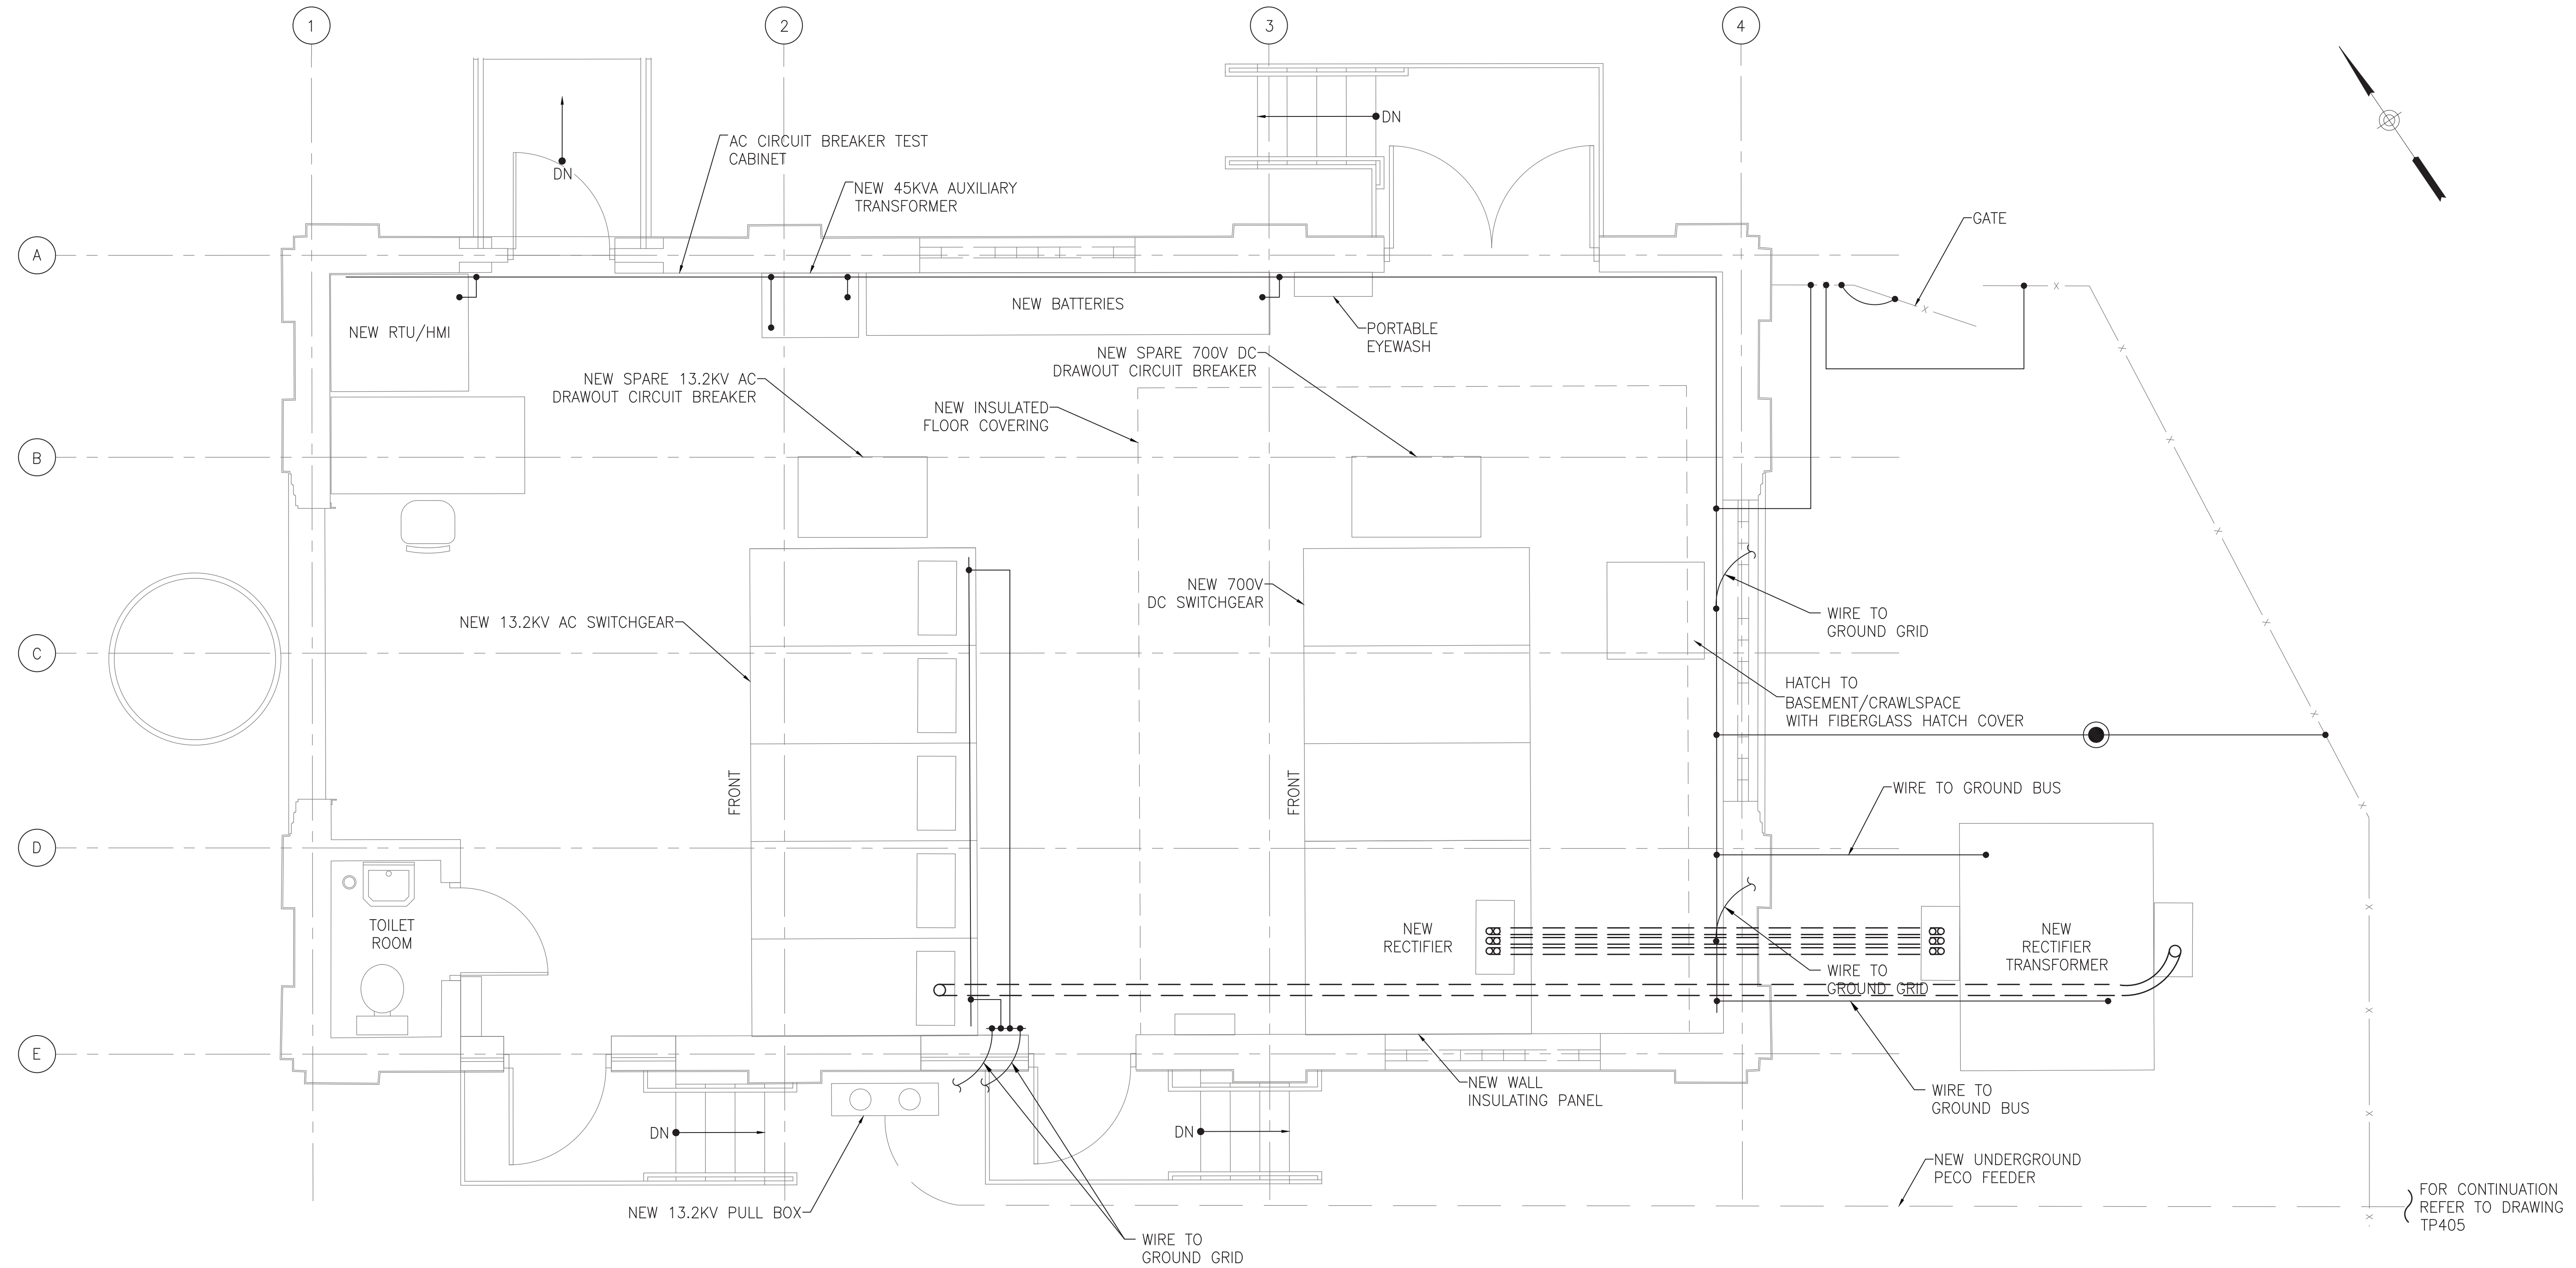

- NOTES:
- GROUND CABLES SHALL, IN GENERAL, RUN PARALLEL TO OR AT RIGHT ANGLES TO FLOORS, WALLS AND STRUCTURAL MEMBERS.
  - THIS DRAWING IS DIAGRAMMATIC ONLY. REFER TO SPECIFICATIONS FOR DETAIL.
  - GROUND CABLE PASSING THROUGH CONCRETE INTO EXPOSED AREAS SHALL BE PROTECTED AGAINST ABRASION AT POURED IN PLACE CONCRETE SLABS.

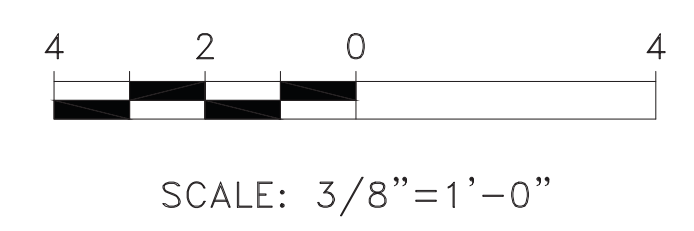

**50% SUBMISSION  
NOT FOR CONSTRUCTION**

C:\P\WORKING\PTITD\16826517AN-TP445.DWG


REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**TRACTION POWER**  
GROUNDING DETAILS


SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	DMW
WORK ORDER NO.:	276496	CHECKED BY:	YL
SHEET NUMBER:	<b>TP446</b>		
DWG. NO.:	22	OF	22
SHT. NO.:	447	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-TP446	REV. NO.:	-

50% SUBMISSION  
NOT FOR CONSTRUCTION


DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

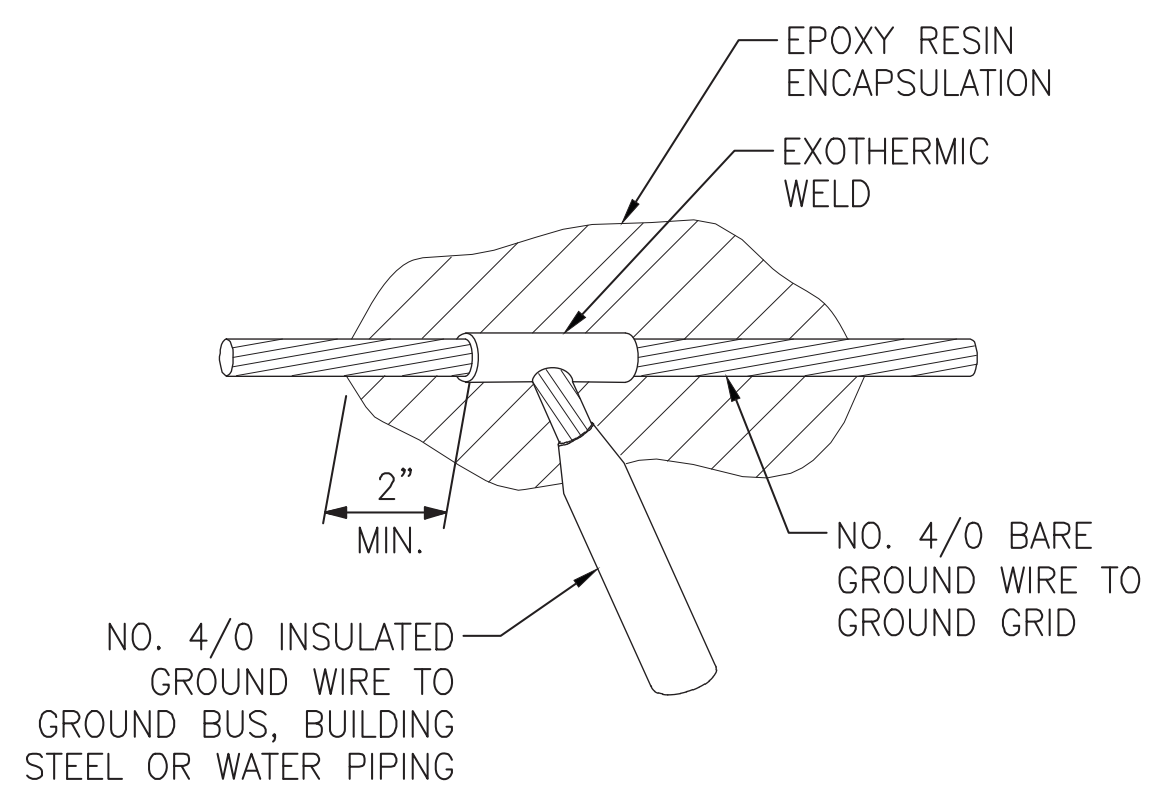


**1** GROUND GRID EXOTHERMIC WELD CONNECTION WITH MOISTURE SEAL  
TP446 SCALE: NONE

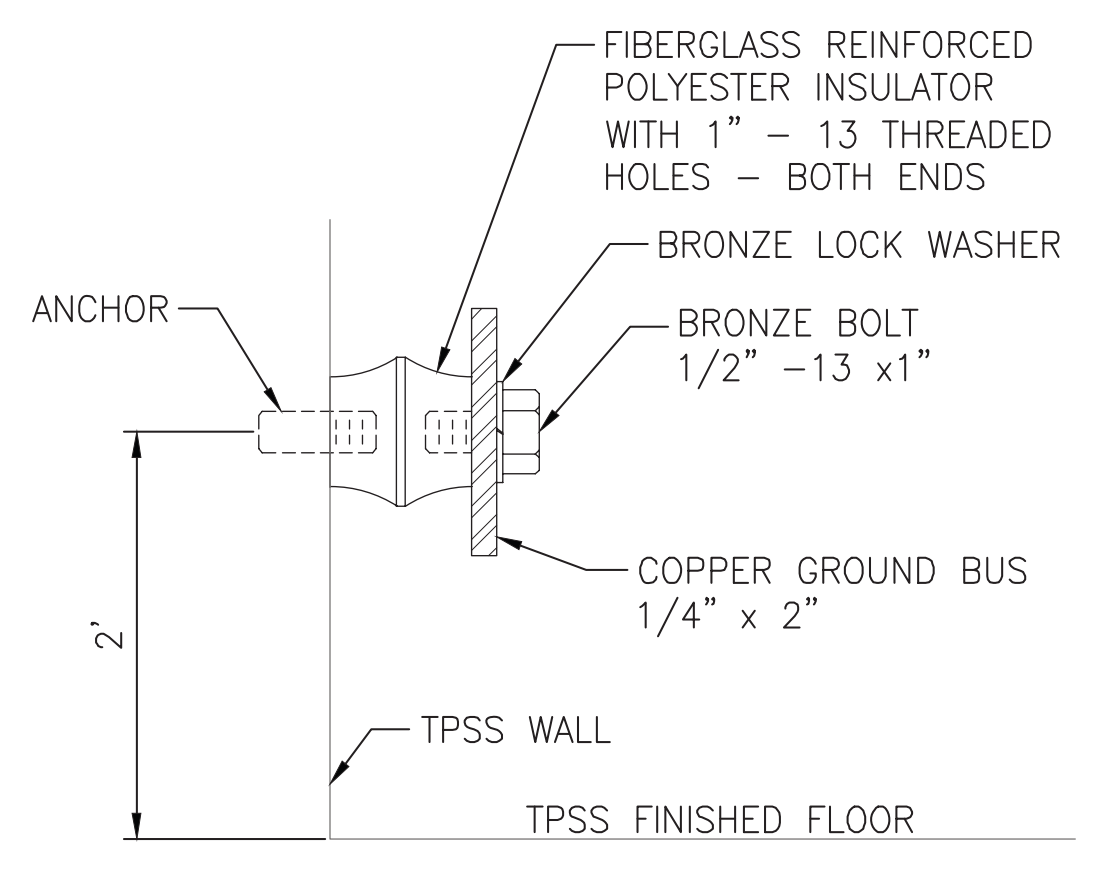



**2** GROUND BUS MOUNTING  
TP446 SCALE: NONE

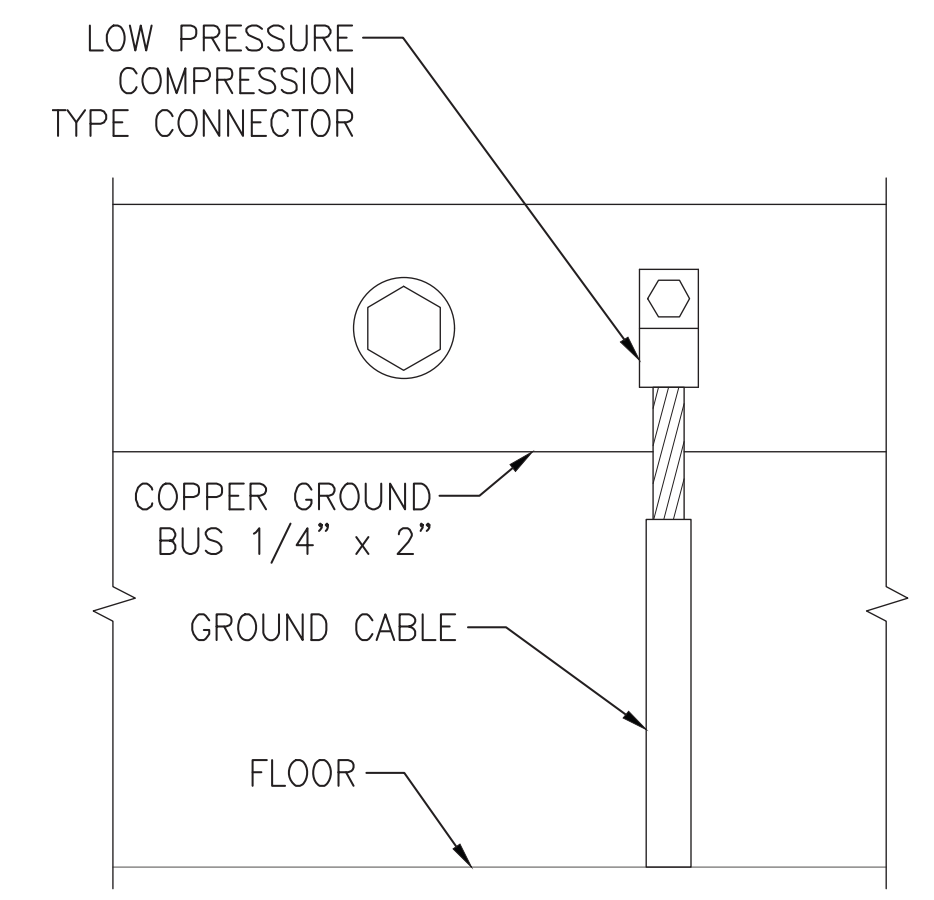


**3** GROUND BUS CONNECTION FOR CAST IN CONCRETE SLAB GROUND WIRE AT AC SWITCHGEAR, RECTIFIER TRANSFORMER  
TP446 SCALE: NONE

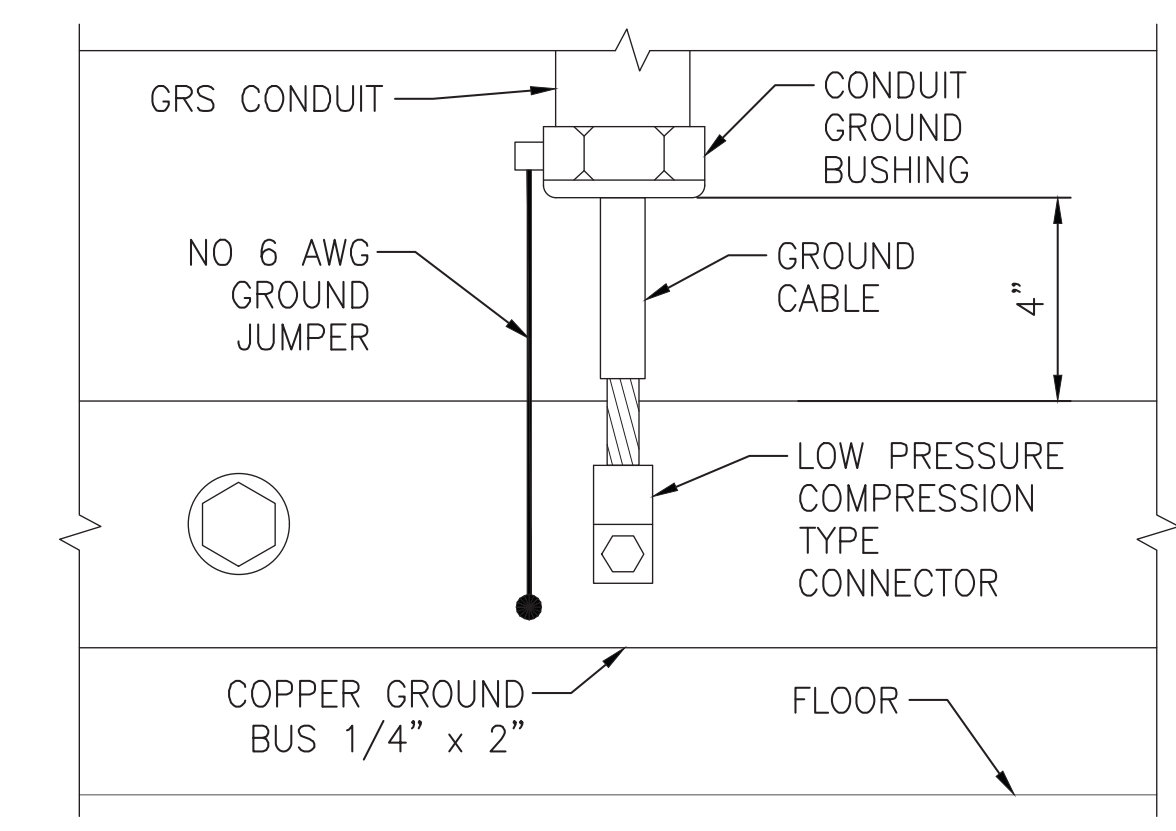


**4** GROUND BUS CONNECTION IN EXPOSED GRS CONDUIT FOR EQUIPMENT GROUNDING  
TP446 SCALE: NONE

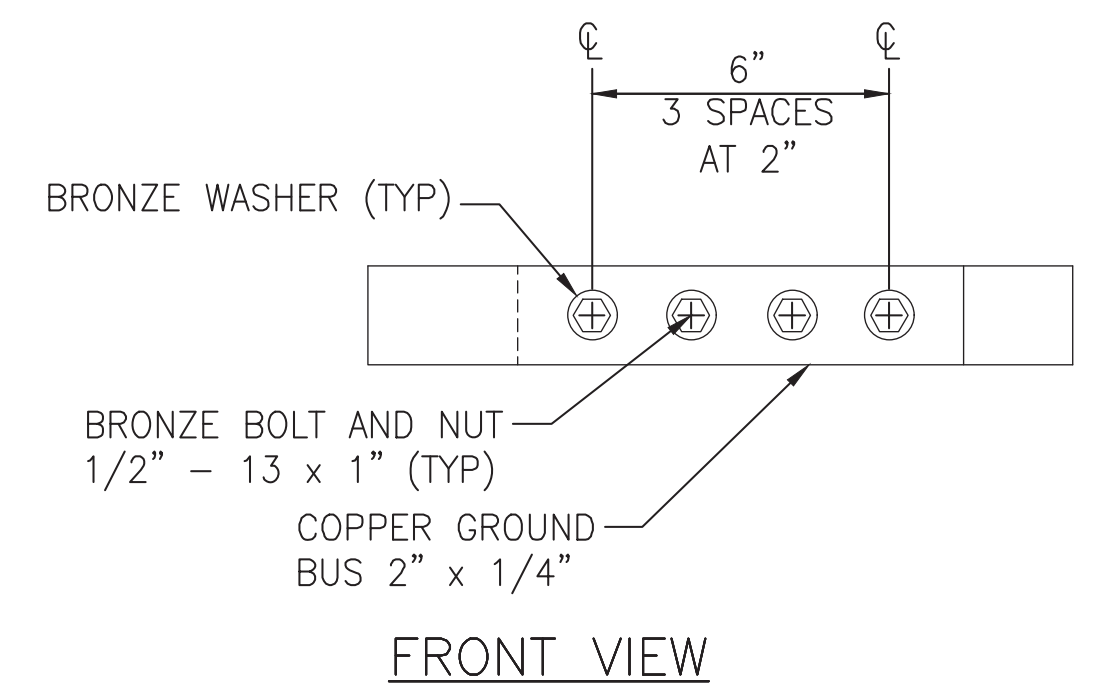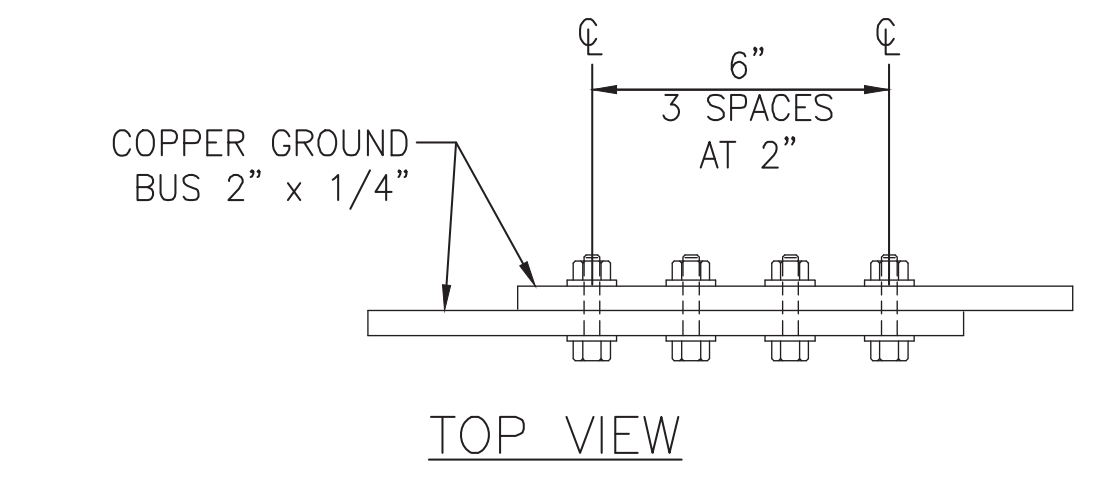

**5** GROUND BUS SPLICE JOINT  
TP446 SCALE: NONE

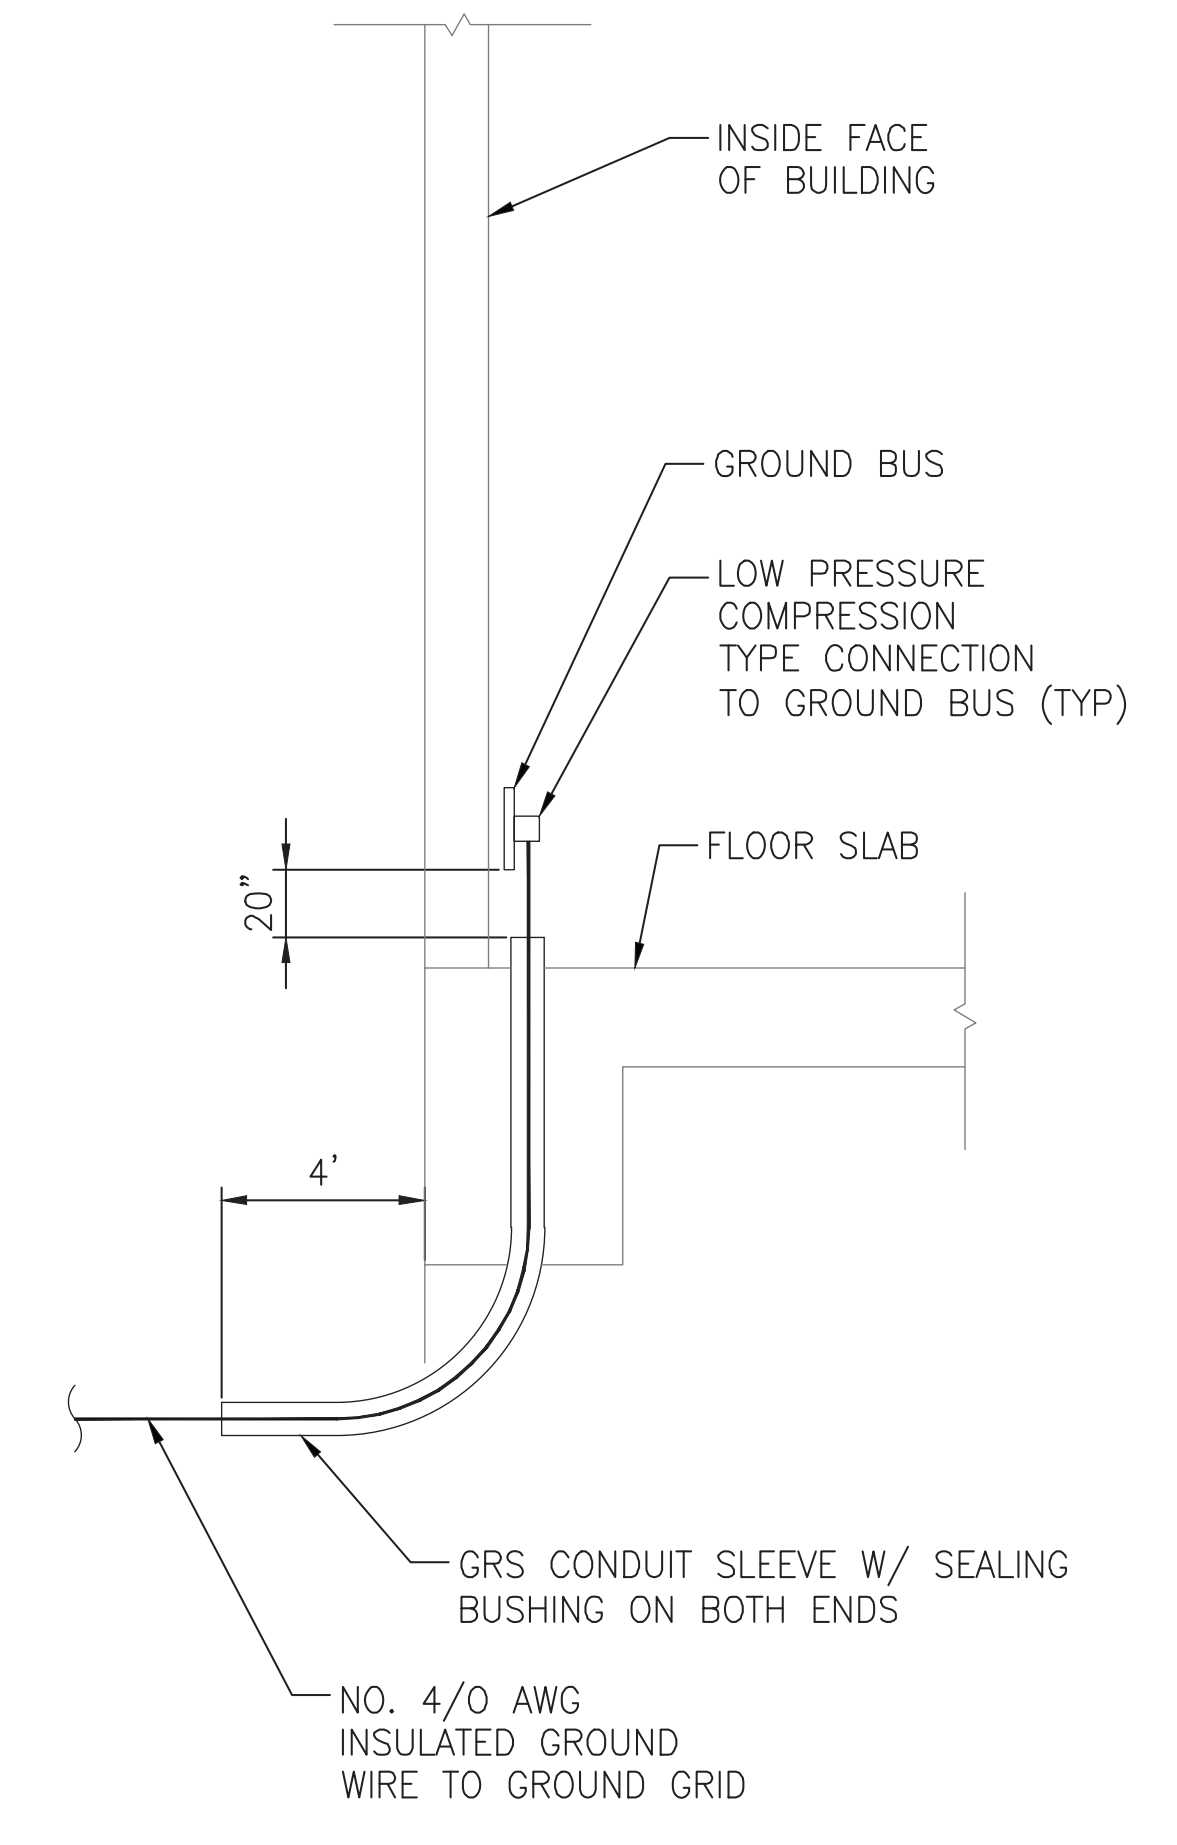

**6** GROUND WIRE ROUTING FROM GROUND GRID TO GROUND BUS  
TP446 SCALE: NONE

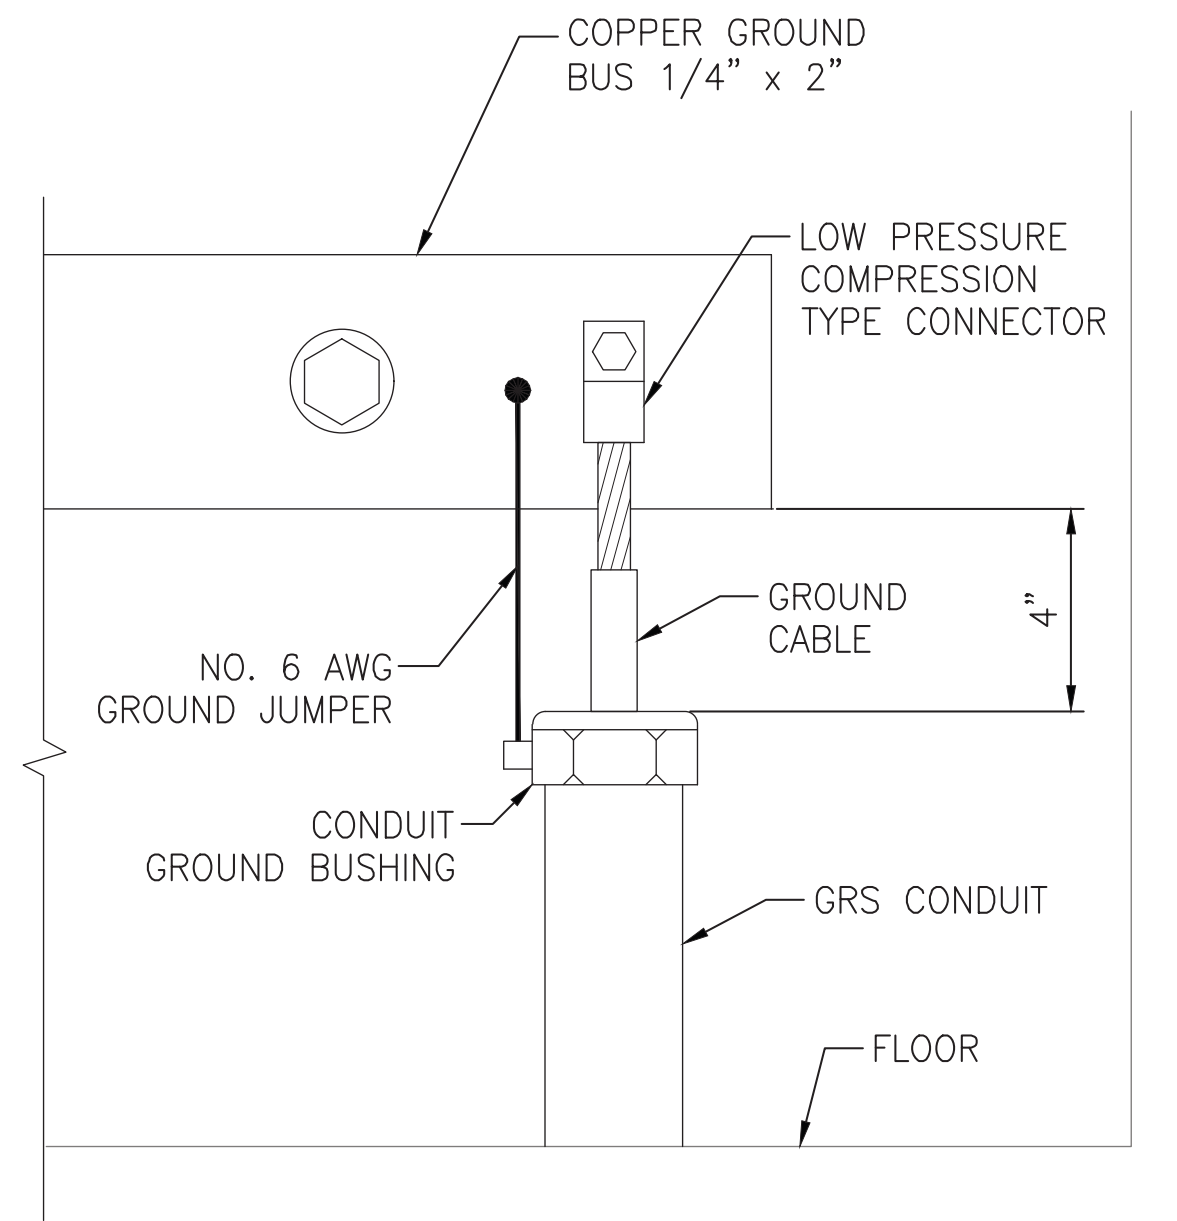

**7** GROUND BUS CONNECTIONS FROM GROUND GRID  
TP446 SCALE: NONE


C:\P\WORKING\PTTD\196236517AN\TP446.DWG



REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**COMMUNICATIONS**  
DEMOLITION FLOOR PLAN

SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	10/16/2017	DRAWN BY:	DC
WORK ORDER NO.:	276496	CHECKED BY:	EH
SHEET NUMBER:	<b>COM401</b>		
DWG. NO.:	2	OF	6
SHT. NO.:	448	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-COM401	REV. NO.:	

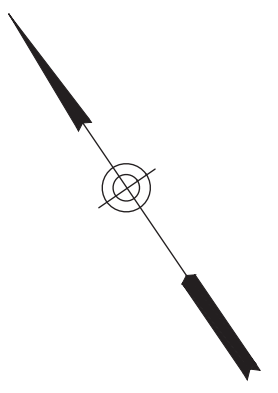


**GENERAL NOTES:**


- FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS REFER TO DRAWING COM400.
- REMOVE ALL CONDUITS, CABLES, STATION JACKS AND BOXES RELATED TO TELECOMMUNICATIONS TO SOURCE.
- DISCARD ALL REMOVED EQUIPMENT.

**KEYED NOTES:**

- REMOVE PHONE, CABLE AND ASSOCIATED APPURTENANCES TO SOURCE.
- REMOVE DOOR CONTACT, CONDUIT AND WIRING BACK TO SOURCE.
- EXISTING TELECOM DEMARCATION BOX. REMOVE BOX AND PUNCH DOWN BLOCKS. REMOVE INCOMING PHONE SERVICE CABLE BACK TO EXTERIOR DEMARCATION BOX. PATCH HOLE IN THE WALL.
- EXISTING DOOR INTRUSION ALARM PANEL AND ASSOCIATED EQUIPMENT AND WIRING TO BE REMOVED.
- EXISTING BUILDING COPPER DEMARCATION BOX TO REMAIN.

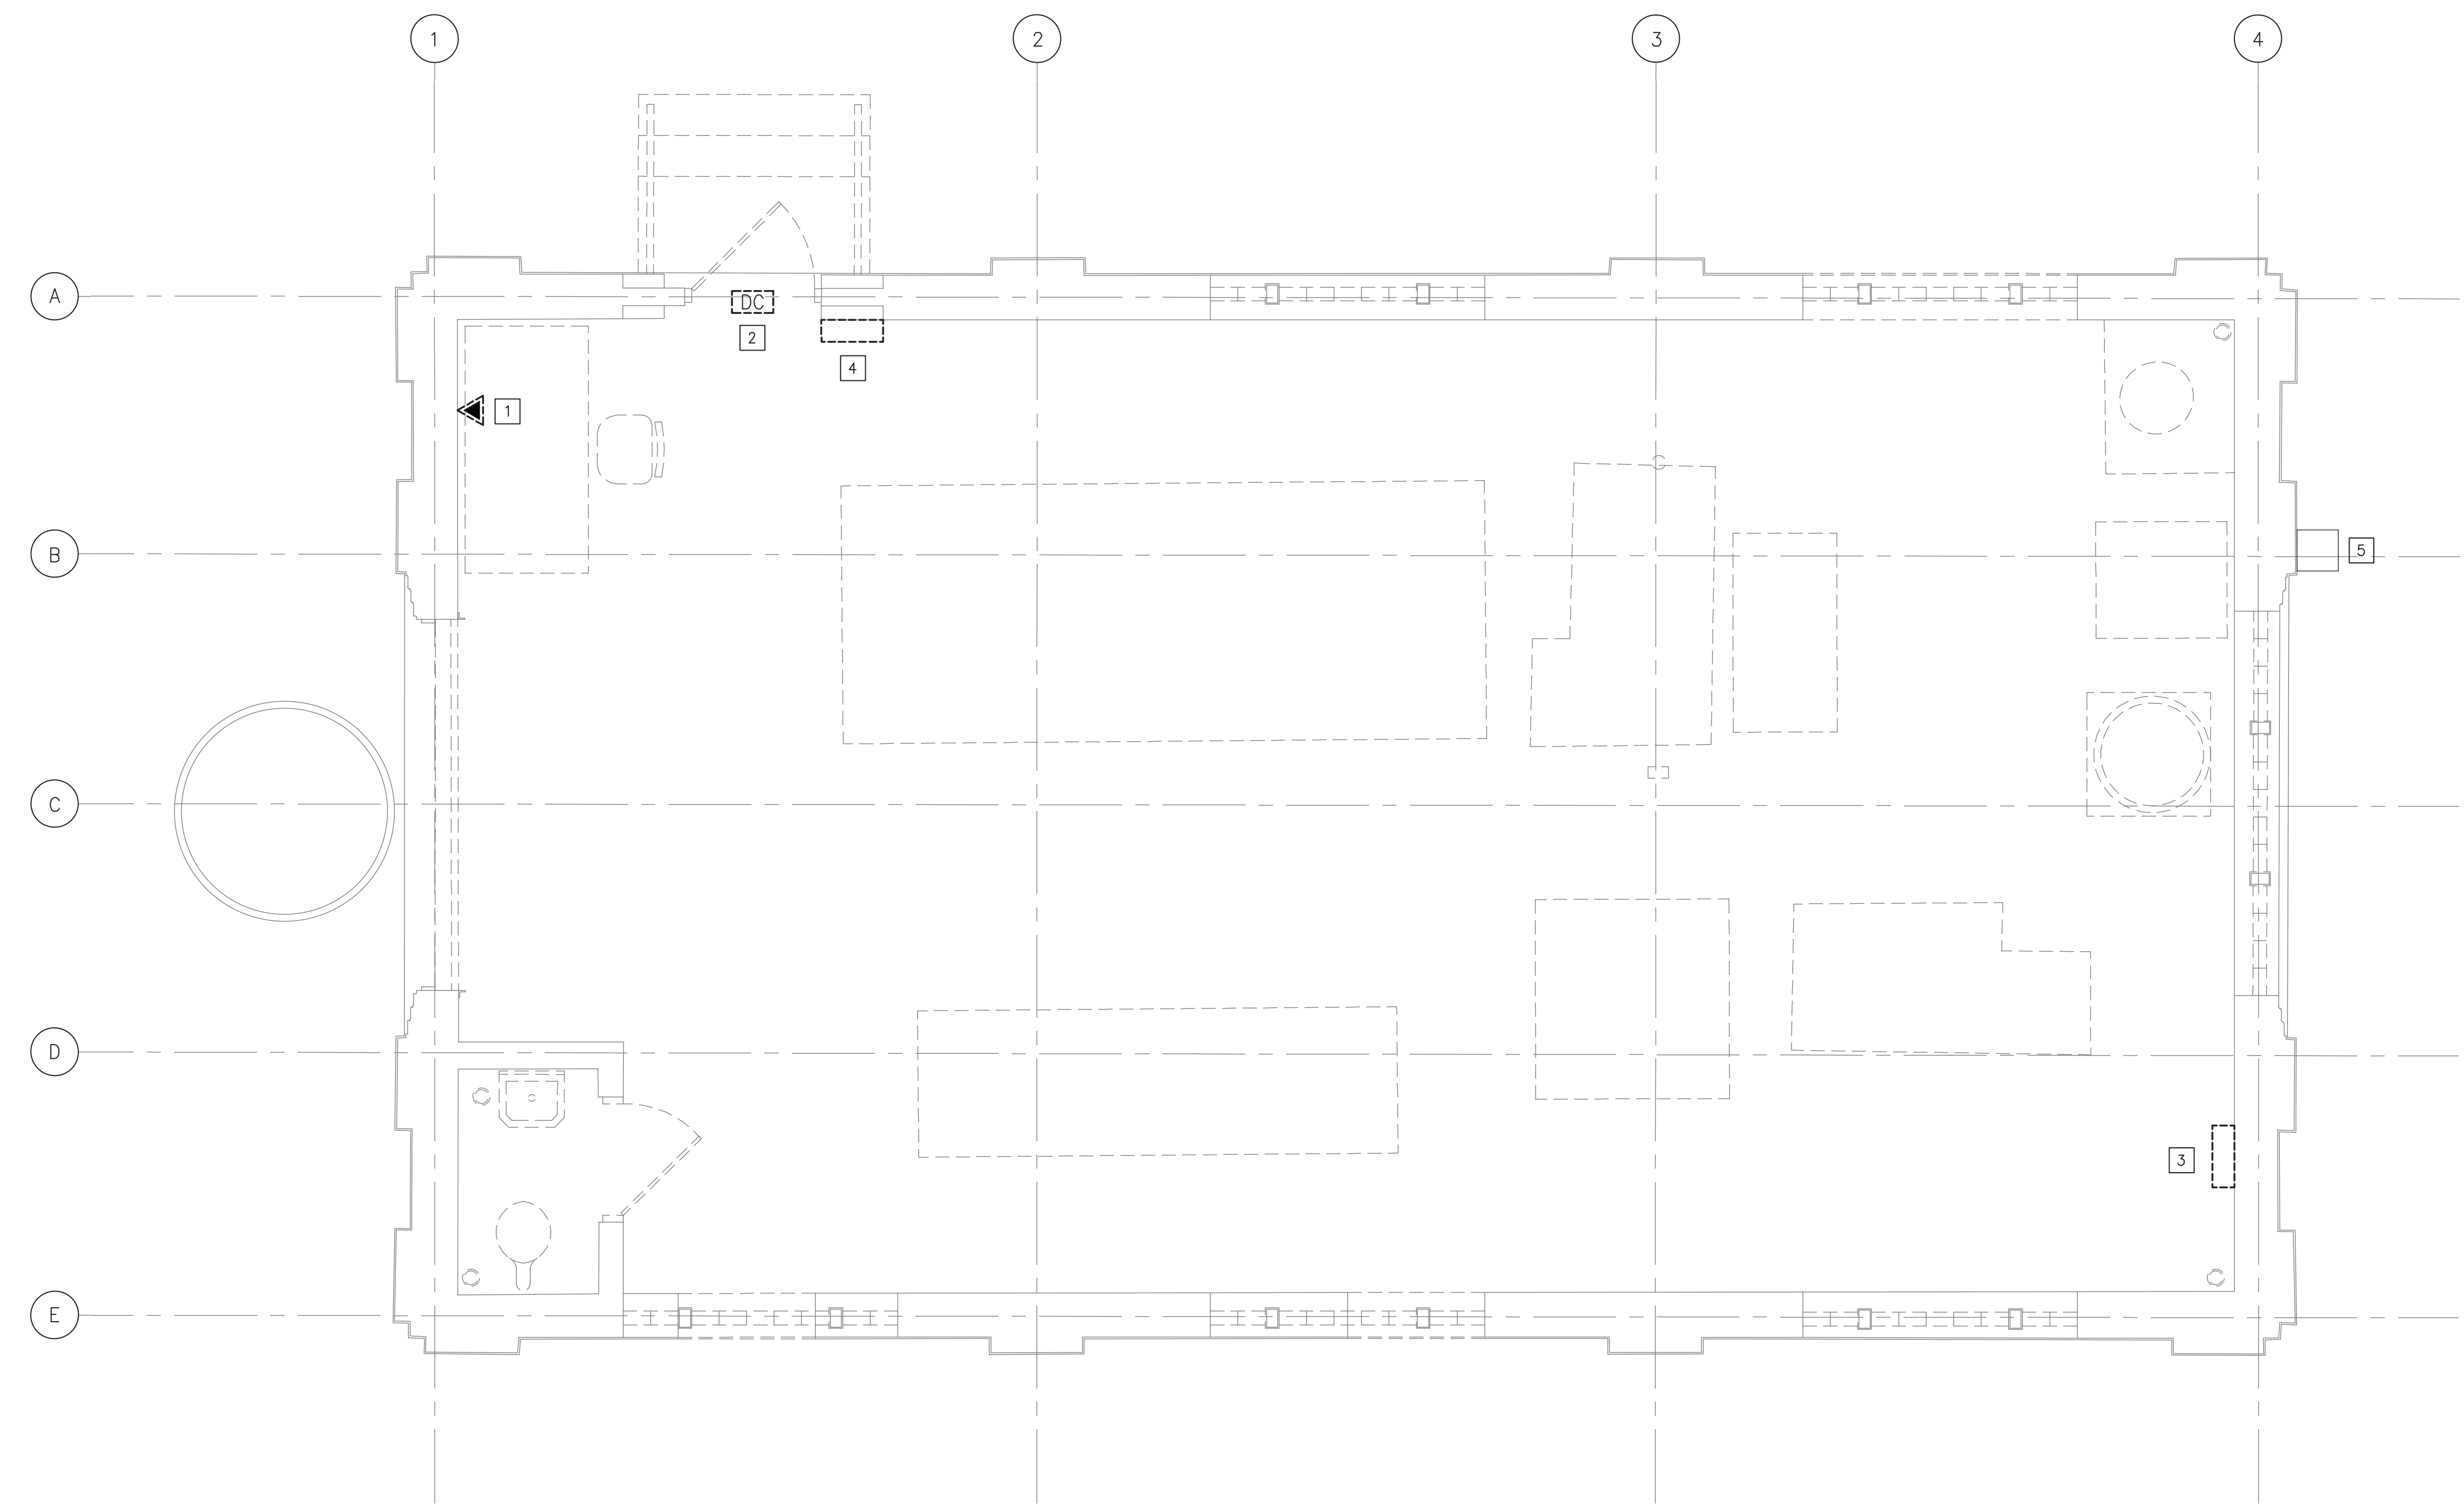

**1**  
COM401  
EXISTING BUILDING PLAN  
SCALE: 3/8" = 1'-0"

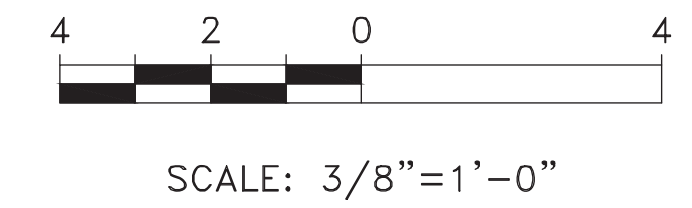

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**


C:\P\WORKING\PTD\1957245\17AN-COM401.DWG

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**COMMUNICATIONS**  
PROPOSED FLOOR PLAN

SCALE: AS SHOWN	SCALE FACTOR: 1:1
DATE: 10/16/2017	DRAWN BY: DC CHECKED BY: EH
WORK ORDER NO: 276496	SHEET NUMBER: <b>COM402</b>
DWG. NO.: 3 OF 6	SHT. NO.: 449 OF 452
ARCHIVE NO.:	REV. NO.: 1
COMPUTER FILE NO.: 17AN-COM402	REV. NO.:

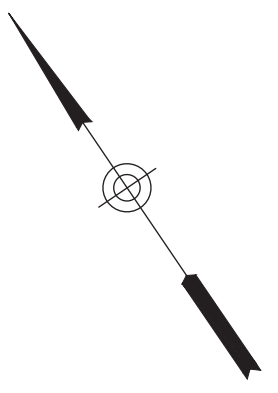


**GENERAL NOTES:**


- FOR GENERAL NOTES, SYMBOLS AND ABBREVIATIONS REFER TO DRAWING COM400.
- COORDINATE ALL FINAL LOCATIONS, MOUNTING HEIGHTS & DETAILS AND EQUIPMENT QUANTITIES WITH SEPTA C&S. ENSURE CAMERA LINE OF SIGHT.

**KEYED NOTES:**

- INTRUSION DETECTION PANEL. ALL COMPONENT CABLING SHALL BE IN MINIMUM OF 3/4" RGS CONDUIT. PROGRAM SYSTEM PER SPECIFICATION 13700.
- FURNISH AND INSTALL NEW 13U WALL MOUNTED, LOCKABLE CABINET. FURNISH AND INSTALL FOLLOWING COMPONENTS PER SPECIFICATION:
  - RIGID PC.
  - CAT 6 PATCH PANEL.
  - 2200VA UPS.
 MOUNT ABOVE DESK. COORDINATE FINAL EQUIPMENT LIST WITH SEPTA C&S.
- FURNISH AND INSTALL A 12 POSITION TERMINAL BLOCK HOUSED IN A LOCKABLE 8" X 8" X 4" NEMA 3R ENCLOSURE. EXTEND SIGNAL CABLE FROM THE IDS PANEL AND TERMINATE ON TERMINAL BLOCK FOR IDS MONITORING. COORDINATE FINAL CONNECTION TO RTU.
- NEW TELEPHONE SHALL UTILIZE THE EXISTING INCOMING SERVICE CONNECTION. ALL CABLE SHALL BE IN MINIMUM 3/4" RGS CONDUIT. INSTALL (N) CAT 6 CABLE TO (N) TERMINATION 110 BLOCK IN (N) BUILDING ENTRANCE TERMINAL.
- BUILDING ENTRANCE TERMINAL WITH LIGHTNING PROTECTION AND 110 TELEPHONE BLOCK FOR APPROPRIATE PAIR COUNT IN A LOCKABLE NEMA 3R ENCLOSURE. EXTEND EXISTING SERVICE CABLE FROM EXTERIOR DEMARICATION BOX TO THIS NEW ENCLOSURE.
- DESK MOUNTED 22" LCD DISPLAY MONITOR CAPABLE OF DVI INPUT 1920X1080 RESOLUTION. PROVIDE WIRE MOLD TO UNDERNEATH DESK TO CONCEAL AND PROTECT DVI CABLE.
- KEYBOARD AND MOUSE.

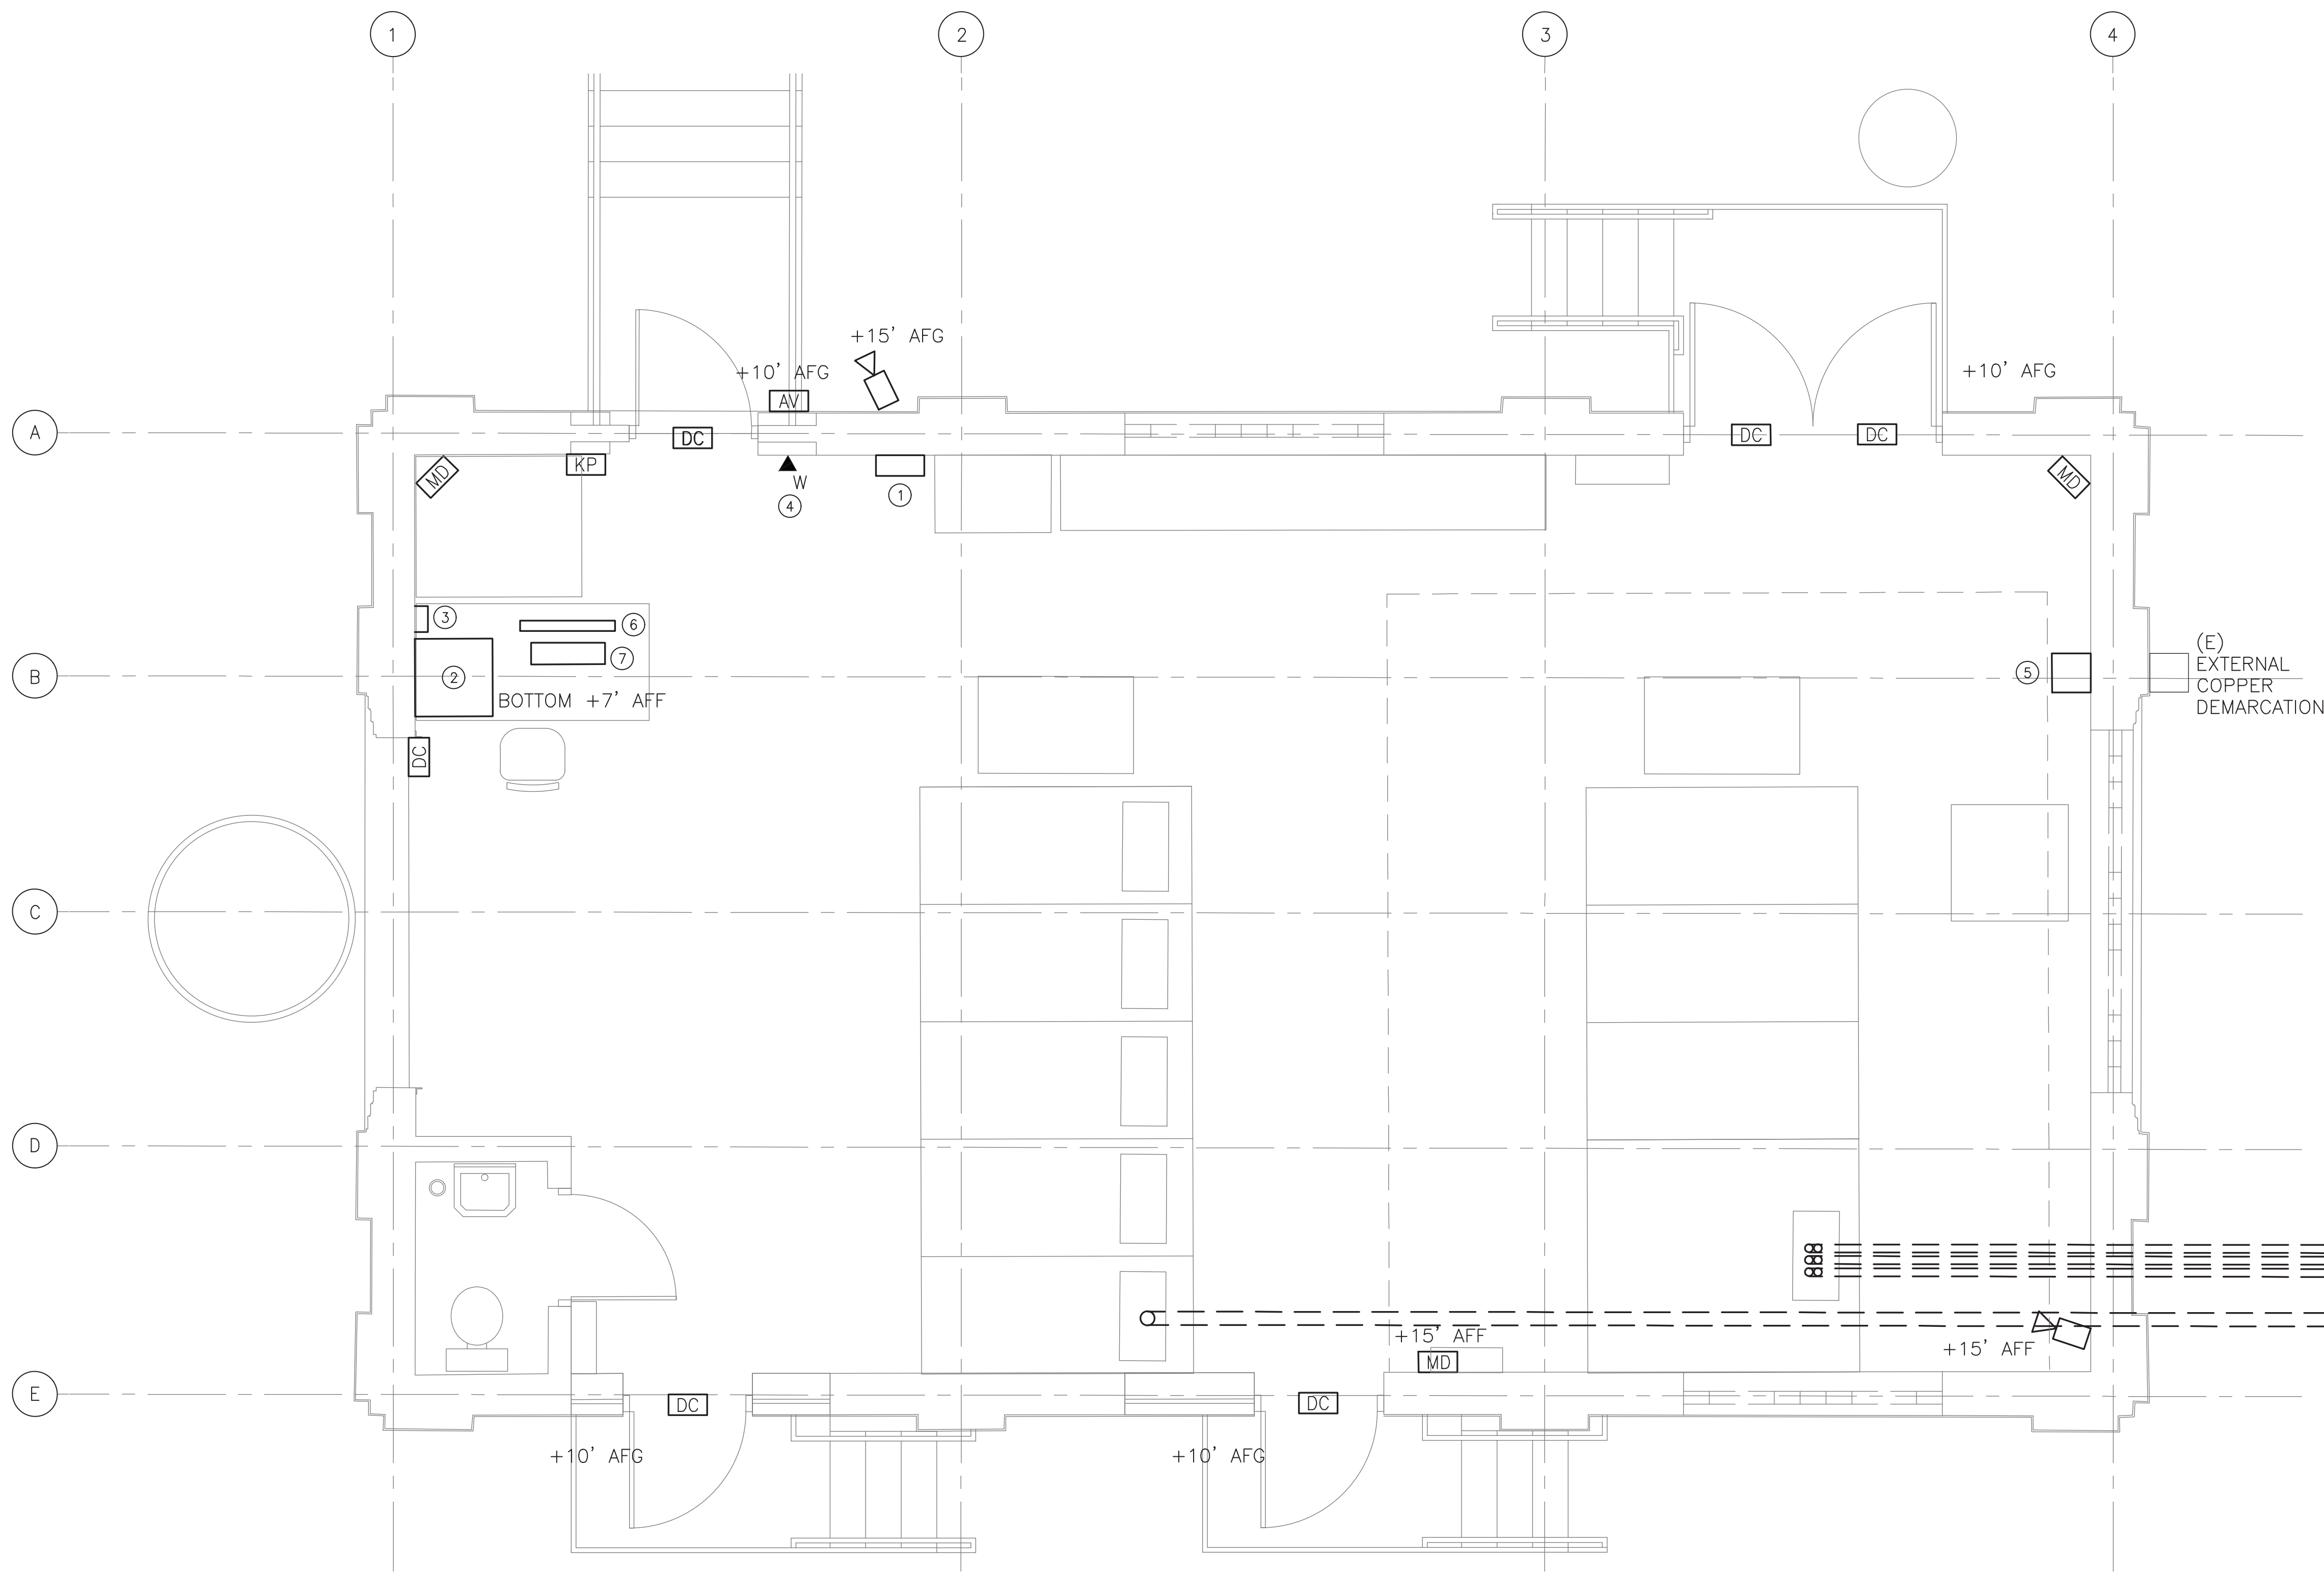

**1**  
**COM402**  
**BUILDING PLAN**  
SCALE: 3/8" = 1'-0"

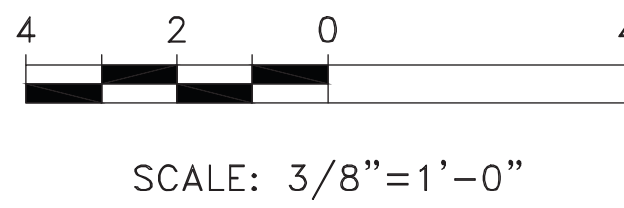

**50% SUBMISSION**  
**NOT FOR CONSTRUCTION**

C:\P\WORKING\PTD\1957245\17AN-COM402.DWG


DATE PRINTED: 10/21/2015  
STATUS: 50% SUBMISSION

REV	DATE	DESCRIPTION	BY	CKD	APD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**COMMUNICATIONS**  
INTERFACE CABINET & CABLE PLANS

SCALE:	AS SHOWN	SCALE FACTOR:	-
DATE:	10/16/2017	DRAWN BY:	M&B
WORK ORDER NO.:	276496	CHECKED BY:	EEZ
SHEET NUMBER:	<b>COM403</b>	COMPUTER FILE NO.:	17AN-COM403
DWG. NO.:	4	OF	6
SHT. NO.:	450	OF	452
ARCHIVE NO.:		REV. NO.:	

- NOTES:
1. GRAYSCALE ITEMS ON THIS DRAWING TO REMAIN.
  2. BOLD ITEMS ON THIS DRAWING ARE NEW.
  3. REMOVE EXISTING COMMUNICATION CABLES, CONDUITS AND EQUIPMENT ONCE NEW PRODUCTS ARE INSTALLED AND TESTED AS FUNCTIONAL.
  4. PULL TO NEW OUTDOOR INTERFACE CABINET NEW FIBER OPTIC CABLE (BY SEPTA).

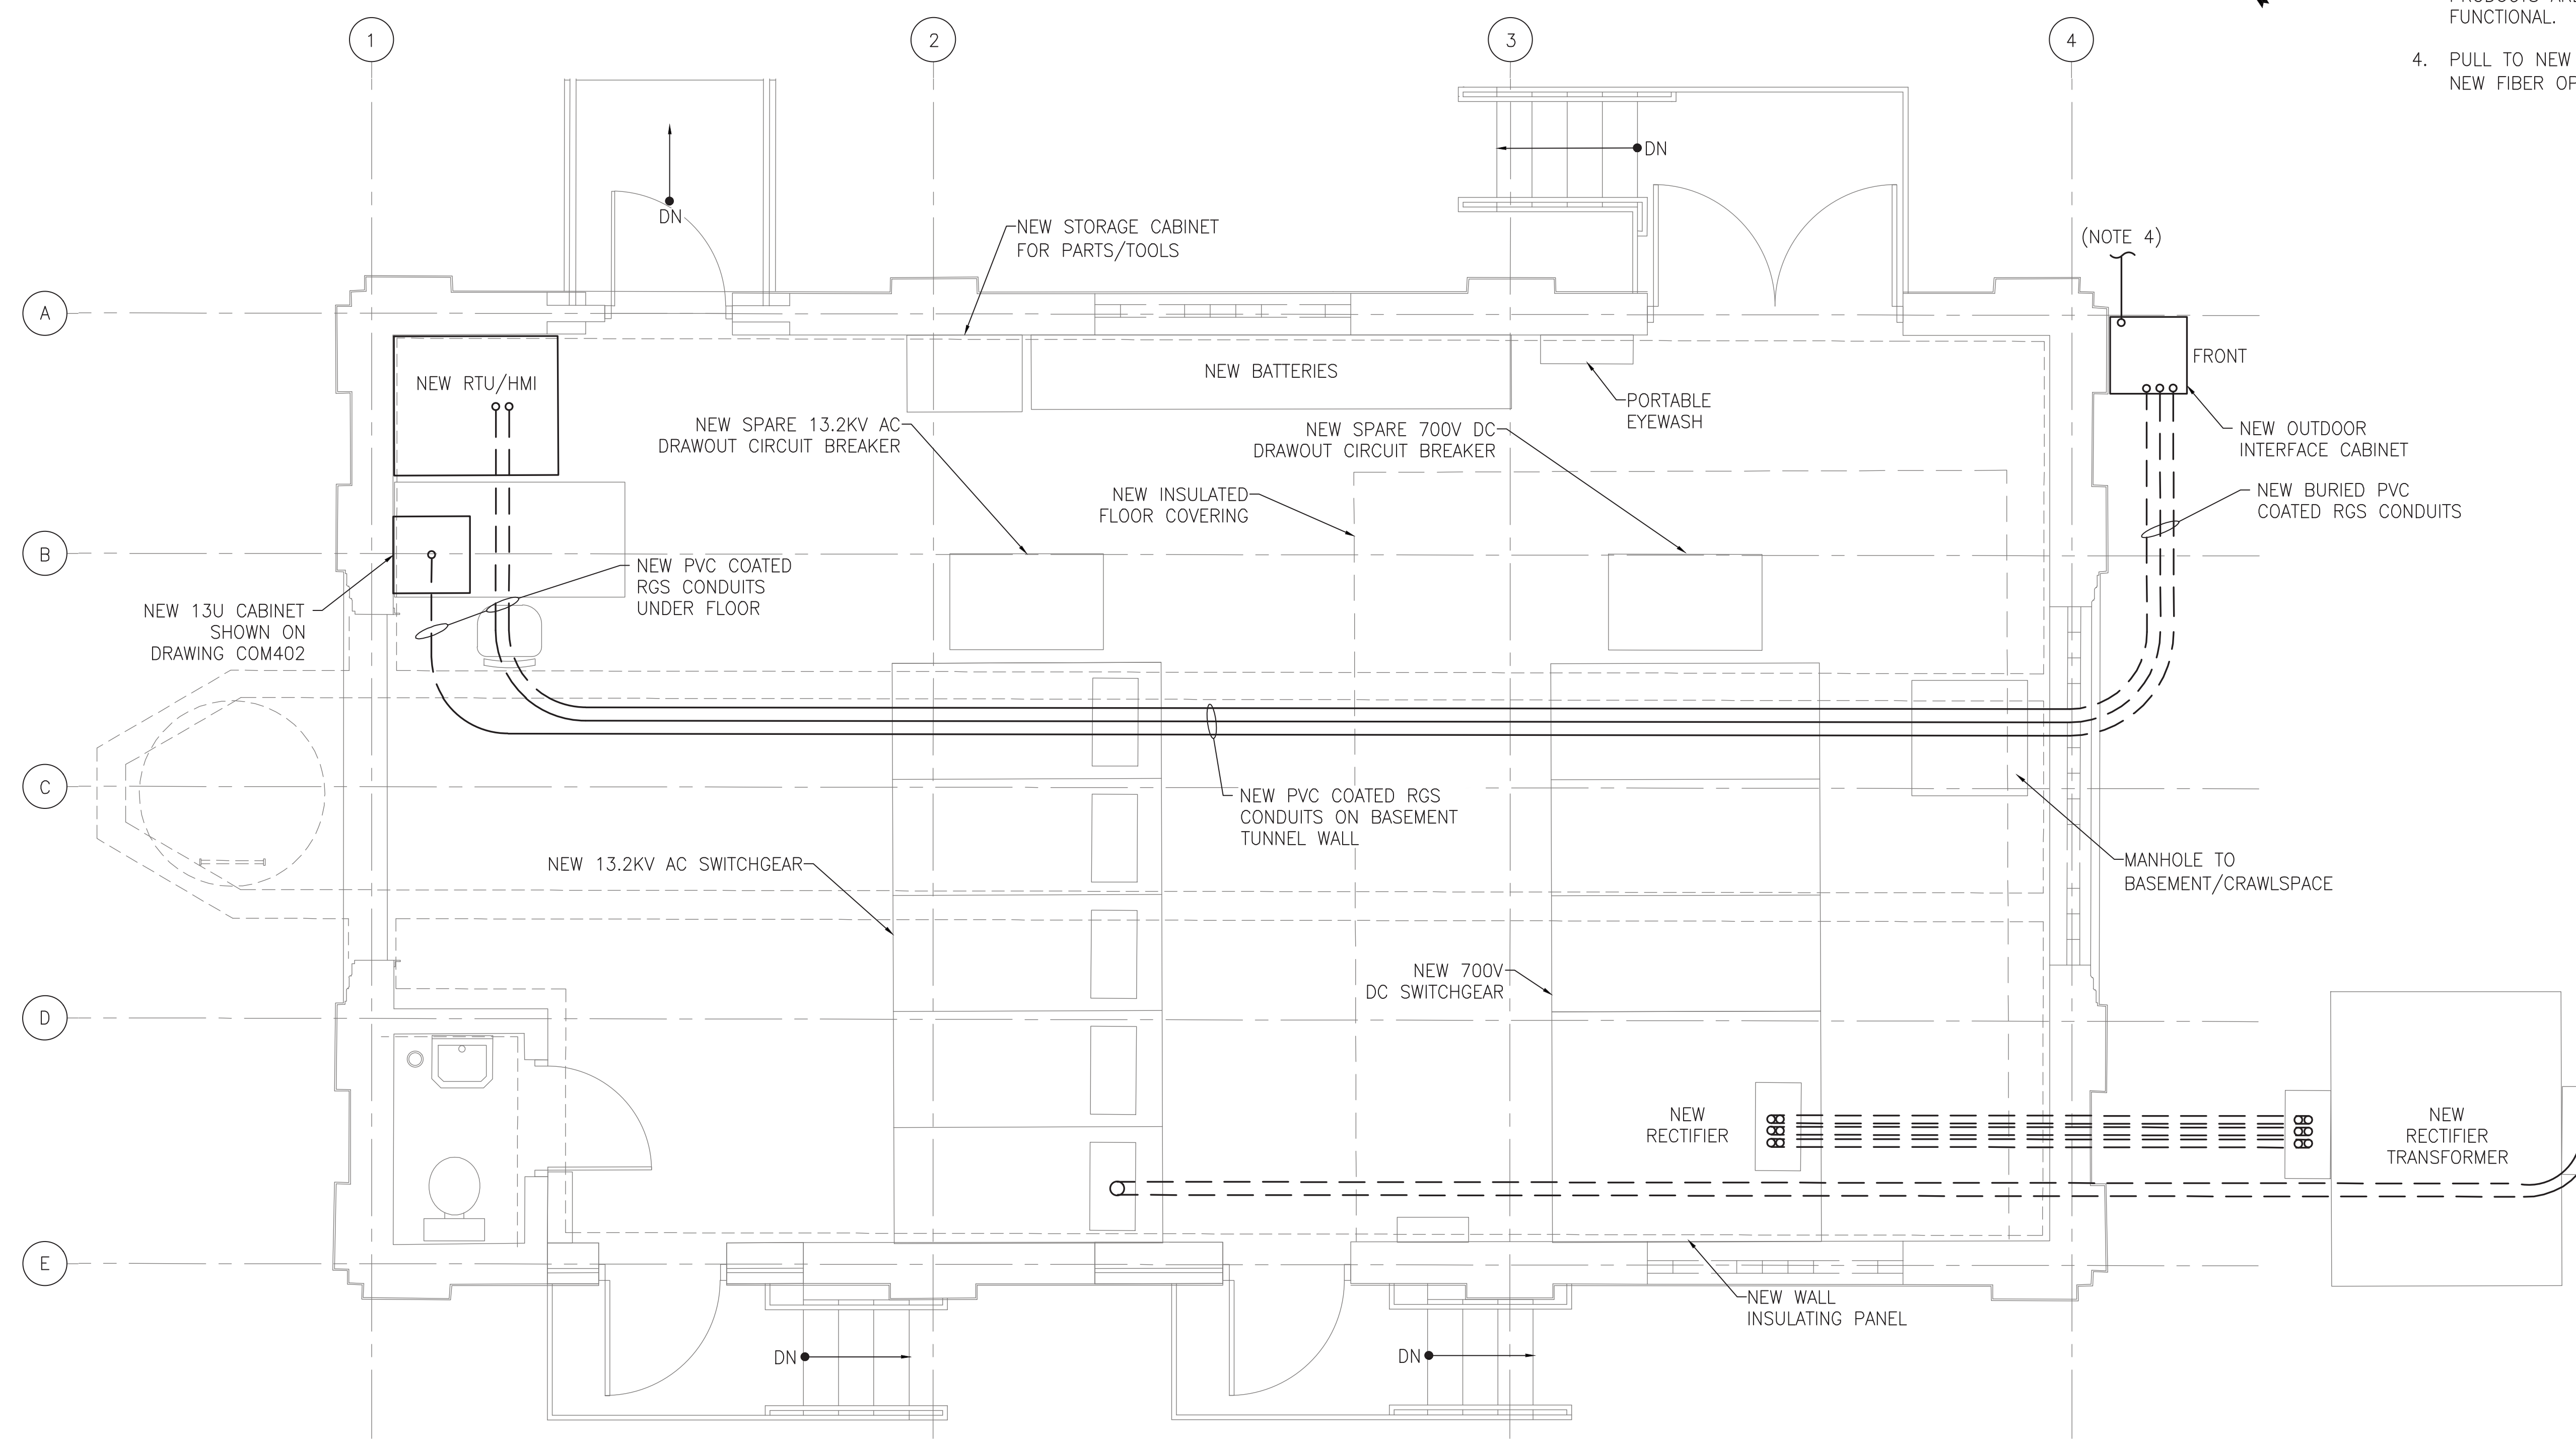

50% SUBMISSION  
NOT FOR CONSTRUCTION

C:\PI\WORKING\PTD\1957215\17AN-COM403.DWG

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION


REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
TRACTION POWER SUBSTATION  
REHABILITATION  
COMMUNICATIONS  
SINGLE LINE DIAGRAM


SCALE:	AS SHOWN	SCALE FACTOR:	1:1
DATE:	10/16/2017	DRAWN BY:	DC
WORK ORDER NO.:	276496	CHECKED BY:	EH
SHEET NUMBER:	<b>COM404</b>		
DWG. NO.:	5	OF	6
SHT. NO.:	451	OF	452
ARCHIVE NO.:			
COMPUTER FILE NO.:	17AN-COM404	REV. NO.:	----

**KEYED NOTES:**


- COORDINATE ALL HARDWARE AND FINAL QUANTITIES WITH SEPTA C&S.
- FURNISH AND INSTALL GENETIC PRO BASE SOFTWARE ON PC, (1) CAMERA LICENSE PER CAMERA AND (1) FEDERATION LICENSE FOR THE SITE.
- THE CONTRACTOR SHALL FURNISH AND INSTALL SIGNAL CABLE FROM IDS PANEL TO TERMINATION BLOCK. COORDINATE CONNECTION TO RTU.
- REFER TO DRAWING COM402 FOR PROPER QUANTITIES. UTILIZE CMX OUTDOOR JACKET FOR OUTDOOR CAMERAS. OUTDOOR CABLE MAY NOT EXCEED 50' INSIDE BUILDING.
- ALL MULTI-CONDUCTOR CABLE SHALL BE IN 3/4" RGS. ALL SECURITY CABLE SHALL BE LOW IMPEDANCE AND A MINIMUM OF NO. 18 AWG CONDUCTOR SIZE. CONDUCTOR QUANTITIES ARE PER MANUFACTURER'S SPECIFICATION.
- NETWORK ADDRESSABLE UPS. APPROXIMATELY 2200 VA AND SHALL LAST MINIMUM 70 MINUTES. PHYSICAL SIZE SHALL MAINTAIN 2 RACK UNITS SPACE WITH NECESSARY BATTERY PACK QUANTITIES.
- REFER TO DRAWING COM402 FOR PROPER QUANTITIES.
- REFER TO TRACTION POWER DRAWINGS FOR SCADA RTU CONNECTION DETAILS.
- COPPER TO FIBER MEDIA CONVERTER ON RACK MOUNT SHELF CONNECT CCTV PC FOR CONNECTIVITY OVER SEPTA'S FIBER NETWORK. FINAL FIBER CONNECTION BY SEPTA.
- COORDINATE FINAL RACK LAYOUT WITH SEPTA C&S.

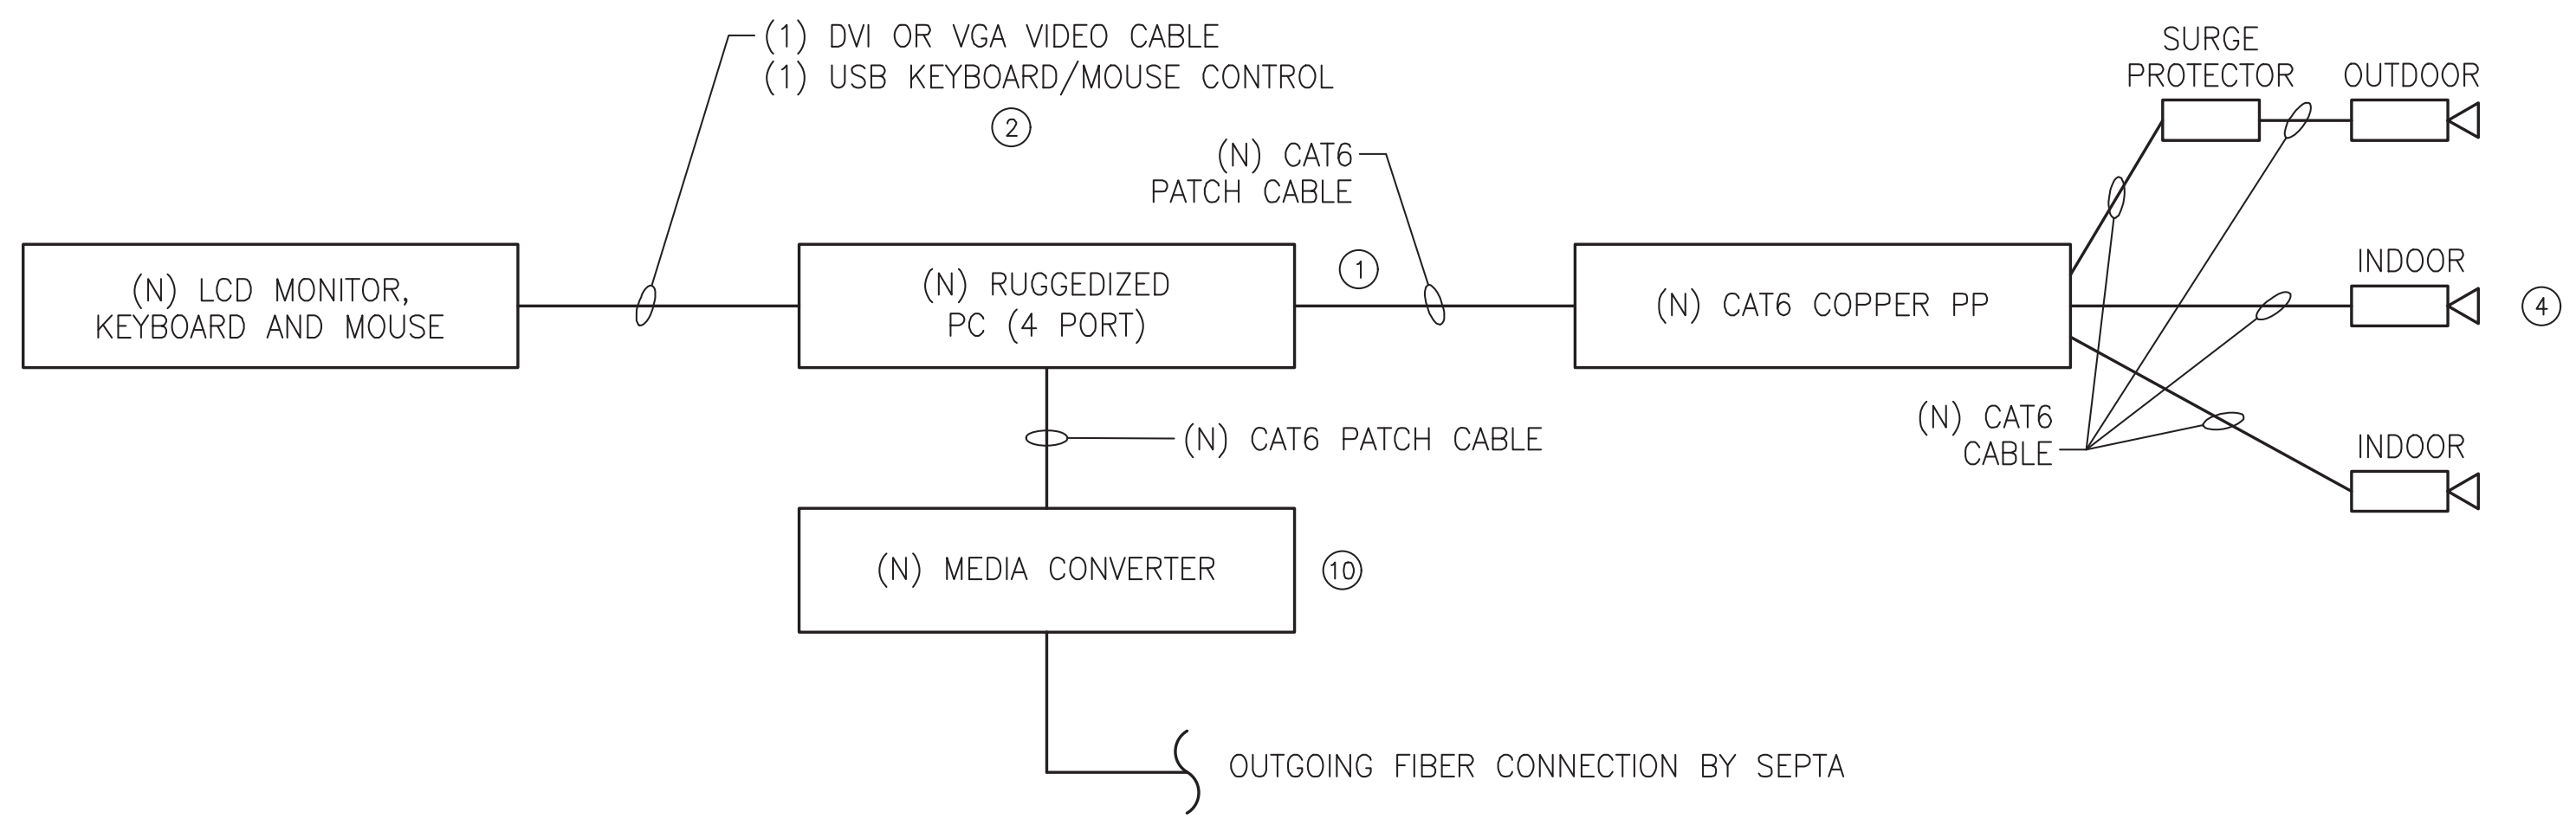


**1**  
COM404  
**CCTV BLOCK DIAGRAM**  
SCALE: NOT TO SCALE

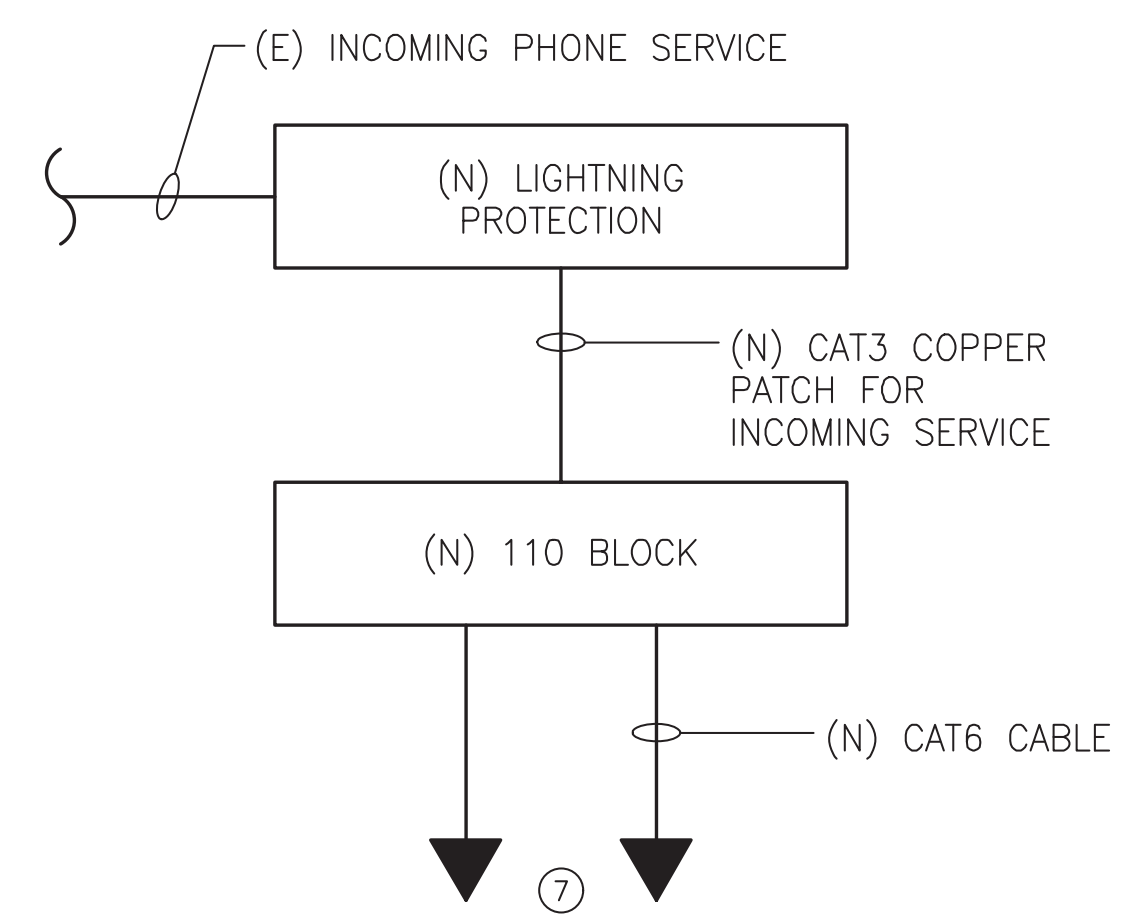

**2**  
COM404  
**VOICE BLOCK DIAGRAM**  
SCALE: NOT TO SCALE

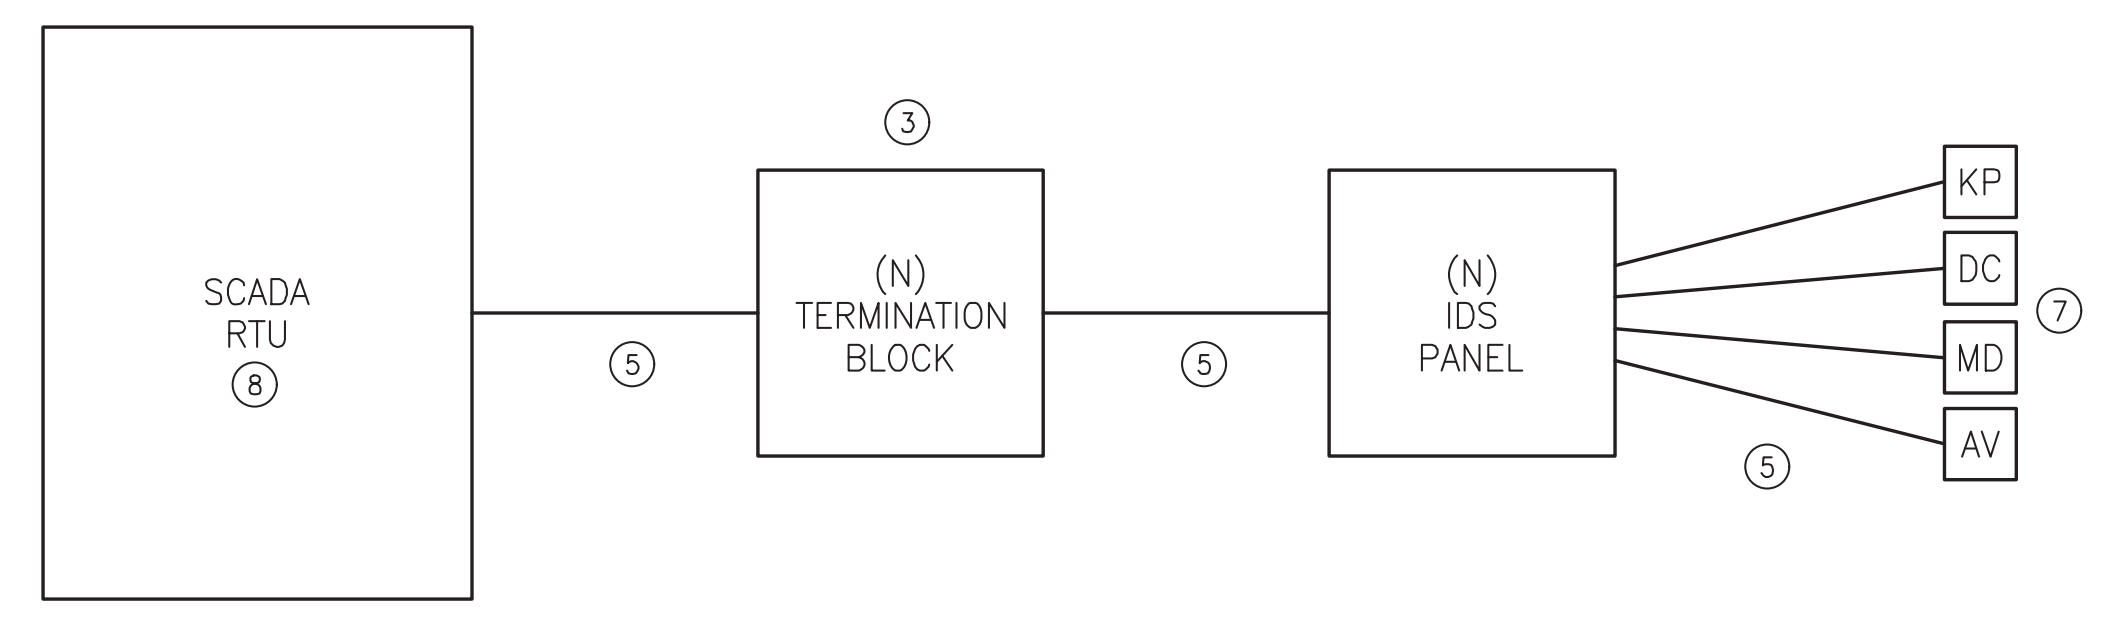

**3**  
COM404  
**INTRUSION DETECTION BLOCK DIAGRAM**  
SCALE: NOT TO SCALE

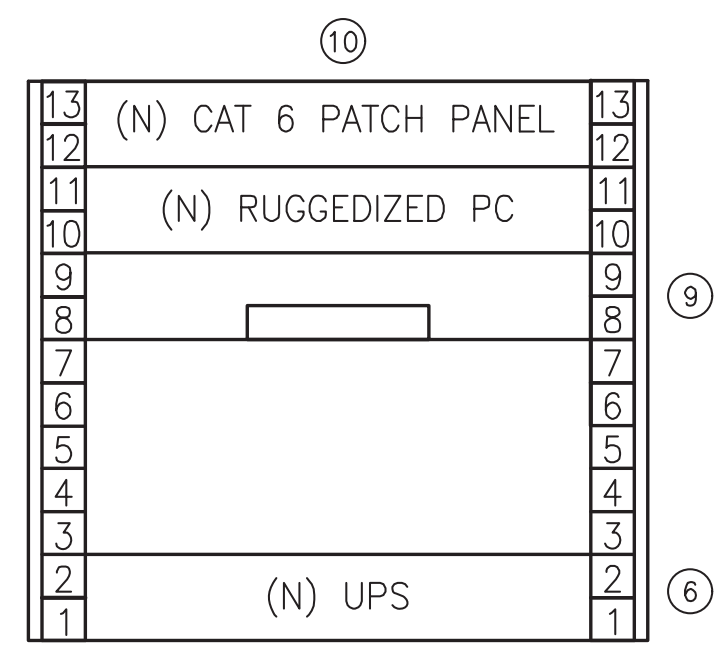

**4**  
COM404  
**TELECOM CABINET ELEVATION**  
SCALE: NOT TO SCALE


**50% SUBMISSION  
NOT FOR CONSTRUCTION**

REV	DATE	DESCRIPTION	BY	CHKD	APPD

**CASTOR**  
ROUTE 59 TROLLEY LINE  
**TRACTION POWER SUBSTATION**  
**REHABILITATION**  
**COMMUNICATIONS**  
FIBER NODE DIAGRAM

SCALE: NTS	SCALE FACTOR: -
DATE: 10/16/2017	DRAWN BY: ARG CHECKED BY: EZ
WORK ORDER NO: 276496	
SHEET NUMBER <b>COM407</b>	
DWG. NO.: 6 OF 6	SHT. NO.: 452 OF 452
ARCHIVE NO.:	REV. NO.:
COMPUTER FILE NO.: 17AN-COM407	REV. NO.:

- NOTES:
- CABINET ARRANGEMENT TO BE FRONT ACCESS ONLY FOR ENCLOSED TIA/EIA 19" RACK.
  - REMOVE EXISTING COMMUNICATION CABLES, CONDUITS AND EQUIPMENT ONCE NEW PRODUCTS ARE INSTALLED AND TESTED AS FUNCTIONAL.
  - BOLD ITEMS ON THIS DRAWING ARE NEW.
  - GRAYSCALE ITEMS ON THIS DRAWING TO BE DEMOLISHED.

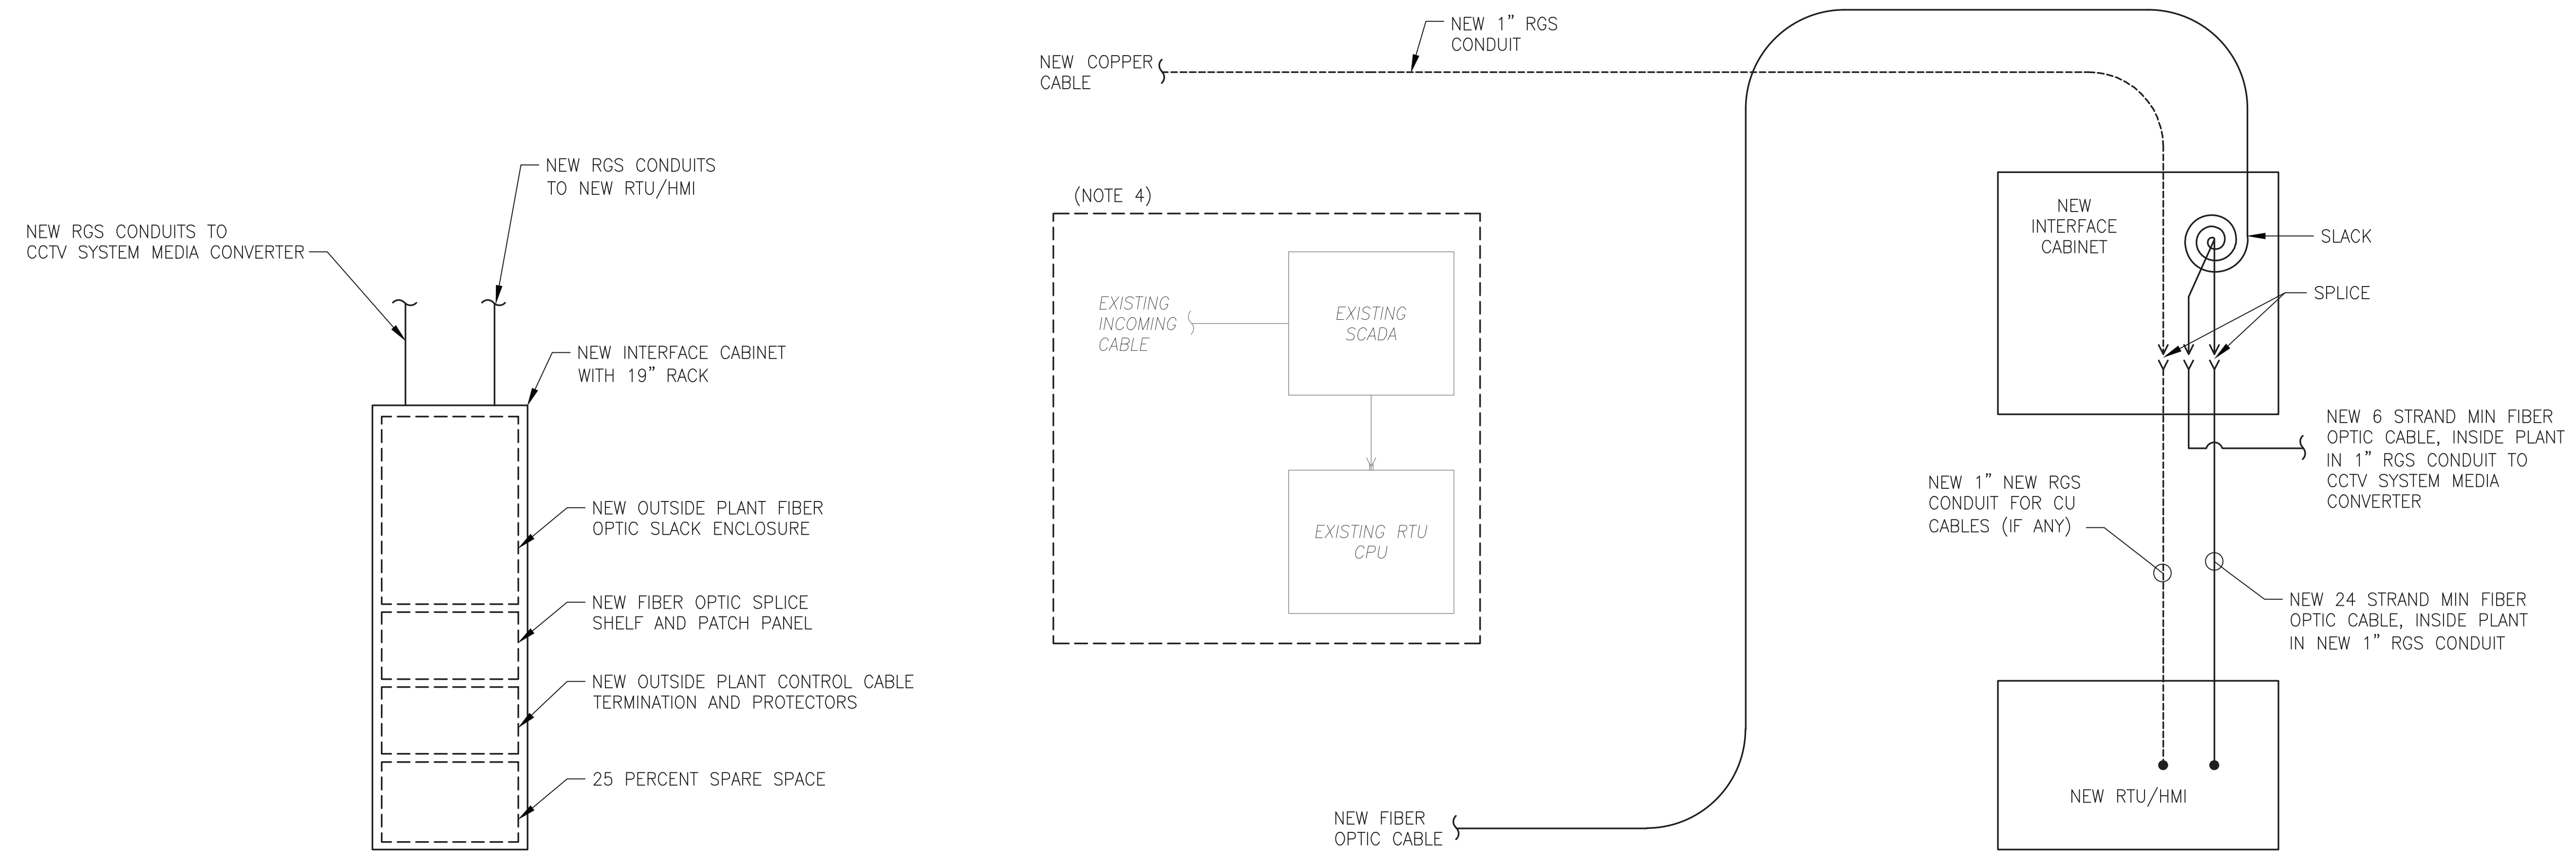

**1**  
COM407  
COM/INTERFACE CABINETS DETAIL  
ELEVATION VIEW  
N.T.S.

**2**  
COM407  
FIBER NODE DIAGRAM  
N.T.S.

50% SUBMISSION  
NOT FOR CONSTRUCTION

C:\PI\WORKING\PI\17\17AN-COM407.DWG

DATE PRINTED: 10/21/2025  
STATUS: 50% SUBMISSION