OEH&E Field Office
Indian Health Service
1201 Heritage Circle
Pawnee, OK 74058
Work#: (918) 762-6581
Fax#: (918) 762-3435

Latitude: *36.21510N*

Longitude: *-96.09596W*

O.Clark SR# 4478

CONTACT OKIE @
1-405/840-5032 or
1-800/522-6543

N

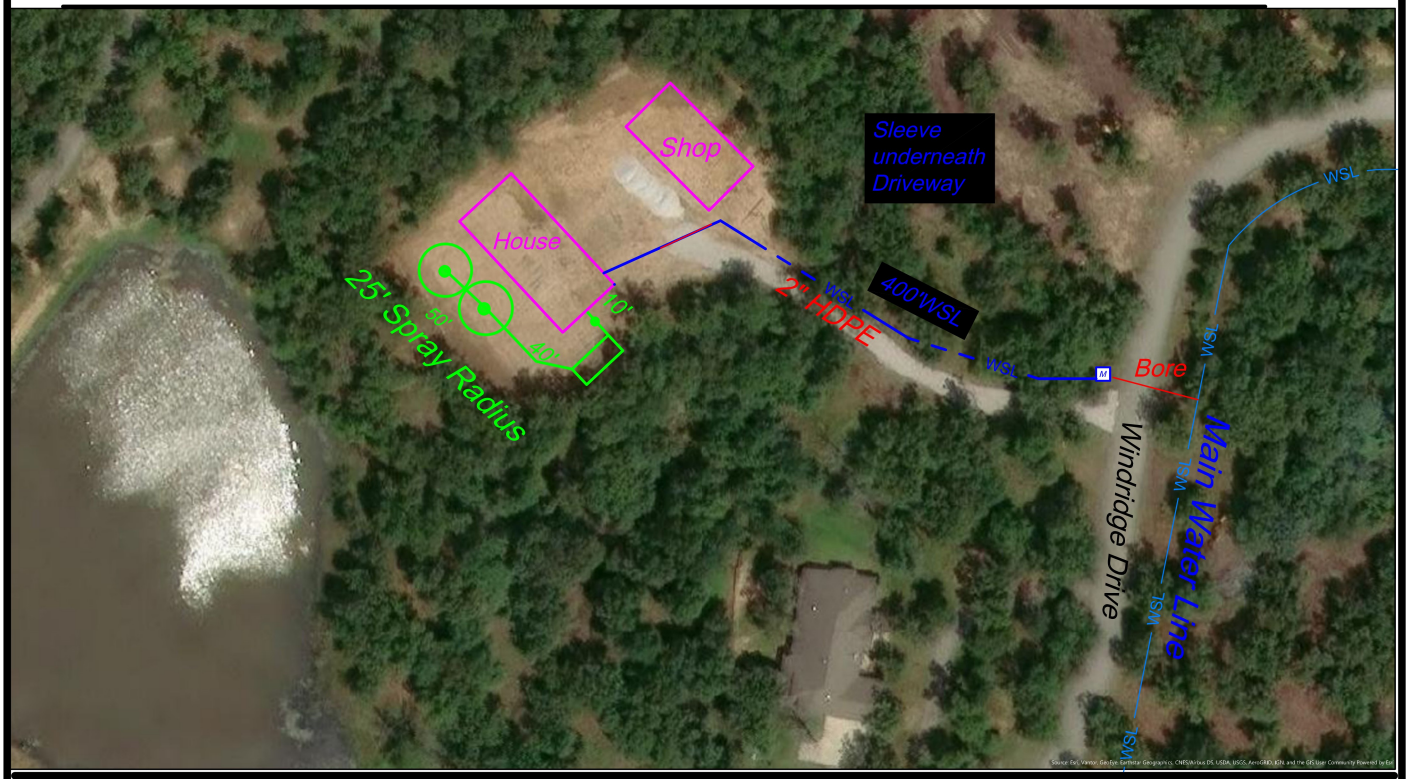

SANITATION FACILITIES DESIGN & LOCATION

[ ] AS-BUILT
[X] PROPOSED

NAME DATE

DRAWN BY: *CHouston* *2/25/2026*
REVIEWED BY: _____ _____
APPROVED BY: Caylen J. Willingham -S Digitally signed by Caylen J. Willingham -S Date: 2026.04.01 14:10:59 -05'00' _____

[ ] COMMUNITY SEWER NAME: _____

[ ] ON-SITE SEWER Soil Profile BY: _____ DATE PROFILED: _____

SOIL CLASSIFICATION: _____ # OF BEDROOMS: *3*

[X] AEROBIC SYSTEM:: Sprinkler Area (ft,) *3531* Pump Tank Size (gal.) *700*

[ ] DRAINFIELD TOTAL LENGTH _____ TRENCH WIDTH _____ MATERIAL _____

[ ] LAGOON TOTAL DEPTH _____ LENGTH _____ WIDTH _____

[X] SEPTIC TANK CAPACITY *1000* SHAPE _____ MATERIAL *Concrete*

[X] COMMUNITY WATER NAME *Sand Springs Water*

[ ] ON-SITE WATER DRILLED BY _____ DATE DRILLED _____

DEPTH _____ YIELD _____ S.W.L. _____ DRAWDOWN _____

WELL CASING DEPTH _____ DIAMETER _____ MATERIAL _____

PUMP MAKE _____ MODEL _____ MOTOR SIZE _____

[ ] CISTERN CAPACITY _____ SHAPE _____ MATERIAL _____

DIRECTIONS TO SITE: *From Hwy 97 N, to Windridge Dr,on Windridge drive 160' to house.*

NAME *Orrin Clark* ADDRESS *9055 Windridge Drive Sand Springs, OK 74063*

COUNTY *Osage* PROPERTY DESCRIPTION *Sec9-T10N-R10W*

PROJECT # 22-20I PROJECT DESCRIPTION *New Aerobic System, WSL, Tap*